

Cleveland ES Intrusion Alarm Replacement

STOCKTON UNIFIED SCHOOL DISTRICT

05/17/17

ADDENDUM #1

FROM : David Varela
Facilities Planning Technician
Stockton Unified School District

PROJECT : Cleveland ES Intrusion Alarm Replacement

LOCATION : 20 E. Fulton, Stockton, CA 95204

THS REF. # : FP2017-020 AD#1

OWNER : Stockton Unified School District
1944 North El Pinal. Stockton, CA 95205

DATE : 5/17/2017

NOTICE TO ALL BIDDERS

IT IS THE PURPOSE AND INTENT OF THIS ADDENDUM TO MODIFY AND/OR CLARIFY THE DRAWINGS AND SPECIFICATIONS FOR THIS PROJECT AND THIS ADDENDUM SHALL BECOME A PART OF THE CONTRACT DOCUMENTS. THESE CHANGES AND/OR INTERPRETATIONS SHALL BE INCORPORATED INTO YOUR BID.

Item 1. Door Contacts – Door Contacts will be located on exterior doors in the area of the key pad. 1. The main entry at the Administration Building. 2. The back door at the kitchen next to keypad. See E3.3.1 attached

Item 2. Plans state to remove all existing conduits and pathways. You may use existing conduits and pathways as allowed by code.

Item 3. Is the Head Start building Included?
No, the Head Start building is not included in the project.

Item 4. Specification; 28 16 00 Intrusion Alarm.

1.2 WORK INCLUDED. Provide a complete addressable, multiplexed Intrusion Alarm System including all necessary wire, cable, equipment and accessories. Provide keypads for arming and disarming system both locally and globally. Interfaces to the Intrusion system will include the Intercom system and a 60-min activation of the lighting panel. An alarm generated by the intrusion panel will have a programmed delayed audible signal through the intercom system, a programmed delayed response by the lighting panel / contractor; provide immediate alarm to the monitoring company and direct cameras in the vicinity to activate a preset routine. Any omission in specified equipment will not relieve contractor of responsibility for furnishing a complete functioning system.

Cleveland ES Intrusion Alarm Replacement

STOCKTON UNIFIED SCHOOL DISTRICT

05/17/17

ADDENDUM #1

ITEM 5. Quotes are due Wednesday, May 24, 2017 by 3:00 PM – You may fax or email your quotes. Email; dvarela@stocktonusd.net or fax to 209-933-7046

ITEM 6. Provide alternate price for wireless devices in Portable units B/C, units E-I and unit D if no current pathway is available. (See page E3.4)

END OF ADDENDUM #1

David Varela – SUSD Planning Technician



HARRY A. YEE & ASSOCIATES, INC.
ELECTRICAL ENGINEERS
4920 FREEMONT BLVD., SUITE D
SACRAMENTO, CALIFORNIA 95822
TEL: 916-484-5318
FAX: 916-484-4117
MVA Lic. #15589 INT.

CLEVELAND
ELEMENTARY
SCHOOL
20 E. FULTON ST.
STOCKTON, CA 95204

INTRUSION
ALARM
REPLACEMENT

STOCKTON UNIFIED
SCHOOL DISTRICT

COMMUNITY ARCHITECTURE PROJECT
NUMBER: 2016-013.00

BID SET APRIL 24, 2017

ADMINISTRATION &
MP SIGNAL FLOOR
PLANS


E3.3.1

CONSTRUCTION NOTES:


- 1 NOT USED.
- 2 NOT USED.
- 3 NOT USED.
- 4 CONNECT TO THE SAME CIRCUIT BREAKER THAT POWERED THE EXISTING IAP.
- 5 NOT USED.
- 6 MOUNT JUNCTION BOX HIGH ON MALL.

**CONDUIT & WIRE
SCHEDULE**

- 1 3/4" MTC
- 2 1" MTC

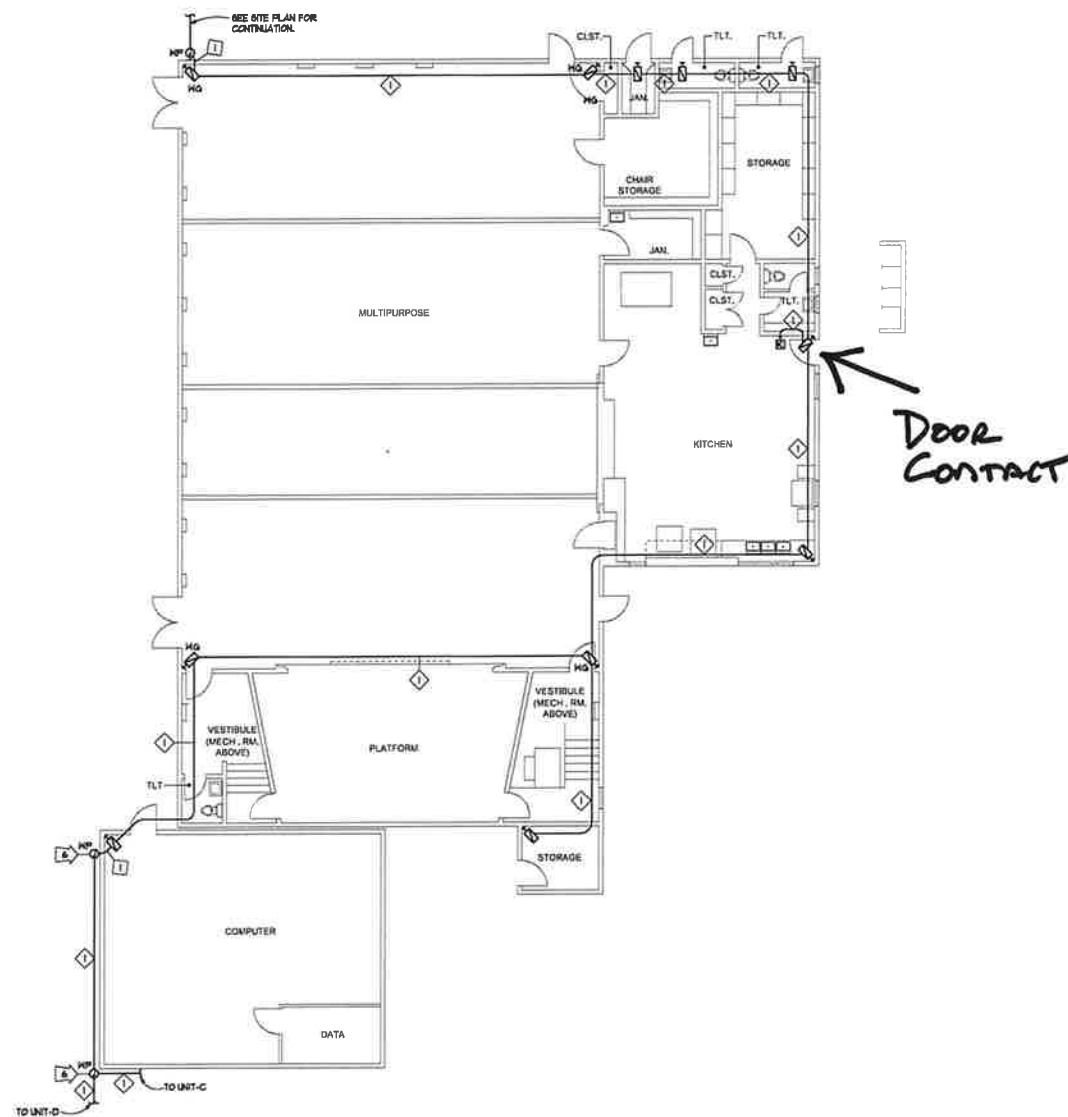

B
E3.3
MULTIPURPOSE
SIGNAL FLOOR PLAN
SCALE: 1/8" = 1'-0"

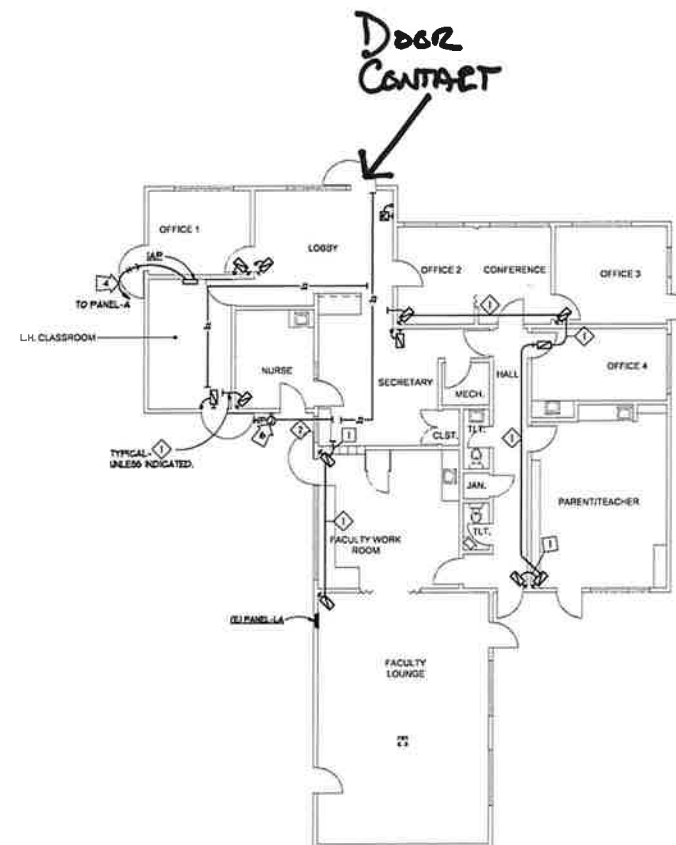

A
E3.3
ADMINISTRATION
SIGNAL FLOOR PLAN
SCALE: 1/8" = 1'-0"

