

Plot Date: 11/1/2024 12:11:07 PM
\\tetr-file1\Users\dylan.seaton_TET\Documents\12899-A-STOCKTON PEYTON ELEM ELOP.dylan.seaton\FLU7Z.rvt




ELOP RELOCATABLE CLASSROOM BUILDING

AT PEYTON ELEMENTARY SCHOOL

STOCKTON UNIFIED SCHOOL DISTRICT




IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC. 
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

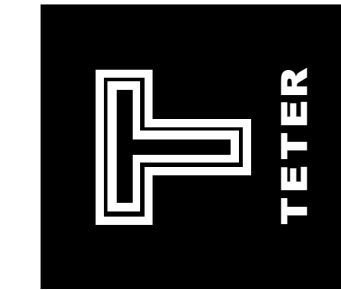

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
COVER

PROJECT NO.
23-12899

DRAWING

G000

FILE NO.: 39-69

PTN: 68676-313

APP: 02-122690

PROJECT ADDRESS

2525 GOLD BROOK DRIVE
STOCKTON, CA 95212

PROJECT DESCRIPTION

THE PROJECT SHALL CONSIST OF THE FOLLOWING ITEMS HEREIN TO INCLUDE BUT NOT NECESSARILY LIMITED TO:

- (1) NEW 36'X40' STOCKPILE #04-123793 APPROVED RELOCATABLE CLASSROOM BUILDING 'G' PURCHASED UNDER A SEPARATE CONTRACT BETWEEN THE DISTRICT AND CLASS LEASING.
- ASSOCIATED SITE WORK.
- SEE SPECIFICATION SECTION "MULTIPLE CONTRACT SUMMARY" FOR ADDITIONAL INFORMATION

MODULAR MANUFACTURER SHALL BE RESPONSIBLE FOR:

- CONSTRUCTION OF RELOCATABLE BUILDING OFF SITE AND DELIVERY TO SITE.
- WELD PLATES WILL BE PROVIDED BY CLASS LEASING AND DELIVERED TO SITE CONTRACTOR PRIOR TO DELIVERY OF BUILDING.
- FIRE RISER AND TRANSITION WILL BE PROVIDED AND DELIVERED TO SITE CONTRACTOR

SITE CONTRACTOR SHALL BE RESPONSIBLE FOR:

- PREPARATION OF EXISTING SITE INCLUDING EXCAVATION AND REMOVAL OF SOIL IN PREPARATION FOR PIT-SET BUILDING WITH CONCRETE FOUNDATION AND ASSOCIATED SITE WORK INCLUDING UTILITIES.
- CONCRETE FOOTINGS AND REINFORCEMENT AS INDICATED ON THE RELOCATABLE DRAWINGS.
- OFF-LOADING OF CLASSROOM RELOCATABLE MODULES FROM DELIVERY VEHICLES, INSTALLING ON CONCRETE FOUNDATION AND ALL REQUIRED CONNECTIONS AS INDICATED ON THE RELOCATABLE DRAWINGS.
- SIGNAGE AND EXTERIOR AND INTERIOR FINISHES AS INDICATED IN THE CONSTRUCTION DOCUMENTS
- CONNECTION AND START UP OF UTILITIES INCLUDING FIRE ALARM.
- INSTALLATION OF FIRE RISER AND ALL OTHER CONNECTIONS AS INDICATED IN THE CONSTRUCTION DOCUMENTS

PRIOR TO SHIPPING OF MODULAR BUILDINGS AT THE SITE PER STOCKPILE APPLICATION 04-123793, THE TEAM MUST SUBMIT TO DSA THE IN-PLANT INSPECTOR INSPECTION CARD, AND VERIFIED REPORT FROM DSA 152-JPL FOR THE STOCKPILE. APPLICATION UPLOADED TO DSA BOX.

PROJECT DESCRIPTION

ENFORCING AGENCY

DIVISION OF THE STATE ARCHITECT (DSA), SACRAMENTO OFFICE.
AMERICAN WITH DISABILITIES ACT AND THE CALIFORNIA TITLE 24 ACCESSIBILITY GUIDELINES

FLOOD ZONE INFORMATION

FLOOD ZONE DESIGNATION: ZONE X
AREA WITH REDUCED FLOOD RISK DUE TO LEVEE.
FLOOD INSURANCE RATE MAP (FIRM) PANEL DESIGNATION: 0607C0320F PANEL
EFFECTIVE DATE OF (FIRM): OCTOBER 16, 2009
BASE FLOOD ELEVATION (BFE): NOT REQUIRED
APPLICABLE COMMUNITY ORDINANCE SECTION: NOT REQUIRED

AGENCY & FLOOD ZONE INFORMATION

NOTE TO CONTRACTOR:

THE CALIFORNIA ENERGY CODE SECTION 10-103 REQUIRES ACCEPTANCE TESTING ON ALL NEWLY INSTALLED LIGHTING CONTROLS, MECHANICAL SYSTEMS, ENVELOPES, AND PROCESS EQUIPMENT AFTER INSTALLATION AND BEFORE PROJECT COMPLETION. AN ACCEPTANCE TEST IS A FUNCTIONAL PERFORMANCE TEST TO HELP ENSURE THAT NEWLY INSTALLED EQUIPMENT IS OPERATING AND IN COMPLIANCE WITH THE ENERGY CODE.

LIGHTING CONTROLS ACCEPTANCE TESTS MUST BE PERFORMED BY A CERTIFIED LIGHTING CONTROLS ACCEPTANCE TEST TECHNICIAN (ATT).

MECHANICAL SYSTEM ACCEPTANCE TESTS MUST BE PERFORMED BY A CERTIFIED MECHANICAL ATT FOR PROJECTS SUBMITTED ON OR AFTER OCTOBER 1, 2021.

ENVELOPE AND PROCESS EQUIPMENT ACCEPTANCE TESTS SHALL BE PERFORMED BY INSTALLING CONTRACTOR, ENGINEER/ARCHITECT OF RECORD OR THE OWNER'S AGENT.

A LISTING OF CERTIFIED ATTS CAN BE FOUND AT [HTTPS://WWW.ENERGY.CA.GOV/PROGRAMS-AND-TOPICS/PROGRAMS/ACCEPTANCE-TEST-TECHNICIAN-CERTIFICATION-PROVIDER-PROGRAM/ACCEPTANCE](https://www.energy.ca.gov/programs-and-topics/programs/acceptance-test-technician-certification-provider-program/acceptance)

THE ACCEPTANCE TESTING PROCEDURES MUST BE REPEATED, AND DEFICIENCIES MUST BE CORRECTED BY THE BUILDER OR INSTALLING CONTRACTOR UNTIL THE CONSTRUCTION/INSTALLATION OF THE SPECIFIED SYSTEMS CONFORM AND PASS THE REQUIRED ACCEPTANCE CRITERIA.

PROJECT INSPECTORS WILL COLLECT THE FORMS TO CONFIRM THAT THE REQUIRED ACCEPTANCE TESTS HAVE BEEN COMPLETED.

ACCEPTANCE TESTING

FIRST TIME RELOCATION DIRECTLY FROM THE STOCKPILE

THE FOLLOWING DOCUMENTS SHALL BE ON THE JOBSITE PRIOR TO INSTALLATION OF THE UNIT(S):

- IN-PLANT VERIFIED REPORT
- LABORATORY VERIFIED REPORT
- WELDING VERIFIED REPORT

THE SITE INSPECTOR SHALL VERIFY THE ABOVE DOCUMENTS AND SERIAL NUMBERS ARE APPLICABLE TO EACH UNIT PRIOR TO INSTALLATION OF THE UNIT(S).

NOTIFY ARCHITECT AND THE DIVISION OF THE STATE ARCHITECT FIELD ENGINEER IF ANY DISCREPANCIES OCCUR.

IN-PLANT INSPECTOR AND MANUFACTURER SHALL FOLLOW THE REQUIREMENTS OF DSA IR16-1.13 AND INCLUDE THE FOLLOWING INFORMATION ON ID TAG OF SHOP FABRICATED RELOCATABLE STRUCTURE:

- THE DSA APPLICATION NUMBER AND CBC EDITION UNDER WHICH THE BUILDING CONSTRUCTION WAS AUTHORIZED;
- THE MANUFACTURER OR BUILDER'S NAME;
- THE SERIAL NUMBER;
- THE DESIGN CLIMATE ZONES;
- THE DESIGN LIVE LOADS FOR THE ROOF AND FLOOR;
- THE DESIGN WIND SPEED AND EXPOSURE CATEGORY;
- THE SEISMIC DESIGN PARAMETER S_s.

DETERIORATION OR EXISTING NON-COMPLIANT CONSTRUCTION:

IF ANY CONDITION IS DISCOVER WHICH, IF LEFT UNCORRECTED, WOULD MAKE THE BUILDING NON-COMPLIANT WITH THE REQUIREMENTS OF THE EDITION OF THE CBC IN FORCE AT THE TIME OF ORIGINAL CONSTRUCTION, THE CONDITION MUST BE CORRECTED IN ACCORDANCE WITH CURRENT CODE REQUIREMENTS. A CONSTRUCTION CHANGE DOCUMENT (CCD) OR A SEPARATE SET OF PLANS AND SPECIFICATIONS DETAILING AND SPECIFYING THE REQUIRED REPAIR WORK SHALL BE SUBMITTED TO AND APPROVED BY DSA BEFORE PROCEEDING WITH THE REPAIR WORK.

MODULAR MANUFACTURER BUILDING

2022 CALIFORNIA ADMINISTRATIVE CODE (CAC), PART 1, TITLE 24 C.C.R.
2022 CALIFORNIA BUILDING CODE (CBC), PART 2, TITLE 24 C.C.R.
2022 CALIFORNIA ELECTRICAL CODE (CEC), PART 3, TITLE 24, C.C.R.
2022 CALIFORNIA MECHANICAL CODE (CMC), PART 4, TITLE 24 C.C.R.
2022 CALIFORNIA PLUMBING CODE (CPC), PART 5, TITLE 24 C.C.R.
2022 CALIFORNIA ENERGY CODE (CAC), PART 6, TITLE 24 C.C.R.
2022 CALIFORNIA FIRE CODE (CFC), PART 9, TITLE 24 C.C.R.
2022 CALIFORNIA EXISTING BUILDING CODE (CEBC), PART 10, TITLE 24 C.C.R.
2022 CALIFORNIA GREEN BUILDING STANDARDS CODE (CALGREEN), PART 11, TITLE 24 C.C.R.
2022 CALIFORNIA REFERENCED STANDARDS CODE, PART 12, TITLE 24,
TITLE 19 C.C.R., PUBLIC SAFETY, STATE FIRE MARSHAL REGULATIONS

- NFPA 13 STANDARD FOR THE INSTALLATION OF SPRINKLER SYSTEMS (CA AMENDED) 2022 EDITION
- NFPA 14 STANDARD FOR THE INSTALLATION OF STANDPIPE AND HOSE SYSTEM (CA AMENDED 2022 EDITION
- NFPA 17 STANDARD FOR DRY CHEMICAL EXTINGUISHING SYSTEMS 2021 EDITION
- NFPA 17A STANDARD FOR WET CHEMICAL EXTINGUISHING SYSTEMS 2021 EDITION
- NFPA20 STANDARD FOR THE INSTALLATION OF STATIONARY PUMPS FOR FIRE PROTECTION 2019 EDITION
- NFPA 22 STANDARD WATER TANKS FOR PRIVATE FIRE PROTECTION 2018 EDITION
- NFPA 24 STANDARD FOR THE INSTALLATION OF PRIVATE FIRE SERVICE MAINS AND THEIR APPURTENANCES (CA AMENDED) 2022 EDITION
- NFPA 72 NATIONAL FIRE ALARM AND SIGNALING CODE (CA AMENDED) 2022 EDITION
- NFPA 80 STANDARD FOR FIRE DOORS AND OTHER OPENING PROTECTIVES 2019 EDITION
- NFPA 2001 STANDARD ON CLEAN AGENT FIRE EXTINGUISHING SYSTEM (CA AMENDED) 2018 EDITION
- UL 300 STANDARD FOR FIRE TESTING OF FIRE EXTINGUISHING SYSTEM FOR PROTECTION OF COMMERCIAL COOKING EQUIPMENT 2005 (R2014)
- UL 464 AUDIBLE SIGNALING DEVICES FOR FIRE ALARM AND SIGNALING SYSTEMS, INCLUDING ACCESSORIES 2003 EDITION
- UL 521 STANDARD FOR HEAT DETECTORS FOR FIRE PROTECTIVE SIGNALING SYSTEMS 1999 EDITION (R2005)
- UL 1971 STANDARD FOR SIGNALING DEVICES FOR THE HEARING IMPAIRED (2024 EDITION)
- ICC 300 STANDARD FOR BLEACHERS, FOLDING AND TELESCOPIC SEATING, AND GRANDSTANDS 2017 EDITION

FOR A COMPLETE LIST OF APPLICABLE NFPA STANDARDS REFER TO 2022 CBC (SFM) CHAPTER 35 AND CALIFORNIA FIRE CODE (CFC) CHAPTER 80.

SEE CALIFORNIA BUILDING CODE, CHAPTER 35, FOR STATE OF CALIFORNIA AMENDMENTS TO THE NFPA STANDARDS.

GOVERNING CODES

GENERAL NOTES

STATEMENT OF GENERAL CONFORMANCE

FOR ARCHITECTS/ENGINEERS WHO UTILIZE PLANS, INCLUDING BUT NOT LIMITED TO SHOP DRAWINGS, PREPARED BY OTHER LICENSED DESIGN PROFESSIONALS AND/OR CONSULTANTS.

APPLICATION NO: 02-122690 FILE NO: 39-69

THE DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX SHEET

HAVE BEEN PREPARED BY OTHER DESIGN PROFESSIONALS OR CONSULTANTS WHO ARE LICENSED AND/OR AUTHORIZED TO PREPARE SUCH DRAWINGS IN THIS STATE. IT HAS BEEN EXAMINED BY ME FOR:

- DESIGN INTENT AND APPEARS TO MEET THE APPROPRIATE REQUIREMENTS OF TITLE 24, CALIFORNIA CODE OF REGULATIONS AND THE PROJECT SPECIFICATIONS PREPARED BY ME, AND


- COORDINATION WITH MY PLANS AND SPECIFICATIONS AND IS ACCEPTABLE FOR INCORPORATION INTO THE CONSTRUCTION OF THIS PROJECT.

THE STATEMENT OF GENERAL CONFORMANCE "SHALL NOT BE CONSTRUED AS RELIEVING ME OF MY RIGHTS, DUTIES, AND RESPONSIBILITIES UNDER SECTIONS 17302 AND 81138 OF THE EDUCATION CODE AND SECTIONS 4-336, 4-341, AND 4-344" OF TITLE 24, PART I.

I CERTIFY THAT:

- ☒ ALL DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX
- ☐ THIS DRAWING OR PAGE

IS/ARE IN GENERAL CONFORMANCE AND HAVE BEEN COORDINATED WITH THE PROJECT PLANS AND SPECIFICATIONS


ARCHITECT'S SIGNATURE DATE 7-31-24
JAMIE HICKMAN
ARCHITECT/PARTNER
TETER, INC.
C23801 07-31-25
LICENSE NUMBER EXPIRATION DATE

ARCHITECT'S STATEMENT

WIND DESIGN DATA [2022 CBC 1603A.1.4]



- ULTIMATE DESIGN WIND SPEED V=93 MPH
- RISK CATEGORY II
- WIND EXPOSURE CATEGORY C

EARTHQUAKE DESIGN DATA [2022 CBC 1603A.1.5]

SITE COORDINATES: 38.0005504° N, -121.2741476° W

- RISK CATEGORY II
- SEISMIC IMPORTANCE FACTOR I_e = 1
- MAPPED SPECTRAL RESPONSE ACCELERATION PARAMETERS
S_s = 0.687g S₁ = 0.274g
- SITE CLASS D=(Default)
- DESIGN SPECTRAL RESPONSE ACCELERATION PARAMETERS
S_{DS} = 0.573g S_{D1} = null (Only for Calculation of Ts)
- SITE AMPLIFICATION Fa = 1.2
- SEISMIC DESIGN CATEGORY - D

WIND / SEISMIC DESIGN DATA

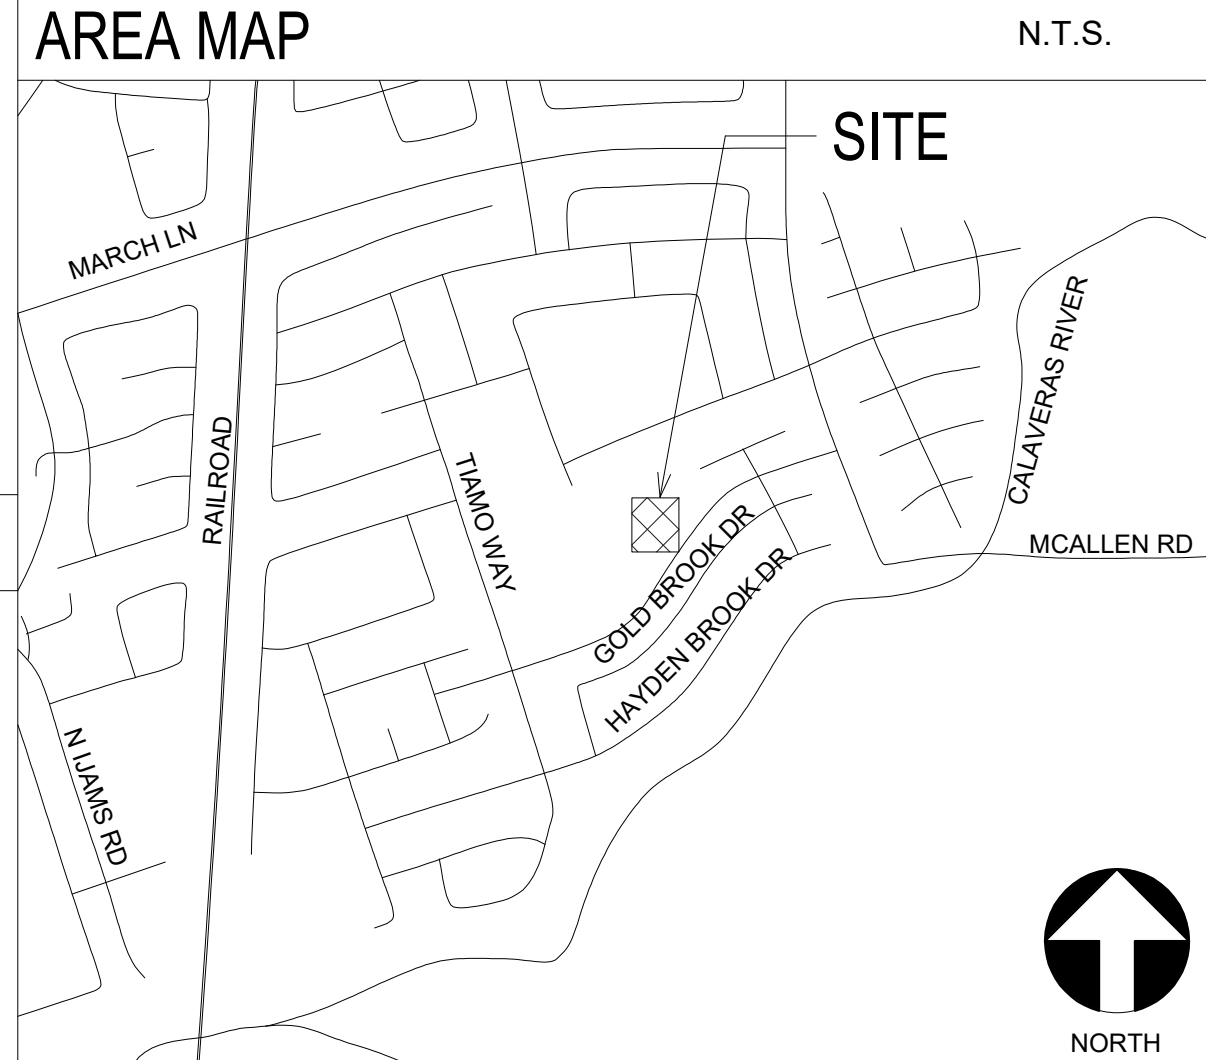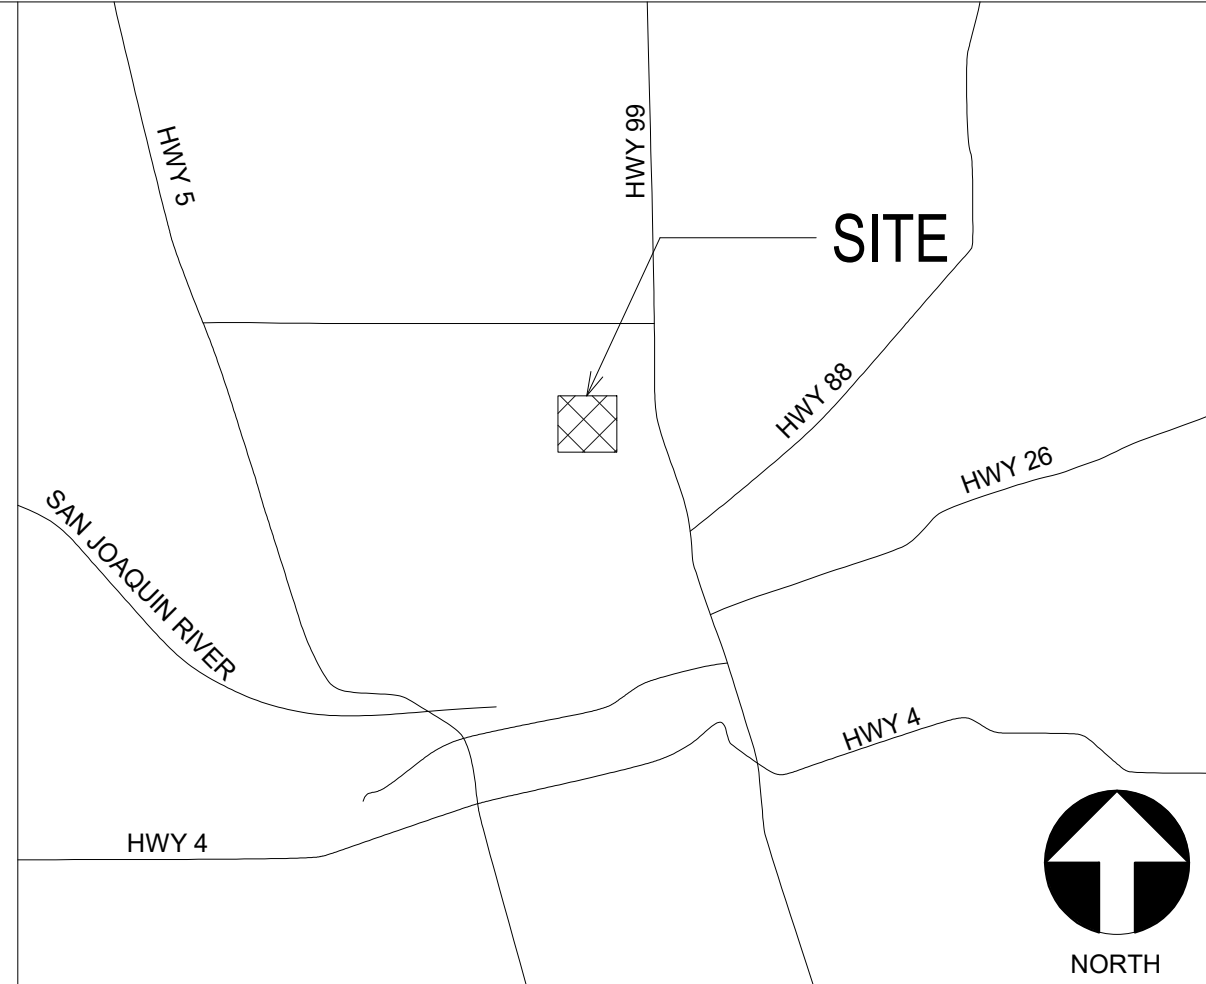

- N/A

DEFERRED SUBMITTALS

PROJECT DIRECTORY

OWNER
STOCKTON UNIFIED SCHOOL DISTRICT

56 SOUTH LINCOLN ST.
STOCKTON, CA 95203
(209) 933-7045

CONTACT: VICKIE BRUM

EMAIL: vbrum@stocktonusd.net

PROJECT ARCHITECT
TETER, INC.

7535 N. PALM AVE., SUITE 201
FRESNO, CA 93711
(559) 437-0887

CONTACT: JAMIE HICKMAN

E-MAIL: jamie.hickman@teterae.com

CIVIL ENGINEER
NORTHSTAR ENGINEERING GROUP

620 12TH ST.
MODESTO, CA 95354
(209) 524-3525

CONTACT: CHRISTIAN GRAJEDA

EMAIL: cgrajeda@nseng.net

LANDSCAPE ARCHITECT
DAVID BIGLER ASSOCIATES

516 W. SHAW AVE, SUITE 101
FRESNO, CA 93704
(559) 276-9495

CONTACT: DAVE BIGLER

EMAIL: davebigler@aol.com

ELECTRICAL ENGINEER
TETER, INC.

7535 N. PALM AVE., SUITE 201
FRESNO, CA 93711
(559) 437-0887

CONTACT: JASON MARCH

E-MAIL: jason.march@teterae.com

GENERAL		ELECTRICAL	
G000	COVER	E100	ELECTRICAL SITE PLAN
G001	SHEET INDEX	E200	ENLARGED POWER & LIGHTING PLAN
G100	OVERALL SITE PLAN-FIRE AUTHORITY	E400	ENLARGED SIGNAL PLAN
		E500	ENLARGED FIRE ALARM PLAN
CIVIL		E600	ELECTRICAL DETAILS & DIAGRAMS
C1.1	COVER SHEET	E710	FIRE ALARM RISER DIAGRAM & CALCULATIONS
C1.2	LEGEND AND ABBREVIATIONS	E800	ELECTRICAL LEGEND, NOTES, & SCHEDULES
C1.3	GENERAL NOTES AND SPECIFICATIONS	E900	CALIFORNIA ENERGY COMPLIANCE FORMS
C1.4	DETAILS AND CROSS SECTIONS		
C1.5	DETAILS AND CROSS SECTIONS		
C2.1	TOPOGRAPHIC AND DEMOLITION PLAN	RELOCATABLE DRAWINGS: PC 04-123793	
C3.1	DIMENSION AND PAVING PLAN	A0.0	COVER SHEET
C4.1	GRADING AND DRAINAGE PLAN	A0.0.1	PROJECT OPTIONS SCHEDULE
C5.1	COMPOSITE UTILITY PLAN	A0.1	TYPICAL KEY PLAN AND SCHEDULES, GEN NOTES
C6.1	EROSION CONTROL PLAN	A0.2	SIGNAGE AND SYMBOLS
C6.2	EROSION CONTROL NOTES AND DETAILS	A0.3	DSA-103 T&I CONCRETE FLOORS
		A0.4	DSA-103 T&I PLYWOOD FLOORS
		A0.5	CALGREEN SPEC'S
LANDSCAPE		A0.6	CALGREEN CHECKLIST
L100	LANDSCAPE DEMOLITION PLAN	A0.7	CALGREEN CHECKLIST
L101	IRRIGATION DEMOLITION PLAN	A0.8	CALGREEN CHECKLIST
L200	LANDSCAPE PLANTING PLAN	A1.1	36x40 FLOOR PLAN
L201	LANDSCAPE IRRIGATION PLAN	A2.1(A)	ARCHITECTURAL DETAILS (WOOD FRAMING SHITG FINISH)
L202	LANDSCAPE IRRIGATION PLAN	A2.9	ARCHITECTURAL DETAILS (FLOOR)
L300	LANDSCAPE AND IRRIGATION DETAILS	A3.0.1	FIRE SEPARATION & PENETRATION DETAILS
L301	LANDSCAPE AND IRRIGATION DETAILS	A3.1	SINGLE OCC. BATHROOM
L302	LANDSCAPE AND IRRIGATION DETAILS	A3.2	RCP
		A3.2.1	CEILING NOTES
ARCHITECTURAL		A3.3	CEILING NOTES (T-GRID)
A000	LEGENDS AND ABBREVIATIONS	A4.0.1	ROOF PLAN MONO SLOPE (STANDING SEAM)
A100	OVERALL SITE PLAN	A4.1	ROOF DETAILS (STANDING SEAM)
A101	DEMOLITION AND PROPOSED PARTIAL SITE PLANS	A5.0	SIDEWALL ELEVATION
A102	DEMOLITION AND PROPOSED PARTIAL TRENCHING SITE PLANS	A5.1	ENDWALL ELEVATIONS
A103	DEMOLITION AND PROPOSED PARTIAL SITE PLANS	A5.2	INTERIOR ELEVATIONS
A104	PARTIAL SITE PLANS	A6.0	SECTION - STANDING SEAM (MONO)
A110	SITE DETAILS	A6.2	SECTION
A111	SITE DETAILS	A7.0	ADDITIONAL OPTION DETAILS
A200	FLOOR PLANS	A7.1	ADDITIONAL OPTION DETAILS
A201	PLUMBING FLOOR PLAN	A7.2	ADDITIONAL OPTION DETAILS
A202	VENTING FLOOR PLANS	E0.1	ELECTRICAL GENERAL NOTES
A300	EXTERIOR ELEVATIONS	E1.2	ELECTRICAL PLAN 36x40
A800	SIGNAGE DETAILS	E1.3	ELECTRICAL SCHEDULE 36x40
A801	EXTERIOR DETAILS (LAP SIDING)	M0.1	MISCELLANEOUS NOTES & DETAILS
A802	EXTERIOR DETAIL	M0.2	MISCELLANEOUS NOTES & DETAILS
		M2.9	24'x40' T24 CZ 14 (WALL AC)
		M2.10	24'x40' T24 CZ 14 (WALL AC)
		M2.11	24'x40' T24 CZ 14 (WALL AC)
		M2.12	24'x40' T24 CZ 14 (WALL AC)
		M2.13	24'x40' T24 CZ 14 (WALL AC)
		M2.14	24'x40' T24 CZ 14 (WALL AC)
		M3.3	ENVELOPE AND NOTES
		M6.1	MECHANICAL CEILING PLAN 36x40
		P1.0	TYPICAL PLUMBING DETAILS
		F2.10	CONCRETE FOUNDATION PLAN
		F2.20	CONCRETE FOUNDATION DETAILS
		F2.22	CONCRETE FOUNDATION DETAILS
		F2.23	CONCRETE FOUNDATION DETAILS
		S0.1	STRUCTURAL GEN NOTES
		S1.0.4	WD SHITG FLR FRAMING PLAN CROSS-STRAP OPT.
		S1.2	STRUCTURAL DETAILS (FLOOR)
		S3.0.3	MONO SLOPE ROOF FRM'G PLAN CROSS-STRAP OPT.
		S3.1	STRUCTURAL DETAILS (ROOF)
		S3.3	ROOF PERIMETER TRUSS
		S4.1	WD WALL FRAMING ELEVATION
		S4.2	WALL DETAILS (WOOD FRAMING)
		S4.4	TYP FRAMING
		S4.5	FRAMING SCHEDULES
		S5.0	LONG SECTION - MONO
		ALT-D1	SCHEDULES AND DETAILS
		ALT-01	FLOOR PLAN & REFLECTED CEILING PLAN
		ALT-02	ELECTRICAL PLAN & MECHANICAL PLAN
		ALT-03	ROOF PLAN & PLUMBING PLAN
		ALT-04	FIRE ALARM
		ALT-05	INTERIOR ELEVATIONS
		ALT-06	EXTERIOR ELEVATIONS
		FIRE SUPPRESSION	
		FP-1	FSP PIPING PLAN
		FP-2	DETAILS
		FP-3	HYDRAULIC PLAN
		FP-3.1	HYDRAULIC PLAN
TOTAL PAGES: 113			


PROJECT NO.

DRAWING

G001

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA

DRAWING TITLE
SHEET INDEX

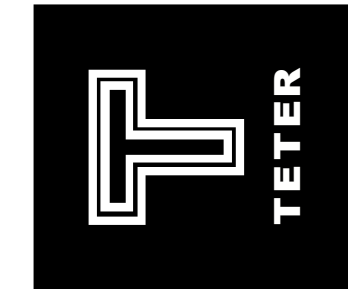

TETER, INC.

FRESNO HEADQUARTERS

VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO

ARCHITECTS ENGINEERS CONNECTED




B	07/31/2024	DSA SUBMITTAL	
MARK	DATE	DESCRIPTION	
C	11/01/2024	DSA BACK-CHECK SUBMITTAL	

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

IDENTIFICATION STAMP
IV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
S ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

\\net-file1\Users\dyLAN.seaton\PEYTON ELEM ELOP.dwg ELOP.dwg
PLOT DATE: 11/1/2024 12:11:14 PM

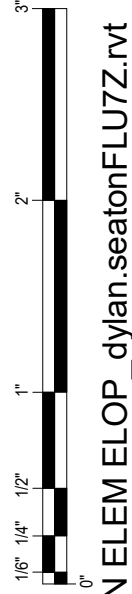


1" = 50'-0"

PROJECT NORTH NORTH

DATE: 05/15/2024
Requesting Company: TETER
Contact Name: DYLAN SEATON
Email: DYLAN.SEATON@TETERAE.COM
Telephone/FAX: 805.439.3353
Mailing Address: 7535 N. Palm Avenue Suite 201, Fresno, CA 93711
Project Name: PEYTON E.S. MODULAR CLASSROOM BUILDING
Project Location: 2525 GOLD BROOK DRIVE, STOCKTON, CA 95212
City use only below this line.
Fire Department Dist #: 408G
Nearest Flow Hydrant: 2525 Gold Brook
Water Main Size: 18"

FIRE FLOW TEST

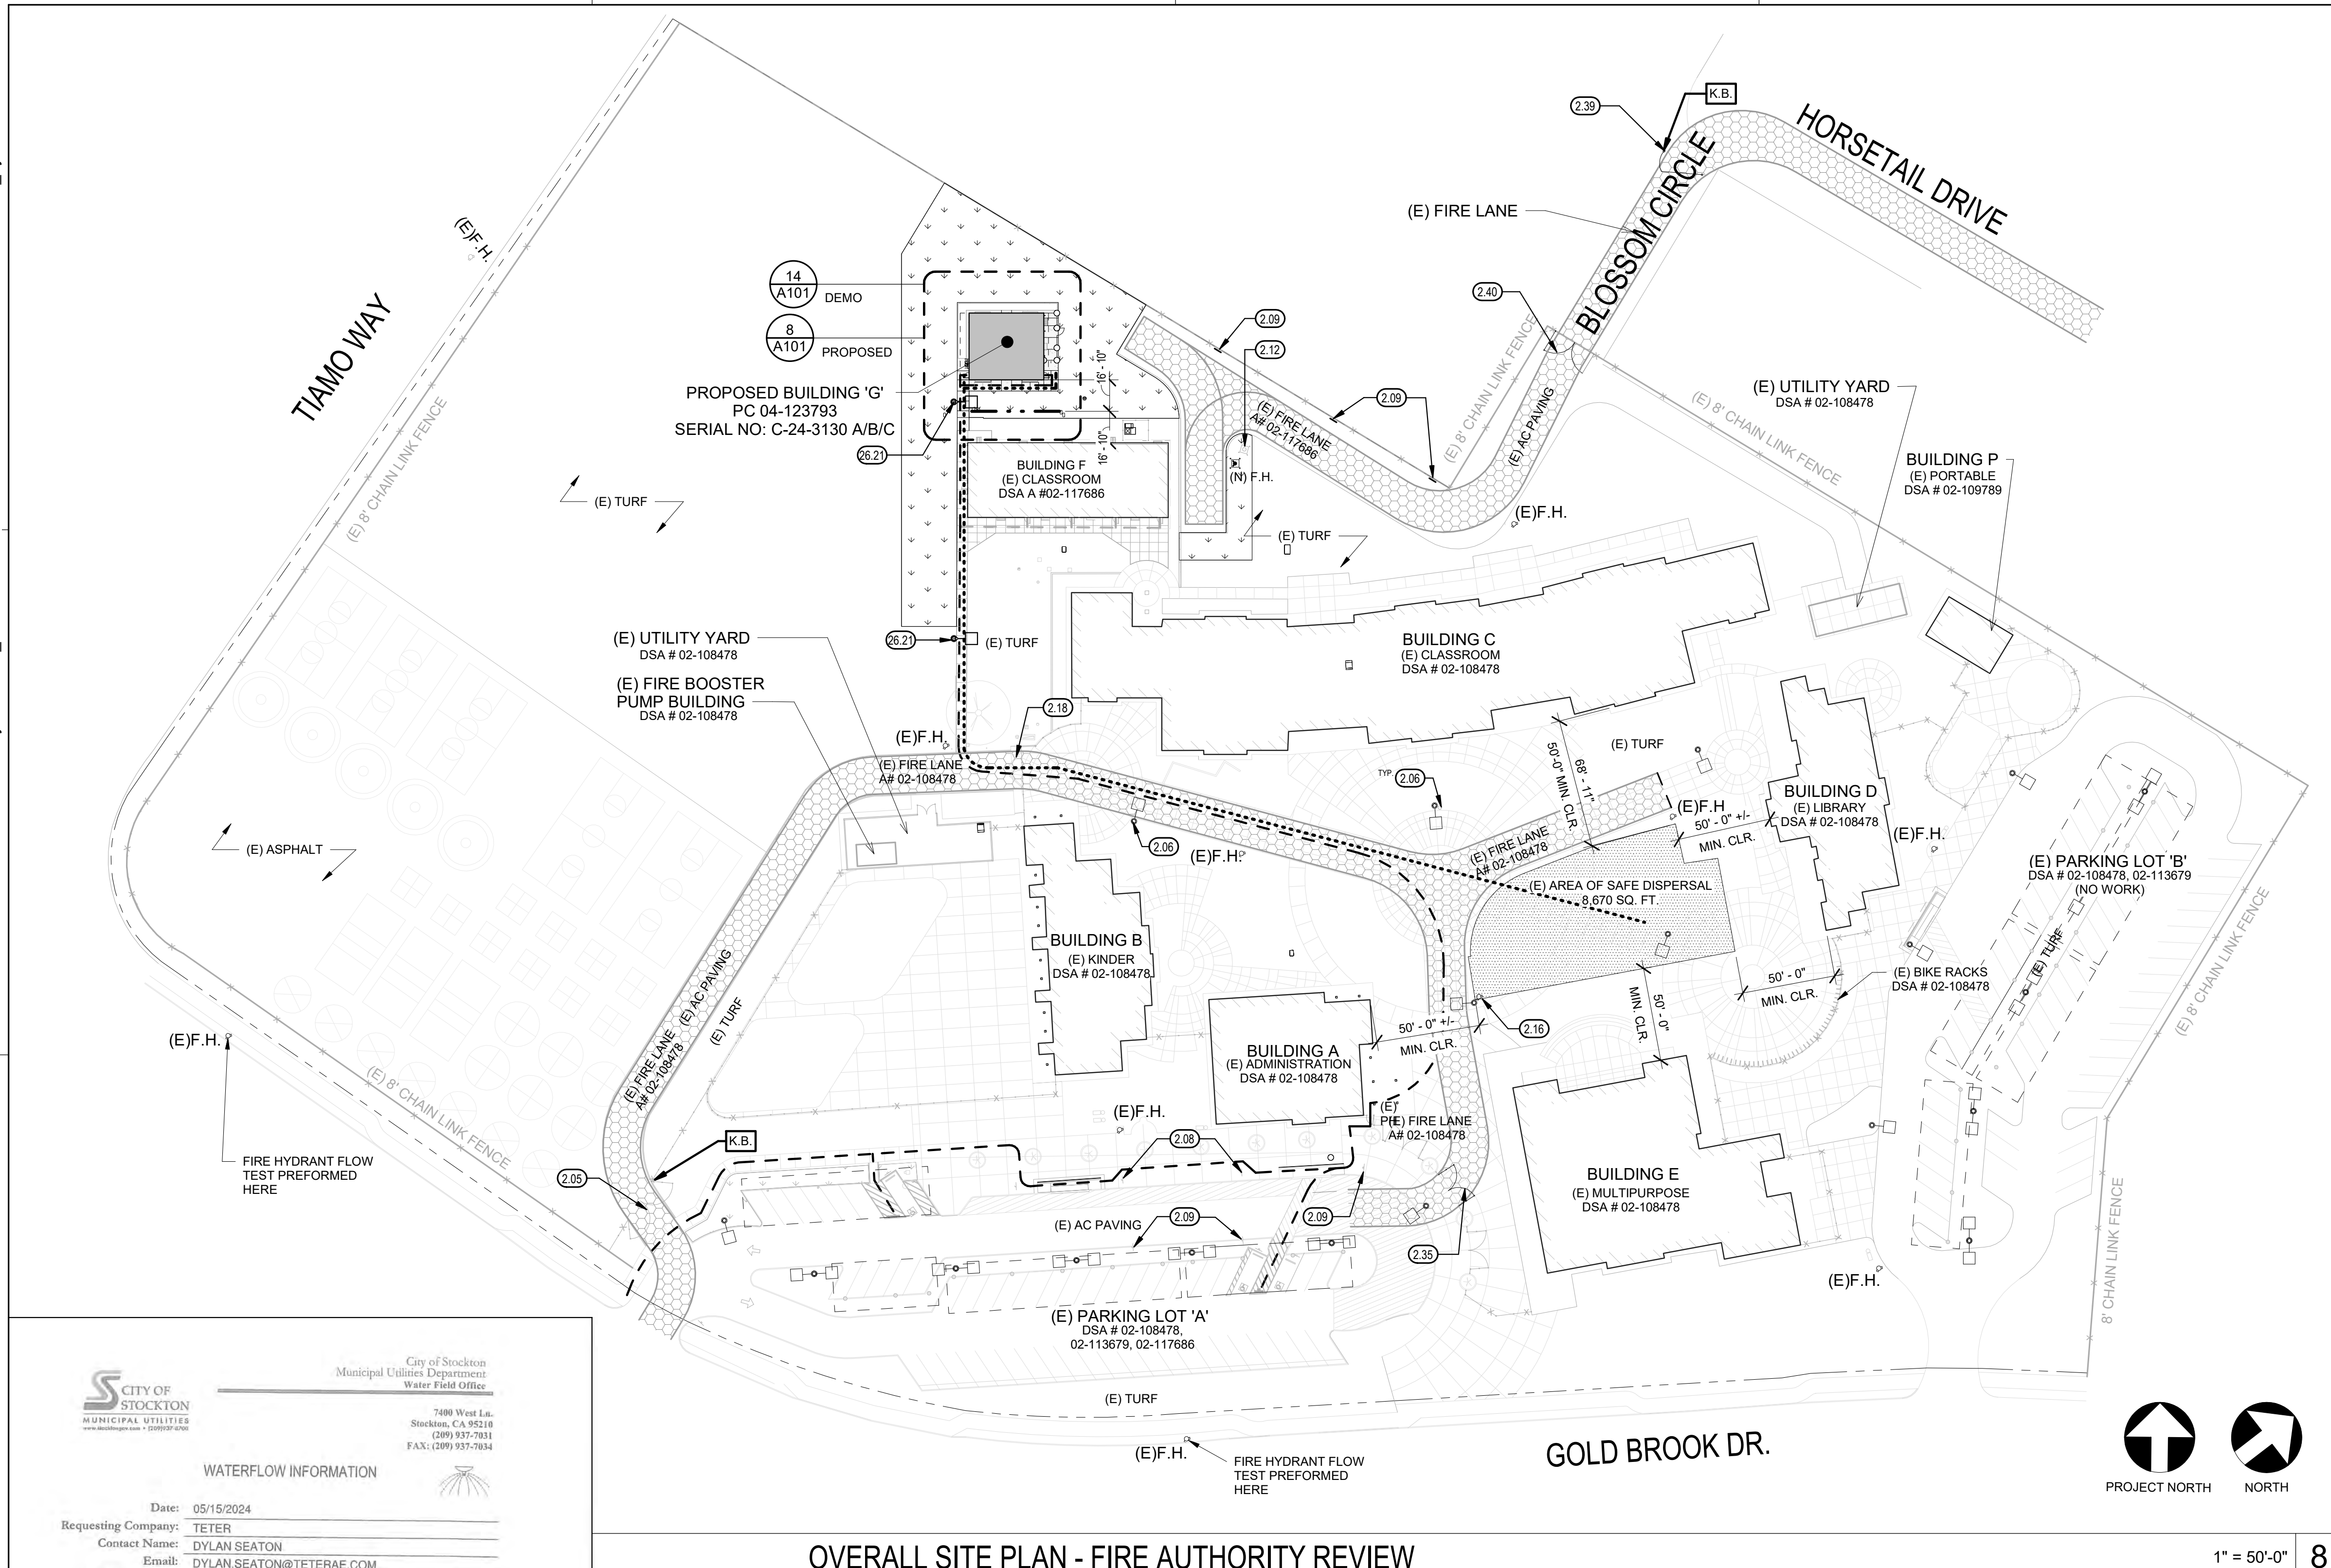

BUILDING SUMMARY				
BUILDING	SIZE	SQ. FT.	TYPE	OCC. LOAD (20 SF/OCC.)
BUILDING 'G'	36'X40'	1,440	V-B	52
FRONT OVERHANG	5'X36'	180		
REAR OVERHANG	2'-6"X36'	90		
TOTAL		1,710		52 OCCUPANTS

BUILDING SUMMARY		
APPLICATION NO.	TOTAL OCC. LOAD	REQ.D SF
02-108478	2,159 X 3 SF	6,447
02-117686	192 X 3 SF	579
UNDER THIS APP.	61 X 3 SF	183
MIN. TOTAL AREA REQUIRED		7,206
TOTAL AREA PROVIDED		8,670

BUILDING "G" CODE ANALYSIS	
CONSTRUCTION TYPE:	V-B
OCCUPANCY CLASSIFICATION:	MIXED USE OCCUPANCY E & B - NON SEPARATED
FIRE SPRINKLERS:	YES
ALLOWABLE STORIES, HEIGHT:	E & B = 3 STORIES 60'-0"
ACTUAL STORIES, HEIGHT:	1 STORIES 12'-6"
BUILDING AREA:	E = 1,300 S.F. B = 140 S.F.
TOTAL BUILDING AREA:	1,440 S.F.
W/COVERED AREA:	1,710 S.F.
ALLOWABLE AREA DETERMINATION	
TABULAR AREA FACTOR	B S - 36,000 S.F.
DETERMINATION: (OK)	1,440 S.F. < 36,000 S.F.

SITE INFORMATION	
EXISTING 20'-0" FIRE ACCESS LANE	
IMAGINARY LINES BETWEEN BUILDINGS	
PROPERTY LINE	
EXISTING CHAIN LINK FENCING, TYP	
EXIT DISCHARGE TO AREA OF SAFE DISPERSAL	
ACCESSIBLE ROUTE (2022 C.B.C. SECTION 11B-206)	
(E) FIRE HYDRANT	
NEW 6'-0" CHAIN LINK FENCE/GATE, SEE 5 / A111	
KNOX BOX @ CENTER 5'-0" ABV. GRADE	

KEYNOTES

- 2.05 EXISTING PAIR OF 12'-0" WIDE CHAIN LINK FIRE ACCESS GATES
- 2.06 EXISTING POLE MOUNTED LIGHT FIXTURE TO REMAIN
- 2.08 EXISTING 'LOADING ZONE ONLY' SIGN TO REMAIN (A# 02-108478)
- 2.09 EXISTING 'FIRE LANE - NO PARKING' SIGN TO REMAIN (A# 02-108478)
- 2.12 EXISTING FIRE DEPARTMENT CONNECTION TO REMAIN
- 2.16 EXISTING FIRE HYDRANT
- 2.18 EXISTING PAIR OF 12'-0" WIDE DECORATIVE METAL GATES TO REMAIN (GATES TO REMAIN OPEN DURING SCHOOL HOURS - NO LOCKS ON GATE)
- 2.35 EXISTING PAIR OF 10'-0" WIDE DECORATIVE METAL FIRE ACCESS GATES
- 2.39 EXISTING 20'-0" WIDE BAR GATE
- 2.40 EXISTING PAIR OF 12'X 8' CHAIN LINK GATES
- 26.21 POLE MOUNTED LIGHT FIXTURE, SEE ELECTRICAL

LEGEND

- EXISTING BUILDING
NO SCOPE OF WORK UNDER THIS PROJECT
- EXISTING CONCRETE
NO SCOPE OF WORK UNDER THIS PROJECT
- PROPOSED MODULAR BUILDING
MODULAR BUILDING UNDER THIS SCOPE OF WORK, SEE MFR DWGS.
- PROPOSED CONCRETE PAVING
SEE CIVIL FOR GRADING, FOR CONSTRUCTION, ISOLATION, CONTRACTION JOINTS
- PROPOSED TURF AREA
SEE LANDSCAPE DRAWINGS (TREES AND PLANTING NOT SHOWN FOR CLARITY)

ADSA 810

FIRE & LIFE SAFETY SITE CONDITIONS SUBMITTAL

Division of the State Architect (DSA) documents referenced within this publication are available on the DSA Forms or DSA Publications webpages.

To facilitate the Division of the State Architect's (DSA) fire and life safety plan review of project site conditions, DSA requires the design professional to provide the following information at time of project submittal for projects consisting of construction of a new campus, construction of new buildings, additions to existing buildings, and for site alternate design means for fire department emergency vehicle access, and fire suppression water supply. Information associated with compliance items 1 through 3 below is to be provided for all project types indicated above. Information associated with items 4 through 7 is to be completed when an alternate means is utilized. Acknowledgment by the school district and signature from the Local Fire Authority (LFA) is only required when an alternate design means is being requested.

The Project Information and Fire & Life Safety Information sections are to be completed for all projects and imaged onto the fire access site plan. When an alternate design means is proposed, all sections on pages 1 and 2 are to be completed and imaged on the fire access site plan.

For additional information refer to the instructions at the end of this form and DSA Policy PL 09-01: Fire Flow for Buildings.

PROJECT INFORMATION			
School District/Owner: STOCKTON UNIFIED SCHOOL DISTRICT			
Project Name/School: PEYTON ELEMENTARY SCHOOL			
Project Address: 2525 GOLD BROOK DR. STOCKTON, CA 95212			

FIRE & LIFE SAFETY INFORMATION			
1. Has a fire hydrant flow test been performed within the past 12 months? (If yes, provide a copy of the test data.)	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
2. Was the fire hydrant water flow test performed as part of this LFA review?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
3. Is the project located within a designated fire hazard severity zone (FHSZ) as established by Cal-Fire? (If yes, indicate FHSZ classification below.)	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>	
Refer to the following website for FHSZ locations: https://www.fire.ca.gov/FHSZ/		Moderate <input type="checkbox"/>	High <input type="checkbox"/> Very High <input type="checkbox"/>
Wildland Interface Area (WIFA) (If any designations are checked, project design must meet the requirements of CBC Chapter 7A.)		WIFA <input type="checkbox"/>	

CONDITION MEANS AND METHODS RESOLUTION				ALTERNATE ACCEPTED	
	Yes	No	N/A	NR	
4. Emergency vehicle access roadways do not meet CFC requirements.					
4a. Acceptable Alternate: Emergency vehicle and personnel access as proposed by the project architect is acceptable for providing fire suppression and protection of life and property.					
5. Fire Hydrants: Number and spacing does not meet CFC requirements.					
5a. Acceptable Alternate: Number of fire hydrants and spacing as proposed by the project architect is acceptable for fire suppression and protection of life and property.					
6. Fire Hydrants: Water flow and pressure are less than CFC minimum.					
6a. Acceptable Alternate: The available flow and pressure is acceptable for providing fire suppression and protection of life and property.					
7. Location of fire department connection(s) serving fire sprinkler systems or standpipe systems does not meet CFC requirements.					
7a. Acceptable Alternate: The location of fire department connection serving the fire sprinkler system and/or standpipe system is acceptable for providing fire suppression and protection of life and property.					

School District Acceptance of Acceptable Design Alternates

By signing this form, the school district acknowledges and accepts the proposed design as an alternative to California Building Code (CBC) and California Fire Code (CFC) minimum requirements, as indicated by one or more of the conditions indicated at items 4a, 5a, 6a or 7a, for providing fire and life safety protection of life and property.

Accepted by: VICTOR BRUN Title: Director of Facilities Planning

Signature: [Signature] Date: 11/1/24

LOCAL FIRE AUTHORITY (LFA) INFORMATION			
LFA Agency Name: STOCKTON FIRE DEPARTMENT			
LFA Review Official: Phil Simon			
Title: Assistant Fire Marshal	Work Phone: 209-937-8271		
Work Email: Phil.Simon@stocktonca.gov			
LFA Reviewer's Signature: <u>Phil Simon</u>	Date: <u>10/31/2024</u>		

UNDERGROUND 4" FIRELINE FOR SPRINKLER SYSTEM TO BE A DEFERRED SUBMISSION

DGS DSA 810 (revised 12/29/20) DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES Page 2 of 4 STATE OF CALIFORNIA

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☐ FLS ☐ ACS ☐
DATE: 11/26/2024

DATE	DESCRIPTION	MARK
07/31/2024	DSA SUBMITTAL	B
11/01/2024	DSA BACKCHECK SUBMITTAL	C




LICENSED ARCHITECT
No. C25834
EXPIRATION 7-31-25
STATE OF CALIFORNIA

TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
OVERALL SITE PLAN-FIRE AUTHORITY

PROJECT NO.
23-12899
DRAWING
G100


CIVIL IMPROVEMENT PLANS FOR
PEYTON
ELEMENTARY SCHOOL
STOCKTON,
CALIFORNIA

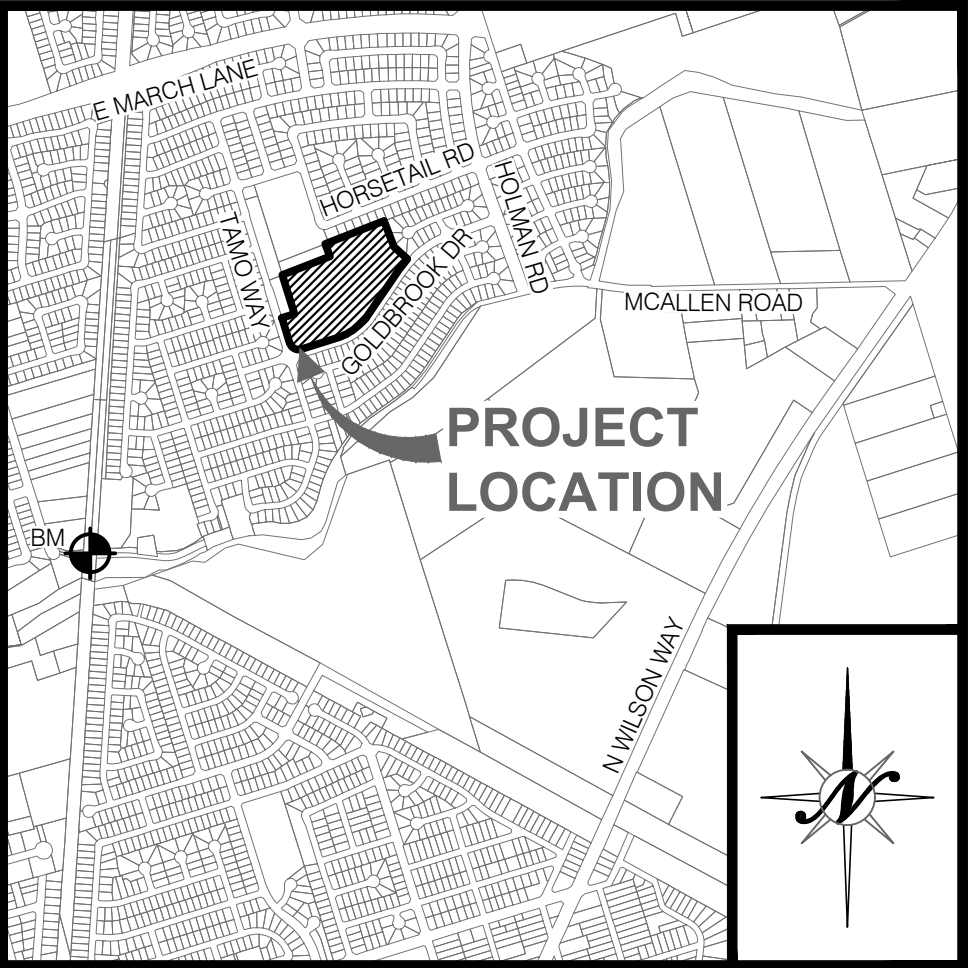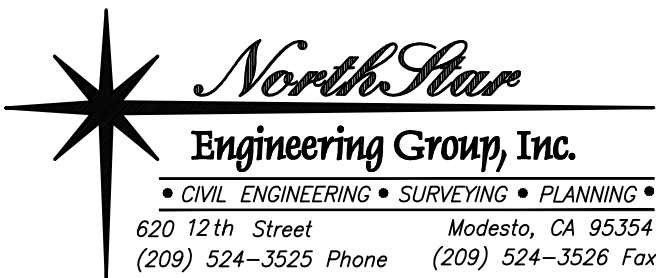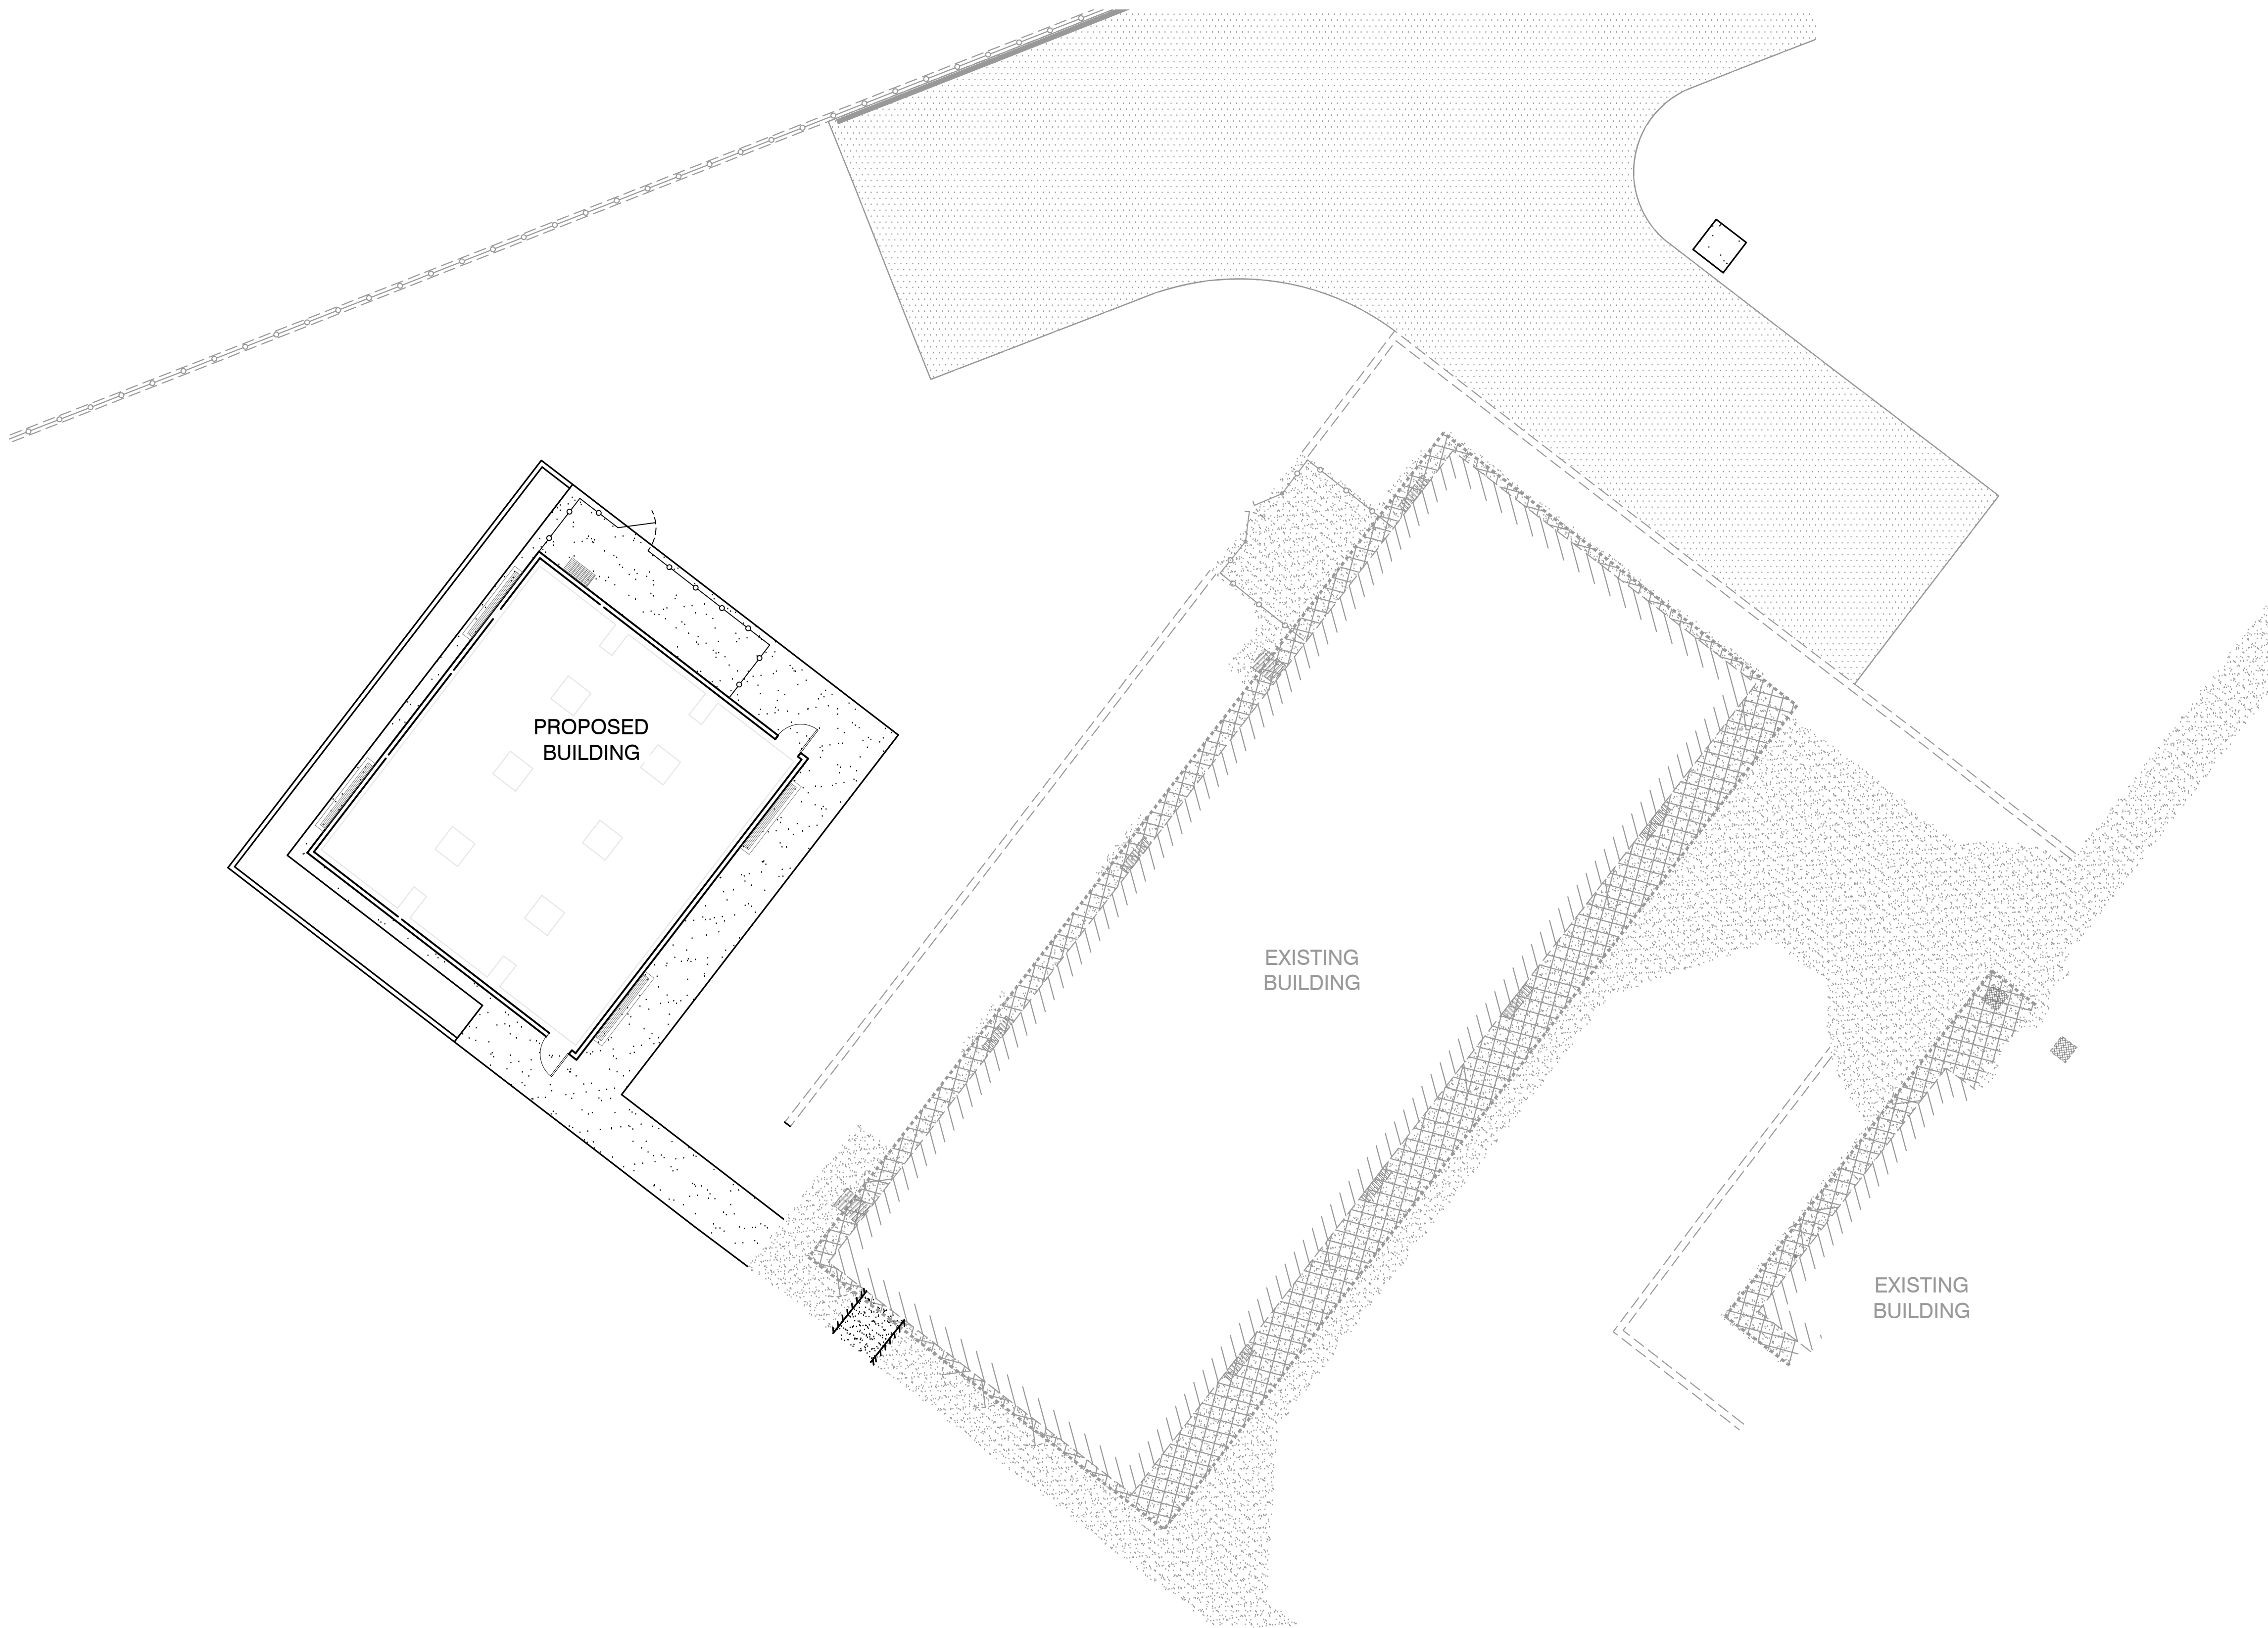

VICINITY MAP
NTS

BENCHMARK

ELEVATION: 32.58
BM: BRASS DISK MARKING COS MONUMENT STAMPED "4IN-1" IN MONUMENT WELL ON THE SOUTH SIDE OF MCALLEN RD 15FT WEST OF THE S.P.R.R TRACKS.

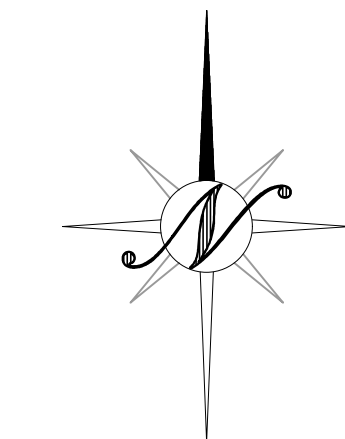

10 5 0 10
1" = 10'

CONTACTS

A. REGULATORY AGENCY:	DIVISION OF THE STATE ARCHITECT-SACRAMENTO 1102 O STREET, SUITE 5200 SACRAMENTO, CA 95811 T: (916) 445-8730
B. OWNER/DEVELOPER:	STOCKTON UNIFIED SCHOOL DISTRICT 56 S LINCOLN ST. STOCKTON, CA 95203 T: (209) 933-7000
C. PROJECT LOCATION:	PEYTON ELEMENTARY SCHOOL 2325 GOLDBROOK DRIVE, STOCKTON, CA 95212
D. ENGINEER:	NORTHSTAR ENGINEERING GROUP, INC. 620 12TH STREET MODESTO, CA 95354 T: (209) 524-3525 F: (209) 524-3526 CONTACT: JOHN ELLIS
E. ARCHITECT:	TETER, INC. 7535 N PALM AVENUE, SUITE 201 FRESNO, CA 93711 T: (559) 437-0887 CONTACT: JAMIE HICKMAN

SHEET INDEX

GENERAL INFORMATION	
1.	C1.1 COVER SHEET
2.	C1.2 LEGEND AND ABBREVIATIONS
3.	C1.3 GENERAL NOTES AND SPECIFICATIONS
4.	C1.4 DETAILS AND CROSS SECTIONS
5.	C1.5 DETAILS AND CROSS SECTIONS
SITE PLANS	
6.	C2.1 TOPOGRAPHIC AND DEMOLITION PLAN
7.	C3.1 DIMENSION AND PAVING PLAN
8.	C4.1 GRADING AND DRAINAGE PLAN
9.	C5.1 COMPOSITE UTILITY PLAN
EROSION CONTROL PLAN	
10.	C6.1 EROSION CONTROL PLAN
11.	C6.2 EROSION CONTROL NOTES AND DETAILS

COPYRIGHT © 2024 NORTHSTAR ENGINEERING GROUP, INC

IDENTIFICATION STAMP	
DIV. OF THE STATE ARCHITECT	
APP. 02-122690	INC:
REVIEWED FOR	
SS <input type="checkbox"/>	FLS <input type="checkbox"/> ACS <input type="checkbox"/>
DATE: 11/26/2024	

Teter, Inc. expressly reserves its common law copyright in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED



CIVIL IMPROVEMENT PLANS FOR
PEYTON ELEMENTARY SCHOOL
STOCKTON, CALIFORNIA
DRAWING TITLE
COVER SHEET

PROJECT NO.

23-12862

DRAWING


C1.1

LEGEND


	EXISTING	PROPOSED		EXISTING	PROPOSED
BOUNDARY LINE			AIR RELEASE VALVE		
CENTERLINE			WATER WELL		
RIGHT-OF-WAY			WATER (DOMESTIC)		
LOT LINE			WATER (NON-POTABLE WATER)		
SECTION LINE		N/A	WATER (FIRE SERVICE)		
EASEMENT			WATER STRUCTURE ID		
RIGHT-OF-WAY EASEMENT			IRRIGATION MANHOLE		
SETBACK LINE	N/A		IRRIGATION METER		
RESTRICTED ACCESS			BACKFLOW PREVENTER		
CENTERLINE STATION POINT			IRRIGATION CONTROL BOX		
MONUMENT			IRRIGATION CONTROL VALVE		
PROPERTY CORNER			IRRIGATION LINE		
BENCHMARK			GAS VALVE		
TREE			GAS METER		
BOULDER		N/A	GAS LINE		
STUMP		N/A	ELECTROLIER		
CONCRETE			SITE LIGHTING		
CURB + GUTTER			TRAFFIC SIGNAL		
ACCESSIBLE RAMP			TRAFFIC SIGNAL WITH STREET LIGHT		
DETECTABLE WARNING SURFACE			UTILITY POLE		
EDGE OF PAVEMENT			UTILITY POLE WITH LIGHT		
BUILDING OVERHEAD			WIRE ANCHOR		
RAILROAD			UTILITY BOX		
BUILDING			TELEPHONE MAINTENANCE HOLE		
WHEEL STOP			ELECTRIC MAINTENANCE HOLE		
HANDRAIL			CABLE MAINTENANCE HOLE		
BOLLARD	N/A		TRANSFORMER		
DOOR			OUTLET		
VALLEY GUTTER			UTILITY VALVE		
WALL			JOINT TRENCH		
WALL			OVERHEAD ELECTRICAL		
RETAINING WALL			TELEVISION/CABLE		
FENCE - CHAINLINK/VINYL/CABLE			UNDERGROUND ELECTRICAL		
FENCE - WOOD/METAL/STEEL			TELEPHONE		
FENCE - BARBED WIRE			ELECTRICAL		
FENCE - PICKET			MISCELLANEOUS UTILITY		
FENCE - SPLIT RAIL		N/A	SEWER MANHOLE		
FENCE - HOGWIRE			ECCENTRIC SEWER MANHOLE		
BARRICADE			SEWER CLEAN OUT		
GUARDRAIL		N/A	SEPTIC TANK		
ROLLING GATE			SEWER STRUCTURE ID		
SWING GATE			SEWER (MAIN)		
TRENCH		N/A	SEWER (LATERAL)		
SAWOUT			SEWER (FORCE MAIN)		
UTILITY REMOVAL		N/A	STORM DRAIN MANHOLE		
CONTOUR - MAJOR			DEWATERING MANHOLE		
CONTOUR - MINOR			ECCENTRIC MANHOLE		
DAYLIGHT CUT	N/A		STORM DRAIN CLEAN OUT		
DAYLIGHT FILL	N/A		CURB INLET		
GRADE BREAK			DRAIN INLET		
PAD ELEVATION			DRAIN INLET ON MANHOLE		
SLOPE			STORM DRAIN STRUCTURE ID		
ELEVATION TAG			RAINWATER LEADER		
TOE OF SLOPE			RIPRAP (ROCK DISCHARGE PAD)		
HIGH POINT			STORM DRAIN		
SIGN			STORM DRAIN TRENCH DRAIN		
SINGLE LINE			SWALE		
DOUBLE LINE			STORM DRAIN (LANDSCAPE SERVICES)	N/A	
STOP BAR/CROSSWALK			ROCK TRENCH		
DASHED LINE			FRENCH DRAIN	N/A	
DOUBLE DASHED LINE			CULVERT		
MAN-HOLE					
MAILBOX					
UTILITY STRUCTURE					
WATER VALVE					
WATER METER					
BLOW OFF VALVE					
BACKFLOW PREVENTER					
DOUBLE CHECK DETECTOR ASSEMBLY					
FIRE HYDRANT					
MONITORING WELL					

ABBREVIATIONS




±	PLUS OR MINUS (NOT EXACT)	IV	IRRIGATION VALVE
@	AT	JB	JUNCTION BOX
Ø	DIAMETER	JP	JUNCTION POLE
AB	AGGREGATE BASE	JT	JOINT TRENCH
ABDN	ABANDONED	LT	JOINT POLE
AC	ACRE, ASPHALT CONCRETE	L, LP	LEFT
A/C	AIR CONDITIONING	L =	LENGTH (CURVE)
ACP	ASBESTOS CEMENT PIPE	LF	LINEAL/LINEAR FEET
ACM	ASBESTOS CONTAINING MATERIAL	LAT	LATERAL
AD	AREA DRAIN	LIP	LIP OF GUTTER
ADA	AMERICANS W/ DISABILITIES ACT	LN	LANE
AG	ATRIUM GRATE	LP	LIGHT POLE, LOW POINT
AGG	AGGREGATE	LP	FIRE HYDRANT
ALGN	ALIGNMENT	LS	LANDSCAPE
ALT	ALTERNATE	LSA	LANDSCAPE ARCHITECT
APN	ASSESSORS PARCEL NUMBER	MA	MEDICAL AIR
ARV	AIR RELEASE VALVE	MAX	MAXIMUM
ASB	MECHANICAL/ELECTRICAL/PLUMBING	MEP	MECHANICAL/ELECTRICAL/PLUMBING
ASPH	ASPHALT	MH	MAN/MAINTENANCE HOLE
ASR	AUTOMATIC SPRINKLER RISER	MIN	MINIMUM
BC	BEGIN CURVE	MIPT	MALE IRON PIPE THREAD
BDRY	BOUNDARY	MJ	MECHANICAL JOINT
BFP	BACK FLOW PREVENTOR	MPVC	MIDPOINT OF VERTICAL CURVE
BOOK	BOOK	MON	MONUMENT
BLDG	BUILDING CORNER	MS	MOW STRIP
BLDG	BUILDING	MW	MONITORING WELL
BMP	BEST MANAGEMENT PRACTICES	N	NORTH, NORTHING COORDINATE
BM	BENCHMARK	(N)	NEW
BO	BLOW OFF	NDS	NDS INC. (MANUFACTURER)
BOD	BOTTOM OF DOCK	NIC	NOT INCLUDED/IN CONTRACT
BOL	BOLLARD	NO	NUMBER
BOW	BACK OF WALK	NSE	NORTHSTAR ENGINEERING
BSW	BACK OF SIDEWALK	NST	NOT TO SCALE
BS	BEGIN STRIPING	OC	ON CENTER
BSL	BUILDING SETBACK LINE	OG	ORIGINAL GROUND / GRADE
BVC	BEGIN VERTICAL CURVE	OHE	OVERHEAD ELECTRICAL
BW	FINISHED GRADE AT BOTTOM OF WALL	O.R.	OFFICIAL RECORDS
C	CIVIL	(P)	PROPOSED
CC	CONCRETE	P, PAV	PAVEMENT
CB	CATCH BASIN	PB	PULL BOX
CBL	CABLE	PCC	POINT OF COMPOUND/CONVERSE CURVATURE
CDS	CONTINUOUS DEFLECTION	PCC	PORTLAND CEMENT CONCRETE
CG&G	CURB AND GUTTER	PE	PLAIN END
CG&S	CURB, GUTTER & SIDEWALK	PED	PEDESTRIAN
CI	CAST IRON/CURB INLET	PERF	PERFORATED
CIP	CAST IRON PIPE	PG	PAGE
CL	CENTER LINE	PG&E	PACIFIC GAS AND ELECTRIC
CL	OR CL	PH	POTHOLE
CLR	CABLE MAINTENANCE HOLE	PID	POINT ID
CMH	COMMUNICATION	PIV	POST/PRESSURE INDICATOR VALVE
CMN	CORRUGATED METAL PIPE	PL	PROPERTY LINE
CMP	CLEAN OUT	PM	PARKING METER, PARCEL MAP
CO	COMPACT	PMH	POWER MANHOLE
COMP	CONCRETE	PO	PUSH-ON
CONC	CONCRETE	PCC	POINT ON CURVE/POINT OF CONNECTION
CONST	CONSTRUCTION OR CONSTRUCT	POI	POINT OF INTERSECTION
CONF	CONFORM TO EXISTING	PP	POWER POLE
COS OR C.O.S	CITY OF STOCKTON	PRC	POINT OF REVERSE CURVATURE
CT	COURT/CUBIC	PROF	PROFILE
CU	CULVERT	PRV	PRESSURE REDUCING VALVE
CV	CHECK VALVE	PRUE	PRIVATE UTILITY EASEMENT
CY	CUBIC YARD	PT	POINT
CLR	DELTA (CURVE)	PT&T	PACIFIC TELEPHONE & TELEGRAPH
DCDA	DOUBLE CHECK DETECTOR ASSEMBLY	PUE	PUBLIC UTILITY EASEMENT
DEMO	DEMOLISH	PVC	POLYVINYL CHLORIDE PIPE
DEPT	DEPARTMENT	R	RIGHT
DI	DROP/RAIN INLET/DUCTILE IRON	R=	RADIUS
DIA	DIAMETER	RC	RELATIVE COMPACTION
DIP	DUCTILE IRON PIPE	RCP	REINFORCED CONCRETE PIPE
DOM, (DOM)	DOMESTIC	RD	ROAD, RELATIVE DENSITY
DR	DRIVE	RJ	RESTRAINED JOINT
DS	DOWNSPOUT	RP	RADIUS POINT
DTL	DETAIL	RPPA	REDUCED PRESSURE PRINCIPLE ASSEMBLY
DW	DOMESTIC WATER/DRYWELL/DEWATERING	RSC	RECEIVING AND SUPPORT CENTER
DWG	DRAWING	RV	RESISTANCE VALUE
DRIVEWAY	DRIVEWAY	RW	RECYCLED WATER
DYL	DOUBLE YELLOW LINE	RW, R/W, ROW	RIGHT-OF-WAY
E	EAST/EASTING COORDINATE/ELECTRIC	RWL	RAINWATER LEADER
(E)	EXISTING	S	SOUTH, SLOPE
EC	END CURVE	S.A.D.	SEE ARCHITECTURAL DRAWINGS
EG	EXISTING GRADE	SBL	SETBACK LINE, SOLID BLACK LINE
EL, ELEV	ELEVATION	SC	SAN JOAQUIN COUNTY
ELB	ELECTRIC BOX	SCO	SEWER CLEANOUT
ELEC/ELEC	ELECTRICAL	SD	STORM DRAIN
ELV	ELECTRIC VAULT	SDB	STORM DRAIN BASIN
EM	ELECTRIC METER	SDCB	STORM DRAIN CATCH BASIN
EMH	ELECTRIC MAINTENANCE HOLE	SDCO	STORM DRAIN CLEAN OUT
EDGE OF PAVEMENT	EDGE OF PAVEMENT	SDDW	STORM DRAIN DEWATERING
END STRIPING	END STRIPING	SDI	STORM DRAIN INLET
ESMT OR EASE	EASEMENT	SDFM	STORM DRAIN FORCE MAIN
EVC	END OF VERTICAL CURVE	SDMH	STORM DRAIN MAINTENANCE HOLE
EX OR EXIST	EXISTING	S.E.D.	SEE ELECTRICAL DRAWINGS
EVA	EMERGENCY VEHICLE ACCESS	SG	SUB-GRADE
F	FUTURE	SF	SILT FENCE SG SUBGRADE
FA	FIRE ALARM	SHT	SHEET
FAB	FIRE ALARM BOX	SIM	SIMILAR
FC, F/C	FACE OF CURB	SL	STREET LIGHT
FD	FOUND/FRENCH DRAIN	S.L.D.	SEE LANDSCAPE DRAWINGS
FDC	FIRE DEPARTMENT CONNECTION	SLB	STREET LIGHT BOX
FE	FENCE	SMH	SIGNAL MANHOLE
FES	FLARED END SECTION	S.M.D.	SEE MECHANICAL DRAWINGS
FF	FINISH FLOOR	SNS	STREET NAME SIGN
FFE	FINISH FLOOR ELEVATION	SP	SERVICE POLE
FG	FINISH GRADE	S.P.D	SEE PLUMBING DRAWINGS
FH	FIRE HYDRANT	SRL	SOLID RED LINE
FIPT	FEMALE IRON PIPE THREAD	SS	SANITARY SEWER
FL	FLOW LINE/FLANGE	SSCO	SANITARY SEWER CLEAN OUT
FLG	FLANGE	SSFM	SANITARY SEWER FORCE MAIN
FM	FLOWMETER/FORCE MAIN	SSMH	SANITARY SEWER MAN/MAINTENANCE HOLE
FOUND	FOUNDATION	SSPS	SANITARY SEWER PUMP STATION
FS	FINISHED SURFACE, FIRE SERVICE	ST	STREET, SEPTIC TANK
FSR	FIRE SPRINKLER RISER	STA	STATION
FT	FOOT, FEET	STD	STANDARD
FW	FIRE WATER	STL	STEEL
G	GAS, GROUND	SW, SW	SIDEWALK
GB	GRADE BREAK	SWL	SOLID WHITE LINE, SWALE
GE	GROUND ELEVATION	T	TELEPHONE
GI	GALVANIZED IRON	TC	TOP OF CURB
GM	GAS METER	TBC	TOP BACK OF CURB
GR	GRATE	TCP	TEMPORARY CONTROL POINT
GRD	GROUND	TD	TRENCH DRAIN
GS	GROUND SHOT ELEVATION	TEL	TELEPHONE
GV	GUIDE LINE	TELB	TELEPHONE BOX
H2O	WATER	TELV	TELEPHONE VAULT
HB	HOSE BIB	TEMP	TEMPORARY
HMA	HOT MIX ASPHALT	TFC	TOP FACE OF GRATE
HORIZ	HORIZONTAL	TG	TOP OF GRATE
HT	HEIGHT	TH	THRESHOLD
HP	HIGH POINT	THK	THICK
HPS	HIGH PRESSURE SODIUM/SYSTEM	TI	TRAFFIC INDEX
HT	HEIGHT	TMH	TELEPHONE MAINTENANCE HOLE
HWY	HIGHWAY	TOD	TOP OF DOCK
HWL	HIGH WATER LINE	TOW	TOP OF WALL
IBX	IRRIGATION BOX	TP	TELEPHONE POLE, TEST PIT
ICB	IRRIGATION CONTROL BOX	TPE	TREE PLANTING EASEMENT
ICV	IRRIGATION CONTROL VALVE	TS	TRAFFIC SIGNAL
IHW	IRRIGATION HEADWALL	TSSB	TRAFFIC SIGNAL BOX
IM	IRRIGATION METER	TSCCE	TEMPORARY STABILIZED CONSTRUCTION ENTRANCE
IMH	IRRIGATION MAINTENANCE HOLE	TSP	TRAFFIC SIGNAL POLE
ID	INSIDE DIAMETER	TV	TELEVISION
INV	INVERT	TVR	CABLE TV RISER
INST	INSTALL	TYP	TYPICAL
IRR	IRRIGATION	UTL	UTILITY
ISP	IRRIGATION STAND PIPE	UG, U/G	UNDERGROUND
		UON	UNLESS OTHERWISE NOTED

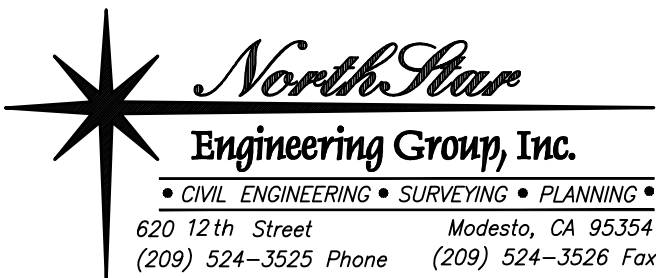

UOS	UNLESS OTHERWISE SPECIFIED
USA-B	WATER (BLUE)
USA-G	SEWER/STORM DRAIN (GREEN)
USA-M	TEMPORARY SURVEY MARKINGS (MAGENTA)
USA-O	COMMUNICATION CATV (ORANGE)
USA-P	RECLAIMED WATER IRR. SLURRY (PURPLE)
USA-R	ELECTRICAL (RED)
USA-W	PROPOSED EXCAVATION (WHITE)
USA-Y	GAS, OIL, STEAM (YELLOW)
VC	VERTICAL CURVE
VCP	VITRIFIED CLAY PIPE
VERT	VERTICAL
W	WEST, WATER
W/	WITH
WA	WALL
WB	WATER BOX
WM	WATER METER
WMB	WATER METER BOX
WOA	WASHOUT AREA
WS	WATER SERVICE
WV	WATER VALVE
WW	WATER WELL
WWF	WELDED WIRE FABRIC
WY	WAY
YD	YARD

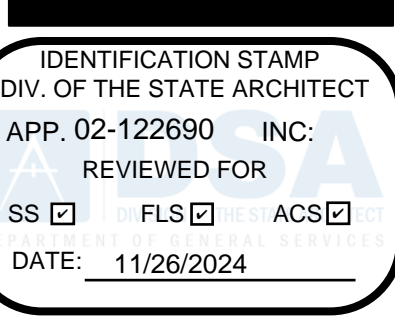

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL

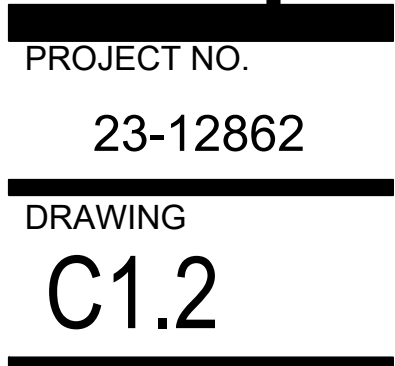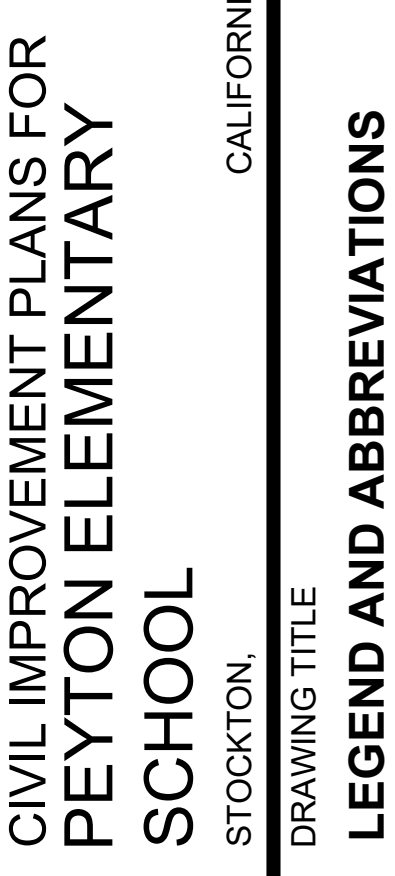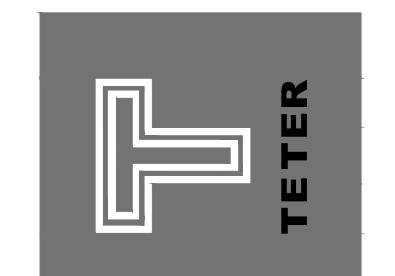

GENERAL NOTES

- CONTRACTOR SHALL BE AWARE THAT THE FOLLOWING NOTES LISTED BELOW ARE NORTSTAR ENGINEERING GROUPS' TYPICAL GENERAL NOTES AND SOME NOTES MAY NOT BE APPLICABLE TO THIS PLAN SET.
- ALL IMPROVEMENTS SHALL BE CONSTRUCTED IN STRICT ACCORDANCE WITH THE FOLLOWING: CITY OF STOCKTON (CITY) STANDARD SPECIFICATIONS AND THE LATEST EDITION OF THE CALIFORNIA BUILDING CODE. WHERE THERE IS A CONFLICT BETWEEN THE PLANS AND THE CITY AND/OR CALIFORNIA BUILDING CODE STANDARDS, THE CITY AND/OR CALIFORNIA BUILDING CODE STANDARDS SHALL PREVAIL. ALL WORK SHALL BE SUBJECT TO THE INSPECTION OF THE CITY OF STOCKTON.
- PRIOR TO ANY WORK BEING PERFORMED, THE CONTRACTOR SHALL CONTACT THE APPROPRIATE REGULATORY AGENCIES FOR A PRE-CONSTRUCTION CONFERENCE. CONTRACTOR SHALL ALSO NOTIFY THE PROJECT CONTRACTS LISTED ON THIS SHEET FORTY- EIGHT (48) HOURS IN ADVANCE OF SAID MEETING.
- IT IS INTENDED THAT THESE PLANS AND SPECIFICATIONS REQUIRE ALL LABOR AND MATERIALS NECESSARY AND PROPER FOR THE WORK CONTEMPLATED AND THAT THE WORK BE COMPLETED IN ACCORDANCE WITH THEIR TRUE INTENT AND PURPOSE. THE CONTRACTOR SHALL NOTIFY NORTSTAR ENGINEERING GROUP, INC. (ENGINEER) IMMEDIATELY REGARDING ANY DISCREPANCIES AND AMBIGUITIES WHICH MAY EXIST IN THE PLANS AND SPECIFICATIONS, IF THE PLANS OR SPECIFICATIONS DESCRIBE PORTIONS OF THE WORK IN GENERAL, TERMS BUT NOT IN COMPLETE DETAIL, IT IS UNDERSTOOD THAT ONLY THE BEST GENERAL PRACTICE IS TO PREVAIL AND THAT ONLY MATERIALS AND WORKMANSHIP OF THE FIRST QUALITY ARE TO BE USED.
- IF NORTSTAR ENGINEERING GROUP, INC. IS TO PERFORM ANY SURVEY STAKING, THEN CONSTRUCTION STAKING FOR GRADING, CURB, GUTTER, SIDEWALK, SANITARY SEWER, STORM DRAIN, AND WATER SHALL BE DONE UNDER THE DIRECTION OF THE ENGINEER. THE CONTRACTOR SHALL NOTIFY THE ENGINEER SEVENTY- TWO (72) HOURS IN ADVANCE OF THIS NEED FOR STAKING. ANY STAKING REQUESTED BY THE CONTRACTOR OR ITS SUBCONTRACTORS THAT IS ABOVE AND BEYOND NORMAL STANDARD STAKING NEEDS AS OUTLINED IN THE CONTRACT, WILL BE SUBJECT TO AN EXTRA BARG CHARGE TO THE CONTRACTOR.
- THE CONTRACTOR SHALL EXERCISE DUE CAUTION AND SHALL CAREFULLY PRESERVE BENCH MARKS, REFERENCE POINTS AND ALL SURVEY STAKES, AND SHALL BEAR ALL EXPENSE FOR REPLACEMENT AND/OR ERRORS CAUSED BY THEIR UNNECESSARY LOSS OR DISTURBANCE.
- CONTRACTOR AGREES THAT HE SHALL ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THIS PROJECT, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY, THAT THIS REQUIREMENT SHALL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS; AND THAT THE CONTRACTOR SHALL DEFEND, INDEMNIFY AND HOLD THE OWNER, ENGINEER AND THE CITY HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED, IN CONNECTION WITH THE PERFORMANCE OF WORK ON THIS PROJECT, EXCEPTING FOR LIABILITY ARISING FROM THE SOLE NEGLIGENCE OF THE OWNER OR THE ENGINEER.
- THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR ANY FIELD CHANGES MADE WITHOUT WRITTEN AUTHORIZATION FROM THE CITY ENGINEER.
- THE CONTRACTOR SHALL PROVIDE ALL LIGHTS, SIGNS, BARRICADES, FLAGMEN, OR OTHER DEVICES NECESSARY FOR PUBLIC SAFETY IN ACCORDANCE WITH THE CURRENT ISSUE OF "MANUAL OF TRAFFIC CONTROLS, WARNING SIGNS, LIGHTS, AND DEVICES FOR USE IN PERFORMANCE OF WORK UPON HIGHWAY" PUBLISHED BY THE STATE OF CALIFORNIA BUSINESS AND TRANSPORTATION AGENCY. CONTRACTOR SHALL COORDINATE WITH THE GOVERNING LOCAL AGENCY TO DETERMINE IF ANY CHANGES TO THE CLASSIFICATION OR OPERATION OF A ROADWAY ARE REQUIRED DUE TO THE IMPROVEMENTS SHOWN ON THESE PLANS (SUCH AS SPEED LIMITS, INTERSECTION TYPE, ETC.) AND SHALL BE RESPONSIBLE FOR PROVIDING ALL NECESSARY INTERIM TRAFFIC MANAGEMENT MEASURES REQUIRED BY THE GOVERNING AGENCY, INCLUDING TRANSITIONAL SIGNAGE AND STRIPING IN PREPARATION OF AND TO BE INSTALLED PRIOR TO COMPLETION AND ACCEPTANCE OF ULTIMATE SIGNAGE AND STRIPING. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL COSTS ASSOCIATED WITH IMPLEMENTING THESE MEASURES.
- THE OFFICE OF THE CITY OF STOCKTON PUBLIC WORKS SHALL BE NOTIFIED AT LEAST 48 HOURS IN ADVANCE OF ANY WORK.
- CABLE TV, ELECTRICAL, GAS, AND TELEPHONE UNDERGROUND WORK SHALL BE COMPLETED PRIOR TO CONSTRUCTION OF THE CURB, GUTTER, SIDEWALK AND PAVING.
- THE CONTRACTOR SHALL OBTAIN AN ENCROACHMENT PERMIT FROM THE CITY OF STOCKTON, DEPARTMENT OF PUBLIC WORKS OR OTHER AGENCY PRIOR TO COMMENCEMENT OF WORK WITHIN EXISTING CITY RIGHT-OF-WAY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL PERMITS AND LICENSES REQUIRED FOR THE CONSTRUCTION AND COMPLETION OF THE PROJECT.
- THE CITY OF STOCKTON OR ASSOCIATED UTILITY COMPANY AND RESIDENCES TO BE AFFECTED SHALL BE NOTIFIED IMMEDIATELY UPON ANY UTILITY SERVICE DISRUPTION OTHER THAN THAT SHOWN ON THESE IMPROVEMENT PLANS AND A TWENTY-FOUR (24) HOUR NOTICE SHALL BE GIVEN FOR ANY PLANNED DISRUPTION.
- STREET SIGNS, TRAFFIC CONTROL SIGNS, AND PAVEMENT MARKINGS SHALL BE PROVIDED AND INSTALLED BY THE CONTRACTOR AT LOCATIONS ESTABLISHED BY THE ENGINEER.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING EXISTING IMPROVEMENTS FROM DAMAGE. COST OF REPLACING DAMAGED EXISTING IMPROVEMENTS SHALL BE INCLUDED IN THE UNIT PRICE BID FOR ITEMS REQUIRING REMOVAL AND REPLACEMENT.
- CONTRACTOR IS RESPONSIBLE FOR COORDINATION OF THE REMOVAL OR RELOCATION OF ALL EXISTING UTILITIES WITH RESPECTIVE UTILITY COMPANIES.
- ASPHALT CONCRETE SHALL BE PLACED ONLY WHEN THE ATMOSPHERIC TEMPERATURE IS ABOVE 50°F AND RISING.
- DRAWING NUMBERS SHOWN ON THE PLANS REFER TO DRAWINGS CONTAINED IN THE CITY OF STOCKTON STANDARD SPECIFICATIONS (I.E. DWG. 30).
- ALL TRENCHES IN PAVED AREAS SHALL BE PAVED WITH TEMPORARY PAVING, OR COVERED WITH A STEEL PLATE OF APPROPRIATE SIZE AND STRENGTH, THE SAME DAY THE PAVEMENT CUT IS MADE.
- WHENEVER PAVEMENT IS BROKEN OR CUT IN THE INSTALLATION OF THE WORK COVERED BY THESE SPECIFICATIONS AND PLANS, THE PAVEMENT SHALL BE REPLACED, AFTER PROPER BACK FILLING, WITH PAVEMENT MATERIALS EQUAL TO OR BETTER THAN THE MATERIALS USED IN THE ORIGINAL PAVING. THE FINISHED PAVEMENT SHALL BE SUBJECT TO THE APPROVAL OF THE CITY ENGINEER.
- PRIOR TO COMMENCING ANY WORK, IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO HAVE EACH UTILITY COMPANY LOCATED. IN THE FIELD, THEIR MAIN AND SERVICE LINES. THE CONTRACTOR SHALL NOTIFY MEMBERS OF THE UNDERGROUND SERVICE ALERT (U.S.A.) FORTY- EIGHT (48) HOURS IN ADVANCE OF PERFORMING ANY EXCAVATION WORK BY CALLING THE TOLL-FREE NUMBER (800) 227-2600. THE CONTRACTOR SHALL RECORD THE U.S.A. ORDER NUMBER. IT SHALL BE THE CONTRACTORS SOLE RESPONSIBILITY TO PROTECT ALL EXISTING UTILITIES SO THAT NO DAMAGE RESULTS TO THEM DURING THE PERFORMANCE OF THIS CONTRACT. ANY REPAIRS NECESSARY TO DAMAGED UTILITIES SHALL BE PAID FOR BY THE CONTRACTOR. THE CONTRACTOR SHALL BE REQUIRED TO COOPERATE WITH OTHER CONTRACTORS AND UTILITY COMPANIES INSTALLING NEW STRUCTURES, UTILITIES AND SERVICE TO THE DEVELOPMENT.
- PAYMENT FOR PAVEMENT WILL BE MADE ONLY FOR AREAS SHOWN ON THE PLANS. REPLACEMENT OF PAVEMENT WHICH IS BROKEN OR CUT DURING THE INSTALLATION OF THE WORK COVERED BY THESE SPECIFICATIONS AND PLANS, AND WHICH LIES OUTSIDE OF SAID AREAS, SHALL BE INDICATED IN THE CONTRACTORS UNIT PRICE FOR PAVEMENT, AND NO ADDITIONAL PAYMENT SHALL BE MADE FOR SUCH WORK.
- EXCAVATIONS OF 5 FEET OR MORE IN DEPTH WILL REQUIRE AN EXCAVATION PERMIT FROM THE STATE OF CALIFORNIA DEPARTMENT OF INDUSTRIAL SAFETY. FOR TRENCHES 5 FEET OR MORE IN DEPTH, THE CONTRACTOR SHALL COMPLY WITH SECTION 9-1.02A OF THE CALTRANS STANDARDS, CHAPTER 9 OF THE STATE OF CALIFORNIA LABOR CODE, AND ANY LOCAL CODES OR ORDINANCES.
- WE CALL YOUR ATTENTION TO TITLE 8 CALIFORNIA ADMINISTRATION CODE SECTION 1540 (A) (1) OF THE CONSTRUCTION SAFETY ORDERS ISSUED BY THE OCCUPATIONAL SAFETY AND HEALTH STANDARDS BOARD PURSUANT TO THE CALIFORNIA OCCUPATIONS SAFETY AND HEALTH ACT OF 1973 AS AMENDED WHICH STATES: (1) PRIOR TO OPENING AN EXCAVATION EFFORT SHALL BE MADE TO DETERMINE WHETHER UNDERGROUND INSTALLATIONS, I.E. SEWER, WATER, FUEL, ELECTRICAL LINES, ETC., WILL BE ENCOUNTERED AND IF SO, WHERE SUCH UNDERGROUND INSTALLATIONS ARE LOCATED. WHEN THE EXCAVATION APPROACHES THE APPROXIMATE LOCATION OF SUCH INSTALLATION, THE EXACT LOCATION SHALL BE DETERMINED BY CAREFUL PROBING OR HAND DIGGING, AND, WHEN IT IS UNCOVERED, ADEQUATE PROTECTION SHALL BE PROVIDED FOR THE EXISTING INSTALLATION. ALL KNOWN OWNERS OF UNDERGROUND FACILITIES IN THE AREA CONCERNED SHALL BE ADVISED OF PROPOSED WORK AT LEAST FORTY-EIGHT (48) HOURS PRIOR TO THE START OF ACTUAL EXCAVATION.
- THE CONTRACTOR SHALL MAINTAIN A NEATLY MARKED SET OF FULL-SIZE AS-BUILT RECORD DRAWINGS SHOWING THE FINAL LOCATION AND LAYOUT OF ALL MECHANICAL, ELECTRICAL AND INSTRUMENTATION EQUIPMENT, PIPING AND CONDUITS, STRUCTURES AND OTHER FACILITIES. AS-BUILT RECORD DRAWINGS SHALL REFLECT CHANGES, ORDERS, ACCOMMODATIONS, AND ADJUSTMENTS TO ALL IMPROVEMENTS CONSTRUCTED. WHERE NECESSARY, SUPPLEMENTAL DRAWINGS SHALL BE PREPARED AND SUBMITTED BY THE CONTRACTOR TO THE DEVELOPER AND APPROVAL AGENCY.
- SIGNS, STRIPING AND PAVEMENT MARKINGS SHALL BE IN STRICT CONFORMANCE WITH THE CITY OF STOCKTON STANDARDS AND SPECIFICATIONS.

GENERAL NOTES (CONT)

- PRIOR TO ACCEPTANCE OF THE PROJECT, THE CONTRACTOR SHALL DELIVER TO THE ENGINEER, ONE SET OF NEATLY MARKED AS-BUILT RECORD DRAWINGS SHOWING THE INFORMATION REQUIRED ABOVE. AS-BUILT RECORD DRAWINGS SHALL BE REVIEWED AND THE COMPLETE AS-BUILT RECORD DRAWING SET SHALL BE CURRENT WITH ALL CHANGES AND DEVIATIONS REQUIRED AS A PRECONDITION TO THE FINAL PROGRESS PAYMENT APPROVAL AND/OR FINAL ACCEPTANCE.
- AFTER CONSTRUCTION OF ALL IMPROVEMENTS, THE CONTRACTOR SHALL SUBMIT ONE SET OF REPRODUCIBLE PLANS, FINAL, INVERT ELEVATIONS FOR SEWER AND STORM DRAIN LINES THAT ARE TO BE EXTENDED FOR FUTURE CONSTRUCTION SHALL ALSO BE SHOWN ON THE AS-BUILT PLANS ALL AS PROVIDED BY THE CONTRACTOR.
- THE CONTRACTOR SHALL NOTIFY NORTSTAR ENGINEERING AT LEAST 48 HOURS PRIOR TO BACK FILLING OF ANY PIPE WHICH STUBS TO A FUTURE PHASE OF CONSTRUCTION FOR INVERT VERIFICATION. TOLERANCE SHALL BE IN ACCORDANCE WITH THE CITY OF STOCKTON STANDARD SPECIFICATIONS.
- WHENEVER EXISTING FACILITIES ARE REMOVED, DAMAGED, BROKEN, OR CUT IN THE INSTALLATION OF THE WORK COVERED BY THESE PLANS OR SPECIFICATIONS, SAID FACILITIES SHALL BE REPLACED AT THE CONTRACTORS EXPENSE, AFTER PROPER BACKFILLING AND/OR CONSTRUCTION, WITH MATERIALS EQUAL TO OR BETTER THAN THE MATERIALS USED IN THE ORIGINAL EXISTING FACILITIES. THE FINISHED PRODUCT SHALL BE SUBJECT TO THE APPROVAL OF THE OWNER, THE ENGINEER, AND THE RESPECTIVE REGULATORY AGENCY.
- DUST CONTROL SHALL BE PROVIDED AT ALL TIMES. AT THE CONTRACTOR'S EXPENSE TO MINIMIZE ANY DUST NUISANCE AND SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CITY OF STOCKTON. CONTRACTOR SHALL OBTAIN A PERMIT FROM CAL WATER FOR USE OF WATER FROM FIRE HYDRANTS FOR CONSTRUCTION PURPOSES. THE PERMIT SHALL BE APPROVED BY THE CITY OF STOCKTON FIRE DEPARTMENT.
- CONTRACTOR SHALL PROVIDE CITY WITH A CERTIFICATE SIGNED BY A REGISTERED CIVIL ENGINEER OR LAND SURVEYOR STATING THAT ALL BUILDING PAD ELEVATIONS ARE IN ACCORDANCE WITH THE APPROVED GRADING PLAN.
- UNLESS OTHERWISE STATED, ALL STATIONS INDICATED ON THE IMPROVEMENT PLANS ARE REFERENCED TO THE CENTRLINE OF THE STREET. ALL STATIONS OFF CENTER ARE PERPENDICULAR TO OR RADIIALLY OFFSET CENTERLINE STATIONS, UNLESS OTHERWISE NOTED.
- IF THE PROJECT IS SUBJECT TO THE INDIRECT SOURCE REVIEW (ISR) REQUIREMENT, THE CONTRACTOR IS REQUIRED TO KEEP DAILY RECORDS OF THE TOTAL HOURS OF OPERATION FOR EACH PIECE OF EQUIPMENT GREATER THAN 50 HORSEPOWER BEING USED ON THE PROJECT SITE DURING CONSTRUCTION, WITHIN 30 DAYS OF COMPLETING CONSTRUCTION OF EACH PROJECT PHASE. A REPORT SUMMARIZING TOTAL HOURS OF OPERATION BY EQUIPMENT TYPE, MODEL, YEAR, AND HORSEPOWER FOR EACH PIECE OF CONSTRUCTION EQUIPMENT GREATER THAN 50 HORSEPOWER MUST BE SUBMITTED TO THE AIR DISTRICT, TO ASSIST IN THIS RECORDKEEPING, THE "DETAILED FLEET TEMP" RATE IS AVAILABLE FROM THE DISTRICTS WEBSITE AT [HTTP://WWW.VALLEYAIR.ORG/isr/isrformsandapplications.htm](http://www.valleyair.org/isr/isrformsandapplications.htm) FOR EACH PROJECT PHASE. THE CONTRACTOR IS NOT GOING TO MEET THE STANDARDS AND/OR RECORD KEEPING REQUIRED BY THE AIR DISTRICT. THE CONTRACTOR SHALL NOTIFY THE AIR BOARD PRIOR TO CONSTRUCTION SO THE NECESSARY REGISTRATION FEE SHALL BE PAID. IF THE AIR BOARD IS NOT NOTIFIED PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL BE REQUIRED TO PAY THE PENALTY TO THE AIR BOARD.
- PRIOR TO FINALIZING IMPROVEMENTS AND OPENING ROADS TO THE CONTRACTOR SHALL COORDINATE WITH THE GOVERNING LOCAL AGENCY FOR POTENTIAL TRAFFIC SIGNAGE AND STRIPING MODIFICATIONS (FOR EXAMPLE, SPEED LIMIT CHANGES OR REDUCTIONS) BEYOND THE PROJECT LIMITS THAT ARE NECESSITATED BY THE CONSTRUCTION OF THE IMPROVEMENTS SHOWN ON THESE PLANS. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL COSTS ASSOCIATED WITH SIGNAGE AND STRIPING MODIFICATIONS REQUIRED BY THE GOVERNING AGENCY.
- AN ASSUMPTION MADE BY THE CONTRACTOR IS NOT THE RESPONSIBILITY OF THE ENGINEER OR DESIGN CONSULTANT. CONTRACTOR SHALL SUBMIT A PRE-BID REQUEST FOR INFORMATION (RFI) FOR ANY CLARIFICATION NEEDED AND SHALL BE RESPONSIBLE FOR COMPLETING THE PROJECT AT THE CONTRACTORS EXPENSE FOR ANY WRONG ASSUMPTIONS MADE.

GRADING NOTES

- EARTHWORK SHALL BE PERFORMED IN ACCORDANCE WITH THE CITY OF STOCKTON STANDARDS AND THE PROJECT SOLDS REPORT. ALL FILL AREAS SHALL BE TESTED AS REQUIRED BY THE CITY OF STOCKTON AND SHALL BE PAID FOR BY THE CONTRACTOR.
- THE DEVELOPER SHALL BE RESPONSIBLE FOR COST OF INITIAL TEST FOR MOISTURE DENSITY CURVE. IF THE FIRST TEST FAILS, THE CONTRACTOR SHALL BE RESPONSIBLE FOR COST OF ALL SUBSEQUENT CURVES AND TESTS.
- THE CONTRACTOR SHALL REVIEW SITE PRIOR TO BIDDING. ALL VEGETATION AND DELETERIOUS MATERIALS SHALL BE REMOVED FROM THE SITE AT THE EXPENSE OF THE CONTRACTOR AND SHALL BE INCLUDED IN THE LUMP SUM CLEARING COST.
- THE CONTRACTOR SHALL PRESERVE ALL STAKES AND POINTS SET FOR LINES, GRADES OR MEASUREMENT OF THE WORK IN THEIR PROPER PLACES UNTIL AUTHORIZED TO REMOVE THEM BY THE ENGINEER. ALL EXPENSES INCURRED IN REPLACING STAKES THAT HAVE BEEN REMOVED WITHOUT PROPER AUTHORITY SHALL BE PAID FOR BY THE CONTRACTOR.
- CONTRACTORS PRICE SHALL INCLUDE COST TO ACHIEVE A BALANCED SITE. IT IS THE CONTRACTORS RESPONSIBILITY TO IMPORT AND EXPORT MATERIAL AS REQUIRED TO BALANCE SITE.
- CONTRACTOR SHALL GRADE ALL LANDSCAPE AREAS TO WITHIN 0.1 FEET OF FINAL GRADE ELEVATIONS WITH APPROPRIATE LANDSCAPE SECTIONS INCLUDED.
- ALL A.C. PAVING SHALL BE FOG SEALED PER SECTION 37 OF CALTRANS STANDARD SPECIFICATIONS, THE LATEST EDITION.
- GRADE TAGS LOCATED ON CURBS REFERENCE TO TOP OF CURB ELEVATION UNLESS OTHERWISE NOTED. ADDITIONAL DESCRIPTIONS ARE PROVIDED TO DENOTE HORIZONTAL AND VERTICAL CHANGES IN ACCORDANCE WITH ABBREVIATIONS DEFINED ON COVER SHEET.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING HIS OWN EARTH-WORK QUANTITIES FOR BIDDING, CONTRACT AND CONSTRUCTION PURPOSE. IF IT APPEARS THERE WILL BE AN EXCESS OR SHORTAGE OF MATERIAL, THE CONTRACTOR SHALL NOTIFY THE ENGINEER TO DETERMINE IF POSSIBLE GRADE ADJUSTMENTS CAN BE MADE.
- SITE CONTRACTOR SHALL COORDINATE WITH BUILDING CONTRACTOR TO ACCOMMODATE THE PROPER CLEARANCE BETWEEN THE BOTTOM OF THE STUCCO AND THE TOP OF THE GRADE TREATMENT ALONG THE BUILDING AS APPLICABLE, IN ACCORDANCE WITH SECTION 2512.1.2. OF THE MOST CURRENT CALIFORNIA BUILDING CODE. IF THE SUBJECT BUILDING SINKING TREATMENT IS STUCCO, CONTRACTOR SHALL NOTIFY ENGINEER IF ANY GRADES ARE ADJUSTED. CONTRACTOR SHALL ALSO APPLY FLASHING WHERE APPLICABLE WITHIN AREAS OF GRADE TREATMENT.
- ALL LANDSCAPE AREAS THAT ABOUT ANY PORTION OF THE BUILDING SHALL BE GRADED SUCH THAT THE FINISHED GRADE IN LANDSCAPE AREAS SHALL BE A MINIMUM OF EIGHT INCHES (8") BELOW FINISHED FLOOR OF THE ADJACENT BUILDING AND IN CASE SHALL THE LANDSCAPE AREA BE GRADED OR LANDSCAPED SUCH THAT WATER DRAINS TOWARD THE BUILDING.
- SINCE THE ENGINEER CANNOT CONTROL THE EXACT METHOD OR MEANS USED BY THE CONTRACTOR DURING GRADING OPERATIONS, NOR CAN THE ENGINEER GUARANTEE THE EXACT SOIL CONDITION OVER THE ENTIRE SITE, THE ENGINEER ASSUMES NO RESPONSIBILITY FOR FINAL EARTHWORK QUANTITIES.
- CONTRACTOR IS RESPONSIBLE FOR THE OFF HALL AND DISPOSAL OF ANY AND ALL EXCESS DIRT FROM CONSTRUCTION SITE.
- CONTRACTOR SHALL COORDINATE WITH THE EXISTING ADJOINING PROPERTY OWNERS PRIOR TO ANY WORK BEING STARTED THAT MAY AFFECT THEIR PROPERTY.
- CONTRACTOR SHALL PROVIDE A SMOOTH TRANSITION FROM THE PROPOSED GRADING TO THE EXISTING FLOWLINE, CURB, CONCRETE, AND OR PAVEMENT ELEVATIONS.
- ALL EXISTING WELLS AND SEPTIC TANKS SHALL BE REMOVED AND/OR ABANDONED PER THE REQUIREMENTS OF THE COUNTY HEALTH DEPARTMENT AND THE CITY OF STOCKTON. THIS WORK SHALL BE INCLUDED IN THE LUMP SUM CLEARING COST.
- CONTRACTOR SHALL VERIFY BUILDING SUBGRADE SECTIONS WITH ARCHITECT PLANS BEFORE CONSTRUCTION. IF A DISCREPANCY EXISTS, CONTRACTOR TO NOTIFY THE ENGINEER IMMEDIATELY.
- PRIOR TO CONSTRUCTING ANY FLATWORK THE CONTRACTOR SHALL VERIFY THE FINISH FLOOR ELEVATIONS AT ALL DOORS. NOTE THAT FINISH FLOOR ELEVATIONS MAY HAVE BEEN CHANGED DUE TO FOUNDATION ADJUSTMENTS IN FIELD. CONTRACTOR SHALL HOLD ADJUSTED FINISH FLOOR GRADES, ACCOUNT FOR DOOR THRESHOLDS, AND ADJUST GRADES AS NECESSARY TO STAY IN COMPLIANCE WITH CURRENT ADA STANDARDS. CONTRACTOR SHALL NOTIFY NORTSTAR ENGINEERING IMMEDIATELY IF ANY GRADE ADJUSTMENTS WILL CREATE ADA ACCESSIBILITY ISSUES.

GRADING NOTES (CONT)

- THE VALUES SHOWN ON THE GRADING PLAN ARE FOR REFERENCE AND FEE PURPOSES ONLY. SINCE THE ENGINEER CANNOT CONTROL THE EXACT METHOD OR MEANS USED BY THE CONTRACTOR DURING GRADING OPERATIONS, NOR CAN THE ENGINEER GUARANTEE THE EXACT SOIL CONDITION OVER THE ENTIRE SITE, THE ENGINEER ASSUMES NO RESPONSIBILITY FOR FINAL EARTHWORK QUANTITIES.
- THE VALUES SHOWN ON THE GRADING PLAN ARE TO AID THE CONTRACTOR IN DETERMINING THE QUANTITIES OF DIRT TO BE MOVED, THE CUT AND FILL QUANTITIES SHOWN INDICATE A THEORETICAL VARIANCE FIGURE AND ARE GIVEN ONLY AS A CONVENIENCE TO THE CONTRACTOR. THE QUANTITIES SHOWN SHALL NOT BE USED AS THE BASIS OF BID COSTS.
- EARTHWORK QUANTITY VALUES SHOWN ON PAVING PLAN REPRESENT THE DIFFERENCE BETWEEN THE ESTIMATED EXISTING GRADES FROM ASBUILT DOCUMENTS COMPARED WITH THE SUBGRADE STRUCTURAL SECTIONS OF THE PROPOSED GRADING DESIGN. SEE STRUCTURAL SECTIONS IN HATCH LEGEND ON PAVING PLAN.
- EARTHWORK QUANTITY CALCULATIONS DO NOT INCLUDE STRIPPING, SHRINKAGE, SWELL FACTORS OR MATERIAL FROM UTILITY TRENCH SPOLS.

NPDES NOTES

- STORM DRAIN NPDES PERMIT TO COMPLY WITH THE STATE OF CALIFORNIA'S STATEWIDE GENERAL NPDES PERMIT, REGULATING DISCHARGES OF STORM WATER ASSOCIATED WITH CONSTRUCTION ACTIVITY FROM SOIL DISTURBANCES OF ONE (1) ACRE OR MORE. A NOTICE OF INTENT (NOI) TO COMPLY WITH THE TERMS AND CONDITIONS OF THE GENERAL PERMIT TO DISCHARGE STORM WATER ASSOCIATED WITH CONSTRUCTION ACTIVITY MUST BE FILED AND THE APPROPRIATE FEE PAID PRIOR TO COMMENCEMENT OF CONSTRUCTION. IN ADDITION, AT THE CONCLUSION OF THE PROJECT A NOTICE OF TERMINATION (NOT) MUST ALSO BE FILED. SUBMIT THE FEE, NOI, AND NOT TO THE STATE WATER RESOURCES CONTROL BOARD UTILIZING THE STORM WATER MULTIPLE APPLICATION AND REPORT TRACKING SYSTEM (SMARTS) AT THE FOLLOWING ADDRESS:

WWW.SMARTS.WATERBOARDS.CA.GOV

FEES AND PAYMENTS CAN BE MADE TO THE FOLLOWING ADDRESS:

STATE WATER RESOURCES CONTROL BOARD
DIVISION OF WATER QUALITY
ATTN: STORM WATER PERMIT UNIT
P.O. BOX 1977
SACRAMENTO, CA 95812-1977

IF YOU HAVE ANY QUESTIONS CALL JOSEPH HENAO, WATER QUALITY CONTROL ENGINEER, CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD, AT (916) 255-3028.

THE FOLLOWING MUST BE SUBMITTED TO THE CITY PRIOR TO BEGINNING WORK AND PRIOR TO THE ISSUANCE OF AN ENCROACHMENT PERMIT:

A) TRANSMITTAL MEMO THAT INCLUDES:
* THE NAME AND PHONE NUMBER OF THE PERSON RESPONSIBLE FOR SWPPP IMPLEMENTATION, AND IF APPLICABLE, A LISTING OF THE PERSONS RESPONSIBLE FOR THE MANAGEMENT OF THE PROJECT.
* THE INSTALLATION TO SATISFY THE REQUIREMENTS OF THE CITY OF STOCKTON MUNICIPAL CODE CHAPTER TITLES 13 AND 15.
* COPY OF SWPPP MUST REMAIN ON SITE DURING CONSTRUCTION AT ALL TIMES.

B) COPY OF A SIGNED NOTICE OF INTENT FORM OR A WASTE DISCHARGE IDENTIFICATION NUMBER (WIDIN). CONTRACTOR TO PROVIDE PRIOR TO CONSTRUCTION, IF REQUIRED.

C) FOR SITES THAT HAVE SOIL DISTURBANCES OF 1 ACRE OR MORE AND ARE REQUIRED TO OBTAIN COVERAGE UNDER THE STATES CONSTRUCTION GENERAL PERMIT (CGP). THE CONTRACTOR SHALL COORDINATE WITH THE OWNER AND ENSURE THAT A QUALIFIED SWPPP PRACTITIONER (OSP) IS CONTRACTED TO PROVIDE OSP SERVICES THROUGHOUT THE COURSE OF CONSTRUCTION FROM THE START OF CONSTRUCTION TO THE DATE AT WHICH THE NOTICE OF TERMINATION - NOT - IS FILED. THE OSP SHALL BE RESPONSIBLE FOR ALL APPLICABLE INSPECTIONS, TRAINING, SAMPLING, TESTING, REPORTING, CHANGES OF INFORMATION (COI), SWPPP REVISIONS, NOTICE OF TERMINATION (NOT), AND OTHER OSP-RELATED RESPONSIBILITIES AS IDENTIFIED IN THE STATES CGP.

DEWATERING NOTES

- THE CONTRACTOR SHALL FURNISH, INSTALL, OPERATE AND MAINTAIN ALL MACHINERY APPLIANCES, AND EQUIPMENT TO MAINTAIN ALL EXCAVATIONS FREE FROM WATER DURING CONSTRUCTION. THE CONTRACTOR SHALL DISPOSE OF THE WATER SO AS NOT TO CAUSE DAMAGE TO PUBLIC OR PRIVATE PROPERTY, OR TO CAUSE A NUISANCE OR MENACE TO THE PUBLIC OR VIOLATE THE LAW. THE DEWATERING SYSTEM SHALL BE INSTALLED AND OPERATED SO THAT THE GROUNDWATER LEVEL OUTSIDE THE EXCAVATION IS NOT REDUCED TO THE EXTENT WHICH WOULD CAUSE DAMAGE OR ENDANGERED ADJACENT STRUCTURES OR PROPERTY. ALL COST FOR DEWATERING SHALL BE INCLUDED IN THE UNIT PRICE BID FOR ALL PIPE CONSTRUCTION. THE STATIC WATER LEVEL SHALL BE DRAWN DOWN A MINIMUM OF 1 FOOT BELOW THE BOTTOM OF EXCAVATIONS TO MAINTAIN THE UNDISTURBED STATE OF NATURAL SOILS AND ALLOW THE PLACEMENT OF ANY FILL TO THE SPECIFIED DENSITY. THE CONTRACTOR SHALL HAVE ON HAND, PUMPING EQUIPMENT, AND MACHINERY IN GOOD WORKING CONDITION FOR EMERGENCIES AND SHALL HAVE WORKMEN AVAILABLE FOR IT'S OPERATION. DEWATERING SYSTEMS SHALL OPERATE CONTINUOUSLY UNTIL BACK FILL HAS BEEN COMPLETED TO 1 FOOT ABOVE THE NORMAL STATIC GROUNDWATER LEVEL.
- THE CONTRACTOR SHALL CONTROL SURFACE WATER TO PREVENT ENTRY INTO EXCAVATIONS. AT EACH EXCAVATION, A SUFFICIENT NUMBER OF TEMPORARY OBSERVATION WELLS TO CONTINUOUSLY CHECK THE GROUNDWATER LEVEL SHALL BE PROVIDED.
- THE CONTROL OF GROUNDWATER SHALL BE SUCH THAT SOFTENING OF THE BOTTOM OF EXCAVATIONS, OR FORMATION OF "QUICK" CONDITIONS OR "BOILS" DOES NOT OCCUR. DEWATERING SYSTEMS SHALL BE DESIGNED AND OPERATED SO AS TO PREVENT REMOVAL OF THE NATURAL SOILS. THE RELEASE OF GROUNDWATER AT ITS STATIC LEVEL SHALL BE PERFORMED IN SUCH A MANNER AS TO MAINTAIN THE UNDISTURBED STATE OF THE NATURAL FOUNDATIONS SOILS, PREVENT DISTURBANCE OF COMPACTED BACK FILL, AND PREVENT FLOTATION OR MOVEMENT OF STRUCTURES, PIPELINES AND SEWERS. IF AN IMPACT NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM PERMIT IS REQUIRED FOR DISPOSAL OF WATER FROM CONSTRUCTION DEWATERING ACTIVITIES, IT SHALL BE OBTAINED BY THE CONTRACTOR PRIOR TO ANY DEWATERING ACTIVITIES.
- ONE HUNDRED PERCENT STANDBY PUMPING CAPACITY SHALL BE AVAILABLE ON SITE AT ALL TIMES AND SHALL BE CONNECTED TO THE DEWATERING SYSTEM PIPING TO PERMIT IMMEDIATE USE. IN ADDITION, STANDBY AUXILIARY EQUIPMENT AND APPLIANCES FOR ALL ORDINARY EMERGENCIES, AND COMPETENT WORKMEN FOR OPERATION AND MAINTENANCE OF ALL DEWATERING EQUIPMENT SHALL BE ON SITE AT ALL TIMES. STANDBY EQUIPMENT SHALL INCLUDE EMERGENCY POWER GENERATION AND AUTOMATIC SWITCH OVER TO THE EMERGENCY GENERATOR WHEN NORMAL POWER FAILS. DEWATERING SYSTEMS SHALL NOT BE SHUT DOWN BETWEEN SHIFTS, ON HOLIDAYS, ON WEEKENDS, OR DURING WORK STOPPAGES.
- SUMPS SHALL BE NO DEEPER THAN 5 FEET AND SHALL BE AT THE LOW POINT OF EXCAVATION. EXCAVATION SHALL BE GRADED TO DRAIN TO THE SUMPS.

STORM DRAIN NOTES

- ALL STORM DRAIN CONSTRUCTION, MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE LATEST EDITION OF THE CALIFORNIA PLUMBING CODE.
- THE CONTRACTOR SHALL PROVIDE ALL LIGHTS, SIGNS, BARRICADES, FLAGMEN OR OTHER DEVICES NECESSARY FOR PUBLIC SAFETY.
- THE CONTRACTOR SHALL PROVIDE ALL SHORING, BRACING, SLOPING OR OTHER PROVISIONS NECESSARY TO PROTECT WORKMEN FOR ALL AREAS TO BE EXCAVATED TO A DEPTH OF 5 FEET OR MORE. SAID PROTECTION TO BE DONE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CITY OF STOCKTON DEPARTMENT OF PUBLIC WORKS, AND STATE REGULATIONS.
- ALL MAINTENANCE HOLE RIMS TO BE ADJUSTED TO PROPOSED FINISH GRADE AFTER STREET PAVING, UNLESS OTHERWISE NOTED. COST FOR RAISING FACILITIES TO BE INCLUDED IN UNIT PRICES FOR MAINTENANCE HOLES.
- ALL STORM DRAIN LINES SHALL BE CLEARED OF ALL SAND AND DEBRIS PRIOR TO ACCEPTANCE BY THE CITY OF STOCKTON.
- THE CONTRACTOR SHALL EXPOSE ALL EXISTING STORM DRAIN PIPES, WHERE A CONNECTION IS TO BE MADE, AND NOTIFY THE ENGINEER IF THERE IS A DISCREPANCY BETWEEN THE SIGNED PLANS AND THE EXISTING FIELD CONDITION PRIOR TO THE START OF CONSTRUCTION.
- STORM DRAIN CONTRACTOR SHALL VERIFY LOCATION OF ALL EXISTING UNDERGROUND UTILITIES AND WILL BE RESPONSIBLE FOR PROTECTION OF THE SAME.
- CONTRACTOR TO BE RESPONSIBLE FOR ALL TESTING OF STORM DRAIN PIPES IN ACCORDANCE WITH THE CITY OF STOCKTON STANDARD SPECIFICATIONS AND PLANS.
- STORM DRAINAGE SYSTEM WILL BE PRIVATELY OWNED AND MAINTAINED.

STORM DRAIN NOTES (CONT)

- ALL STORM DRAIN PIPE MATERIALS SHALL BE IN ACCORDANCE WITH TABLE 701.2 OF THE 2022 CALIFORNIA PLUMBING CODE. CONTRACTOR SHALL HAVE PIPE MANUFACTURER PERFORMANCE CALCULATIONS TO DETERMINE PIPE CLASS PRIOR TO CONSTRUCTION DUE TO EXCESSIVE DEPTH.
- ALL STORM DRAIN MAINTENANCE HOLES AND BASES SHALL BE PRECAST AND CONSTRUCTED IN ACCORDANCE WITH CITY OF STOCKTON STANDARDS. CONTRACTOR SHALL SET MAINTENANCE HOLE CASTING AND COVERS TO FINISH GRADE AFTER STREET IMPROVEMENTS ARE COMPLETE, AND SHALL BE RESPONSIBLE FOR LOCATION OF MAINTENANCE HOLES BENEATH THE FINISH PAVEMENT.
- SANITARY SEWER NOTES
- ALL SANITARY SEWER CONSTRUCTION, MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CITY OF STOCKTON OR APPROPRIATE AGENCY STANDARD SPECIFICATIONS AND PLANS.
- THE CONTRACTOR SHALL EXPOSE EXISTING SANITARY SEWER WHERE CONNECTION IS TO BE MADE, SO THAT THE ENGINEER CAN VERIFY EXISTING FLOW LINES AND LOCATIONS BEFORE START OF CONSTRUCTION.
- SEWER MAINS SHALL BE INSTALLED FROM THE EXISTING FACILITIES UPSTREAM TO THE END OF THE LINE.
- ALL SANITARY SEWER CONSTRUCTION SHALL BE DONE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CITY OF STOCKTON. MAIN LINES AND LATERAL SHALL BE AIR TESTED FOR LEAKAGE IN CONFORMANCE WITH THE CITY OF STOCKTON STANDARDS.
- ALL TESTING REQUIRED BY THE CITY SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR, INCLUDING THE TELEVISION OF ALL SEWER LINES.
- THE CONTRACTOR SHALL PROVIDE ALL SHORING, BRACING, SLOPING OR OTHER PROVISIONS NECESSARY TO PROTECT WORKMEN FOR ALL AREAS TO BE EXCAVATED TO A DEPTH OF 5 FEET OR MORE. SAID PROTECTION TO BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CITY OF STOCKTON DEPARTMENT OF PUBLIC WORKS, AND STATE REGULATIONS.
- SEWER PIPE SHALL BE IN ACCORDANCE WITH TABLE 701.2 OF THE 2022 CALIFORNIA BUILDING CODE. CONTRACTOR SHALL HAVE PIPE MANUFACTURER PERFORMANCE CALCULATIONS TO DETERMINE PIPE CLASS PRIOR TO CONSTRUCTION DUE TO EXCESSIVE DEPTH.
- THE CONTRACTOR SHALL PROVIDE ALL LIGHTS, SIGNS, BARRICADES, FLAGMEN, OR OTHER DEVICES NECESSARY FOR PUBLIC SAFETY.
- ALL SANITARY SEWER CONSTRUCTION SHALL COMPLY WITH THE REQUIREMENTS OF THE STATE HEALTH DEPARTMENT, WHERE SANITARY SEWER SERVICES AND LATERALS CROSS ABOVE WATER MAINS. A 20 FEET MINIMUM JOINT OF PVC C-900 CLASS 200, OR AN 18 FEET JOINT OF CLASS 50 D.I.P., SHALL BE CENTERED ON THE SEWER MAIN. CONTRACTOR SHALL CONSTRUCT ALL CROSSINGS IN ACCORDANCE WITH THE CALIFORNIA HEALTH DEPARTMENT REQUIREMENTS.
- SEWER CONTRACTOR SHALL VERIFY LOCATION OF ALL EXISTING UNDERGROUND UTILITIES, AND WILL BE RESPONSIBLE FOR THE PROTECTION OF SAME.
- MAINTENANCE HOLE CASTINGS AND COVERS SHALL BE ADJUSTED TO FINISH GRADES BY THE PAVING CONTRACTOR AFTER STREET IMPROVEMENTS ARE COMPLETED. COST FOR ADJUSTING FACILITIES TO BE INCLUDED IN THE UNIT PRICE FOR MAINTENANCE HOLES AND CLEAVINGS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ADEQUATELY MARKING INSTALLED LOCATION OF SERVICE LATERALS. THE CONTRACTOR SHALL STAMP AN 'S' AT THE CURB FACE DIRECTLY OVER THE SERVICE.
- SANITARY SEWER SYSTEM WILL BE PRIVATELY OWNED AND MAINTAINED.

DOMESTIC AND FIRE WATER NOTES

- ALL WATER CONSTRUCTION, MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CITY OF STOCKTON, CALIFORNIA PLUMBING CODE, CALIFORNIA FIRE CODE, OR APPROPRIATE AGENCY STANDARD SPECIFICATIONS PLANS.
- CONTRACTOR SHALL EXPOSE EXISTING WATER LINES WHERE CONNECTIONS ARE TO BE MADE TO VERIFY EXISTING ELEVATION AND LOCATION PRIOR TO START OF CONSTRUCTION.
- ALL CONNECTIONS TO EXISTING CITY OF STOCKTON FACILITIES SHALL BE MADE IN THE PRESENCE OF THE CITY OF STOCKTON ENGINEER, OR HIS APPOINTED REPRESENTATIVE.
- FOR EXCAVATIONS OF FIVE FEET OR MORE, TRENCHES SHALL BE MADE IN CONFORMANCE WITH APPROPRIATE SHORING SYSTEM STANDARDS.
- PAYING REPLACEMENT TO MATCH EXISTING PAVEMENT SECTION, OR IN ACCORDANCE WITH STREET DETAILS ON THESE PLANS.
- WATER LINE TESTING SHALL BE AS FOLLOWS:
A) ALL WATER LINES SHALL BE TESTED AND DISINFECTED IN CONFORMANCE WITH THE REQUIREMENTS OF THE CITY OF STOCKTON AND THE AMERICAN WATER WORKS ASSOCIATION (AWWA) STANDARDS, SECTION C-651.
B) WATER LINE TESTING SHALL INCLUDE: HYDROSTATIC PRESSURE TESTING PER CITY OF STOCKTON STANDARDS & SPECIFICATIONS, AND BACTERIOLOGICAL TESTING PER CITY OF STOCKTON STANDARDS AND SPECIFICATIONS.
C) AFTER THE FINAL FLUSHING AND BEFORE THE NEW WATER MAIN IS CONNECTED TO THE DISTRIBUTION SYSTEM, TWO CONSECUTIVE SETS OF ACCEPTABLE SAMPLES, TAKEN 24 HOURS APART, SHALL BE COLLECTED AT SITES SHOWN ON THE PLANS. (AT LEAST ONE SET OF SAMPLES SHALL BE COLLECTED EVERY 1200 FEET OF THE NEW WATER MAIN, PLUS ONE SET AT EACH END OF THE LINE AND AT LEAST ONE SET FROM EACH BRANCH). ALL SAMPLES SHALL BE TESTED FOR BACTERIOLOGICAL QUALITY, AND SHALL SHOW THE ABSENCE OF COLIFORM ORGANISMS. A STANDARD HETEROPLIC PLATE COUNT MAY BE REQUIRED AT THE OPTION OF THE ENGINEER.
D) SAMPLES SHALL BE TAKEN FROM WATER THAT HAS STOOD IN THE NEW MAIN FOR AT LEAST 16 HOURS AFTER FINAL FLUSHING HAS BEEN COMPLETED.
E) IF THE INITIAL DISINFECTION FAILS TO PRODUCE SATISFACTORY BACTERIOLOGICAL SAMPLES, THE CONTRACTOR SHALL BE REQUIRED TO REPEAT THE DISINFECTION PROCESS AT THE SAME POINT(S) UNTIL TWO CONSECUTIVE SAMPLES ARE NEGATIVE FOR COLIFORM ORGANISMS.
F) THE DEVELOPER SHALL PAY FOR THE INITIAL BACTERIOLOGICAL TESTS. THE CONTRACTOR SHALL PAY FOR ALL TESTING NECESSITATED BY FAILURE OF THE INITIAL TEST(S).
G) IF TRENCH WATER HAS ENTERED THE NEW MAIN DURING CONSTRUCTION OR, IF IN THE OPINION OF THE CITY OF STOCKTON, EXCESSIVE QUANTITIES OF DIRT AND DEBRIS HAVE ENTERED THE NEW MAIN, BACTERIOLOGICAL SAMPLES SHALL BE TAKEN AT INTERVALS OF APPROXIMATELY 200 FEET AND SHALL BE IDENTIFIED BY LOCATION. THE CONTRACTOR SHALL INSTALL ADDITIONAL WATER SERVICE TAPS AND SANITARY DEVICES AS REQUIRED. THE CONTRACTOR SHALL ALSO REMOVE SAMPLING STATIONS AND SERVICES UPON SATISFACTORY COMPLETION OF TESTING. THE CONTRACTOR SHALL PAY FOR TESTING OF THE CONTAMINATED AREAS.
H) CONTRACT PRICE SHALL INCLUDE FULL COMPENSATION FOR FURNISHING ALL LABOR, MATERIALS, TOOLS, EQUIPMENT, AND INCIDENTALS, AND FOR DOING ALL OF THE WORK INVOLVED IN TESTING AND DISINFECTION OF THE WATER MAINS.
- CONTRACTOR SHALL PROVIDE ALL LIGHTS, SIGNS, BARRICADES, FLAGMEN, OR OTHER DEVICES NECESSARY FOR PUBLIC SAFETY.
- PIPE WATER MATERIALS SHALL BE IN ACCORDANCE WITH TABLE 604.1 OF THE 2022 CALIFORNIA PLUMBING CODE.
- DEPTH OF PIPE SHALL BE 36 INCHES MINIMUM FROM FINISHED GRADE, 30 INCHES MINIMUM FROM EXISTING UNDERGROUND UTILITIES, AND 18 INCHES MINIMUM FROM SUBGRADE IN NEW STREETS, WHICHEVER IS GREATER AS SPECIFIED BY THE CITY OF STOCKTON.
- WATER LINE IMPROVEMENTS MUST BE REVIEWED AND APPROVED BY THE CITY OF STOCKTON.
- WHERE WATER LINE CROSSES UNDER STORM DRAIN, A 20 FEET MIN JOINT OF PVC C-900 CLASS 200, OR AN 18 FEET JOINT OF CLASS 50 D.I.P. SHALL BE CENTERED ON STORM DRAIN OR IN ACCORDANCE WITH CITY OF STOCKTON STANDARDS AND SPECIFICATIONS.
- PROVIDE THRUST BLOCKS AT FIRE HYDRANTS, BLOW-OFFS, TEES, AND AT CHANGES IN SIZE AND DIRECTION, AND AT CURB, BENDS, AND ENDS. IN CASE THRUST BLOCKS AS REQUIRED, IN ACCORDANCE WITH CITY OF STOCKTON STANDARDS AND SPECIFICATIONS.

DOMESTIC AND FIRE WATER NOTES (CONT)

- CONTRACTOR IS ADVISED THAT ANY FIELD CHANGES DUE TO EXISTING CONDITIONS MUST COMPLY WITH STATE HEALTH DEPARTMENT CRITERIA.
- ALL VALVE BOXES TO BE ADJUSTED TO FINISH GRADE AFTER PAVING. COST FOR RAISING FACILITIES TO BE INCLUDED IN UNIT PRICES FOR VALVES.
- ALL VALVES TWELVE (12) INCHES AND LARGER SHALL BE BUTTERFLY VALVES AND OPERATORS INTENDED FOR BURIED SERVICE IN A DOMESTIC WATER SYSTEM.
- ACTUAL CONNECTIONS TO EXISTING WATER LINES WILL NOT BE PERMITTED PRIOR TO THE COMPLETION OF STERILIZATION AND TESTING OF NEW WATER MAINS. ALL EXISTING WATER VALVES TO BE OPERATED UNDER THE DIRECTION OF THE WATER DIVISION OF THE REGULATORY AGENCY PERSONNEL ONLY.
- REDUCED PRESSURE BACKFLOW PREVENTION DEVICE MUST BE INSPECTED AND APPROVED BY AN APPROVED TESTING FIRM PRIOR TO THE FINAL APPROVAL OF THE BUILDING.
- THE WATER METER AND METER BOX SHALL BE PROVIDED AND INSTALLED BY THE CITY OF STOCKTON, PAID BY THE DEVELOPER.
- FIRE HYDRANT MAINS SHALL BE HYDROSTATICALLY TESTED AT 50 PSI FOR ONE HOUR AND FIRE SPRINKLER MAINS, ON THE SYSTEM SIDE OF THE FDC, SHALL BE HYDROSTATICALLY TESTED AT 200 PSI FOR TWO HOURS. CALL THE FIRE PREVENTION BUREAU 48 HOURS PRIOR TO DESIRED TEST.
- SELF ADHESIVE BLUE REFLECTIVE FIRE HYDRANT MARKERS ARE TO BE PROVIDED TO THE FIRE DEPARTMENT BY THE CONTRACTOR. THEY SHALL BE PROVIDED AT A RATIO OF ONE REFLECTOR PER HYDRANT, UNLESS THE FIRE HYDRANT PASSES TWO STREETS THEN TWO REFLECTORS SHALL BE REQUIRED. CONTRACTOR SHALL REFER TO THE MUTCD, CALIFORNIA SUPPLEMENT, SECTION 3B.11 AND FIGURE 3B-102.
- CONTRACTOR SHALL PAINT FIRE HYDRANTS WITH ENAMEL SAFETY YELLOW PAINT.
- FIRE HYDRANT STEM BREAKAWAY MUST COINCIDE WITH BREAKAWAY SPOOL.
- A LOCATING "TRACE WIRE" IS REQUIRED ON ALL MAINS AND SERVICE LINES. THE "TRACE WIRE" SHALL BE FIRMLY ATTACHED TO THE TOP CENTER OF THE PIPE AT INTERVALS NOT EXCEEDING FIVE (5) FEET. ALL MAIN LINE "TRACE WIRES" SHALL BE INTERCONNECTED TO FORM A GRID. ALL SPICES SHALL BE NEUTRALIZED AND THE LOCATING WIRE SHALL BE MADE WATERPROOF WITH AN APPROVED COMPOUND. INSTALLATION OF THE "TRACE WIRE" SYSTEM SHALL BE INSPECTED AND APPROVED BY THE ENGINEER PRIOR TO BACKFILL. THE "TRACE WIRE" SYSTEM SHALL BE TESTED BY APPROVED TESTING PERSONNEL AFTER THE TRENCHES HAVE BEEN BACKFILLED AND HYDROSTATIC TESTS HAVE BEEN PERFORMED, BUT BEFORE ANY PAVEMENT HAS BEEN PLACED. THE CITY SHALL PAY THE COST OF THE INITIAL TEST. ANY SUBSEQUENT TESTING COSTS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- THE DISCHARGE OF CHLORINATED AND DE-CHLORINATED WATER INTO THE STORM DRAIN SYSTEM IS PROHIBITED. THE DISCHARGE OF CHLORINATED AND DE-CHLORINATED WATER INTO THE SANITARY SEWER SYSTEM REQUIRES PRIOR APPROVAL FROM MUD.
- WATER SYSTEM WILL BE PRIVATELY OWNED AND MAINTAINED.
- PRIOR TO COMMENCEMENT OF CONSTRUCTION, THE FIRE DEPARTMENT REQUIRES ALL ACCESS ROADS AND WATER SUPPLIES TO BE SUFFICIENTLY PROVIDED FOR THE PROPOSED DEVELOPMENT. IF THERE IS ANY ALTERNATION TO THIS REQUIREMENT, THE PROPOSED DEVELOPMENT WILL BE SUBJECT TO A FINE AND AN ORDER OF COMPLIANCE MAY BE SHUTDOWN FOR AN INDEFINITE PERIOD OF TIME, OR UNTIL COMPLIANCE HAS BEEN MET.

TOPOGRAPHY NOTES

- PLAN SET DESIGN BASED OFF OF TOPOGRAPHIC SURVEY PERFORMED ON FEB 27, 2024. CONTRACTOR SHALL BE AWARE THAT SINCE THIS INITIAL SURVEY THE SITE MAY HAVE CHANGED.
- ALL EXISTING UTILITIES WERE PLOTTED FROM RECORD INFORMATION AND FIELD TOPOGRAPHY. ACTUAL LOCATIONS MAY VARY AND ADDITIONAL CROSSINGS MAY EXIST IN THE FIELD.
- THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN EXPOSING EXISTING UTILITY CROSSINGS AND SERVICES.
- ANY DAMAGE TO EXISTING UTILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.
- PRIOR TO BEGINNING CONSTRUCTION THE CONTRACTOR SHALL CALL U.S.A. (800) 227-2600 TO HAVE THE SITE MARKED. THE CONTRACTOR SHALL POTHOLE ALL EXISTING UTILITIES TO VERIFY THAT NO CONFLICTS EXIST BETWEEN PROPOSED AND EXISTING IMPROVEMENTS.
- CONTRACTOR/DEVELOPER SHALL OBTAIN AN ENCROACHMENT PERMIT FROM THE APPROPRIATE AGENCY TO DO ANY WORK WITHIN RIGHT-OF-WAY PRIOR TO CONSTRUCTION.
- IN CONJUNCTION WITH CONTACTING USA TO LOCATE UNDERGROUND UTILITIES WITHIN THE PUBLIC RIGHT-OF-WAY IT IS HIGHLY RECOMMENDED THAT THE CONTRACTOR UTILIZE (GPS) GROUND PENETRATING RADAR UNDERGROUND SERVICES TO IDENTIFY ONSITE UTILITIES THAT MAY NOT BE VISIBLE FROM THE SURFACE.
- CONTRACTOR SHALL REVIEW ALL OF THE CONSULTANTS PLAN SETS FOR ADDITIONAL DEMOLITION, REPLACEMENT AND IMPROVEMENTS WORK. IF A CONFLICT IS FOUND THEN THE CONTRACTOR SHALL NOTIFY THE ARCHITECT AND ENGINEER IMMEDIATELY.

B) WHEN MONUMENTS EXIST THAT CONTROL THE LOCATION OF SUBDIVISIONS, TRACTS, BOUNDARIES, ROADS, STREETS, OR HIGHWAYS, OR PROVIDE HORIZONTAL OR VERTICAL SURVEY CONTROL, THE MONUMENTS SHALL BE LOCATED AND REFERENCED BY OR UNDER THE DIRECTION OF A LICENSED LAND SURVEYOR OR REGISTERED CIVIL ENGINEER PRIOR TO THE TIME WHEN ANY STREETS, HIGHWAYS, OTHER RIGHTS-OF-WAY, OR EASEMENTS ARE IMPROVED, CONSTRUCTED, RECONSTRUCTED, MAINTAINED, RESURFACED, OR RELOCATED, AND A CORNER RECORD OR RECORD OF WAY OR EASEMENT LINES SHALL BE REQUIRED ADEQUATE FOR THIS PURPOSE. THEY SHALL BE RESET IN THE SURFACE OF THE NEW CONSTRUCTION, A SUITABLE MONUMENT BOX PLACED THEREON, OR PERMANENT WITNESS MONUMENTS SET TO PERPETUATE THEIR LOCATION IF ANY MONUMENT COULD BE DESTROYED, DAMAGED, COVERED, OR OTHERWISE OBLITERATED, AND A CORNER RECORD OR RECORD OF SURVEY FILED WITH THE COUNTY SURVEYOR PRIOR TO THE RE-OPENING OF A CERTIFICATE OF COMPLETION FOR THE PROJECT. SUFFICIENT CONTROLLING MONUMENTS SHALL BE RETAINED OR REPLACED IN THEIR ORIGINAL POSITIONS TO ENABLE PROPERTY, RIGHT-OF-WAY AND EASEMENT LINES, PROPERTY CORNERS, AND SUBDIVISION AND TRACT BOUNDARIES TO BE REESTABLISHED WITHOUT PREVIOUS SURVEYS NECESSARILY ORIGINATING ON MONUMENTS DIFFERING FROM THOSE THAT CURRENTLY CONTROL THE AREA. IT SHALL BE THE RESPONSIBILITY OF THE GOVERNMENTAL AGENCY OR OTHERS PERFORMING CONSTRUCTION WORK TO PROVIDE FOR THE MONUMENTATION REQUIRED BY THIS SECTION. IT SHALL BE THE DUTY OF EVERY LAND SURVEYOR OR CIVIL ENGINEER TO COOPERATE WITH THE GOVERNMENTAL AGENCY IN MATTERS OF MAPS, FIELD NOTES, AND OTHER PERTINENT RECORDS. MONUMENTS SET TO MARK THE LIMITING LINES OF HIGHWAYS, ROADS, STREETS OR RECORD OF WAY OR EASEMENT LINES SHALL BE REQUIRED ADEQUATE FOR THIS PURPOSE, UNLESS SPECIFICALLY NOTED ON THE CORNER RECORD OR RECORD OF SURVEY OF THE IMPROVEMENT WORKS WITH DIRECT TIES IN BEARING OR AZIMUTH AND DISTANCE BETWEEN THESE AND OTHER MONUMENTS OF RECORD.
- CONTRACTOR SHALL COORDINATE WITH THE LAND SURVEYOR OF RECORD, PRIOR TO STARTING CONSTRUCTION, TO IDENTIFY ALL SURVEY MONUMENTS THAT MAY BE SUBJECT TO DISTURBANCE AND SHALL INCLUDE COSTS FOR MONUMENT PRESERVATION, REPLACEMENT, AND PREPARATION OF CORNER RECORDS OR RECORD OF SURVEY IN CONTRACTORS BID.

D) THE DECISION TO FILE EITHER THE REQUIRED CORNER RECORD OR A RECORD OF SURVEY PURSUANT TO SUBDIVISION (B) SHALL BE AT THE ELECTION OF THE LICENSED LAND SURVEYOR OR REGISTERED CIVIL ENGINEER SUBMITTING THE DOCUMENT, AT CONTRACTORS EXPENSE.

6732 S, §1492 S, §1810 S OF THE CALIFORNIA STATUTES AND HIGHWAYS CODES STATE: SURVEY MONUMENTS, AND INSTALL THRUST BLOCKS AS REQUIRED, OR REPLACED PURSUANT TO SECTION 8772 OF THE BUSINESS AND PROFESSIONS CODE.



TOPOGRAPHY NOTES(CONT)

- CONTRACTOR TO BE CAUTIOUS OF UNDERGROUND STUBS AND LINES. CONTRACTOR SHALL USE EXTREME CAUTION AS TO OTHER LINES MAY EXIST ON THE SITE THAT ARE NOT CLEARLY MARKED.
- AN ATTEMPT HAS BEEN MADE TO SHOW ALL EXISTING STRUCTURES, UTILITIES, DRIVES, PAVEMENTS, CURBS, WALKS, ETC. IN THEIR APPROXIMATE LOCATION ON THE SURVEY AND/OR WORKING DRAWINGS. HOWEVER, OTHERS THAT ARE NOT SHOWN MAY EXIST AND MAY BE FOUND UPON VISITING THE SITE OR DURING THE CLEARING AND REMOVAL WORK. IT WILL BE THE RESPONSIBILITY OF THIS CONTRACTOR TO ACCURATELY LOCATE ALL EXISTING FACILITIES AND TO DETERMINE THEIR EXTENT IF SUCH FACILITIES OBSTRUCT THE PROGRESS OF THE WORK AND ARE NOT INDICATED TO BE REMOVED OR RELOCATED, THEY SHALL BE REMOVED OR RELOCATED ONLY AS DIRECTED BY THE OWNER.
- THE CONTRACTOR SHALL REPORT ANY EXISTING SITE ELEMENT NOT SHOWN ON THE WORKING DRAWINGS TO THE ARCHITECT OF RECORD SO THAT THE PROPER DISPOSITION OF THAT ELEMENT MAY BE MADE.

SITE LAYOUT NOTES

CITY OF STOCKTON STANDARD DETAILS

1. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL OBTAIN THE MOST UP TO DATE CITY STANDARDS FOR REFERENCE PRIOR TO AND DURING CONSTRUCTION.

2. THE LATEST COPY OF THE CITY OF STOCKTON STANDARDS SHALL BE CONSIDERED PART OF THIS PLAN SET.

3. IN THE EVENT OF A DISCREPANCY BETWEEN THIS PLAN SET AND CITY STANDARDS, THE CITY STANDARDS SHALL PREVAIL.

4. STANDARD PLAN DRAWINGS REFERENCED WITHIN THIS PLAN SET INCLUDE, BUT ARE NOT LIMITED TO THE FOLLOWING DRAWINGS:

CITY OF STOCKTON:

DTL No. R-36..... EXISTING STREET TRENCH SECTION FOR TRENCHES LARGER THAN 8"

DTL No. R-37..... EXISTING STREET TRENCH SECTION FOR TRENCHES 8" AND LESS

DTL No. R-42..... TRENCH SECTION HDPE PIPE

DTL No. R-50..... SIDEWALK DETAILS

DTL No. R-51..... ROLL CURB, GUTTER & SIDEWALK

DTL No. R-55..... CONCRETE CURB, GUTTER & SIDEWALKS CONSTRUCTION STANDARDS

DTL No. S-4..... CALIFORNIA HEALTH DEPARTMENT REQUIREMENTS

DTL No. S-15..... PROTECTION OF STORM DRAINS AND SANITARY SEWER LINES

DTL No. S-17..... SEWER CLEANOUT LOCATION

DTL No. S-18..... CLEANOUT

DTL No. W-1..... WATER DESIGN DATA

DTL No. W-3..... WATER SERVICE INSTALLATION 1", 1.5" AND 2" SERVICE

DTL No. W-4..... FITTINGS FOR WATER SERVICE

DTL No. W-12..... THRUST BLOCK DETAILS


DTL No. W-13..... FIRE HYDRANT

DTL No. W-14..... FIRE HYDRANT SPACING

DTL No. W-15..... FIRE HYDRANT LOCATION

DTL No. W-16..... FIRE PROTECTION SYSTEM STANDARDS


DTL No. W-17..... TYPICAL FIRE PROTECTION CONNECTION

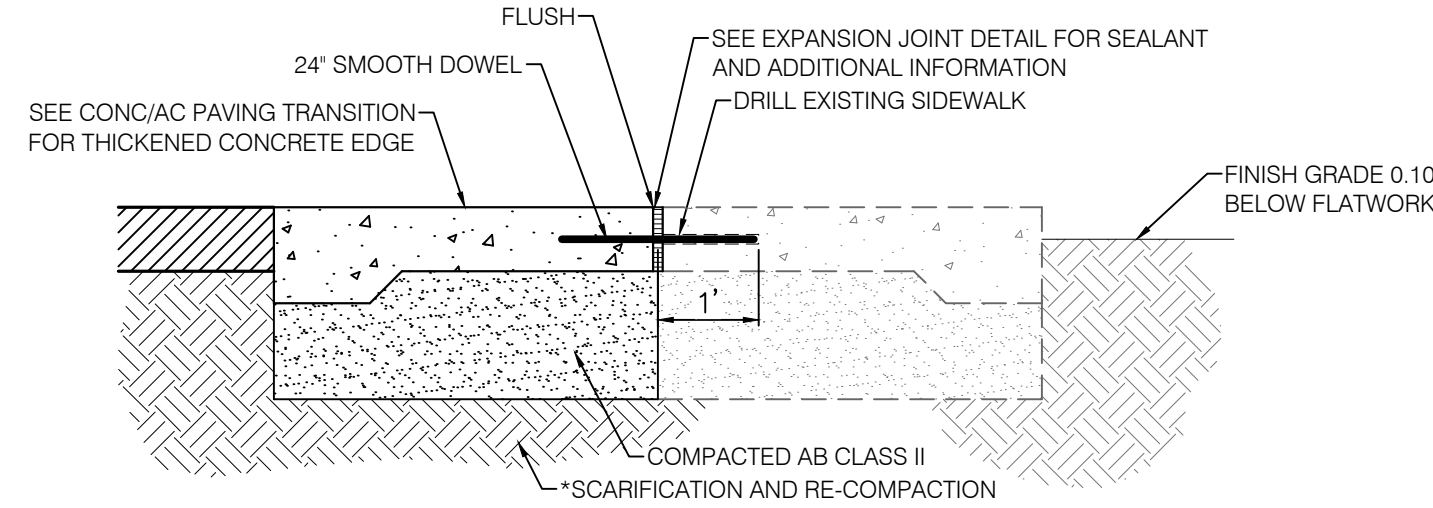


- *NOTE:
- *SUBGRADE PREPARATION REQUIREMENTS PER GEOTECHNICAL RECOMMENDATIONS, CITY OF STOCKTON STANDARDS, AND PROJECT SPECIFICATIONS.
 - AT EXPANSION JOINT USE 1/2"x24" SMOOTH DOWELS, 18" OC GREASE 1/2 THE LENGTH BEFORE CONCRETE PLACEMENT. SEE EXPANSION JOINT DETAIL THIS SHEET.
 - CONSTRUCT CONTROL AND CONSTRUCTION JOINTS IN ACCORDANCE WITH CURRENT PORTLAND CEMENT ASSOCIATION GUIDELINES.
 - SEE STRUCTURAL SECTIONS ON DIMENSION AND PAVING PLANS: SHEET C3.1

1 CONCRETE FLATWORK AT EXISTING FLATWORK

- *NOTE:
- *SUBGRADE PREPARATION REQUIREMENTS PER GEOTECHNICAL RECOMMENDATIONS, CITY OF STOCKTON STANDARDS, AND PROJECT SPECIFICATIONS.
 - AT EXPANSION JOINT USE 1/2"x24" SMOOTH DOWELS, 18" OC GREASE 1/2 THE LENGTH BEFORE CONCRETE PLACEMENT. SEE EXPANSION JOINT DETAIL THIS SHEET.
 - CONSTRUCT CONTROL AND CONSTRUCTION JOINTS IN ACCORDANCE WITH CURRENT PORTLAND CEMENT ASSOCIATION GUIDELINES.
 - SEE STRUCTURAL SECTIONS ON DIMENSION AND PAVING PLAN SHEET C3.1.

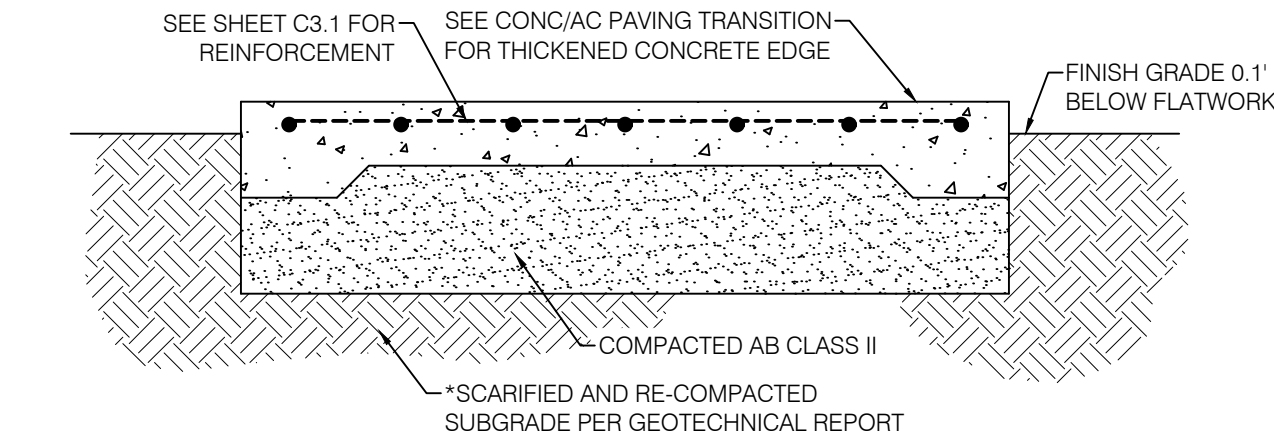


2 CONCRETE FLATWORK

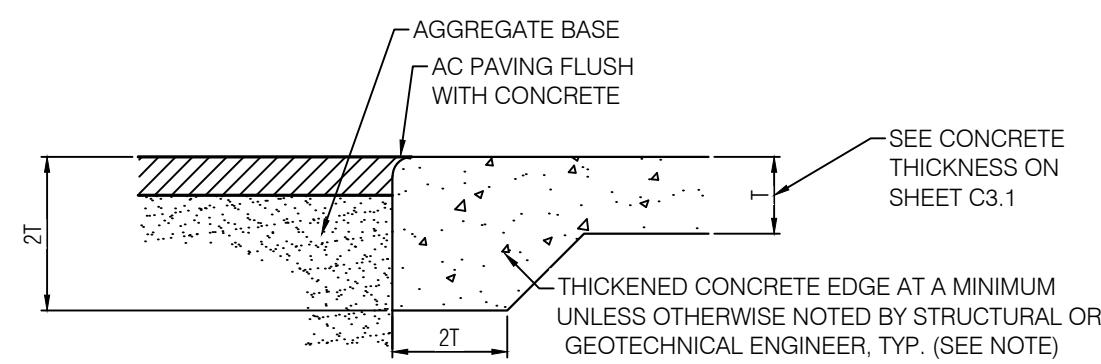


NOTE:
CONTRACTOR SHALL TRANSITION THICKENED EDGE PER SOILS REPORT RECOMMENDATIONS.


3 CONC / AC PAVING TRANSITION AND THICKENED EDGE

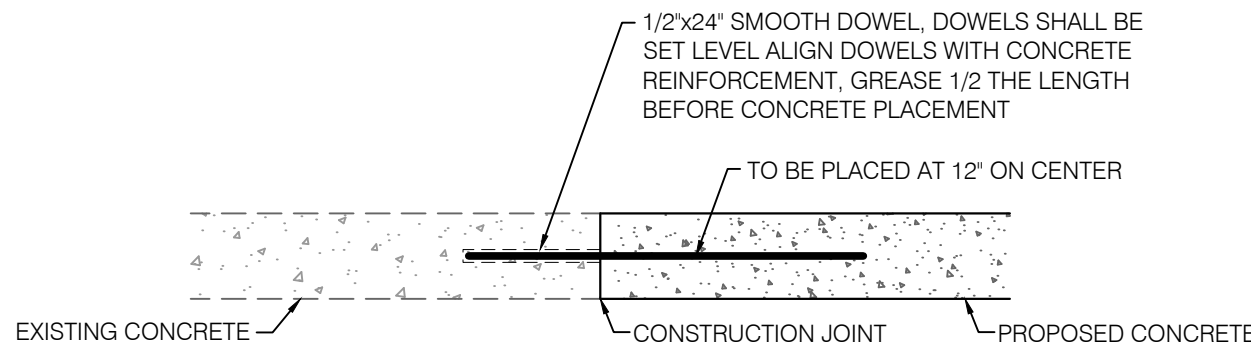


4 CONSTRUCTION JOINT

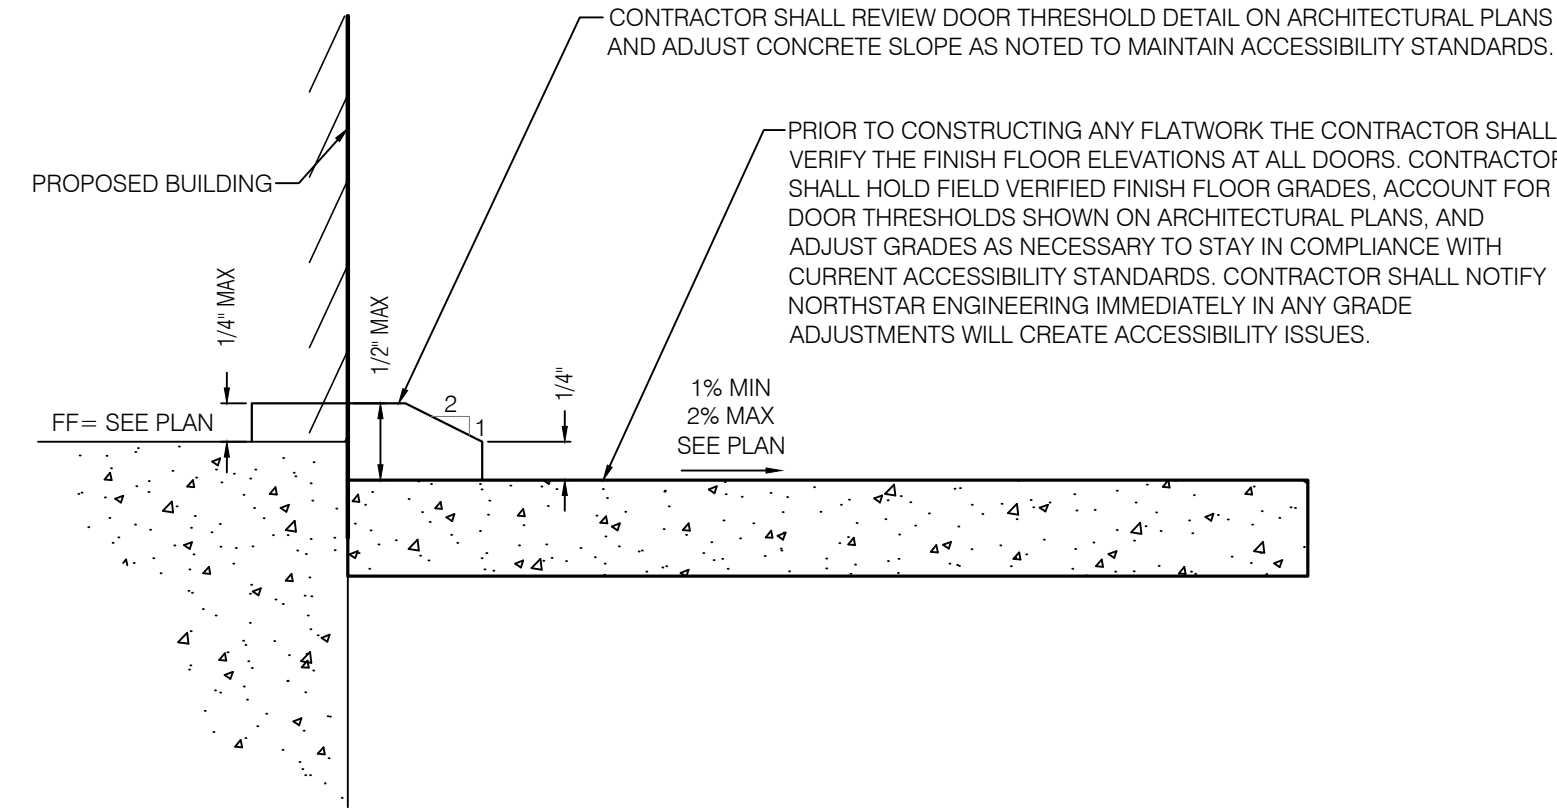

5 TYPICAL DOOR THRESHOLD AT CONCRETE LANDING

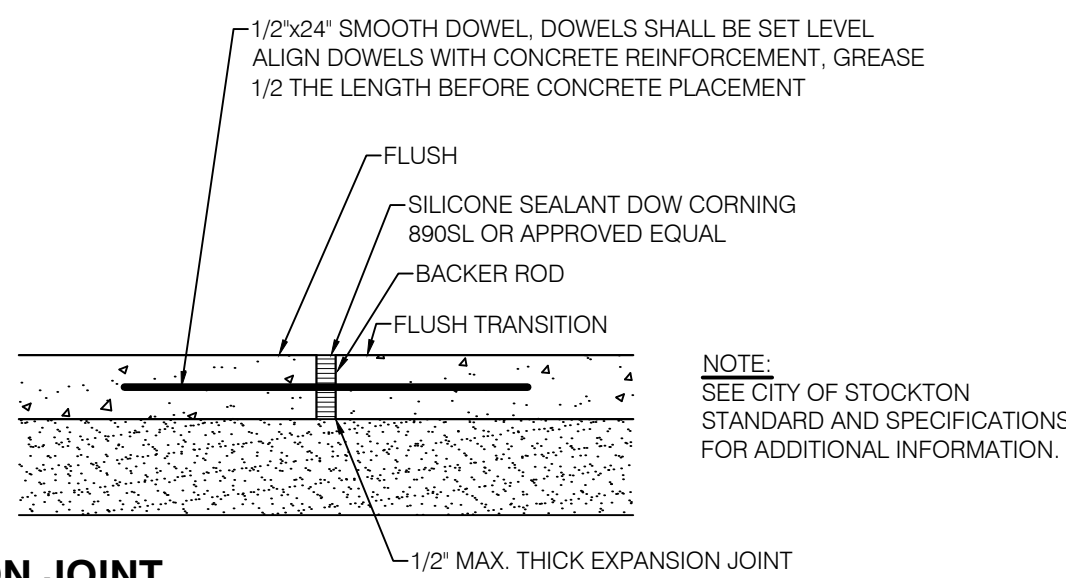


6 EXPANSION JOINT

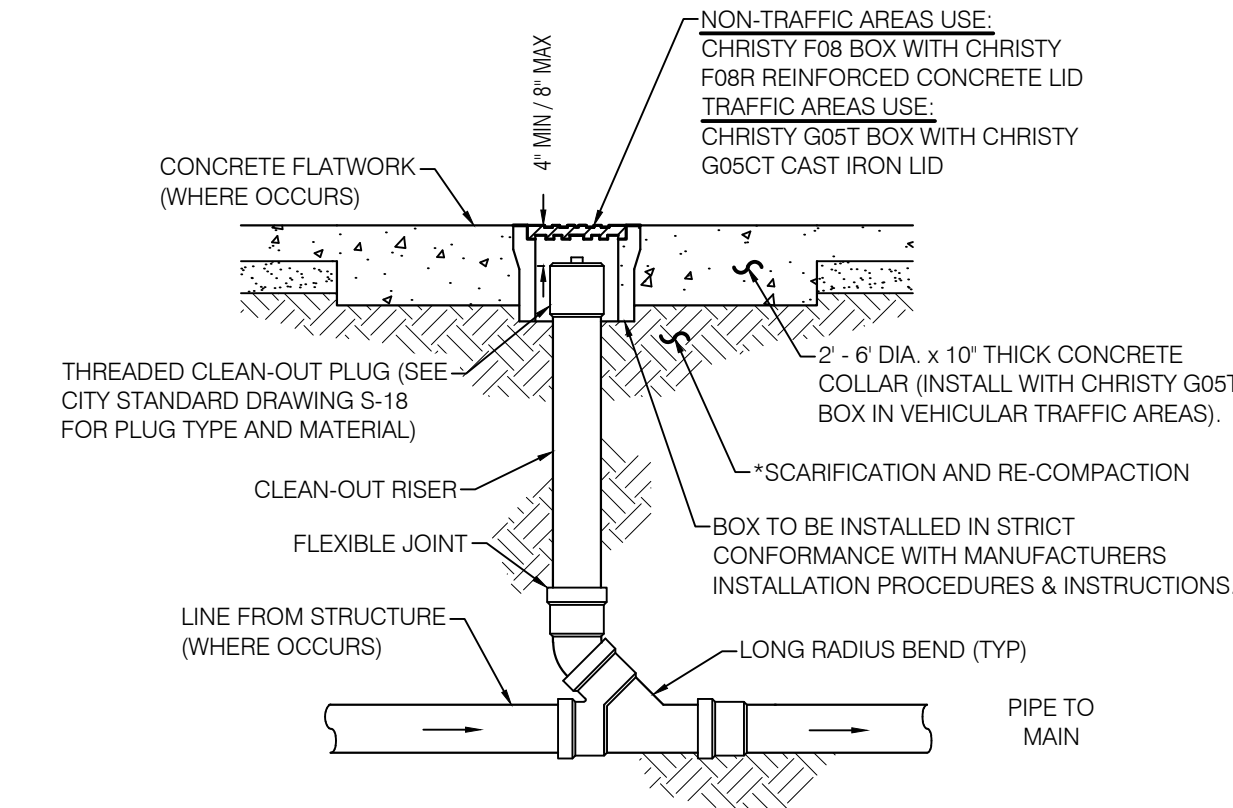

- *NOTE:
- CLEAN-OUT RISER SHALL BE THE SAME SIZE AS THE LATERAL.
 - CLEAN-OUT RIM SHALL BE FLUSH WITH GRADE, ADA COMPLIANT AND "HEEL PROOF."
 - *SUBGRADE PREPARATION REQUIREMENTS PER GEOTECHNICAL REPORT


7 TYPICAL STORM DRAIN OR SANITARY SEWER CLEAN OUT RISER

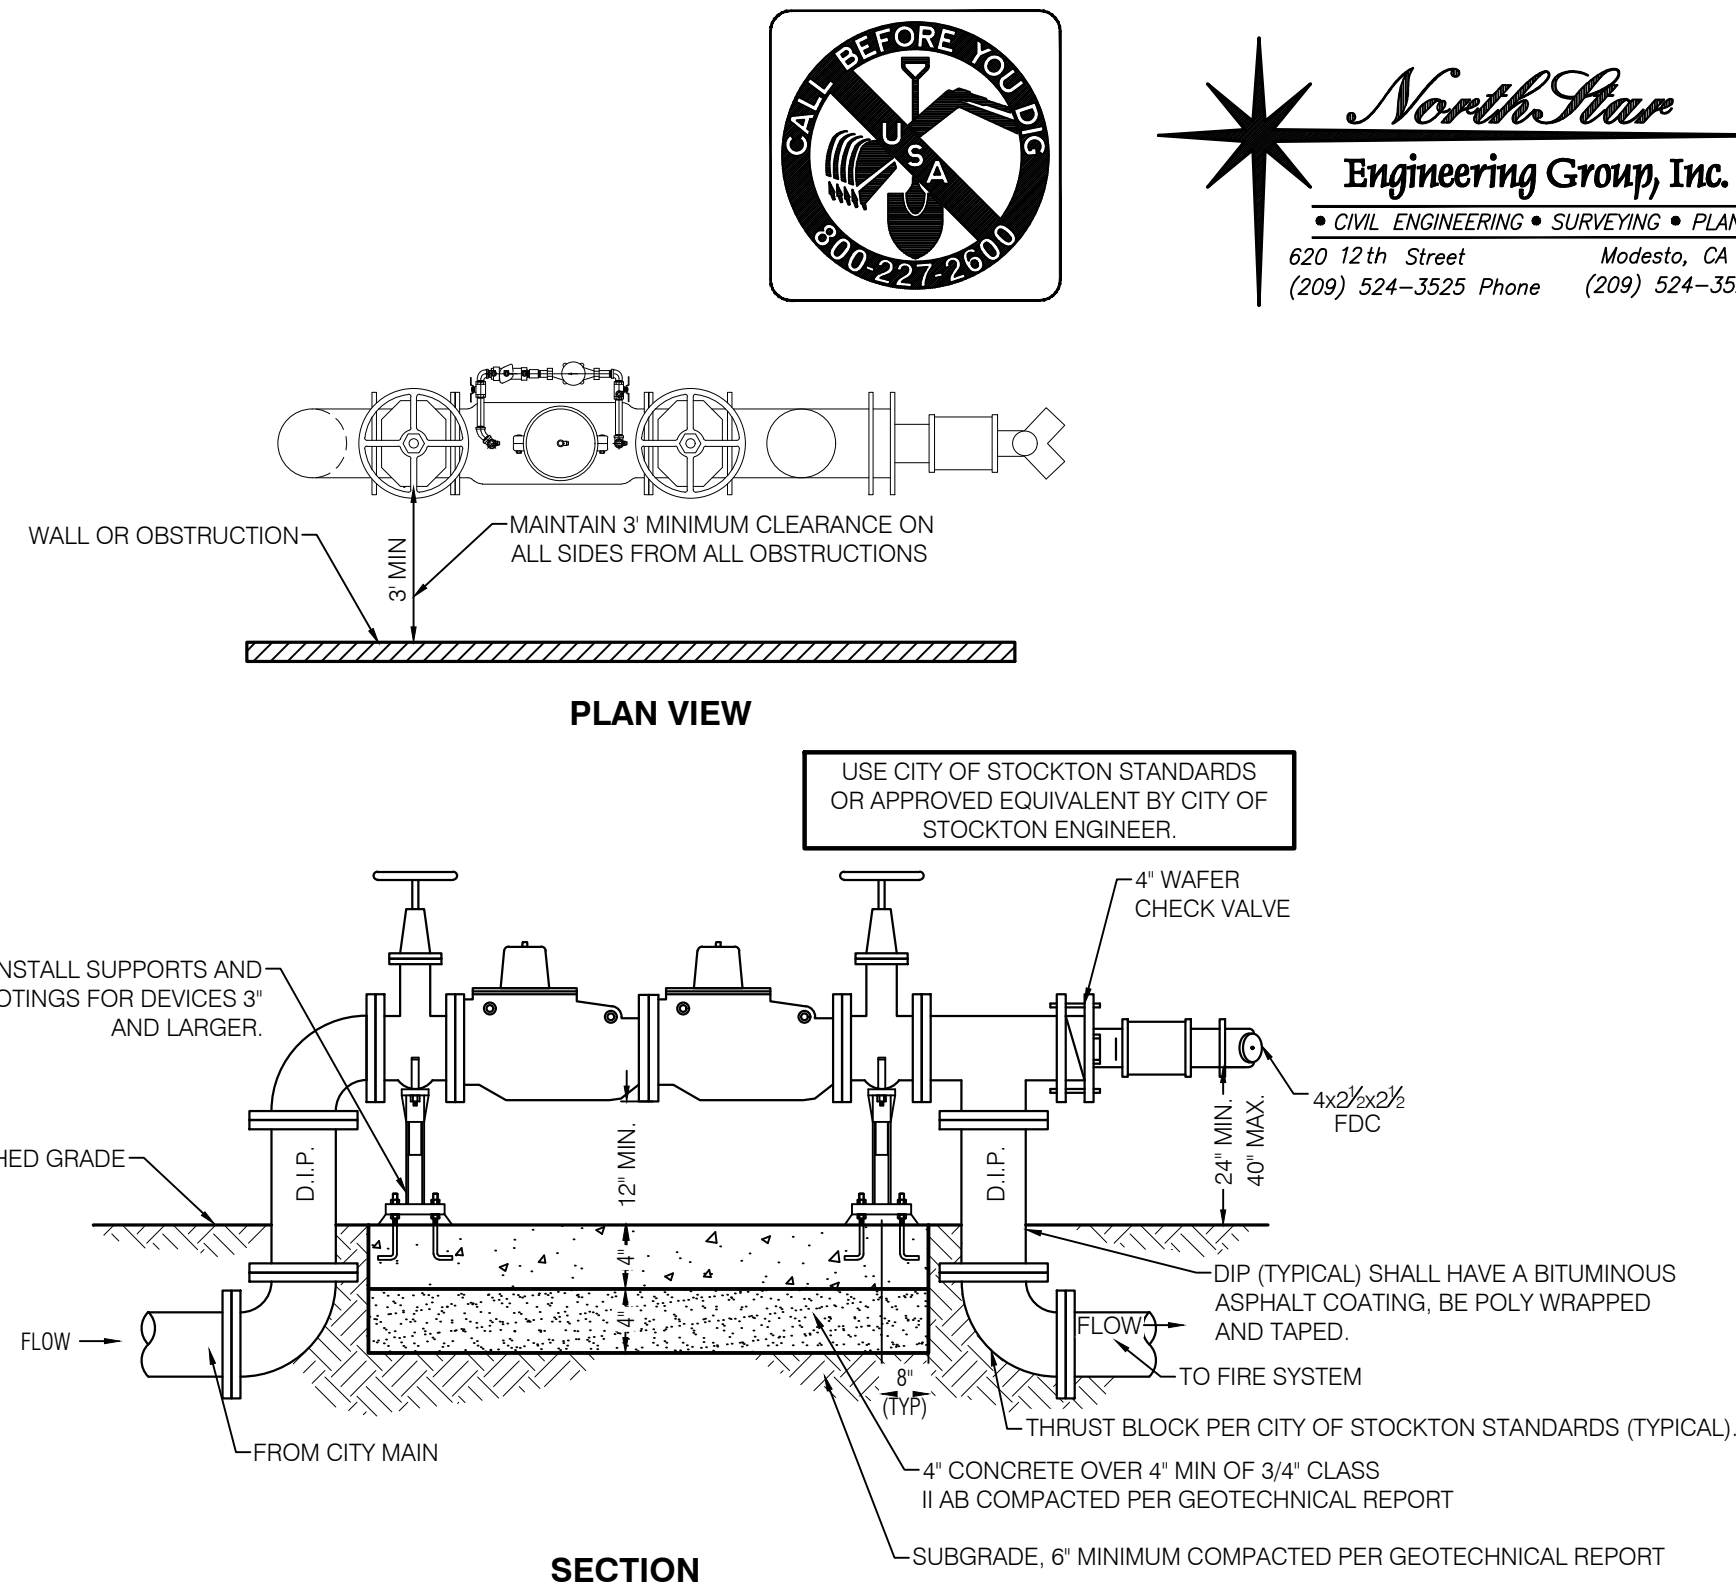

- NOTES:
- FDC SHALL BE INSTALLED ON BUILDING SIDE.
 - SEE CITY OF STOCKTON APPROVED DOUBLE DETECTOR CHECK VALVE (BACKFLOW PREVENTION ASSEMBLY) SPECIFICATIONS.
 - CONTRACTOR SHALL INSTALL OS&Y AND TAMPER SWITCH PER CITY OF STOCKTON STANDARDS AND SPECIFICATIONS.
 - CONTRACTOR SHALL COORDINATE WITH OWNER AND ELECTRICAL ENGINEER TO RUN CONDUIT TO TAMPER SWITCH.

8 DOUBLE DETECTOR CHECK VALVE WITH FIRE DEPARTMENT CONNECTION

9 RESERVED

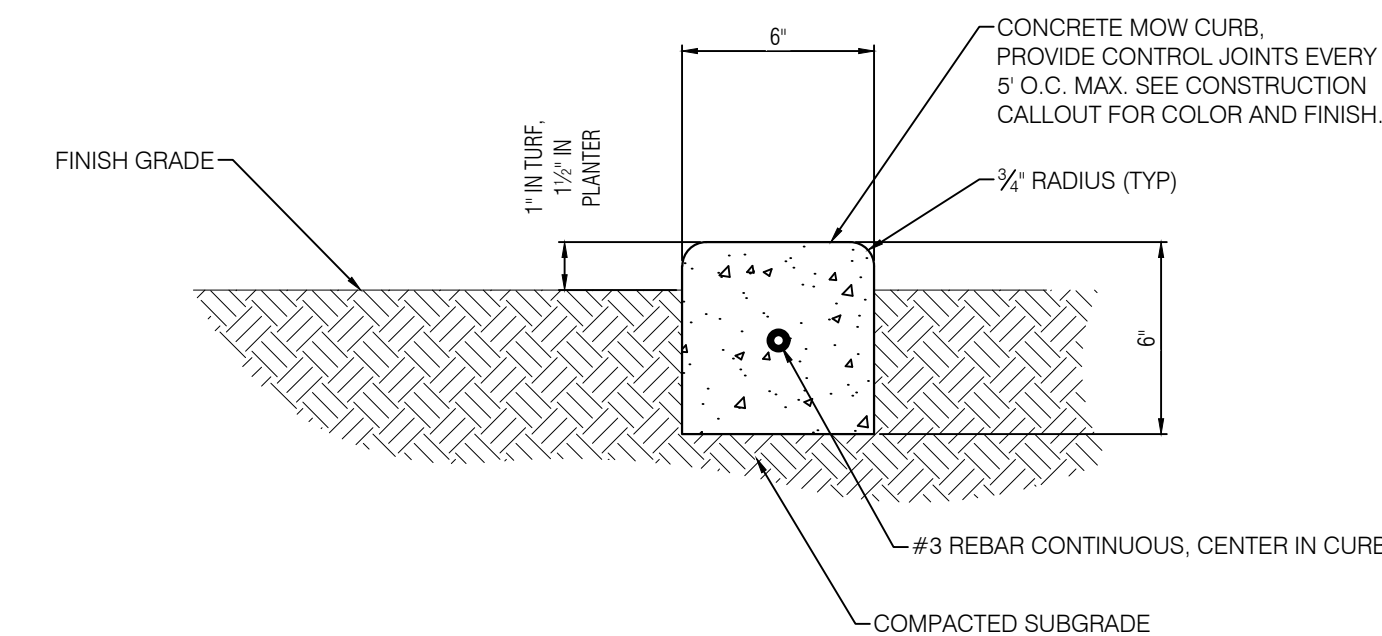

10 6" LANDSCAPE CONCRETE MOW STRIP


IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly
reserves its common law
rights in the design and
any other project without
prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

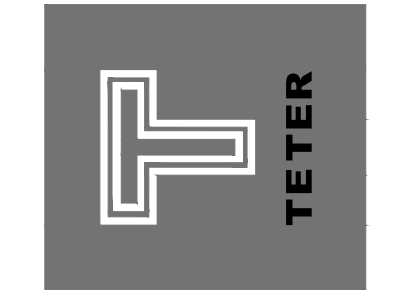

CIVIL IMPROVEMENT PLANS FOR
PEYTON ELEMENTARY
SCHOOL
STOCKTON, CALIFORNIA
DRAWING TITLE
DETAILS AND CROSS SECTIONS

PROJECT NO.

23-12862

DRAWING

C1.4





North Star
Engineering Group, Inc.
• CIVIL ENGINEERING • SURVEYING • PLANNING •
620 12th Street Modesto, CA 95354
(209) 524-3525 Phone (209) 524-3526 Fax

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly
reserves its common law
rights and all other
property rights in these
plans. This document, the
ideas and designs
incorporated herein, as an
instrument of professional
service, is not to be used
in whole or in part, for
any other project without
prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.

FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED




CIVIL IMPROVEMENT PLANS FOR
PEYTON ELEMENTARY
SCHOOL
STOCKTON, CALIFORNIA
DRAWING TITLE
DETAILS AND CROSS SECTIONS

PROJECT NO.
23-12862

DRAWING

C1.5

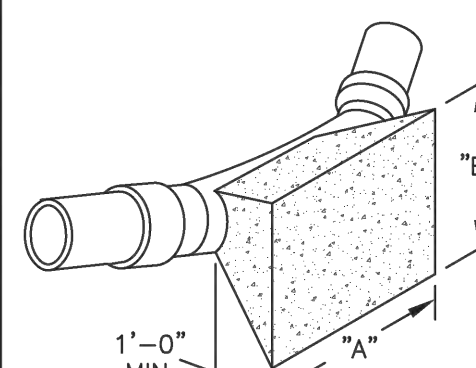

THRUST BLOCK AREA IS BASED ON THE SIZE OF THE BRANCH LINE.

1'-0" MIN.

"B"

"A"

1'-0" MIN.

"B"

"A"

1'-0" MIN.

"B"

"A"

TYPICAL THRUST BLOCK BEND

45° MAX. (TYP. FOR ALL ANGLES).

1'-0" MIN.

TYPICAL SECTION THRU THRUST BLOCK

TYPICAL THRUST BLOCK TEE OUTLET


TYPICAL THRUST BLOCK DEAD END

FITTINGS	THRUST BLOCK AREA REQUIRED	
	ALLOWABLE SOIL BEARING VALUE 1000 LBS. PER SQ. FT.	
6" LINE OR SMALLER	"A"	"B"
22 1/2	1'-6"	1'-6"
45°	2'-0"	2'-0"
90°	3'-0"	2'-6"
TEE OUTLET	2'-6"	2'-0"
DEAD END	2'-6"	2'-0"
8" LINE		
22 1/2	2'-0"	2'-0"
45°	3'-0"	2'-6"
90°	4'-0"	3'-0"
TEE OUTLET	3'-0"	3'-0"
DEAD END	3'-0"	3'-0"
10" LINE		
22 1/2	3'-0"	2'-0"
45°	3'-6"	3'-0"
90°	5'-0"	4'-0"
TEE OUTLET	4'-0"	3'-6"
DEAD END	4'-0"	3'-6"
12" LINE		
22 1/2	3'-0"	3'-0"
45°	4'-0"	4'-0"
90°	7'-0"	4'-0"
TEE OUTLET	5'-0"	4'-0"
DEAD END	5'-0"	4'-0"

THRUST BLOCK DETAILS

CITY OF STOCKTON
DEPARTMENT OF PUBLIC WORKS

REVISION NO. 4
DATE 09/27/2016


APPROVED BY CITY ENGINEER:


SCALE NONE
SUPERSEDES DWG. DATED 01/09/02


DRAWING NO. W-12

1 THRUST BLOCK

NTS

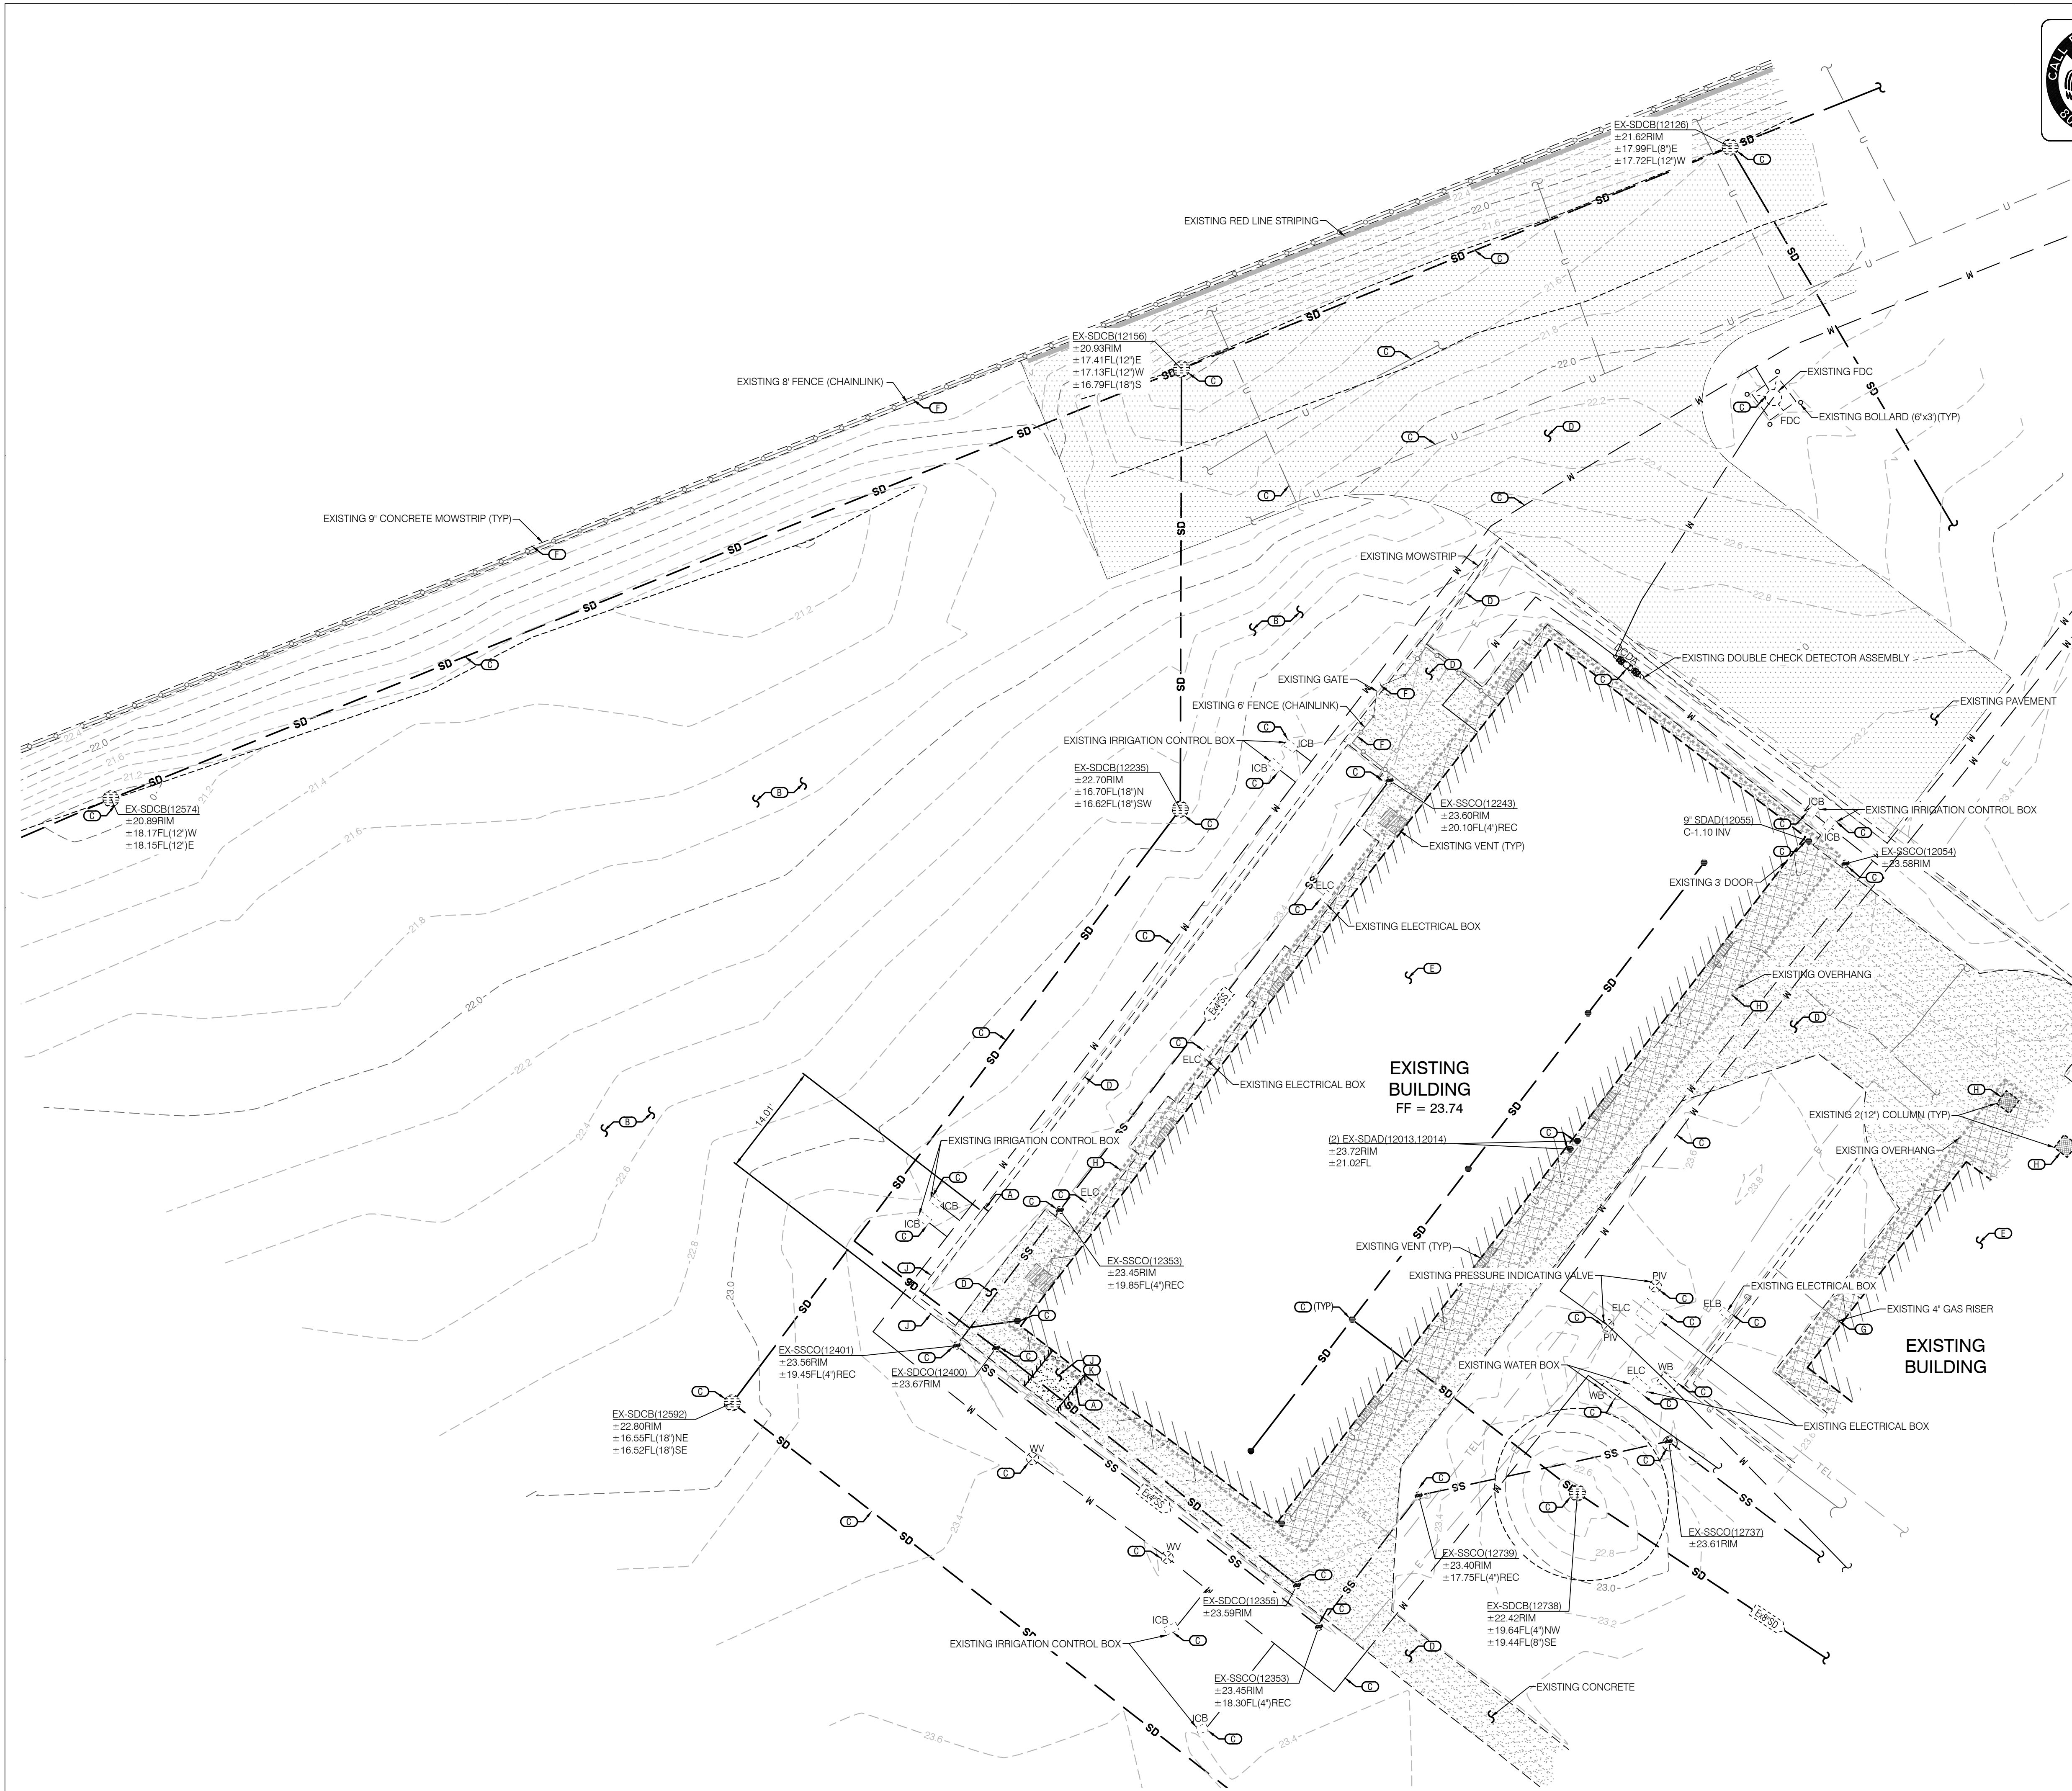

North Star
Engineering Group, Inc.
• CIVIL • ENGINEERING • SURVEYING • PLANNING •
620 12th Street Modesto, CA 95354
(209) 524-3525 Phone (209) 524-3526 Fax

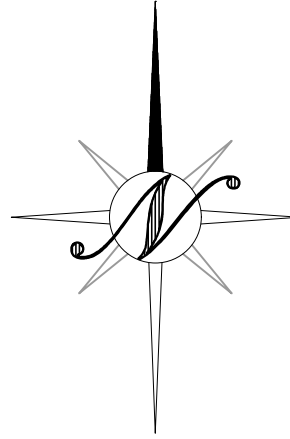

10 5 0 10
1" = 10'

LEGEND

	EXISTING CONCRETE		EXISTING PAVEMENT
	EXISTING BUILDING OVERHANG		
	EXISTING CONCRETE TO BE REMOVED		

KEY NOTES

- SAWCUT AND REMOVE EXISTING PAVEMENT, CONCRETE, AND/OR CURB AS REQUIRED PER THESE PLANS. CONTRACTOR MAY NEED TO FIELD ADJUST SAWCUT LINE TO REMOVE THE PAVEMENT OR CONCRETE SECTION AT A CLEAN EDGE OR NEAREST JOINT BASED ON FIELD CONDITIONS WHILE MAINTAINING ACCESSIBLE TRANSITION TO PROVIDE COMPLIANCE WITH ACCESSIBILITY STANDARDS, WHERE APPLICABLE.
- CONTRACTOR SHALL "USE EXTREME CAUTION" THROUGHOUT THE COURSE OF CONSTRUCTION AS ADDITIONAL UNDERGROUND LINES AND STRUCTURES NOT SHOWN ON THIS PLAN MAY EXIST AND ARE NOT CLEARLY MARKED OR VISIBLE FROM THE SURFACE. ADDITIONALLY CONTRACTOR SHALL USE EXTREME CAUTION WHILE WORKING BY LOW HANGING POWER LINES. IN CONJUNCTION WITH CONTACTING USA TO LOCATE UNDERGROUND UTILITIES WITHIN THE PUBLIC RIGHT-OF-WAY IT IS HIGHLY RECOMMENDED THAT THE CONTRACTOR UTILIZE (GPR) GROUND PENETRATING RADAR UNDERGROUND SERVICES TO IDENTIFY UTILITIES THAT MAY NOT BE VISIBLE FROM THE SURFACE.
- "USE EXTREME CAUTION" CONTRACTOR SHALL PROTECT EXISTING STRUCTURES, OVERHEAD LINES AND UNDERGROUND UTILITIES THROUGHOUT THE COURSE OF CONSTRUCTION AND REPAIR/REPLACE IF DAMAGED DURING CONSTRUCTION, AT CONTRACTORS EXPENSE. COORDINATE WITH APPROPRIATE CONSULTANT AND/OR AGENCY FOR ANY RELOCATION OR REMOVAL. CONTRACTOR SHALL ADJUST TO PROPOSED GRADE AS NECESSARY.
- CONTRACTOR SHALL PROTECT EXISTING CONCRETE, CURB, MOWSTRIP, AND/OR PAVEMENT THROUGHOUT THE COURSE OF CONSTRUCTION AND REPAIR/REPLACE IF DAMAGED DURING CONSTRUCTION, AT CONTRACTORS EXPENSE. SEE KEYNOTE 'A' ABOVE.
- CONTRACTOR SHALL PROTECT EXISTING BUILDING THROUGHOUT THE COURSE OF CONSTRUCTION AND REPAIR/REPLACE IF DAMAGED DURING CONSTRUCTION, AT CONTRACTORS EXPENSE.
- CONTRACTOR SHALL PROTECT EXISTING WALL, FENCE, GATE AND/OR MOWSTRIP THROUGHOUT THE COURSE OF CONSTRUCTION AND REPAIR/REPLACE IF DAMAGED DURING CONSTRUCTION, AT CONTRACTORS EXPENSE.
- CONTRACTOR SHALL "USE EXTREME CAUTION" WHEN PERFORMING CONSTRUCTION ACTIVITIES NEAR EXISTING GAS LINE STRUCTURES AND/OR UNDERGROUND UTILITIES. SEE KEYNOTE 'B' FOR ADDITIONAL INFORMATION.
- CONTRACTOR SHALL PROTECT EXISTING OVERHEAD STRUCTURES AND COLUMNS THROUGHOUT THE COURSE OF CONSTRUCTION AND REPAIR/REPLACE IF DAMAGED DURING CONSTRUCTION, AT CONTRACTORS EXPENSE.
- CONTRACTOR SHALL REMOVE EXISTING CONCRETE, CURB, MOWSTRIP AND/OR PAVEMENT AS SHOWN AND DISPOSE OF OFF-SITE AT THE CONTRACTOR'S EXPENSE. SEE KEYNOTE 'A' ABOVE FOR ADDITIONAL INFORMATION.
- PRIOR TO CONCRETE REMOVAL, CONTRACTOR SHALL COORDINATE WITH ELECTRICAL PLANS TO DETERMINE THE EXACT LOCATION OF THE ELECTRICAL LINE TRENCHING AND REMOVE CONCRETE WALKWAY AT THE NEAREST JOINT ON EITHER SIDE OF THE ELECTRICAL LINE. LIMITS OF CONCRETE REMOVAL SHALL BE DETERMINED IN THE FIELD BY CONTRACTOR.

COPYRIGHT © 2024, NORTHSTAR ENGINEERING GROUP, INC

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly
reserves its common law
rights in the design
and construction
plans. This document, the
ideas and designs
incorporated herein, as an
instrument of professional
service, is not to be used
in whole or in part, for
any other project without
prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED



CIVIL IMPROVEMENT PLANS FOR
**PEYTON ELEMENTARY
SCHOOL**
STOCKTON, CALIFORNIA
DRAWING TITLE
TOPOGRAPHIC AND DEMOLITION PLAN

PROJECT NO.
23-12862
DRAWING
C2.1





North Star

Engineering Group, Inc.

CIVIL ENGINEERING • SURVEYING • PLANNING

620 12th Street Modesto, CA 95354

(209) 524-3525 Phone (209) 524-3526 Fax

IDENTIFICATION STAMP

DIV. OF THE STATE ARCHITECT

APP. 02-122690 INC.

REVIEWED FOR

SS ☒ FLS ☒ ACS ☒

DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and all other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL

TETER, INC.

FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO

ARCHITECTS ENGINEERS CONNECTED

CIVIL IMPROVEMENT PLANS FOR

PEYTON ELEMENTARY SCHOOL

STOCKTON, CALIFORNIA

DRAWING TITLE

DIMENSION AND PAVING PLAN

PROJECT NO.
23-12862

DRAWING
C3.1

COPYRIGHT © 2024, NORTHSTAR ENGINEERING GROUP, INC

LEGEND



EXISTING CONCRETE



EXISTING BUILDING OVERHANG



**CONCRETE SECTION - PEDESTRIAN
4"POC/4" CLASS II AB (95% RC) W/ #4 REBAR @ 18" O.C., BOTH WAYS

*CONTRACTOR SHALL REFER TO GEOTECHNICAL RECOMMENDATIONS DOCUMENT FOR ADDITIONAL INFORMATION INCLUDING SUBGRADE, AGGREGATE BASE PREPARATION, COMPACTION, AND TO CONFIRM STRUCTURAL SECTIONS SHOWN ABOVE.
**SEE ARCHITECTURAL PLANS FOR SCORING, CONTROL JOINTS, PATTERN, COLOR, ADDITIONAL CONCRETE DETAILS, AND SPECIFICATIONS.

KEY NOTES

SEE TOPOGRAPHIC AND DEMOLITION SHEET C2.1 FOR ADDITIONAL REMOVAL, REPLACEMENT AND PROTECTION NOTES.

(A) SAWCUT AND REMOVE EXISTING PAVEMENT, CONCRETE, AND OR CURB AS REQUIRED PER THESE PLANS. CONTRACTOR MAY NEED TO FIELD ADJUST SAWCUT LINE TO REMOVE THE PAVEMENT OR CONCRETE SECTION AT A CLEAN EDGE OR NEAREST JOINT BASED ON FIELD CONDITIONS WHILE MAINTAINING ACCESSIBLE TRANSITION TO PROVIDE COMPLIANCE WITH ACCESSIBILITY STANDARDS, WHERE APPLICABLE. CONTRACTOR SHALL INSTALL DOWELS AT ALL CONNECTIONS BETWEEN EXISTING AND PROPOSED CONCRETE.

(B) ACCESSIBLE PATH OF TRAVEL NOT TO EXCEED 5.0% MAX RUNNING SLOPE AND 2.0% MAX CROSS SLOPE. PLAZA/COURTYARD AREAS AND INTERSECTING PATHS SHALL HAVE A 2% MAX SLOPE IN ANY DIRECTION. ACCESSIBLE PATH OF TRAVEL DETERMINATION, ACCESSIBILITY AND SIGNAGE SHALL BE DETERMINED BY ARCHITECTURAL AND LANDSCAPE PLANS. SEE ARCHITECTURAL AND LANDSCAPE PLANS FOR DIMENSIONS AND DETAILS, INCLUDING HANDRAILS, WHERE APPLICABLE.


(C) CONTRACTOR SHALL CONSTRUCT BUILDING PER ARCHITECTURAL AND MODULAR BUILDING PLANS AND SPECIFICATIONS.

(D) CONTRACTOR SHALL INSTALL FENCE AND/OR GATE PER ARCHITECTURAL PLANS AND LANDSCAPE ARCHITECTURAL PLANS.


(E) CONTRACTOR SHALL INSTALL LANDSCAPE MOW STRIP PER DETAIL 10 ON SHEET C1.4.



North Star
Engineering Group, Inc.
• CIVIL • ENGINEERING • SURVEYING • PLANNING •
620 12th Street Modesto, CA 95354
(209) 524-3525 Phone (209) 524-3526 Fax

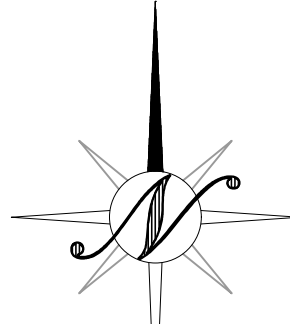

10 5 0 10
1" = 10'

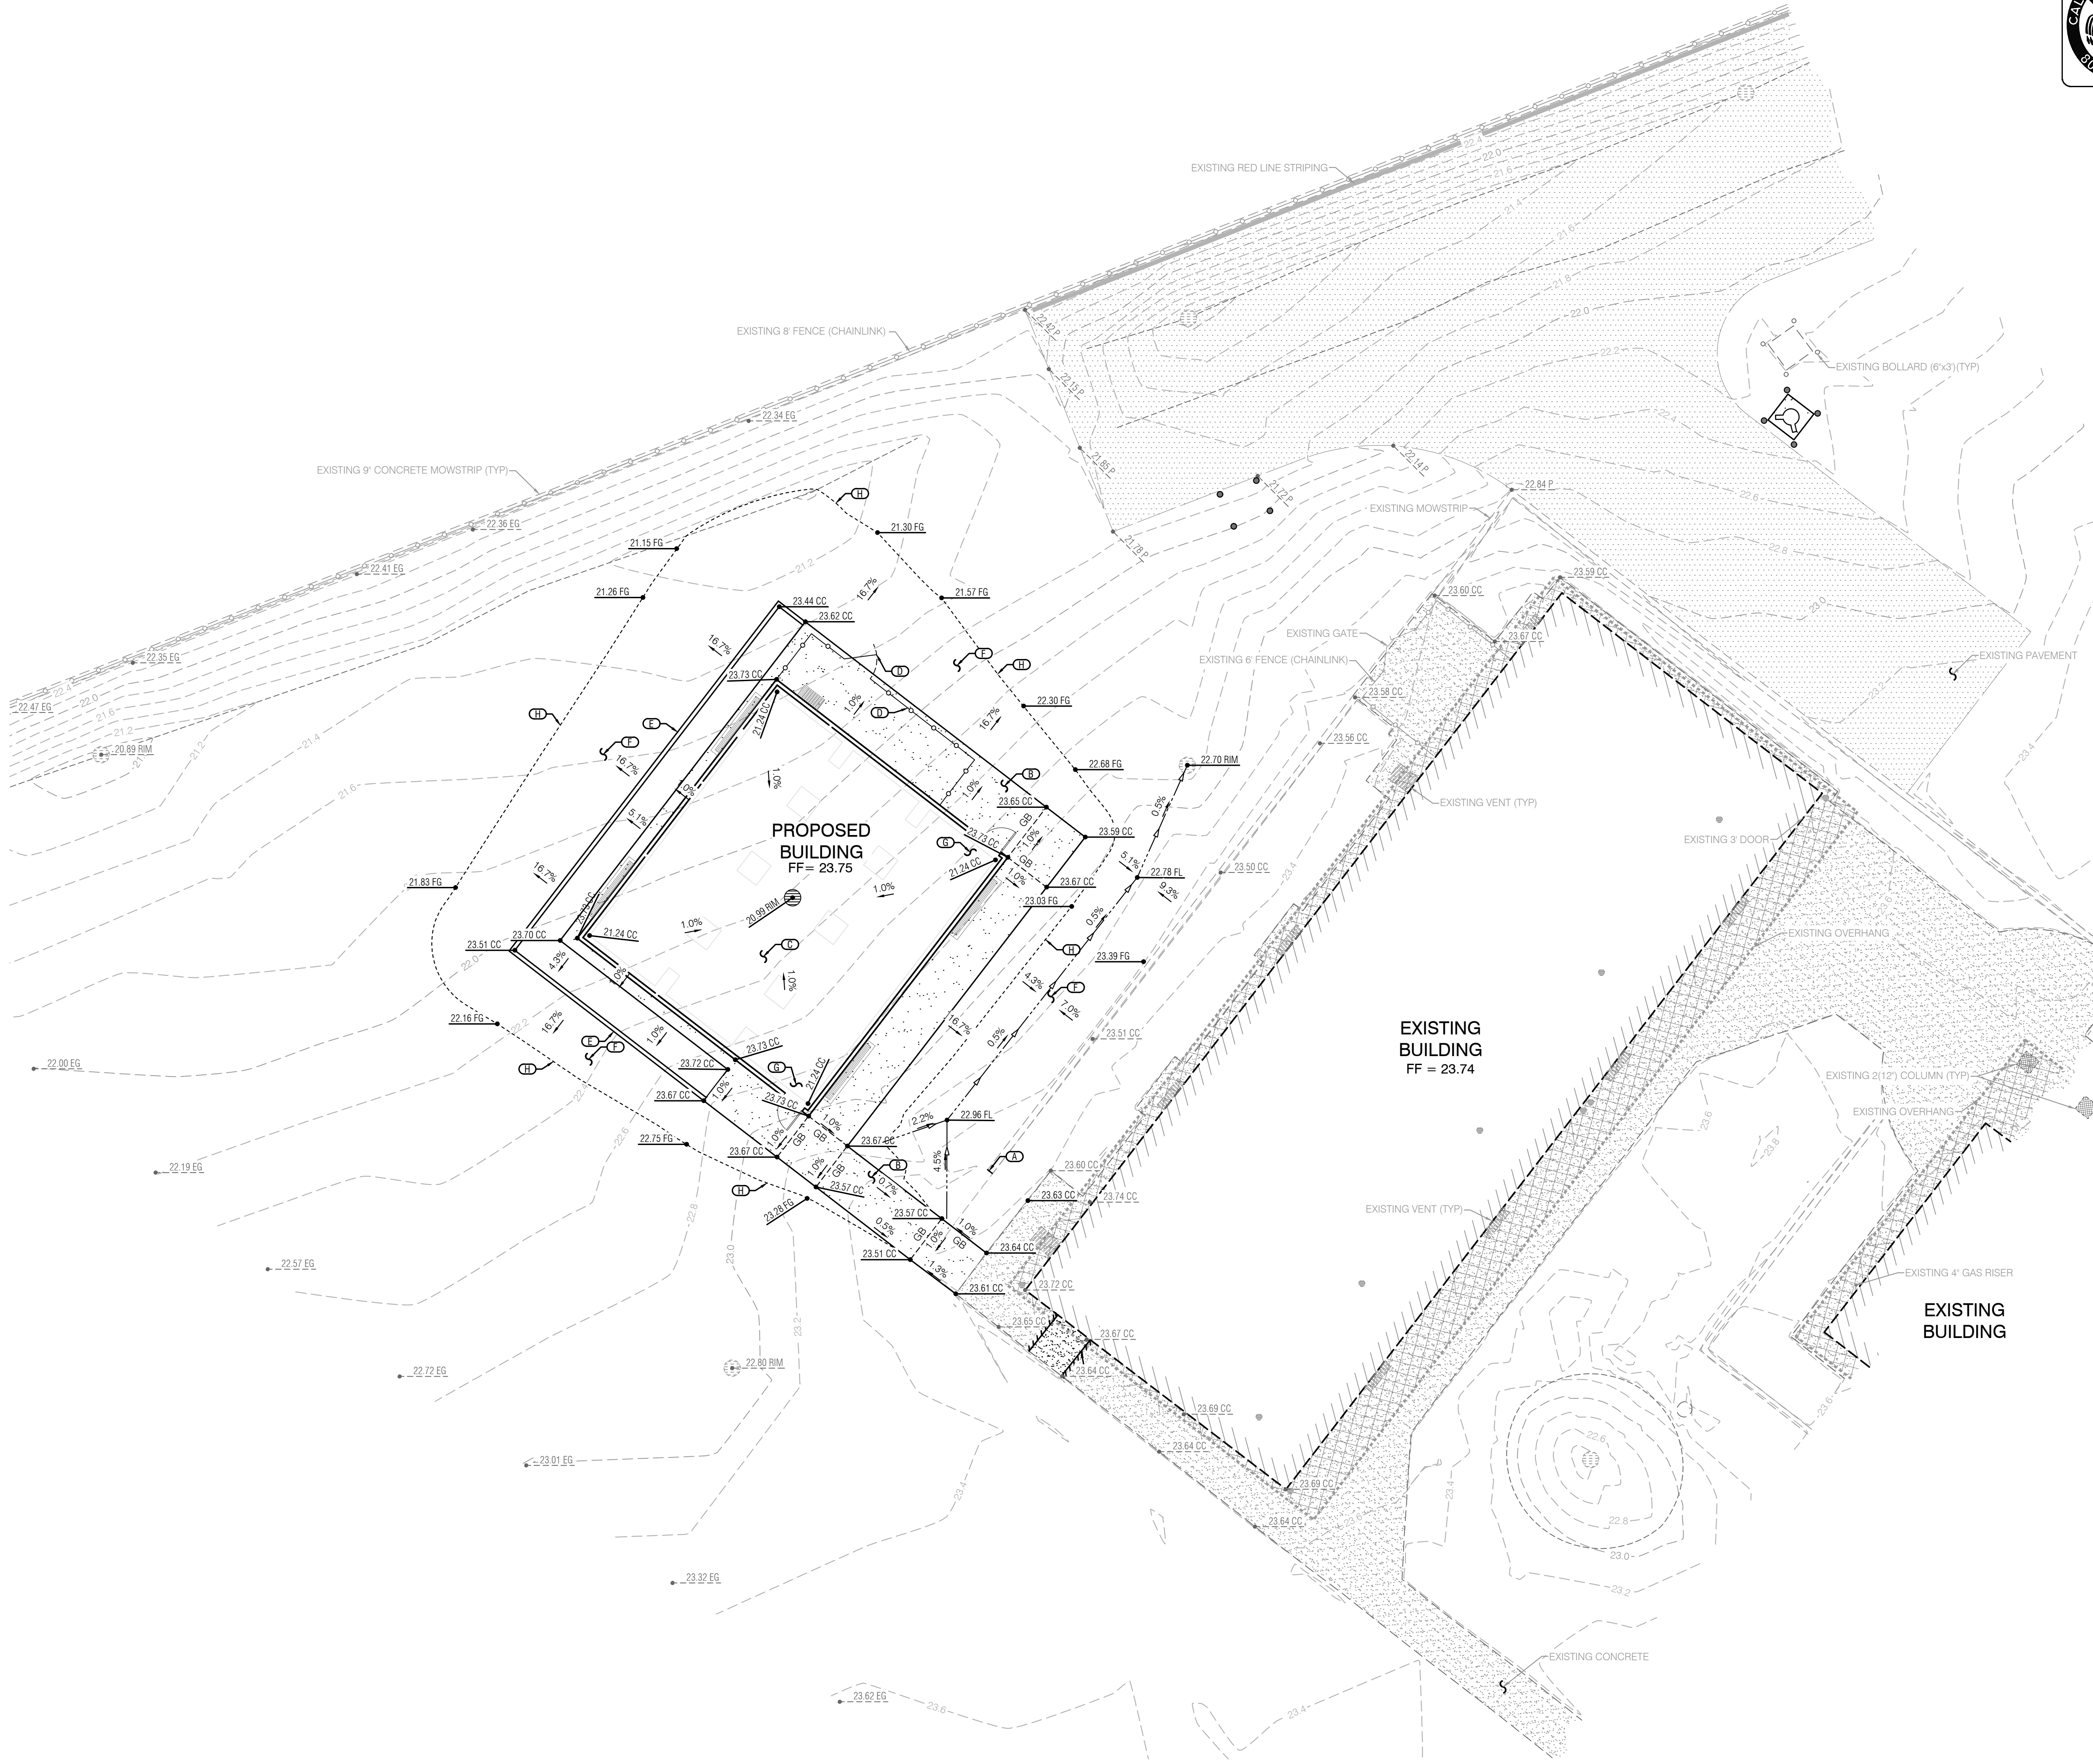

KEY NOTES

- SEE TOPOGRAPHIC AND DEMOLITION SHEET C2.1 FOR ADDITIONAL REMOVAL, REPLACEMENT AND PROTECTION NOTES.
- (A) SAWCUT AND REMOVE EXISTING PAVEMENT, CONCRETE, AND OR CURB AS REQUIRED PER THESE PLANS. CONTRACTOR MAY NEED TO FIELD ADJUST SAWCUT LINE TO REMOVE THE PAVEMENT OR CONCRETE SECTION AT A CLEAN EDGE OR NEAREST JOINT BASED ON FIELD CONDITIONS WHILE MAINTAINING ACCESSIBLE TRANSITION TO PROVIDE COMPLIANCE WITH ACCESSIBILITY STANDARDS, WHERE APPLICABLE. CONTRACTOR SHALL INSTALL DOWELS AT ALL CONNECTIONS BETWEEN EXISTING AND PROPOSED CONCRETE.
- (B) ACCESSIBLE PATH OF TRAVEL NOT TO EXCEED 5.0% MAX RUNNING SLOPE AND 2.0% MAX CROSS SLOPE. PLAZA/COURTYARD AREAS AND INTERSECTING PATHS SHALL HAVE A 2% MAX SLOPE IN ANY DIRECTION. ACCESSIBLE PATH OF TRAVEL DETERMINATION, ACCESSIBILITY AND SIGNAGE SHALL BE DETERMINED BY ARCHITECTURAL AND LANDSCAPE PLANS. SEE ARCHITECTURAL AND LANDSCAPE PLANS FOR DIMENSIONS AND DETAILS, INCLUDING HANDRAILS, WHERE APPLICABLE.
- (C) CONTRACTOR SHALL CONSTRUCT BUILDING PER ARCHITECTURAL AND MODULAR BUILDING PLANS AND SPECIFICATIONS.
- (D) CONTRACTOR SHALL INSTALL FENCE AND/OR GATE PER ARCHITECTURAL PLANS AND LANDSCAPE ARCHITECTURAL PLANS.
- (E) CONTRACTOR SHALL INSTALL LANDSCAPE MOW STRIP PER DETAIL 10 ON SHEET C1.4.
- (F) CONTRACTOR SHALL SWALE AND GRADE LANDSCAPE AREA IN SUCH A WAY THAT NO PONDING WILL OCCUR. CONTRACTOR SHALL GRADE LANDSCAPE AREAS SO THAT ALL RUNOFF IS COLLECTED IN THE STORM DRAIN SYSTEM. ALL LANDSCAPE AREAS THAT ABUT ANY PORTION OF THE BUILDING SHALL BE A MINIMUM OF EIGHT INCHES (8") BELOW FINISHED FLOOR OF THE ABUTTING BUILDING, UNLESS THE BUILDING HAS A PERIMETER MOWSTRIP, AND IN NO CASE SHALL THE LANDSCAPE AREA BE GRADED OR LANDSCAPED SUCH THAT WATER DRAINS TOWARD THE BUILDING.
- (G) PRIOR TO CONSTRUCTING ANY CONCRETE OR PAVEMENT THE CONTRACTOR SHALL VERIFY THE FINISH FLOOR ELEVATIONS AT ALL DOORS. CONTRACTOR SHALL HOLD FIELD VERIFIED FINISH FLOOR GRADES, ACCOUNT FOR DOOR THRESHOLDS, AND ADJUST GRADES AS NECESSARY TO STAY IN COMPLIANCE WITH CURRENT ACCESSIBLE STANDARDS. CONTRACTOR SHALL NOTIFY NORTHSTAR ENGINEERING IMMEDIATELY IF ANY GRADE ADJUSTMENTS WILL CREATE ANY ACCESSIBILITY ISSUES.
- (H) LIMITS OF 6:1 FILL SLOPE. CONTRACTOR SHALL REFER TO LANDSCAPE ARCHITECTURAL PLANS FOR PLANTING AND IRRIGATION.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly
reserves its common law
rights in the project
property rights in these
plans. This document, the
ideas and designs
incorporated herein, as an
instrument of professional
service, is not to be used
in whole or in part, for
any other project without
prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED




CIVIL IMPROVEMENT PLANS FOR
PEYTON ELEMENTARY
SCHOOL
STOCKTON, CALIFORNIA
DRAWING TITLE
GRADING AND DRAINAGE PLAN


PROJECT NO.
23-12862
DRAWING
C4.1



North Star
Engineering Group, Inc.
• CIVIL ENGINEERING • SURVEYING • PLANNING •
620 12th Street Modesto, CA 95354
(209) 524-3525 Phone (209) 524-3526 Fax

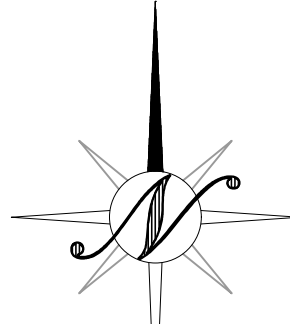

10 5 0 10
1" = 10'

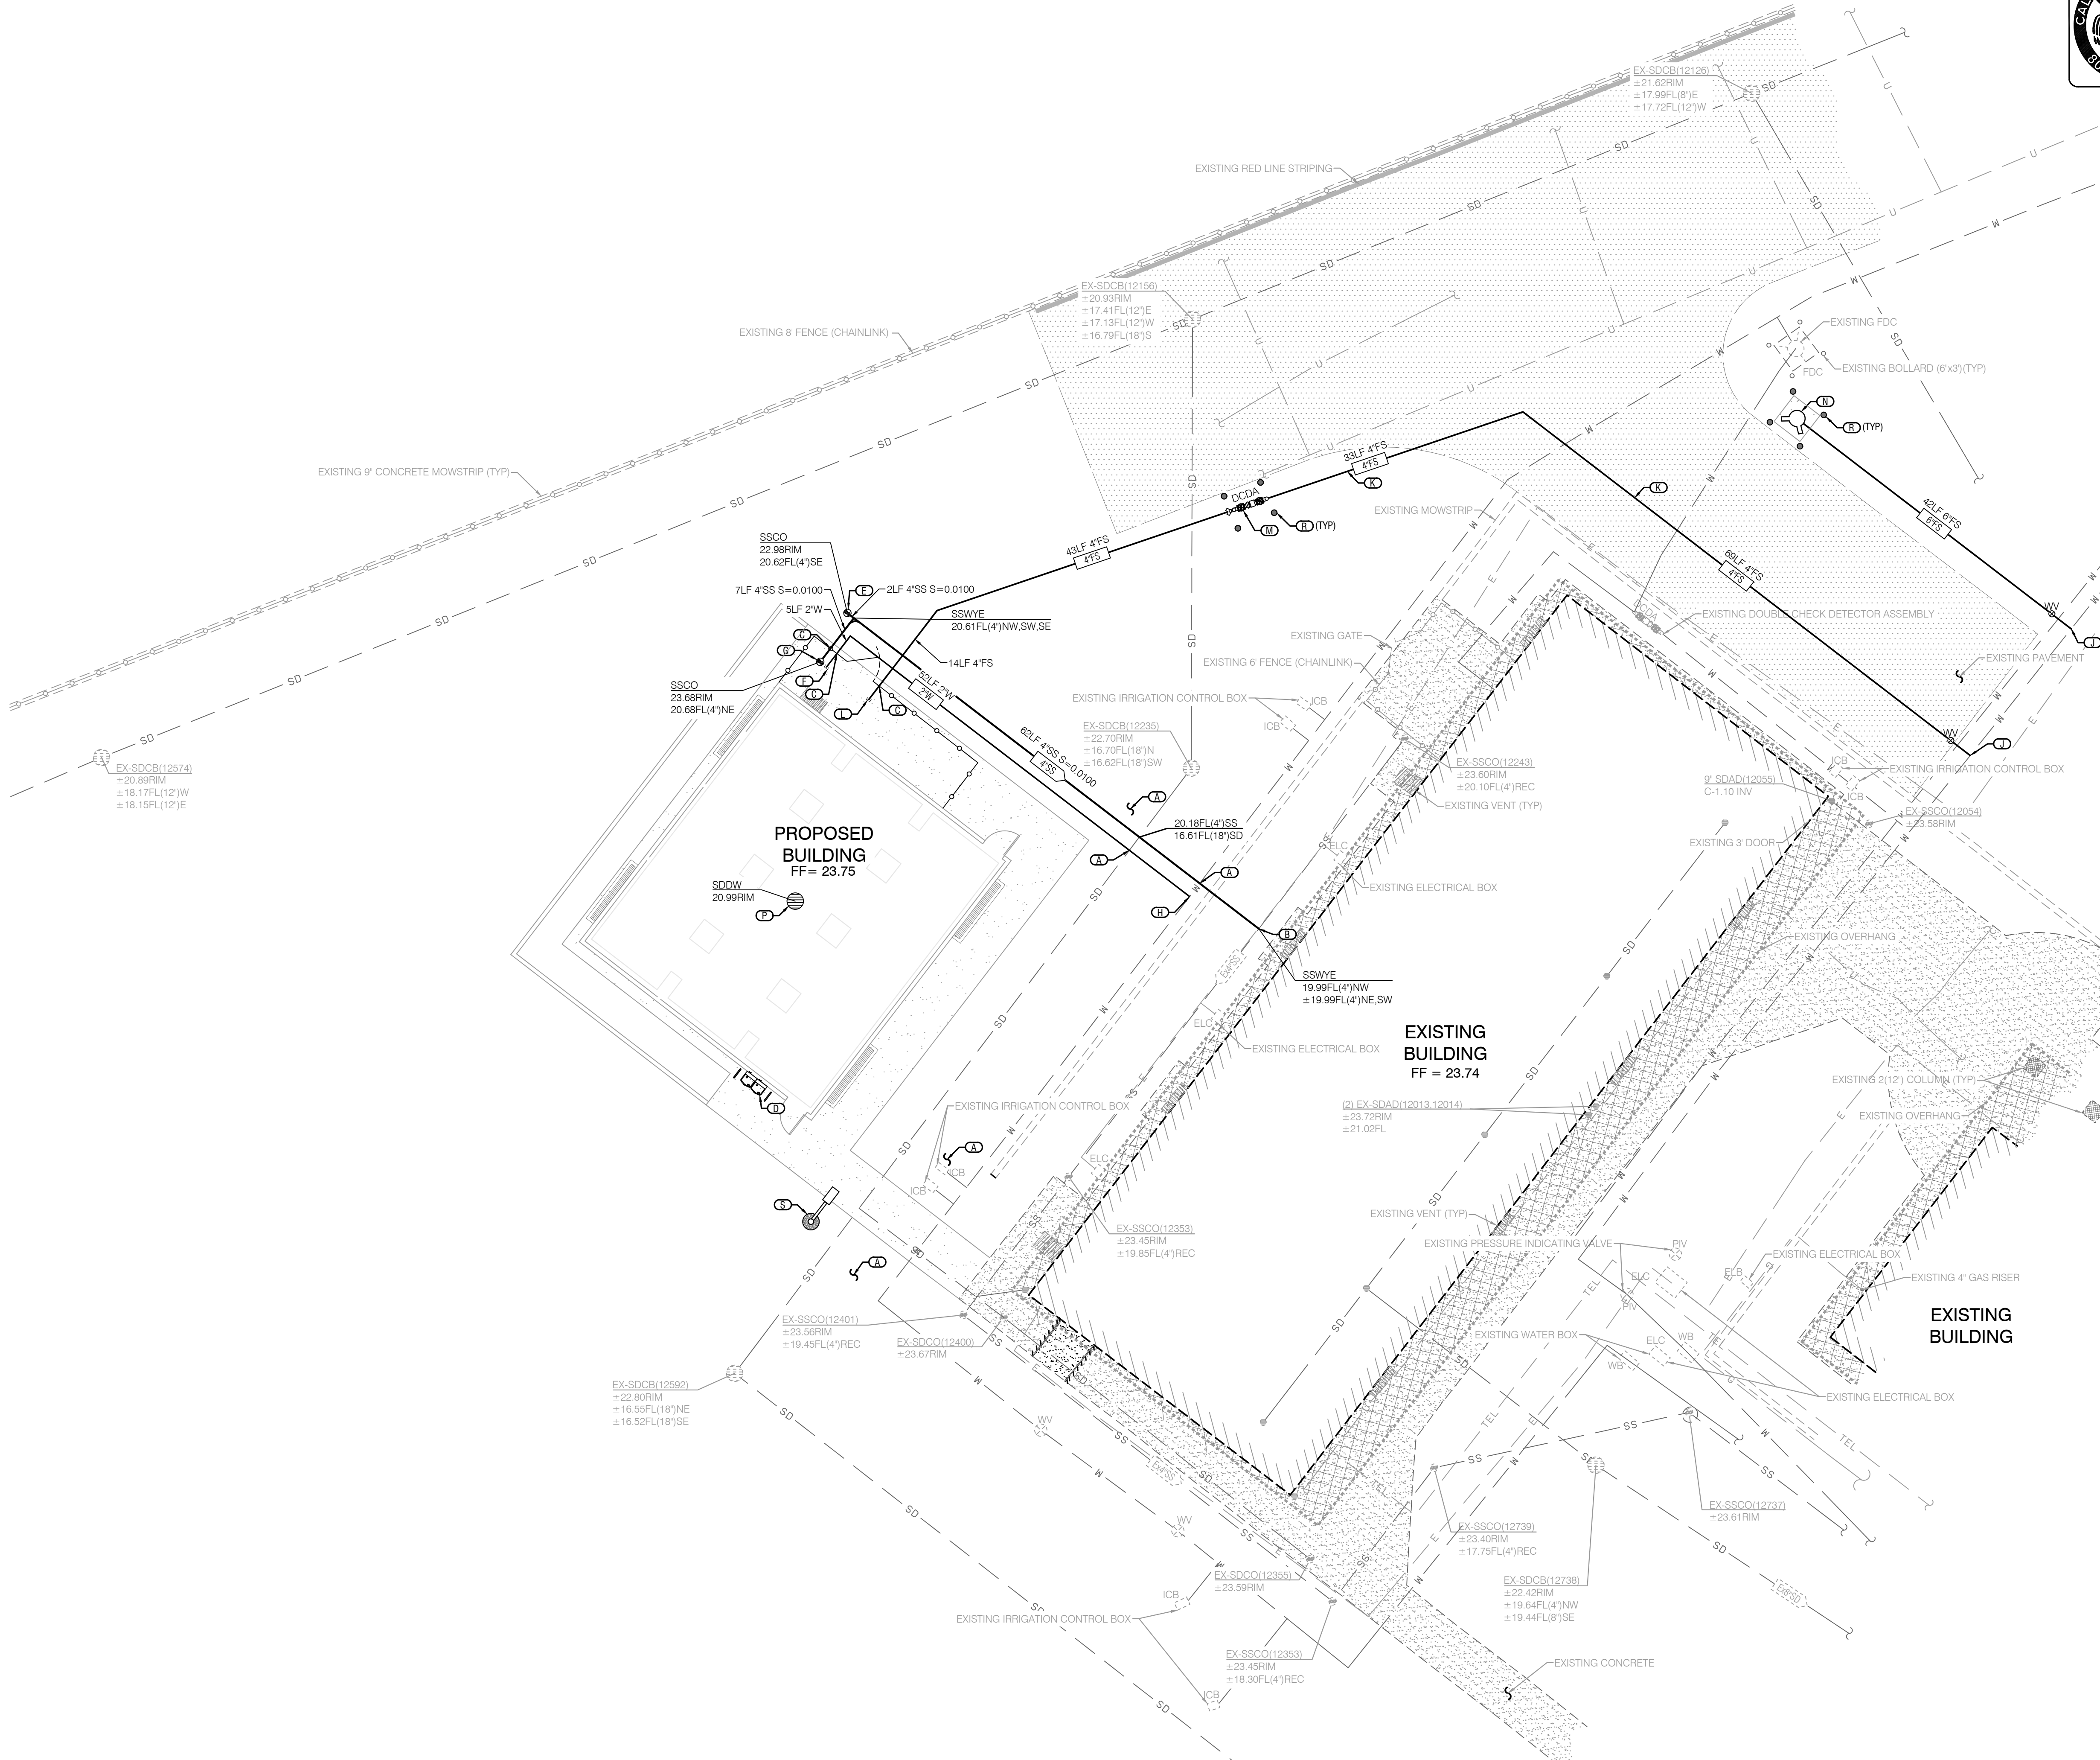

KEY NOTES

- SEE TOPOGRAPHIC AND DEMOLITION SHEET C2.1 FOR ADDITIONAL REMOVAL, REPLACEMENT AND PROTECTION NOTES.
- CONTRACTOR SHALL "USE EXTREME CAUTION" THROUGHOUT THE COURSE OF CONSTRUCTION AS TO AVOID EXISTING UNDERGROUND LINES AND STRUCTURES THAT MAY CONFLICT WITH PROPOSED IMPROVEMENTS.
 - CONTRACTOR SHALL EXCAVATE EXISTING SEWER PIPE TO VERIFY THE HORIZONTAL AND VERTICAL ALIGNMENT PRIOR TO THE INSTALLATION OF THE SEWER SYSTEM. CONTRACTOR SHALL INFORM THE ENGINEER IF THE ALIGNMENTS ARE DIFFERENT THAN SHOWN. CONTRACTOR SHALL CONNECT TO EXISTING SEWER SYSTEM PER CITY OF STOCKTON STANDARDS AND SPECIFICATIONS.
 - "USE EXTREME CAUTION" TO AVOID UNDERGROUND UTILITIES WHEN INSTALLING FOOTINGS FOR WALLS, FENCES OR ARCHITECTURAL AMENITIES AT ALL UTILITY WALL/FENCE/AMENITY CROSSINGS.
 - CONTRACTOR SHALL INSTALL DRINKING FOUNTAIN PER ARCHITECTURAL PLANS AND SPECIFICATIONS.
 - CONTRACTOR SHALL INSTALL SEWER CLEANOUT PER DETAIL 7 ON SHEET C1.4.
 - PROPOSED DOMESTIC WATER WITH SHUT OFF VALVE TO BE STUBBED 5 FEET FROM THE FACE OF THE BUILDING. CONTRACTOR SHALL VERIFY THE LOCATIONS OF THE UTILITY CONNECTIONS WITH THE PLUMBING PLANS PRIOR TO CONSTRUCTION OF PROPOSED STUBS.
 - CONTRACTOR SHALL INSTALL SEWER CLEANOUT PER DETAIL 7 ON SHEET C1.4 WITH APPROPRIATE FITTINGS AND REDUCER. CONTRACTOR SHALL VERIFY THE LOCATIONS OF THE UTILITY CONNECTIONS WITH THE PLUMBING PLANS PRIOR TO CONSTRUCTION OF PROPOSED STUBS AND STUB 5 FEET FROM THE FACE OF THE BUILDING.
 - CONTRACTOR SHALL CONNECT TO EXISTING DOMESTIC WATER LINE PER CITY OF STOCKTON STANDARDS AND SPECIFICATIONS. CONTRACTOR SHALL EXCAVATE EXISTING WATER LINE TO VERIFY THE HORIZONTAL AND VERTICAL ALIGNMENT PRIOR TO THE INSTALLATION OF THE PROPOSED WATER PIPE. CONTRACTOR SHALL INFORM THE ENGINEER IF THE ALIGNMENTS ARE DIFFERENT THAN SHOWN.
 - CONTRACTOR SHALL CONNECT TO EXISTING LOOPED FIRE WATER LINE CONNECTED TO THE FIRE PUMP DISCHARGE LINE PER CITY OF STOCKTON STANDARDS AND SPECIFICATIONS. CONTRACTOR SHALL EXCAVATE EXISTING WATER LINE TO VERIFY THE HORIZONTAL AND VERTICAL ALIGNMENT PRIOR TO THE INSTALLATION OF THE PROPOSED WATER PIPE. CONTRACTOR SHALL INFORM THE ENGINEER IF THE ALIGNMENTS ARE DIFFERENT THAN SHOWN.
 - CONTRACTOR SHALL INSTALL WATER PIPES WITH SUFFICIENT ENOUGH DEPTH TO MAINTAIN 1' MINIMUM VERTICAL CLEARANCE FORM OUTSIDE DIAMETER OF PIPES AND COMPLY WITH THE MOST CURRENT STATE HEALTH CODE AND THE CALIFORNIA BUILDING AND PLUMBING CODE STANDARDS. CONTRACTOR SHALL DEEPEN WATER PIPES AS NECESSARY AND USE EXTREME CAUTION WHEN PLACING THRUST BLOCKS AS TO AVOID CONFLICTS WITH OTHER UTILITY PIPES. CONTRACTOR SHALL INSTALL REDUCERS AS REQUIRED. WATER VALVES SHALL BE INSTALLED ON 4" WATER PIPES OR LARGER AND BALL VALVES/CORP STOPS SHOULD BE INSTALLED ON 3" WATER PIPES OR SMALLER. THRUST BLOCKS SHALL BE INSTALLED AT FIRE HYDRANTS, BLOW-OFFS, TEES, CAPS, BENDS, ENDS, AND CHANGES IN SIZE AND/OR DIRECTION. WATER SEPARATION SHALL BE CONSTRUCTED IN ACCORDANCE WITH SECTION 720.0 AND TABLE 7-7 OF THE CALIFORNIA PLUMBING CODE. SEE CITY OF STOCKTON STANDARD DETAIL W-12 FOR THRUST BLOCK DETAILS AND SPECIFICATIONS.
 - PROPOSED FIRE SPRINKLER WATER WITH SHUT OFF VALVE TO BE STUBBED 5 FEET FROM THE FACE OF THE BUILDING. CONTRACTOR SHALL VERIFY THE LOCATIONS OF THE UTILITY CONNECTIONS WITH THE PLUMBING PLANS PRIOR TO CONSTRUCTION OF PROPOSED STUBS.
 - CONTRACTOR SHALL INSTALL 4" DOUBLE CHECK DETECTOR ASSEMBLY WITH OS&Y VALVES, TAMPER SWITCH, FDC, AND ASSOCIATED CONDUITS PER DETAIL 3 ON SHEET C1.4. "USE EXTREME CAUTION" WHEN INSTALLING DEVICES TO AVOID EXISTING UNDERGROUND UTILITIES THAT MAY EXIST. CONTRACTOR TO FIELD VERIFY PRIOR TO CONSTRUCTION.
 - CONTRACTOR SHALL INSTALL FIRE HYDRANT ASSEMBLY PER CITY OF STOCKTON STANDARD DETAIL W-13, MAINTAINING A 3 FEET MINIMUM CLEARANCE SPACE. CONTRACTOR SHALL INSTALL MINIMUM 6" THICK CONCRETE PAD UNDER FIRE HYDRANT. "USE EXTREME CAUTION" WHEN INSTALLING FOOTINGS TO AVOID UNDERGROUND UTILITIES.
 - CONTRACTOR SHALL INSTALL DRY WELL PER ARCHITECTURAL PLANS. REFER TO ARCHITECTURAL PLANS FOR ADDITIONAL INFORMATION AND DETAILS. CONTRACTOR SHALL ENSURE THAT DRY WELL HAS NO WATER PRIOR TO SETTING CLASSROOM.
 - CONTRACTOR SHALL INSTALL BOLLARDS PER DETAIL 3 ON ARCHITECTURAL PLAN SHEET A111.
 - CONTRACTOR SHALL INSTALL LIGHT PER ELECTRICAL PLANS.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and all other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.

FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED




CIVIL IMPROVEMENT PLANS FOR
PEYTON ELEMENTARY SCHOOL

STOCKTON, CALIFORNIA
DRAWING TITLE
COMPOSITE UTILITY PLAN

PROJECT NO.
23-12862

DRAWING
C5.1

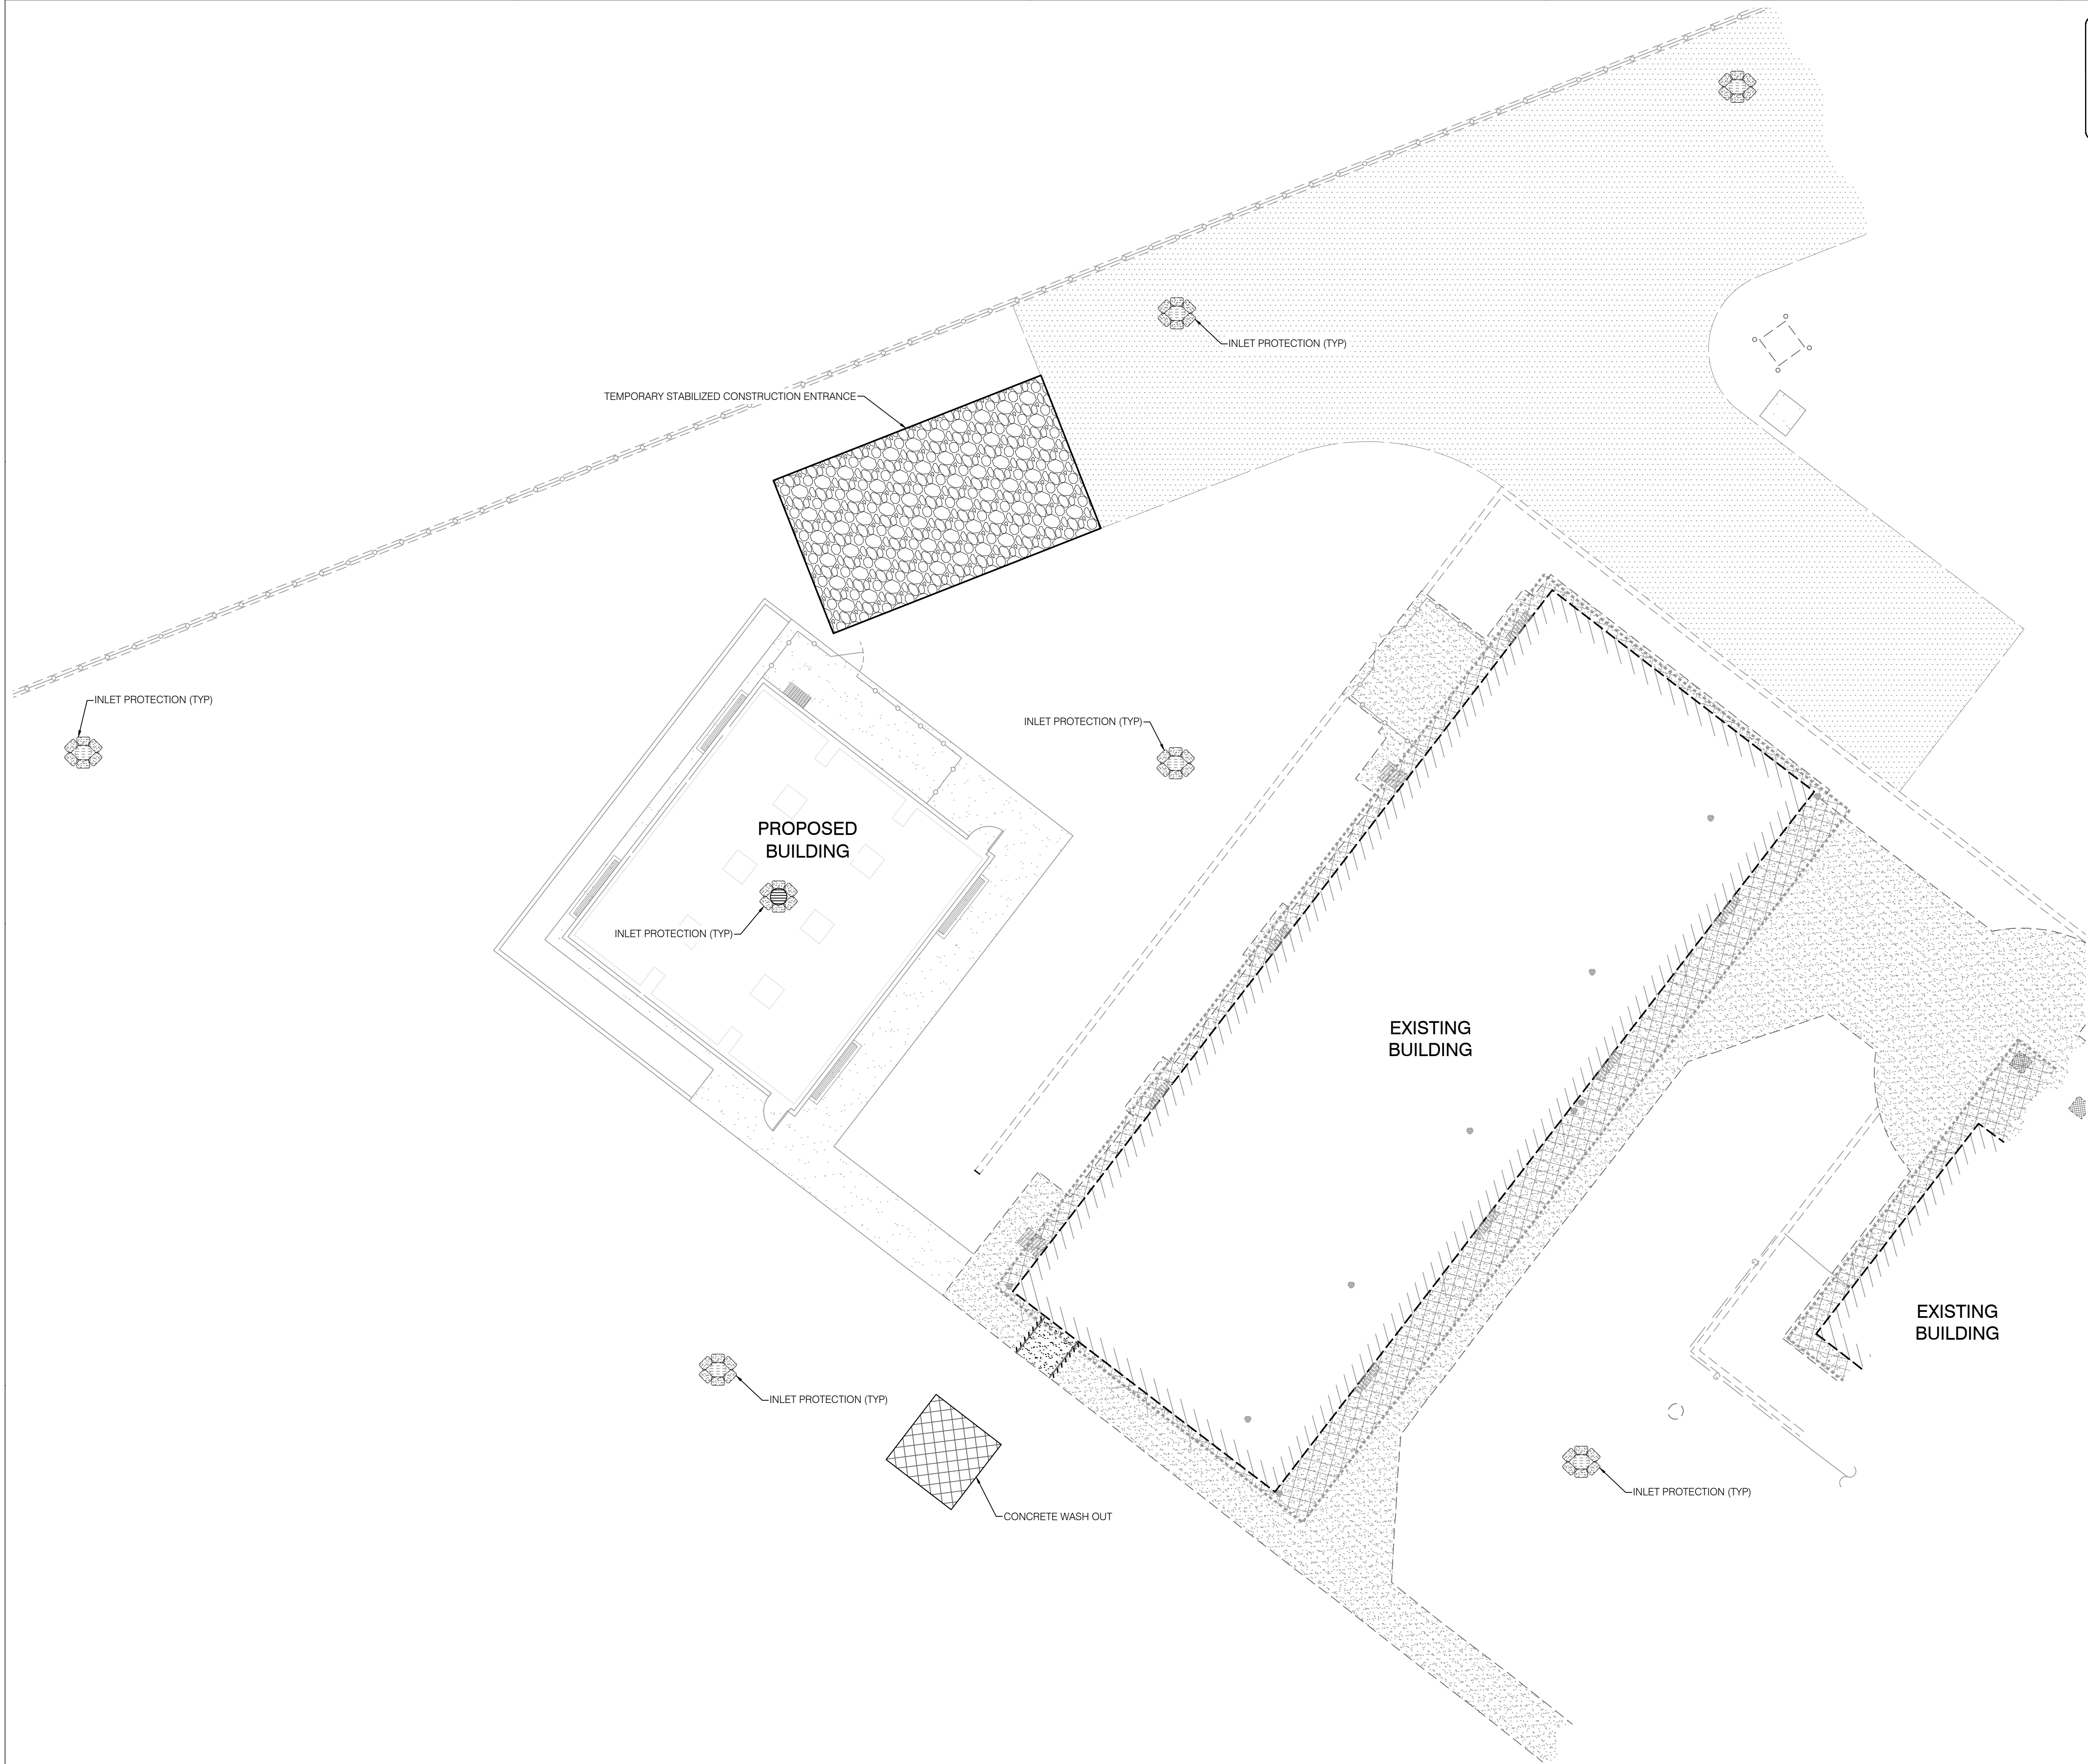

NorthStar
Engineering Group, Inc.
• CIVIL • ENGINEERING • SURVEYING • PLANNING •
620 12th Street Modesto, CA 95354
(209) 524-3525 Phone (209) 524-3526 Fax



LEGEND

INLET PROTECTION (SEE DETAILS ON SHEET C6.2) SHALL BE PLACED AROUND ALL CATCH BASINS WITHIN THE PROJECT DRAINAGE LIMITS, INCLUDING BUT NOT LIMITED TO ALL LANDSCAPE DRAINAGE. ALSO, INLET PROTECTION SHALL BE PLACED AT THE FIRST INLET DOWNSTREAM FROM THE PROJECT SITE (ON EITHER DIRECTION).

CONCRETE WASHOUT AREA (SEE DETAIL ON SHEET C6.2)

STRAW WATTLE (SEE DETAIL ON SHEET C6.2) TO BE PLACED AT ALL LOCATIONS SHOWN. STRAW WATTLES SHALL ALSO BE PLACED AT THE FRONT OF ANY LOT WHERE AN UNDERCUT IS NOT PRESENT.

TEMPORARY STABILIZED CONSTRUCTION ENTRANCE (SEE DETAIL ON SHEET C6.2) TO BE DETERMINED BY CONTRACTOR IN FIELD.

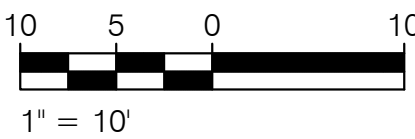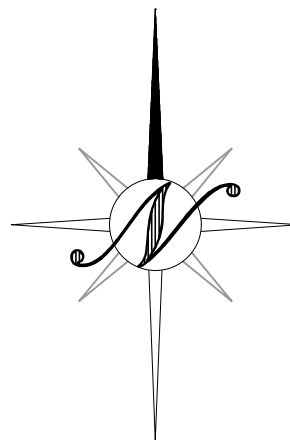


IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law and statutory rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

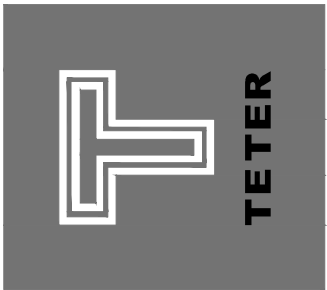

CIVIL IMPROVEMENT PLANS FOR
PEYTON ELEMENTARY
SCHOOL
STOCKTON, CALIFORNIA
DRAWING TITLE
EROSION CONTROL PLAN

PROJECT NO.
23-12862

DRAWING
C6.1

1. THESE PLANS DEPICT APPROPRIATE MEASURES TO CONTROL EROSION ON THE SITE TO BE GRADED AS SHOWN ON THE PLANS. THE NATIVE VEGETATION WILL BE REMOVED ONLY FROM THOSE AREAS TO BE GRADED. AREAS OUTSIDE OF AND DOWNSLOPE OF THE LIMITS OF GRADING WILL BE PROTECTED FROM SILT LADEN RUNOFF BY PERIMETER SILT FENCES AS DEPICTED ON THIS PLAN. SLOPED AREAS WHICH HAVE BEEN STRIPPED OF VEGETATION AND NEW SLOPES OVER FOUR FEET HIGH CREATED DURING THE GRADING OPERATION WILL BE TRACKWALKED & HYDROSEED.
2. ALL EROSION SEDIMENT STRUCTURES SHALL BE INSPECTED AFTER EACH RAINSTORM AND SHALL BE CLEANED OUT AS NECESSARY.
3. A STABILIZED CONSTRUCTION ENTRANCE SHALL BE INSTALLED PRIOR TO COMMENCEMENT OF GRADING. THE LOCATION IS SHOWN ON THESE PLANS. ALL CONSTRUCTION TRAFFIC ENTERING THE PAVED ROAD MUST CROSS THE ENTRANCE.
4. THE CONTRACTOR IS RESPONSIBLE FOR ALL ASPECTS OF EROSION CONTROL FOR THE LIFE OF THE PROJECT AND SHALL INSTALL AND MAINTAIN ANY DEVICES AND MEASURES NECESSARY TO THE SATISFACTION OF THE CITY ENGINEER, DURING CONSTRUCTION ACTIVITIES.
5. TO MINIMIZE EROSION OF GRADED BANKS, ALL GRADED BANKS AND STOCKPILE AREAS SHALL BE HYDROSEED, LANDSCAPED OR SEALED.
6. STRAW BALES, PIECES OF WOOD, FABRIC OR OTHER SUITABLE MATERIALS SHALL BE USED TO PREVENT SEDIMENT LADEN RUNOFF FROM ENTERING ANY COMPLETED STORM DRAIN INLETS. THESE PROTECTION MEASURES SHALL BE MAINTAINED UNTIL THE PROJECT IS COMPLETED.
7. WHEN TEMPORARY STRUCTURES HAVE SERVED THEIR INTENDED PURPOSE AND THE CONTRIBUTING DRAINAGE AREA HAS BEEN PROPERLY STABILIZED, THE EMBANKMENT AND RESULTING SEDIMENT DEPOSITS ARE TO BE LEVELED OR OTHERWISE DISPOSED OF BY THE CONTRACTOR AS RECOMMENDED BY THE SOILS ENGINEER.
8. GRADED AREAS MUST DRAIN AWAY FROM THE FACE OF SLOPES AT THE CONCLUSION OF EACH WORKING DAY. DRAINAGE SHALL BE DIRECTED TOWARDS DRAINAGE INLETS.
9. TEMPORARY EROSION CONTROL DEVICES SHOWN ON THIS PLAN WHICH INTERFERE WITH THE WORK SHALL BE RELOCATED OR MODIFIED AS AND WHEN THE INSPECTOR SO DIRECTS AS THE WORK PROGRESSES.
10. ALL LOOSE SOIL AND DEBRIS SHALL BE REMOVED FROM THE STREET AREAS UPON STARTING OPERATIONS AND PERIODICALLY THEREAFTER AS DIRECTED BY THE INSPECTOR.
11. HYDROMULCHING OF SLOPES OVER 5' IN HEIGHT SHALL BE COMPLETED BETWEEN SEPTEMBER 1 AND OCTOBER 1 OF THE YEAR IN WHICH THEY ARE CONSTRUCTED OR IMMEDIATELY AFTER THEIR CONSTRUCTION IF THEY ARE COMPLETED AFTER OCTOBER 1ST. APPLICATION RATES SHALL BE AS FOLLOWS AS REQUIRED BY CITY OF STOCKTON:

12. WHEN DIRECTED BY THE INSPECTOR, A 12-INCH BERM SHALL BE MAINTAINED ALONG THE TOP OF THE SLOPE OF THOSE FILLS ON WHICH GRADING IS NOT IN PROGRESS.

13. STAND-BY CREWS SHALL BE ALERTED BY THE PERMITTEE OR CONTRACTOR FOR EMERGENCY WORK DURING RAINSTORMS.

14. SEWER OR STORM DRAIN TRENCHES THAT DRAIN THROUGH BASIN DIKES SHALL BE PLUGGED WITH SANDBAGS FROM TOP OF PIPE TO TOP OF DIKE.

15. ALL UTILITY TRENCHES SHALL BE BLOCKED WHEN DIRECTED BY THE DESIGN ENGINEER AT THE PRESCRIBED INTERVALS FROM THE BOTTOM TO TOP WITH DOUBLE ROW OF SANDBAGS PRIOR TO BACKFILL. SANDBAGS ARE TO BE PLACED WITH ALTERNATE HEADER AND STRETCHER COURSES. THE INTERVALS PRESCRIBED BETWEEN SANDBAG BLOCKING SHALL DEPEND ON THE SLOPE OF THE GROUND SURFACE, BUT NOT TO EXCEED THE FOLLOWING:

GRADE OF GROUND SURFACE OR STREET LESS THAN 2% 2% TO 4% 4% TO 10% OVER 10%	INTERVAL AS REQUIRED 100 FEET 50 FEET 25 FEET
GRADE OF GROUND SURFACE OR STREET LESS THAN 2% 2% TO 4% 4% TO 10% OVER 10%	INTERVAL AS REQUIRED 100 FEET 50 FEET 25 FEET

17. AFTER SEWER AND UTILITY TRENCHES ARE BACKFILLED AND COMPACTED, THE SURFACES OVER SUCH TRENCHES SHALL BE MOUNDING SLIGHTLY TO PREVENT CHANNELING OF WATER IN THE TRENCH AREA. CARE SHOULD BE EXERCISED TO PROVIDE FOR CROSS-FLOW AT FREQUENT INTERVALS WHERE TRENCHES ARE NOT ON THE CENTERLINE OF A CROWNED STREET. REMOVE ALL CHECK DAMS PRIOR TO BACKFILL.
18. TO CONTROL SEDIMENT ENTERING FIELD INLETS, PLACE TWO STRAW BALES IN THE CONCRETE V-DITCH AT THE SIDE OPENING OF THE FIELD INLET AT THE LOCATIONS SHOWN ON THIS PLAN.
19. EXCEPT AS OTHERWISE DIRECTED BY THE INSPECTOR, ALL DEVICES SHOWN SHALL BE IN PLACE AT THE END OF EACH WORKING DAY OR WHEN DIRECTED BY THE INSPECTOR.
20. ALL BASINS AND CHECK DAMS SHALL HAVE BEEN PUMPED DRY, AND ALL DEBRIS AND SILT REMOVED WITHIN 24 HOURS AFTER EACH STORM.
21. SANDBAGS SHALL BE STOCKPILED ON-SITE, READY TO BE PLACED IN POSITION WHEN RAIN FORECAST IS 40% CHANCE OR GREATER
22. EXPOSED SLOPES SHALL BE PROTECTED BY VEGETATION COVER OR FABRIC COVER AS APPROVED BY THE CITY ENGINEER.
23. WHEN PAD ELEVATION OF ADJACENT LOTS OR ELEVATION BETWEEN STREET AND LOT ARE SEPARATED BY MORE THAN 6 FEET, A MINIMUM 12" BERM SHALL BE MAINTAINED ALONG THE PROPERTY LINE SEPARATING THE LOTS, AND THE BERM SHALL DIRECT THE WATER TO THE OUTLET. VELOCITY CHECK DAMS SHALL BE INSTALLED BETWEEN THE OUTLET ON THE LOT AND THE STREET.




1. INTENDED FOR SHORT-TERM USE.
2. USE TO INHIBIT NON-STORM WATER FLOW.
3. ALLOW FOR PROPER MAINTENANCE AND CLEAN UP.
4. BAGS MUST BE REMOVED AFTER ADJACENT OPERATION IS COMPLETED.
5. NOT APPLICABLE IN AREAS WITH HIGH SILTS AND CLAYS WITHOUT FILTER FABRIC.

THE GRAVEL BAG BARRIER (TYPE C) IS SHOWN IN THE FIGURES. FLOW FROM A SEVERE STORM SHOULD NOT OVERTOP THE CURB. IN AREAS OF HIGH CLAY AND SILTS, USE FILTER FABRIC AND GRAVEL AS ADDITIONAL FILTER MEDIA. GRAVEL BAGS SHOULD BE USED TO THEIR HIGH PERMEABILITY.

1. USE SAND BAG MADE OF GEOTEXTILE FABRIC (NOT BURLAP) AND FILL WITH 0.75 ROCK OR 0.25 IN. PEA GRAVEL.
2. CONSTRUCT ON GENTLY SLOPING STREET.
3. LEAVE ROOM UPSTREAM OF BARRIER FOR WATER TO POND AND SEDIMENT TO SETTLE.
4. PLACE SEVERAL LAYERS OF SAND BAGS - OVERLAPPING THE BAGS AND PACKING THEM TIGHTLY TOGETHER.
5. LEAVE GAPS FOR ONE BAG ON THE TOP ROW TO SERVE AS A SPILLWAY. FLOW FROM A SEVERE STORM (E.G. HEAVY RAIN STORM) SHOULD NOT OVERTOP THE CURB.
6. THIS DETAIL IS TO BE USED ON EXISTING STREETS WHERE SILTED FLOW IS TO BE INTERCEPTED (CAUGHT) PRIOR TO ENTERING THE STORM DRAIN SYSTEM. SANDBAGS CAN ALSO BE USED WHEN THE ROUGH GRADED STREETS HAVE POURED INPLACE CONCRETE SURROUNDING THE INLET TO CREATE A FLOW LINE WITHIN THE DAM CAN BE ACHIEVED TO PROTECT THE STORM SYSTEM FROM THE INFLOW OF SEDIMENT.

INSTALLATION DETAIL

D TYPICAL SILTSACK CONSTRUCTION

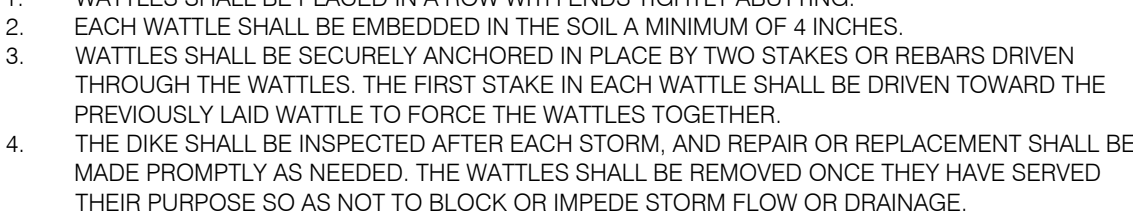


NTS



1. FACE SIGN TOWARD NEAREST STREET OR ACCESS POINT.
2. CONCRETE WASHOUT SHALL BE LOCATED BEHIND THE CURB AND 50 FEET MINIMUM FROM DRAINAGE INLETS OR WATERCOURSES.
3. CONTRACTOR SHALL CONDUCT ALL CONCRETE WASHOUT OFF-SITE

NIS

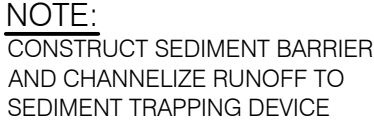

NTS





NTS

DESIGN AND CONSTRUCTION SPECIFICATIONS:

1. THE TEMPORARY STABILIZED CONSTRUCTION ENTRANCE SHALL BE CONSTRUCTED IN STRICT ACCORDANCE WITH THE PLANS AND SPECIFICATIONS OF LATEST EDITION OF THE CALIFORNIA STORMWATER HANDBOOK, DETAIL TC-1. WHERE THERE IS A DISCREPANCY BETWEEN THIS DETAIL AND THE CALIFORNIA STORMWATER HANDBOOK, THE HANDBOOK SHALL GOVERN.
2. CONTRACTOR SHALL CONSTRUCT A STABILIZED CONSTRUCTION ENTRANCE AT EACH ENTRANCE TO THE PROJECT SITE AND SHALL BE CONSTRUCTED ON LEVEL GROUND.
3. THE MATERIAL FOR CONSTRUCTION OF THE PAD SHALL BE 3 TO 6 INCH DIA. STONE.
4. THE THICKNESS FOR THE PAD SHALL NOT BE LESS THAN 12 INCHES OR AS RECOMMENDED BY SOILS ENGINEER.
5. THE WIDTH OF THE PAD SHALL NOT BE LESS THAN 50 OR THE FULL WIDTH OF ALL POINTS OF INGRESS OR EGRESS, WHICHEVER IS GREATER.
6. THE LENGTH OF THE PAD SHALL AS BE REQUIRED, BUT NOT LESS THAN 50 FEET.
7. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHT-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND, AND REPAIR AND/OR CLEAN OUT ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHT-OF-WAY SHALL BE REMOVED IMMEDIATELY.
8. WHEN NECESSARY, WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP, SEDIMENT BASIN, OR SEDIMENT SWALE. CONTRACTOR SHALL NOT ALLOW ANY SEDIMENT TO ENTER FROM ENTERING ANY STORM DRAIN, DITCH, OR WATERCOURSE THROUGH USE OF GRAVEL BAGS, GRAVEL, SODS, OR OTHER APPROVED METHODS.
9. CONTRACTOR TO REMOVE AND DISPOSE OF STABILIZED CONSTRUCTION ENTRANCE UPON COMPLETION OF CONSTRUCTION.
10. CONSTRUCTION AND MAINTENANCE SHALL BE IN ACCORDANCE WITH THE 2003 CALIFORNIA STORMWATER BMP HANDBOOK.

NIS

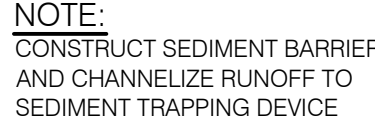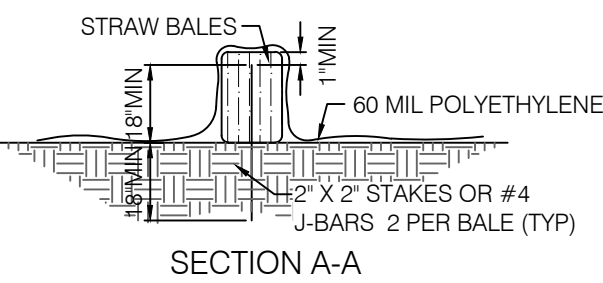

NTS



NTS



VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED



STOCKTON, CALIFORNIA


DRAWING TITLE

23-12862

C6.2

\\net-file1\Users\jesus.izazaga_TETRI\Documents\12889-A-STOCKTON PEYTON ELEM ELOP_jezazaga.rvt

PLOT DATE: 7/3/2024 2:47:03 PM

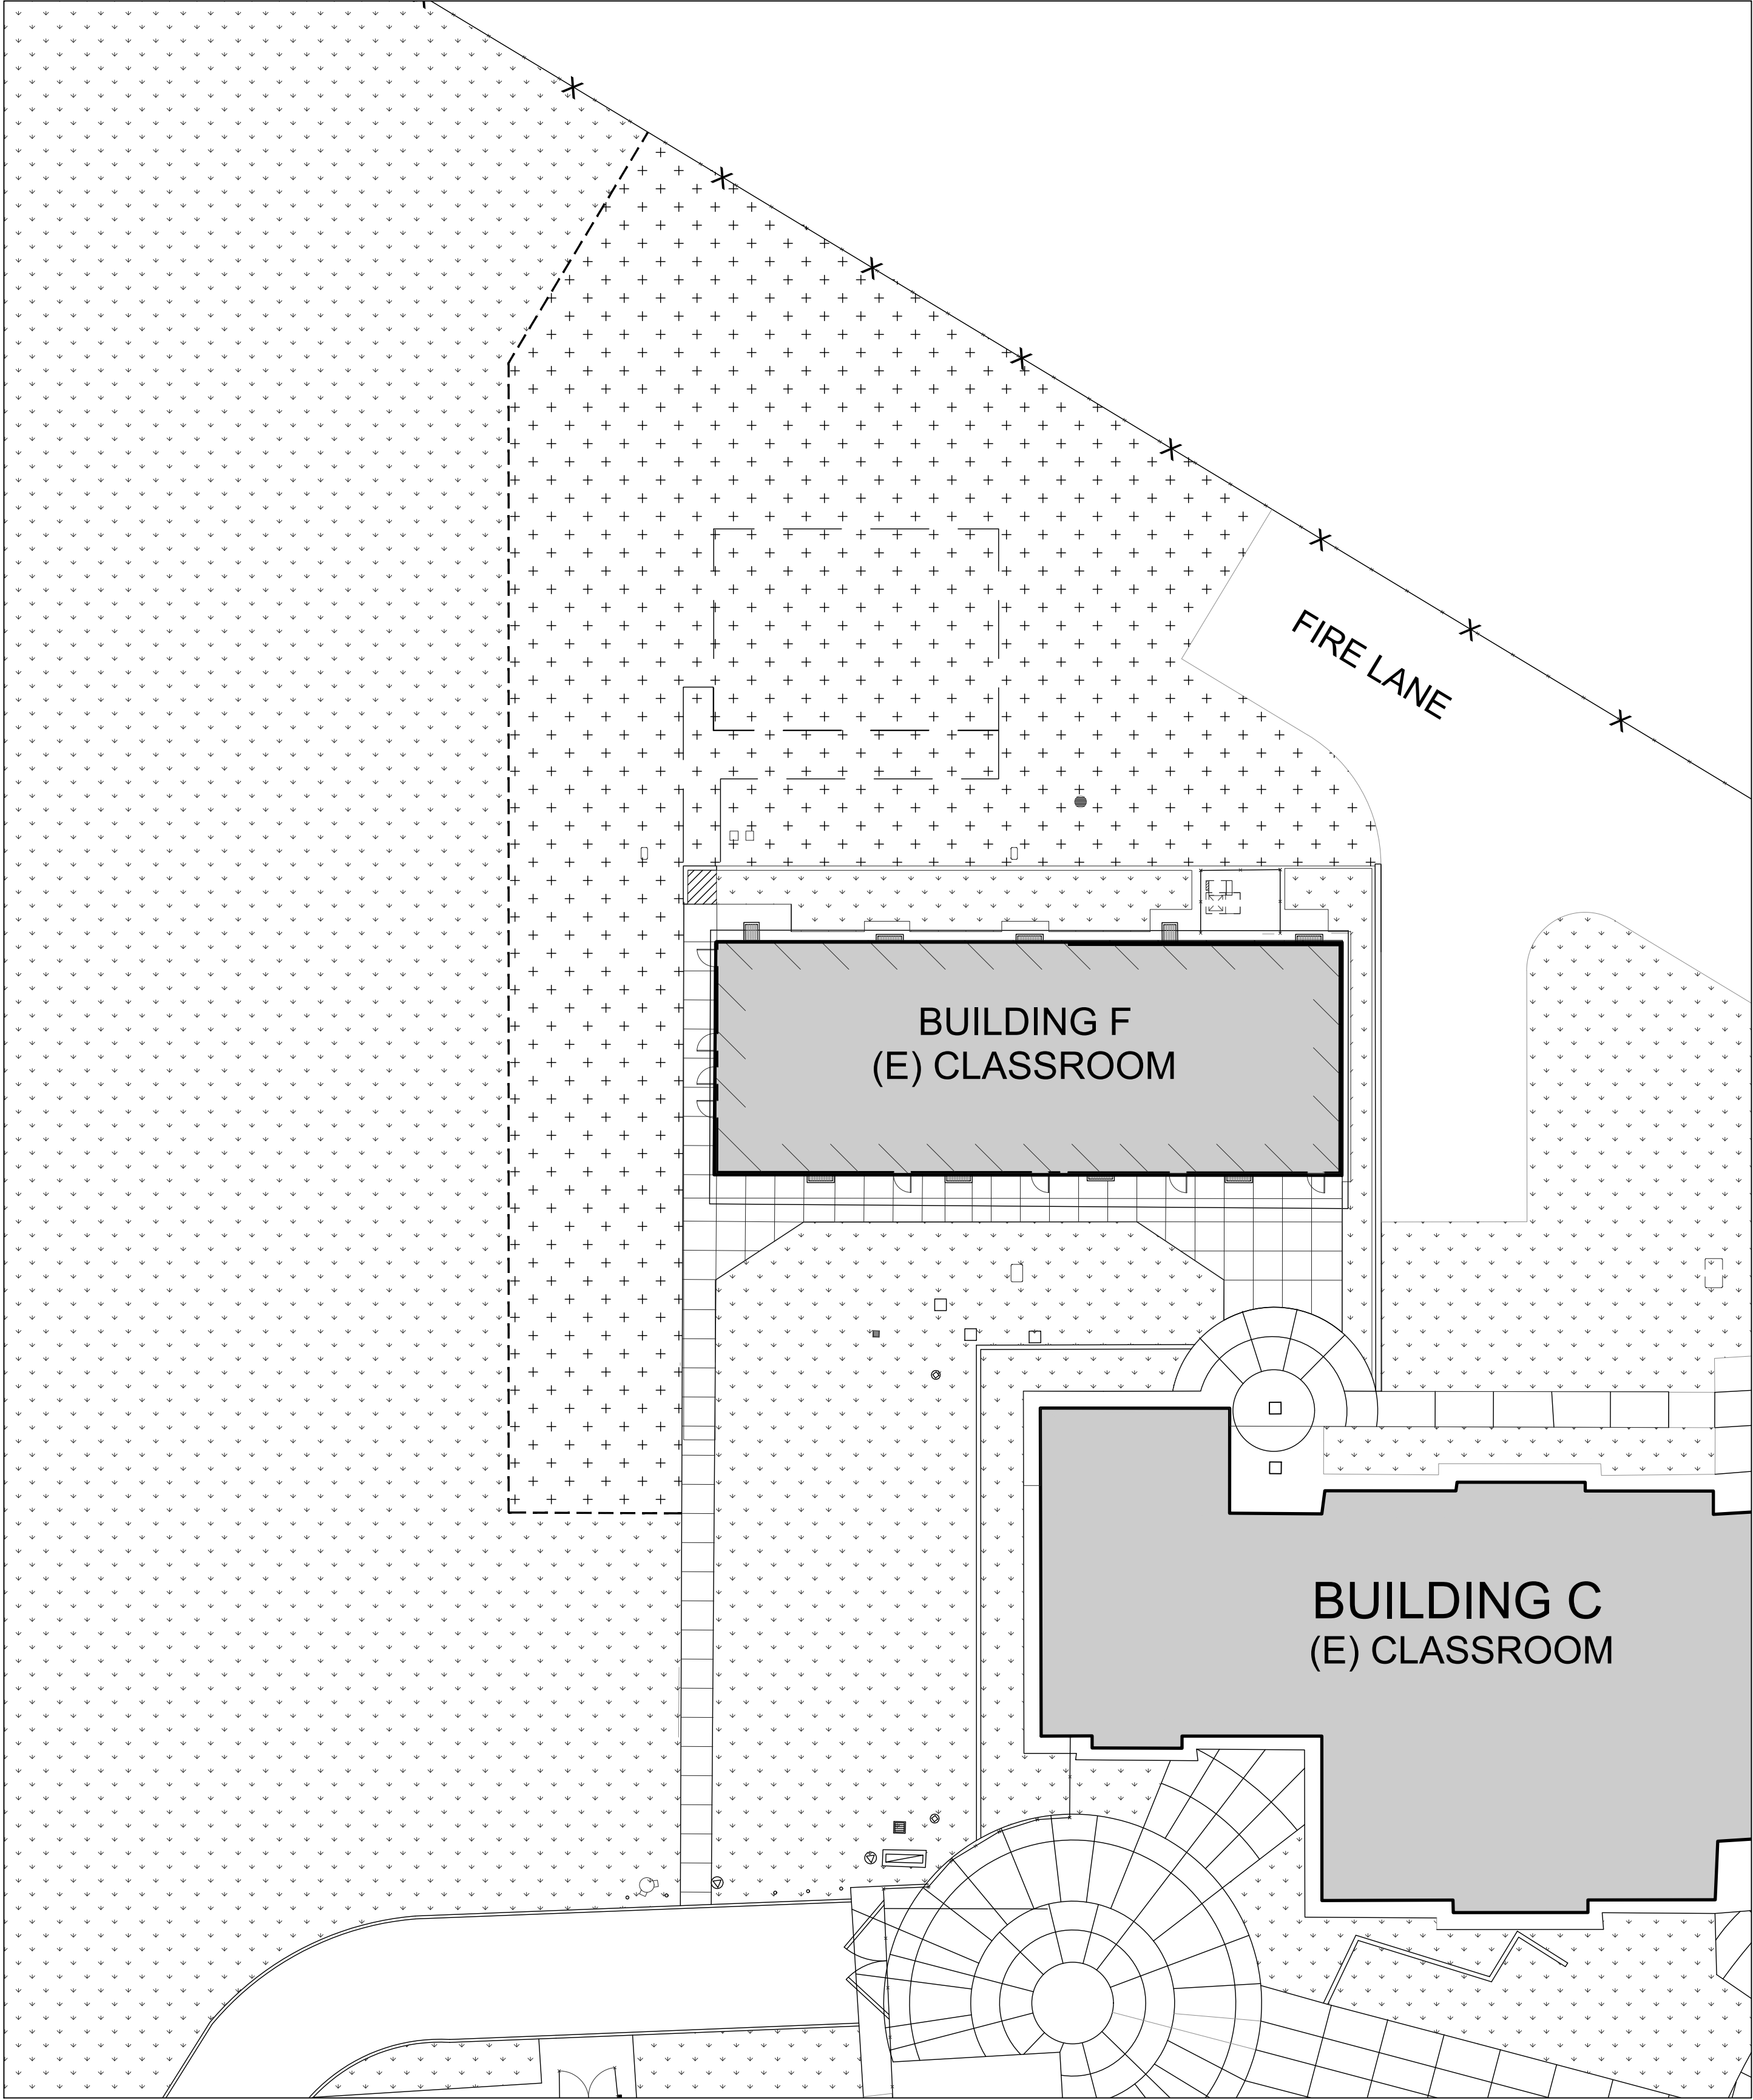


LANDSCAPE DEMOLITION LEGEND


SYMBOL	DESCRIPTION
	Existing Turf & Landscape Areas to Remain and Protect. Existing turf, plant material or trees that are damaged due to construction activities, vehicle damage, stress due to lack of water or other deterioration of the existing areas to remain are to be restored by the contractor to the existing condition prior to the project at no additional cost to the District. This includes damage that may occur at any area of the campus. In disturbed areas, the Contractor is to fill and grade low and depressed areas with clean sandy topsoil and sod damaged existing turf areas to match the adjacent existing turf. In shrub areas, after grading as described above, the Contractor is to repair any damage and replace any stressed or damaged plant material to match the existing. The Contractor is responsible for sodding over trenches and all disturbed turf areas due to any construction activities. Contractor is to maintain sodded and repaired landscape areas until fully established and weed free, a minimum of 90 days or until accepted by the District.
	Existing Turf & Landscape Areas to Remain and Protect are not to have construction vehicle traffic or parking and are not to have stored materials in these areas. Automatic irrigation systems are to be maintained active and Contractor is to restore damaged areas as described above.
	Existing Turf Demolition: Contractor is to remove existing turf areas after existing turf has been eradicated with approved chemical herbicide (3 applications min.) required. Contractor to irrigate existing turf to keep in healthy growth state. Herbicide applications are to be a minimum of 1 week apart. Contractor is to remove all vegetation and root mat. Regrade Landscape areas 1" (Turf Areas) below adjacent concrete sidewalks and contour grades to insure positive drainage in areas. Contractor is to remove all vegetation, green waste and debris off site at no additional cost to the District. All landscape areas are to have a positive slope and the site is to be free draining with no standing water. See Site Grading Plan. Contractor is to field verify the extent of Landscape Demolition prior to bid.
	Existing Planter Areas to be Removed. Contractor is to remove the designated shrubs to include all vegetation, branches, trunk, stump and roots to a minimum depth of 24" below grade. Contractor is to fill any depressed areas with clean sandy topsoil and haul all debris off site at the contractors expense to and approved disposal site. Contractor to field verify.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these drawings and designs, the design and design documents, and the design and design documents, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.	
B	07/31/2024
DSA SUBMITTAL	
DESCRIPTION	
C	11/01/2024
DSA BACKCHECK SUBMITTAL	

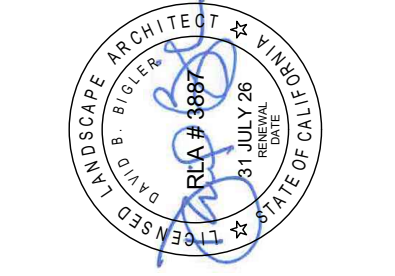


TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

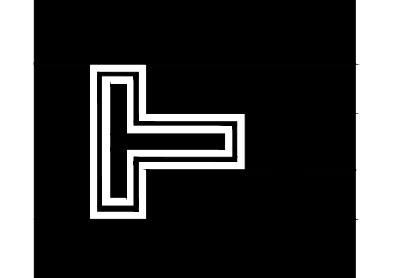

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
LANDSCAPE DEMOLITION PLAN

PROJECT NO.
23-12899

DRAWING
L100




1" = 20'-0"

David Bigler Associates
Landscape Architect #3887
1589 W Shaw Avenue #5
Fresno, California 93711
E Mail: davebigler@aol.com
Tel: (559) 276-9495
Fax: (559) 276-9497

\\net-file1\Users\jesus.izazaga_TETRI\Documents\12889-A-STOCKTON PEYTON ELEM ELOP_jezazaga.rvt

PLOT DATE: 7/3/2024 2:47:03 PM

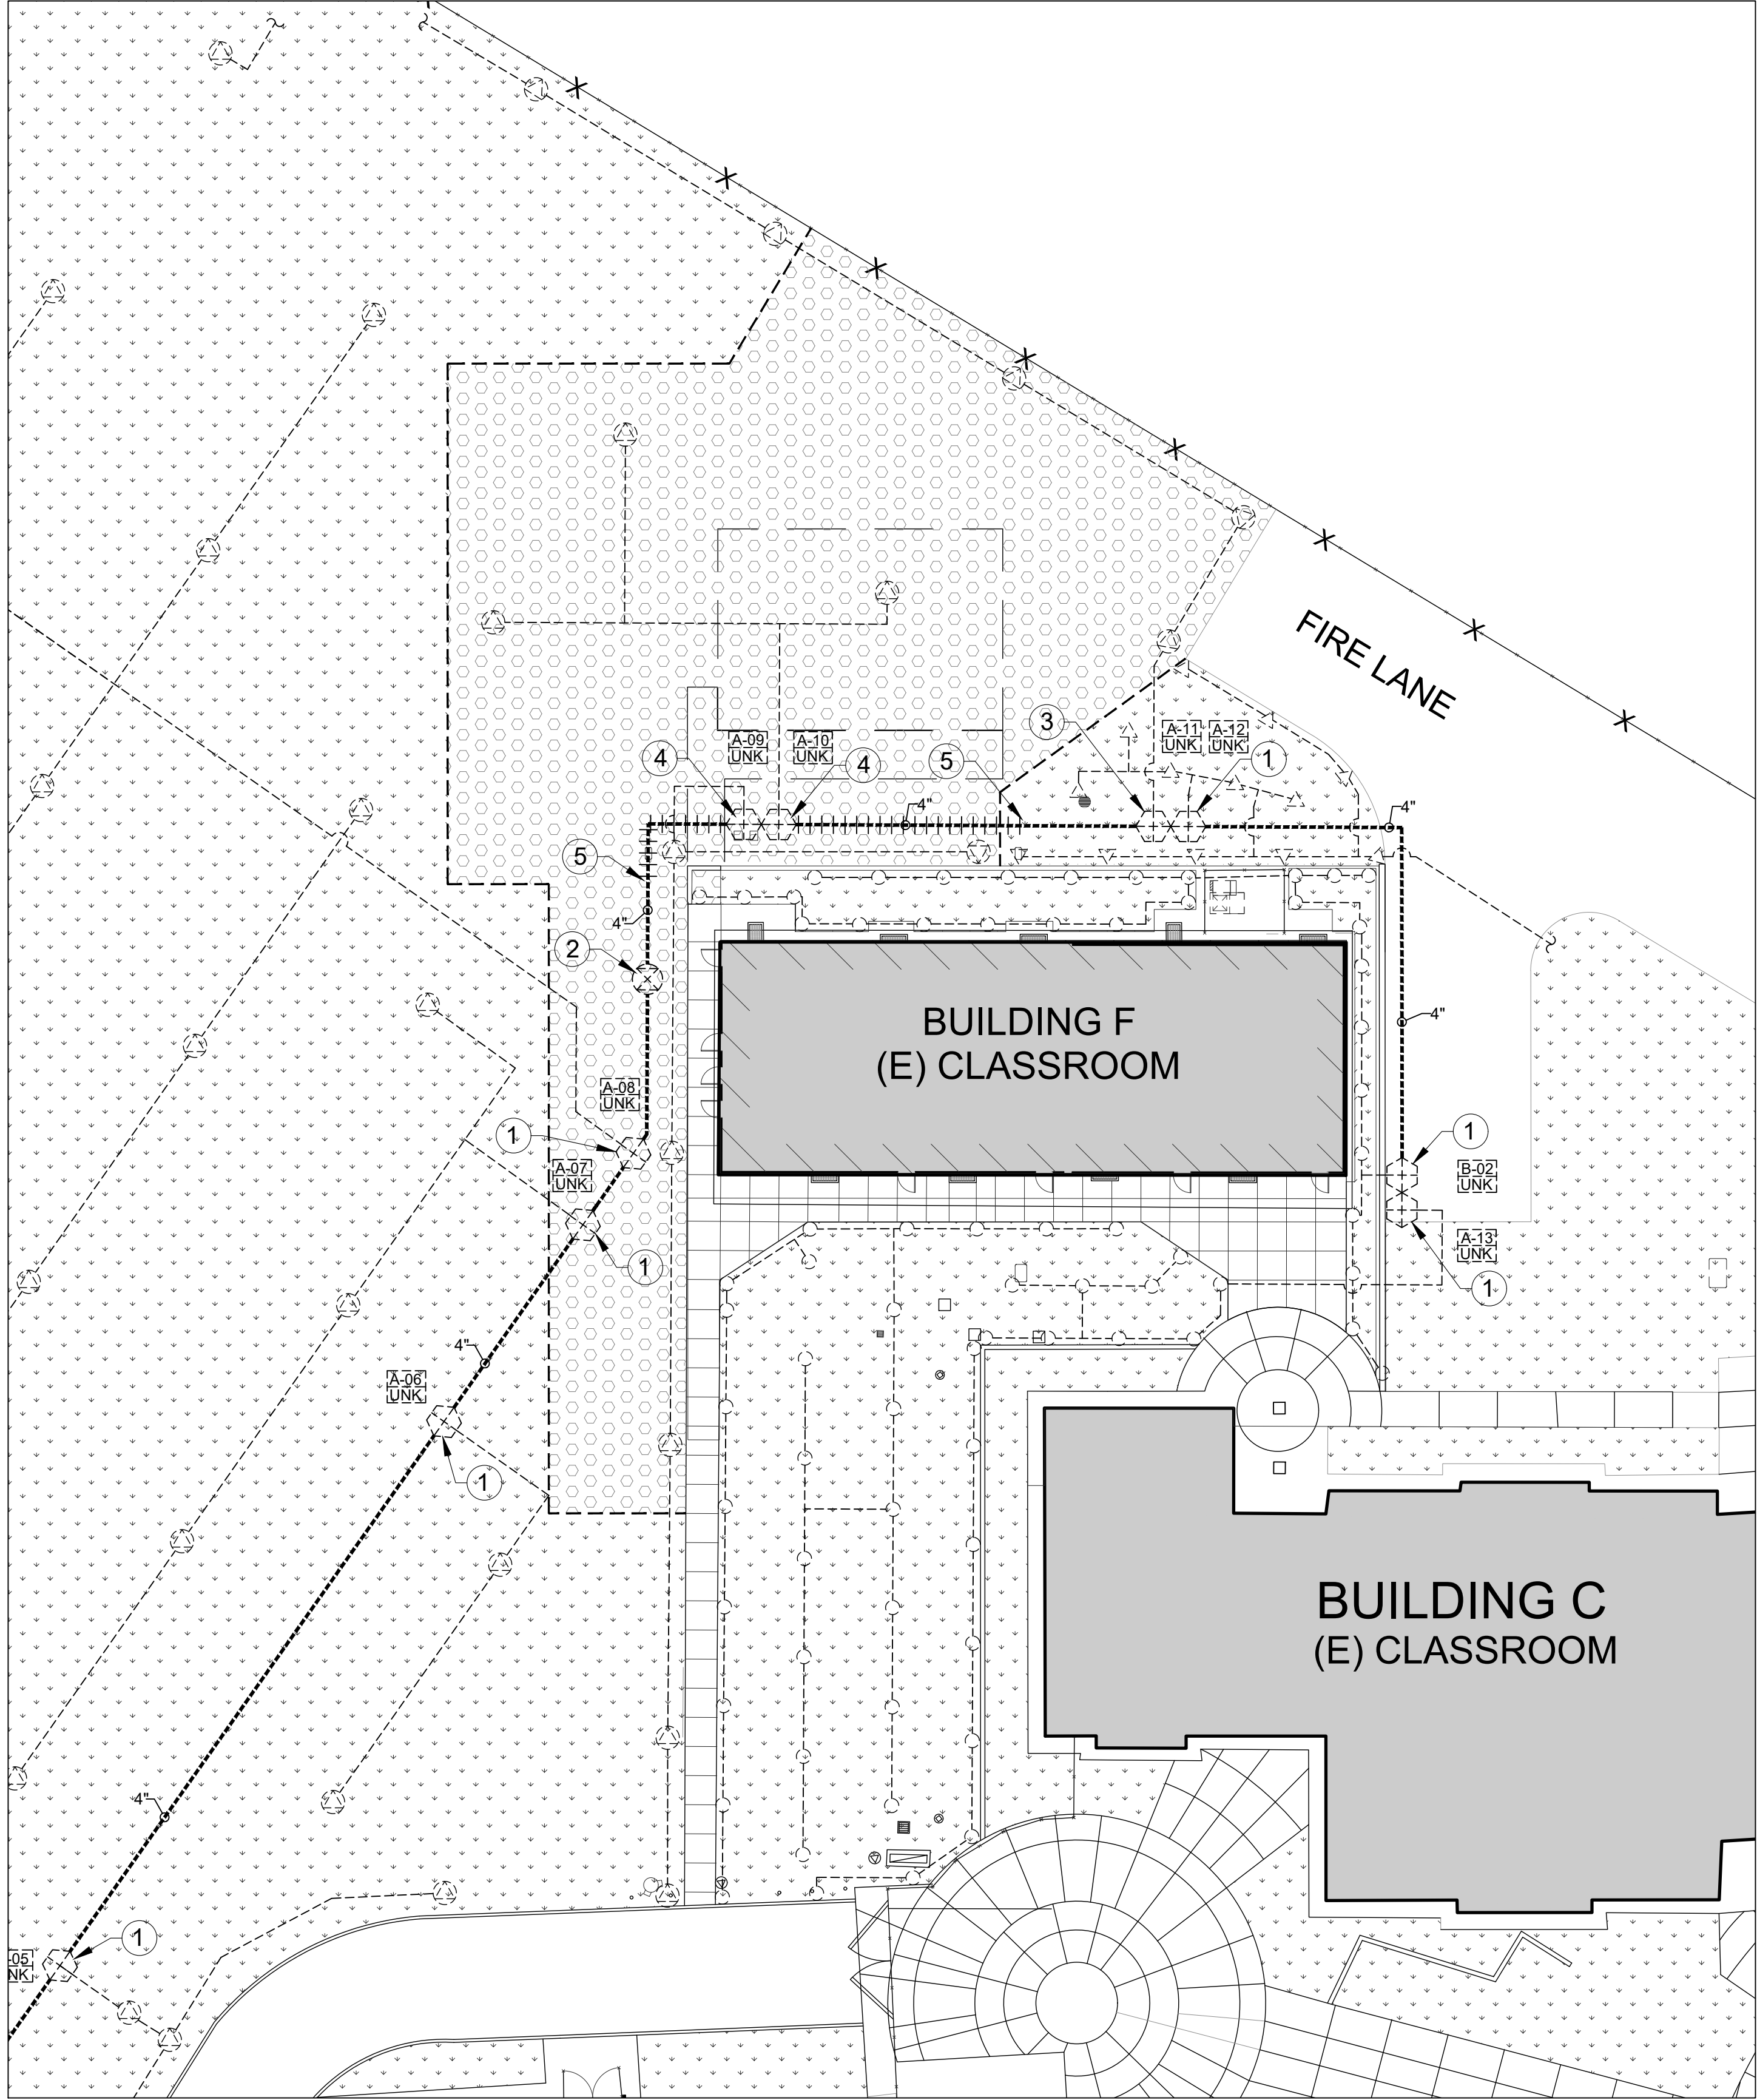

IRRIGATION DEMOLITION LEGEND

SYMBOL	DESCRIPTION
	Existing Sprinklers to Remain & Protect, unless otherwise noted. See Keynotes, Designated Irrigation Demolition Areas and Landscape Irrigation Plans. Contractor to field verify.
	Existing Lateral Pipe to Remain & Protect. Modify as required for the project. See Keynotes, Designated Irrigation Demolition Areas and Landscape Irrigation Plans. Sections of the existing lateral pipe are being taken out of service. Lateral piping being taken out of service is to be removed where it interfere's with construction activities, or is located below the proposed buildings, otherwise mainline piping may be abandoned below grade. Contractor to field verify.
	Existing Irrigation Mainline (Remain & Protect): Routing shown is diagrammatic. Contractor is to pot hole and field locate all relevant existing irrigation improvements that affect construction activities. Sections of the existing mainline pipe are to remain and protect and other sections are being taken out of service. Contractor is to field verify existing conditions prior to bid to determine the final extent of work. See Irrigation Plans for additional information where new irrigation mainline will replace existing irrigation mainline pipe. Contractor to field verify.
	Existing Irrigation Mainline (Abandoned / Removed): Routing shown is diagrammatic. Contractor is to pot hole and field locate all relevant existing irrigation improvements that affect construction activities. Sections of the existing mainline pipe are being taken out of service. Mainline piping being taken out of service is to be removed where it interfere's with construction activities, or is located below the proposed buildings, otherwise mainline piping may be abandoned below grade. Cap ends to abandon below grade where it is cut or damaged. Contractor is to field verify existing conditions prior to bid to determine the final extent of work. See Irrigation Plans for additional information where new irrigation mainline will replace existing irrigation mainline pipe. Contractor to field verify.
	Existing Remote Control Valve to Remain & Protect, unless otherwise noted. See Keynotes, designated Irrigation Demolition Areas and Landscape Irrigation Plan. Contractor to field verify.
	Existing Controller # / Station # Gallons per minute (UNK - Valve flow rate is unknown)
NOT SHOWN	Existing Conventional Irrigation Controllers 'A' and 'B' to remain and protect. Contractor to field verify. See Landscape Irrigation Plan on Plan Sheets L201 for additional information.
	Existing Irrigation Improvements to Remain and Protect. All areas adjacent to the project area have existing Irrigation Improvements to Remain & Protect. Contractor is to repair all damage to existing improvements that are intended to remain & protect to match existing improvements. Damage may be a direct or indirect result of their work or may be caused by neglect. Contractor to field verify.
	Existing Irrigation Areas to be Removed. The Contractor is to remove existing sprinklers, valves and other irrigation improvements visible at the surface in areas to receive new irrigation and deliver salvaged parts, including, but not limited to sprinklers, valves, valve boxes etc., to the District Maintenance Department. Piping is to be removed where it interferes with construction activities or is below proposed buildings, otherwise piping may be abandoned below grade. Where piping is brought to the surface, the Contractor shall cut it off a minimum of 12" below grade and capped. Depressions and holes that are created from removing existing Irrigation improvements being replaced are to be filled with clean topsoil level with surrounding grade and compacted. Irrigation system and building water are to remain intact and operational for areas to remain and protect. Contractor to field verify.


Dashed symbols represent existing irrigation improvements to Remain & Protect unless otherwise noted or located in areas to receive new improvements or areas to have new irrigation installed. Existing locations are diagrammatic. Contractor is to field locate all existing improvements that may effect the work. Contractor to field verify.

IRRIGATION DEMOLITION KEYNOTES


- EXISTING REMOTE CONTROL VALVE TO REMAIN & PROTECT AND MAINTAIN EXISTING CONTROLLER ASSIGNMENT. CONTRACTOR TO FIELD VERIFY.
- EXISTING GATE VALVE TO REMAIN & PROTECT. CONTRACTOR TO FIELD VERIFY.
- EXISTING REMOTE CONTROL VALVE TO BE REMOVED AND REPLACED. INSTALL NEW REMOTE CONTROL VALVE ON THE EXISTING IRRIGATION MAINLINE PIPE AND CONNECT TO THE NEW SPRINKLERS. CONTRACTOR IS TO RECONNECT EXISTING LOW VOLTAGE CONTROL WIRING TO THE NEW REMOTE CONTROL VALVE. REMOTE CONTROL VALVE IS TO MAINTAIN SAME STATION NUMBER ON DESIGNATED CONTROLLER. SEE IRRIGATION PLAN ON PLAN SHEET L201 FOR ADDITIONAL INFORMATION. DELIVER USABLE PARTS AND VALVE BOX TO DISTRICT. DISPOSE OF ALL REMOVED MATERIALS NOT WANTED BY DISTRICT OFF SITE AT NO ADDITIONAL COST TO DISTRICT. CONTRACTOR TO FIELD VERIFY.
- EXISTING REMOTE CONTROL VALVE TO BE REMOVED AND REPLACED. INSTALL NEW REMOTE CONTROL VALVE ON THE NEW IRRIGATION MAINLINE PIPE AND CONNECT TO NEW SPRINKLERS. CONTRACTOR IS TO RECONNECT EXISTING LOW VOLTAGE CONTROL WIRING TO THE NEW REMOTE CONTROL VALVE. REMOTE CONTROL VALVE IS TO MAINTAIN SAME STATION NUMBER ON DESIGNATED CONTROLLER. SEE IRRIGATION PLAN ON PLAN SHEET L201 FOR ADDITIONAL INFORMATION. DELIVER USABLE PARTS AND VALVE BOX TO DISTRICT. DISPOSE OF ALL REMOVED MATERIALS NOT WANTED BY DISTRICT OFF SITE AT NO ADDITIONAL COST TO DISTRICT. CONTRACTOR TO FIELD VERIFY.
- IRRIGATION POINT OF CONNECTION: CONTRACTOR IS TO CONNECT NEW IRRIGATION MAINLINE PIPE TO EXISTING IRRIGATION MAINLINE PIPE TO REMAIN IN SERVICE AT THE LOCATIONS INDICATED. EXISTING MAINLINE PIPE ROUTING IS DIAGRAMMATIC, AND CONTRACTOR IS TO FIELD LOCATE TO DETERMINE POINTS OF CONNECTION IN THE FIELD. SEE IRRIGATION PLAN L201 FOR ADDITIONAL INFORMATION. CONTRACTOR IS TO TRACE AND IDENTIFY EXISTING LOW VOLTAGE CONTROL WIRING THAT TRAVERSES THROUGH THE PROJECT AND IS TO INTERCEPT, SPLICE AND EXTEND IT ADJACENT TO THE NEW IRRIGATION MAINLINE PIPE. CONTRACTOR IS TO SPLICE AND EXTEND EXISTING LOW VOLTAGE CONTROL WIRING TO DESIGNATED REPLACEMENT IRRIGATION CONTROLLER. CONTRACTOR IS TO TRACE ALL EXISTING LOW VOLTAGE CONTROL WIRING IN THE FIELD, FOR ALL EXISTING VALVES TO REMAIN AND PROTECT, TO DETERMINE THE BEST LOCATION TO INTERCEPT EXISTING CONTROL WIRES AS NOTED ABOVE. ALL EXISTING VALVES TO REMAIN AND PROTECT ARE NOT SHOWN ON THE PLAN AND CONTRACTOR IS RESPONSIBLE FOR CONNECTION OF ALL EXISTING VALVES TO REMAIN AND PROTECT TO EXISTING IRRIGATION CONTROLLER TO REMAIN AND PROTECT. CONTRACTOR TO FIELD VERIFY.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these drawings, designs, and specifications. No part of these drawings, designs, or specifications may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written authorization of Teter, Inc.	07/31/2024	DSA SUBMITTAL	DATE	11/01/2024	DESCRIPTION	DSA BACKCHECK SUBMITTAL
B			MARK	C		



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
IRRIGATION DEMOLITION PLAN

PROJECT NO.

23-12899

DRAWING

L101




David Bigler Associates
Landscape Architect #3887
1589 W Shaw Avenue #5
Fresno, California 93711
E Mail: davebigler@aol.com
Tel: (559) 278-9495
Fax: (559) 278-9497

1" = 20'-0"

2

IRRIGATON DEMOLITION PLAN

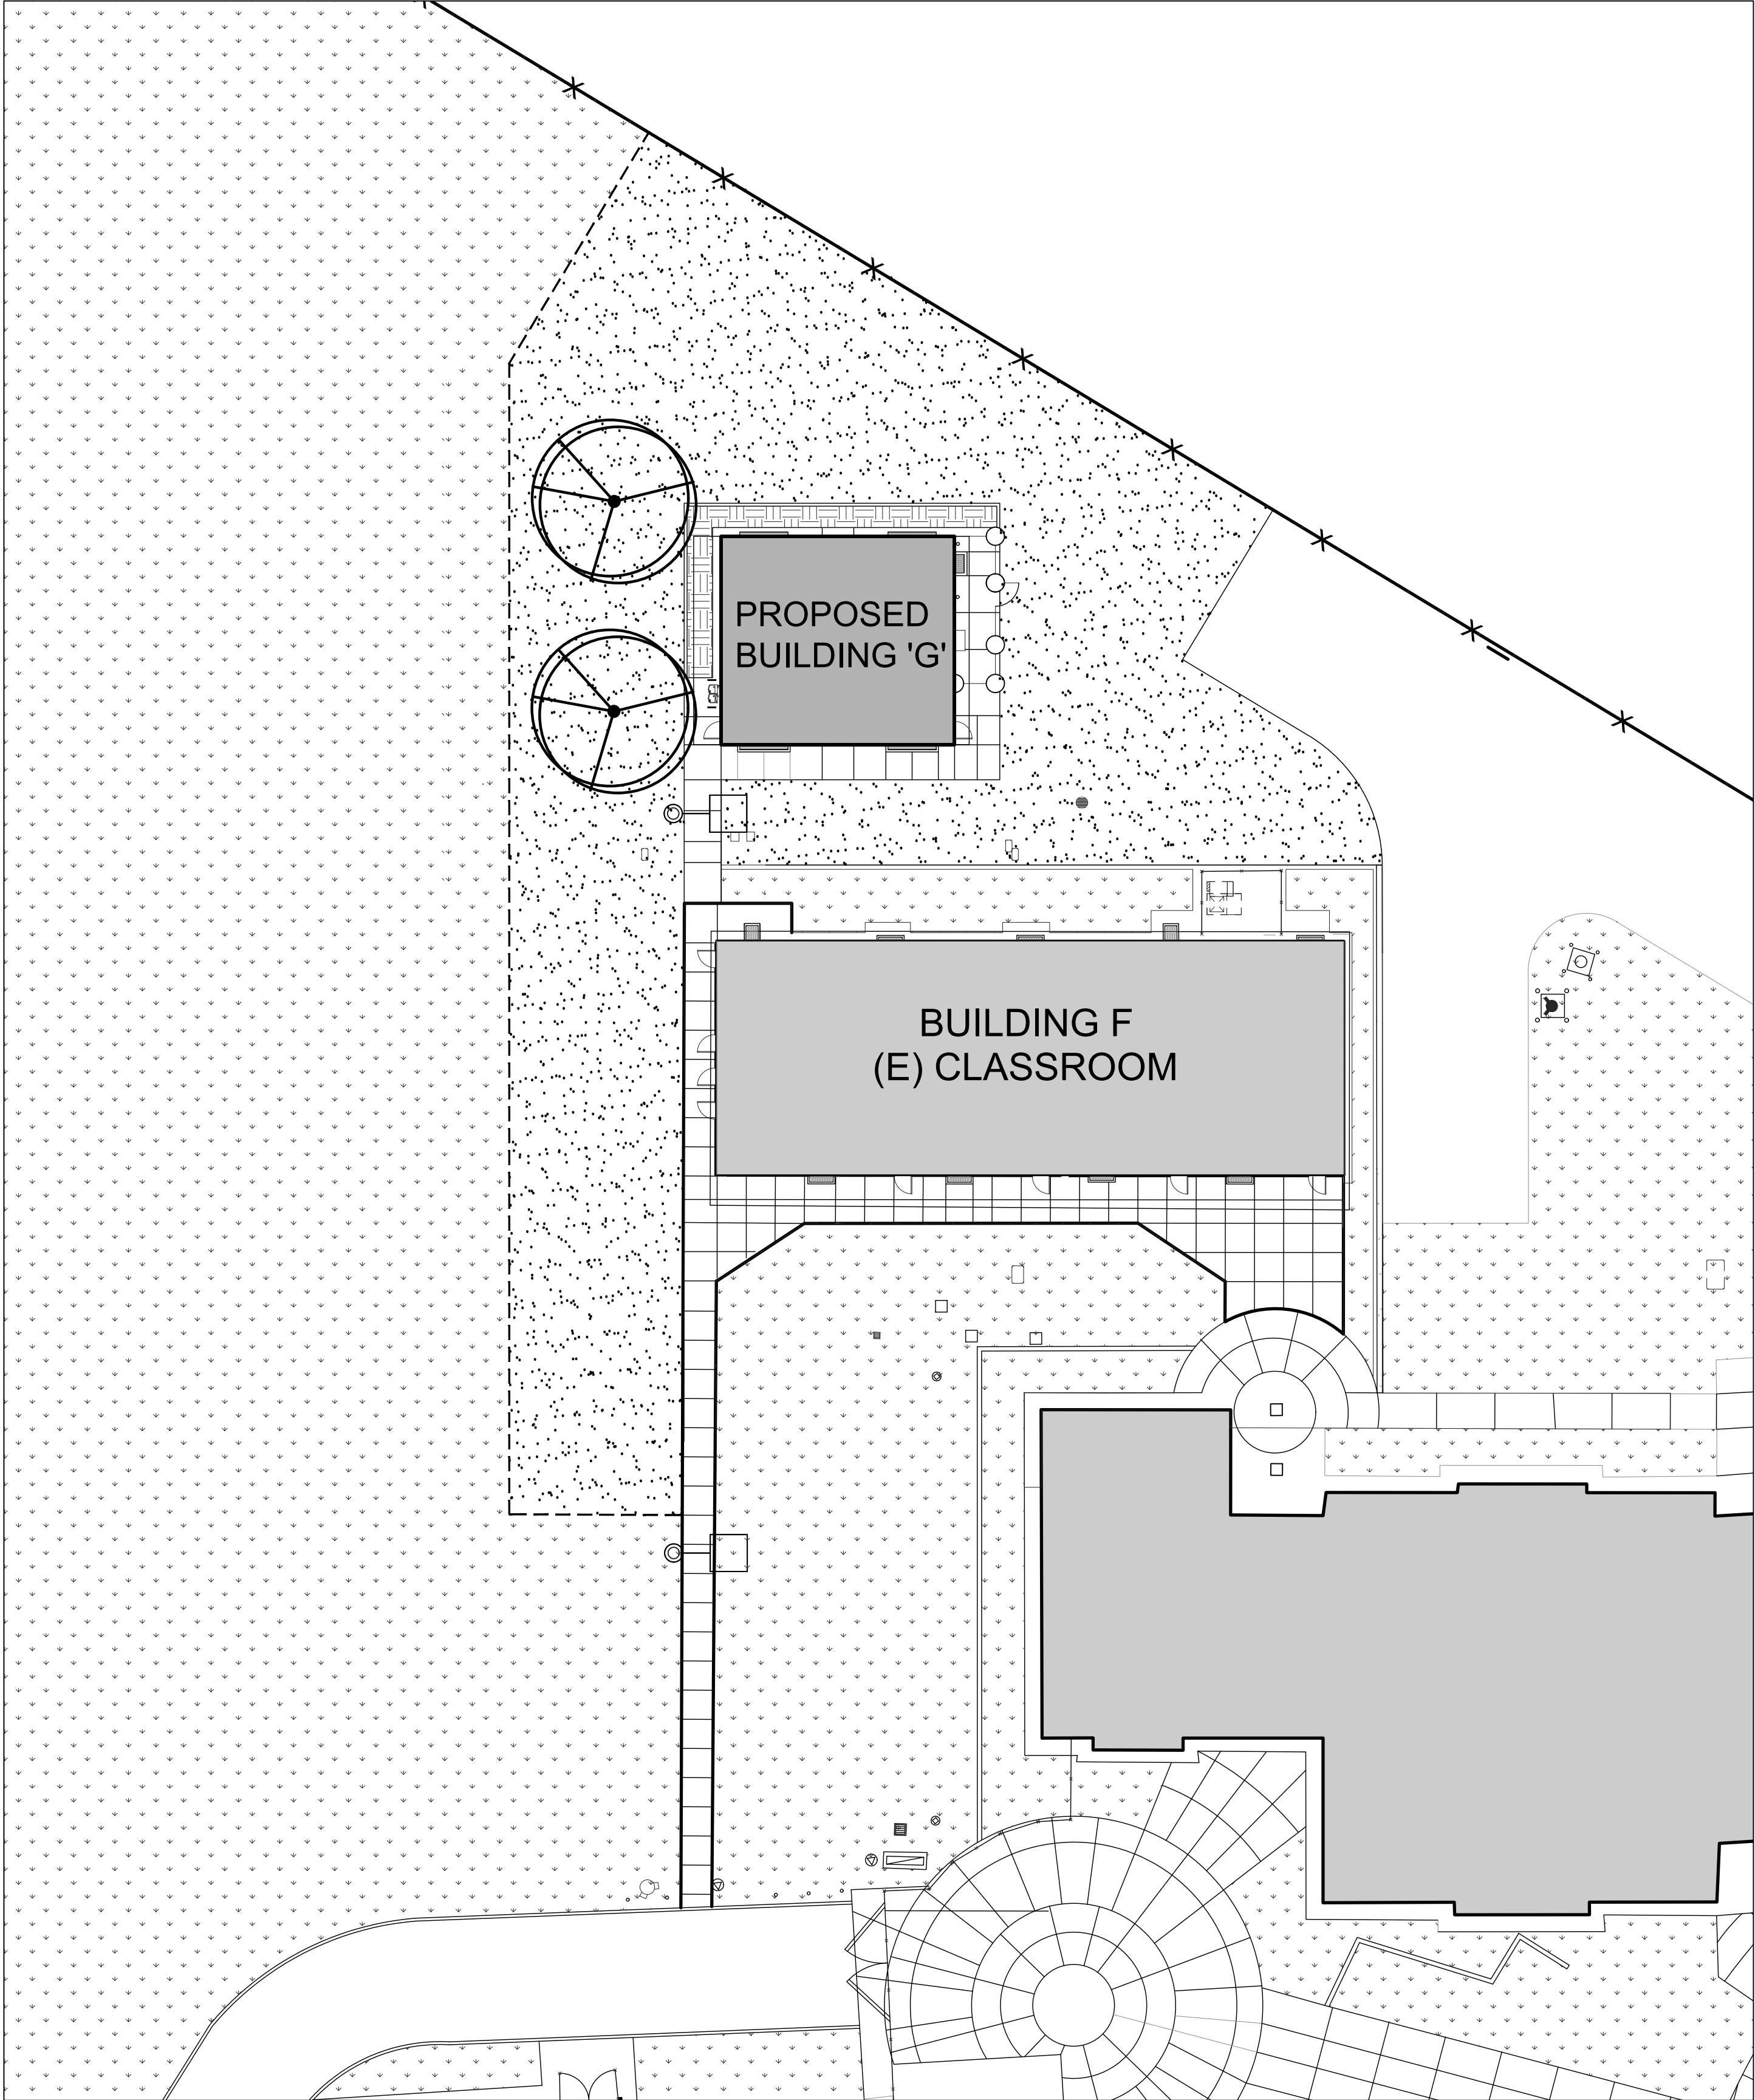

LANDSCAPE PLANTING LEGEND

SYMBOL	WATER USE	SIZE	DESCRIPTION
	MOD	15 GAL	ACER rubrum 'October Glory', October Glory Red Maple Tree, Standard Form. See Installation Detail #09 on Plan Sheet L301 for additional information.
	MOD	SOD	Sodded Turfgrass - Celebration Hybrid Bermudagrass Sod as supplied by Delta Bluegrass Sod, (800) 637-8873, or approved equal. See specifications. Contractor is to maintain sodded turfgrass until fully established and weed free. Contractor is to remove existing turf areas where new improvements or sod are shown. Contractor is to remove all vegetation and shrubbery where new improvements are shown. Remove root systems as required to a minimum depth of 18" below grade for shrubs and trees. Regrade turf areas 1" below adjacent concrete sidewalks and contour grades to insure positive drainage. Contractor is to remove all vegetation, green waste and debris off site at no additional cost to the District. All planters are to have a positive slope away from buildings (min. 2% slope).
			Stabilized Decomposed Granite Areas - 3" compacted layer of stabilized Gold Decomposed Granite installed over compacted subgrade. Excavate existing soil as required to achieve the design finish grade (top of DG) to insure site drainage to established existing drainage patterns. See Installation Detail #10 on Plan Sheet L301 for additional information.
			Existing Turf & Landscape Areas to Remain and Protect. Existing turf, plant material or trees that are damaged due to construction activities, vehicle damage, stress due to lack of water or other deterioration of the existing areas to remain are to be restored by the contractor to the existing condition prior to the project at no additional cost to the District. This includes damage that may occur at any area of the campus. In disturbed areas, the Contractor is to fill and grade low and depressed areas with clean sandy topsoil and sod existing turf areas to match the adjacent existing turf. In shrub areas, after grading as described above, the Contractor is to repair any damage and replace any stressed or damaged plant material to match the existing. The Contractor is responsible for sodding over trenches and all disturbed turf areas due to any construction activities. Contractor is to maintain sodded and repaired landscape areas until fully established and weed free, a minimum of 90 days or until accepted by the District. Existing Turf & Landscape Areas to Remain and Protect are not to have construction vehicle traffic or parking and are not to have stored materials in these areas. Automatic irrigation systems are to be maintained active and Contractor is to restore damaged areas as described above.
			6" x 6" Concrete Mow Strip with one (1) #4 rebar and deep groove expansion joints installed ten feet (10'-0") on center. See Installation Detail #11 on Plan Sheet L301 for additional information.

SEE TREE & SHRUB PLANTING DETAIL #09 ON PLAN SHEET L301

PROJECT LANDSCAPE AND HARDSCAPE AREA SHADING CALCULATION


	100%	75%	50%	25%	Total
LARGE TREE (35' - 40')	962 SF	722 SF	481 SF	241 SF	
1. ACER rubrum 'October Glory'	2	0	0	0	
	0	0	0	0	
	0	0	0	0	
	0	0	0	0	
SHADE QUANTITY (SF)	1,924 SF	0 SF	0 SF	0 SF	1,924 SF
MEDIUM TREE (30' - 35')	707 SF	530 SF	354 SF	177 SF	
	0	0	0	0	
SHADE QUANTITY (SF)	0 SF	0 SF	0 SF	0 SF	0 SF
SMALL TREE (20' - 25')	452 SF	339 SF	226 SF	113 SF	
	0	0	0	0	
SHADE QUANTITY (SF)	0 SF	0 SF	0 SF	0 SF	0 SF
TOTAL TREE SHADING PROVIDED FOR PROJECT LANDSCAPE AND HARDSCAPE AREAS					1,924 SF
TOTAL BUILDING OVERHANG SHADING PROVIDED FOR PROJECT AREAS					259 SF
TOTAL SHADING PROVIDED FOR PROJECT LANDSCAPE AND HARDSCAPE AREAS					2,183 SF
TOTAL PROJECT LANDSCAPE AND HARDSCAPE AREAS					9,491 SF
PROJECT LANDSCAPE AND TREE SHADING PERCENTAGE (MIN. 20% REQ'D)					23%




David Bigler Associates
Landscape Architect #3887
1589 W Shaw Avenue #5
Fresno, California 93711
E Mail: davebigler@aol.com
Tel: (559) 276-9495
Fax: (559) 276-9497

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these drawings, designs, plans, specifications, and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.	
B	07/31/2024
DSA SUBMITTAL	
MARK	DATE
C	11/01/2024
DESCRIPTION	DSA BACKCHECK SUBMITTAL




TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

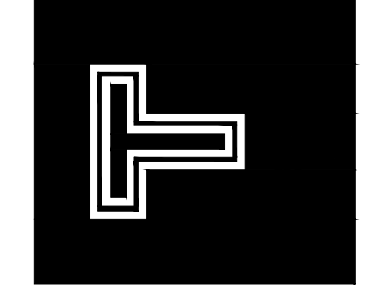


ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
LANDSCAPE PLANTING PLAN

PROJECT NO.
23-12899
DRAWING
L200

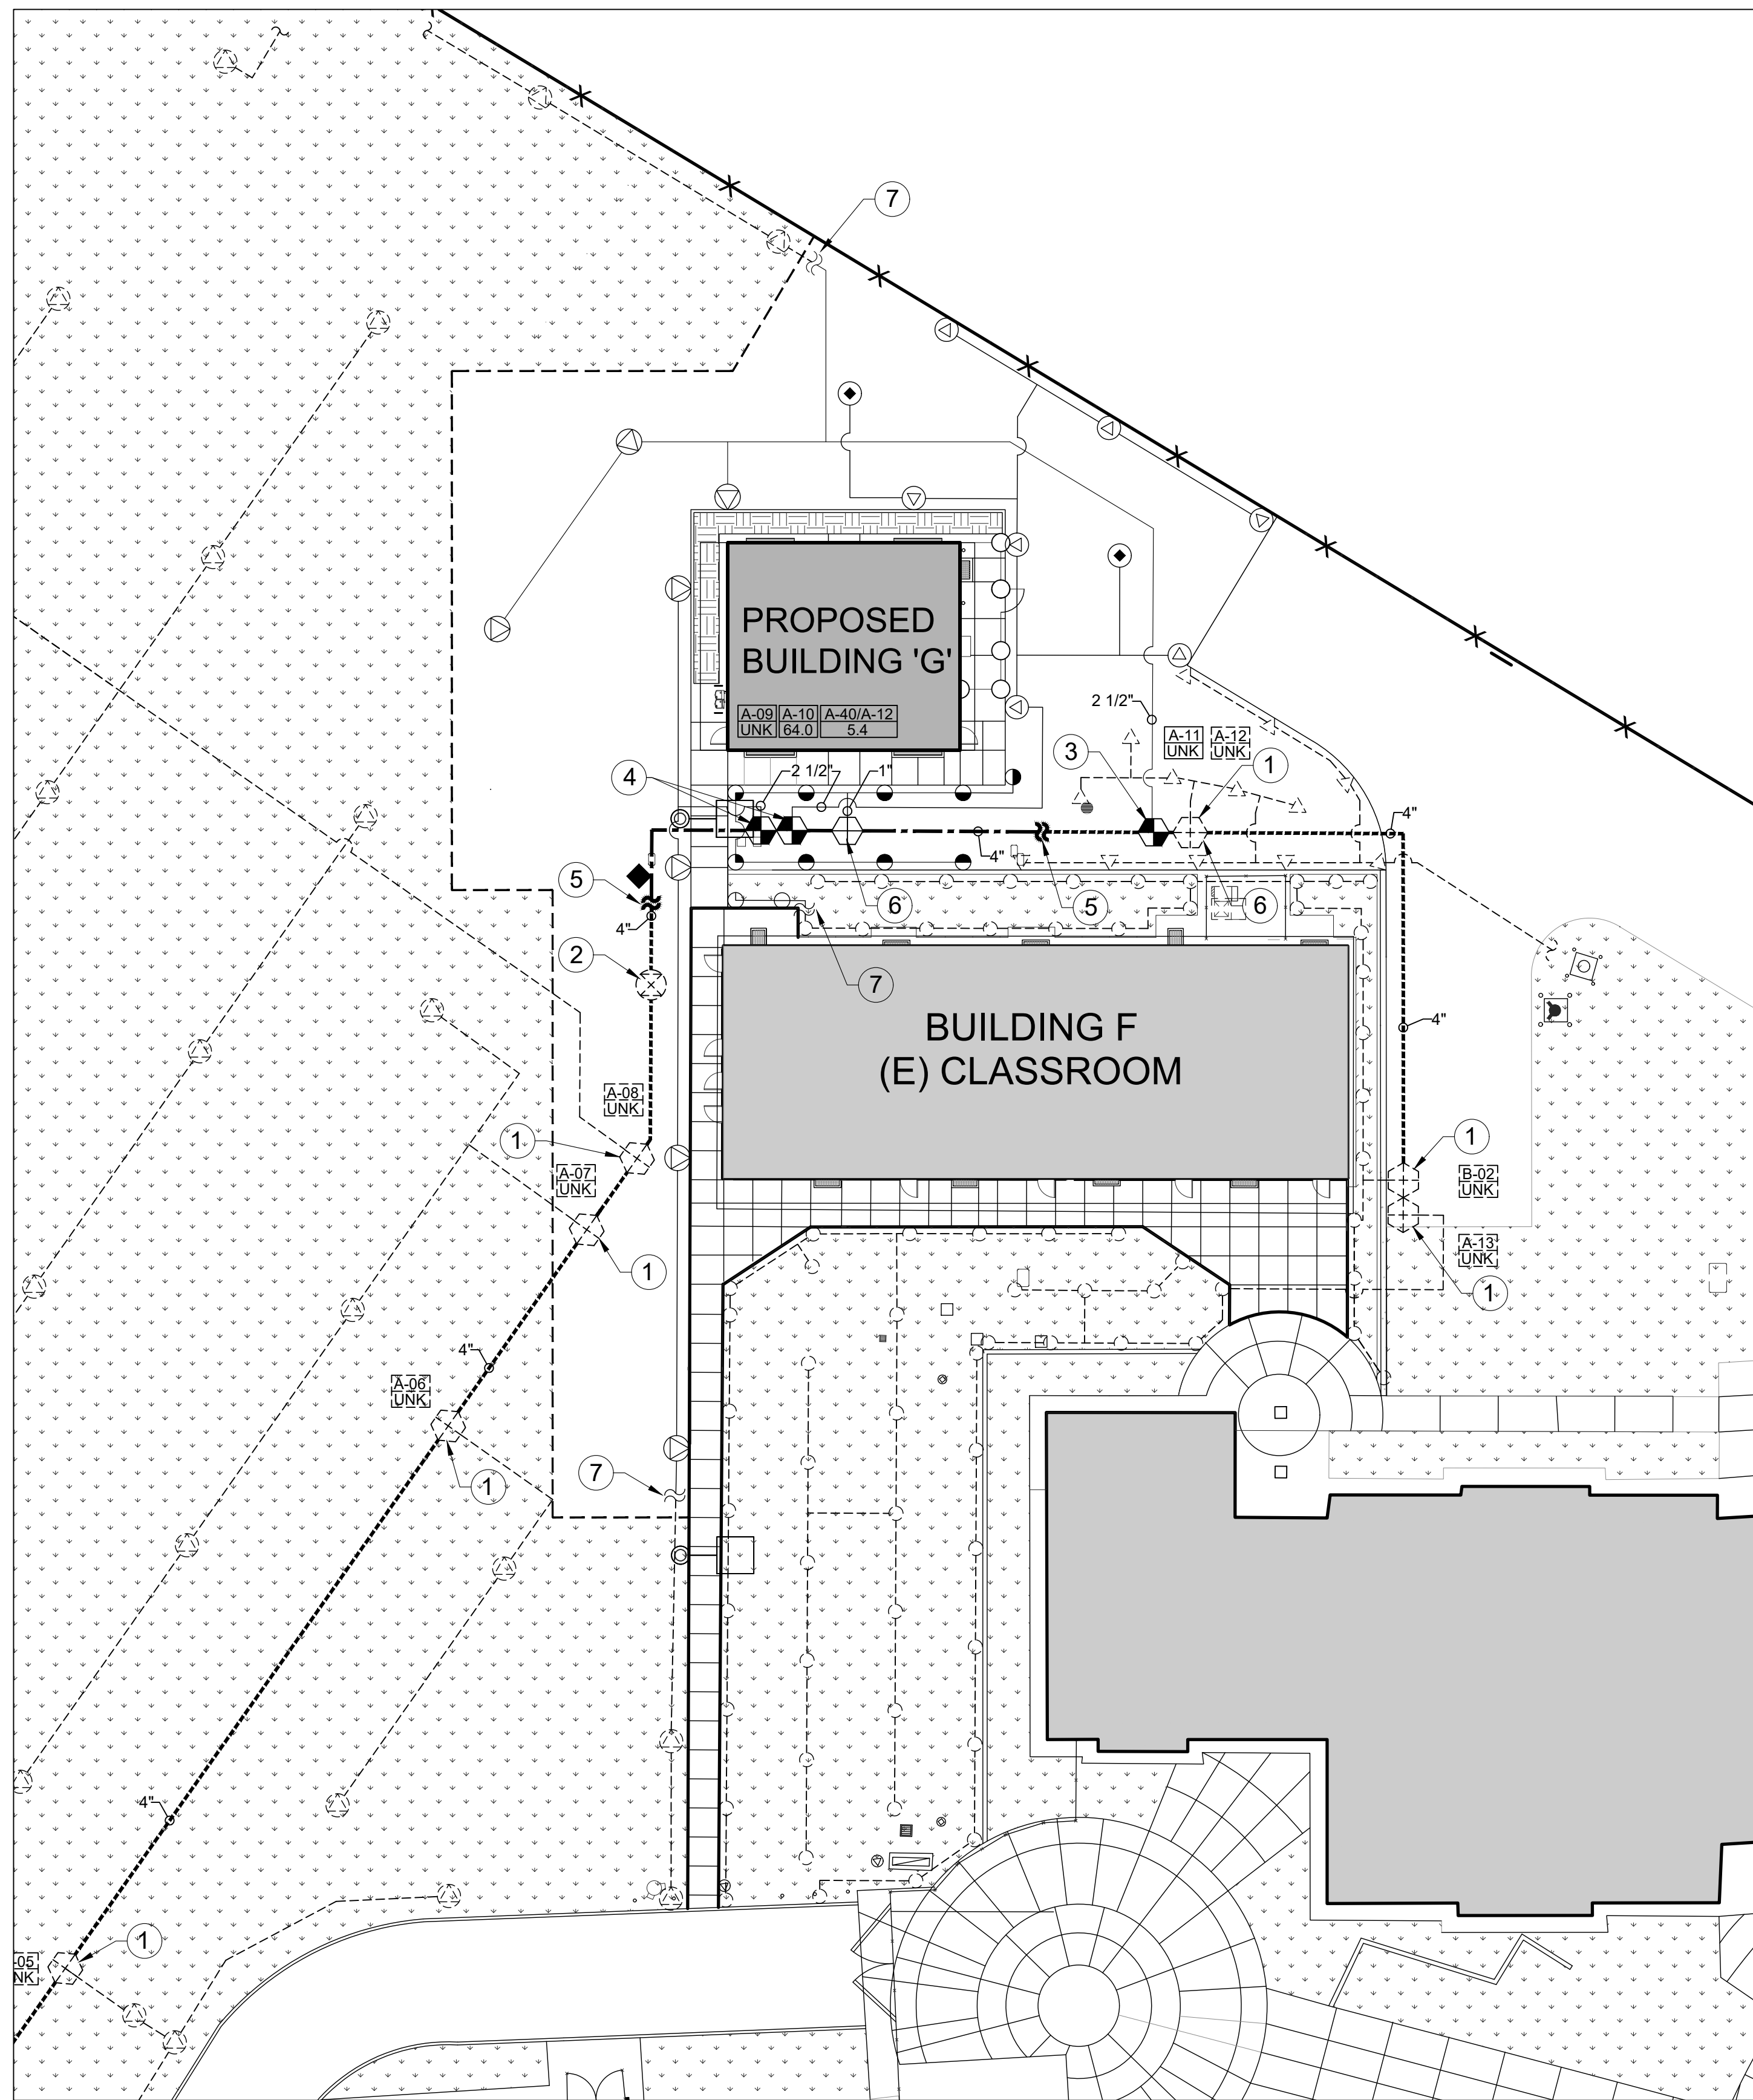

IRRIGATION KEYNOTES

- ① EXISTING REMOTE CONTROL VALVE TO REMAIN & PROTECT. CONTRACTOR TO FIELD VERIFY.
- ② EXISTING GATE VALVE TO REMAIN & PROTECT. CONTRACTOR TO FIELD VERIFY.
- ③ EXISTING REMOTE CONTROL VALVE TO BE REMOVED AND REPLACED. INSTALL NEW REMOTE CONTROL VALVE ON THE EXISTING IRRIGATION MAINLINE PIPE AND CONNECT TO THE NEW SPRINKLERS. CONTRACTOR IS TO RECONNECT EXISTING LOW VOLTAGE CONTROL WIRING TO THE NEW REMOTE CONTROL VALVE. REMOTE CONTROL VALVE IS TO MAINTAIN SAME STATION NUMBER ON DESIGNATED CONTROLLER. SEE IRRIGATION DEMOLITION PLAN ON PLAN SHEET L101 FOR ADDITIONAL INFORMATION. DELIVER USABLE PARTS AND VALVE BOX TO DISTRICT. DISPOSE OF ALL REMOVED MATERIALS NOT WANTED BY DISTRICT OFF SITE AT NO ADDITIONAL COST TO DISTRICT. CONTRACTOR TO FIELD VERIFY.
- ④ EXISTING REMOTE CONTROL VALVE TO BE REMOVED AND REPLACED. INSTALL NEW REMOTE CONTROL VALVE ON THE NEW IRRIGATION MAINLINE PIPE AND CONNECT TO NEW SPRINKLERS. CONTRACTOR IS TO RECONNECT EXISTING LOW VOLTAGE CONTROL WIRING TO THE NEW REMOTE CONTROL VALVE. REMOTE CONTROL VALVE IS TO MAINTAIN SAME STATION NUMBER ON DESIGNATED CONTROLLER. SEE IRRIGATION DEMOLITION PLAN ON PLAN SHEET L101 FOR ADDITIONAL INFORMATION. DELIVER USABLE PARTS AND VALVE BOX TO DISTRICT. DISPOSE OF ALL REMOVED MATERIALS NOT WANTED BY DISTRICT OFF SITE AT NO ADDITIONAL COST TO DISTRICT. THE EXISTING VALVES A-09 AND A-10 ARE JUMPED TOGETHER ON THE SAME STATION. IF THE EXISTING LOW VOLTAGE CONTROL WIRING CANNOT BE LOCATED OR IF THERE ARE NO OPEN STATIONS ON THE EXISTING IRRIGATION CONTROLLERS, CONTRACTOR IS TO CONNECT BOTH VALVES A-09 AND A-10 ON THE SAME STATION (EXISTING CONTROL WIRE) THAT IS CURRENTLY IN SERVICE. CONTRACTOR TO FIELD VERIFY.
- ⑤ IRRIGATION POINT OF CONNECTION: CONTRACTOR IS TO CONNECT NEW IRRIGATION MAINLINE PIPE TO EXISTING IRRIGATION MAINLINE PIPE TO REMAIN IN SERVICE AT THE LOCATIONS INDICATED. EXISTING MAINLINE PIPE ROUTING IS DIAGRAMMATIC, AND CONTRACTOR IS TO FIELD LOCATE TO DETERMINE POINTS OF CONNECTION IN THE FIELD. SEE IRRIGATION DEMOLITION PLAN L101 FOR ADDITIONAL INFORMATION. CONTRACTOR IS TO TRACE AND IDENTIFY EXISTING LOW VOLTAGE CONTROL WIRING THAT TRAVERSES THROUGH THE PROJECT AND IS TO INTERCEPT, SPLICE AND EXTEND IT ADJACENT TO THE NEW IRRIGATION MAINLINE PIPE. CONTRACTOR IS TO SPLICE AND EXTEND EXISTING LOW VOLTAGE CONTROL WIRING TO DESIGNATED REPLACEMENT IRRIGATION CONTROLLER. CONTRACTOR IS TO TRACE ALL EXISTING LOW VOLTAGE CONTROL WIRING IN THE FIELD, FOR ALL EXISTING VALVES TO REMAIN AND PROTECT, TO DETERMINE THE BEST LOCATION TO INTERCEPT EXISTING CONTROL WIRES AS NOTED ABOVE. ALL EXISTING VALVES TO REMAIN AND PROTECT ARE NOT SHOWN ON THE PLAN AND CONTRACTOR IS RESPONSIBLE FOR CONNECTION OF ALL EXISTING VALVES TO REMAIN AND PROTECT TO EXISTING IRRIGATION CONTROLLER TO REMAIN AND PROTECT. CONTRACTOR TO FIELD VERIFY.
- ⑥ NEW REMOTE CONTROL VALVE TO BE ADDED TO THE NEW IRRIGATION MAINLINE. INSTALL NEW REMOTE CONTROL VALVE ON THE NEW IRRIGATION MAINLINE PIPE AND CONNECT TO NEW SPRINKLERS. CONTRACTOR IS TO INTERCEPT THE EXTRA LOW VOLTAGE CONTROL WIRES AND CONNECT TO EXTRA STATION IN EXISTING CONTROLLER 'A' OR 'B'. IF EXTRA CONTROL WIRES CANNOT BE LOCATED OR IF THERE ARE NO OPEN STATIONS IN THE EXISTING CONTROLLERS, THEN CONTRACTOR IS TO INTERCEPT AND EXTEND THE EXISTING LOW VOLTAGE CONTROL WIRING FROM EXISTING VALVE A-12 AND INSTALL NEW CONTROL WIRING (HOT AND COMMON) TO THE NEW REMOTE CONTROL VALVE, SO BOTH VALVES ARE ON STATION A-12. CONTRACTOR TO INSTALL NEW CONTROL WIRING BETWEEN EXISTING VALVE A-12 AND NEW ADDED VALVE IN 1" ELECTRICAL CONDUIT WITH SWEEP ELLS ENTERING AND EXITING ALL VALVE BOXES. CONTRACTOR TO FIELD VERIFY.
- ⑦ CONTRACTOR IS TO FIELD LOCATE THE EXISTING LATERAL PIPE AND CONNECT NEW LATERAL PIPE AS SHOWN ON THE PLAN. CONTRACTOR IS TO MATCH EXISTING PIPE SIZE. CONTRACTOR TO FIELD VERIFY.

Water Usage Chart - MAWA vs. ETWU	
$\text{MAWA} = (\text{Et}_o) \times (0.62) \times [(0.45 \times \text{LA}) + (1.0 - 0.45) \times \text{SLA}]$ $= (53.3) \times (0.62) \times [(0.45 \times 10,833) + (1.0 - 0.45) \times (10,833)]$ $= 357,987 \text{ gallons per year}$	
Hydrozone #1 - SLA $\text{MAWA} = (\text{Et}_o) \times (0.62) \times (\text{SLA})$ $= (53.3) \times (0.62) \times (10,833)$ $= 357,987 \text{ gallons per year}$	
TOTAL ETWU (Sum of Hydrozone 1) = 357,987 gallons per year	
MAWA > ETWU 357,987 gallons > 357,987 gallons 	

Hydrozone (HZ)	Plant Water Use Req.	Plant Factor (PF)	Hydrozone Area (sq ft) (HA)	Zone or Valve Numbers	Irrigation Method	Percent of Landscape Area	Irrigation Efficiency (IE)
1	SLA	N/A	10,833	A-09 thru A-12	Sprays	100%	N/A
		Sum	10,833				

SEE IRRIGATION LEGEND AND NOTES ON PLAN SHEET L202


$$1'' = 20' - 0''$$



David Bigler Associates
Landscape Architect #3887
1589 W Shaw Avenue #5
Fresno, California 93711
E Mail: davebigler@aol.com
Tel: (559) 276-9495
Fax: (559) 276-9497

LANDSCAPE IRRIGATION PLAN

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ DLS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.


B	07/31/2024	DSA SUBMITTAL	
MARK	DATE	DESCRIPTION	
C	11/01/2024	DSA BACKCHECK SUBMITTAL	



TETER, INC.

FRESNO HEADQUARTERS

ARCHITECTS ENGINEERS CONNECTED

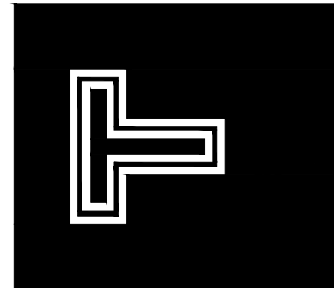

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR

STOCKTON, CA
DRAWING TITLE

LANDSCAPE IRRIGATION PLAN

PROJECT NO.

23-12899

DRAWING

L201

LANDSCAPE & IRRIGATION NOTES

1. PRODUCT "OR APPROVED EQUAL" SPECIFICATION NOTE: ALL SPECIFIED MATERIALS, PRODUCTS AND MANUFACTURERS ARE RELEVANT TO DESCRIBE THE REQUIRED QUALITY AND FEATURES OF A PARTICULAR COMPONENT OF THE PROJECT, HOWEVER, THE SPECIFIC PRODUCT OR MANUFACTURER NOTED IS TO BE CONSTRUED TO BE FOLLOWED BY THE WORDS, "OR APPROVED EQUAL".

2. GENERAL NOTE: THE CONTRACTOR IS TO SUPPLY ALL EQUIPMENT, MATERIALS AND LABOR TO PROVIDE A COMPLETE AND OPERATIONAL SYSTEM. ADDITIONAL EQUIPMENT AND MATERIALS IN ADDITION TO THE SYSTEM COMPONENTS LISTED IN THE LEGEND MAY BE REQUIRED TO PROVIDE A COMPLETE AND OPERATIONAL SYSTEM.

3. SPRINKLER ADJUSTMENT NOTE: CONTRACTOR SHALL MAKE ANY ADJUSTMENTS OR CHANGES TO SPRINKLERS, NOZZLES, RADIUS AND ARCS AS REQUIRED TO PROVIDE 100% COVERAGE TO ALL LANDSCAPE AREAS AND PREVENT OVER SPRAY ONTO BUILDINGS OR HARDSCAPED SURFACES.

4. EXISTING IRRIGATION SYSTEM AND WATERING NOTE: THE CONTRACTOR IS RESPONSIBLE TO KEEP THE EXISTING IRRIGATION SYSTEM TO REMAIN OPERATIONAL TO IRRIGATE ALL LANDSCAPED AREAS. WHERE AUTOMATIC OPERATION OF EXISTING IRRIGATION SYSTEMS IS INTERRUPTED DUE TO CONSTRUCTION ACTIVITIES, THE CONTRACTOR IS RESPONSIBLE TO SUPPLY TEMPORARY IRRIGATION TO NEW AND/OR EXISTING AREAS THAT ARE AFFECTED BY THE SERVICE INTERRUPTION AS REQUIRED DUE TO PREVAILING WEATHER CONDITIONS. THE CONTRACTOR SHALL MAKE REPAIRS TO THE EXISTING SYSTEM AS NEEDED. THE CONTRACTOR IS TO ASSIST CAMPUS MAINTENANCE PERSONNEL AS NEEDED TO KEEP THE EXISTING LANDSCAPED AREAS IRRIGATED. AREAS AFFECTED BY NEW CONSTRUCTION ARE TO BE IRRIGATED BY THE CONTRACTOR. CONTRACTOR IS TO REPLACE ANY DEAD OR STRESSED PLANT MATERIALS (TO MATCH EXISTING) THAT WERE TO REMAIN THAT WERE DAMAGED OR NEGLECTED DUE TO CONSTRUCTION ACTIVITIES.

5. EXISTING IRRIGATION SYSTEM TO BE REPLACED BY NEW IRRIGATION SYSTEM NOTE: THE CONTRACTOR IS TO REMOVE EXISTING SPRINKLERS, VALVES AND OTHER IRRIGATION IMPROVEMENTS VISIBLE AT THE SURFACE IN AREAS TO RECEIVE NEW IRRIGATION AND DELIVER SALVAGED PARTS, INCLUDING, BUT NOT LIMITED TO SPRINKLERS, VALVES, VALVE BOXES ETC., TO THE CAMPUS MAINTENANCE DEPARTMENT. PIPING IS TO BE REMOVED WHERE IT INTERFERES WITH CONSTRUCTION ACTIVITIES, OTHERWISE PIPING MAY BE ABANDONED BELOW GRADE. WHERE PIPING IS BROUGHT TO THE SURFACE, THE CONTRACTOR SHALL CUT IT OFF A MINIMUM OF 12" BELOW GRADE. DEPRESSIONS AND HOLES THAT ARE CREATED FROM REMOVING EXISTING IRRIGATION IMPROVEMENTS BEING REPLACED ARE TO BE FILLED WITH CLEAN TOPSOIL LEVEL WITH SURROUNDING GRADE AND COMPACTED. IRRIGATION SYSTEM AND BUILDING WATER ARE TO REMAIN INTACT AND OPERATIONAL.

6. CAMPUS IRRIGATION WATER AVAILABILITY NOTE: THE CONTRACTOR IS TO INSTALL ALL REROUTED MAINLINE PIPES WHILE LEAVING THE EXISTING IRRIGATION SYSTEM IN SERVICE DURING THE PROJECT. WHEN ALL PIPING AND WIRE REROUTING WORK IS COMPLETE THE CONTRACTOR MAY ARRANGE TO SHUT OFF THE WATER TO MAKE FINAL CONNECTIONS FOR A PERIOD OF TIME NOT TO EXCEED TWO DAYS. THE CAMPUS MAINTENANCE SUPERVISOR IS TO BE GIVEN A MINIMUM OF ONE WEEK WRITTEN NOTICE TO OVERWATER THE CAMPUS AREAS IN QUESTION PRIOR TO SHUTTING OFF THE WATER TO MAKE FINAL CONNECTIONS. IF PREVAILING WEATHER CONDITIONS ARE OVER 95 DEGREES DAYTIME HIGH TEMPERATURES, THEN THE SHUT DOWN DURATION MAY BE LIMITED TO NO MORE THAN ONE DAY AS DECIDED BY CAMPUS MAINTENANCE SUPERVISOR.

7. EXISTING TURF, PLANT & TREE TO REMAIN & PROTECT NOTE: THE CONTRACTOR IS RESPONSIBLE TO REPLACE ANY EXISTING TURF, PLANT MATERIALS OR TREES THAT ARE DAMAGED DUE TO CONSTRUCTION ACTIVITIES, VEHICLE DAMAGE, AND STRESS DUE TO LACK OF WATER OR OTHER DETERIORATION OF THE EXISTING AREAS TO REMAIN ARE TO BE RESTORED BY THE CONTRACTOR TO THE EXISTING CONDITION PRIOR TO THE PROJECT AT NO ADDITIONAL COST TO THE DISTRICT. THIS INCLUDES DAMAGE THAT MAY OCCUR AT ANY AREA OF THE CAMPUS

8. CONTRACTOR IS RESPONSIBLE FOR REMOVAL AND DISPOSAL OF ANY VEGETATION WITHIN THE PROJECT AREA THAT IS NOT CALLED TO REMAIN AND PROTECT. ANY ADJACENT LANDSCAPE AREAS OUTSIDE THE PROJECT AREA THAT ARE TO REMAIN AND PROTECT THAT ARE DAMAGED ARE TO BE REPAIRED AND RESTORED AT NO ADDITIONAL COST TO THE DISTRICT. CONTRACTOR IS TO VISIT THE SITE PRIOR TO BID TO VERIFY EXISTING CONDITIONS AND IMPROVEMENTS.

9. EXISTING IRRIGATION REMOTE CONTROL VALVES TO BE REMOVED NOTE: PRIOR TO ANY DEMOLITION WORK, CONTRACTOR IS TO FIELD VERIFY THAT ANY IRRIGATION SYSTEMS CONNECTED TO REMOTE CONTROL VALVES NOTED TO BE REMOVED HAVE NEW IRRIGATION PLANNED FOR THOSE AREAS. IF ANY IRRIGATION SYSTEM, OR PART THERE OF, IS LOCATED IN AN EXISTING AREA TO REMAIN & PROTECT, THE CONTRACTOR IS TO LEAVE THAT VALVE, OR A PORTION OF IT, IN SERVICE AS REQUIRED. NOTIFY THE LANDSCAPE ARCHITECT FOR DIRECTION. CONTRACTOR TO FIELD VERIFY.

10. ALL AREAS ADJACENT TO THE PROJECT AREA HAVE EXISTING IRRIGATION IMPROVEMENTS TO REMAIN & PROTECT. CONTRACTOR IS TO REPAIR ALL DAMAGE TO EXISTING IMPROVEMENTS THAT ARE INTENDED TO REMAIN & PROTECT TO MATCH EXISTING IMPROVEMENTS. DAMAGE MAY BE A DIRECT, INDIRECT RESULT OF THEIR WORK OR MAY BE CAUSED BY NEGLIGENCE. CONTRACTOR TO FIELD VERIFY.

11. SEE LANDSCAPE IRRIGATION PLAN FOR WORK RELATING TO EXISTING SPRINKLERS AND LATERAL PIPING. CONTRACTOR TO FIELD VERIFY.






12. MANUAL IRRIGATION NOTE: THE CONTRACTOR IS RESPONSIBLE TO MANUALLY IRRIGATE ANY EXISTING IRRIGATION SYSTEM AREAS ON THE SITE WHERE THE EXISTING AUTOMATIC OPERATION OF THE EXISTING SYSTEMS TO REMAIN AND PROTECT ARE INTERRUPTED DUE TO CONSTRUCTION ACTIVITIES. DEPENDING UPON PREVAILING WEATHER CONDITIONS, DAILY WATERING MAY BE REQUIRED AS REQUESTED BY THE CAMPUS MAINTENANCE SUPERVISOR. THIS MAY INCLUDE AN AREA NEAR 10 ACRES IN SIZE WITH DOZENS OF REMOTE CONTROL VALVES. THE CONTRACTOR IS TO CAREFULLY FIELD VERIFY AND COORDINATE WORK TO AVOID DAMAGING THE EXISTING PIPING OR WIRING THAT MAY REQUIRE MANUAL IRRIGATION OF THE SITE BY THE CONTRACTOR FOR EXTENDED PERIODS OF TIME.

13. THE CONTRACTOR IS RESPONSIBLE TO CAREFULLY EXAMINE THE SITE AND PLANS TO FIELD VERIFY ALL EXISTING CONCRETE, PATIOS, SIDEWALKS, PAVING AND OTHER HARDSCAPING TO REMAIN AND PROTECT TO DETERMINE THE SCOPE OF WORK REGARDING THE REQUIRED HORIZONTAL DIRECTIONAL BORING THAT WILL BE NECESSARY TO COMPLETE THE PROJECT. ALL EXISTING CONCRETE, PATIOS, SIDEWALKS, PAVING AND OTHER HARDSCAPED SURFACES MAY NOT BE SHOWN ON THE PLANS. IT IS THE CONTRACTORS RESPONSIBILITY TO FIELD VERIFY ALL LOCATIONS THAT MAY REQUIRE BORING, OR CUTTING AND PATCHING OF EXISTING HARDSCAPED SURFACES PRIOR TO BIDDING. GENERALLY, ALL HARDSCAPED SURFACE CROSSINGS ARE TO BE BY HORIZONTAL DIRECTIONAL BORING. THE CONTRACTOR MUST RECEIVE WRITTEN PERMISSION FROM THE DISTRICT PROJECT MANAGER TO SAW CUT AND PATCH ANY EXISTING HARDSCAPED SURFACES.

14. EXISTING REMOTE CONTROL VALVES AND IRRIGATION IMPROVEMENTS SHOWN ON THE PLAN ARE DIAGRAMMATIC. CONTRACTOR IS RESPONSIBLE TO FIELD LOCATE ALL IMPROVEMENTS AND PERFORM THE WORK OUTLINED AS SHOWN ON THE PLANS. CONTRACTOR IS TO TRACE EXISTING WIRING, POT HOLE AND USE ALL REASONABLE MEANS TO FIELD LOCATE EXISTING IMPROVEMENTS.


LANDSCAPE IRRIGATION LEGEND

SYMBOL	DESCRIPTION
	Rainbird #1806-SAM-PRS, 6" Pop-up Sprinkler with Rainbird U-Series 12" radius nozzles, U-12Q and U-12H for 90 & 180 arcs. Contractor is to adjust arc and radius to prevent overspray onto buildings and other hardscaped surfaces. If nozzle radius adjustment required is greater than 25% of nozzle rating, the Contractor is to substitute nozzle with 8", 10" or specialty pattern nozzle as required at no additional cost to Owner. Contractor is to review nozzle substitutions with Landscape Architect for comment, prior to installation. See Installation Detail #12 on Plan Sheet L302 for additional information.
	Rainbird #1806-SAM-P45, 6" Pop-up Sprinkler with pressure regulation and check valve with Hunter MP Rotator strip series #MP-LCS-515 nozzle. (1/2" inlet: 0.22 gpm @ 40 psi, respectively). Contractor is to adjust arc and radius to prevent overspray onto buildings and other hardscaped surfaces. See Installation Detail #01 on Plan Sheet L300 for additional information.
	Rainbird #1806-SAM-P45, 6" Pop-up Sprinkler with pressure regulation and check valve with Hunter MP Rotator 2000 series #MP-2000-90 / #MP-2000-210 / #MP-2000-360 nozzles. (1/2" inlet: 0.43 / 0.77 / 1.1 / 1.48 gpm @ 40 psi, respectively). Contractor is to adjust arc and radius to prevent overspray onto buildings and other hardscaped surfaces. If nozzle radius adjustment required is greater than 25% of nozzle rating, the Contractor is to substitute nozzle with MP-800 or MP-1000 nozzle as required at no additional cost to Owner. Contractor is to review nozzle substitutions with Landscape Architect for comment, prior to installation. See Installation Detail #01 on Plan Sheet L300 for additional information.
	Rainbird # 5006+ PC/FC SAM R SS-4.0, 6" pop up 5000+ Series Rotor Sprinkler with part & full circle arc and check valve with pressure regulator, stainless steel riser and #4.0 nozzle. (3/4" inlet: 4.0 gpm @ 45 psi). See Installation Detail #02 on Plan Sheet L300 for additional information.
	Rainbird # 5006+ PC/FC SAM R SS-8.0, 6" pop up 5000+ Series Rotor Sprinkler with part & full circle arc and check valve with pressure regulator, stainless steel riser and #8.0 nozzle. (3/4" inlet: 8.0 gpm @ 45 psi). See Installation Detail #02 on Plan Sheet L300 for additional information.
	Rainbird # 6504 PC/FC SS-18.0, 4" pop up 6504 Falcon Series Rotor Sprinkler with part & full circle arc and stainless steel riser with #16.0 nozzle. (1" inlet: 14.3 gpm @ 50 psi). See Installation Detail #04 on Plan Sheet L300 for additional information.
	Rainbird 44LRC, Quick Coupling Valve. Provide District with three (3) quick coupler keys with hose swivels. Install in separate 10" round valve box. See Installation Detail #07 on Plan Sheet L301 for additional information.
	1" Rainbird #100-PESB, PESB Series Electric Remote Control Scrubber Valve w/ pressure regulation. Install one valve per standard rectangular valve box. Mainline schedule 80 nipple entering the valve is to be the same size as the lateral exiting the valve. See Installation Detail #05 on plan sheet L300 for additional information.
	2" Rainbird #200-PESB, PESB Series Electric Remote Control Scrubber Valve w/ pressure regulation. Install one valve per standard rectangular valve box. Mainline schedule 80 nipple entering the valve is to be the same size as the lateral exiting the valve. See Installation Detail #06 on plan sheet L300 for additional information.
	1" thru 2 1/2": PVC Class 200 Solvent Weld lateral pipe. Sleeve all pipe under paved surfaces over six feet wide with PVC Schedule 40 pipe for 2" thru 3" sleeves and with PVC Class 200 pipe for 4" and larger sleeves. Size sleeves a minimum of two times larger than the pipe being sleeved. One pipe per sleeve only. Minimum sleeve size is 2" size. Low voltage control wiring is to be sleeved separately from irrigation pipes. Size lateral pipes as noted on the plan and as outlined in the Lateral Pipe Sizing Chart, Detail #03 on Plan Sheet L300 for additional information. Pipe sizes shall not exceed a velocity of 5.0 feet per second. Install all PVC pipe in strict accordance with the manufacturers recommendations. See Installation Details #08 on Plan Sheet L301 and #14 and #15 on Plan Sheet L302 for additional information.
	2" thru 3" PVC Schedule 40 SW Mainline Pipe. Mainline pipe fittings are to be PVC Schedule 80 solvent weld or threaded fittings or nipples.
	4" thru 8" PVC Class 200 Gasketed Mainline Pipe. Mainline pipe fittings are to be ductile iron Leemco gasketed fittings or Romac #202NS service saddle with double stainless steel straps, except where the irrigation details call for a specific fitting.
	Size Mainline Piping as noted on the plan. Install all pipe in strict accordance with manufacturers instructions. For mainlines 3" and larger install concrete thrust blocks at all changes in direction. No bending, or curving of the pipe will be allowed, except as permitted by the pipe manufacturer. Pipe manufacturer must be approved prior to installation. Use mechanical joint restraints where concrete thrust blocks are not applicable, such as vertical changes in direction, or when two pipelines are side by side. See Installation Details #08 on Plan Sheet L301 and #14 and #15 on Plan Sheet L302 for additional information.

SYMBOL	DESCRIPTION
NOT SHOWN	Existing Conventional Irrigation Controllers 'A' and 'B' to remain and protect. Contractor to field verify. See Landscape Irrigation Plan on Plan Sheets L201 for additional information.
<div style="border: 1px solid black; padding: 2px; display: inline-block;"> A-10 64.0 </div>	Controller # / Station # Gallons per minute (UNK - Valve flow rate is unknown)
	Existing Irrigation Improvements to Remain and Protect. All areas adjacent to the project area have existing Irrigation Improvements to Remain & Protect. Contractor is to repair all damage to existing improvements that are intended to remain & protect to match existing improvements. Damage may be a direct or indirect result of their work or may be caused by neglect. Contractor to field verify.
	Existing Remote Control Valve to Remain & Protect. See Key Notes and Irrigation Demolition Plan. Contractor to field verify.
	Existing Lateral Pipe to Remain & Protect. See Key Notes and Irrigation Demolition Plan. Contractor is to field locate and modify existing lateral pipes as required. In Irrigation Demolition Areas, Contractor is to remove lateral pipe where it interferes with their work or is located below proposed buildings. All other locations, the existing lateral pipe is to be abandoned in place. Cap all openings and open ends of the abandoned pipe. Contractor to field verify.
	Existing Irrigation Mainline Pipe to remain and protect. Contractor is to field verify existing conditions prior to bid to evaluate the extent of work. See Irrigation Demolition Plan for additional information where the existing irrigation mainline will remain and protect. See Key Notes and Landscape Irrigation Plan. Contractor to field verify.
<div style="border: 1px solid black; padding: 2px; display: inline-block;"> B-02 UNK </div>	Existing Irrigation Controller # / Station # Gallons per minute (UNK - GPM is unknown for existing valves)
	Existing Sprinklers to Remain & Protect. See Keynotes and Irrigation Demolition Plans. Contractor to field verify.
<p>Dashed symbols represent existing irrigation improvements to Remain & Protect unless otherwise noted or located in areas to receive new improvements or areas to have new irrigation installed. Existing sprinkler, lateral and mainline locations are diagrammatic. Contractor is to field locate all existing improvements that may effect the work. Contractor to field verify.</p> <p>EXISTING REMOTE CONTROL VALVES AND IRRIGATION IMPROVEMENTS SHOWN ON THE PLAN ARE DIAGRAMMATIC. CONTRACTOR IS RESPONSIBLE TO FIELD LOCATE ALL EXISTING IMPROVEMENTS AND PERFORM THE WORK OUTLINED AS SHOWN ON THE PLANS. CONTRACTOR IS TO TRACE EXISTING LOW VOLTAGE CONTROL WIRING, POT HOLE AND USE ALL REASONABLE MEANS TO FIELD LOCATE EXISTING IMPROVEMENTS. ALL EXISTING IMPROVEMENTS MAY NOT BE SHOWN AND EXISTING IMPROVEMENTS SHOWN ARE DIAGRAMMATIC AS NOTED ABOVE. CONTRACTOR IS TO FIELD VERIFY ALL EXISTING IMPROVEMENTS.</p>	

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024


B	07/31/2024	DSA SUBMITTAL	Tetier, Inc. expressly reserves its common law copyrights and other proprietary rights in these drawings. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without the express written consent of Tetier, Inc.
C	11/01/2024	DSA BACKCHECK SUBMITTAL	



TETER, INC.

FRESNO HEADQUARTERS

ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR

STOCKTON, CA
DRAWING TITLE

IRRIGATION LEGEND AND NOTES

PROJECT NO.

23-12899

DRAWING

L202



David Bigler Associates
Landscape Architect #3887
1589 W Shaw Avenue #5
Fresno, California 93711
E Mail: davebigler@aol.com
Tel: (559) 276-9495
Fax: (559) 276-9497



NOT TO SCALE

5


IRRIGATION LEGEND AND NOTES

\\net-file1\Users\jesus.izazaga_TETRI\Documents\12899-A-STOCKTON PEYTON ELEM ELOP_jezus.izazaga.rvt


PLOT DATE: 7/3/2024 2:47:03 PM

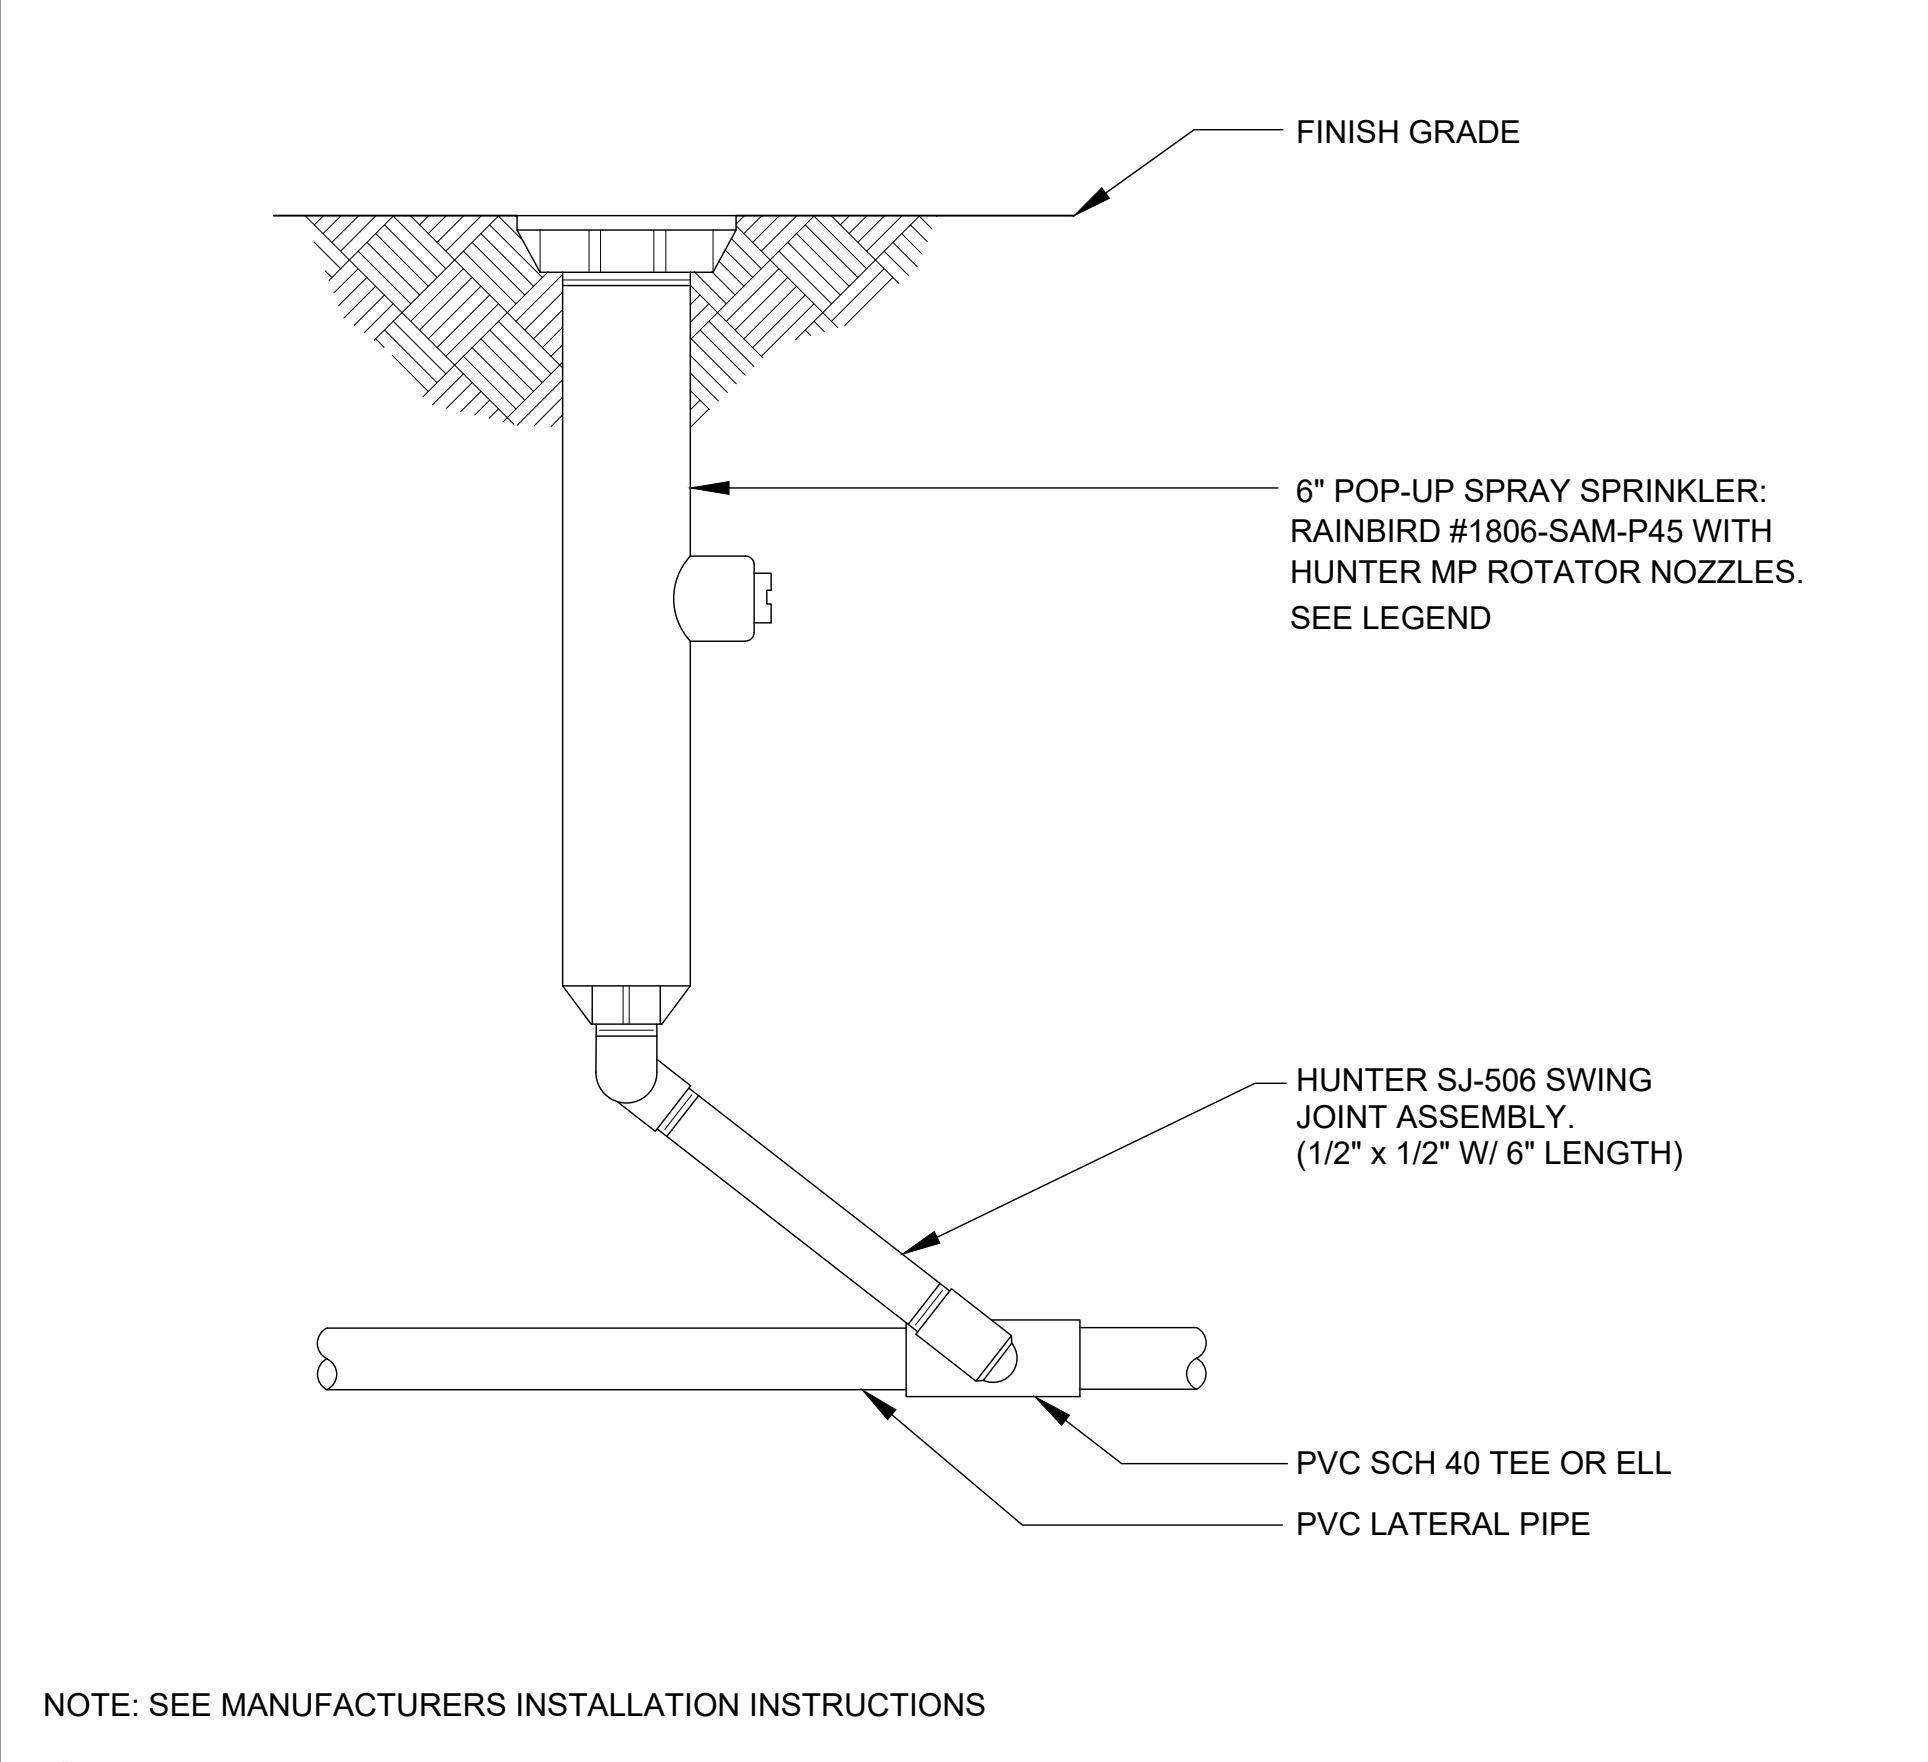


01 6" POP-UP MP ROTATOR SPRINKLER NTS

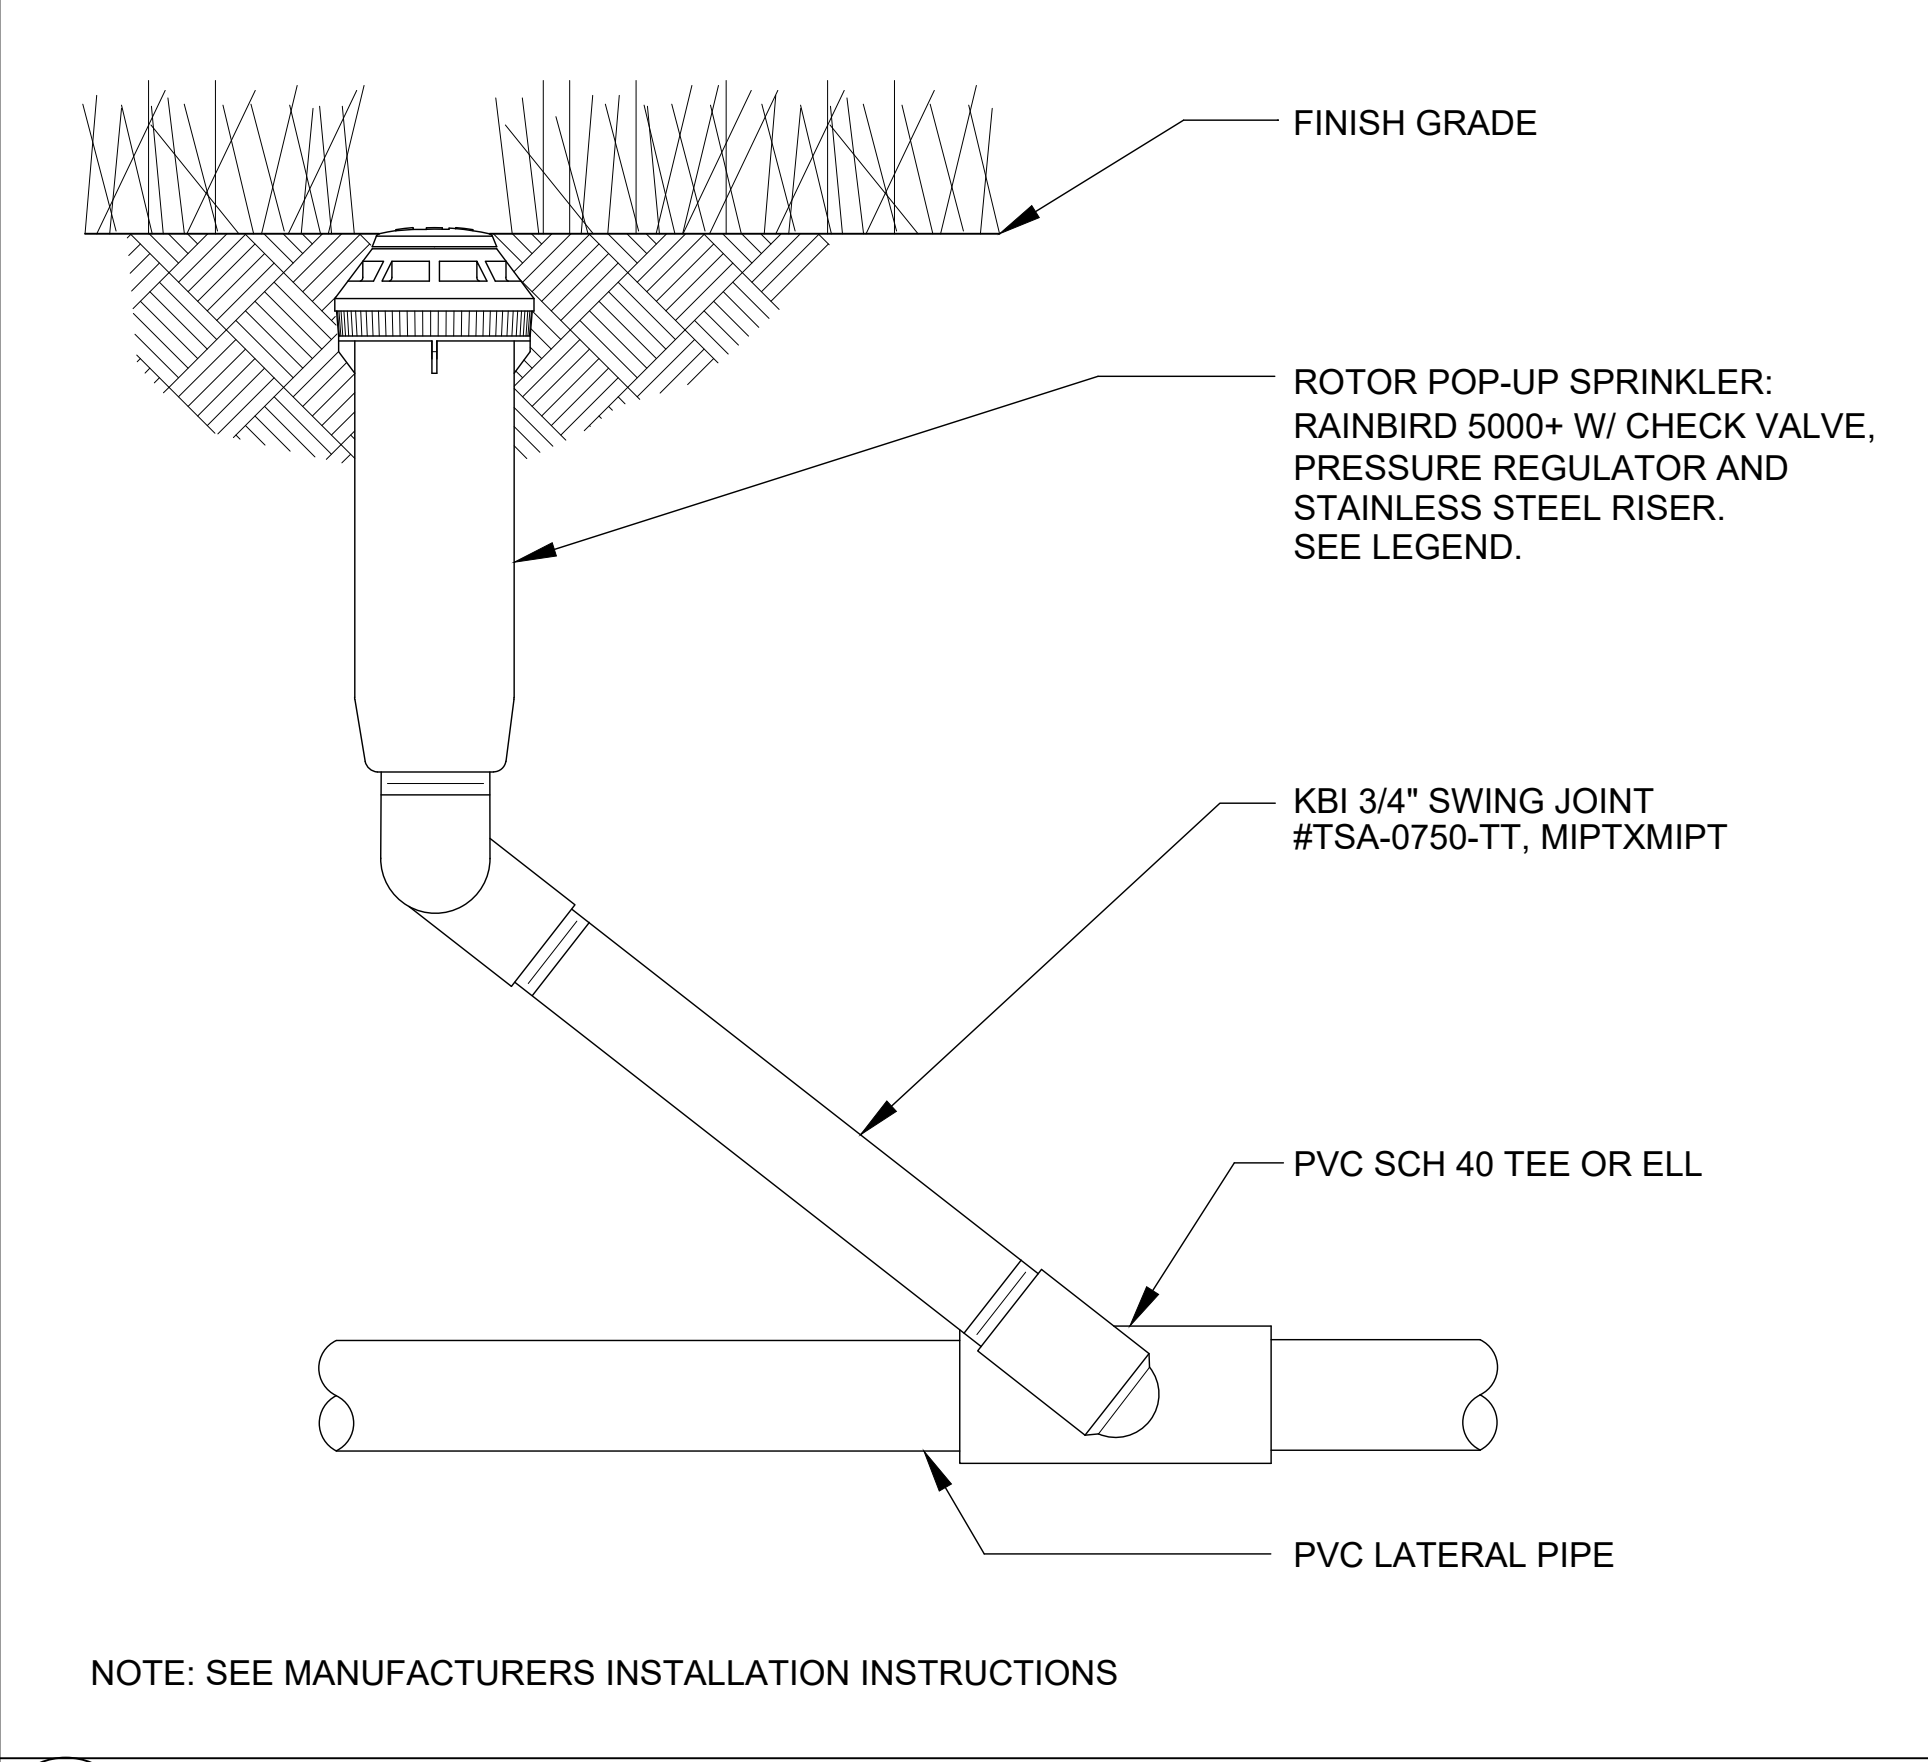


02 ROTOR POP UP SPRINKLER NTS

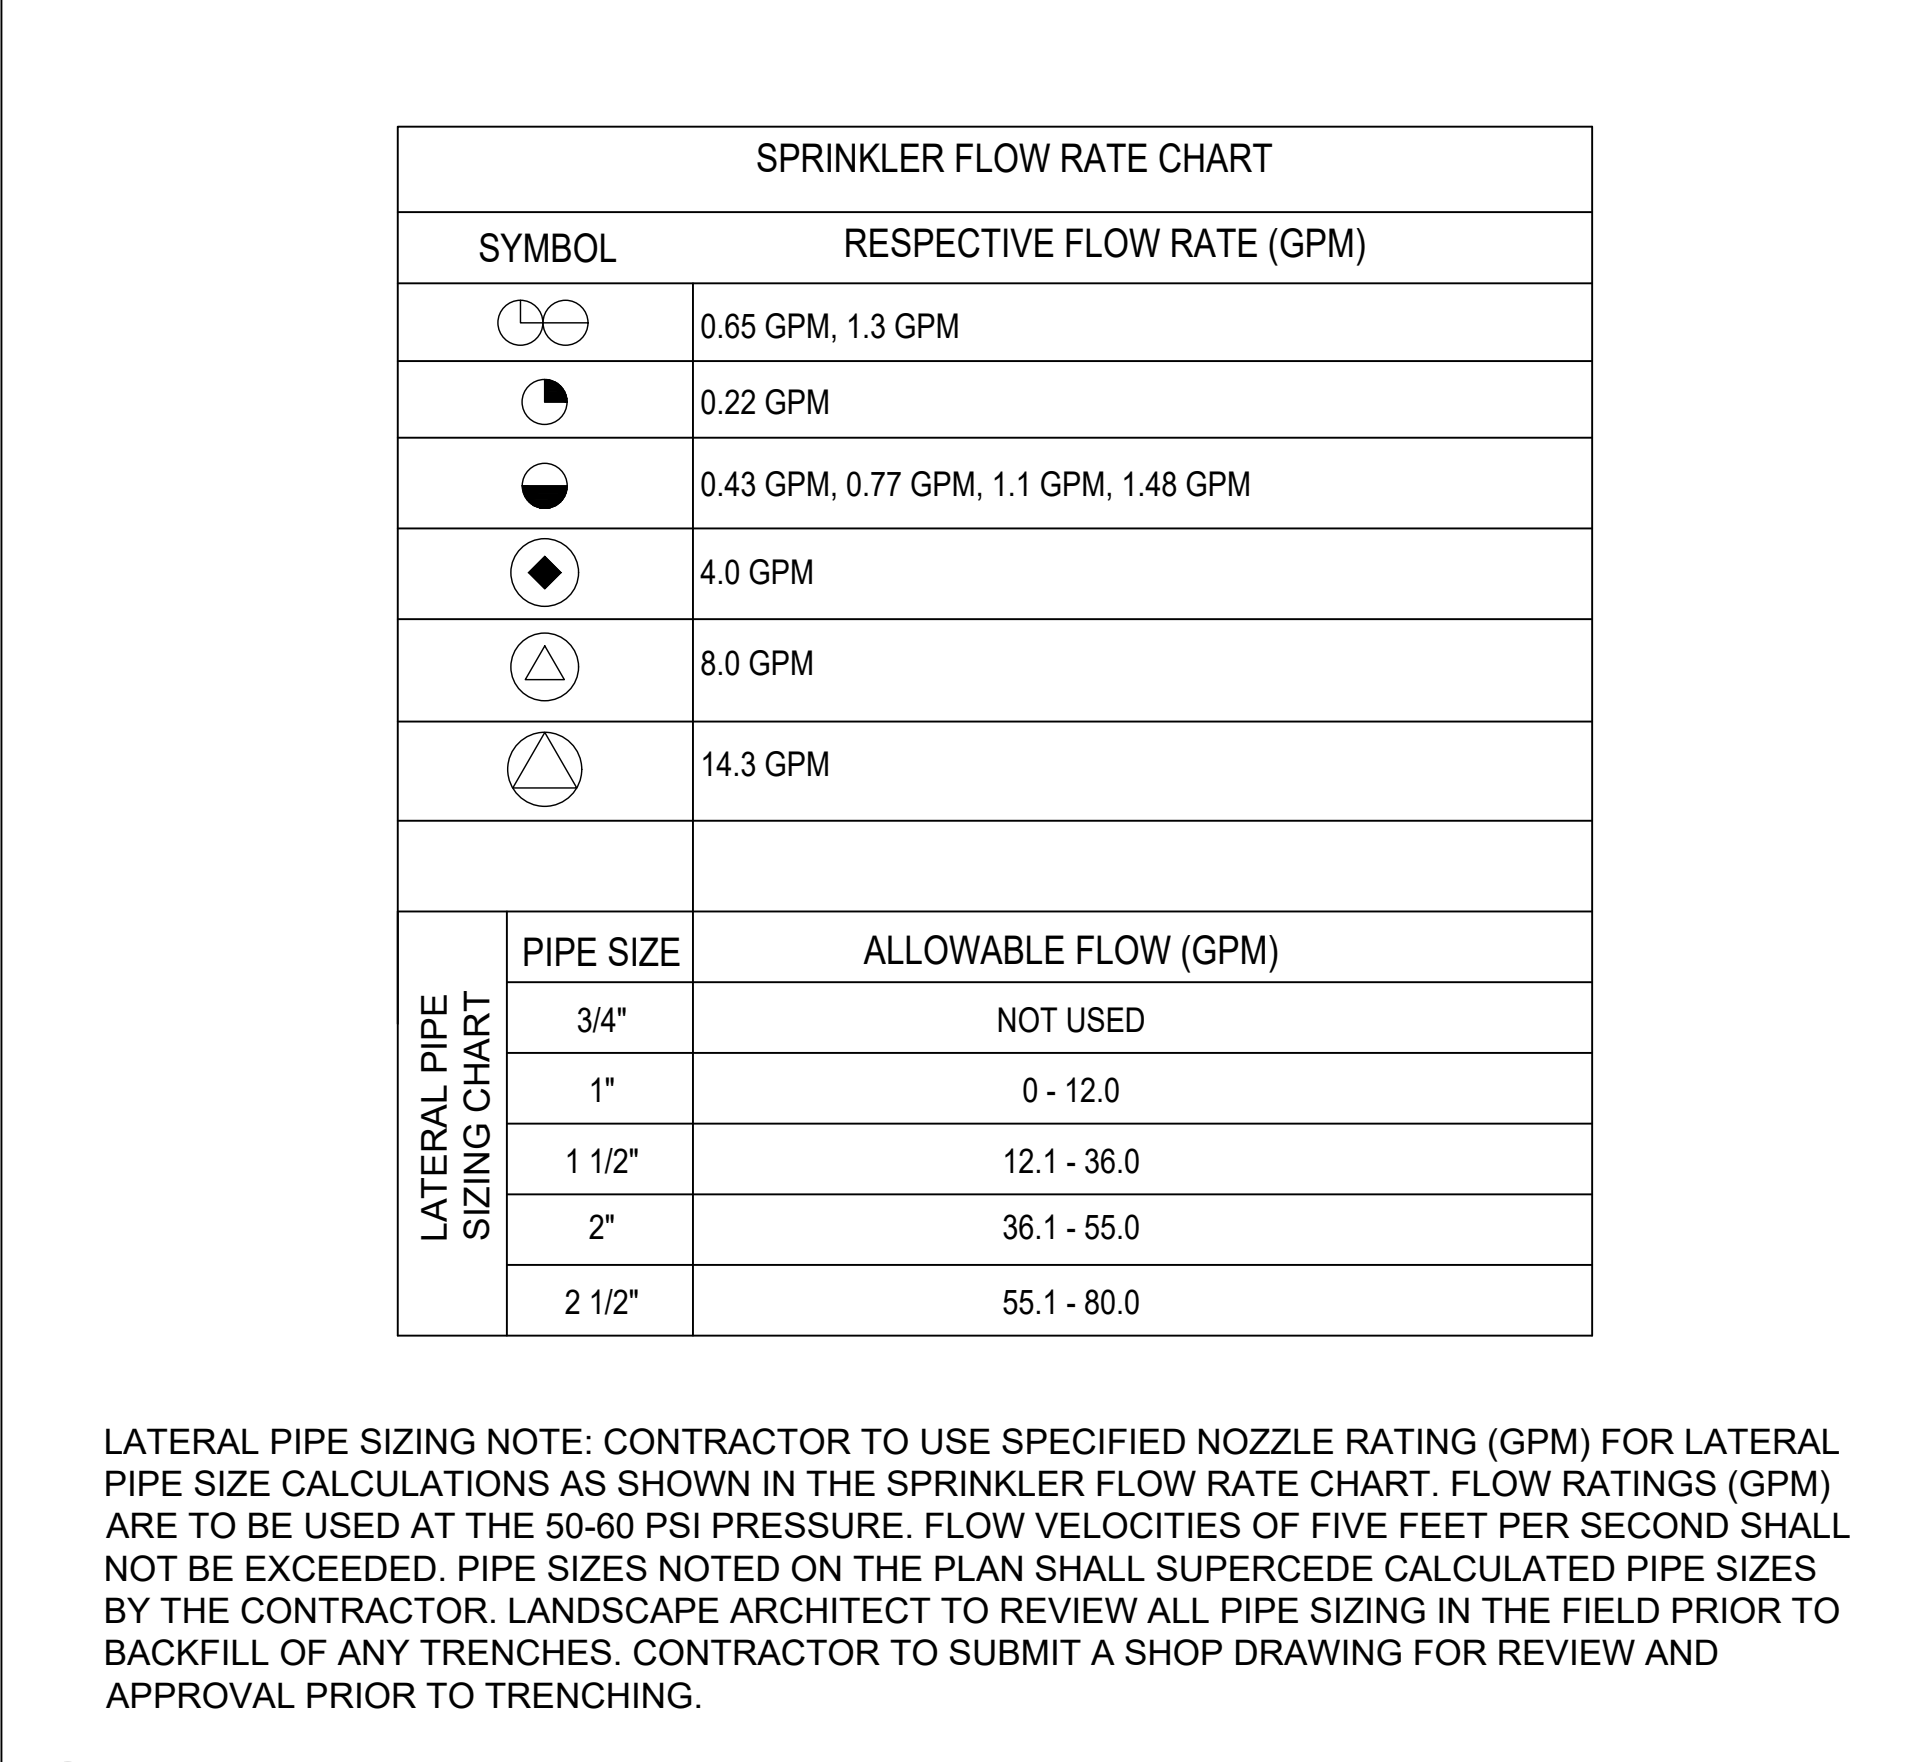


03 LATERAL PIPE SIZING CHART NTS

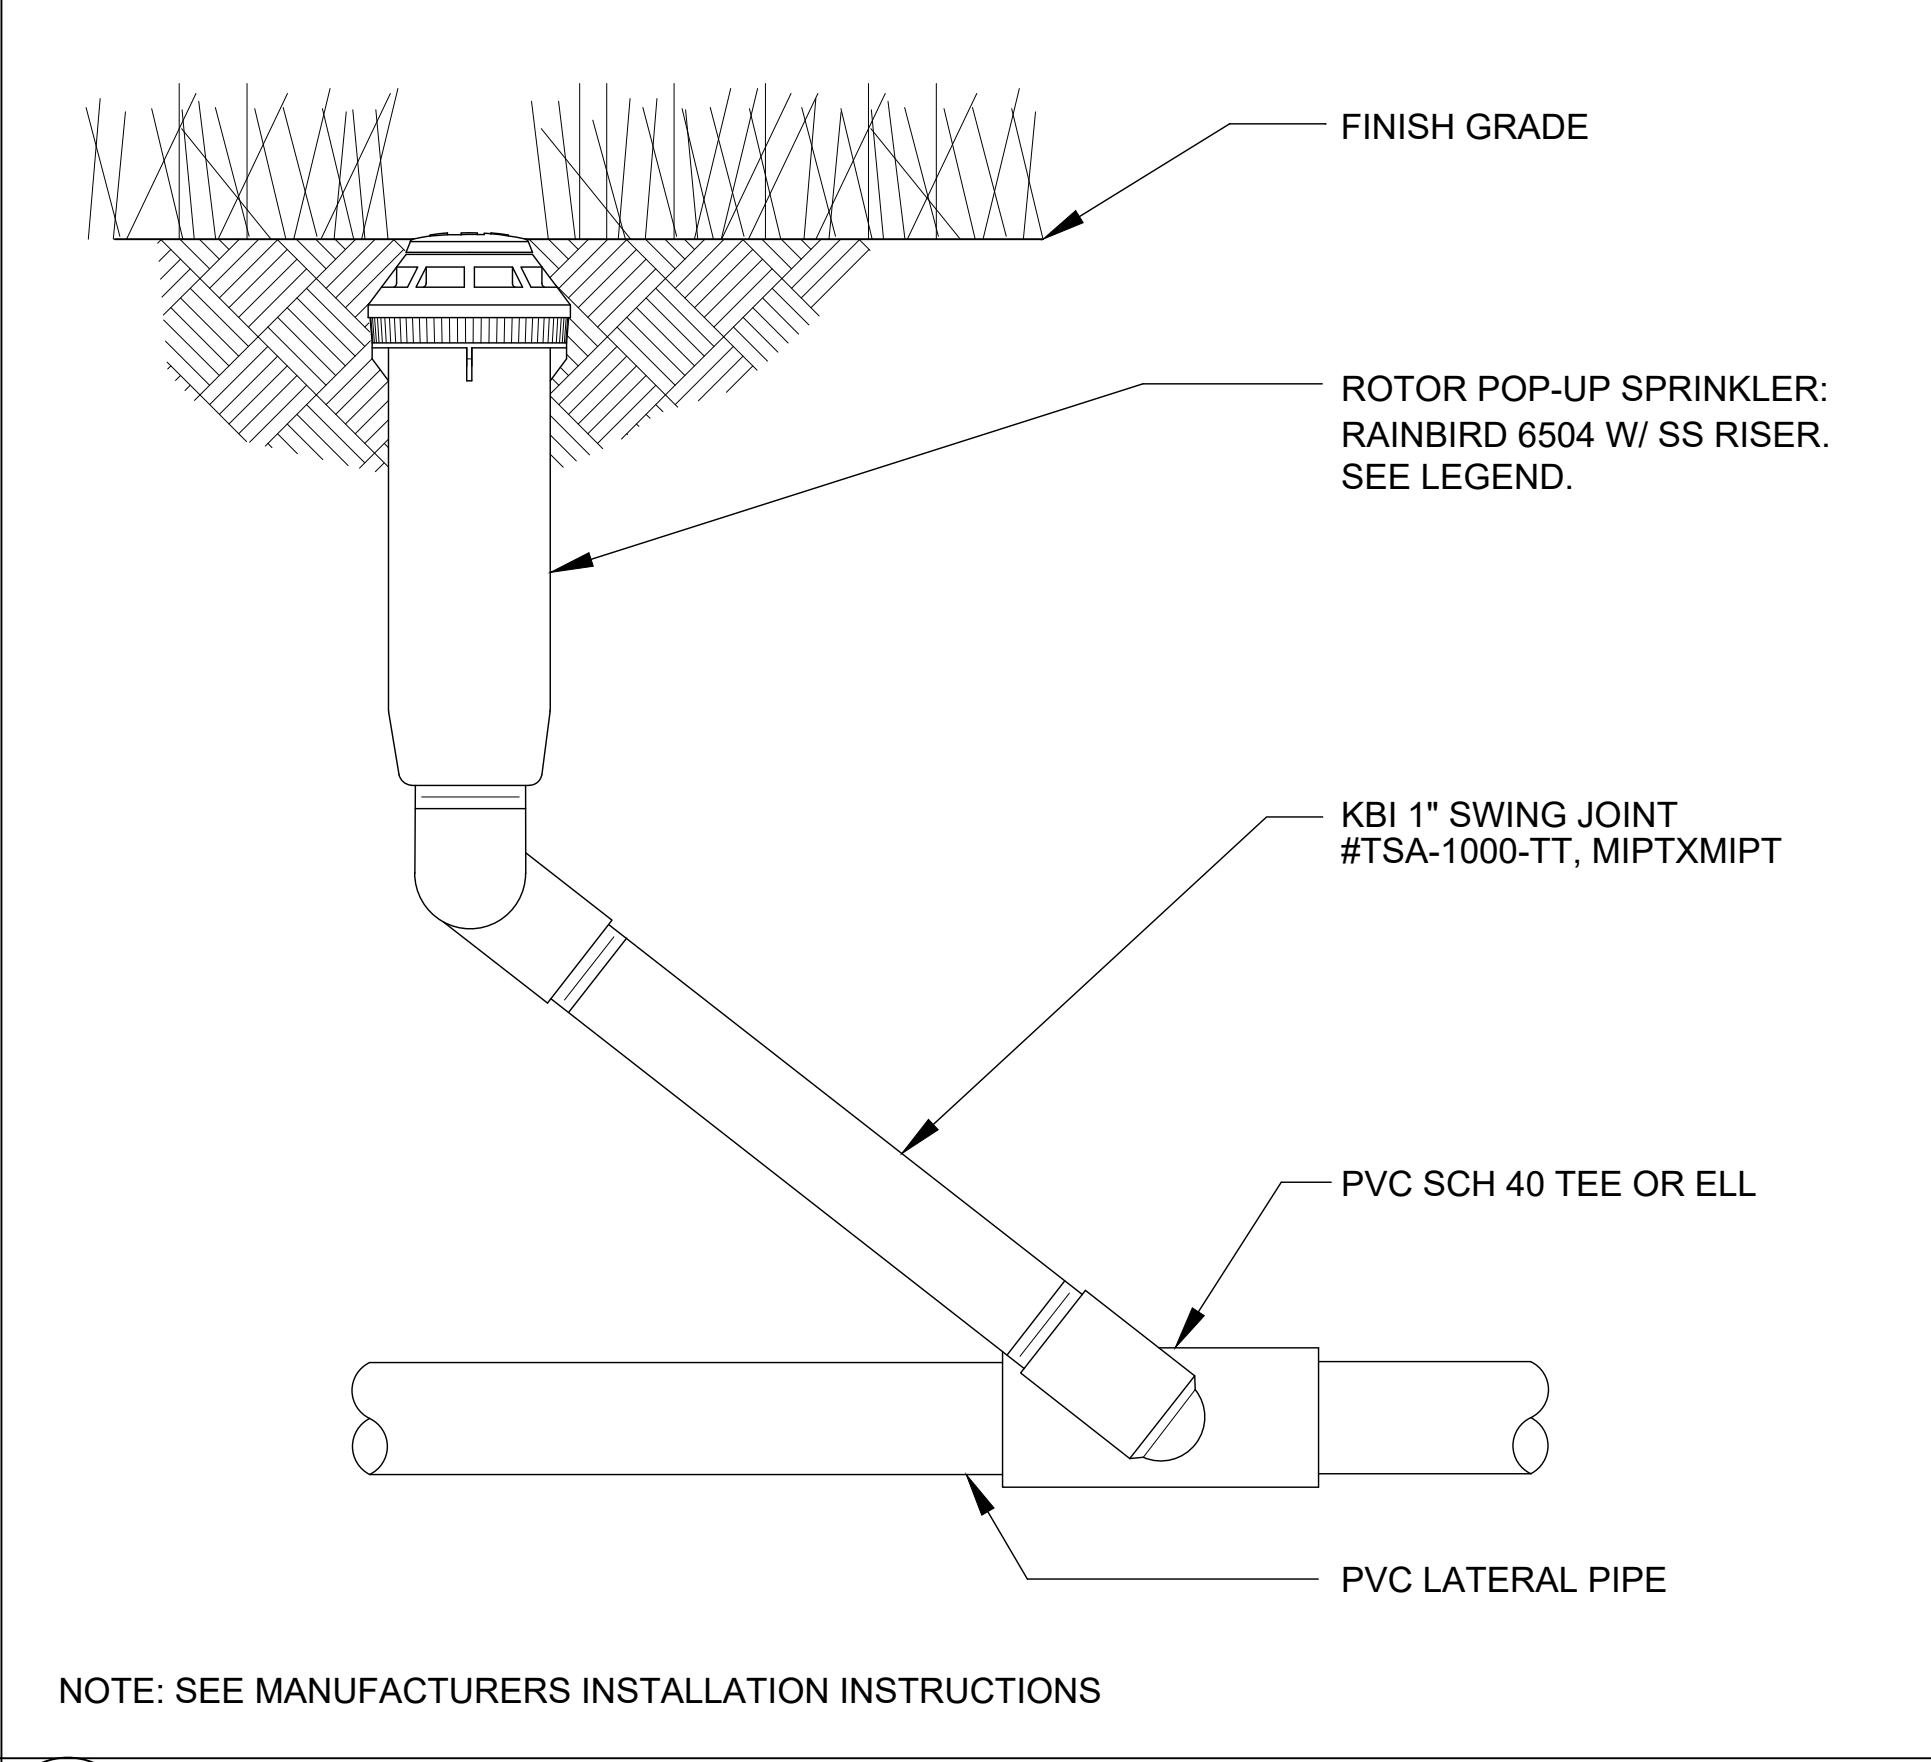

04 ROTOR POP UP SPRINKLER NTS

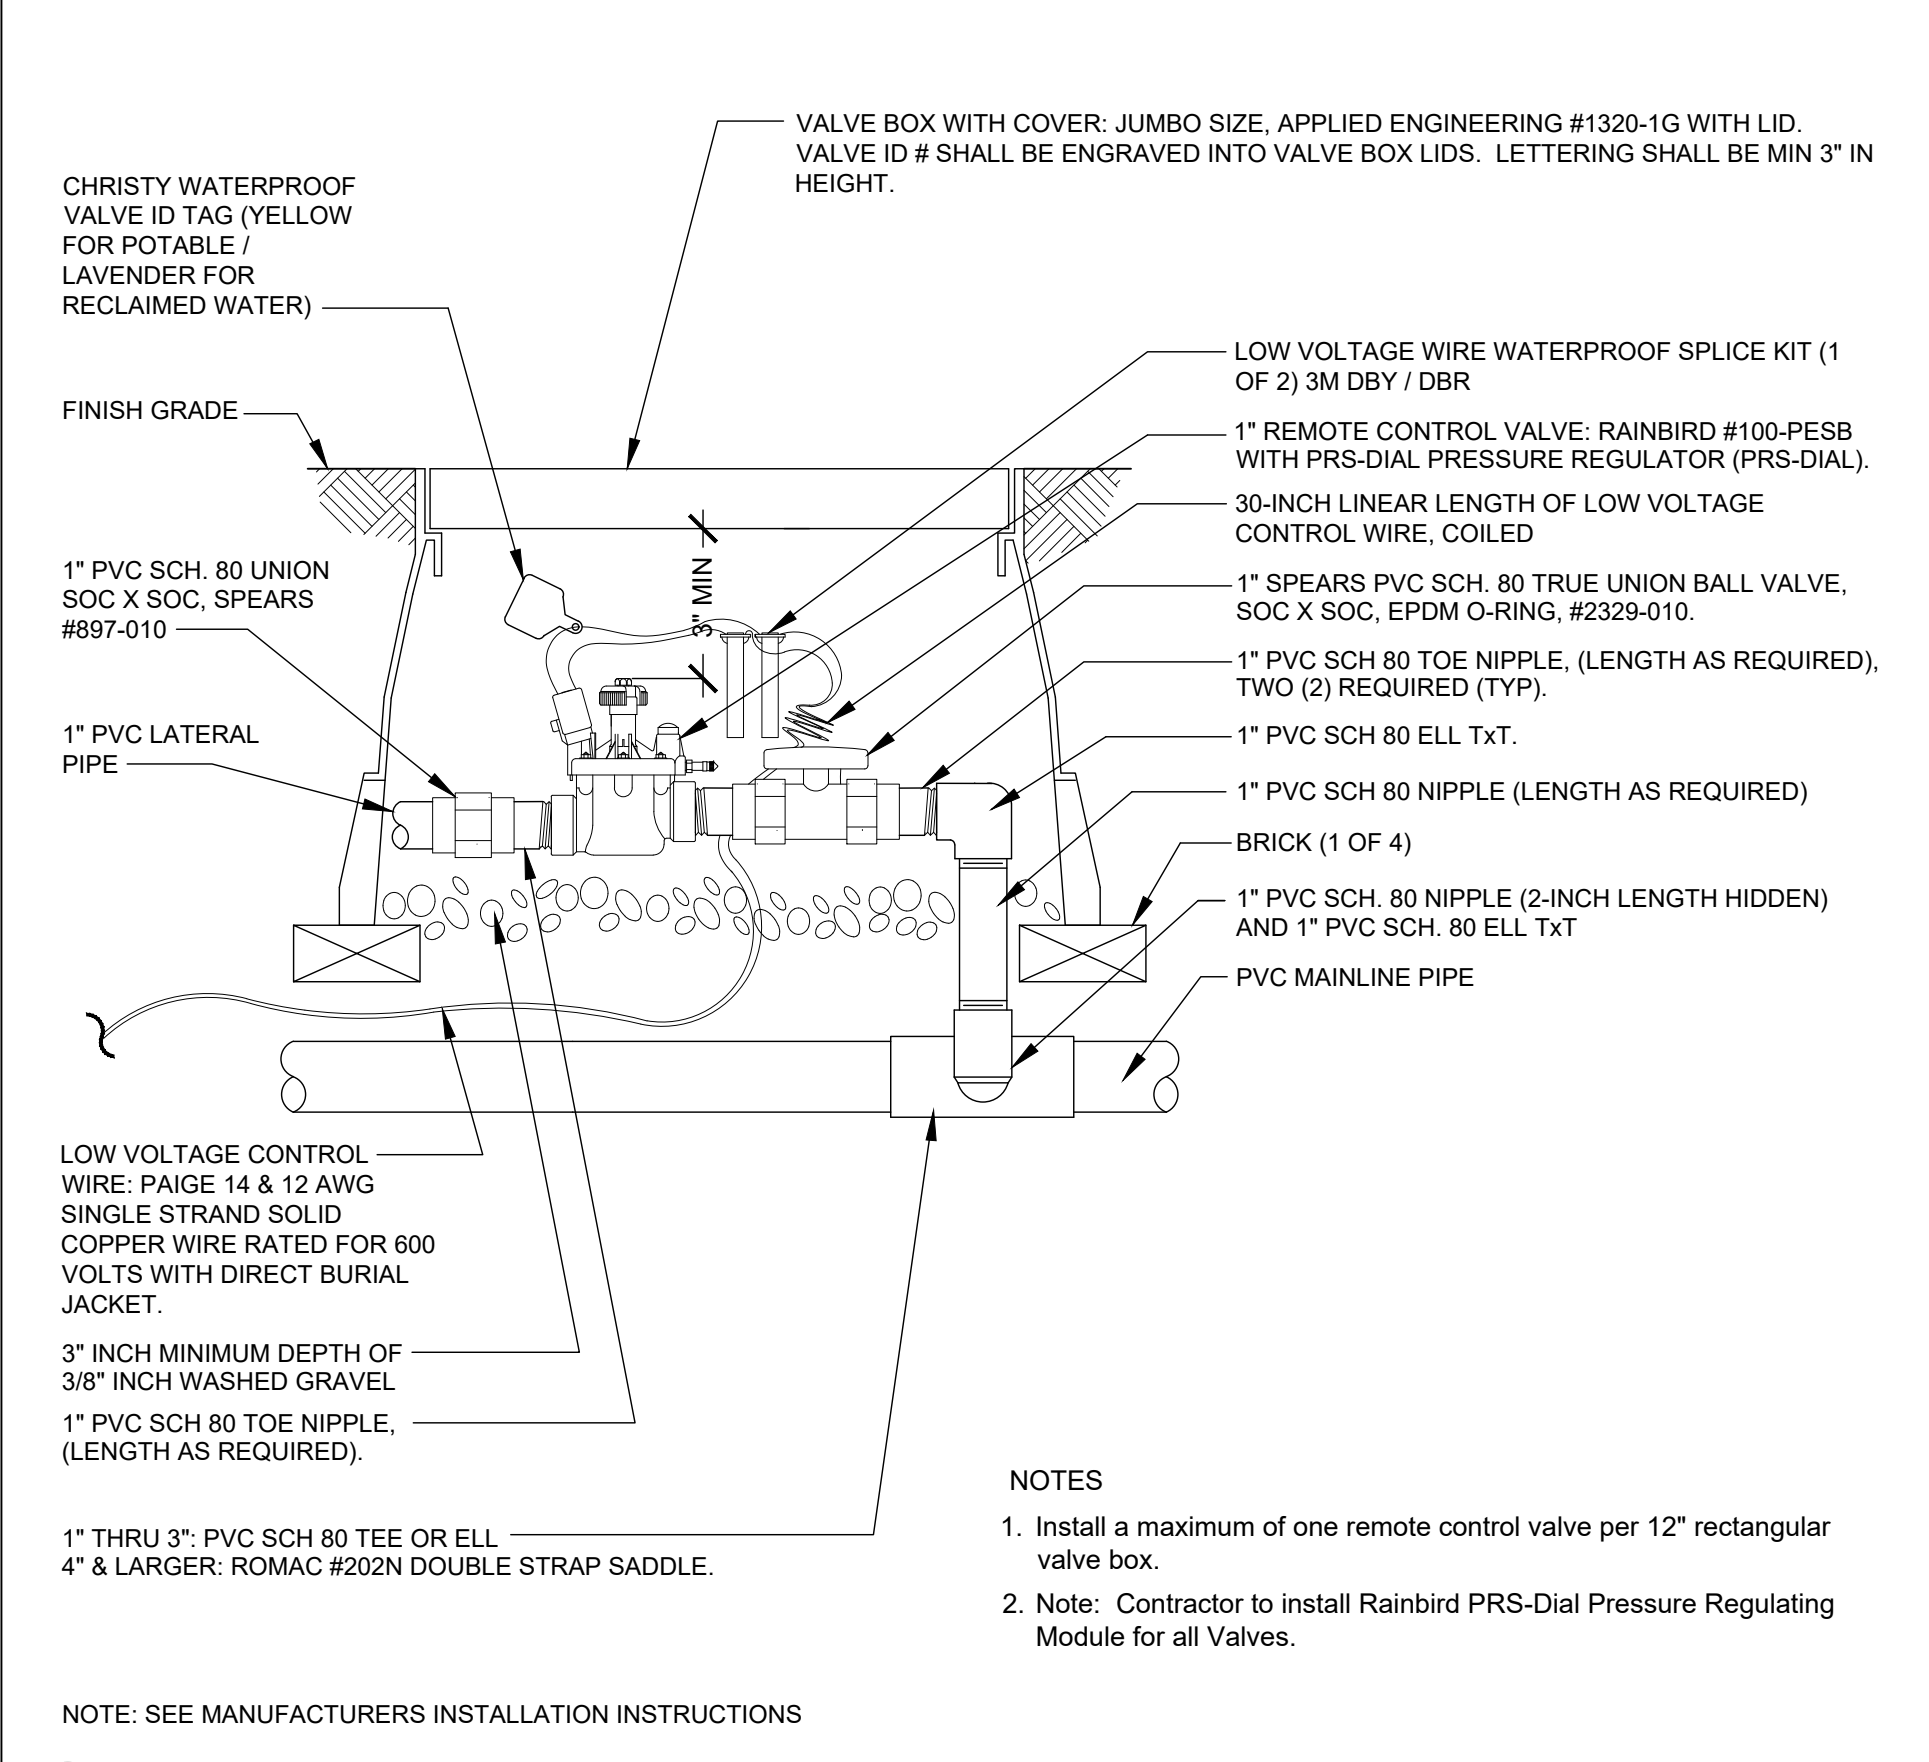


05 1" REMOTE CONTROL VALVE NTS

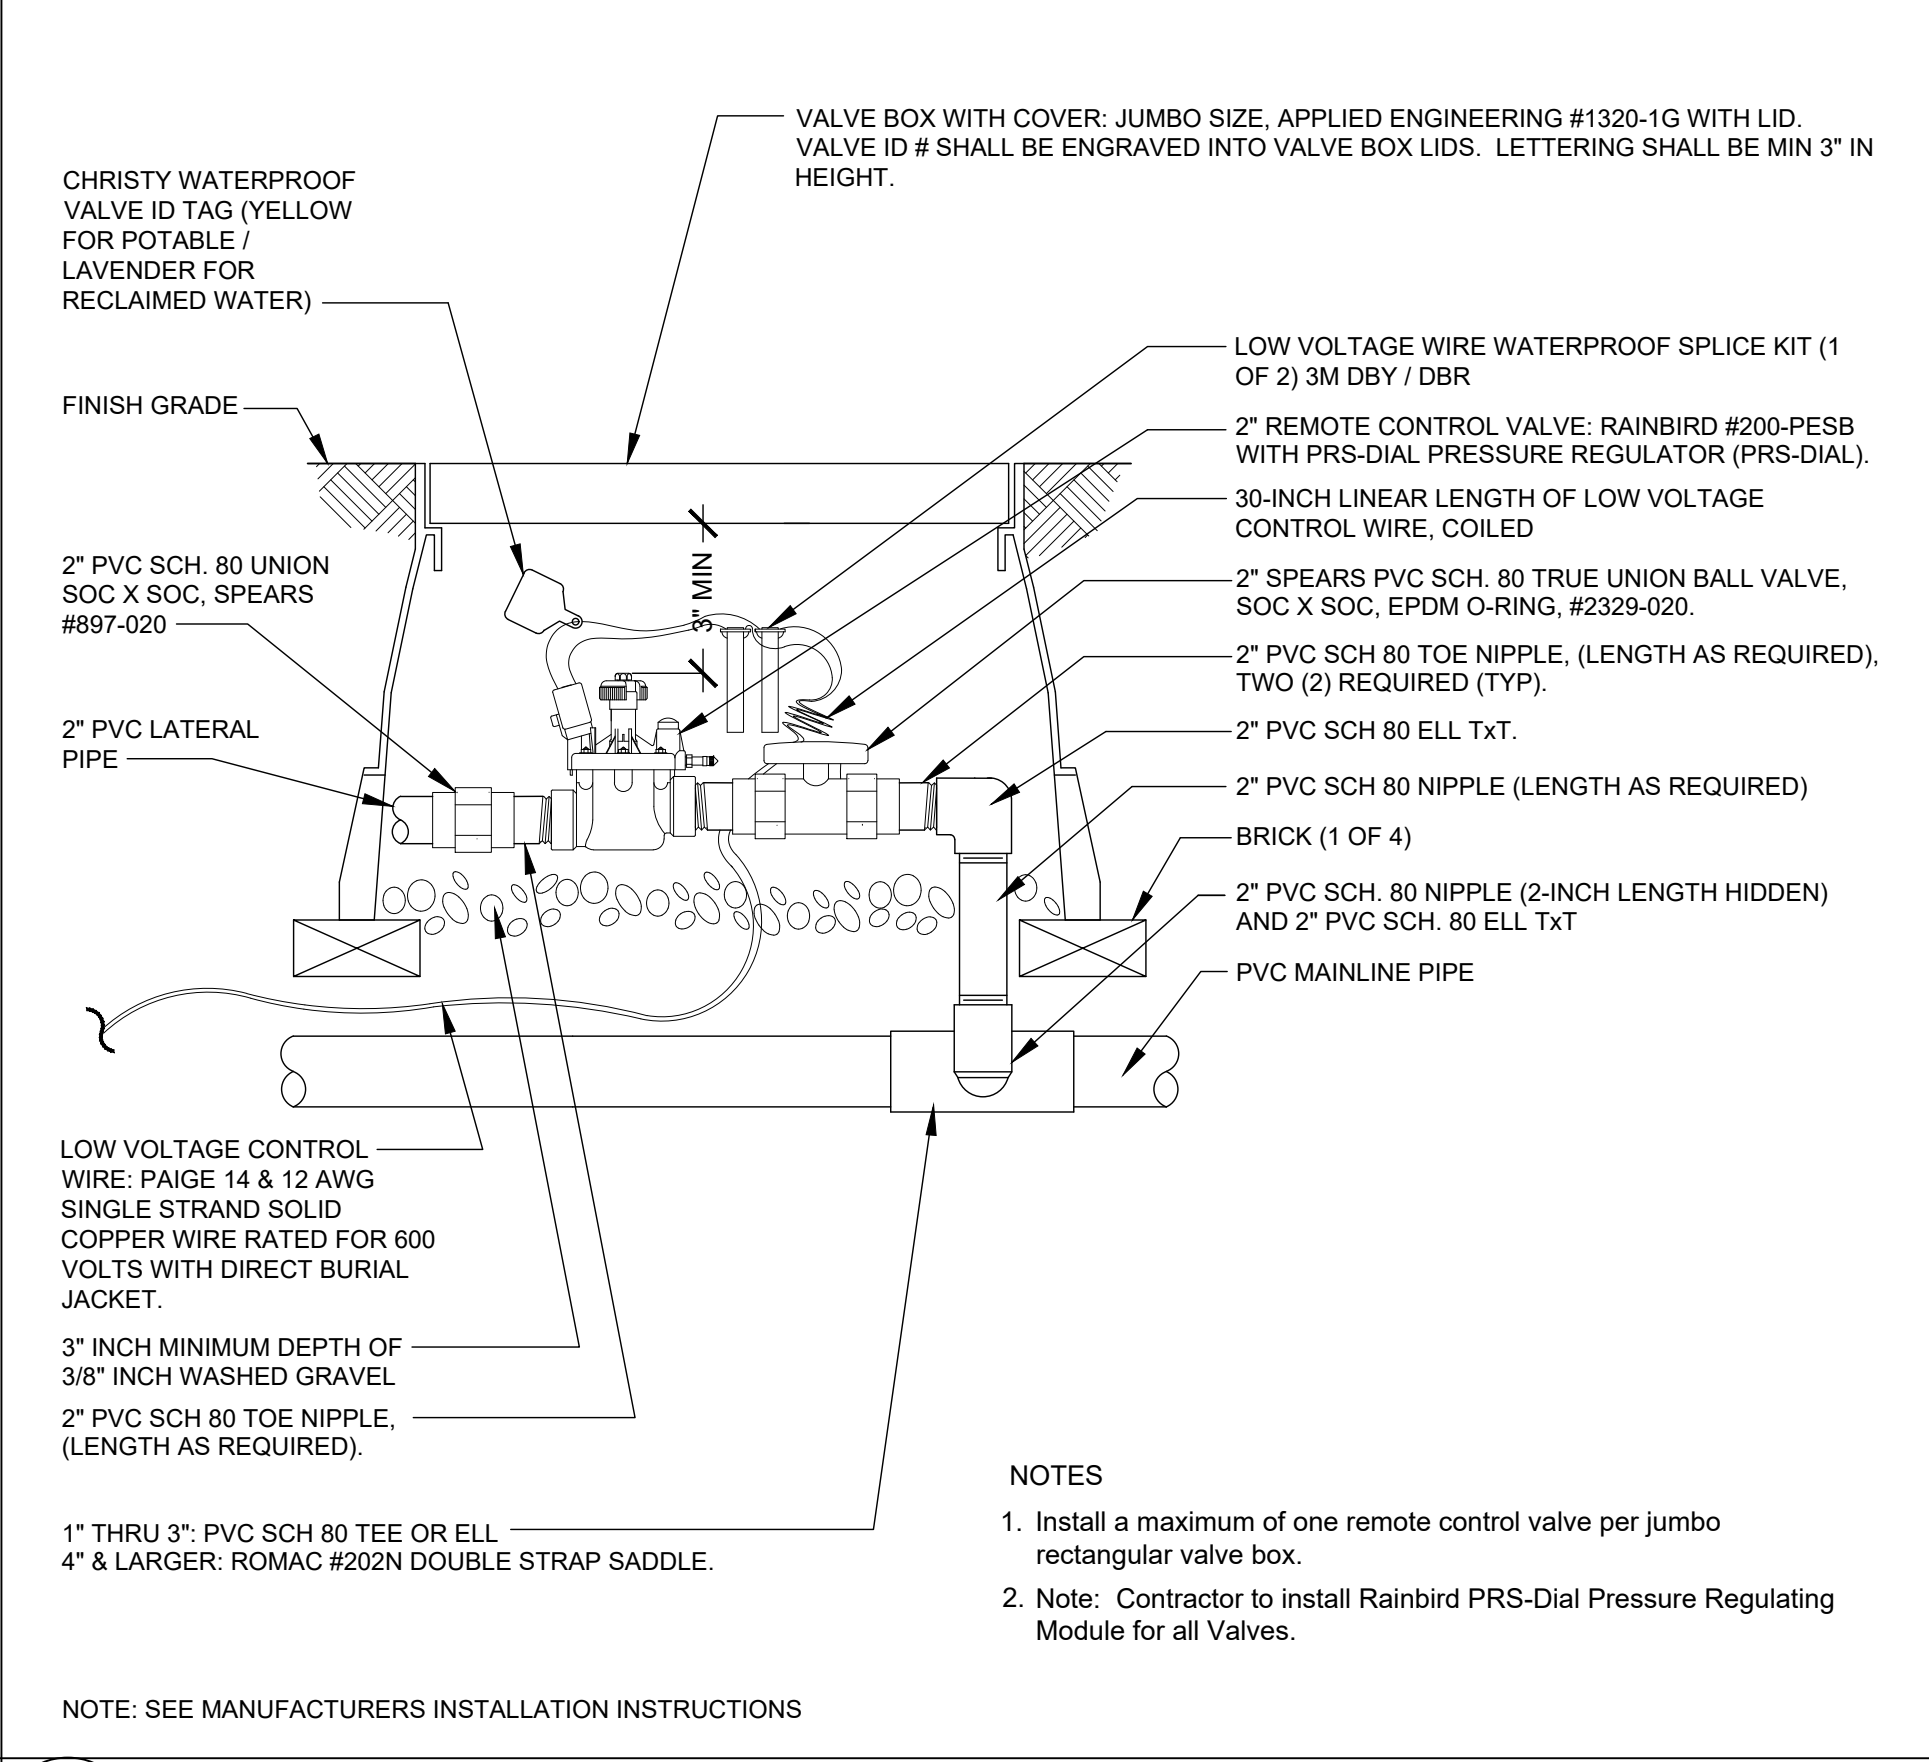


06 2" REMOTE CONTROL VALVE NTS

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these drawings, plans, specifications, and designs. No part of these documents may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written authorization of Teter, Inc.	
B	07/31/2024
DSA SUBMITTAL	
MARK	
C	11/01/2024
DESCRIPTION	
DSA BACKCHECK SUBMITTAL	



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
LANDSCAPE AND IRRIGATION DETAILS

PROJECT NO.

23-12899

DRAWING

L300




David Bigler Associates
Landscape Architect #3887
1589 W Shaw Avenue #5
Fresno, California 93711
E Mail: davebigler@aol.com
Tel: (559) 278-9495
Fax: (559) 278-9497

NTS

6

\\net-file1\Users\jesus.izazaga_TETRI\Documents\12899-A-STOCKTON PEYTON ELEM ELOP_jezazaga.rvt


PLOT DATE: 7/3/2024 2:47:03 PM

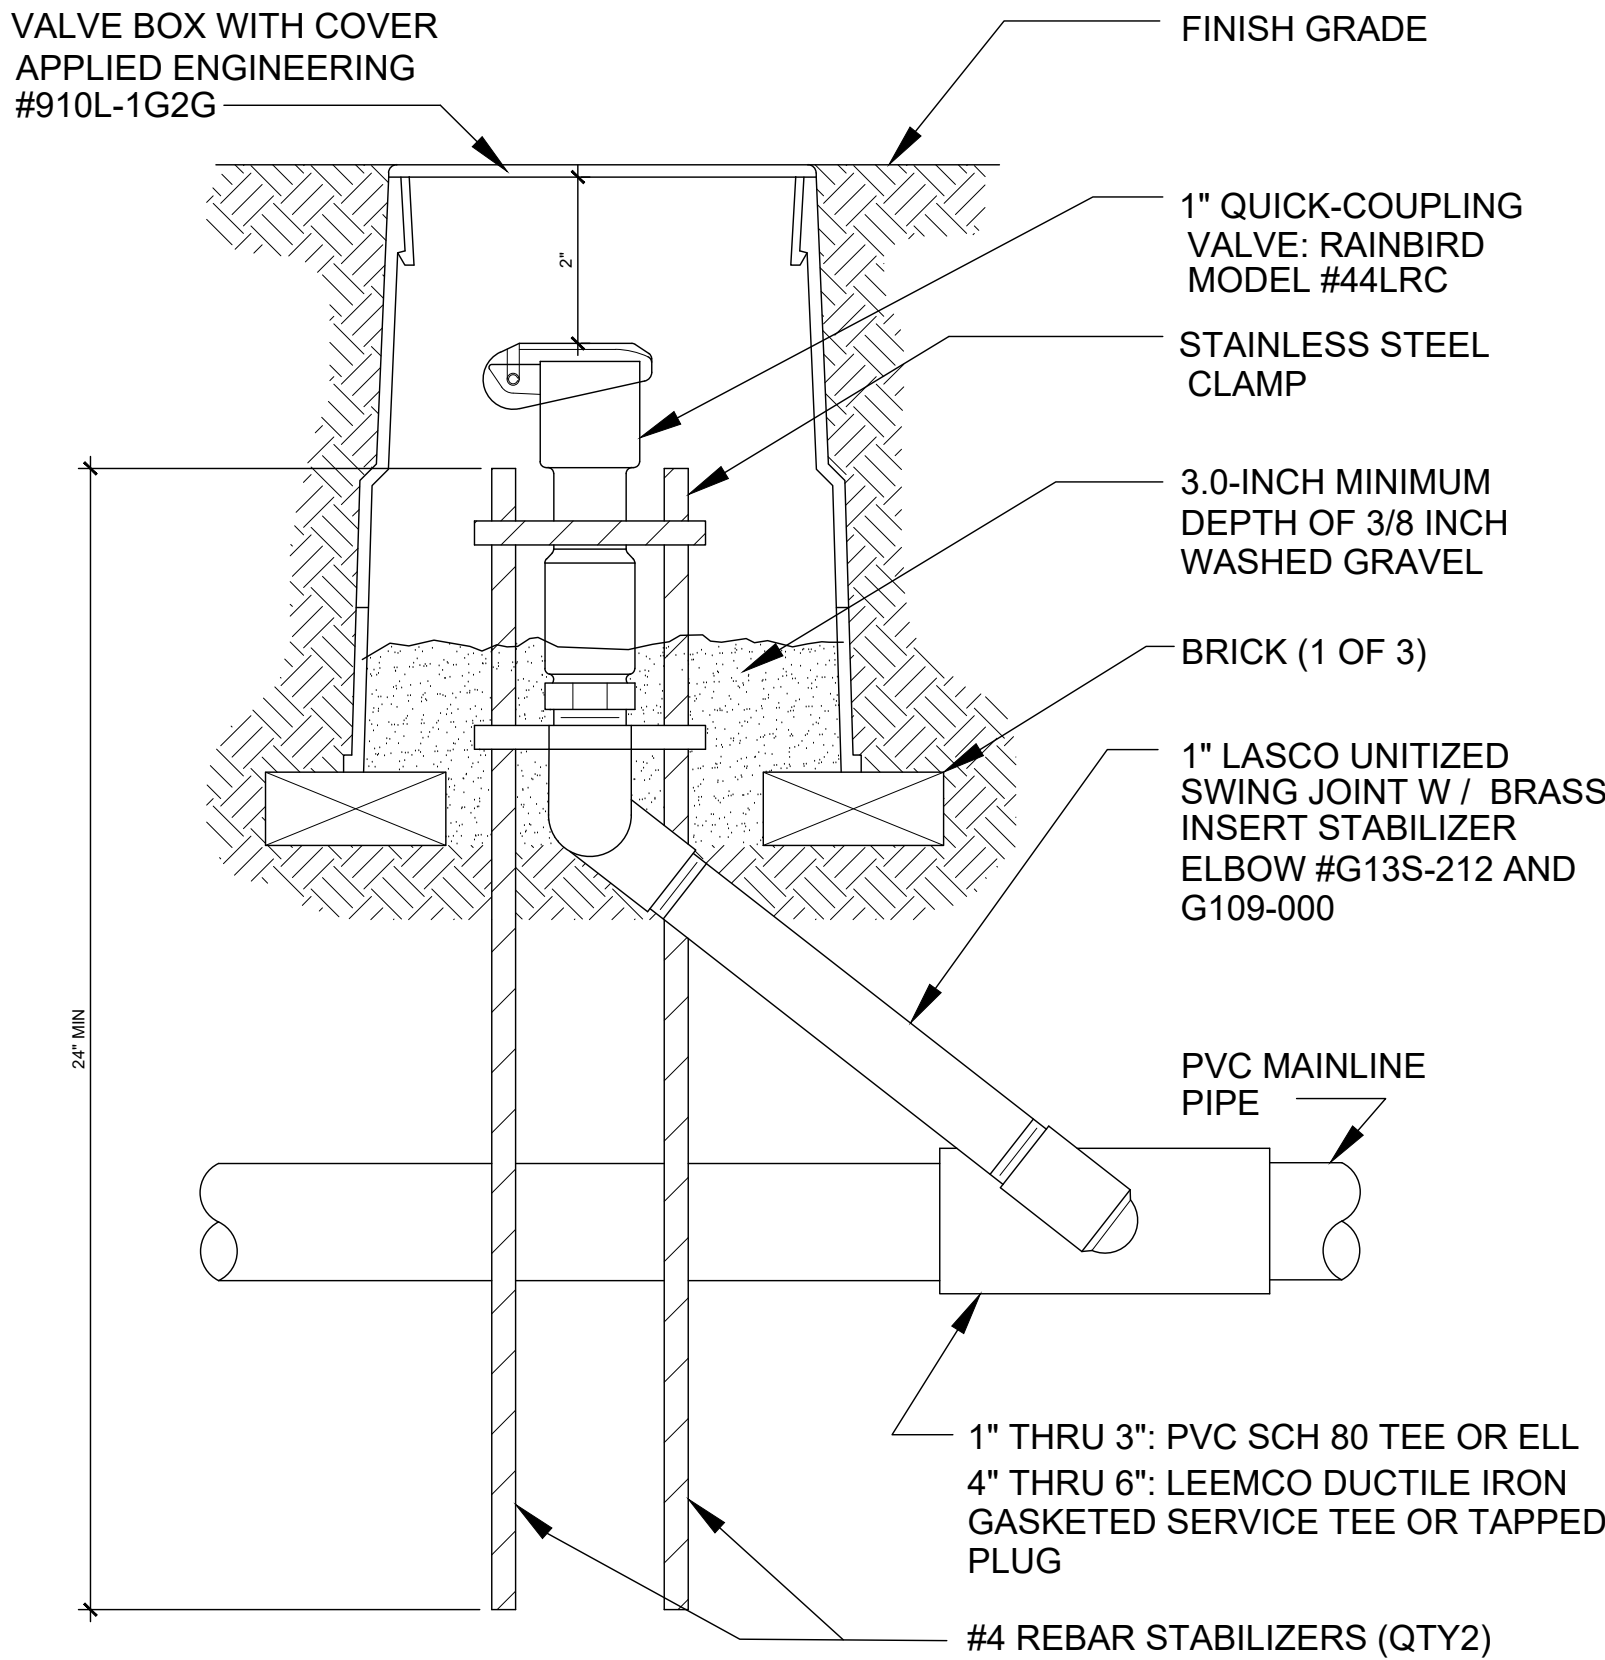

NOTE: SEE MANUFACTURERS INSTALLATION INSTRUCTIONS

07 QUICK-COUPLING VALVE

NTS

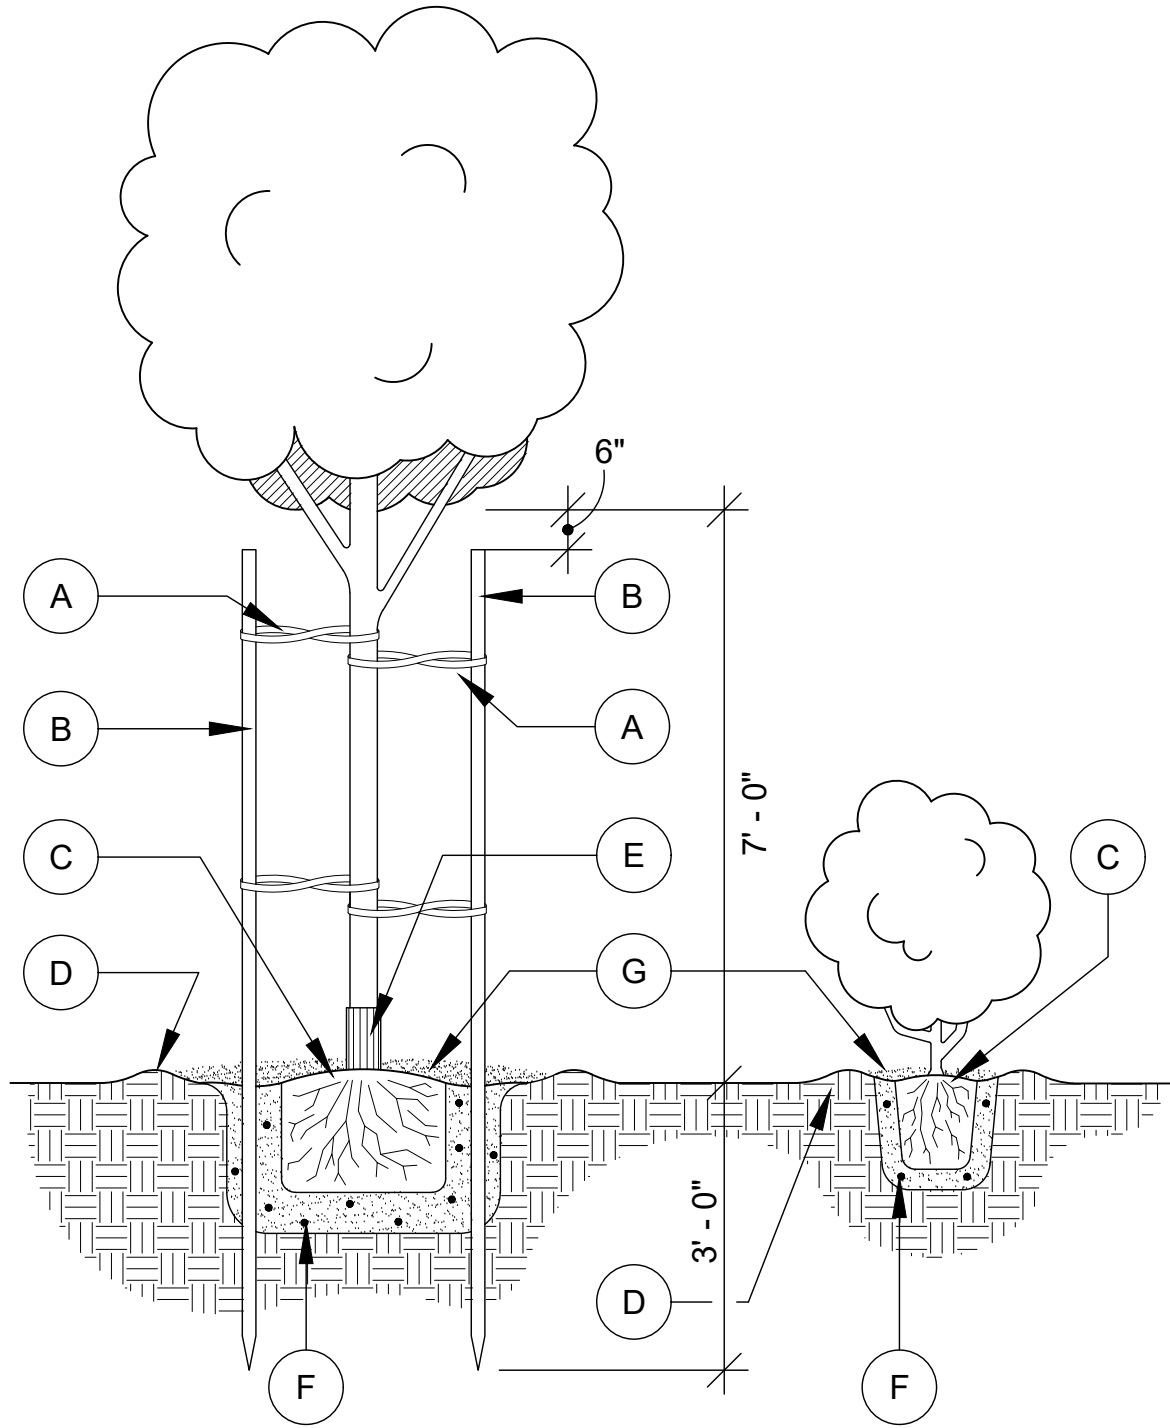

BERM DIAMETER

BERM DIAMETER	SIZE OF PLANT
30"	15 GALLON PLANT
36"	24" BOX
16"	5 GALLON PLANT
12"	1 GALLON PLANT


- KEY NOTES**
- A TREE TIES TO BE APPROVED RUBBER OR PLASTIC STRAPS NAILED TO STAKES
 - B TREATED 2"x10' LODGE POLE STAKE TO BE SET VERTICAL
 - C TOP OF ROOT BALL IS TO BE SET SLIGHTLY ABOVE FINISH GRADE
 - D CONSTRUCT WATER BASIN TO THE DIAMETER NOTED BELOW WITH 3" BERM AROUND PERIMETER. SOFTEN BERM IN TURF AREAS. REMOVE ALL TURF WITHIN BERM AREA IN TURF AREAS
 - E EXPANDABLE STRING TRIMMER TREE BOOT. USE ON TREES INSTALLED IN TURF AREAS ONLY
 - F AGRIFORM PLANT FERTILIZER TABLETS
 - G MULCH AS TOP DRESSING ALL NON TURF LANDSCAPE AREAS WITH WALK ON BARK MULCH AS SUPPLIED BY Z-BEST COMPOSTING. CONTACT STEPHANIE (669) 832-7194. INSTALL TO A COMPACTED DEPTH OF THREE INCHES (3"). DO NOT ENGULF THE STEMS OR TRUNKS OF SHRUBS AND TREES.

PLANTING NOTES

- CONTRACTOR IS TO DRILL ONE 18" DIAMETER DRAINAGE HOLE PER TREE OR 15 GALLON SIZE PLANT. A MINIMUM OF TEN FEET (10'-0") DEEP OR UNTIL THE HARD PAN LAYER IS PIERCED. MIX EXCAVATED SOIL WITH GYPSUM AND HUMUS AND BACKFILL HOLE. DRAINAGE HOLE IS TO BE OFF SET FROM THE PLANTING HOLE TO PREVENT SETTLEMENT OF THE TREE OR SHRUB.
- PLANTING HOLE TO BE TWICE THE DIAMETER OF CONTAINER WITH DEPTH EQUAL TO ROOT BALL, PLUS FOUR INCHES. BACKFILL WITH 85% CLEAN NATIVE SOIL MIXED W/ 15% NITROLIZED FOREST HUMUS. ADD PLANT FERTILIZER TABS TO BACKFILL AS FOLLOWS:

SIZE OF PLANT	# TABS
1 GALLON SIZE	2
5 GALLON SIZE	4
15 GALLON SIZE	6
24" BOX SIZE	8
- PLACE TREE OR SHRUB IN CENTER OF PLANTING HOLE.
- TAMP BACKFILL TO FORCE OUT ALL AIR POCKETS. FOOT TAMP BACKFILL BELOW ROOT BALL TO PREVENT SETTLEMENT.
- WATER TREE OR SHRUB IMMEDIATELY AFTER PLANTING
- DOUBLE STAKE, WITH ONE STAKE TO BE PLACED ON THE WINDWARD SIDE AND THE OTHER PLACED ON THE LEEWARD SIDE OF THE TYPICAL PREVAILING WIND. TOP OF STAKE IS TO BE SIX INCHES BELOW THE BRANCHING POINT OF THE CROWN.

SECTION VIEWS

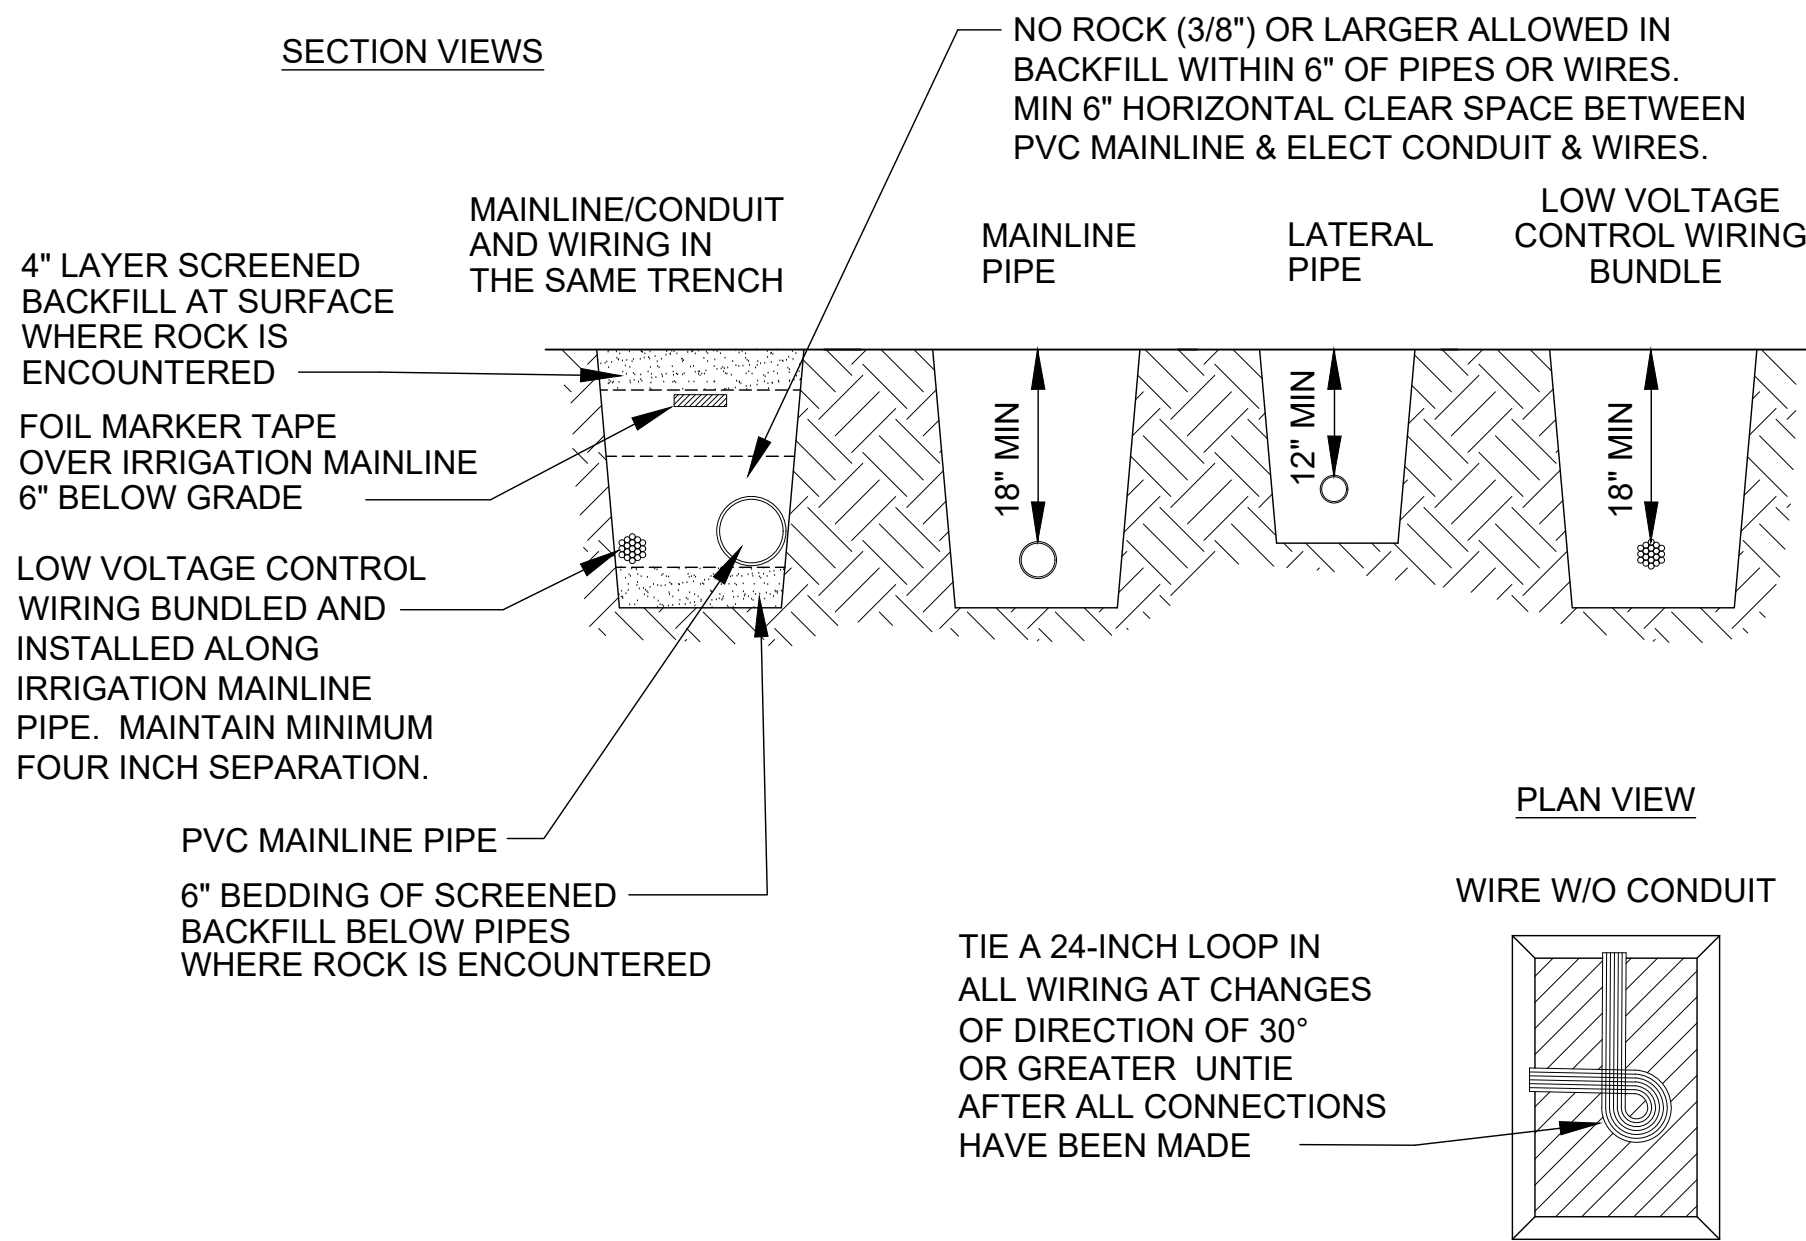


NOTES:

- SLEEVE BELOW ALL HARDSCAPE ELEMENTS WITH PVC SCH. 40 (2" - 3") OR CLASS 200 (4" AND LARGER) TWICE THE DIAMETER OF THE PIPE OR WIRE BUNDLE WITHIN, MIN SLEEVE SIZE IS 2".
- INSTALL ALL PIPE AND WIRE IN STRICT CONFORMANCE WITH MANUFACTURERS INSTRUCTIONS AND RECOMMENDATIONS

08 TRENCHING DETAIL


NTS

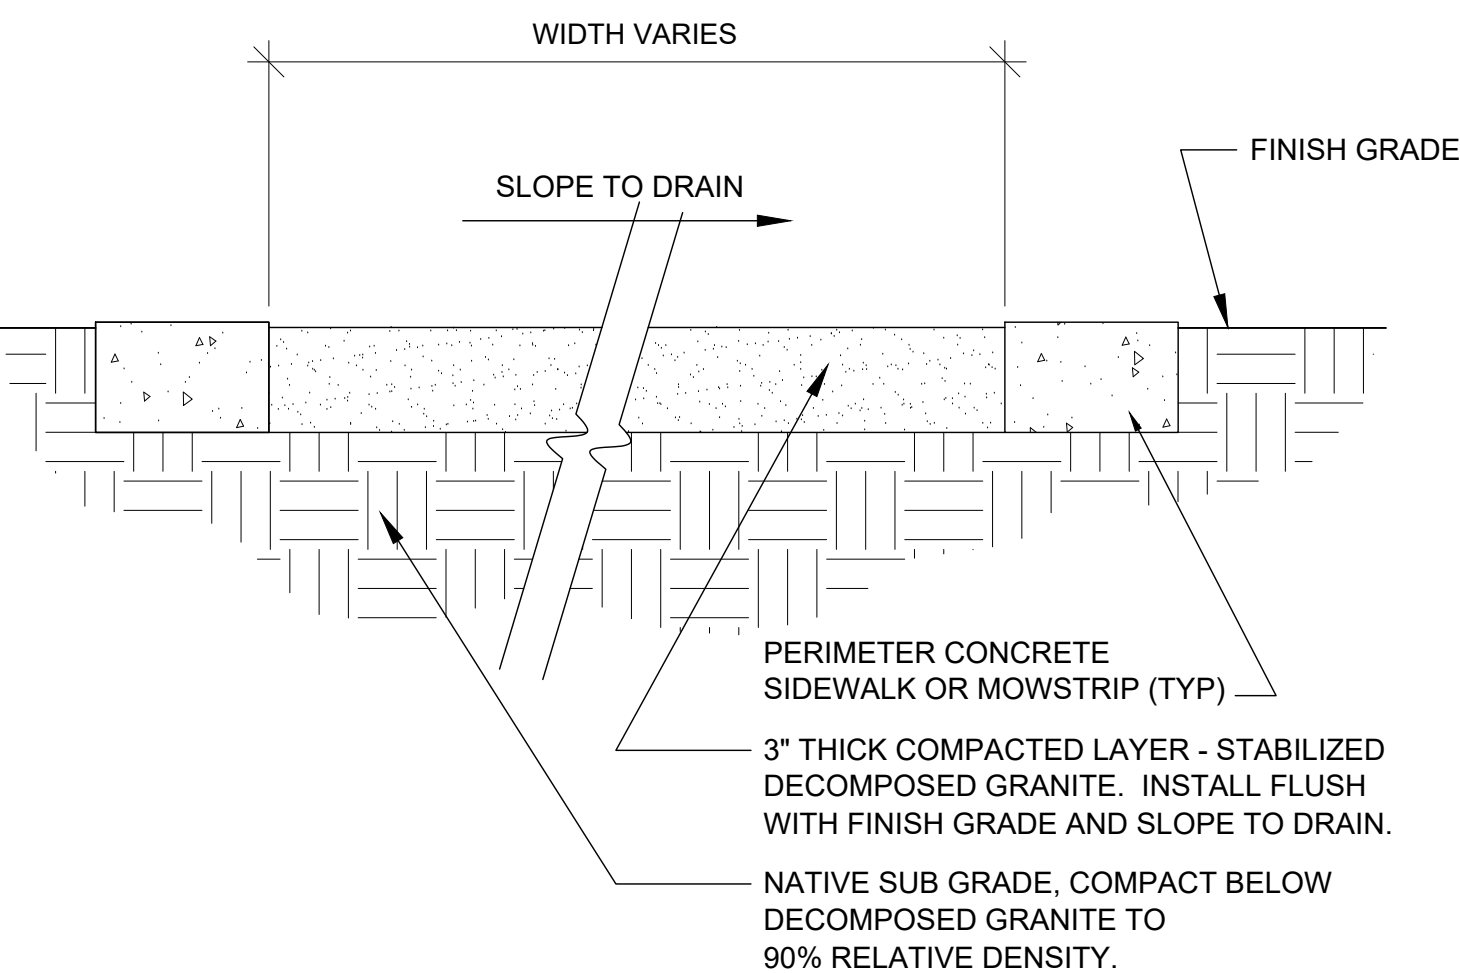

- CONTRACTOR IS TO FINE GRADE THE ENTIRE SITE AND INSURE THE SITE IS FREE DRAINING.
- CONTRACTOR IS TO EXCAVATE THE NATIVE SOIL TO A DEPTH OF THREE (3") INCHES WITH CLEAN EDGES. CONTRACTOR IS TO REMOVE SPOILS FROM THE SITE AT NO ADDITIONAL COST TO THE DISTRICT, OR INCORPORATE THEM INTO THE OVERALL GRADING SCHEME. CONTRACTOR IS TO THOROUGHLY COMPACT THE NATIVE SOIL BELOW THE DECOMPOSED GRANITE AREAS.
- CONTRACTOR IS TO IMPORT CLEAN HIGH QUALITY STABILIZED DECOMPOSED GRANITE (GOLD) AND PLACE IT IN WIND ROWS WITHIN THE DESIGNATED AREAS. THE DECOMPOSED GRANITE IS TO BE CAREFULLY SPREAD (DO NOT MIX WITH ADJACENT SOILS), GRADED AND COMPACTED TO A FINAL THICKNESS OF THREE INCHES (3").
- AREA IS TO BE GRADED SO IT DOES NOT IMPEDE SITE DRAINAGE (SITE IS TO BE FREE DRAINING) AND NO WATER IS TO COLLECT OR PUDDLE ON ANY AREA OF THE DECOMPOSED GRANITE.

10 STABILIZED DECOMPOSED GRANITE

NTS

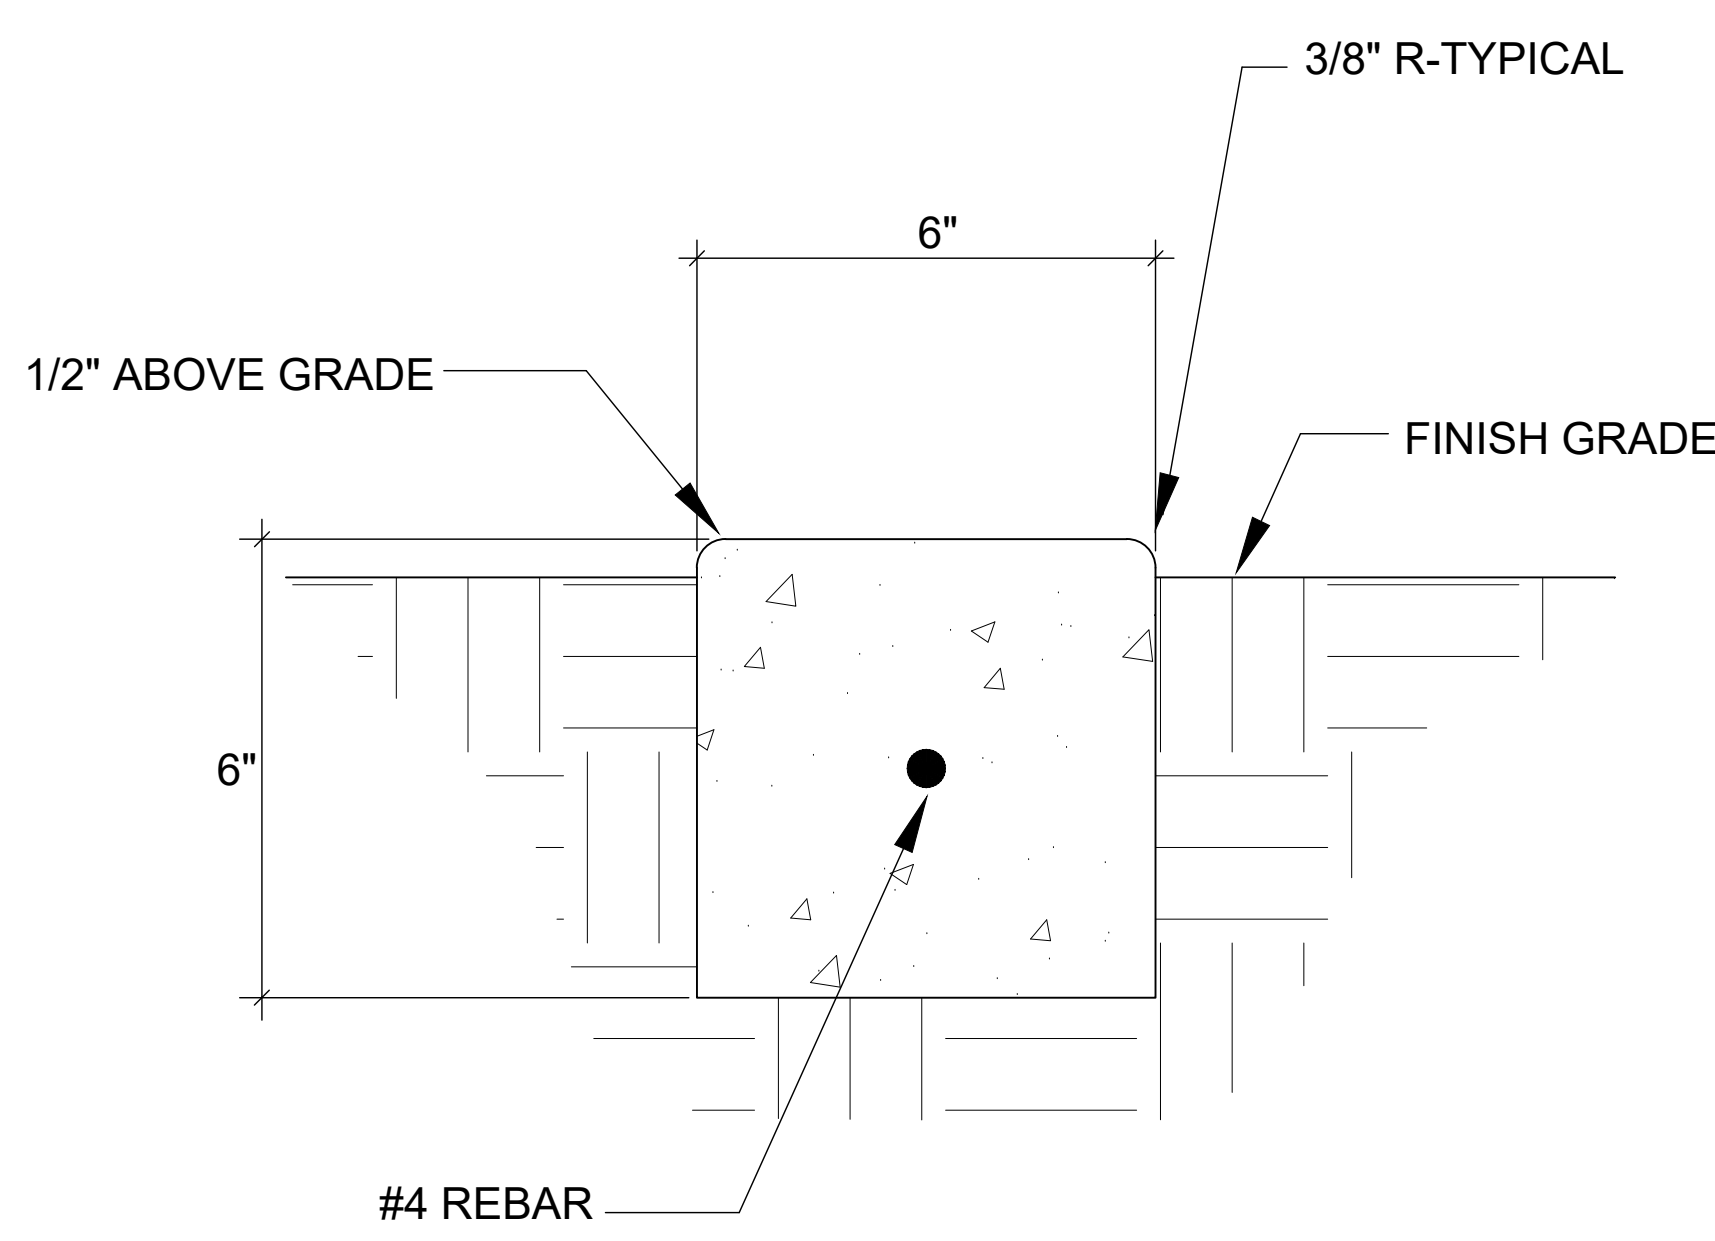

NOTES:

INSTALL EXPANSION JOINTS 10'-0" O.C.

11 CONCRETE MOW STRIP

NTS


\\net-file1\Users\jesus.izazaga_TETRI\Documents\12889-A-STOCKTON PEYTON ELEM ELOP_jezazaga.rvt

PLOT DATE: 7/3/2024 2:47:03 PM

LANDSCAPE AND IRRIGATION DETAILS

12 6" POP-UP SPRAY SPRINKLER

NTS

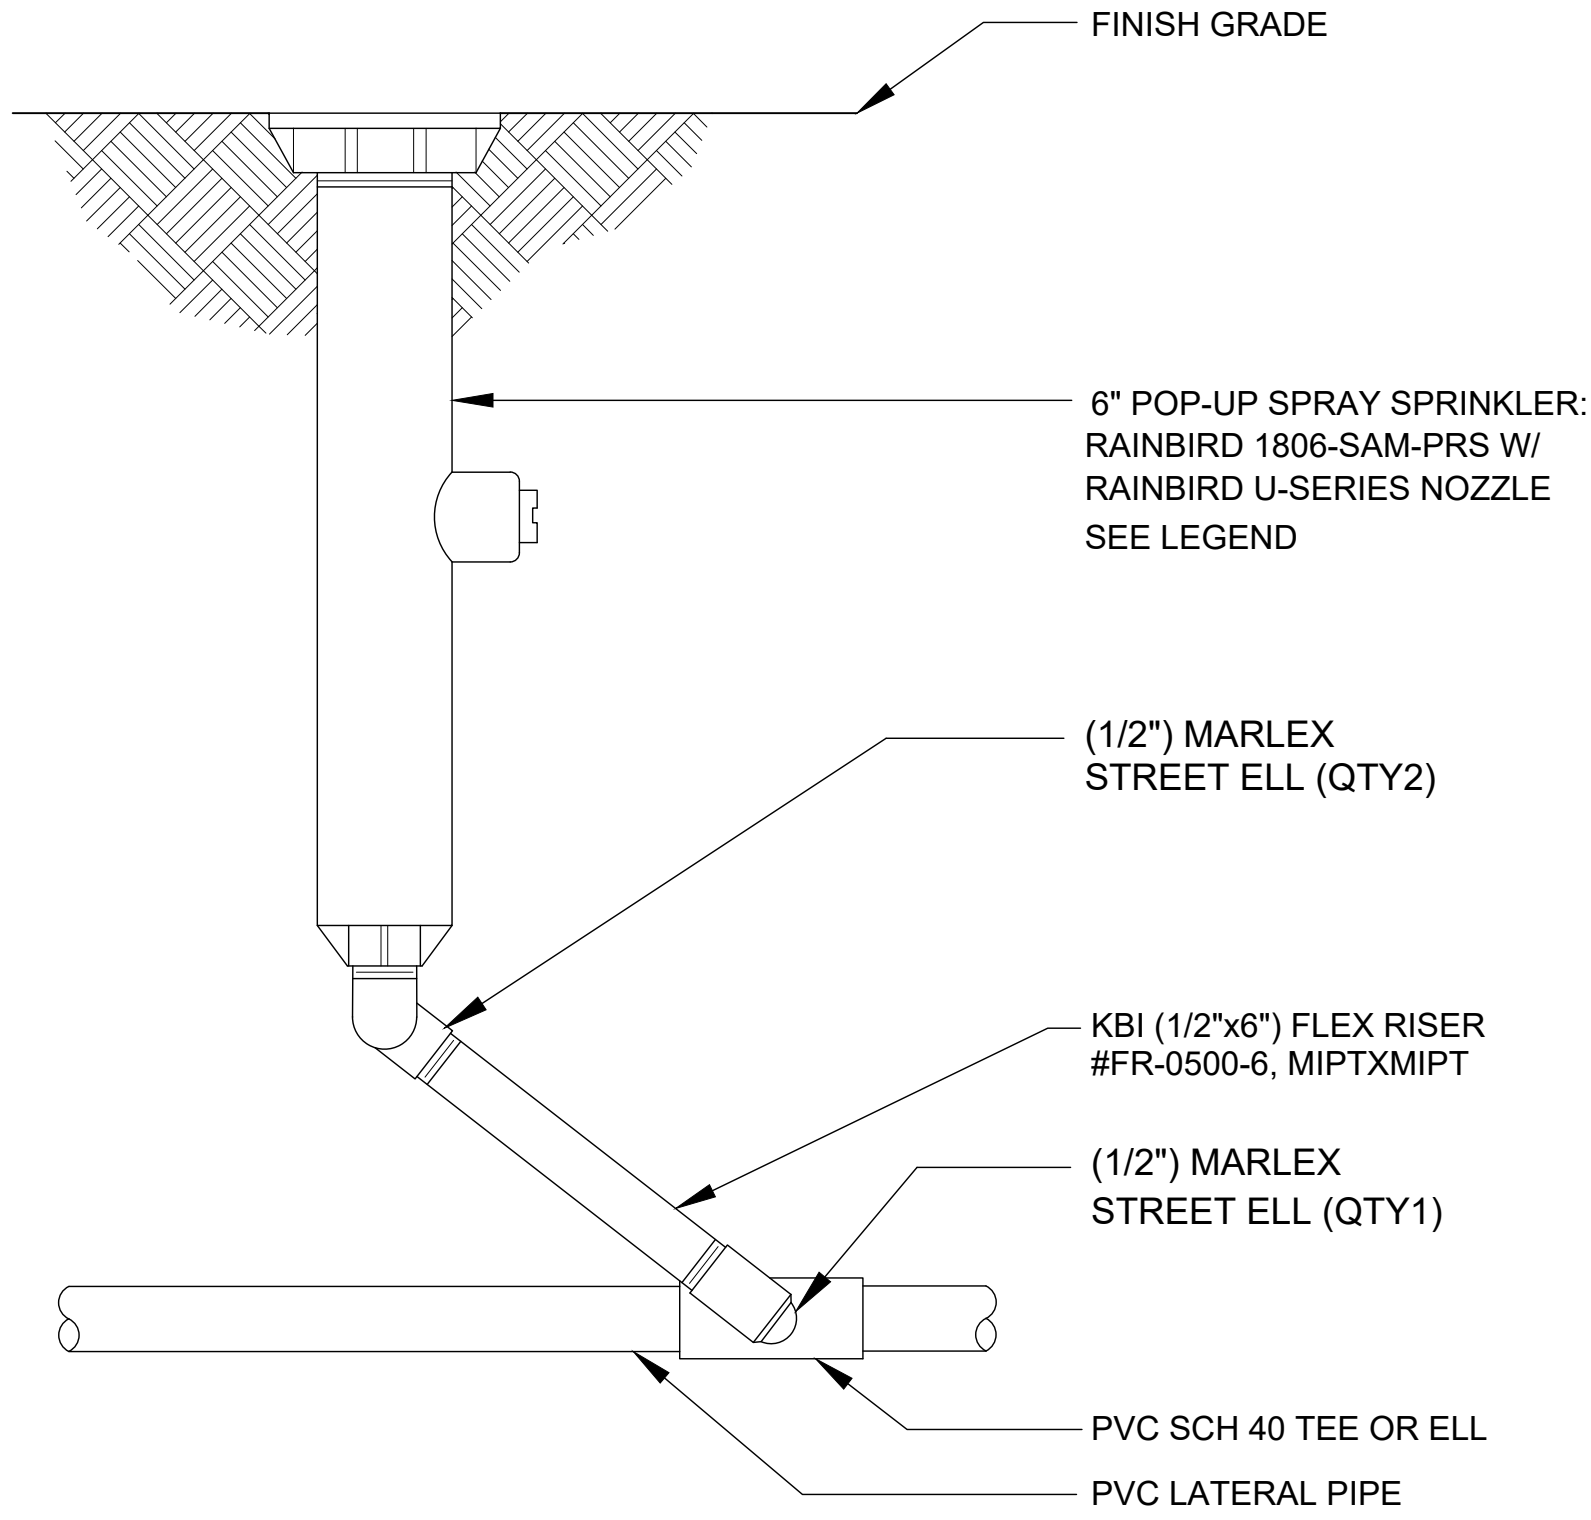


NOTE: SEE MANUFACTURERS INSTALLATION INSTRUCTIONS

13 NOT USED

NTS

14 THRUST BLOCKS

NTS

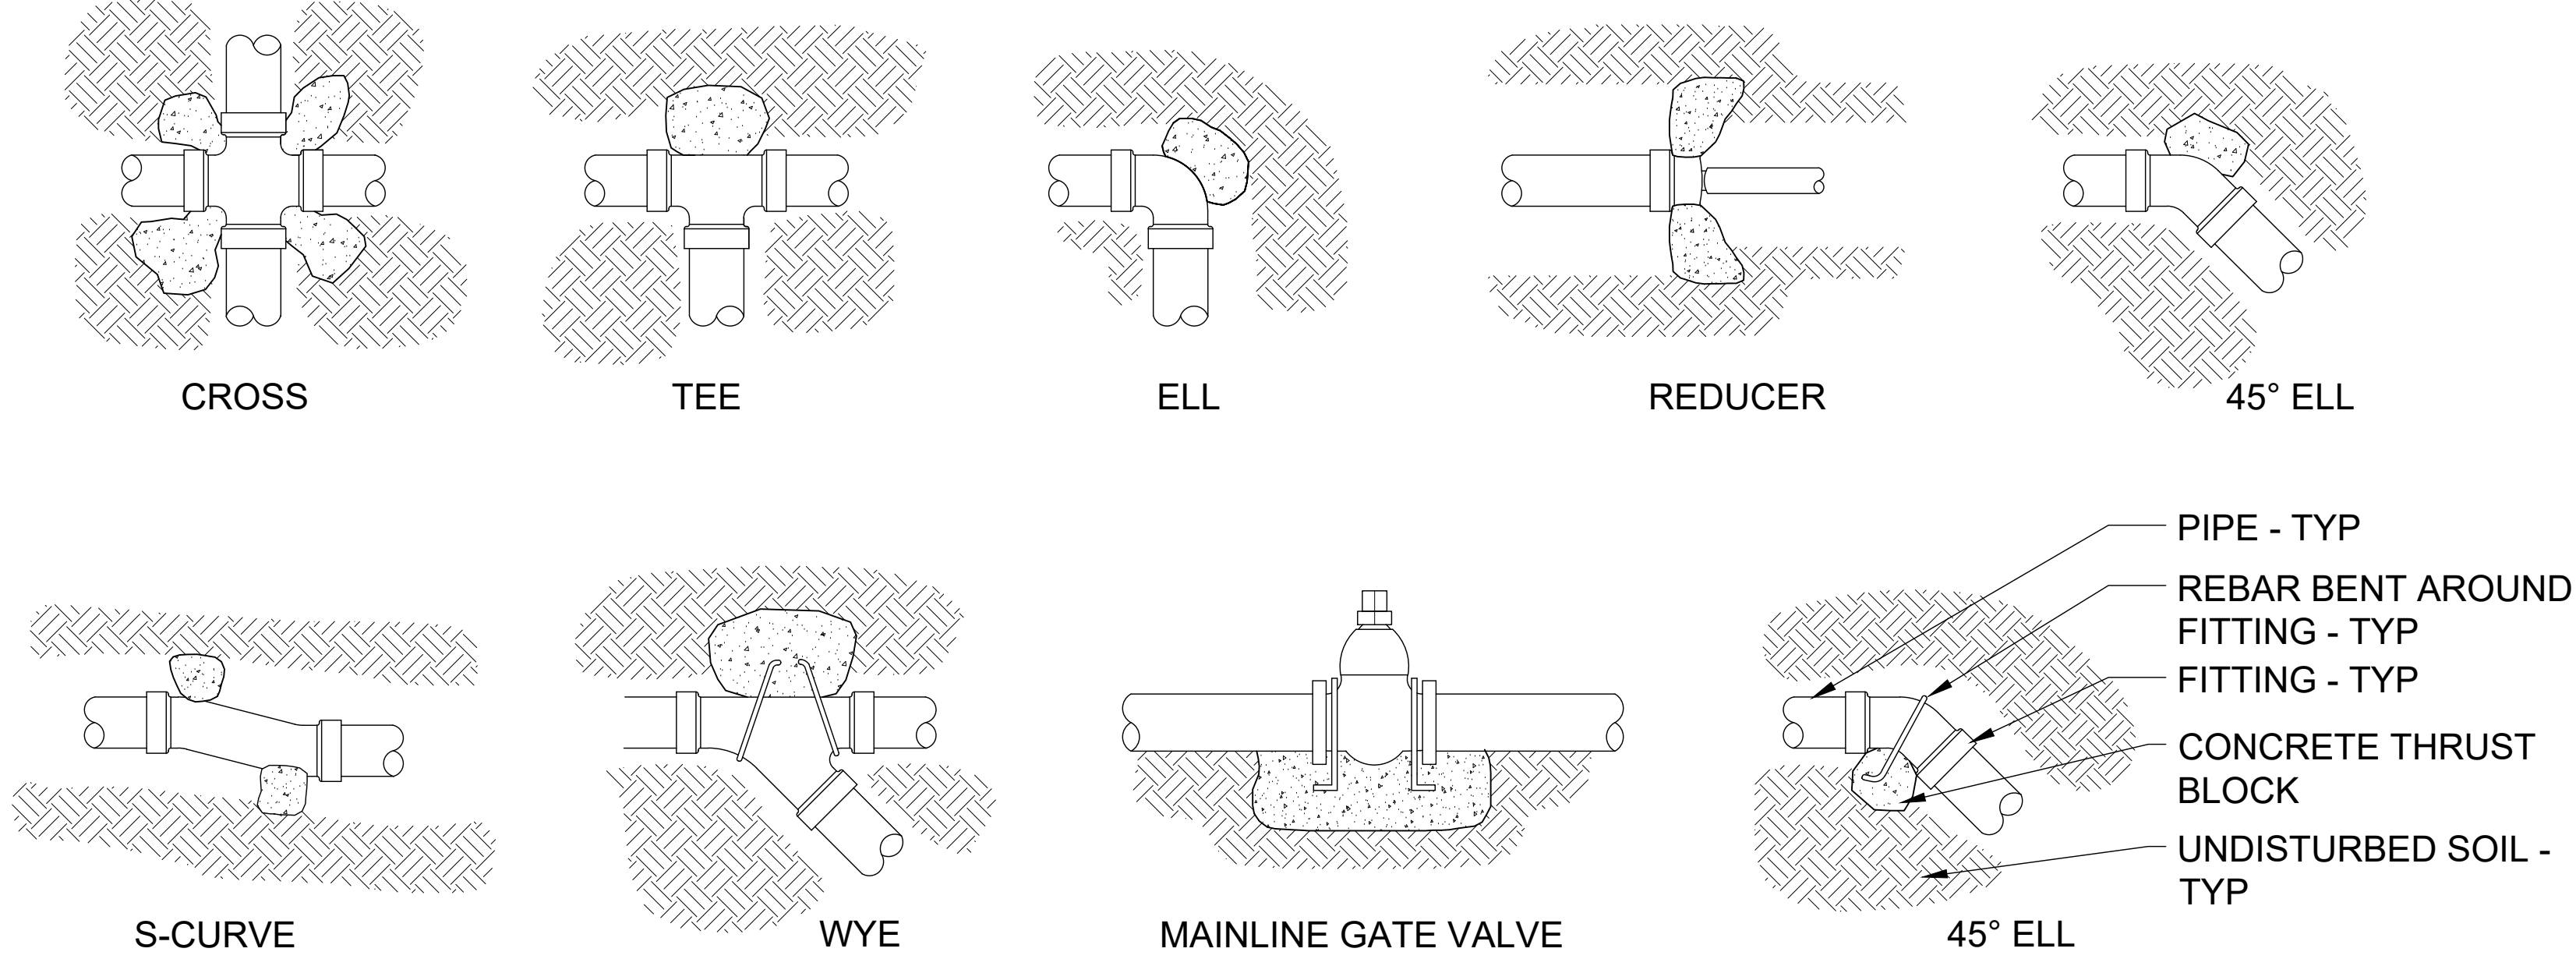


- NOTES:
1. SUPPLY LINES 3-INCHES IN DIAMETER AND LARGER SHALL RECEIVE CONCRETE THRUST BLOCKS.
 2. SEE PIPE MANUFACTURERS SPECIFICATIONS FOR AMOUNT OF CONCRETE TO BE USED FOR THRUST BLOCK.
 3. INSTALL ALL PIPE IN STRICT ACCORDANCE W/ PIPE MANUFACTURERS INSTRUCTIONS AND RECOMMENDATIONS.

NOTE: SEE MANUFACTURERS INSTALLATION INSTRUCTIONS

15 SLEEVING DETAIL

NTS

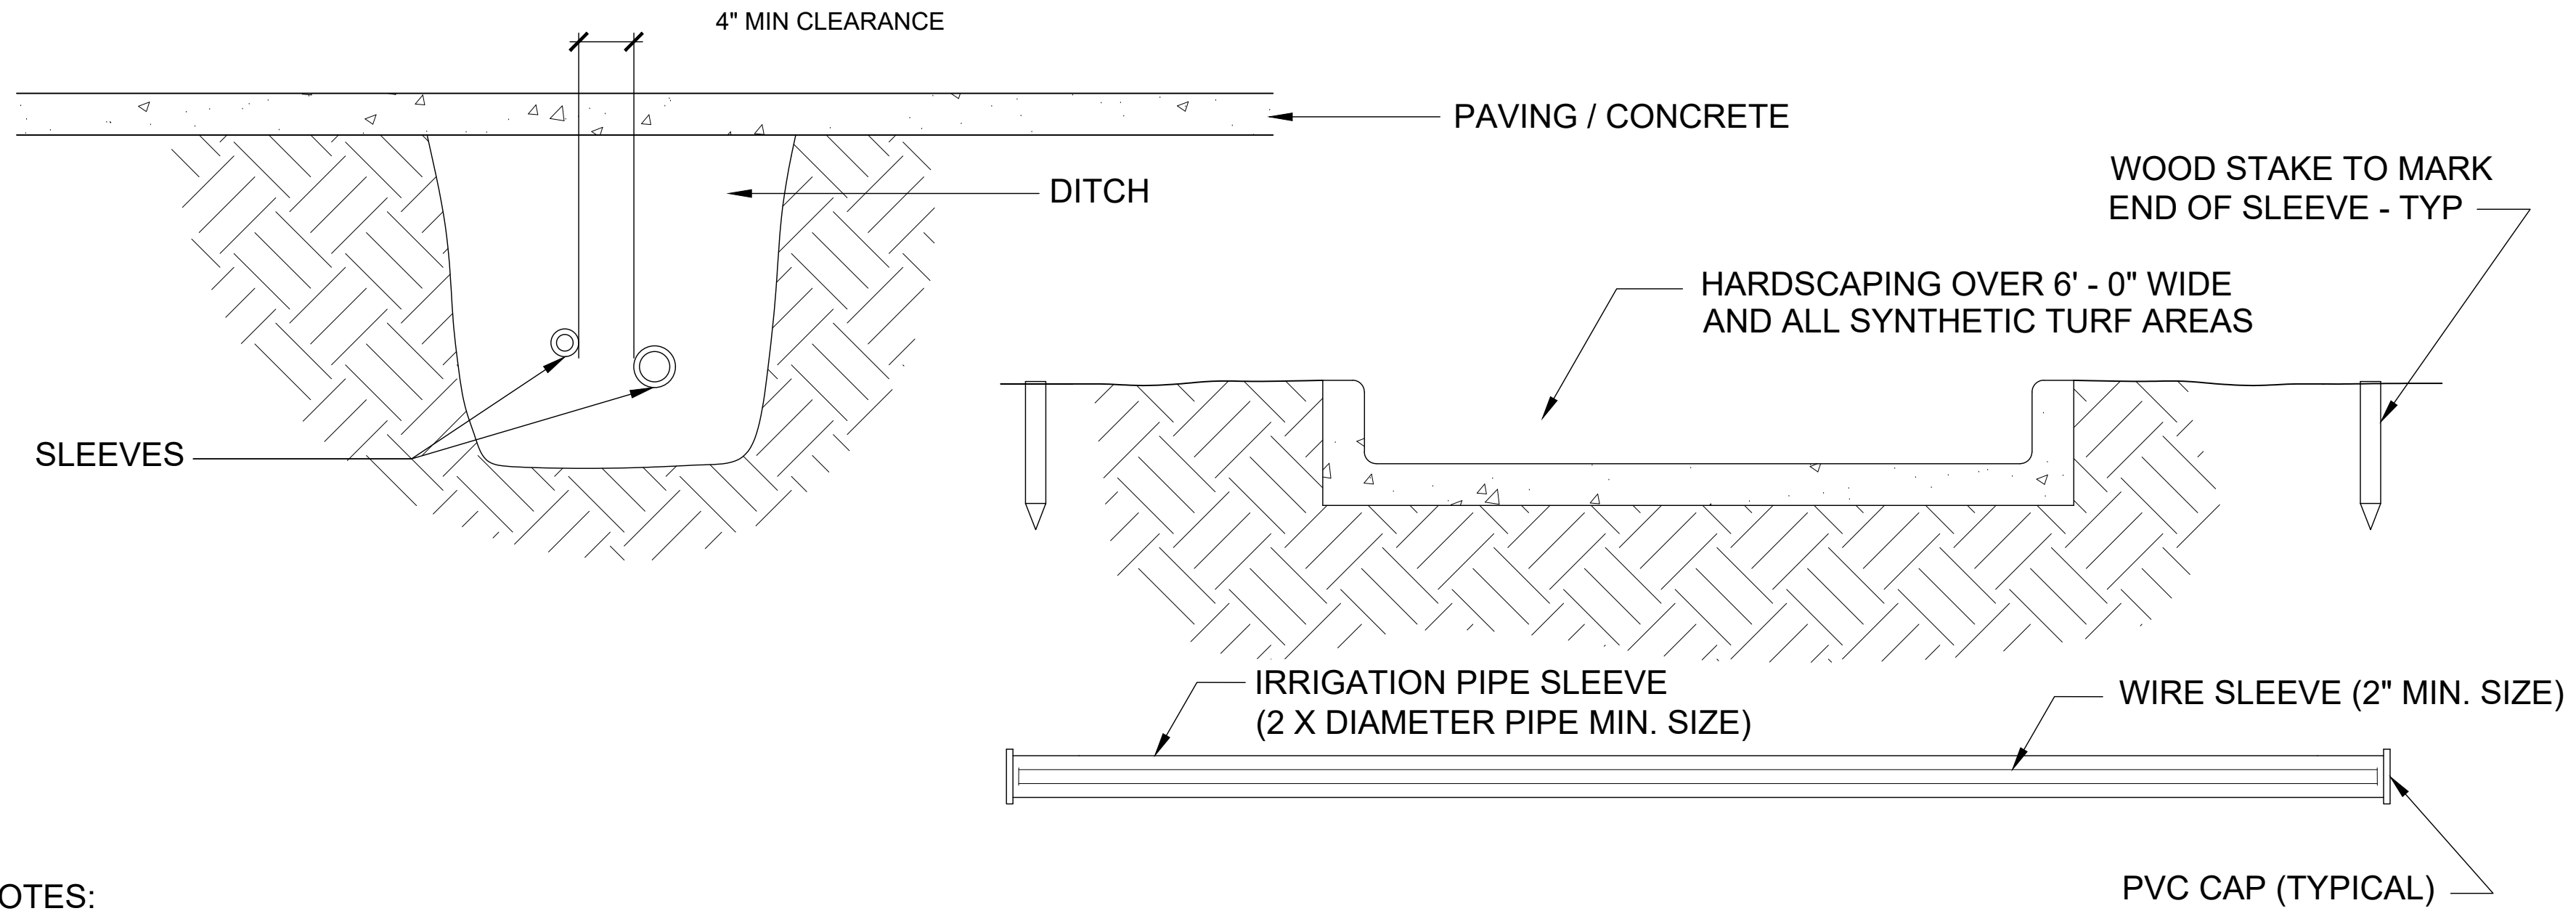

- NOTES:
1. ALL PVC IRRIGATION SLEEVES 2" THRU 3" ARE TO BE PVC SCHEDULE 40 PIPE.
 2. ALL PVC IRRIGATION SLEEVES 4" AND LARGER ARE TO BE PVC CLASS 200 PIPE.
 3. ALL JOINTS TO BE SOLVENT WELDED AND WATERTIGHT.
 4. IRRIGATION PIPES AND LOW VOLTAGE WIRES ARE TO BE SLEEVED SEPARATELY.
 5. ALL PIPES & WIRES ARE TO BE SLEEVED UNDER PAVED/CONC. 6'-0" WIDE OR WIDER AND UNDER ALL SYNTHETIC TURF AREAS. MECHANICALLY COMPACT TO 95% PROCTOR.

NOTE: SEE MANUFACTURERS INSTALLATION INSTRUCTIONS



David Bigler Associates
Landscape Architect #3887
1589 W Shaw Avenue #5
Fresno, California 93711
E Mail: davebigler@aol.com
Tel: (559) 278-9495
Fax: (559) 278-9497


NTS

8


IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly
reserves its common law
copyright and other
property rights in these
plans, specifications, and
designs. No part of these
plans and designs may be
reproduced or transmitted
in any form or by any
means, electronic or
mechanical, including
photocopying, recording,
or by any information
storage and retrieval
system, without the
prior written authorization
of Teter, Inc.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
LANDSCAPE AND IRRIGATION DETAILS

PROJECT NO.

23-12899

DRAWING

L302

SYMBOLS

WINDOW SYMBOL

WINDOW REFERENCE

 WORK POINT, CONTROL POINT OR DATUM POINT

SECTION

LOCATION ON SHEET REFERENCED

SHEET NUMBER WHERE SECTION IS LOCATED

ROOM IDENTIFICATION

+10'-0" CEILING HEIGHT

&	AND	F.A	FIRE ALARM
Λ	ANGLE	F.B	FLAT BAR
@	AT	F.B.O.	FURNISHED BY OWNER/DESIGNER
⊙	CENTERLINE	F.D.	FLOOR DRAIN
⊘	CORNER OR ROUND	F.D.C.	FIRE DEPARTMENT
⊥	PERPENDICULAR		CONNECTION
∅	POLIND OR NUMBER		
(E)	EXISTING	F.D.N.	FOUNDATION
(N)	NEW	F.E.	FIRE EXTINGUISHER
		F.E.C.	FIRE EXTINGUISHER CABINET
		F.F.	FACTORY FINISH
ABV.	ABOVE	F.F.L.	FACTORY FLOOR
A/C	AIR CONDITIONING	F.G.	FINISH GRADE
ACP	ASPHALT CONCRETE	F.H.	FIRE HYDRANT
	PAVING	F.H.M.S	FLAT HEAD MACHINE SCREW
ACST.	ACOUSTICAL		
A.C.T.	ACOUSTIC CEILING TILE	F.H.W.	FLAT HEAD WOOD SCREW

A.B	ANCHOR BOLT	FN.	FINISH	OPP.	OPPOSITE
ADA	AMERICANS WITH DISABILITIES ACT	FX.T.	FIXTURE	O.	OVER
ADAG	ADA ACCESSIBLE GUIDELINES	FL.	FLOORING	OR.	ORIGINAL
ADOL.	ADJUSTABLE	FLR.	FLASHING	OWD	OVER HEAD
ADOL.	ADJACENT	FLUR.	FLOORESCENT	OWJ	OPEN WEB JOIST
A.F.F.	ADDITIONAL	F.O.	FACE OF		
A.F.F.	ADJUSTABLE	F.O.C.	FACE OF CONCRETE	P.B.N.	PLYWOOD BOUNDARY
A.G.	AGGREGATE	F.O.F.	FACE OF FINISH		NAILING
A.F.F.	ABOVE FINISH FLOOR	F.O.M.	FACE OF MASONRY	P.E.N.	PLYWOOD EDGE
A.G.	ABOVE FINISH GRADE	F.O.S.	FACE OF STUD		NAILING
ALT.	ALTERNATE	FRP	FIBERGLASS REINFORCED	P.E.S.	PLYWOOD SCREWS
ALUM.	ALUMINUM	F.S.	FEET SPRINKLERS	P.I.V.	POST INDICATOR
ANOD.	ANODIZED	F.S.H.	FEET SPRINKLER HEAD		VALVE
A.P.C.	ACOUSTIC PANEL CEILING			P.LAM.	PLASTIC LAMINATE
		FT.	FOOTFEET	P.L.	PROPERTY LINE
APPROX.	APPROXIMATE	FURR.	FURRING	PL.	PLATE
ARCH.	ARCHITECT(URAL)	FUT.	FUTURE	PLAS.	PLASTER
AV	AUDIO VISUAL			PLYWD.	PLYWOOD
				PR.	PAIR
				PSF	POUNDS PER
					SQUARE FOOT
BD.	BOARD	GA.	GAUGE	PSI	POUNDS PER
BEL.	BELT	G.B.	GALVANIZED		SQUARE FOOT
B.E.N.	BOUNDARY EDGE NAILING	G.C.	GENERAL CONTR.	PSI	POUNDS PER
		GEN.	GENERAL	PT.	SQUARE INCH
BLDG.	BUILDING	G.I.	GALVANIZED IRON	P.T.D.	PAPER TOWEL DISP.
BLK.	BLOCK	GL.	GLASS	P.T.O.F.	PRESSURE TREATED
BLK.	BLANK	GRD.	GROUND		DOUGLAS FIR
BM.	BEAM	GR.	GRADE	PTN.	PARTITION
BOT.	BOTTOM	GYP.	GYPSPUM	PVC	POLYVINYL CHLORIDE
BRG.	BEARING				
BTWN.	BETWEEN				
B.U.R.	BUILT-UP ROOF(ING)	H.B.	HOSE BIBB	R.	RADIUS
		HBD.	HARDBOARD	R.	THERMAL
		H.C.	HOLLOW CORE		RESISTANCE
C&G	CURB AND GUTTER	HD.	HEAD	R.A.	RETURN AIR
CAB.	CABINET	H.D.	HEAVY DUTY	R.D.	ROOF DRAIN
C.B.	CARRIAGE BOLT	H.H.	HEAD	REFL.	REFLECTED
CEM.	CERAMIC	HOR.	HOR. HEADER	REFR.	REFRIGERATOR
CER.	CERAMIC	HOW.	HARDWARE	REFR.	REINFORCED
C.F.	CUBIC FOOT	HOWD.	HARDWOOD	REM.	REMOVE
C.F.	CAST IRON	H.M.	HOLLOW METAL	REQ.	REQUIRED
C.J.	CENTER LINE	H.M.D.	HOLLOW METAL DOOR	RESIL.	RESILIENT
C.L.	CHAIN LINK FENCE	H.M.F.	HOLLOW METAL FRAME	R.H.	RIGHT HAND
C.L.C.	CEILING			R.H.W.S.	RIGHT HAND WOOD SCREW
CLO.	CLOSET				
CLG.	CLEAR	HORIZ.	HORIZONTAL	RM.	ROOM
CLM.	CLASS ROOM	HOUR	HOUR	R.O.	ROUGH OPENING
CLM	CONCRETE MASONRY UNIT	HT.	HEIGHT	R.O.W.	RIGHT-WAY
		HVAC	HEATING/VENTIL.	RWL	RAIN-WATER LEADER

COL.	COUNTER	COLUMN	CONCRETE	ITONING HIGHWAY	S	SOLTH
CONN.	CONNECTION				S.A.	SUPPLY AIR
CONSTR.	CONSTRUCTION	ID.	INSIDE DIAMETER/		S.C.	SOLID CORE
CONTR.	CONTRIBUTOR		DIMENSION		SCH.	SCHEDULE
CNT.	CONTRACTOR	RFO	INFORMATION		S.D.	STORM DRAIN
CRC	CARPET	INSUL	INSULATION		SECT	SECTION
	COLD ROLLED CHANNEL	INT.	INTERIOR		8F	SECTION FEET/FOOT
CTR	CENTER				SHR	SHOWER
CTSK	COUNTERSUNK	JAN.	JANIT		SHTG.	SHEATHING
C.Y.	CUBIC YARD	JNT.	JOINT		SIMILAR	SIMILAR
					S.P.	SHEET METAL
D.A.	DISABLED ACCESS	KIT.	KITCHEN		S.O.G.	SLAB-ON-GRADE
DBL	DOUBLE	K.O.	KNOCK OUT		SPEC.	SPECIFICATION(S)
DEM.	DEMOLISH	K.O.P.	KNOCK OUT PANEL		SPKR	SPEAKER
	DEMOLITION				SQ.	SQUARE
D.F.	DRINKING FOUNTAIN	LAB.	LABORATORY		S.S.	STAINLESS STEEL
D.E.	OR DOUGLAS FIR	LAM.	LAMINATE		STA	STATION
DIAG.	DIAGONAL	LAV.	LAVATORY		STD.	SOUND TRANS-
DIA.	DIAMETER	(LB/S)	POUND (POUNDS)		STL.	STANDARD
DIM.	DIMENSION	L.B.	LAC BOOT		STR.	STORAGE
DISP.	DOWN	L.F.	LINEAL FOOT		STRUCT.	STRUCTURAL
DN.	DOWN	L.H.	LEFT HAND		SUSP.	SUSPENDED
DEEP	DOWN	L.B.	LIBRARY		S.W.	SIDE WALK
DS	DOWN SPOUT	LT.	LIGHT		SYM.	SYMMETRICAL
DWG(S)	DRAWING	LT.WT.	LIGHT WEIGHT			
DWR.	DRAWER				T.C.	TOP OF CONCRETE
		MACH.	MACHINE		TMP.	TEMPORARY
E	EAST	MAINT.	MAINTENANCE		TMPO	TEMPERED
EA.	EACH	MAX.	MAXIMUM		TNG	TONGUE AND
EGR.	EXHAUST FAN	M.B.	MACHINE BOIL		GROOVE	
		M.B.M.	METAL BUILDING		THD.	THREADED
E.E.	EXPANSION JOINT		MANUFACTURER		TK	THICK
EL.	ELEVATION	MECH.	MEDIUM		T.I.	TENANT
ELEC.	ELECTRIC(A)L	MED.	MEDIUM		TK BD.	TACK BOARD
ELEV.	ELEVATOR	MEMB.	MEMBRANE		T.O.P.	TOP OF STEEL
EMB.	EMBEDMENT	MEF.	METAL		T.O.P.	TOP OF PAVEMENT
EMER.	EMERGENCY	MFL.	MANIFOLD		T.S.	TUBE STEEL
ENCL.	EDGE NAILING	MKR.	MARKER		TEL	TELEPHONE
ENC.	ENCLOSURE	MIN.	MINIMUM		TFB	TELEPHONE TERMINAL
EQ.	EQUIPMENT	MISC.	MISCELLANEOUS		FBQ.	BACK BOARD
EQUIP.	EQUIPMENT	M.O.	MASONRY OPENING		TYP.	TYPICAL
EVAP.	EVAPORATIVE	MTD.	MOUNTED			UNDERGROUND
E.W.	EACH WAY	MTG.	MEETING		U.G.	UNDER
EXH.	EXHAUST	MULL.	MULLION		U.O.	UNLESS NOTED
EXIST.	EXISTING				UR	URN
EXP.	EXPANSION	N	NORTH			
EXT.	EXTERIOR	N.I.C.	NUMBER IN CONTRACT			
		NO.	NUMBER		VCT	VINYL COMPOSITION
		NOM.	NOMINAL		T	TYPE
		N.R.C.	NOISE REDUCTION		VERT.	VERTICAL
		COEFFICIENT			VENT	VENT TO ROOF
		N.T.S.	NOT TO SCALE		VVC	VINYL WALL

CODES AND ORGANIZATIONS

CBC	CALIFORNIA BUILDING CODE
CEC	CALIFORNIA ELECTRICAL CODE
CFC	CALIFORNIA FIRE CODE
CMC	CALIFORNIA MECHANICAL CODE
CPC	CALIFORNIA PLUMBING CODE
DSA	DIVISION OF THE STATE ARCHITECT
ICBO	INTERNATIONAL CONFERENCE OF BUILDING OFFICIALS
NSF	NATIONAL SANITATION FOUNDATION
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NEC	NATIONAL ELECTRICAL CODE

ABBREVIATIONS

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional

B	07/31/2024	DSA SUBMITTAL	
MARK	DATE	DESCRIPTION	
C	11/01/2024	DSA BACK/CHECK SUBMITTAL	



TETER, INC.

FRESNO HEADQUARTERS

ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR

DRAWING TITLE


LEGENDS AND ABBREVIATIONS

PROJECT NO.

23-12899

DRAWING

A000

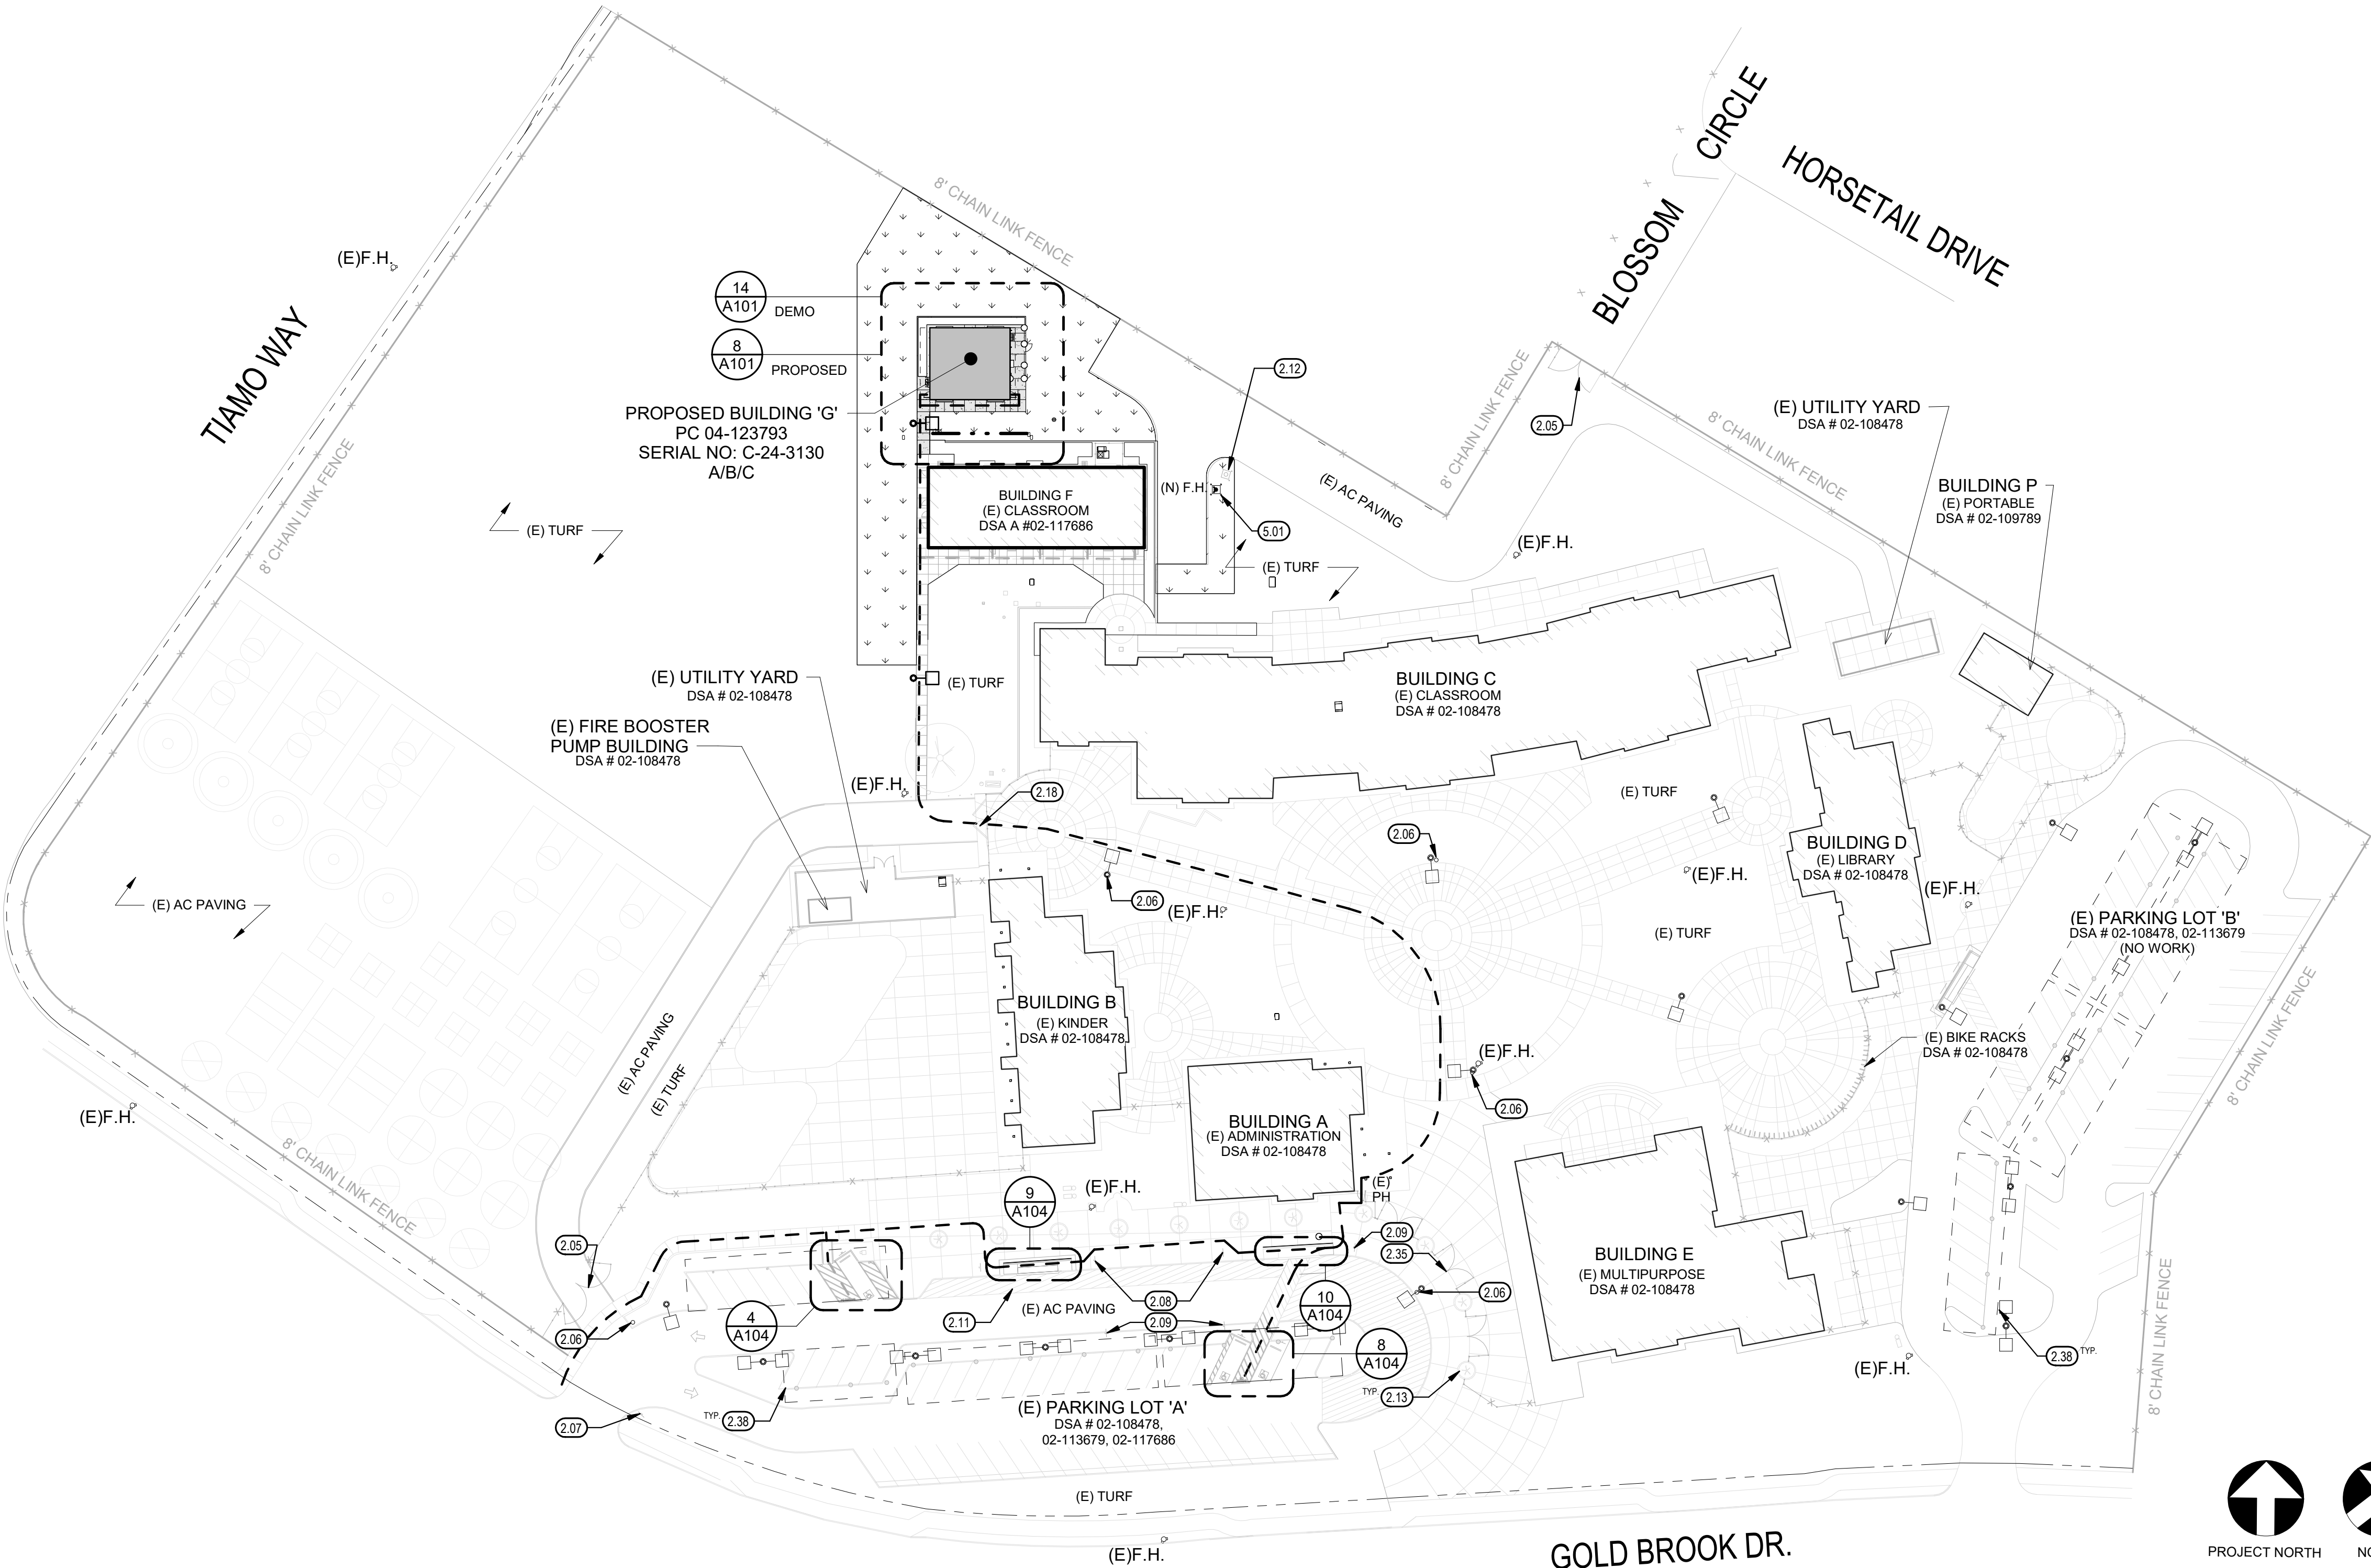

OVERALL SITE PLAN

EXISTING PARKING LOT 'A' SUMMARY DSA # 02-108478, 02-113679, 02-117686		
	QTY. STALLS	SOLAR COVERED STALLS
REGULAR STALLS	50	28
ACCESSIBLE STALLS	2	2
VAN ACCESSIBLE STALL	1	1
TOTAL	53	31

EXISTING PARKING LOT 'B' SUMMARY PER DSA A# 02-108478, 02-113679		
	QTY. STALLS	SOLAR COVERED STALLS
REGULAR STALLS	61	37
ACCESSIBLE STALLS	1	1
VAN ACCESSIBLE STALL	1	1
TOTAL	63	39

GENERAL NOTES

- A. REFER TO CIVIL, LANDSCAPE, ELECTRICAL, FIRE SPRINKLER, AND PRE MANUFACTURER MODULAR DRAWINGS FOR UTILITY INFORMATION. CONTRACTOR TO COORDINATE ALL TRADES TO MAINTAIN PROPER CLEARANCES & AVOID CONFLICTS.
- B. THE CONTRACTOR SHALL ACCEPT THE SITE IN ITS PRESENT CONDITION & DEMOLISH AND/OR REMOVE FROM THE AREA OF THE PROJECT SUBSURFACE, TREES, BRUSH, ROOTS, DEBRIS, ORGANIC MATTER, & ALL OTHER MATTER DETERMINED BY THE INSPECTOR TO BE DELETERIOUS. SUCH MATERIAL SHALL BE REMOVED FROM THE SITE BY THE CONTRACTOR.
- C. PROTECT EXISTING TURF, PLANT & TREES TO REMAIN. THE CONTRACTOR IS RESPONSIBLE TO REPLACE ANY EXISTING TURF, PLANT MATERIALS OR TREES THAT ARE TO REMAIN AND BE PROTECTED AND SHALL INCLUDE BUT NOT BE LIMITED TO: EXISTING TURF, PLANT MATERIAL OR TREES THAT ARE DAMAGED DUE TO CONSTRUCTION ACTIVITIES, VEHICLE DAMAGE, AND STRESS DUE TO LACK OF WATER OR OTHER DETERIORATION. THE EXISTING AREAS TO REMAIN ARE TO BE RESTORED BY THE CONTRACTOR TO THE EXISTING CONDITION PRIOR TO THE PROJECT AT NO ADDITIONAL COST TO THE DISTRICT. THIS INCLUDES DAMAGE THAT MAY OCCUR AT ANY AREA OF THE CAMPUS DUE TO CONSTRUCTION RELATED ACTIVITIES ASSOCIATED WITH THIS CONTRACT.
- D. PROPERTY DIMENSIONS AS SHOWN ARE BASED ON RECORD INFO. & SHOULD BE FIELD VERIFIED BY A PROPERTY SURVEY PRIOR TO CONSTRUCTION.
- E. WORK SHALL COMPLY WITH THE PROVISIONS OF CHAPTER 33 OF CBC AND CFC, "FIRE SAFETY DURING CONSTRUCTIONS AND DEMOLITION"

KEYNOTES

- 2.05 EXISTING PAIR OF 12'-0" WIDE CHAIN LINK FIRE ACCESS GATES
- 2.06 EXISTING POLE MOUNTED LIGHT FIXTURE TO REMAIN
- 2.07 EXISTING 'ENTRY WARNING / TOW AWAY' SIGN TO REMAIN (A# 02-108478)
- 2.08 EXISTING 'LOADING ZONE ONLY' SIGN TO REMAIN (A# 02-108478)
- 2.09 EXISTING 'FIRE LANE - NO PARKING' SIGN TO REMAIN (A# 02-108478)
- 2.11 EXISTING PASSENGER LOADING ZONE TO REMAIN
- 2.12 EXISTING FIRE DEPARTMENT CONNECTION TO REMAIN
- 2.13 EXISTING TREE WELL TO REMAIN
- 2.18 EXISTING PAIR OF 12'-0" WIDE DECORATIVE METAL GATES TO REMAIN (GATES TO REMAIN OPEN DURING SCHOOL HOURS - NO LOCKS ON GATE)
- 2.35 EXISTING PAIR OF 10'-0" WIDE DECORATIVE METAL FIRE ACCESS GATES
- 2.38 SOLAR CANOPY PER DSA A# 02 - 113679
- 5.01 BOLLARDS AT NEW FIRE HYDRANT, SEE CIVIL AND 4/A111

LEGEND

- EXISTING BUILDING
NO SCOPE OF WORK UNDER THIS PROJECT
- EXISTING CONCRETE
NO SCOPE OF WORK UNDER THIS PROJECT
- PROPOSED MODULAR BUILDING
MODULAR BUILDING UNDER THIS SCOPE OF WORK, SEE MFR DWGS.
- PROPOSED CONCRETE PAVING.
SEE CIVIL FOR GRADING, FOR CONSTRUCTION, ISOLATION, CONTRACTION JOINTS
- PROPOSED TURF AREA
SEE LANDSCAPE DRAWINGS (TREES AND PLANTING NOT SHOWN FOR CLARITY)

SITE INFORMATION

- (E) FIRE HYDRANT
- PROPOSED FIRE HYDRANT, SEE CIVIL
- PROPERTY LINE
- EXISTING CHAIN LINK FENCING, TYP
- ACCESSIBLE ROUTE (2022 C.B.C. SECTION 11B-206)

THE ACCESSIBLE ROUTE IS A CONTINUOUS UNOBSTRUCTED PATH CONNECTING ACCESSIBLE ELEMENTS AND SPACES OF AN ACCESSIBLE SITE, BUILDING OR FACILITY THAT CAN BE NEGOTIATED BY A PERSON WITH A DISABILITY USING A WHEELCHAIR, AND THAT IS ALSO SAFE FOR AND USABLE BY PERSONS WITH OTHER DISABILITIES. ACCESSIBLE ROUTES SHALL COMPLY WITH CBC 11B-402. IN GENERAL, EXTERIOR ACCESSIBLE ROUTES SHALL COMPLY WITH THE FOLLOWING: SHALL BE STABLE, FIRM, AND SLIP RESISTANT; HAVE A 1:20 MAXIMUM RUNNING SLOPE FOR WALKS; HAVE A 1:12 MAXIMUM SLOPE FOR RAMPS AND CURB RAMPS; HAVE A 1/4:12 MAXIMUM CROSS SLOPE; HAVE A 48" MINIMUM WIDTH; HAVE NO VERTICAL OFFSETS GREATER THAN 1/4"; OFFSETS BETWEEN 1/4" AND 1/2" SHALL BE BEVELED WITH A SLOPE NOT EXCEEDING 1V:2H; HAVE NO OPENINGS ALLOWING THE PASSAGE OF A 1/2" DIAMETER SPHERE; ELONGATED OPENINGS SHALL BE PERPENDICULAR TO THE DIRECTION OF TRAVEL; HAVE A MINIMUM 6" HIGH CURB OR GUARDRAIL AT EDGES WHERE THE DROP OFF EXCEEDS 4" EXCEPT WHERE ADJACENT TO VEHICULAR WAYS; BE FREE OF ELEMENTS PROJECTING MORE THAN 4" FROM WALLS BETWEEN 27" AND 80" ABOVE THE WALKING SURFACE; AND HAVE 80" MINIMUM VERTICAL CLEARANCE.

DESIGN PROFESSIONAL IN CHARGE STATEMENT:

- THE P.O.T. IDENTIFIED IN THESE CONSTRUCTION DOCUMENTS MEETS THE REQUIREMENTS OF THE CURRENT APPLICABLE CALIFORNIA BUILDING CODE (CBC) ACCESSIBILITY PROVISIONS FOR PATH OF TRAVEL REQUIREMENTS FOR ALTERATIONS, ADDITIONS AND STRUCTURAL REPAIRS.
- AS PART OF THE DESIGN OF THIS PROJECT, THE P.O.T. WAS EXAMINED AND ANY ELEMENTS, COMPONENTS, OR PORTIONS OF THE P.O.T. THAT WERE DETERMINED TO BE NONCOMPLIANT WITH THE CBC HAVE BEEN IDENTIFIED AND THE CORRECTIVE WORK NECESSARY TO BRING THEM INTO COMPLIANCE HAS BEEN INCLUDED WITHIN THE SCOPE OF THIS PROJECT'S WORK THROUGH DETAILS, DRAWINGS, AND SPECIFICATIONS INCORPORATED INTO THESE CONSTRUCTION DOCUMENTS.
- ANY NONCOMPLIANT ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WILL NOT BE CORRECTED BY THIS PROJECT BASED ON VALUATION THRESHOLD LIMITATIONS OR A FINDING OF UNREASONABLE HARDSHIP ARE INDICATED IN THESE CONSTRUCTION DOCUMENTS.
- DURING CONSTRUCTION, IF P.O.T. ITEMS WITHIN THE SCOPE OF THE PROJECT REPRESENTED AS CBC COMPLIANT ARE FOUND TO BE NONCONFORMING BEYOND REASONABLE CONSTRUCTION TOLERANCES, THEY ITEMS SHALL BE BROUGHT INTO COMPLIANCE WITH THE CBC AS A PART OF THIS PROJECT BY MEANS OF A CONSTRUCTION CHANGE DOCUMENT.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.

FRESNO HEADQUARTERS

VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO

ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA

DRAWING TITLE
OVERALL SITE PLAN

PROJECT NO.



23-12899

DRAWING

A100

\\net-file1\Users\dylian.seaton_TETR\Documents\12899-A-STOCKTON PEYTON ELEM ELOP.dylan.seatonFLU7Z.rvt

1/8" = 1/4" = 1/2" = 1" = 2"

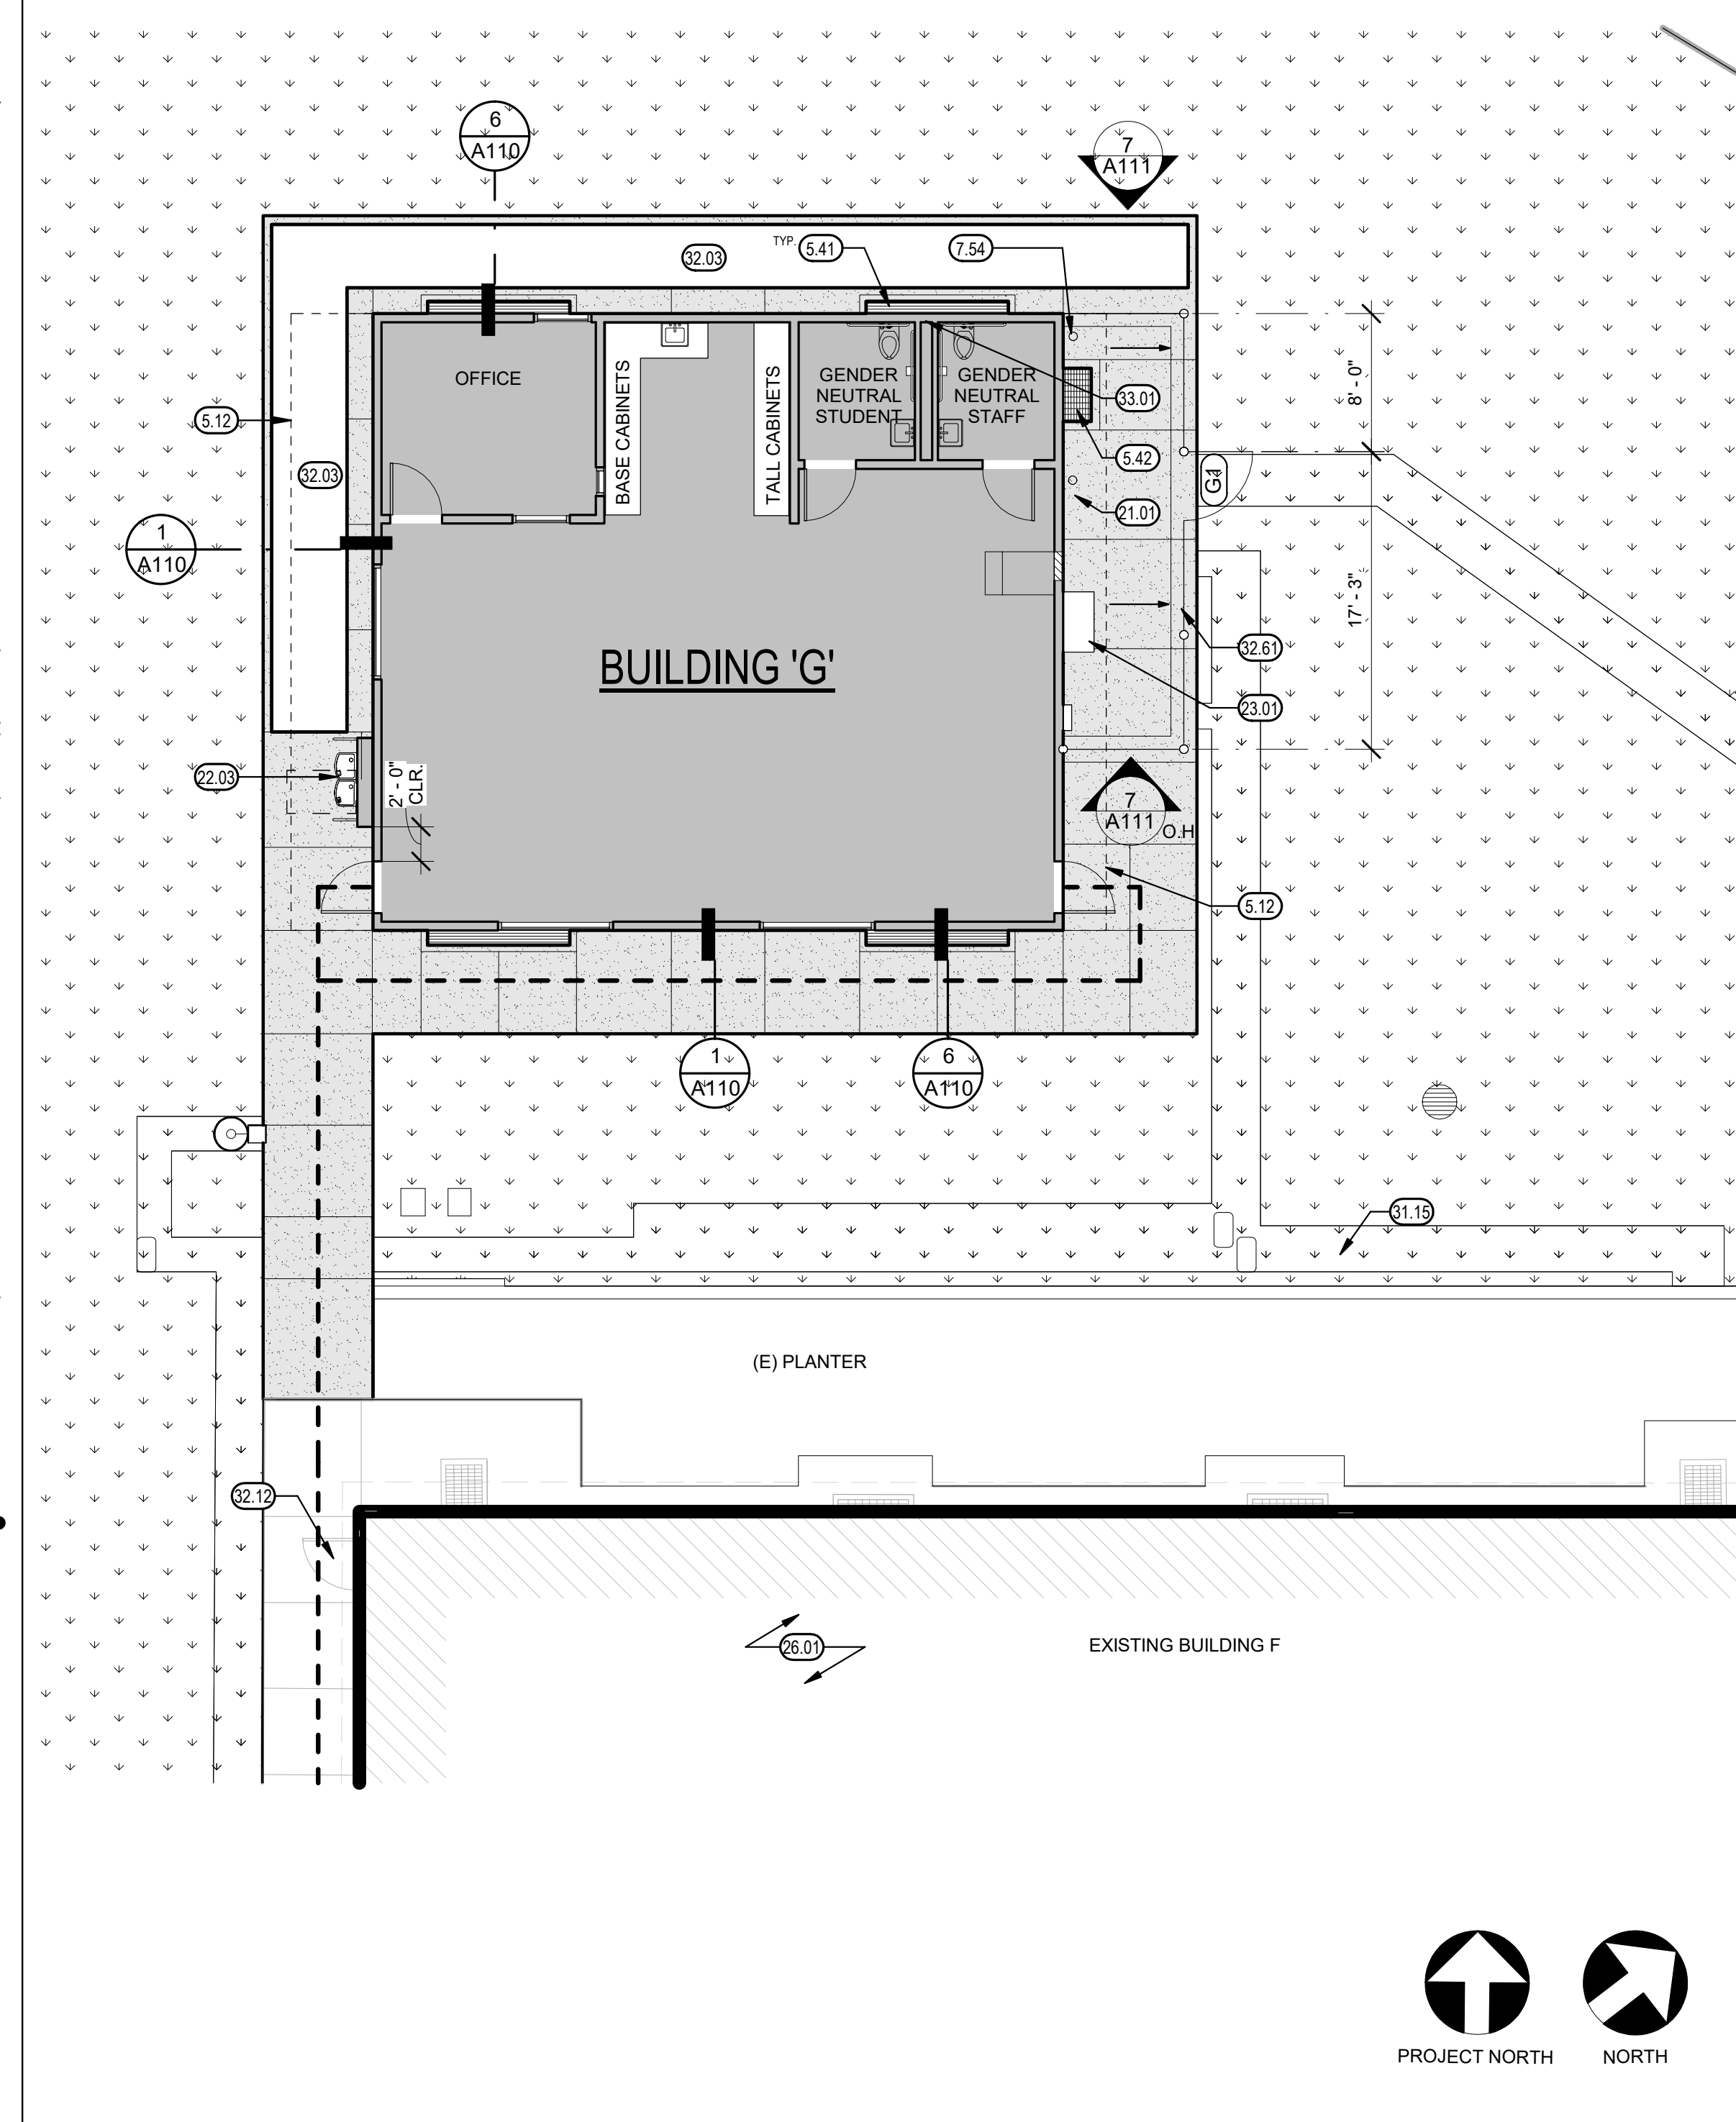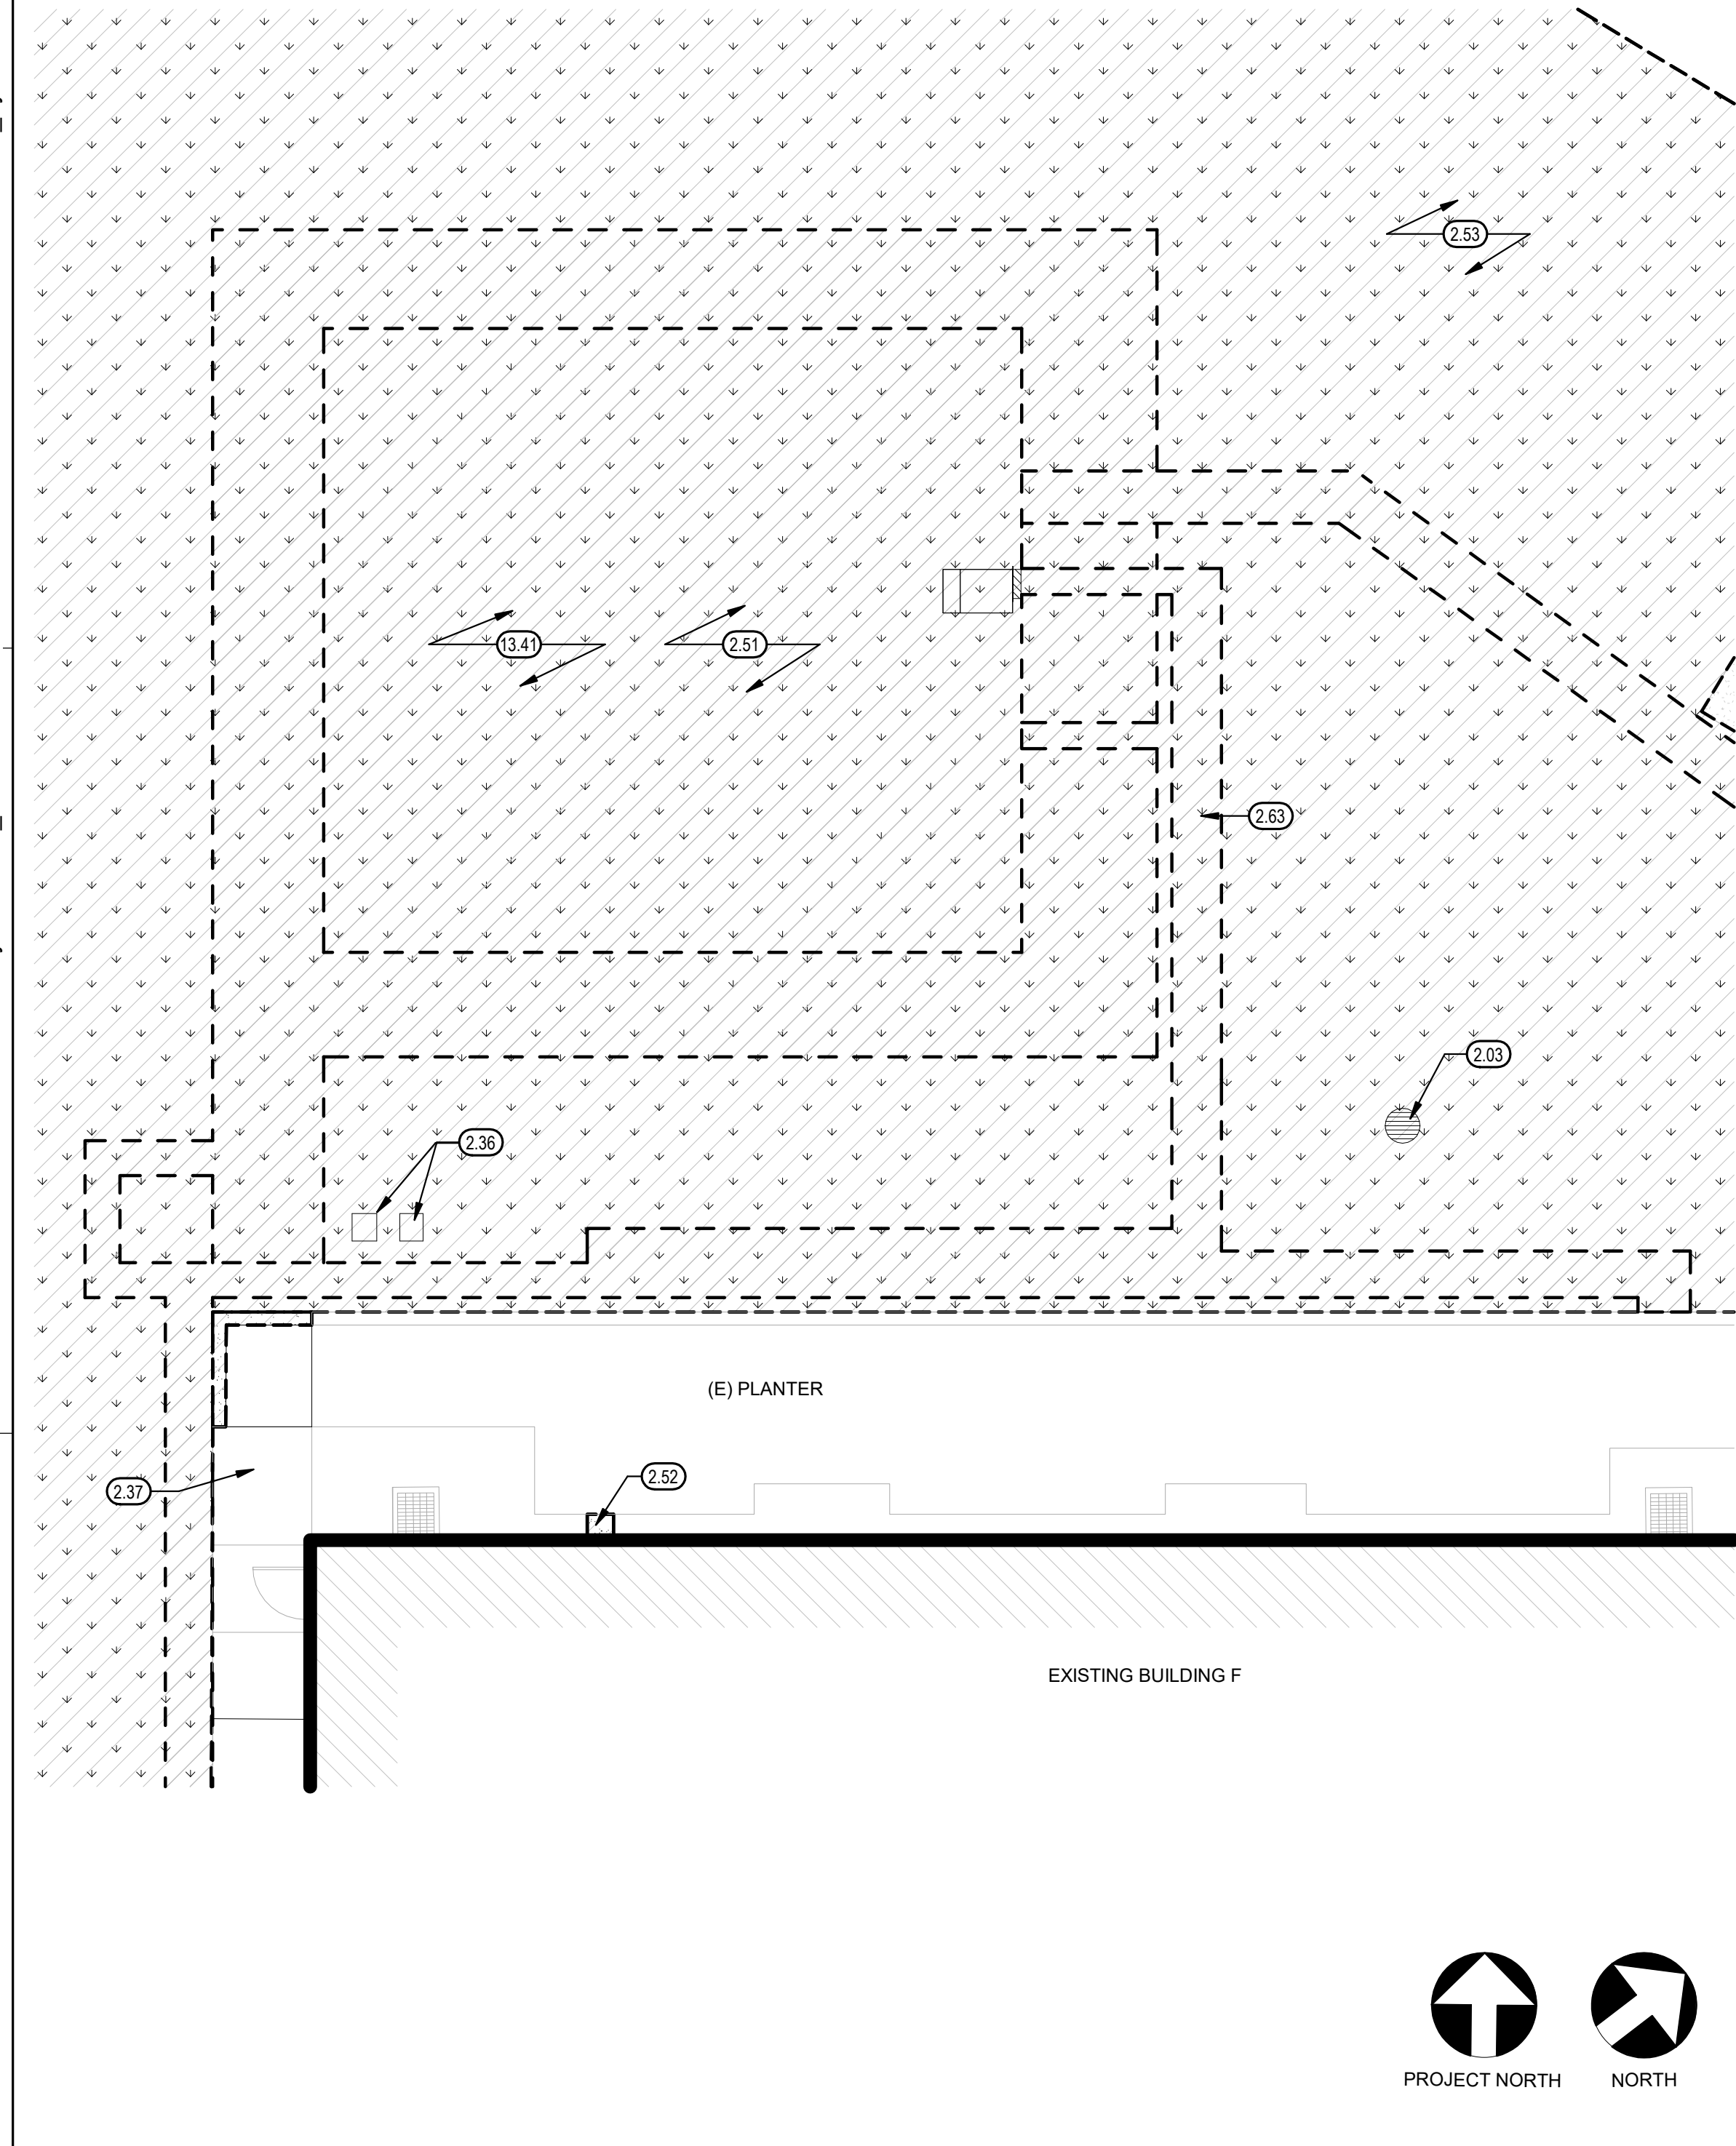

- ### KEYNOTES
- 2.03 EXISTING STORM DRAIN OUTLET TO REMAIN
 - 2.36 EXISTING IRRIGATION CONTROL VALVES, SEE LANDSCAPE
 - 2.37 EXISTING CONCRETE WALK TO REMAIN
 - 2.51 REMOVE EXISTING LANDSCAPE AND IRRIGATION FOR NEW RELOCATABLE CLASSROOM BUILDING AND SITE PAVING. SEE CIVIL AND LANDSCAPE DRAWINGS
 - 2.52 REMOVE EXISTING CONCRETE PAVEMENT FOR THE INSTALLATION OF CONDUIT ELECTRICAL LINES. REMOVE AT NEAREST JOINT LINES
 - 2.53 FOR LIMITS OF DEMOLITION, SEE LANDSCAPE, CIVIL AND ELECTRICAL DRAWINGS
 - 2.63 REMOVE EXISTING TURF AND DISPOSE OF OFF-SITE. SCARIFY TOP 6" OF EXISTING SOIL AND RECOMPACT TO 90% RELATIVE COMPACTION. SEE LANDSCAPE.
 - 5.12 LINE OF ROOF OVERHANG, SEE NEW RELOCATABLE CLASSROOM BUILDING DRAWINGS
 - 5.41 STEEL GRATE FOR BELOW FLOOR VENTILATION, SEE DETAIL 6 / A110
 - 5.42 STEEL GRATE FOR BELOW FLOOR ACCESS, SEE DETAIL 6 / A110
 - 7.54 SHEET METAL DOWNSPOUT (SPILL AT GRADE), SEE NEW RELOCATABLE CLASSROOM BUILDING DRAWINGS
 - 13.41 PROPOSED LOCATION OF BUILDING
 - 21.01 FIRE SPRINKLER RISER, SEE CIVIL AND FIRE SPRINKLER DRAWINGS
 - 22.03 HIGH-LOW WALL MOUNTED DRINKING FOUNTAIN WITH BOTTLE FILLER, SEE CIVIL, AND 1 / A802
 - 23.01 HVAC UNIT, SEE NEW RELOCATABLE CLASSROOM BUILDING DRAWINGS
 - 26.01 SEE ELECTRICAL FOR CONNECTIONS TO FIRE ALARM AND POWER
 - 31.15 INFILL TRENCH AND PROVIDE NEW SOD AS REQUIRED, SEE LANDSCAPE
 - 32.03 DECOMPOSED GRANITE, SEE LANDSCAPE
 - 32.12 PATCH CONCRETE PAVING TO MATCH EXISTING, SEE CIVIL
 - 32.61 CHAIN LINK FENCING, SEE DETAIL 5 / A111
 - 33.01 UTILITIES POINT OF CONNECTION, SEE CIVIL DRAWINGS 2 / A110

- ### LEGEND
- EXISTING BUILDING**
NO SCOPE OF WORK UNDER THIS PROJECT UNLESS NOTED OTHERWISE
 - PROPOSED MODULAR BUILDING**
MODULAR BUILDING UNDER THIS SCOPE OF WORK. SEE MFR DWGS.
 - PROPOSED CONCRETE PAVING**
SEE CIVIL FOR GRADING. FOR CONSTRUCTION, ISOLATION, CONTRACTION JOINTS
 - EXISTING CONCRETE**
NO SCOPE OF WORK UNDER THIS PROJECT
 - DEMOLITION OF TURF AREA**
SEE LANDSCAPE DRAWINGS (TREES AND PLANTING NOT SHOWN FOR CLARITY)
 - PROPOSED TURF AREA**
SEE LANDSCAPE DRAWINGS (TREES AND PLANTING NOT SHOWN FOR CLARITY)
 - DEMOLITION OF ASPHALT AREA**
SEE CIVIL DRAWINGS
 - PROPOSED ASPHALT AREA**
SEE CIVIL DRAWINGS

- ### SITE INFORMATION
- NEW 6'-0" CHAIN LINK FENCE/GATE, SEE DETAIL 5 / A111
 - ACCESSIBLE ROUTE (2022 C.B.C. SECTION 11B-206)

GATE SCHEDULE							
MARK	CLEAR WIDTH	HEIGHT	MATERIAL	FINISH	HARDWARE GROUP	DETAIL	REMARKS
(G1)	4'-0"	6'-0"	CHAIN LINK	GALV	04	10 / A111	A

REMARKS:

A. MAINTENANCE SERVICE GATE

ABBREVIATION:

GALV = GALVANIZED

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED





ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
DEMOLITION AND PROPOSED
PARTIAL SITE PLANS

PROJECT NO.
23-12899
DRAWING
A101

PLOT DATE: 11/1/2024 12:11:23 PM

\\tetr-file1\Users\dylian.seaton_TETR\Documents\12899-A-STOCKTON PEYTON ELEM ELOP.dylan.seatonFLU7Z.rvt

PLOT DATE: 11/1/2024 12:11:25 PM

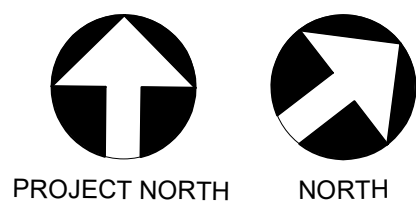
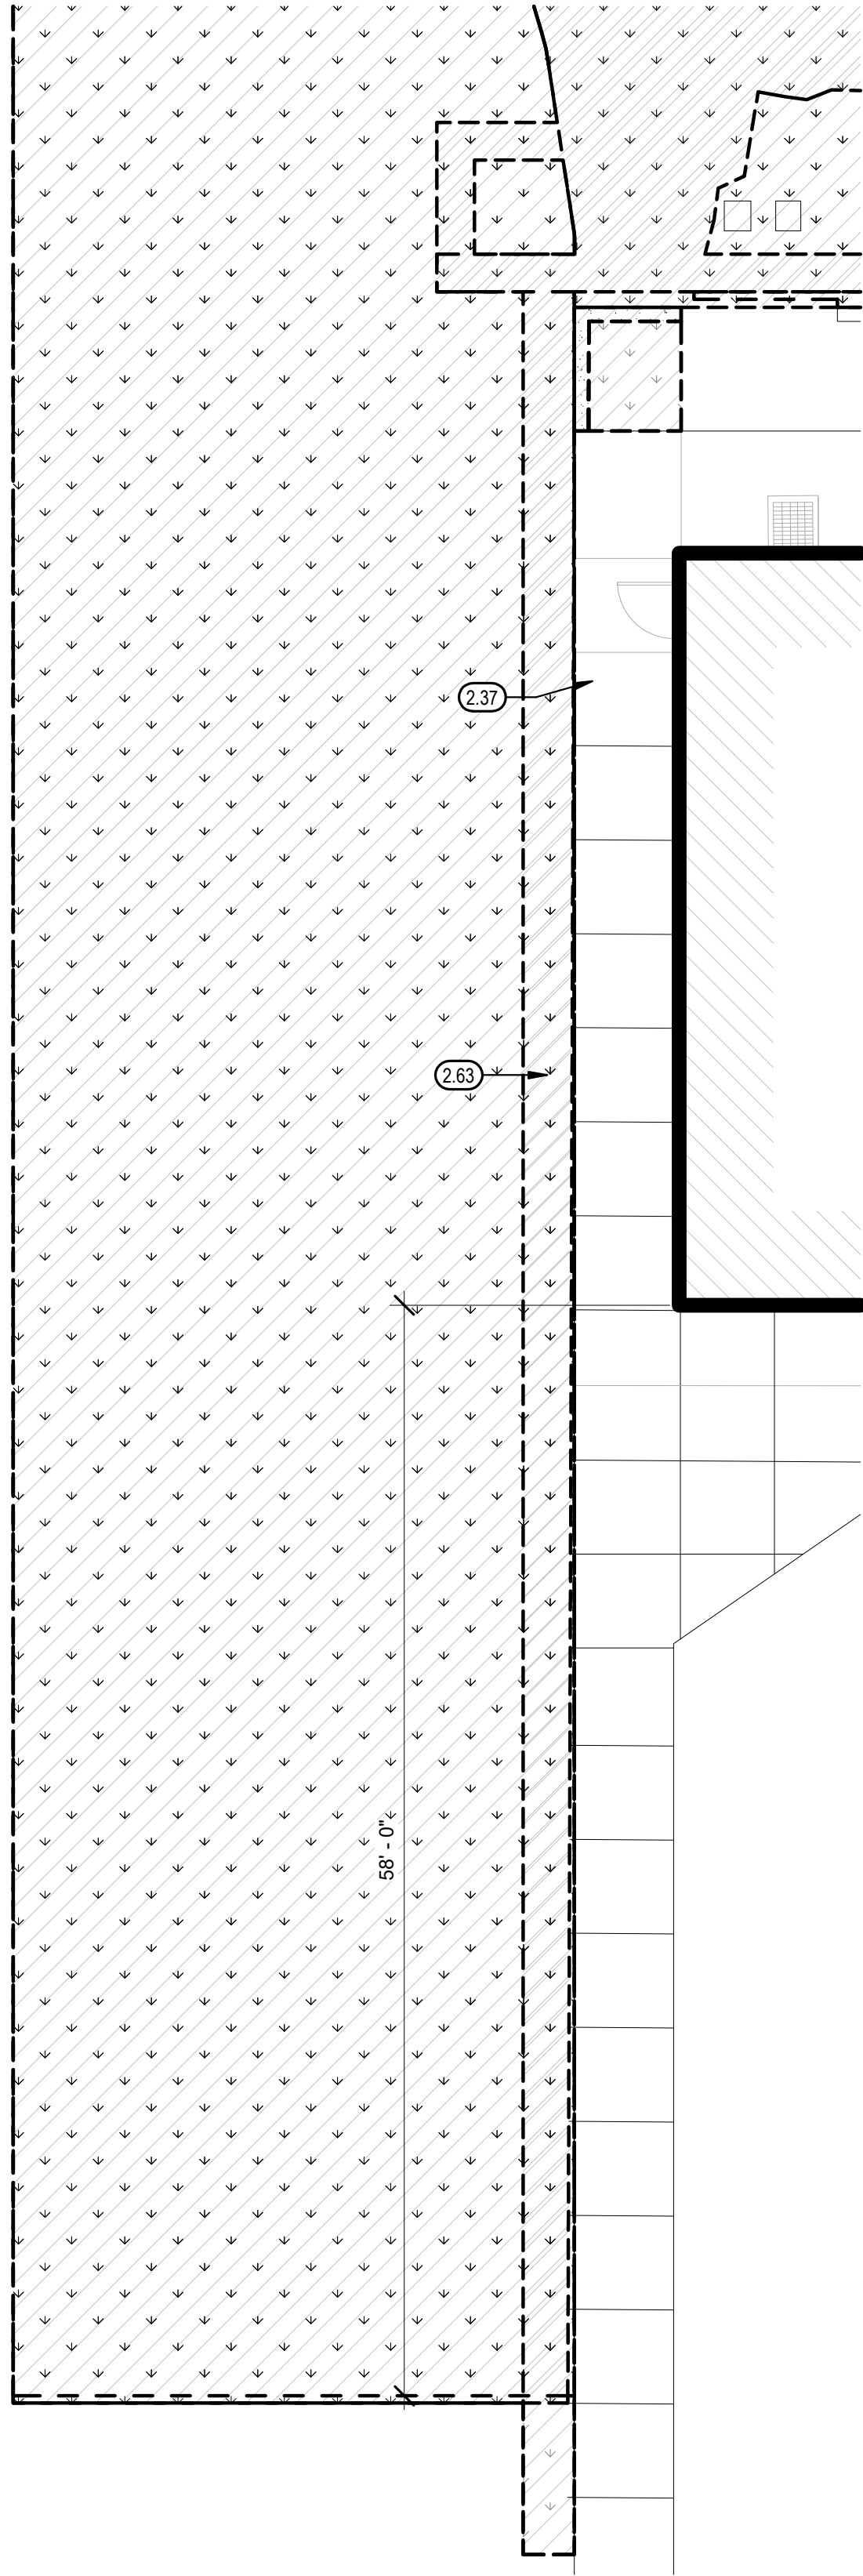


1/8" = 1'-0"

9

DEMOLITION NOTES

- REFER TO CIVIL, LANDSCAPE, ELECTRICAL AND RELOCATABLE DRAWINGS FOR UTILITY INFORMATION. CONTRACTOR TO COORDINATE ALL TRADES TO MAINTAIN PROPER CLEARANCES & AVOID CONFLICTS.
- THE CONTRACTOR SHALL ACCEPT THE SITE IN ITS PRESENT CONDITION AND DEMOLISH AND/OR REMOVE FROM THE AREA OF THE PROJECT SURFACE, TREES, BRUSH, ROOTS, DEBRIS, ORGANIC MATTER AND ALL OTHER MATTER DETERMINED BY THE INSPECTOR TO BE DELETERIOUS. SUCH MATERIAL SHALL BE REMOVED BY THE SITE CONTRACTOR.
- SITE CONTRACTOR IS RESPONSIBLE FOR THE EXCAVATION AND REMOVAL OF SOIL. EXCAVATION SHALL BE ADEQUATELY SHORED, BRACED & SHEETED SO THAT THE EARTH WILL NOT SETTLE OR SLIDE AND SO THAT ALL EXISTING IMPROVEMENTS OF ANY KIND WILL BE FULLY PROTECTED FROM DAMAGE.

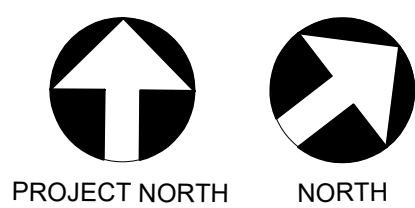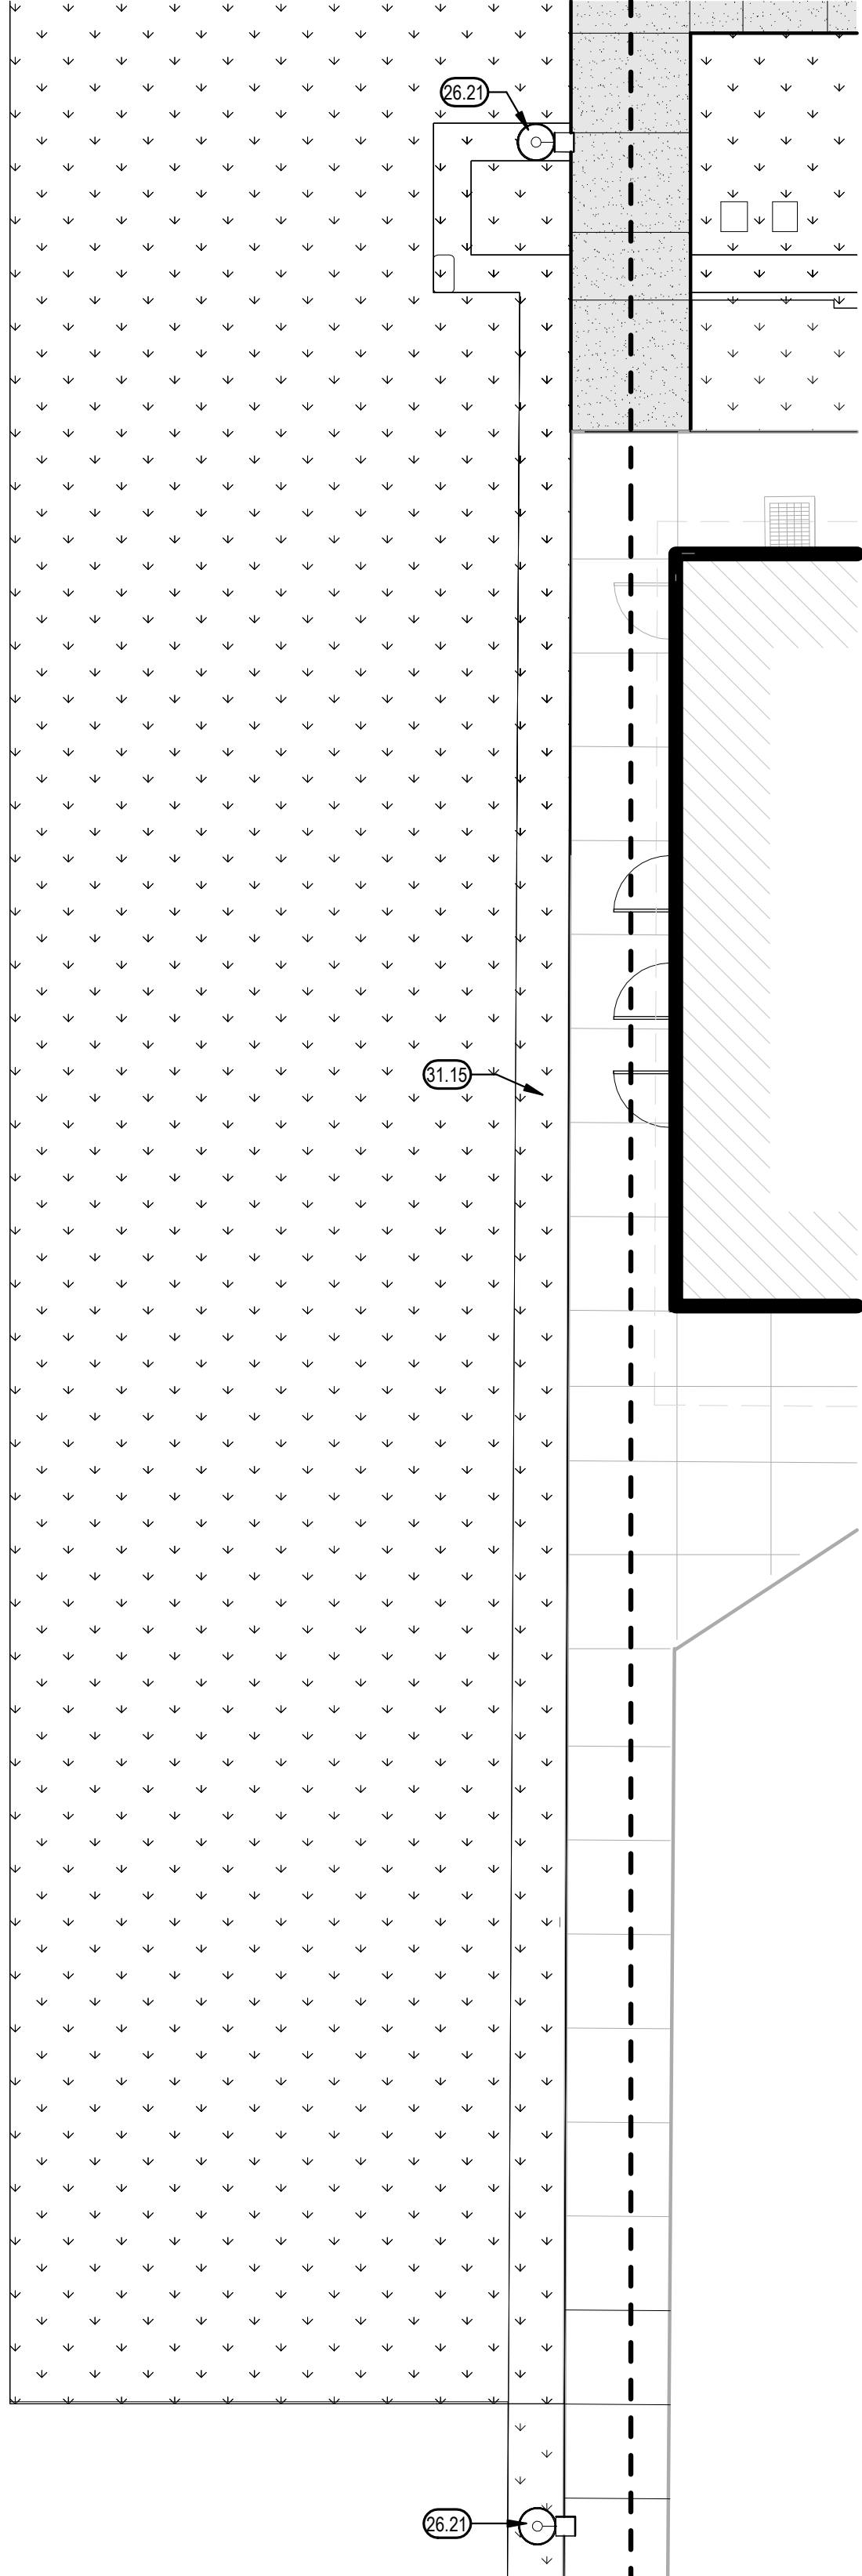

1/8" = 1'-0"

3

SITE PLAN NOTES

- ALL UTILITY TRANSITIONS SHALL BE CONCEALED WITHIN IN THE WALL CAVITIES AND SHALL TRANSITION BELOW GRADE TO POINT OF CONNECTION BELOW THE BUILDING.
- SEE CIVIL, LANDSCAPE, ELECTRICAL AND RELOCATABLE DRAWINGS FOR ADDITIONAL INFORMATION NOT NOTED ON ARCHITECTURAL DRAWINGS.
- EXTERIOR CONCRETE LANDING AT DOORS SHALL NOT BE MORE THAN 1/2 INCH LOWER THAN THE TOP OF THE DOORWAY THRESHOLD. LANDING SHALL SLOPE 1/4 INCH PER FOOT MAX.

KEYNOTES

- EXISTING CONCRETE WALK TO REMAIN
- REMOVE EXISTING TURF AND DISPOSE OF OFF-SITE. SCARIFY TOP 6" OF EXISTING SOIL AND RECOMPACT TO 90% RELATIVE COMPACTION. SEE LANDSCAPE.
- POLE MOUNTED LIGHT FIXTURE, SEE ELECTRICAL
- INFILL TRENCH AND PROVIDE NEW SOD AS REQUIRED, SEE LANDSCAPE

LEGEND

- EXISTING BUILDING**
NO SCOPE OF WORK UNDER THIS PROJECT UNLESS NOTED OTHERWISE
- PROPOSED MODULAR BUILDING**
MODULAR BUILDING UNDER THIS SCOPE OF WORK, SEE MFR DWGS.
- PROPOSED CONCRETE PAVING**
SEE CIVIL FOR GRADING, FOR CONSTRUCTION, ISOLATION, CONTRACTION JOINTS
- EXISTING CONCRETE**
NO SCOPE OF WORK UNDER THIS PROJECT
- DEMOLITION OF TURF AREA**
SEE LANDSCAPE DRAWINGS
(TREES AND PLANTING NOT SHOWN FOR CLARITY)
- PROPOSED TURF AREA**
SEE LANDSCAPE DRAWINGS
(TREES AND PLANTING NOT SHOWN FOR CLARITY)
- DEMOLITION OF ASPHALT AREA**
SEE CIVIL DRAWINGS
- PROPOSED ASPHALT AREA**
SEE CIVIL DRAWINGS

SITE INFORMATION

- NEW 6'-0" H CHAIN LINK FENCE/GATE
- ACCESSIBLE ROUTE
(2022 C.B.C. SECTION 11B-206)

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024


Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.

FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

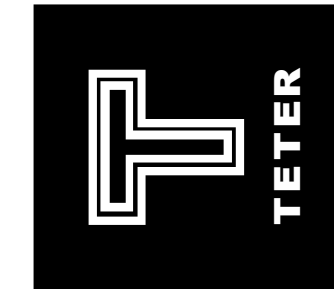

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA

DRAWING TITLE
DEMOLITION AND PROPOSED
PARTIAL TRENCHING SITE PLANS

PROJECT NO.


23-12899

DRAWING

A102

\\tetr-file1\Users\dylan.seaton_TETR\Documents\12899-A-STOCKTON PEYTON ELEM ELOP.dylan.seatonFLU7Z.rvt


PLOT DATE: 11/1/2024 12:11:26 PM

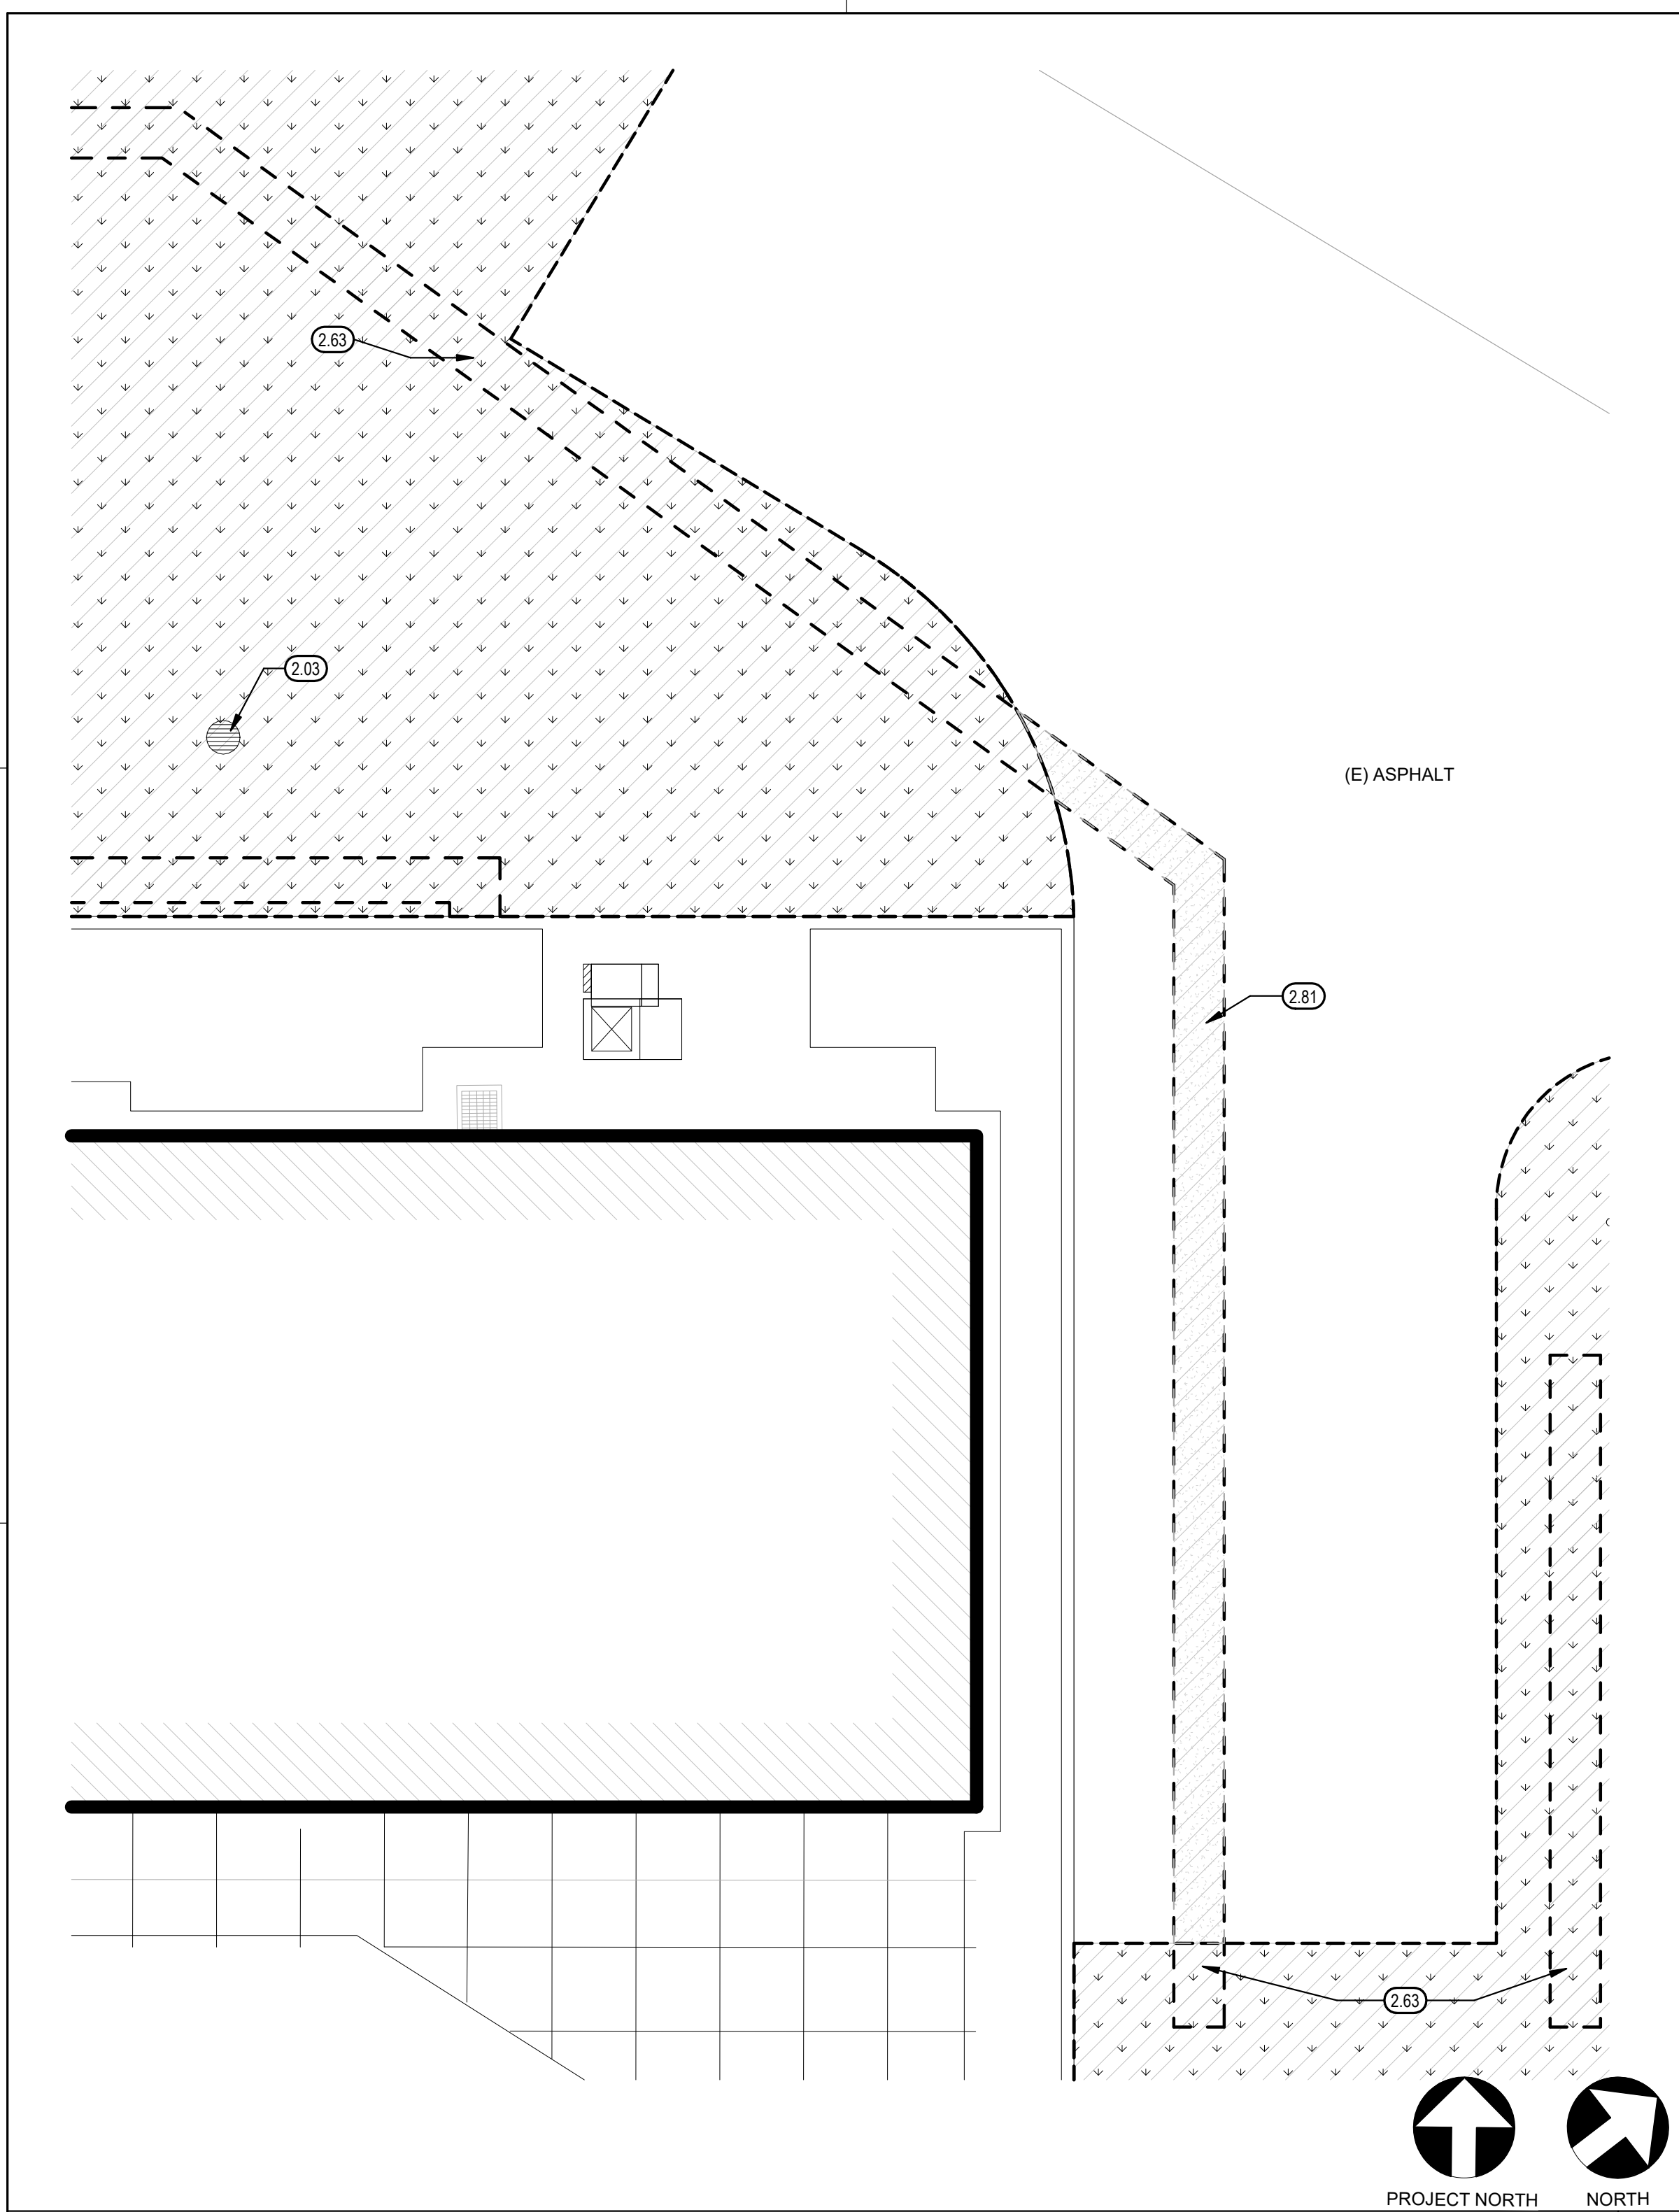

DEMOLITION PARTIAL SITE PLAN 1/8" = 1'-0" 9

DEMOLITION NOTES

- REFER TO CIVIL, LANDSCAPE, ELECTRICAL AND RELOCATABLE DRAWINGS FOR UTILITY INFORMATION. CONTRACTOR TO COORDINATE ALL TRADES TO MAINTAIN PROPER CLEARANCES & AVOID CONFLICTS.
- THE CONTRACTOR SHALL ACCEPT THE SITE IN ITS PRESENT CONDITION AND DEMOLISH AND/OR REMOVE FROM THE AREA OF THE PROJECT SURFACE, TREES, BRUSH, ROOTS, DEBRIS, ORGANIC MATTER AND ALL OTHER MATTER DETERMINED BY THE INSPECTOR TO BE DELETERIOUS. SUCH MATERIAL SHALL BE REMOVED BY THE SITE CONTRACTOR.
- SITE CONTRACTOR IS RESPONSIBLE FOR THE EXCAVATION AND REMOVAL OF SOIL. EXCAVATION SHALL BE ADEQUATELY SHORED, BRACED & SHEETED SO THAT THE EARTH WILL NOT SETTLE OR SLIDE AND SO THAT ALL EXISTING IMPROVEMENTS OF ANY KIND WILL BE FULLY PROTECTED FROM DAMAGE.

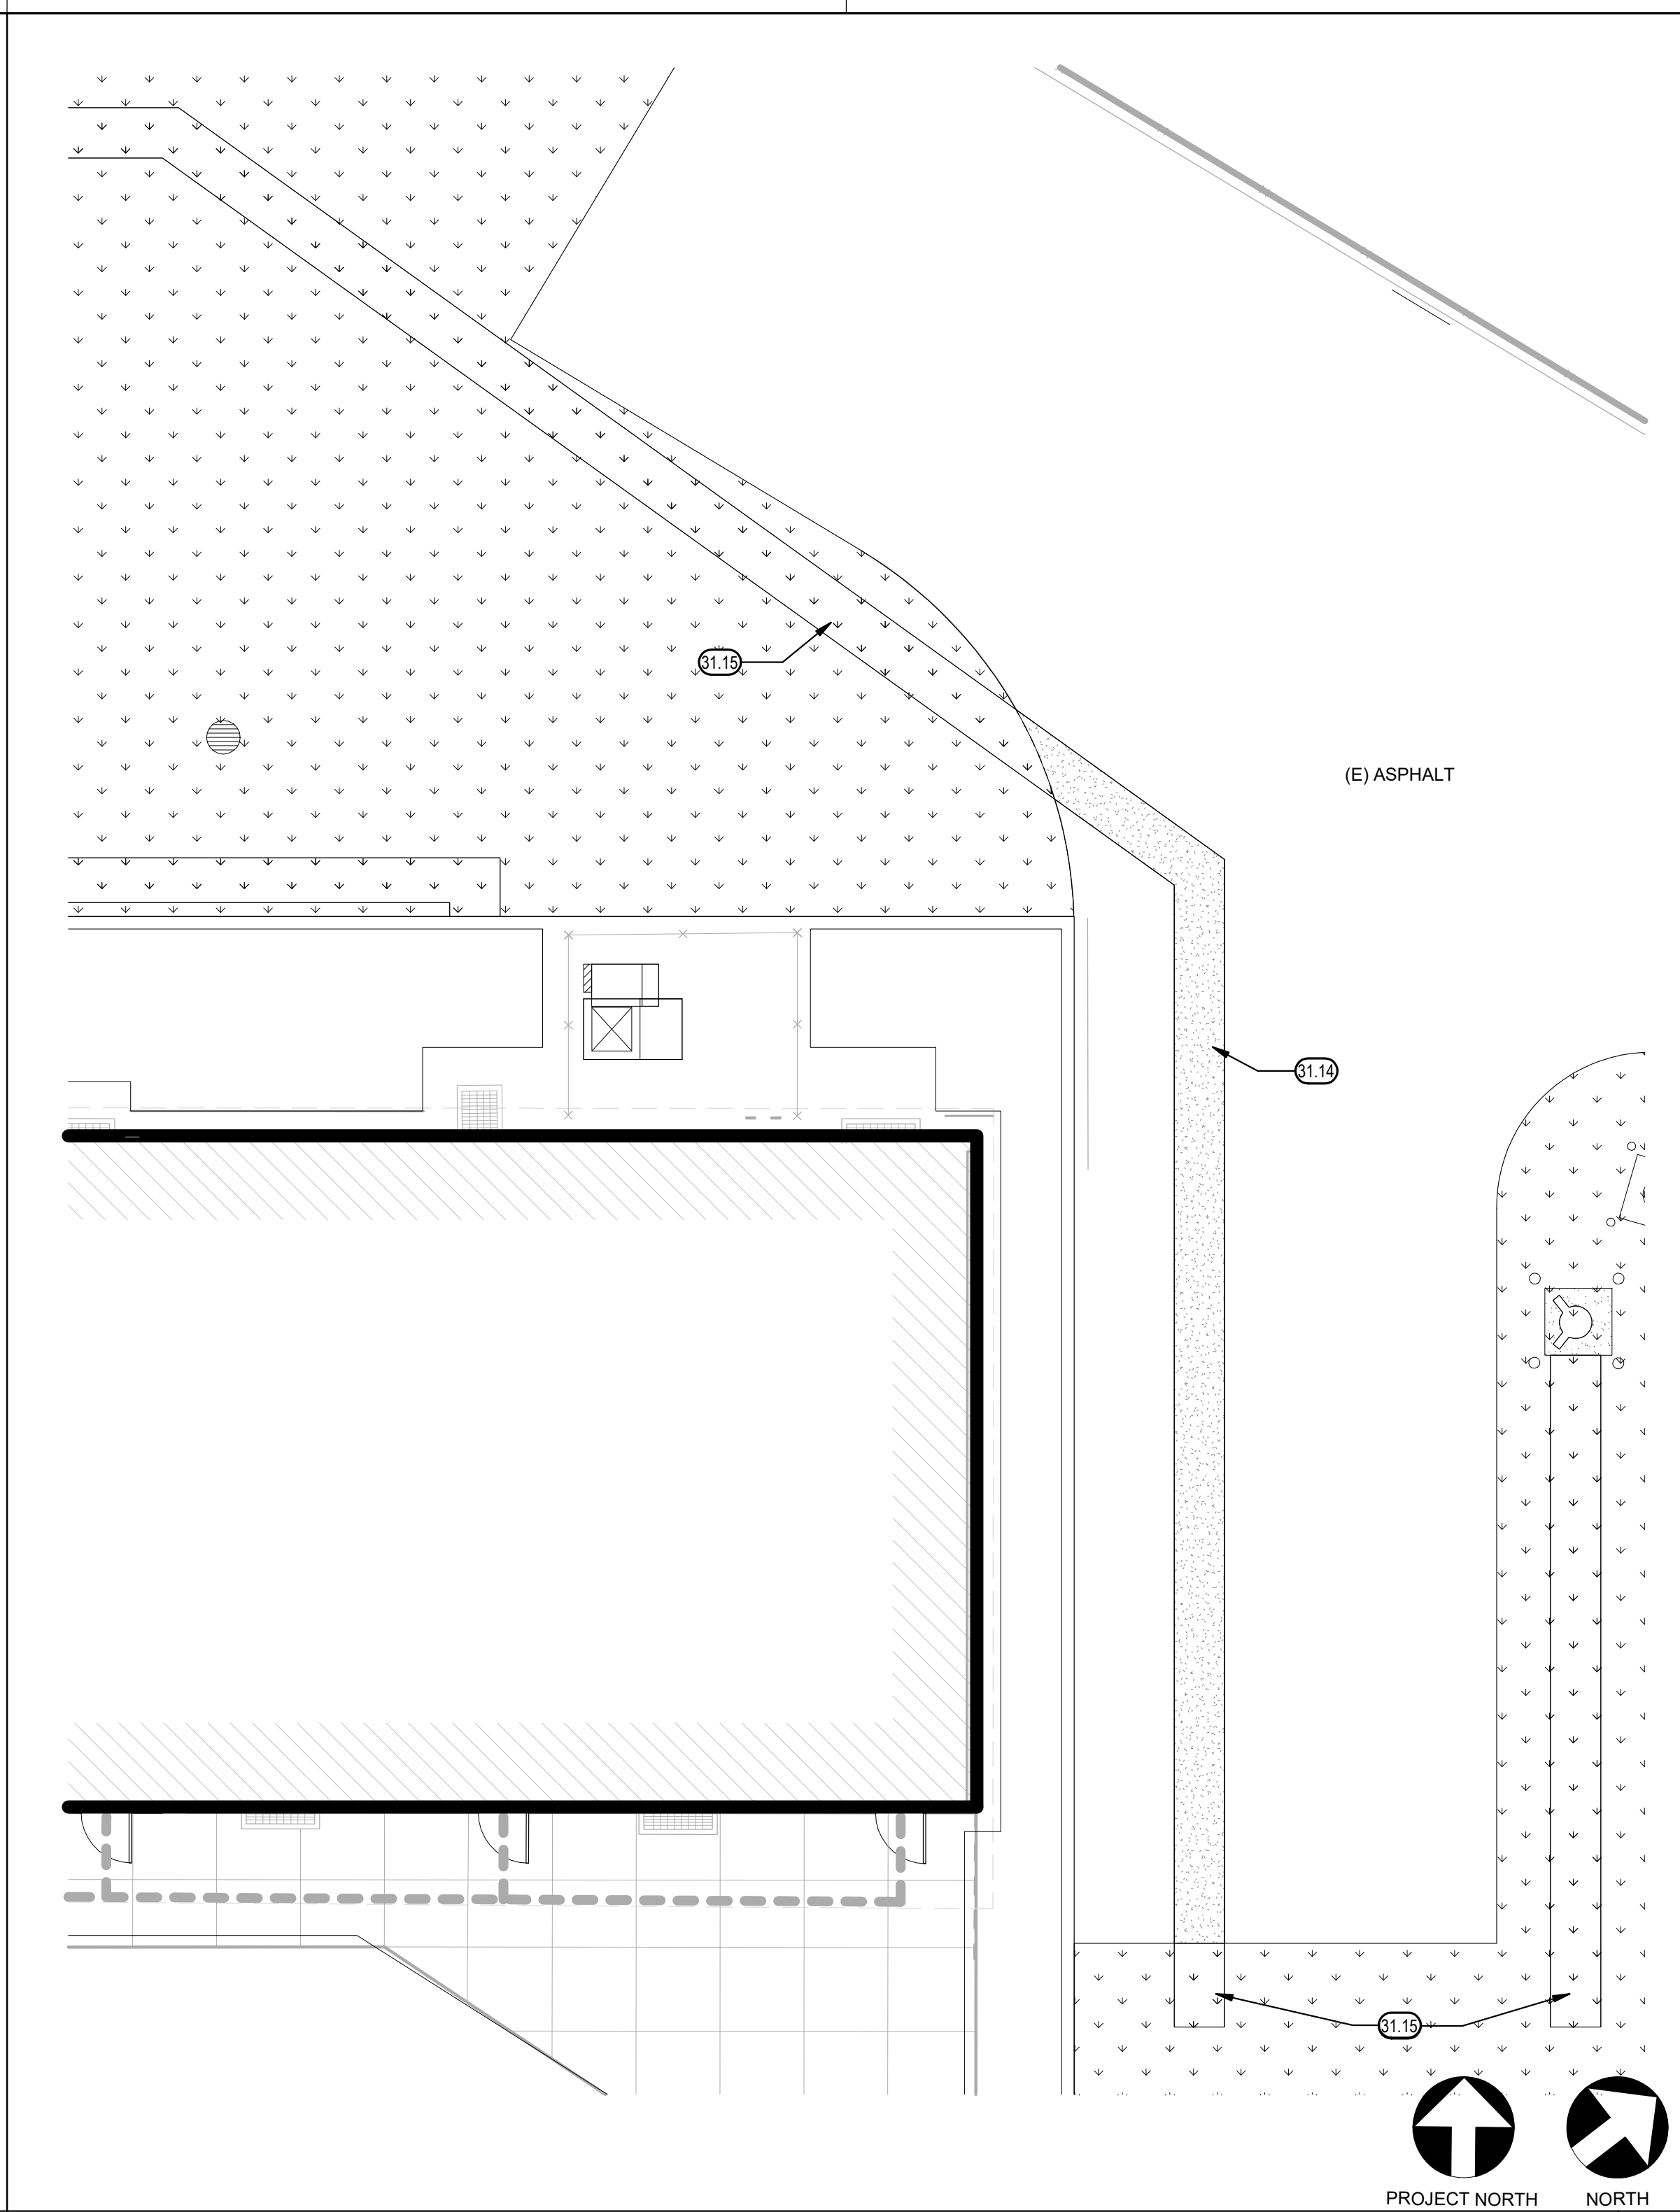

PROPOSED PARTIAL SITE PLAN 1/8" = 1'-0" 3

SITE PLAN NOTES

- ALL UTILITY TRANSITIONS SHALL BE CONCEALED WITHIN IN THE WALL CAVITIES AND SHALL TRANSITION BELOW GRADE TO POINT OF CONNECTION BELOW THE BUILDING.
- SEE CIVIL, LANDSCAPE, ELECTRICAL AND RELOCATABLE DRAWINGS FOR ADDITIONAL INFORMATION NOT NOTED ON ARCHITECTURAL DRAWINGS.
- EXTERIOR CONCRETE LANDING AT DOORS SHALL NOT BE MORE THAN 1/2 INCH LOWER THAN THE TOP OF THE DOORWAY THRESHOLD, LANDING SHALL SLOPE 1/4 INCH PER FOOT MAX.

KEYNOTES

2.03

EXISTING STORM DRAIN OUTLET TO REMAIN

2.63

REMOVE EXISTING TURF AND DISPOSE OF OFF-SITE. SCARIFY TOP 6" OF EXISTING SOIL AND RECOMPACT TO 90% RELATIVE COMPACTION. SEE LANDSCAPE.

2.81

SAW CUT AND PATCH EXISTING ASPHALT CONCRETE

31.14

INFILL TRENCH AND PROVIDE NEW ASPHALT CONCRETE

31.15

INFILL TRENCH AND PROVIDE NEW SOD AS REQUIRED, SEE LANDSCAPE

LEGEND

EXISTING BUILDING

NO SCOPE OF WORK UNDER THIS PROJECT UNLESS NOTED OTHERWISE

PROPOSED MODULAR BUILDING

MODULAR BUILDING UNDER THIS SCOPE OF WORK, SEE MFR DWGS.

PROPOSED CONCRETE PAVING

SEE CIVIL FOR GRADING, FOR CONSTRUCTION, ISOLATION, CONTRACTION JOINTS

EXISTING CONCRETE

NO SCOPE OF WORK UNDER THIS PROJECT

DEMOLITION OF TURF AREA

SEE LANDSCAPE DRAWINGS (TREES AND PLANTING NOT SHOWN FOR CLARITY)

PROPOSED TURF AREA

SEE LANDSCAPE DRAWINGS (TREES AND PLANTING NOT SHOWN FOR CLARITY)

DEMOLITION OF ASPHALT AREA

SEE CIVIL DRAWINGS

PROPOSED ASPHALT AREA

SEE CIVIL DRAWINGS


SITE INFORMATION

NEW 6'-0"H CHAIN LINK FENCE/GATE

ACCESSIBLE ROUTE
(2022 C.B.C. SECTION 11B-206)

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.			
B	07/31/2024	DSA SUBMITTAL	
MARK	DATE	DESCRIPTION	
C	11/01/2024	DSA BACKCHECK SUBMITTAL	

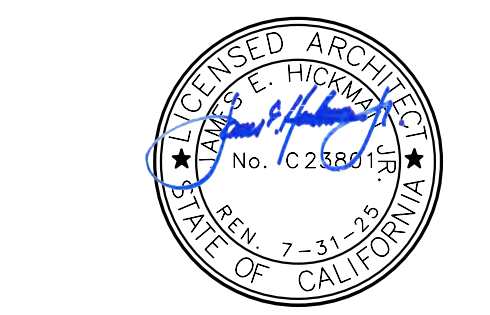

TETER, INC.

FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO

ARCHITECTS ENGINEERS CONNECTED




ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
DEMOLITION AND PROPOSED
PARTIAL SITE PLANS


PROJECT NO.
23-12899
DRAWING
A103

\\tetr-file1\Users\dylan.seaton_TET\Documents\12899-A-STOCKTON PEYTON ELEM ELOP.dylan.seatonFLU7Z.rvt


PLOT DATE: 11/1/2024 12:11:29 PM

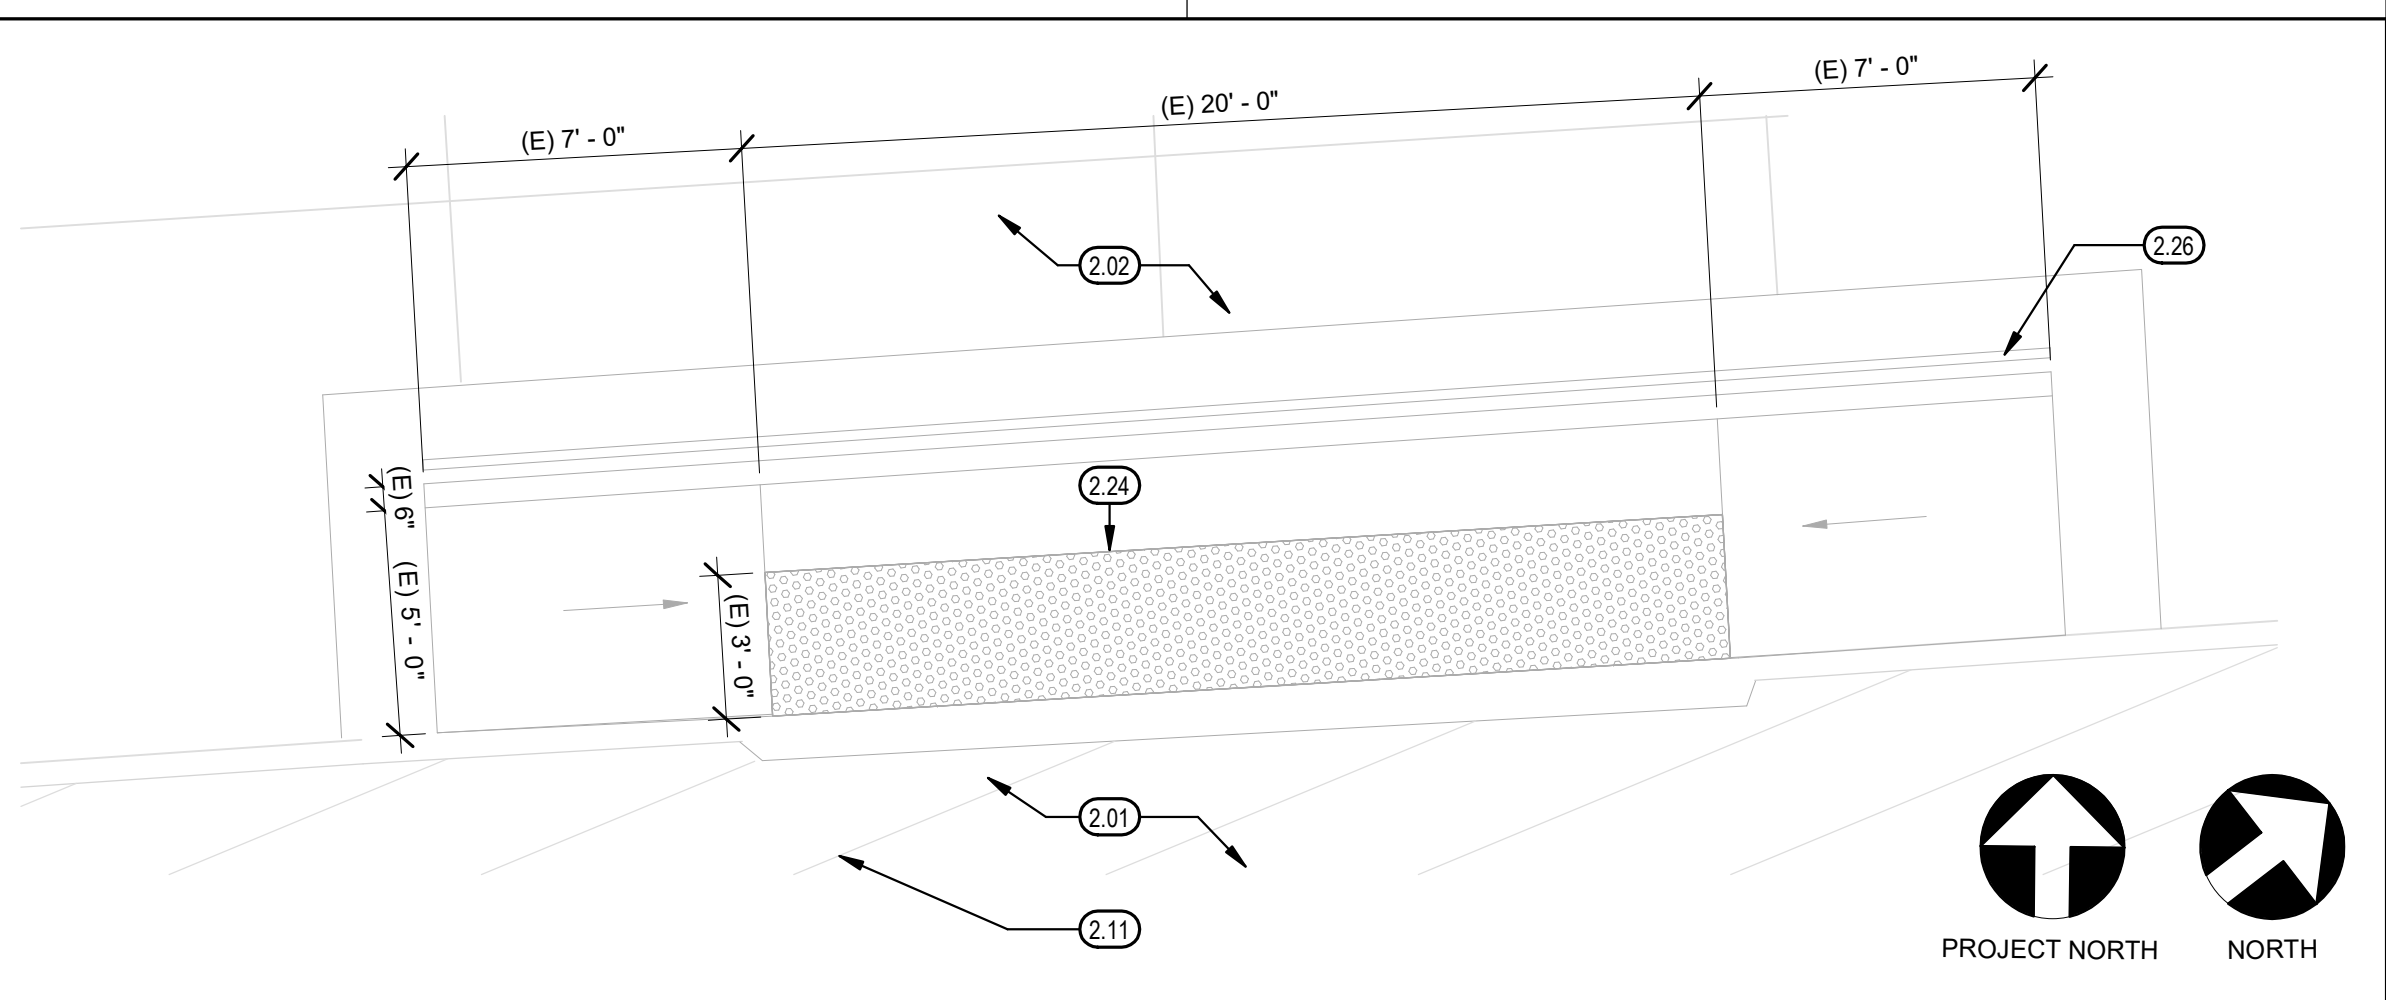


EXISTING ACCESSIBLE DROP OFF - A# 02-117686 (FOR REF, ONLY - NO WORK) 1/4" = 1'-0" 9

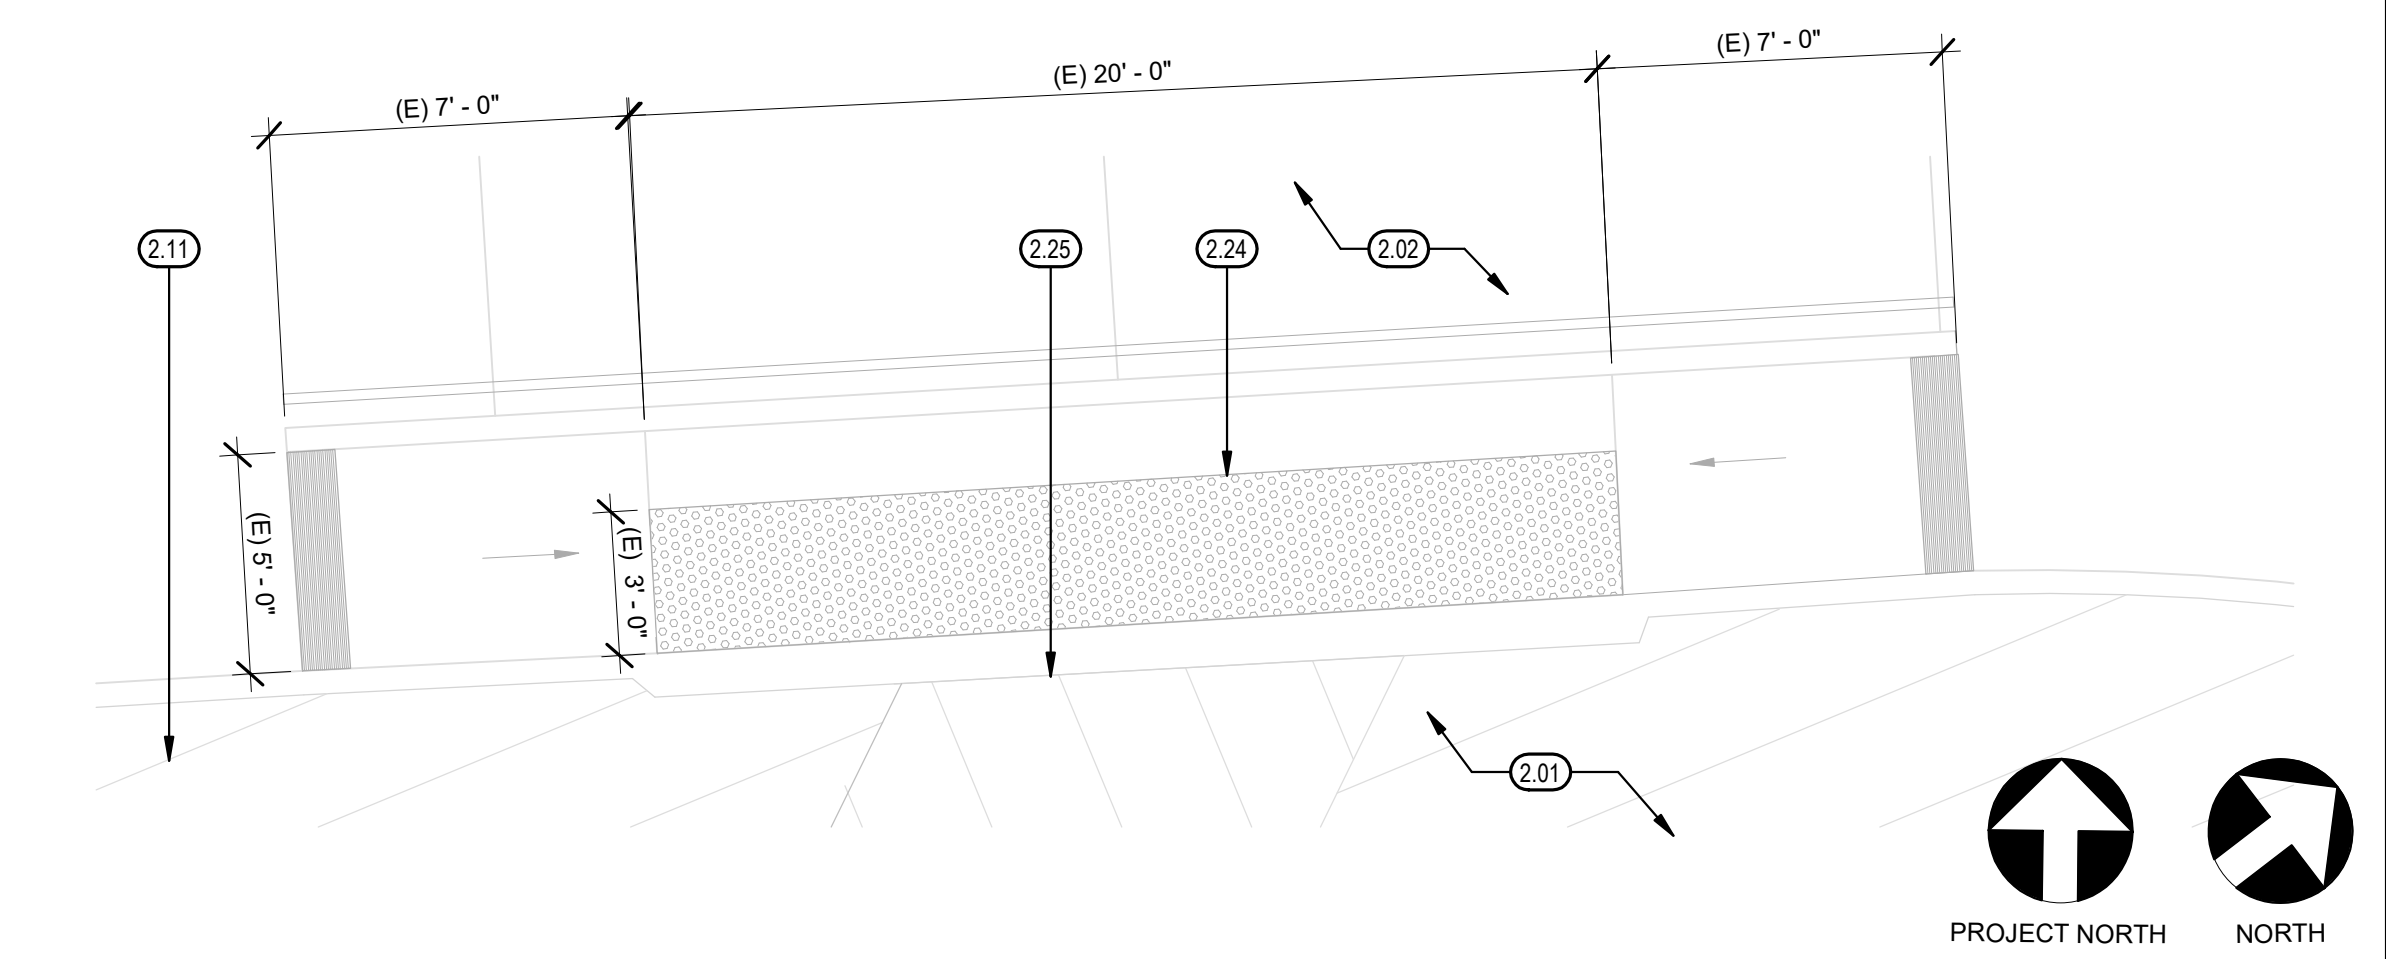

EXISTING ACCESSIBLE DROP OFF - A# 02-108478 (FOR REF. ONLY - NO WORK) 1/4" = 1'-0" 10

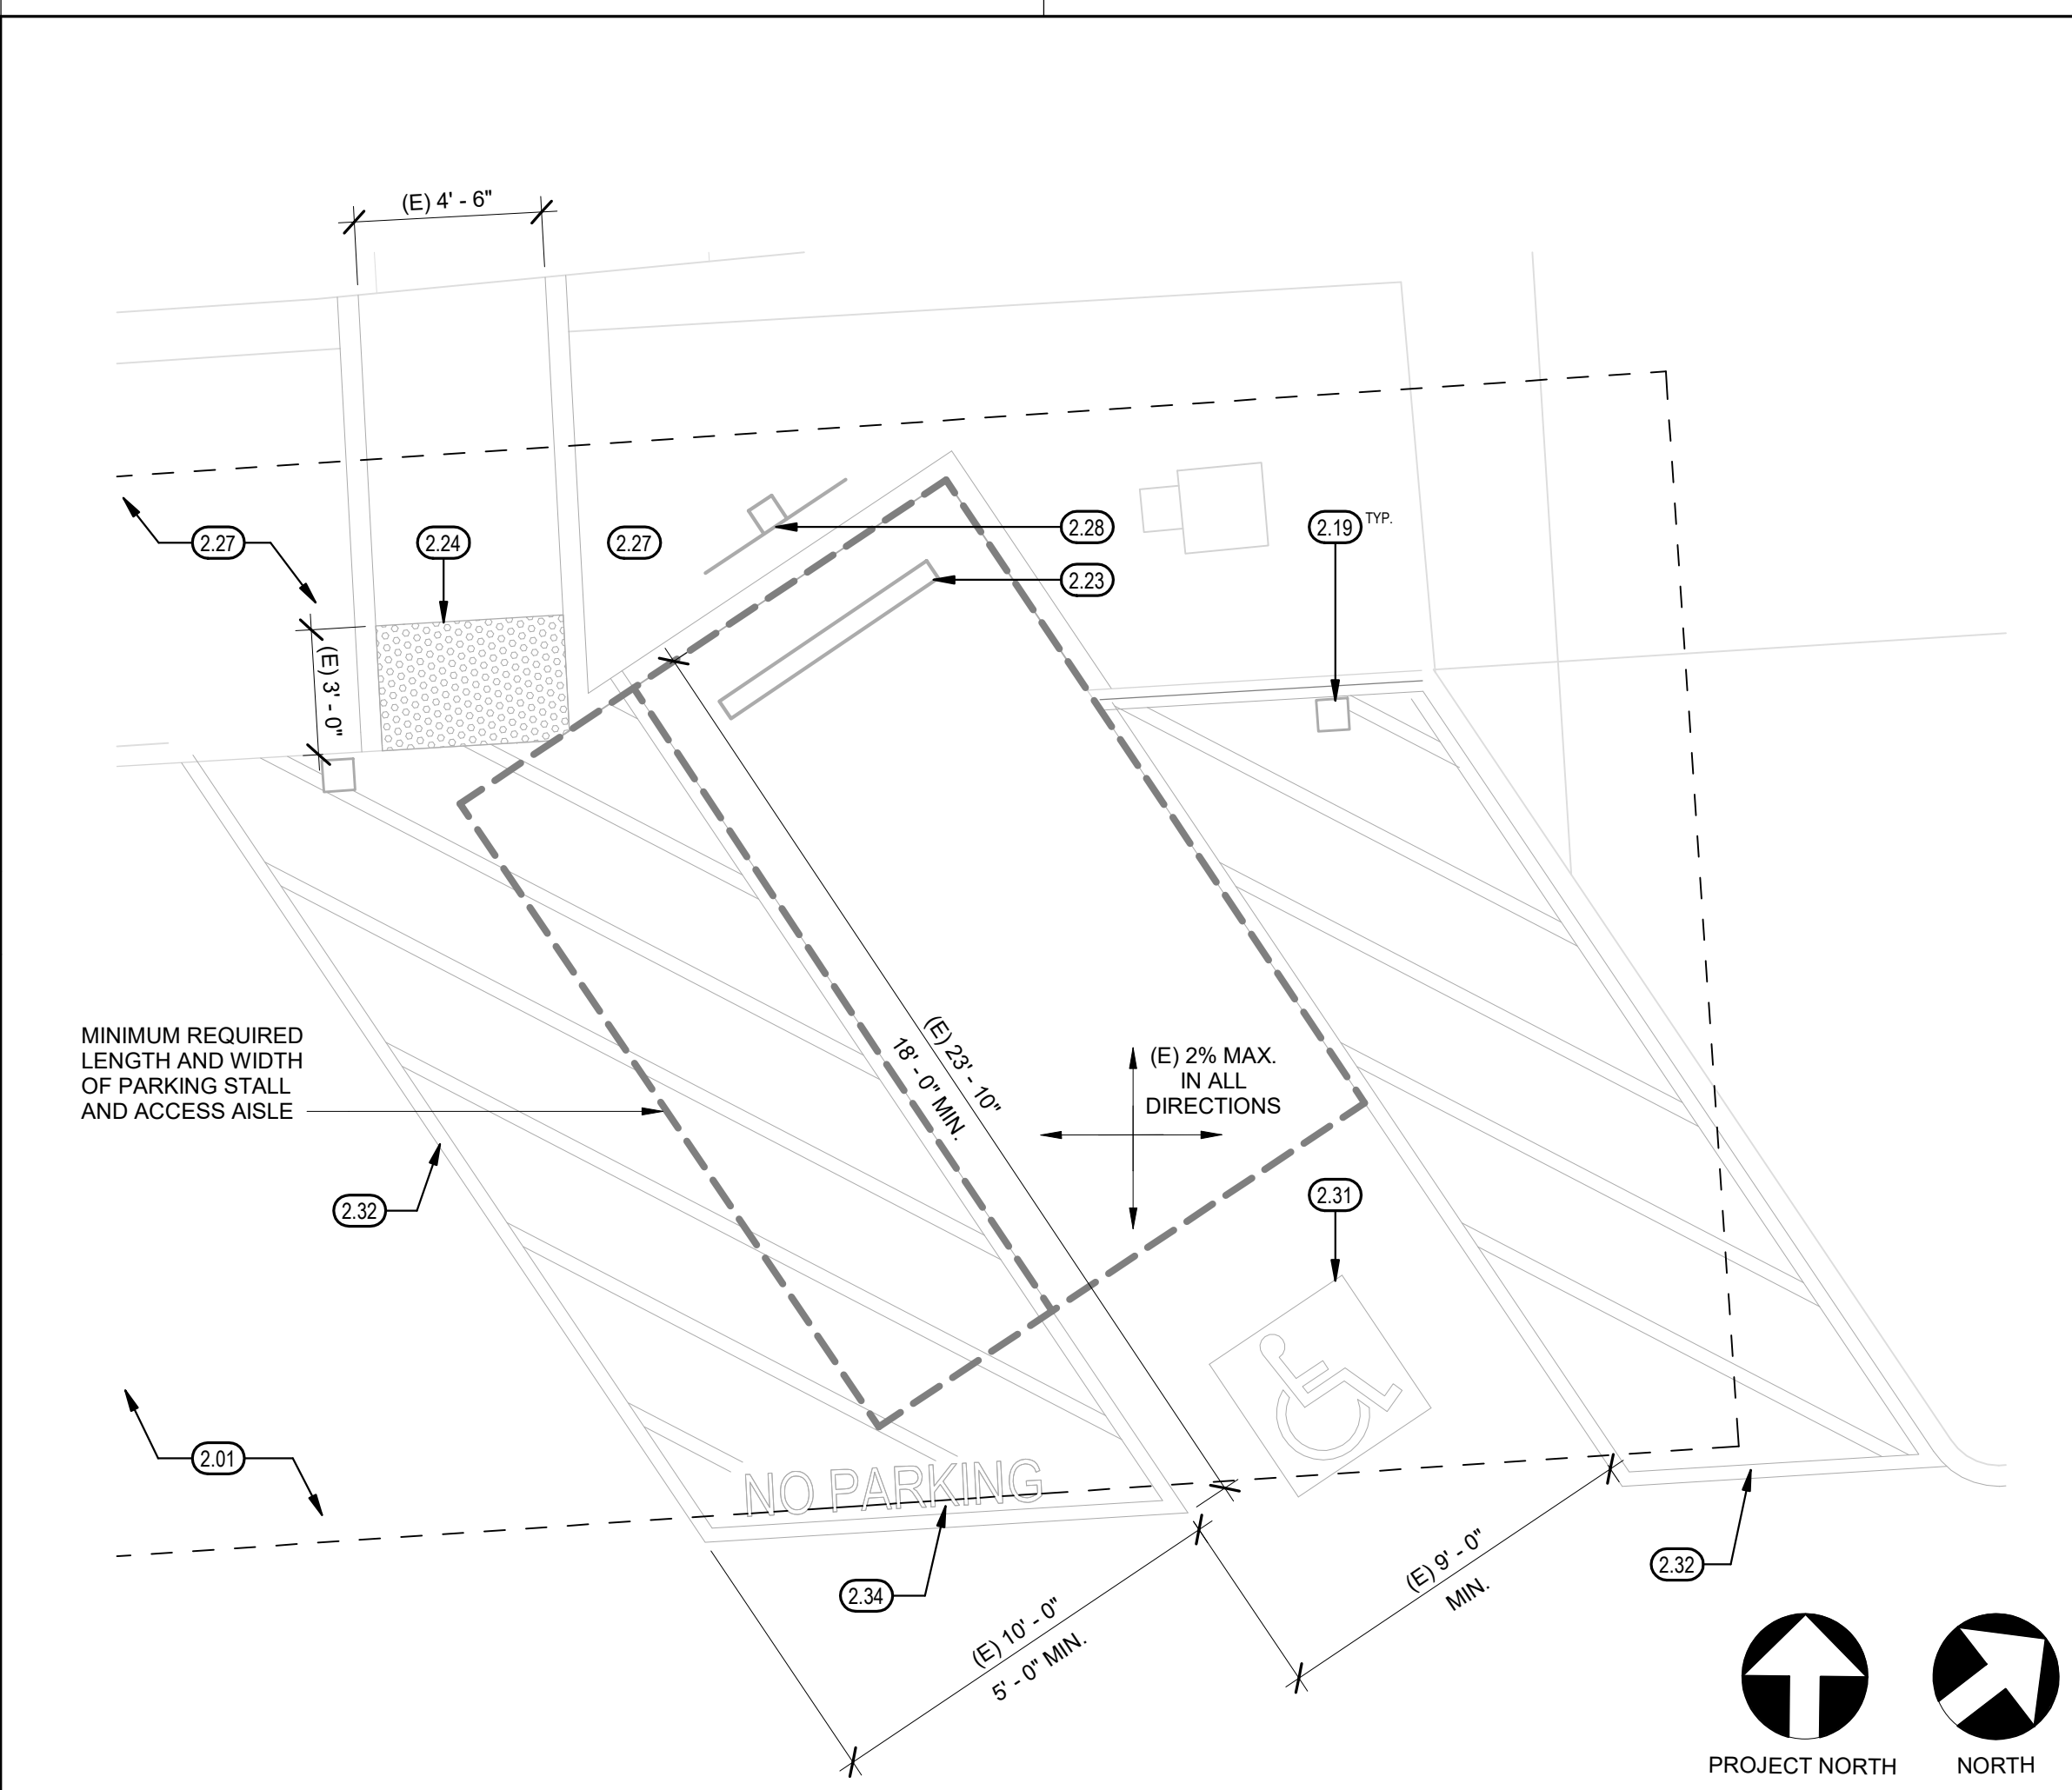

EXISTING ACCESSIBLE STALL - A# 02-117686 (FOR REF. ONLY - NO WORK) 1/4" = 1'-0" 4

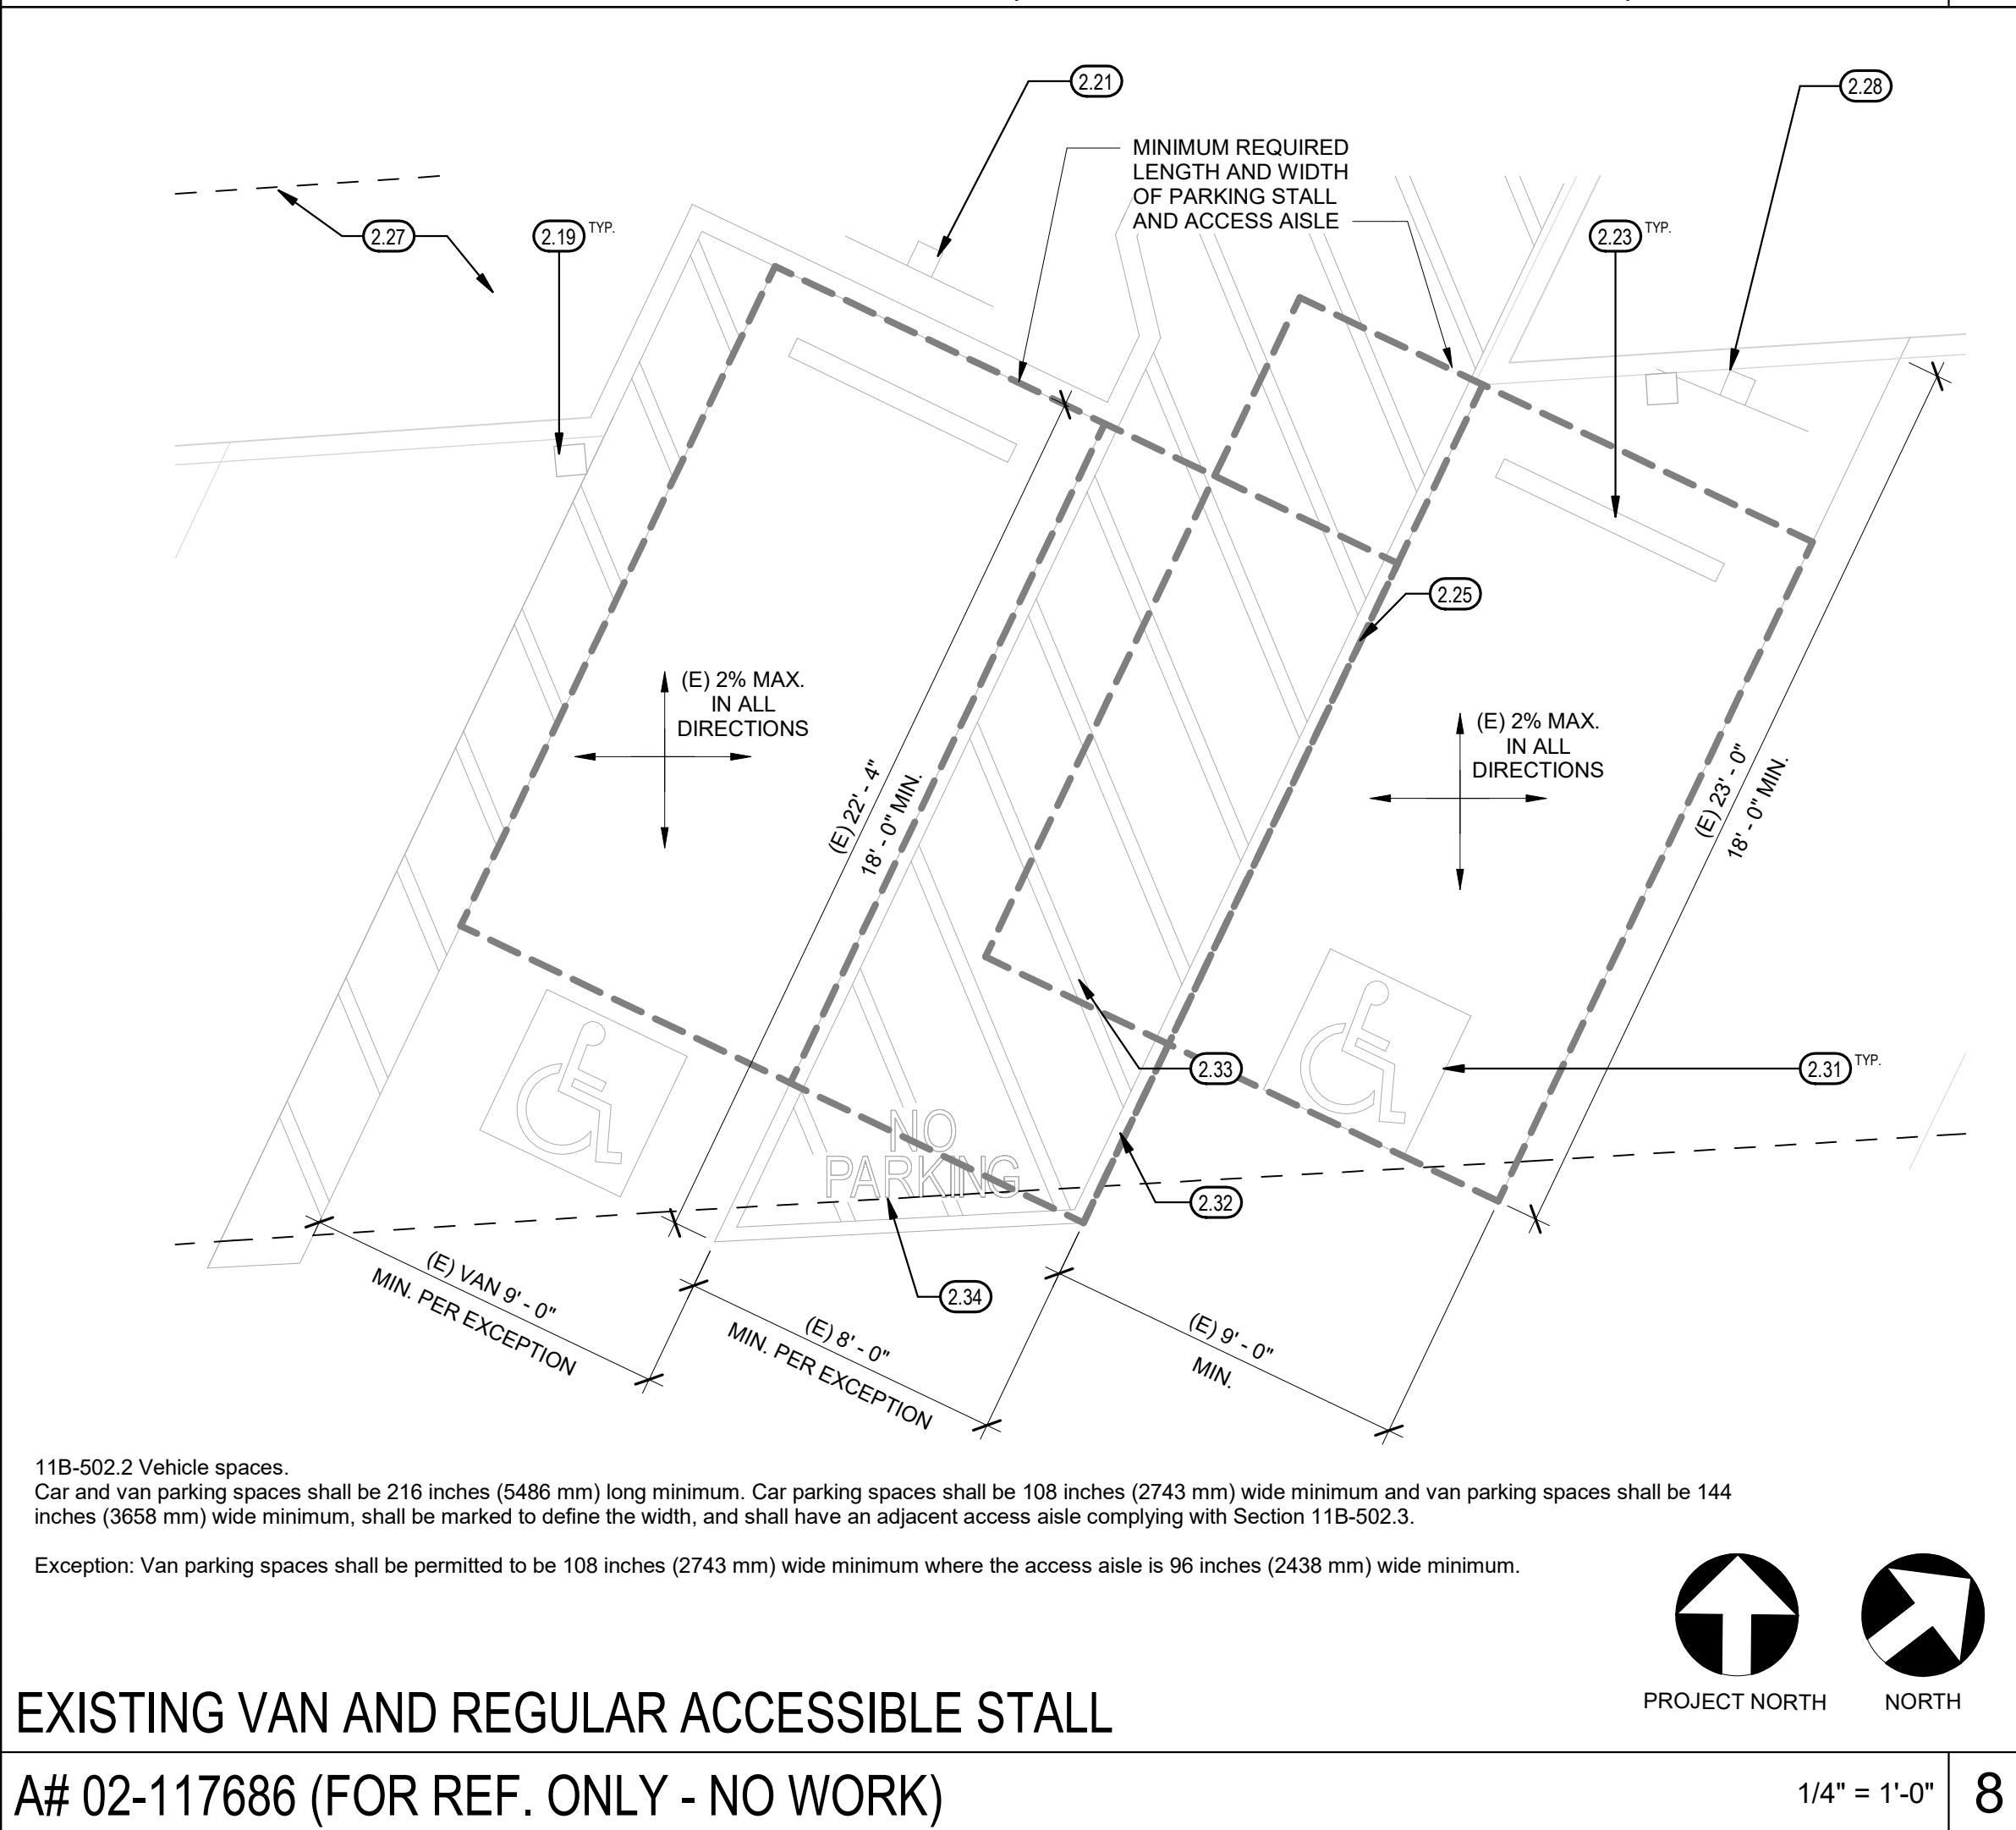

EXISTING VAN AND REGULAR ACCESSIBLE STALL A# 02-117686 (FOR REF. ONLY - NO WORK) 1/4" = 1'-0" 8

KEYNOTES


- 2.01 EXISTING AC PAVING TO REMAIN
- 2.02 EXISTING CONCRETE PAVING/WALK TO REMAIN
- 2.11 EXISTING PASSENGER LOADING ZONE TO REMAIN
- 2.19 EXISTING SOLAR SHADE STRUCTURE COLUMN TO REMAIN
- 2.21 EXISTING VAN ACCESSIBLE PARKING SIGN TO REMAIN (A# 02-117686)
- 2.23 EXISTING CONCRETE WHEEL STOP TO REMAIN
- 2.24 EXISTING DETECTABLE WARNING SURFACE TO REMAIN
- 2.25 EXISTING ACCESSIBLE AISLE STRIPING TO REMAIN
- 2.26 EXISTING GUARD RAIL TO REMAIN
- 2.27 EXISTING PLANTER TO REMAIN
- 2.28 EXISTING ACCESSIBLE PARKING SIGN TO REMAIN (A# 02-117686)
- 2.31 EXISTING 3'-0" SQUARE INTERNATIONAL SYMBOL OF ACCESSIBILITY TO REMAIN
- 2.32 EXISTING BLUE BORDER STRIPING TO REMAIN
- 2.33 EXISTING WHITE DIAGONAL AISLE STRIPING TO REMAIN
- 2.34 EXISTING 12" HIGH WHITE LETTERING TO REMAIN

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☐ FLS ☐ ACS ☐
DATE: 11/26/2024

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL




TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

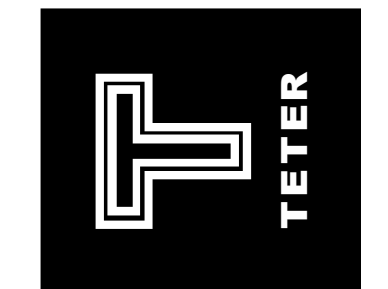

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
PARTIAL SITE PLANS

PROJECT NO.
23-12899
DRAWING

A104



						<div>EXTERIOR WALL CONSTRUCTION, SEE DETAIL 2 / A801</div> <div>(+) FASTEN FLASHING TO STUD @ 16" O.C. MAX. USE (1) # 10 SMS @ STL STUD, (1) 6d WOOD STUD</div> <div>(+) 1x4 FIBER CEMENT BOARD TRIM, PRIME ALL SIDES</div> <div>(*) 22GA CONT FLASHING o/COUNTER FLASH</div> <div>1/2" @ TURF AREAS & 2" @ PLANTER AREAS</div> <div>(+) ASPHALT IMPREGNATED JOINT</div> <div>(+) 18" WIDE PERIMETER CONCRETE MOWSTRIP OR WALKWAY</div> <div>(+) #10 - 24 x 2" SELF-TAPPING PHILLIPS FLAT-HEAD 24" O.C., TYP.</div> <div>(+) 22 GA. COUNTER FLASHING</div> <div>(+) SEALANT/WATER PROOFING</div> <div>(+) BUILDING FOUNDATION, SEE PC SET</div> <div><div>(*) = CLASS LEASING PROVIDED/INSTALLED</div><div>(+) = CONTRACTOR PROVIDED/INSTALLED</div></div> <div></div>
						<div>FOUNDATION VENT</div> <div>VENTILATION OPENINGS SHALL BE FULLY COVERED WITH CORROSION RESISTANT WIRE MESH. OPENING SHALL BE 1/16" MIN. AND NOT TO EXCEED 1/8" MAX. PER CBC SECTION 706A.</div> <div>(+) 2" GOPHER CONCRETE SLURRY</div> <div><div>(*) = CLASS LEASING PROVIDED/INSTALLED</div><div>(+) = CONTRACTOR PROVIDED/INSTALLED</div></div> <div></div>
						<div>EXTERIOR WALL CONSTRUCTION, SEE DETAIL 2 / A801</div> <div>(*) WATER AND/OR WASTE LINE</div> <div>(+) GALVANIZED PERFORATED PLUMBER'S TAPE WRAPPED UNDER PIPE FOR SUPPORT</div> <div>(+) FINAL CONNECTIONS (CONTRACTOR TO COORDINATE EXACT LOCATION WITH CLASS LEASING)</div> <div>(+) SLEEVE THROUGH FOOTING (WATER - 3" OR 4 1/2" / WASTE LINE - 6") (SITE CONTRACTOR TO COORDINATE LOCATION WITH CLASS LEASING'S DRAWINGS)</div> <div>(+) 2" GOPHER SLURRY</div> <div><div>(*) = CLASS LEASING PROVIDED/INSTALLED</div><div>(+) = CONTRACTOR PROVIDED/INSTALLED</div></div> <div></div>



MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT	
APP. 02-122690	INC.
REVIEWED FOR	
SS <input checked="" type="checkbox"/>	FLS <input checked="" type="checkbox"/> ACS <input checked="" type="checkbox"/>
DATE: 11/26/2024	

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.


$$1/2'' = 1'-0''$$

CHAIN LINK FENCE POST & FOOTING SCHEDULE

$$1/2'' = 1'-0''$$

1

GENERAL NOTE:

CONCRETE SETTING MATERIALS SHALL COMPLY WITH ASTM C 150 AND ASTM C 94, UNLESS OTHERWISE NOTED.

- A. STRENGTH 3,000 PSI AT 28 DAYS
- B. AGGREGATE SIZE: 1-1/2" MAXIMUM
- C. SLUMP: 4"
- D. WATER CEMENT RATIO: 0.53 MAXIMUM

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.

B	07/31/2024	DSA SUBMITTAL
MARK	DATE	DESCRIPTION
C	11/01/2024	DSA BACKCHECK SUBMITTAL



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA

DRAWING TITLE
SITE DETAILS

PROJECT NO.

23-12899

DRAWING

A111


$$1/2'' = 1'-0''$$


10


$$1/2'' = 1'-0''$$

7


$$1/2'' = 1'-0''$$


3

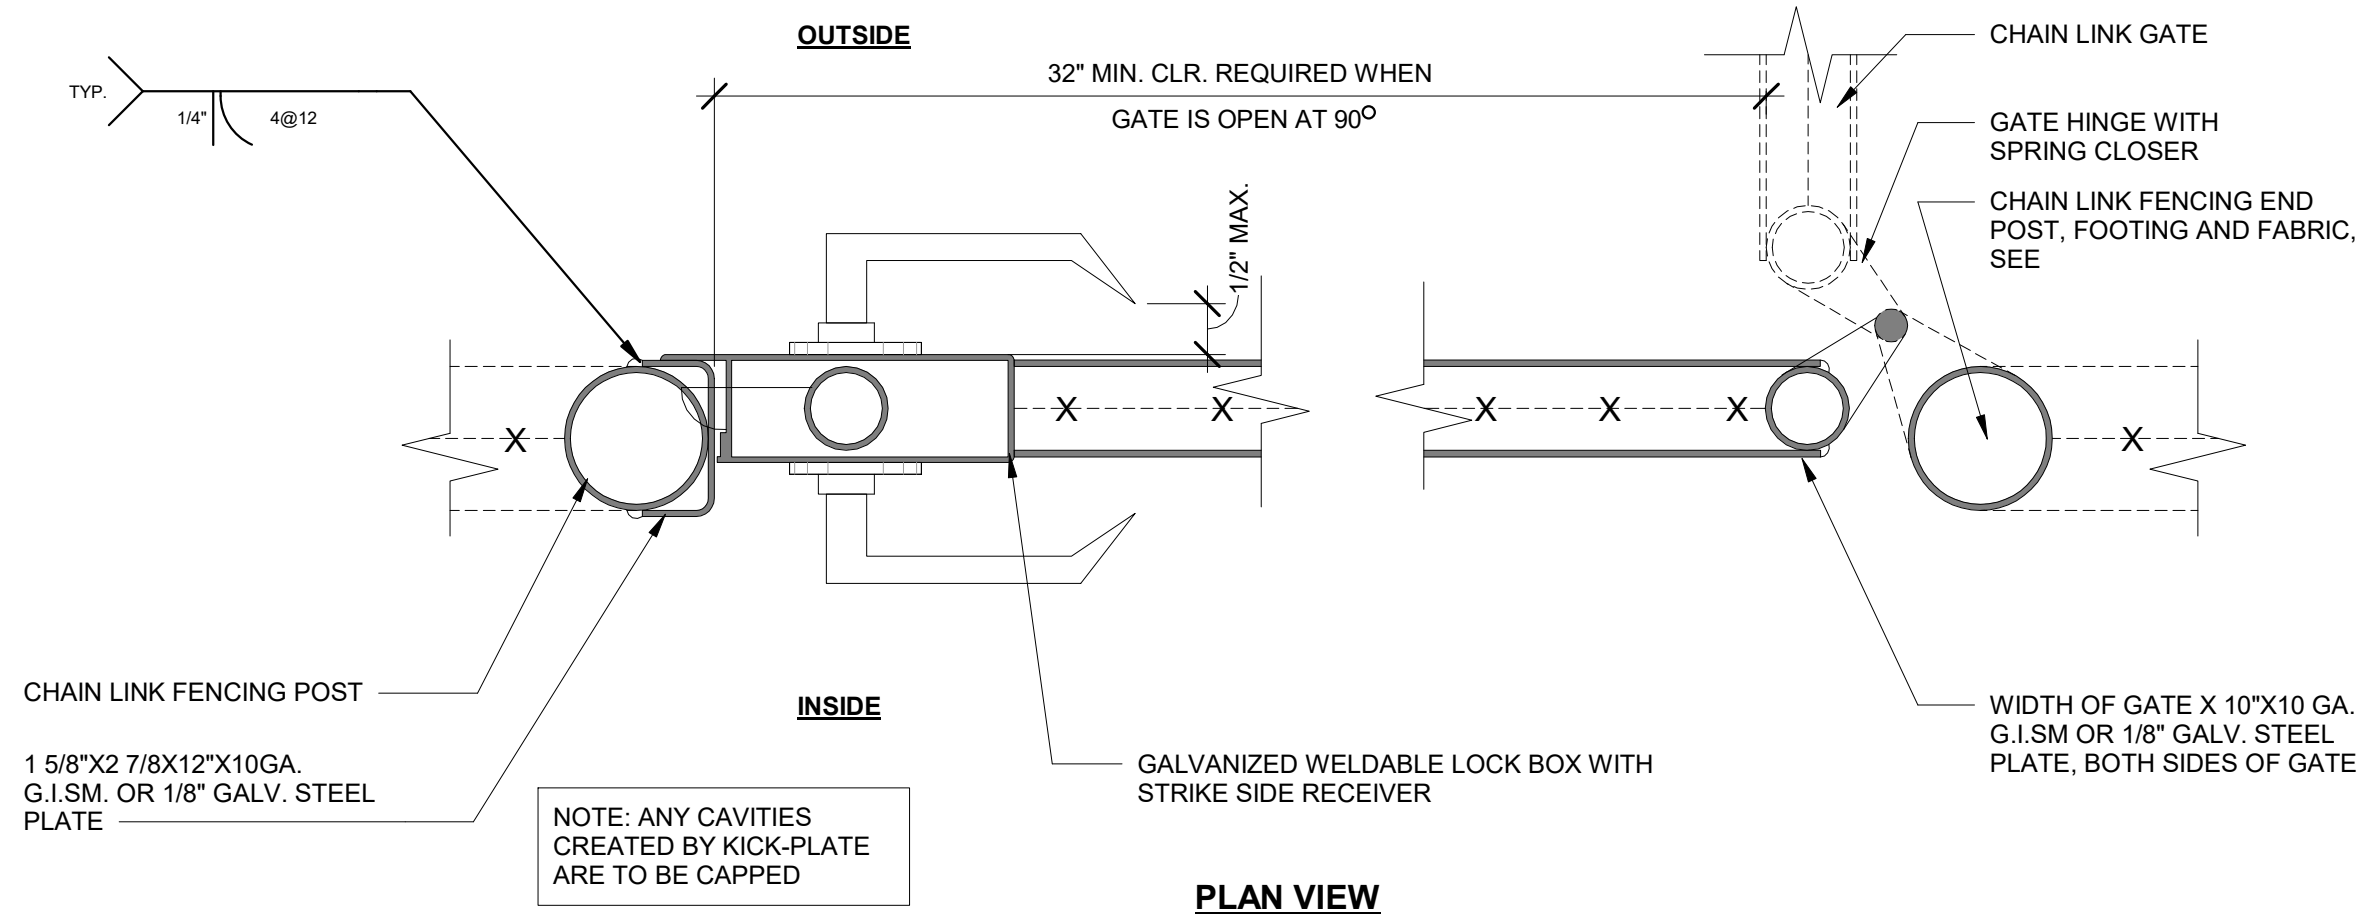

GATE HARDWARE

$$3'' = 1'-0''$$

12


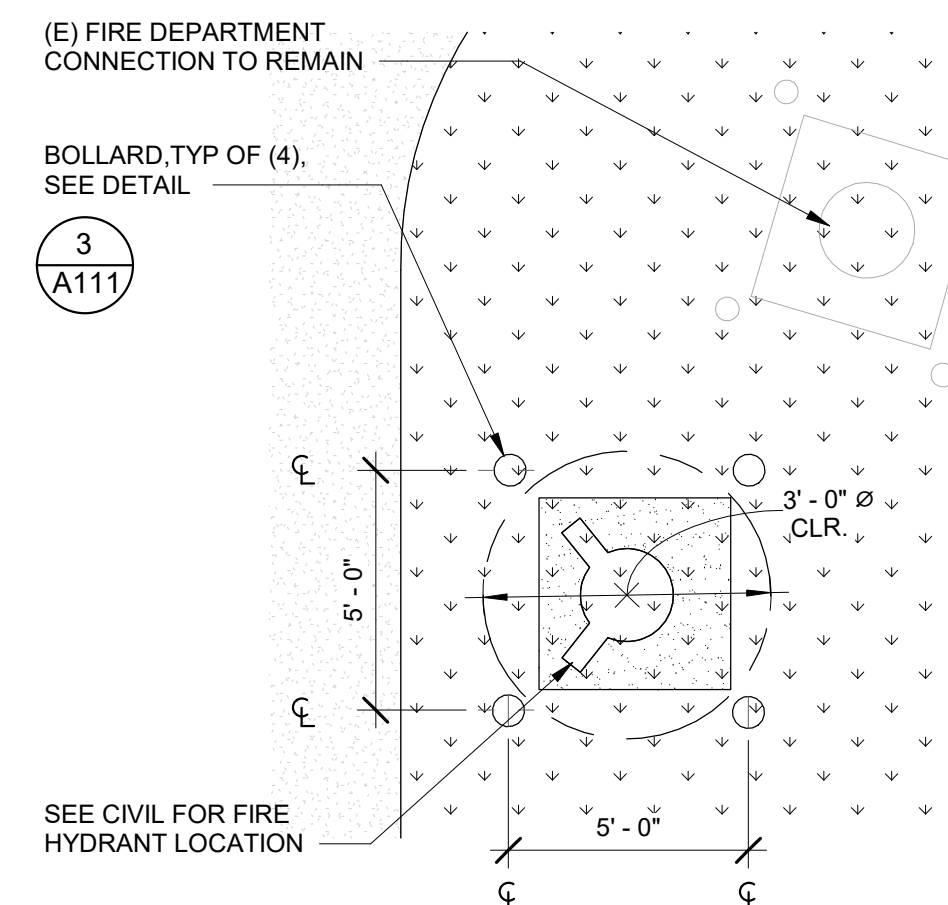


PARTIAL HYDRANT SITE PLAN

$$1/4" = 1'-0"$$


4

\\tetr-file1\Users\dylian.seaton_TETR\Documents\12899-A-STOCKTON PEYTON ELEM ELOP.dylan.seatonFLU7Z.rvt

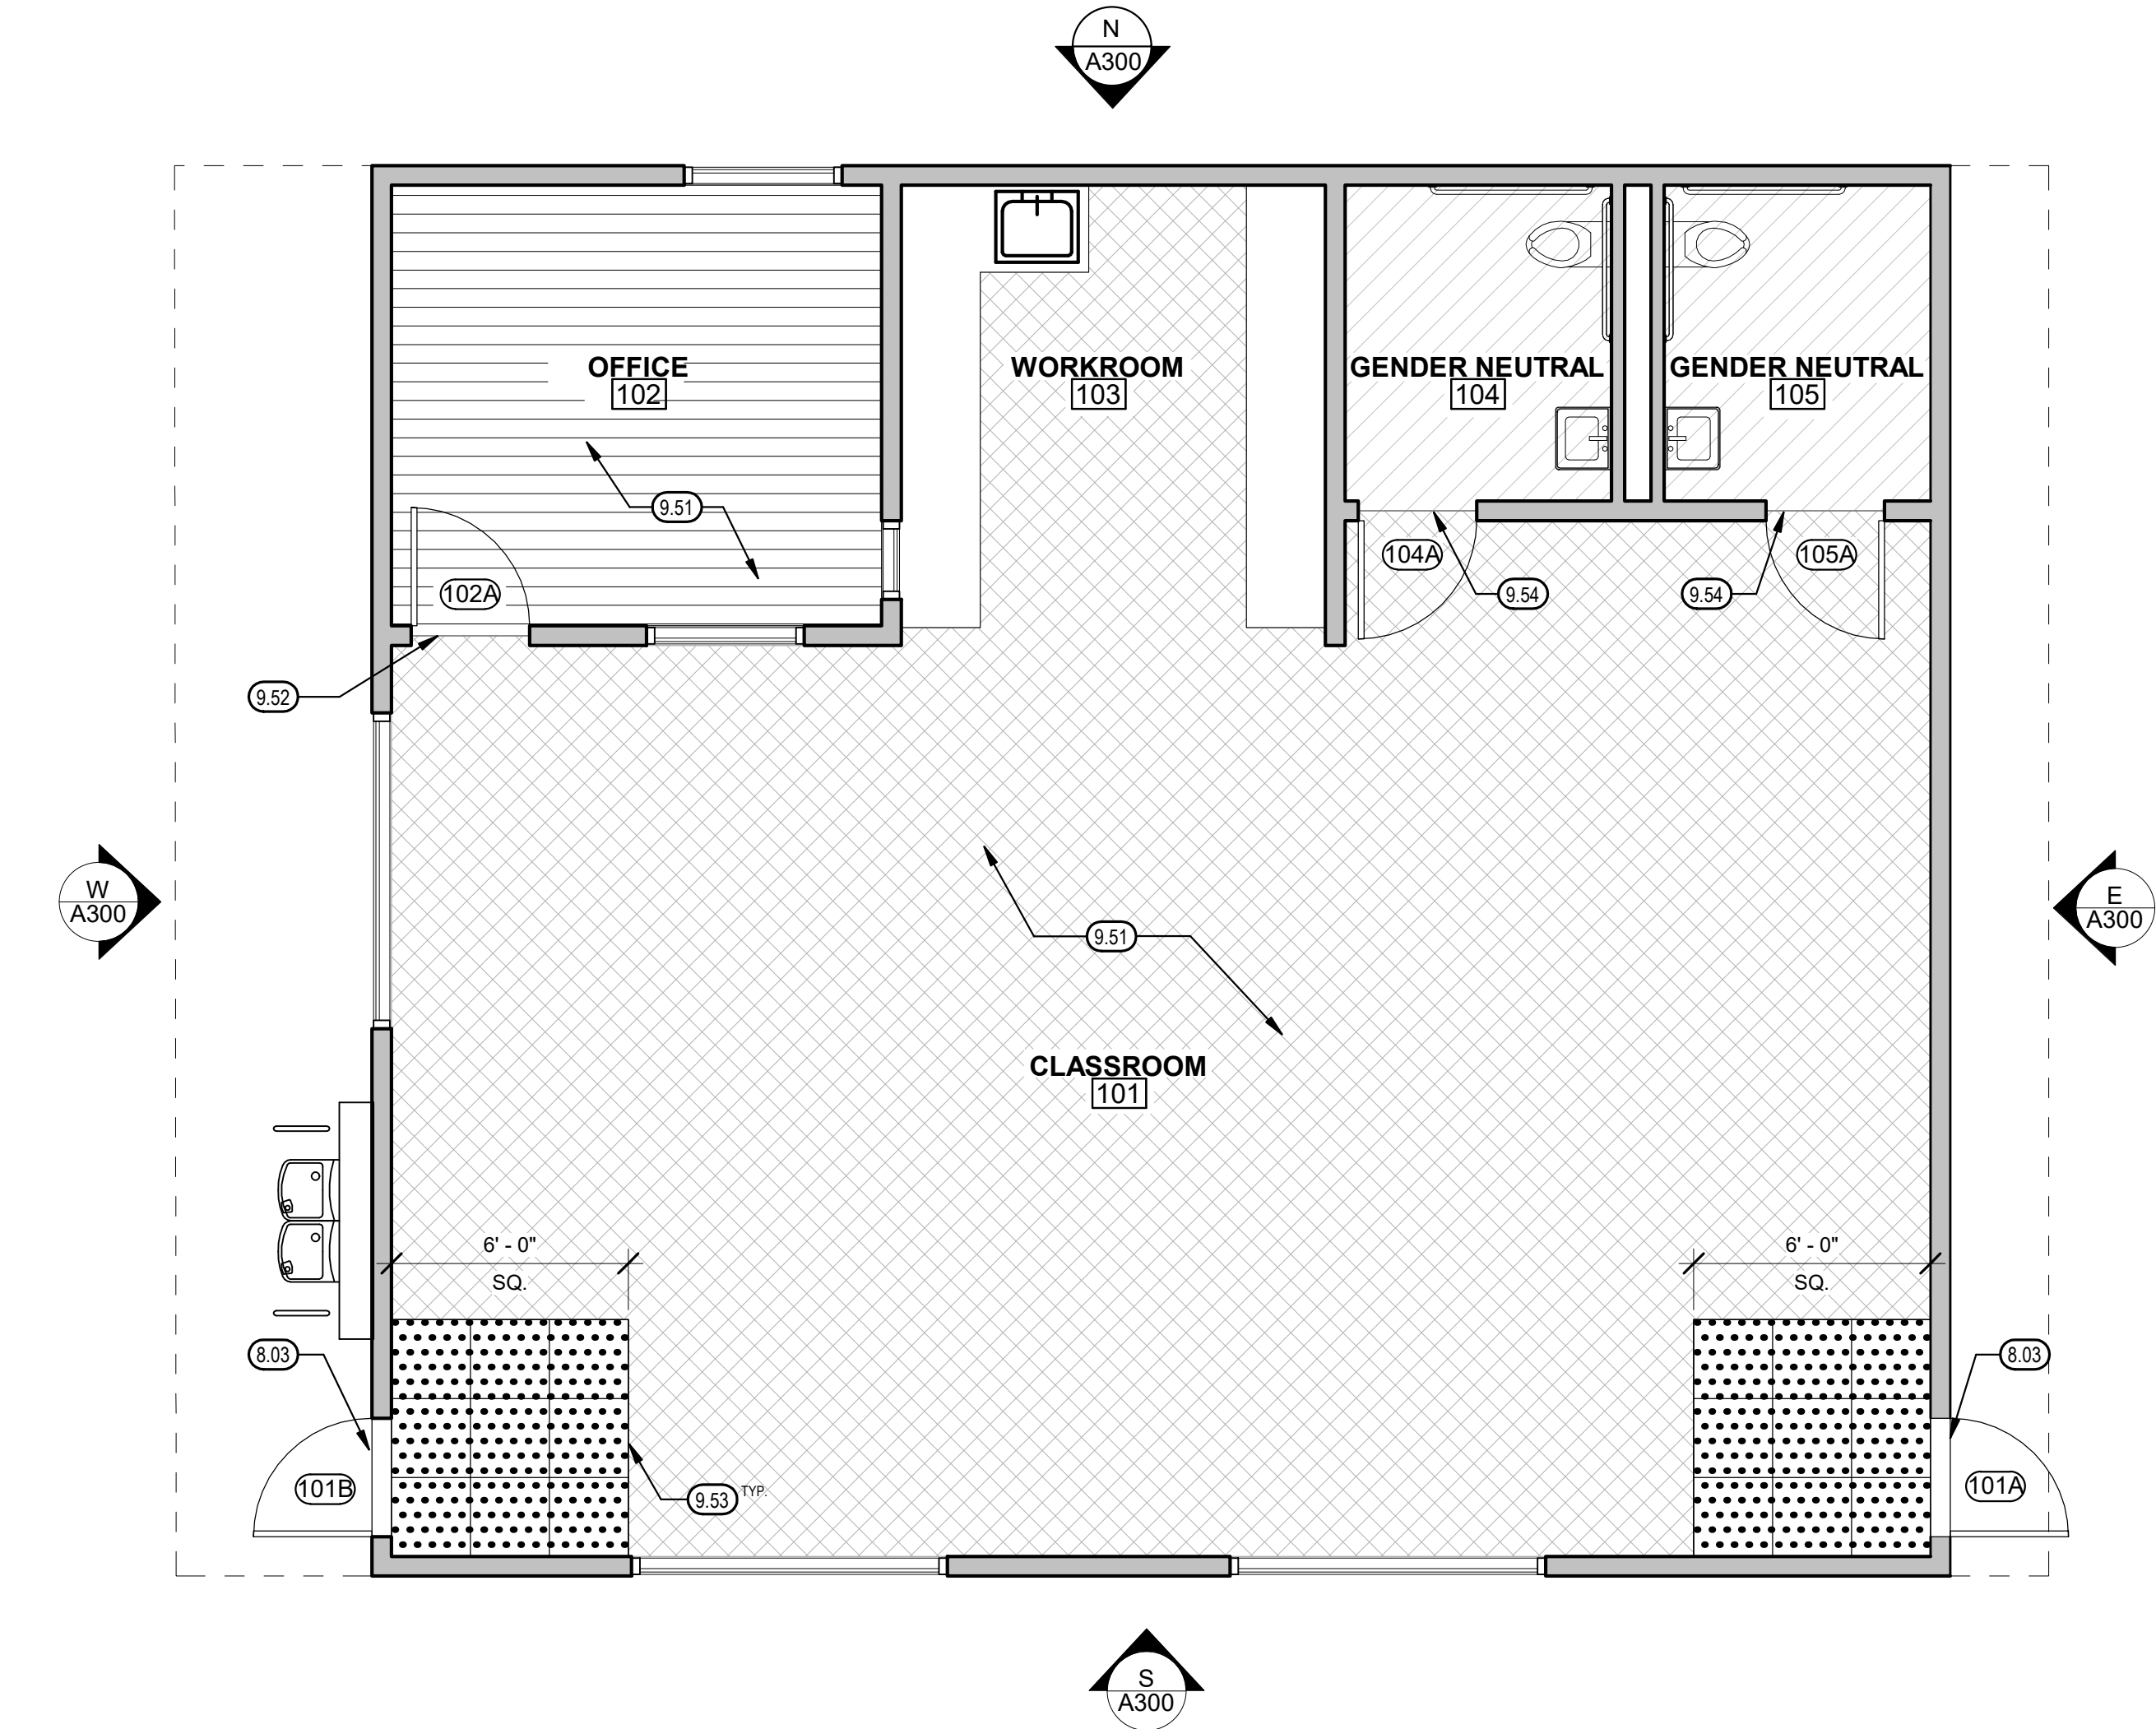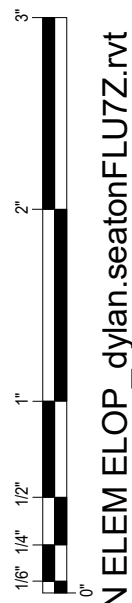

FINISH FLOOR MATERIAL LEGEND

	CPT-M	CARPET WALK-OFF MAT (PROVIDED AND INSTALLED BY SITE CONTRACTOR)		RVT-1	RESILIENT VINYL FLOOR TILE (PROVIDED AND INSTALLED BY SITE CONTRACTOR)
	CPT-1	CARPET (PROVIDED AND INSTALLED BY SITE CONTRACTOR)		SV-1	ROLLED SHEET VINYL W/ 6\"/>

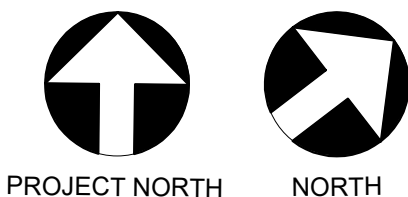

FINISH FLOOR PLAN

1/4" = 1'-0" 12

KEYNOTES


- 8.03 EXTERIOR THRESHOLD AT DOOR BY SITE CONTRACTOR, SEE 6 / A801
- 9.51 RUBBER TOP SET BASE ON ALL WALLS - BY SITE CONTRACTOR, SEE 15 / A800
- 9.52 FLOORING TRANSITION STRIP BY SITE CONTRACTOR, SEE 13 / A800
- 9.53 FLUSH TRANSITION BETWEEN CARPETS, SEE 14 / A800
- 9.54 FLOORING TRANSITION STRIP BY SITE CONTRACTOR, SEE 13 / A800

DOOR HARDWARE SCHEDULE			
ROOM DOOR #	ROOM NAME	HARDWARE	REMARKS
101A	CLASSROOM	01	A, B
101B	CLASSROOM	01	A, B
102A	OFFICE	02	A, B
104A	GENDER NEAUTRAL RR	03	A, B
105A	GENDER NEAUTRAL RR	03	A, B

REMARKS:

- SITE CONTRACTOR SHALL SALVAGE AND REMOVE HARDWARE FROM DOORS AND RETURN TO DISTRICT.
- SITE CONTRACTOR SHALL PROVIDE NEW HARDWARE AS INDICATED IN THE SPECIFICATIONS


DOOR HARDWARE SCHEDULE

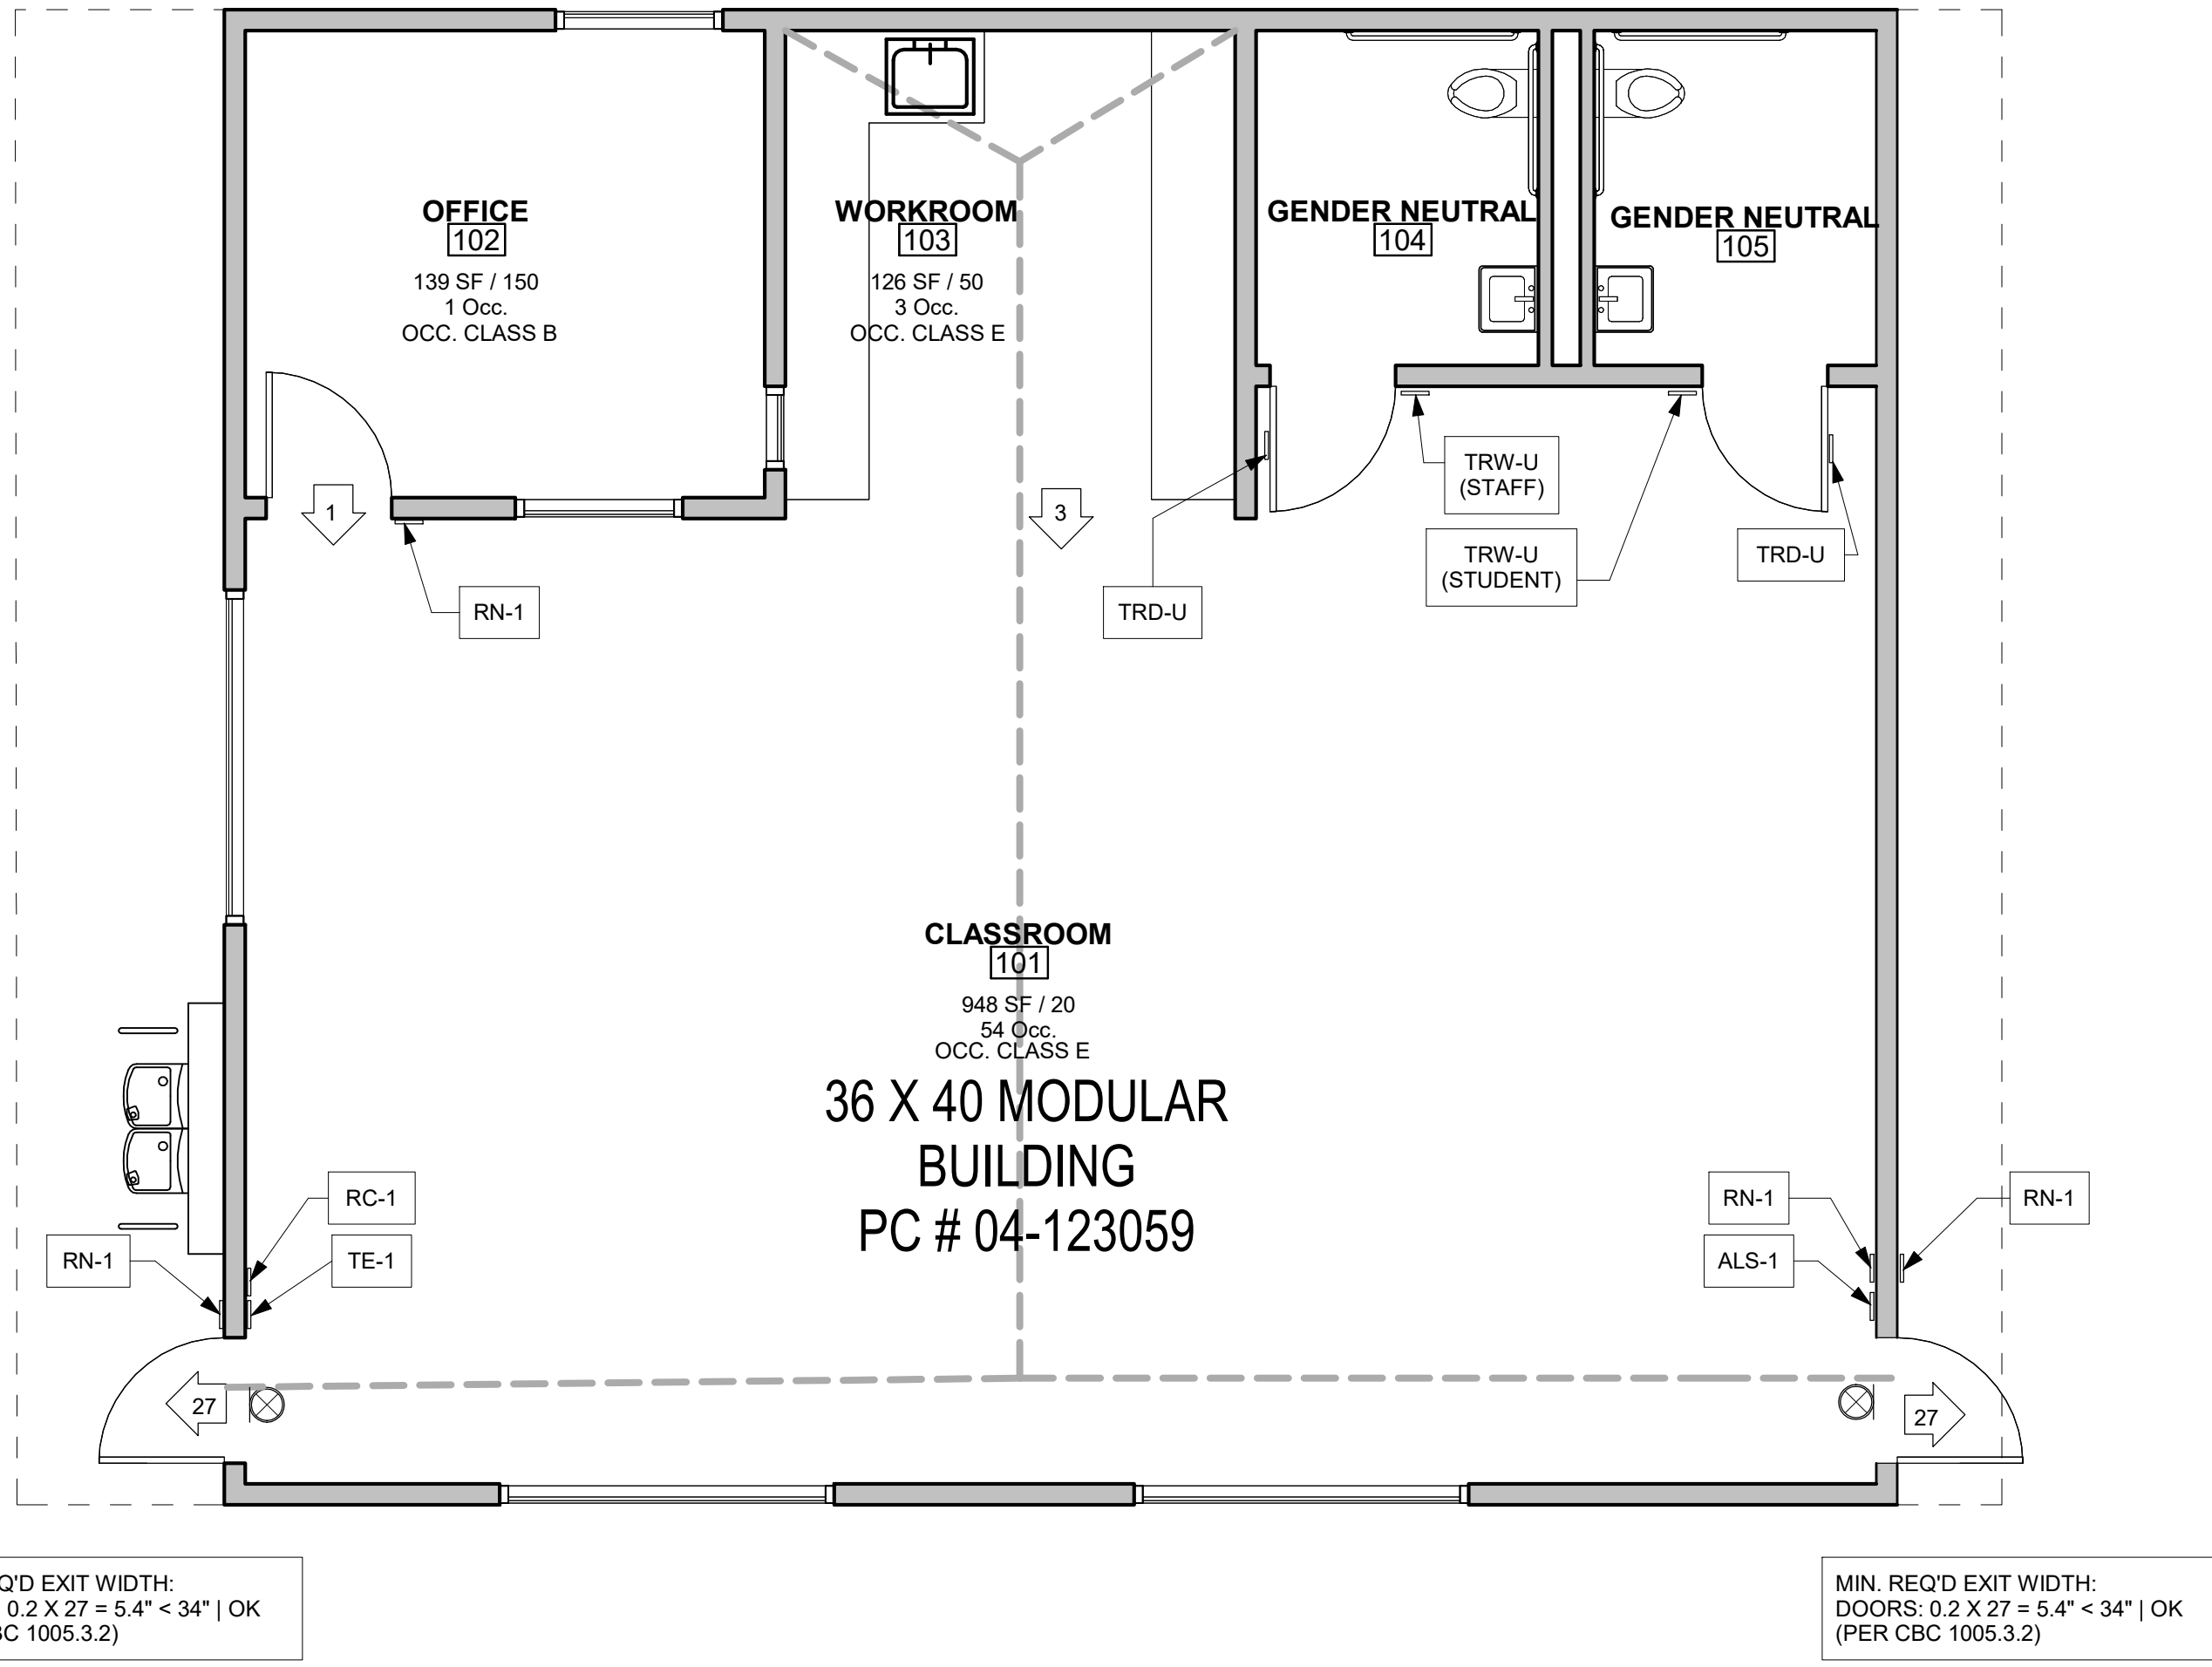

MIN. REQ'D EXIT WIDTH:
DOORS: 0.2 X 27 = 5.4" < 34" | OK
(PER CBC 1005.3.2)

MIN. REQ'D EXIT WIDTH:
DOORS: 0.2 X 27 = 5.4" < 34" | OK
(PER CBC 1005.3.2)

NOTE: SITE CONTRACTOR TO PROVIDE
JUNCTION BOX COVER PLATES AS REQUIRED

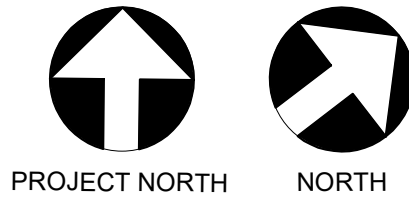

EXIT ANALYSIS AND SIGNAGE PLAN

1/4" = 1'-0" 2

SIGNAGE LEGEND

FOR TYPICAL IDENTIFICATION AND
TACTILE SIGNAGE, SEE DETAIL 4 A800

- (RN - 1) PROVIDE ROOM IDENTIFIATION SIGN
- (TE - 1) PROVIDE EXIT SIGNAGE AT INTERIOR SIDE OF DOOR
- (ALS - 1) PROVIDE ASSISTED LISTENING SIGNAGE AT INTERIOR SIDE OF DOOR
- (TRW-U) PROVIDE WALL MOUNTED TOILET ROOM SIGNAGE AT EXTERIOR SIDE OF DOOR, LABELED "STAFF RESTROOM"
- (TRW-U) PROVIDE WALL MOUNTED TOILET ROOM SIGNAGE AT EXTERIOR SIDE OF DOOR, LABELED "STUDENT RESTROOM"
- (TRD - U) PROVIDE DOOR MOUNTED TOILET ROOM SIGNAGE
- (RC - 1) ROOM CAPACITY SIGN

EXIT ANALYSIS LEGEND

- PATH OF EGRESS TRAVEL
- xx NUMBER OF OCCUPANTS EXITING
- ROOM 101 ROOM NAME & NUMBER
- 150 SF / 50 ROOM AREA
- 00 OCC. OCCUPANT LOAD FACTOR
- CALCULATED LOAD FACTOR
- ILLUMINATED EXIT SIGNS. SEE ELECTRICAL FOR ADDITIONAL INFORMATION

GENERAL NOTES

- OWNER TO PROVIDE EMERGENCY EVACUATION SIGNAGE PER CFC 403.2, 403.4 AND 403.5, AS APPLICABLE, PRIOR TO OCCUPANCY OF THE BUILDINGS OR CAMPUS.
 - EGRESS WIDTH COMPONENT (CBC SECTION 1005.3.2) : 0.2"/OCC.; A 36" WIDE DOOR HAS A CLEAR WIDTH OF 33" MIN. AND WILL ACCOMMODATE 165 OCCUPANTS.
- ASSISTIVE LISTENING:** CLASSROOM 48 OCC
- 48 X 4" = 2 RECIEVERS MIN.
- OWNER TO PROVIDE 2 RECIEVERS, 1 TO BE HEARING AID COMPATIBLE
- TOTAL OCCUPANTS:** 54

IDENTIFICATION STAMP	
DIV. OF THE STATE ARCHITECT	
APP. 02-122690	INC.
REVIEWED FOR	
SS <input type="checkbox"/>	FLS <input type="checkbox"/>
DATE: 11/26/2024	


Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.

FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
FLOOR PLANS


PROJECT NO.

23-12899

DRAWING

A200

PLOT DATE: 11/1/2024 12:11:34 PM

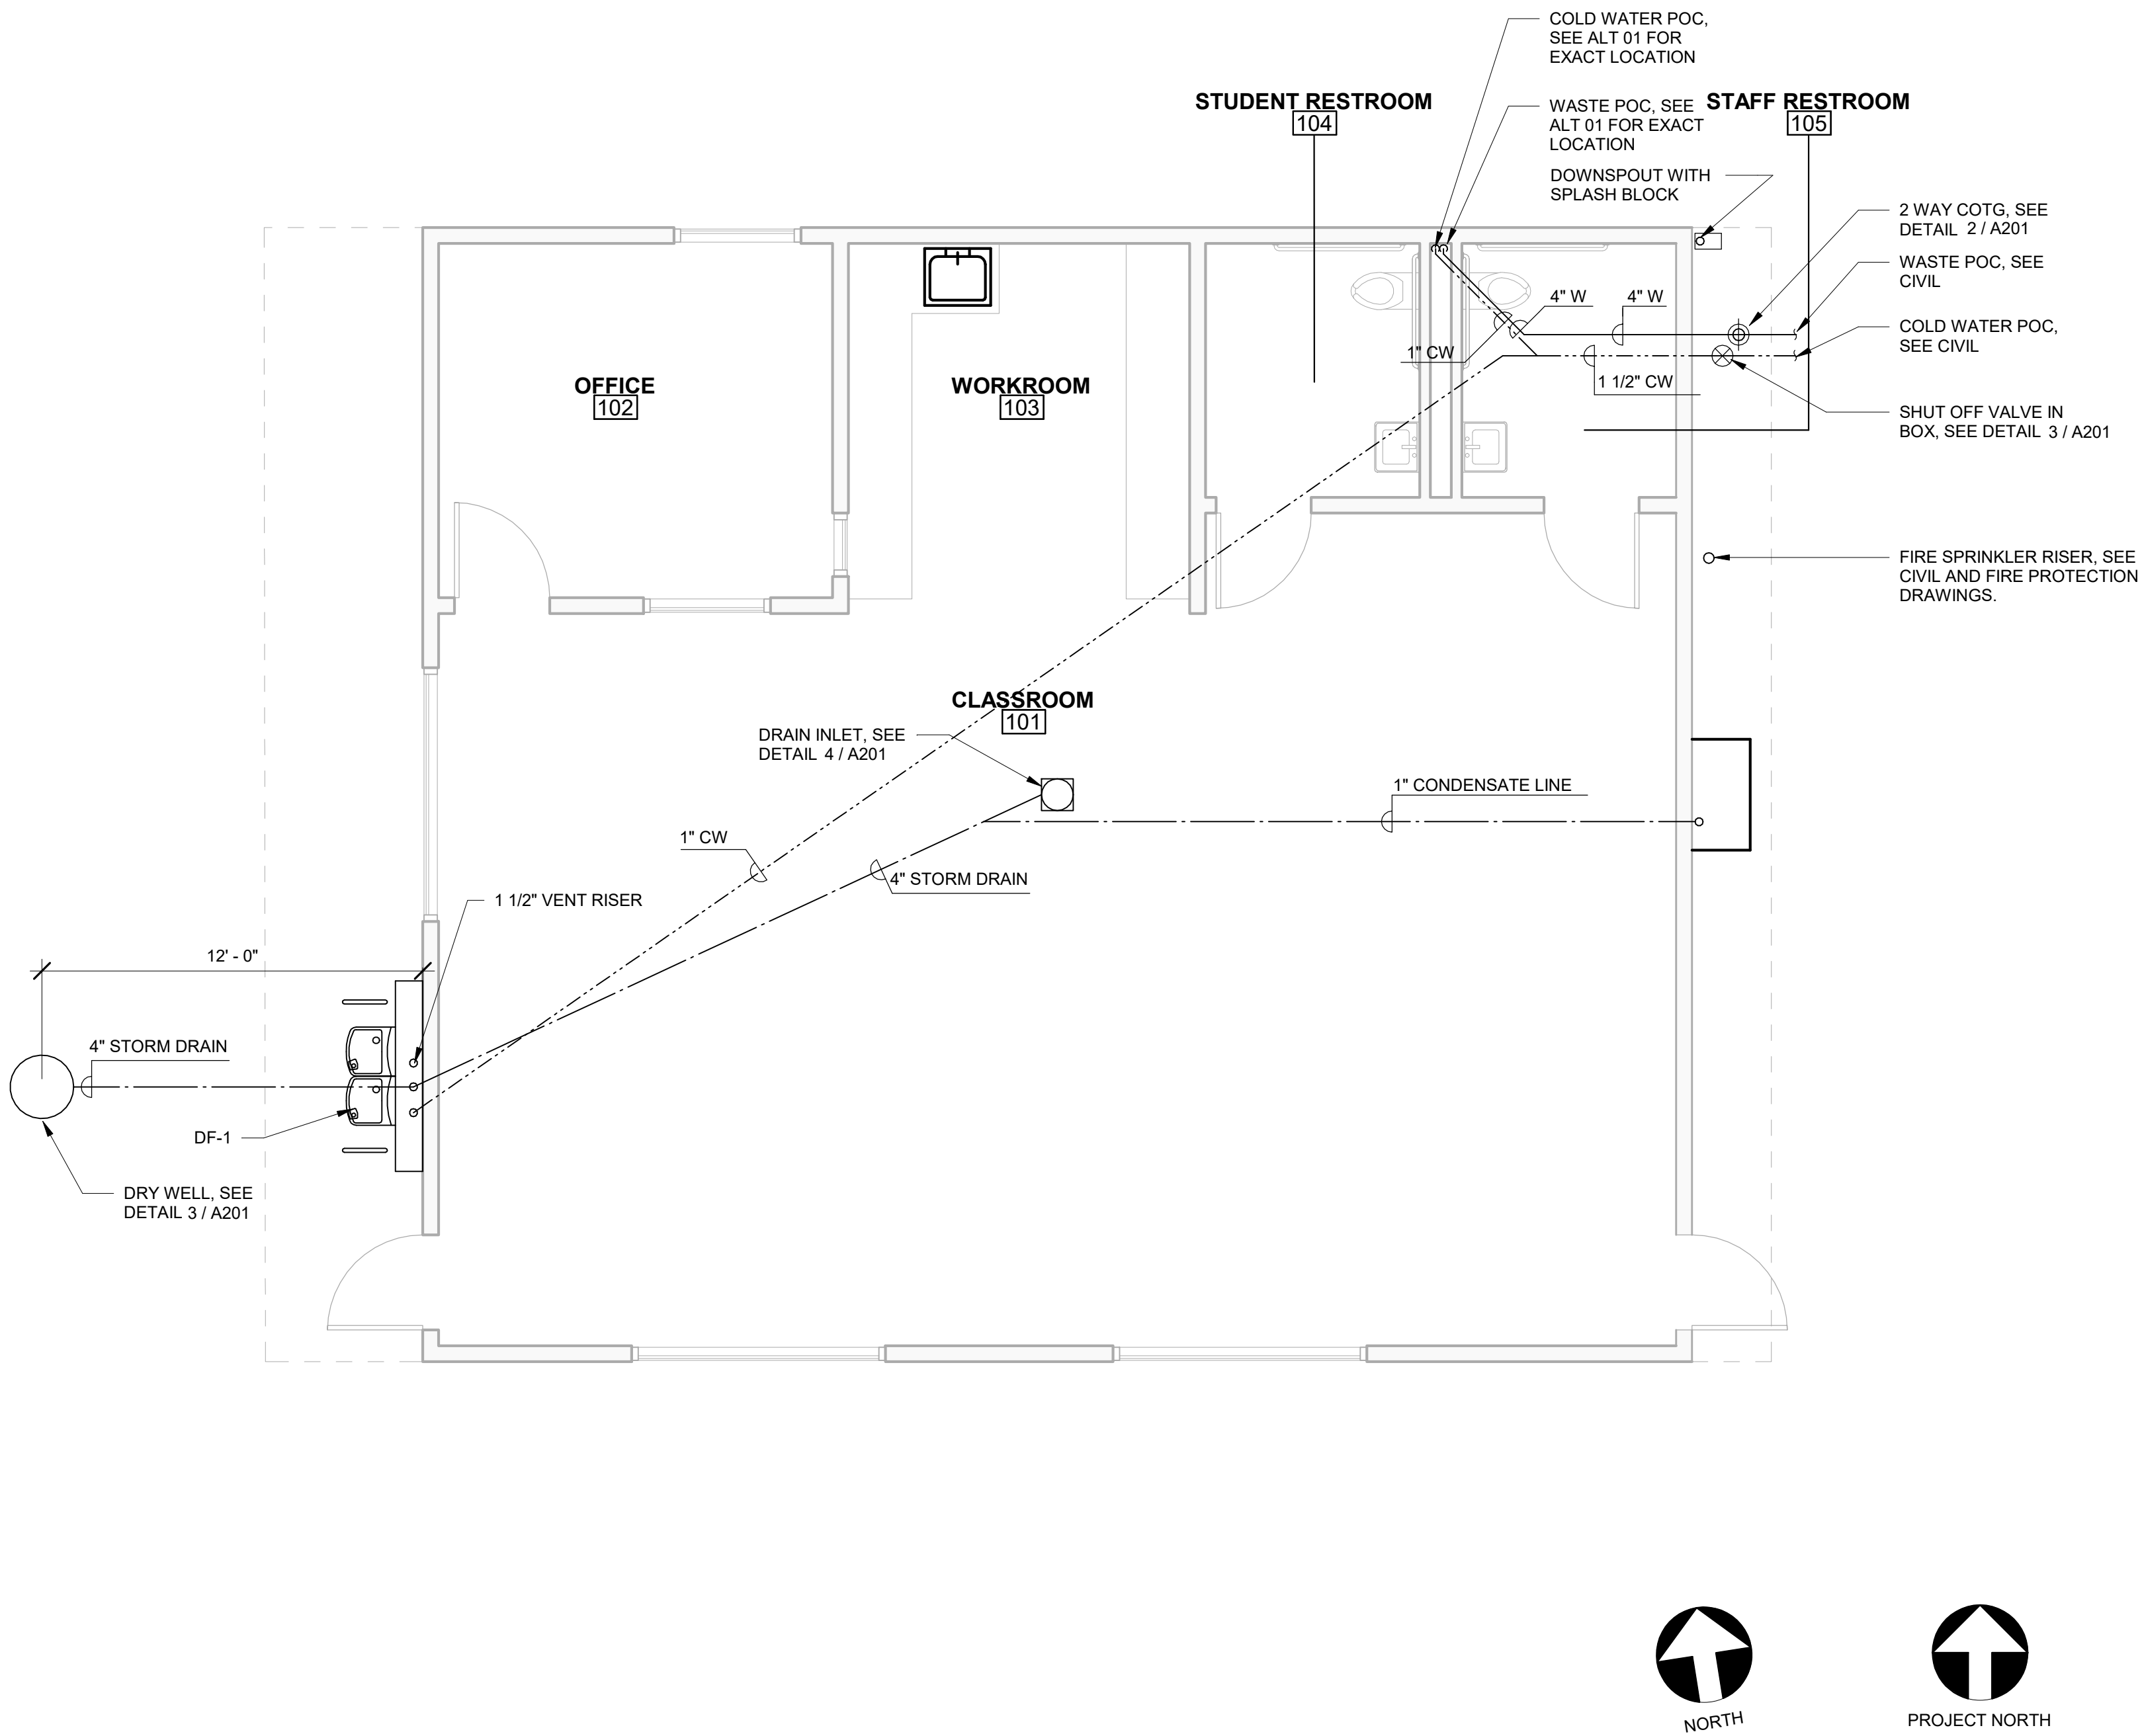

PLUMBING FLOOR PLAN

1/4" = 1'-0"

7

MARK	FIXTURE	S OR W	V	CW	DESCRIPTION
DF-1	DRINKING FOUNTAIN W/BOTTLE FILLER ADA	2"	1-1/2"	1"	MURDOCK DRINKING FOUNTAIN/BOTTLE FILLER, A172-UG-VR-D1-BF SERIES BASE MODEL A172400S-UG-VR-D1 BARRIER FREE, VANDAL RESISTANT, UNIVERSAL BI-LEVEL WALL MOUNTED DRINKING FOUNTAIN WITH VANDAL RESISTANT, PUSHBUTTON OPERATED BOTTLE FILLER, STAINLESS STEEL BUBLER, BOTTLE FILLER WITH PUSHBUTTON OPERATION

PLUMBING GENERAL NOTES

- COORDINATION OF WORK: LAYOUT OF MATERIALS, EQUIPMENT AND SYSTEMS IS GENERALLY DIAGRAMMATIC UNLESS SPECIFICALLY DIMENSIONED. SOME WORK MAY BE SHOWN OFFSET FOR CLARITY.
- THE ACTUAL LOCATION OF ALL MATERIALS, PIPING, DUCTWORK, FIXTURES, EQUIPMENT, SUPPORTS, ETC. SHALL BE CAREFULLY PLANNED, PRIOR TO INSTALLATION OF ANY WORK TO AVOID ALL INTERFERENCES WITH EACH OTHER, OR WITH STRUCTURAL, ELECTRICAL, ARCHITECTURAL OR OTHER ELEMENTS.
- VERIFY THE PROPER VOLTAGE AND PHASE OF ALL EQUIPMENT WITH THE ELECTRICAL PLANS. ALL CONFLICTS SHALL BE CALLED TO THE ATTENTION OF THE ARCHITECT AND THE ENGINEER PRIOR TO THE INSTALLATION OF ANY WORK OR THE ORDERING OF ANY EQUIPMENT.
- ALL DRAWINGS AND SPECIFICATIONS ARE TO BE CONSIDERED PART OF THE CONTRACT DOCUMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REVIEW AND COORDINATION OF ALL DRAWINGS PRIOR TO ANY CONSTRUCTION, INCLUDING ARCHITECTURAL, STRUCTURAL, MECHANICAL, PLUMBING, AND ELECTRICAL. ANY WORK PERFORMED IN CONFLICT WITH THE CONTRACT DOCUMENTS OR ANY CODE REQUIREMENT SHALL BE CORRECTED BY THE CONTRACTOR AT HIS OWN EXPENSE AND AT NO EXPENSE TO THE OWNER OR THE OWNER REPRESENTATIVE.
- MINIMUM SLOPE FOR SEWER IS 1/4" PER FT, UNLESS OTHERWISE NOTED.
- ALL ROOF PENETRATIONS SHALL BE COMPATIBLE WITH ROOF SYSTEM WITH AS FEW PENETRATIONS AS POSSIBLE.
- MINIMUM DOMESTIC WATER PIPE SIZE TO BE 3/4" UNLESS OTHERWISE NOTED. USE A REDUCING ELL AT FIXTURE, IF NECESSARY.
- ALL PLUMBING FIXTURES, VALVES, FAUCETS, FIXTURE STOPS, ETC. WHICH PROVIDE WATER FOR HUMAN CONSUMPTION MUST MEET THE "LEAD FREE" REQUIREMENT FOR THE STATE OF CALIFORNIA.
- PIPING DISTRIBUTION SYSTEMS SHALL BE BRACED TO COMPLY WITH THE FORCES AND DISPLACEMENTS PRESCRIBED IN ASCE 7-16 SECTION 13.3 AS DEFINED IN ASCE 7-16 SECTIONS 13.6.5, 13.6.6, 13.6.7, 13.6.8; AND 2019 CBC, SECTIONS 1617A.1.24, 1617A.1.25 AND 1617A.1.26.


PLUMBING LEGEND

- DOMESTIC COLD WATER
- SOIL OR WASTE
- PIPE TURN UP
- PIPE TURN DOWN

SOV IN BOX

1" = 1'-0"

3

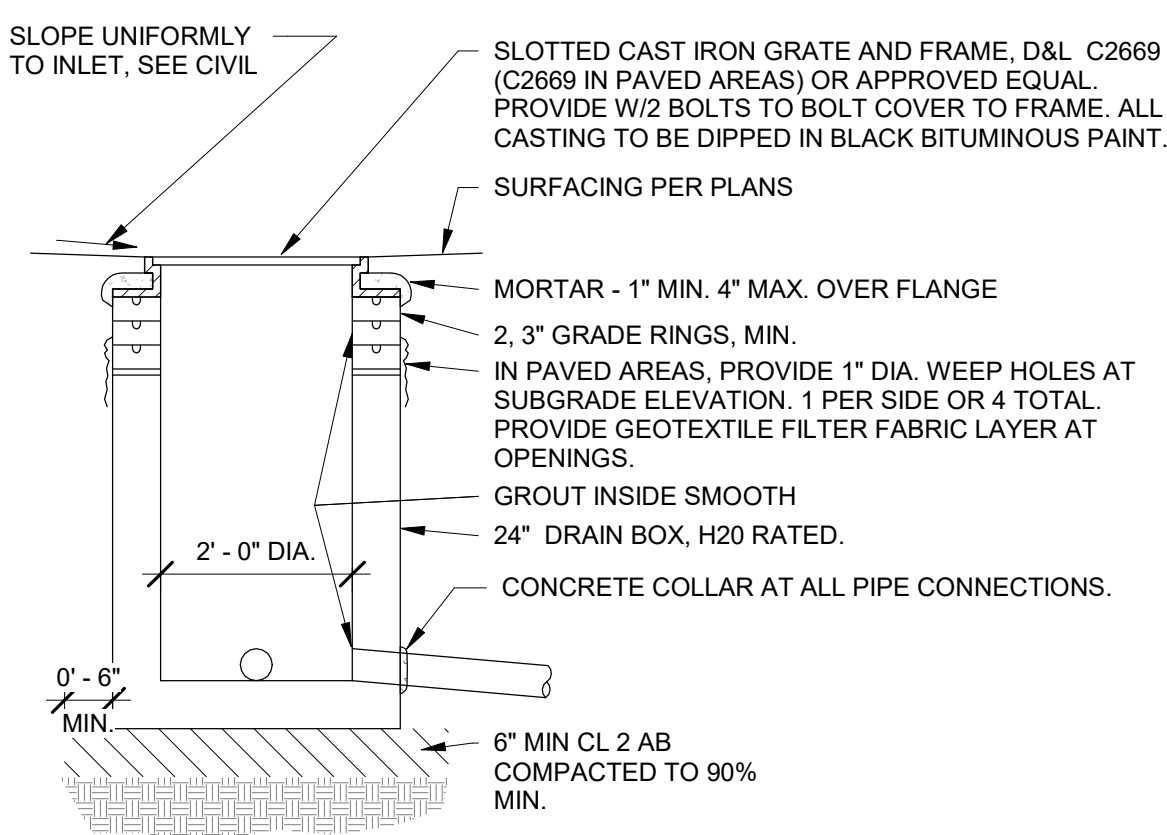

DROP INLET


1/2" = 1'-0"

4

DRY WELL

3/4" = 1'-0"

1

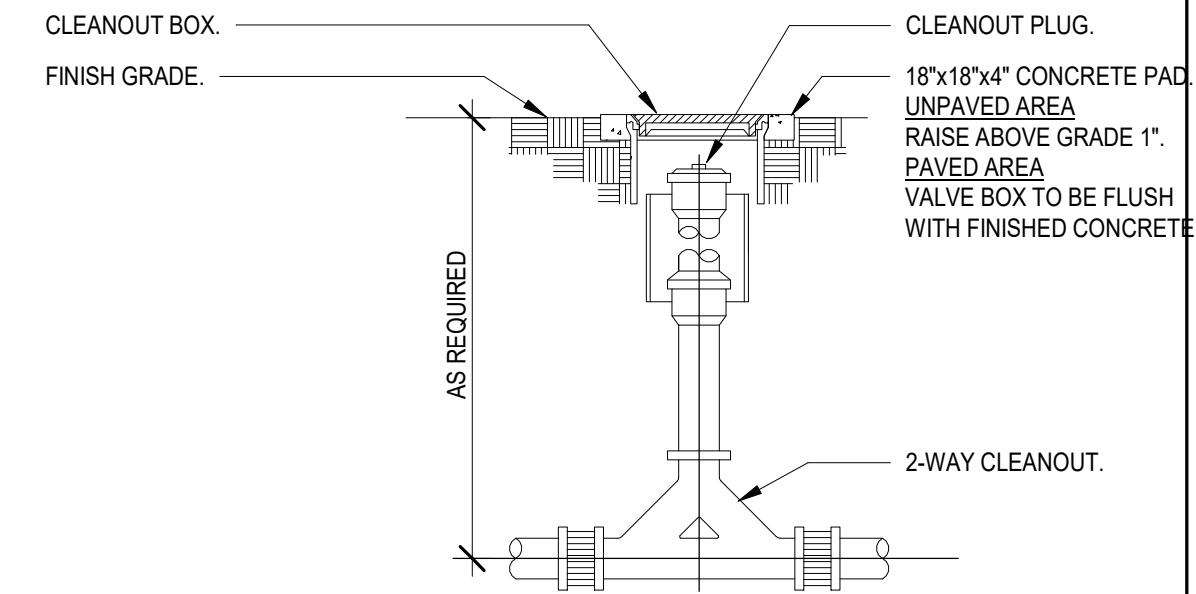


NOTE: ALL CLEANOUT BOXES WITHIN 10'-0" OF EACH OTHER SHALL BE LINED UP WITH EACH OTHER AND PARALLEL TO SIDEWALK OR BUILDING WALL.

2-WAY CLEANOUT TO GRADE

1" = 1'-0"

2

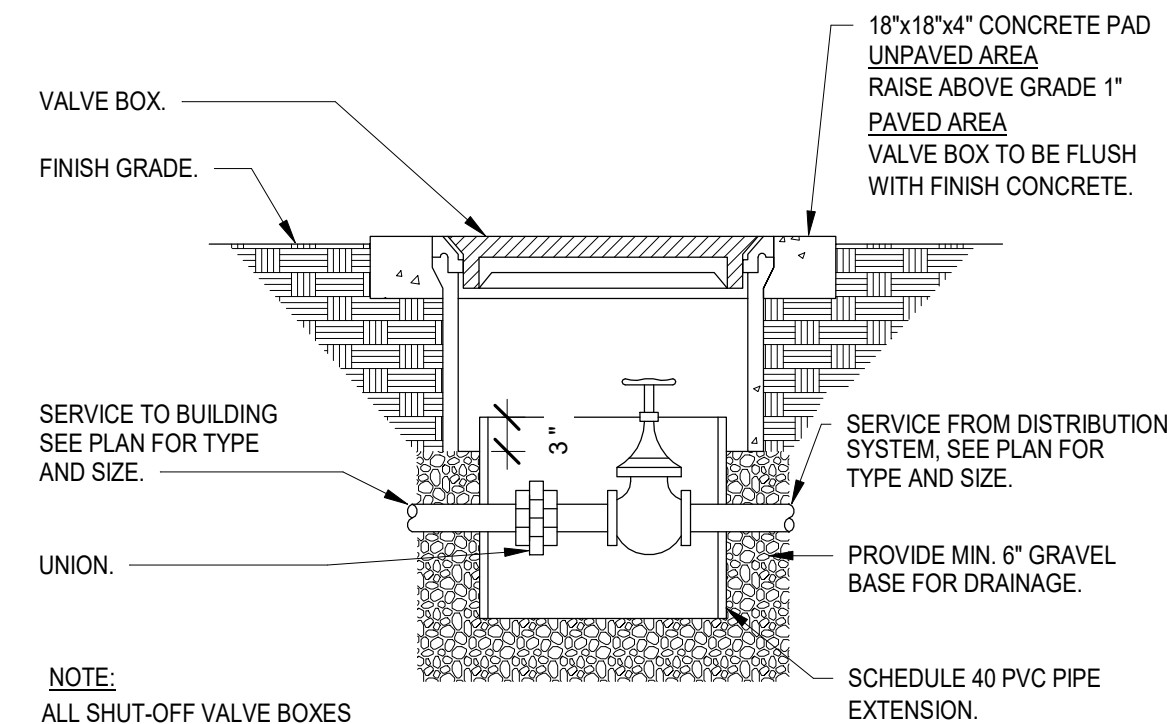

NOTE: ALL SHUT-OFF VALVE BOXES WITHIN 10'-0" OF EACH OTHER SHALL BE LINED UP WITH EACH OTHER AND PARALLEL TO SIDEWALK OR BUILDING WALL. DO NOT LOCATE IN SIDEWALKS.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024


Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.

FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA

PROJECT NO.

23-12899



DRAWING

A201

DRAWING TITLE
PLUMBING FLOOR PLAN

\\tetr-file1\Users\dylan.seaton_TETR\Documents\12899-A-STOCKTON PEYTON ELEM ELOP.dylan.seatonFLU7Z.rvt

PLOT DATE: 11/1/2024 12:11:37 PM

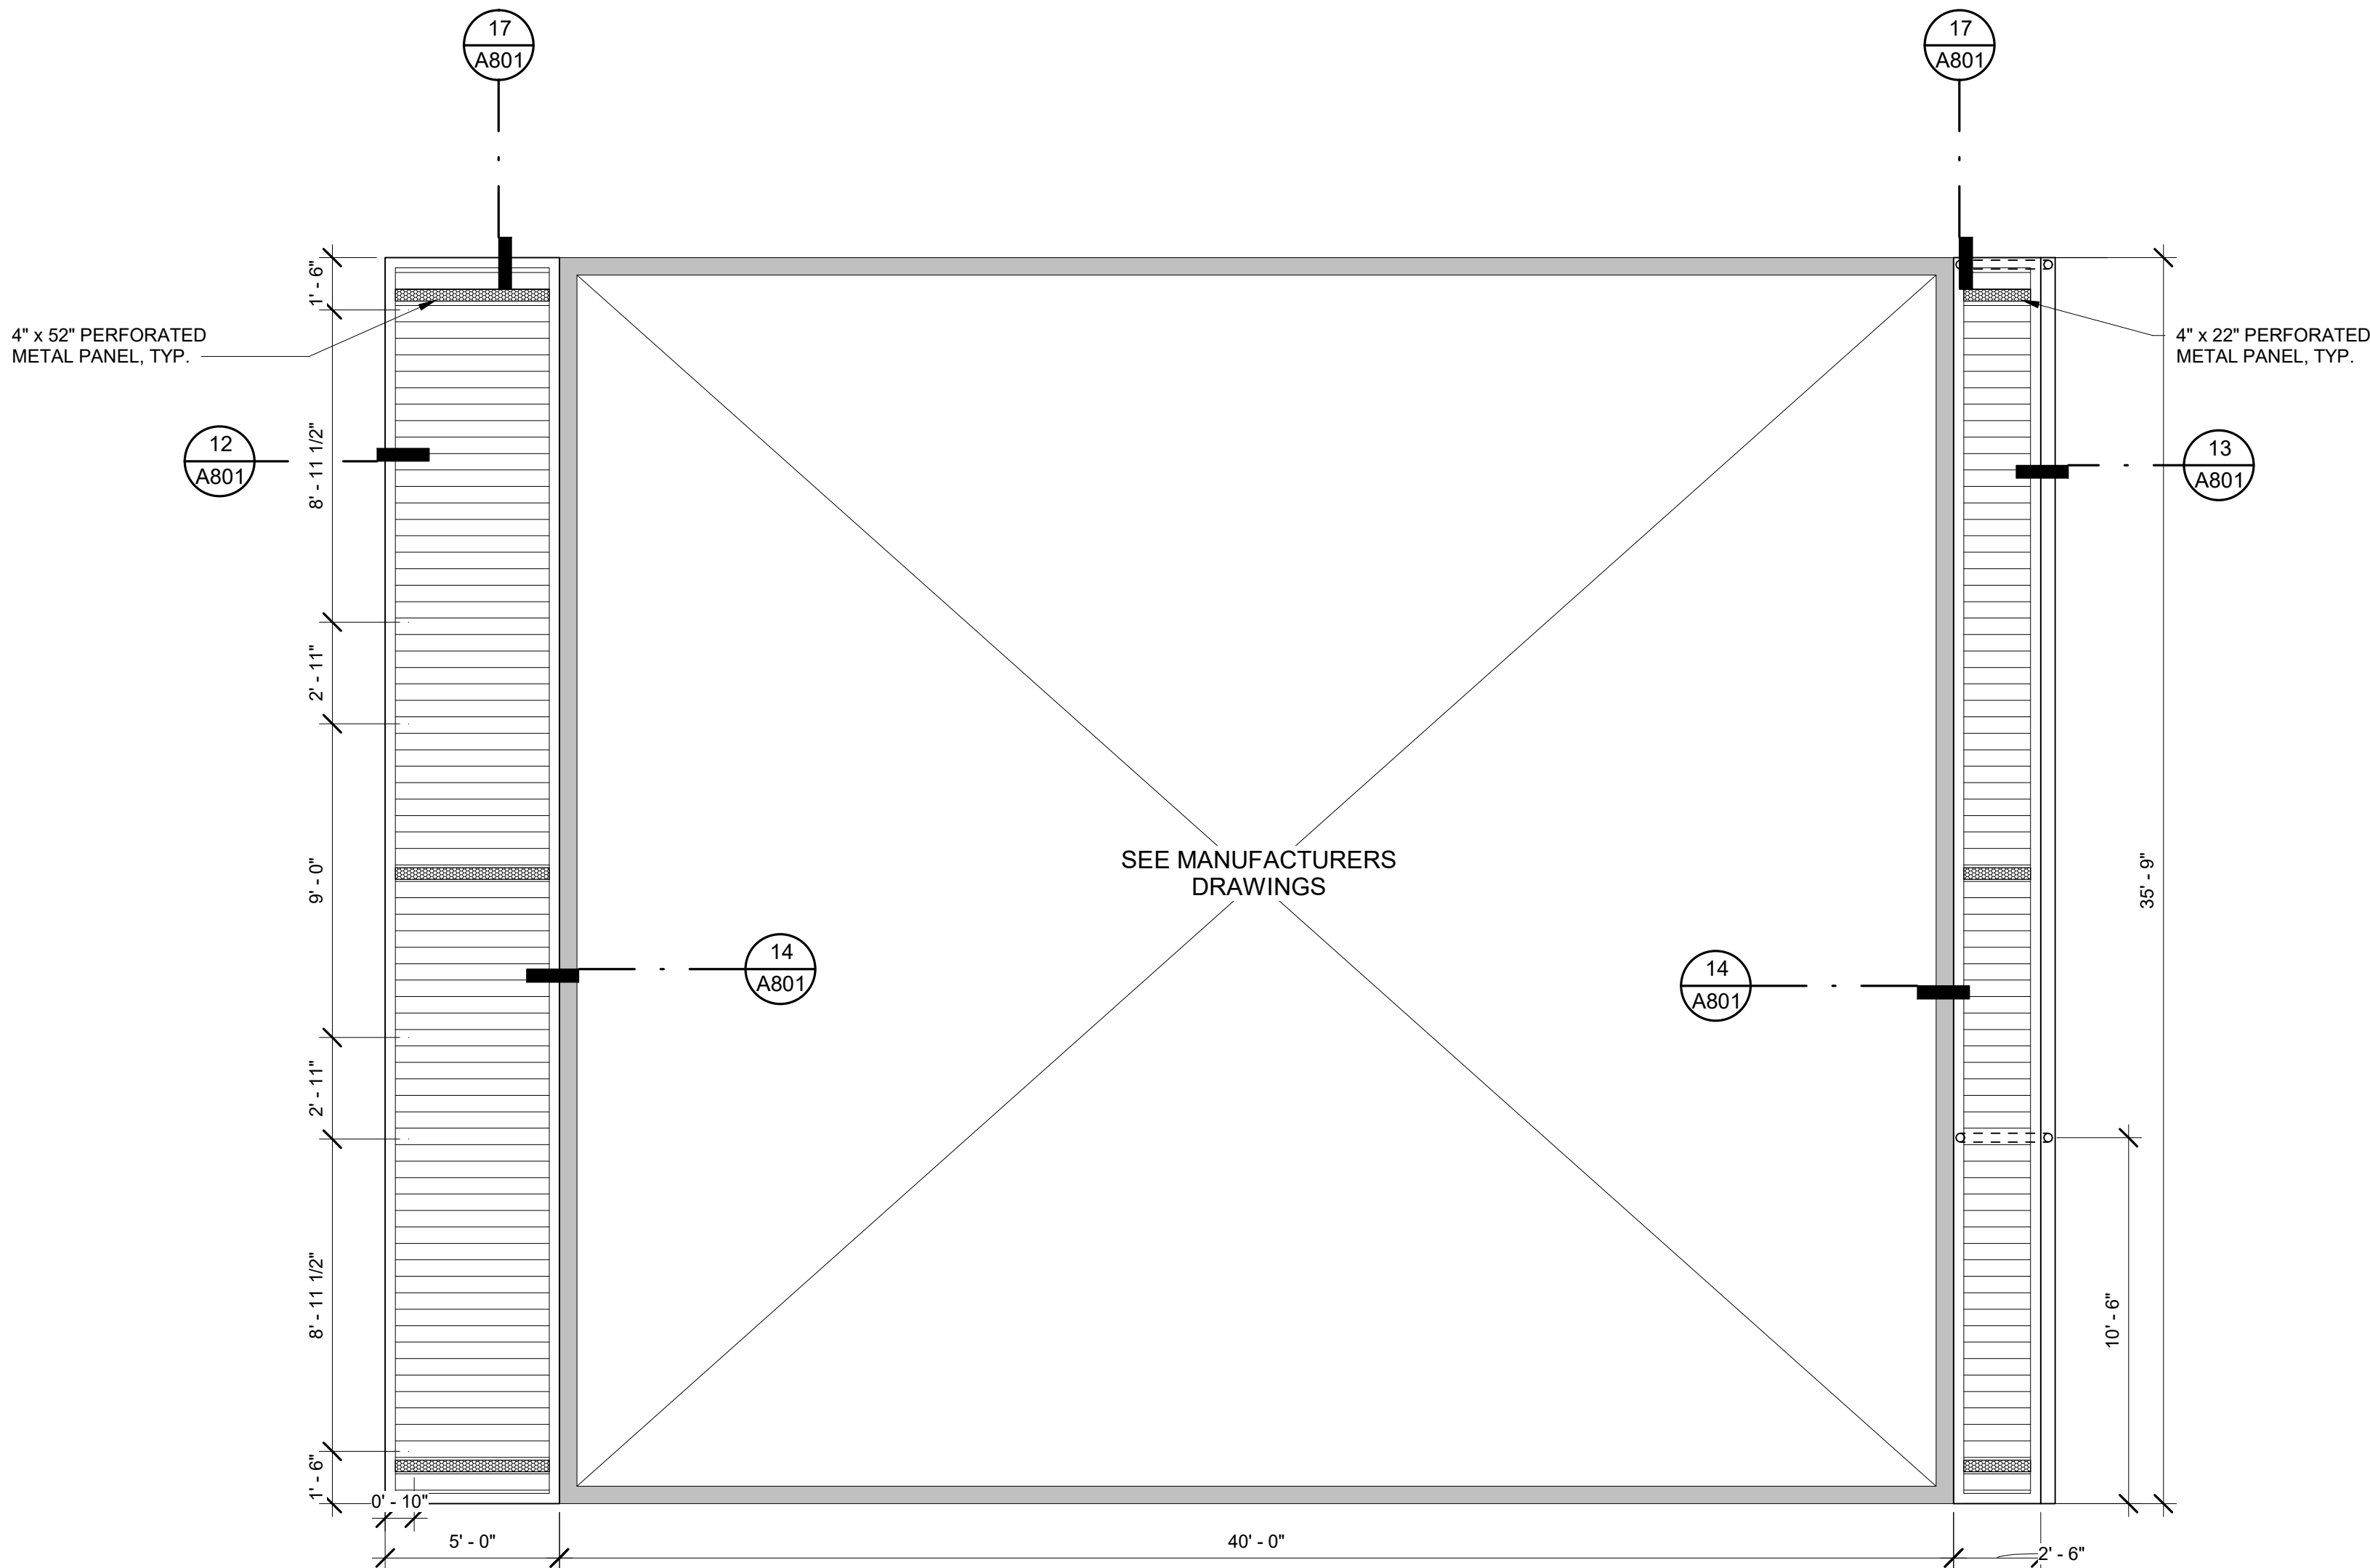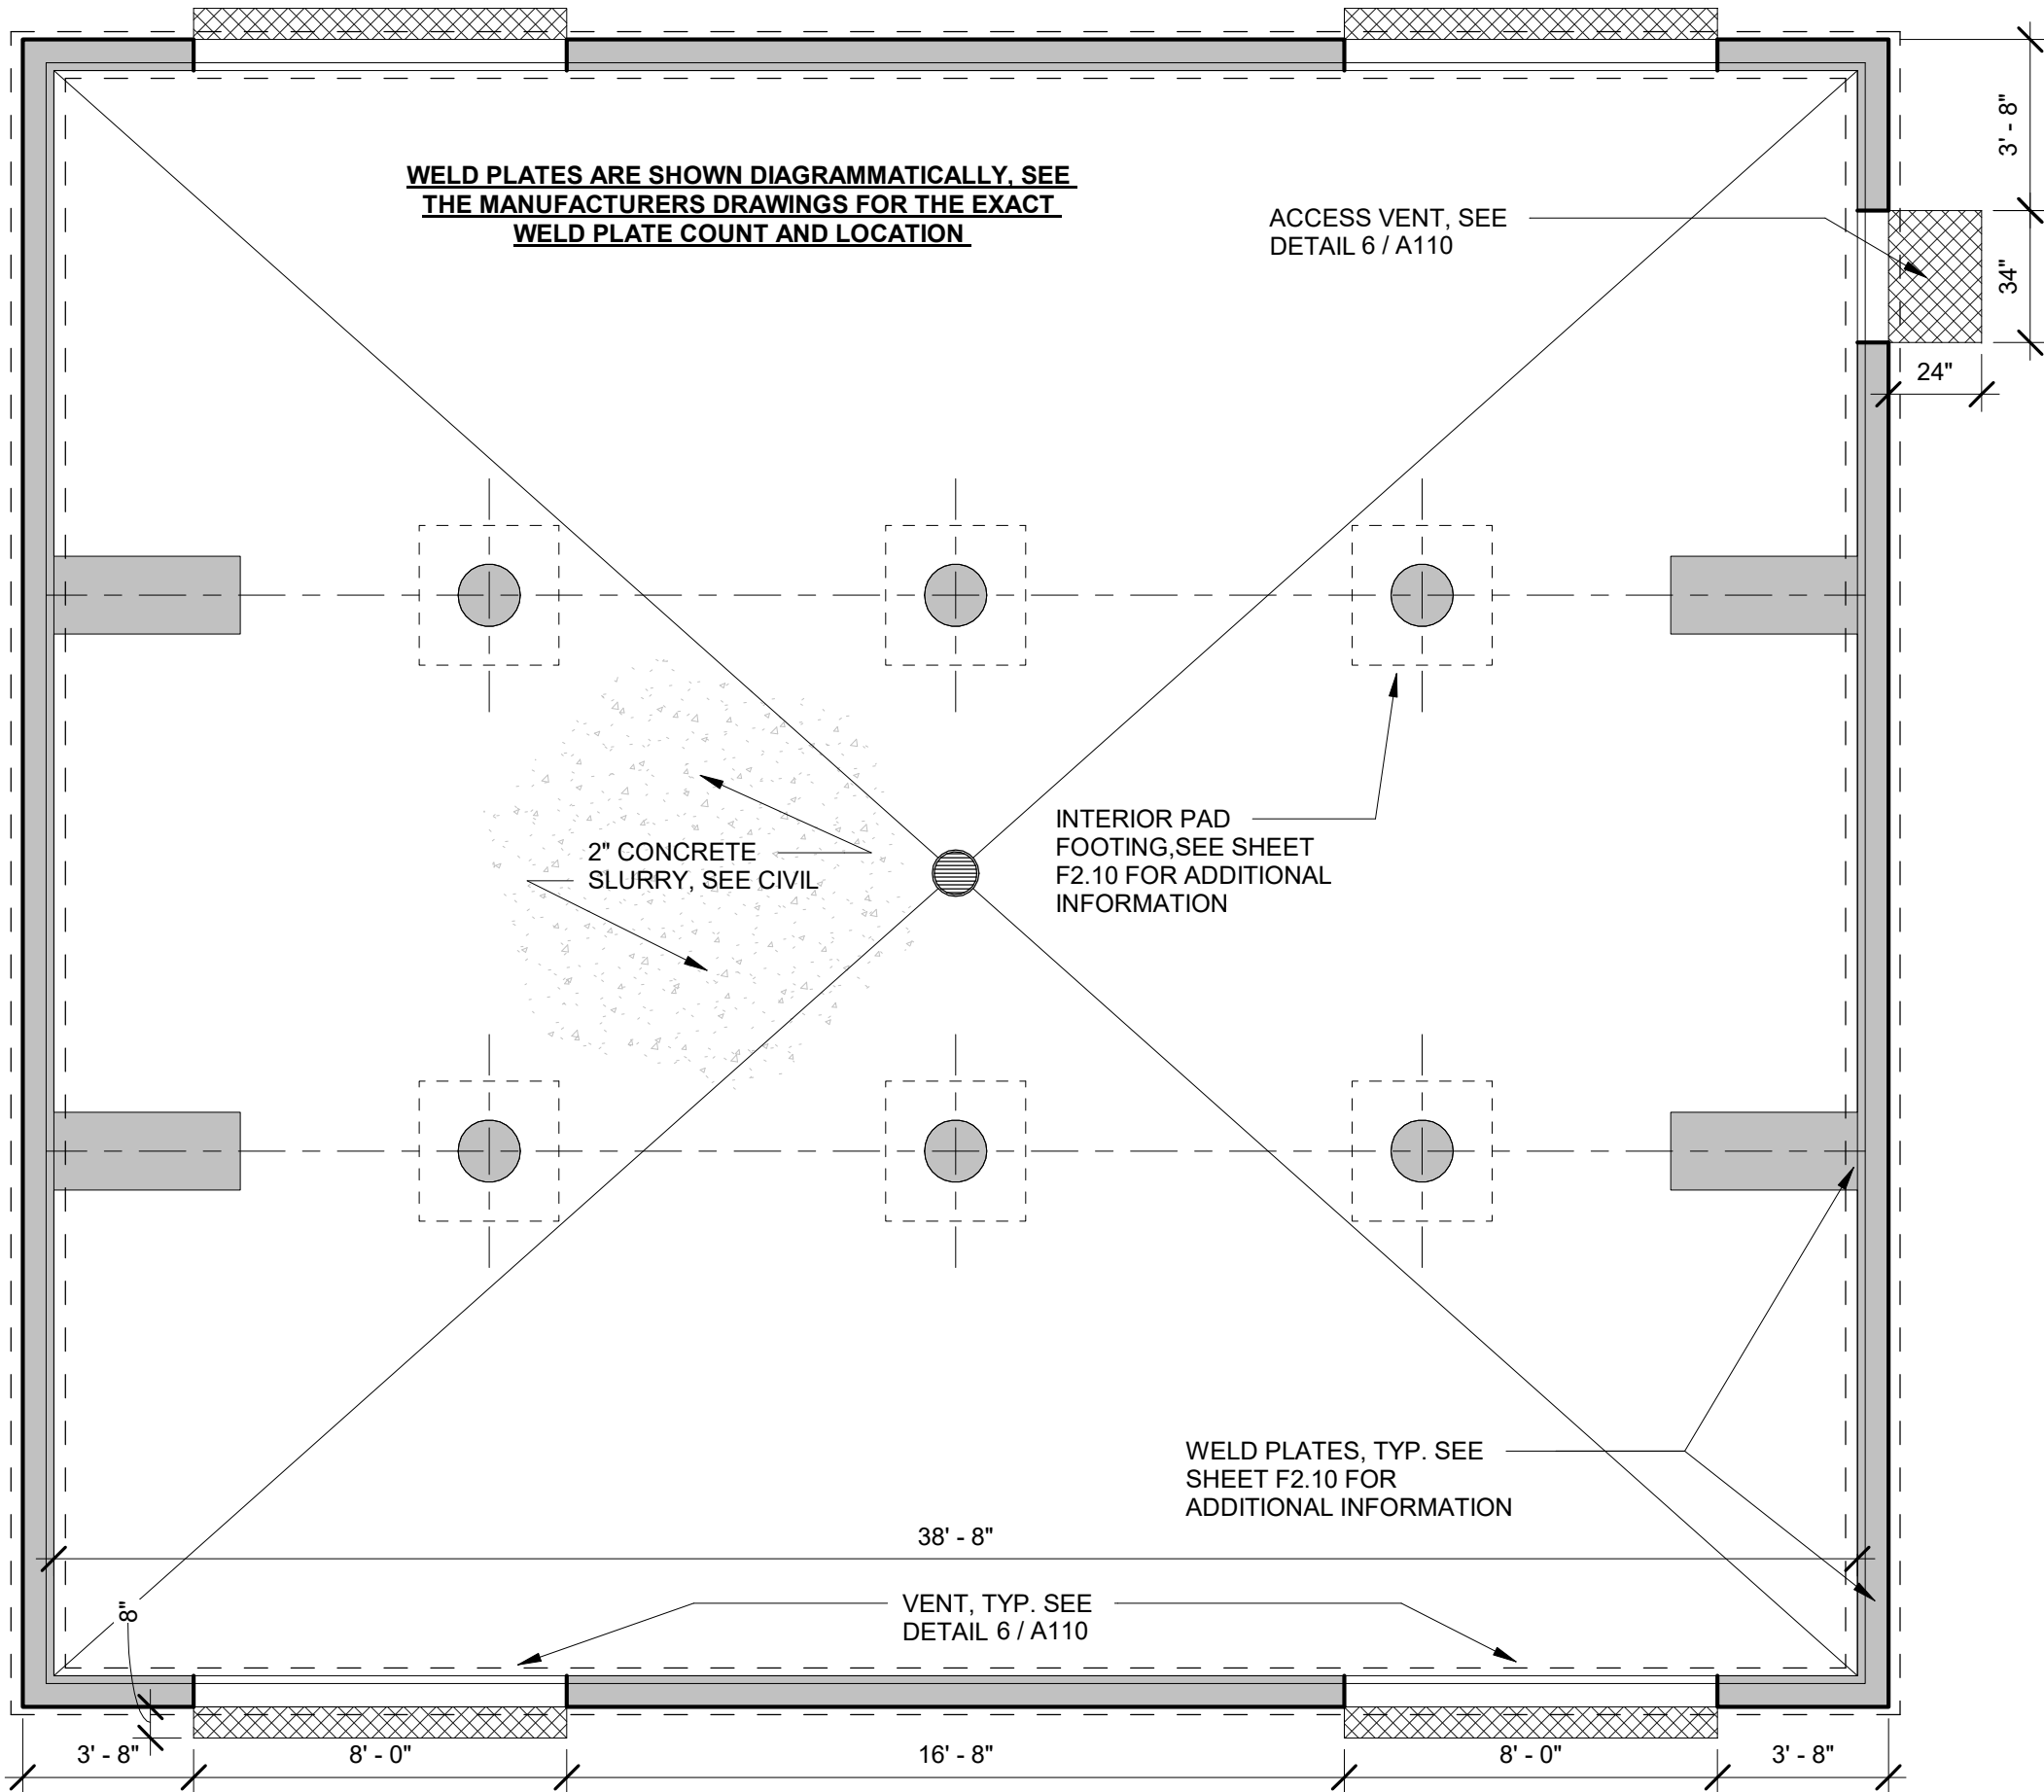


GENERAL NOTES

- MODULAR MANUFACTURER WILL PROVIDE THE WELD PLATES TO THE SITE CONTRACTOR. THE SITE CONTRATOR IS RESPONSIBLE FOR THE PLACEMENT OF THE WELD PLATES.
- SITE CONTRACTOR IS RESPONSIBLE FOR PROVIDING AND INSTALLING THE BUILDING FOUNDATION AS SHOWN IN THE MANUFACTURERS DRAWINGS.
- SITE CONTRACTOR IS TO MEASURE AND VERIFY EXACT BUILDING SIZE AT THE MANUFACTURERS WAREHOUSE PRIOR TO THE EXCAVATION AND THE PLACMENT OF BUILDING FOUNDATION.
- SITE CONTRACTOR IS RESPONSIBLE FOR THE OFFLOADING AND INSTALLATION OF THE RELOCATABLE MODULES ON THE BUILDING FOUNDATION.

PIT VENT CALCULATION

PIT SIZE 34'-5" X 38'-8"
1330SF + 150 = 8.66SF
8.66SF X 144 = 1275.84
VENT 5" X 96" = 480" X .74 = 355.2
355.2 X 4 = 1420.8

REQUIRED 1275.84IN < PROVIDED 1420.8 = OK

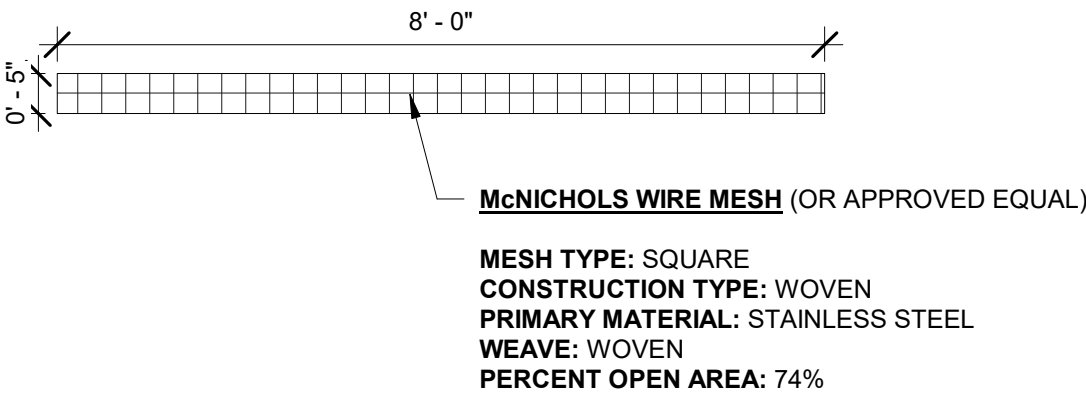

OVERHANG VENT CALCULATION


OVERHANG 2'-6" X 35'-9"
89SF + 150 = 59SF
.59SF X 144 = 84.96IN
4" X 22" = 88"
88" X 3 = 264IN

REQUIRED 84.96IN < PROVIDED 264IN = OK

OVERHANG 5'-0" X 35'-9"
89SF + 150 = 1.18SF
1.18SF X 144 = 169.92IN
4" X 52" = 208IN
208" X 3 = 624IN

REQUIRED 169.92IN < PROVIDED 624 = OK

LEGEND




METAL PANELS
LATITUDE SERIESAS WALL PANELS
LW6S SYMMETRICAL PROFILE


IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL

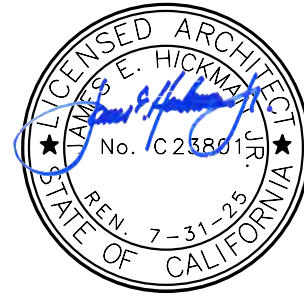


TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

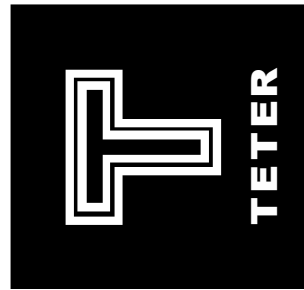

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
VENTING FLOOR PLANS

PROJECT NO.
23-12899
DRAWING

A202

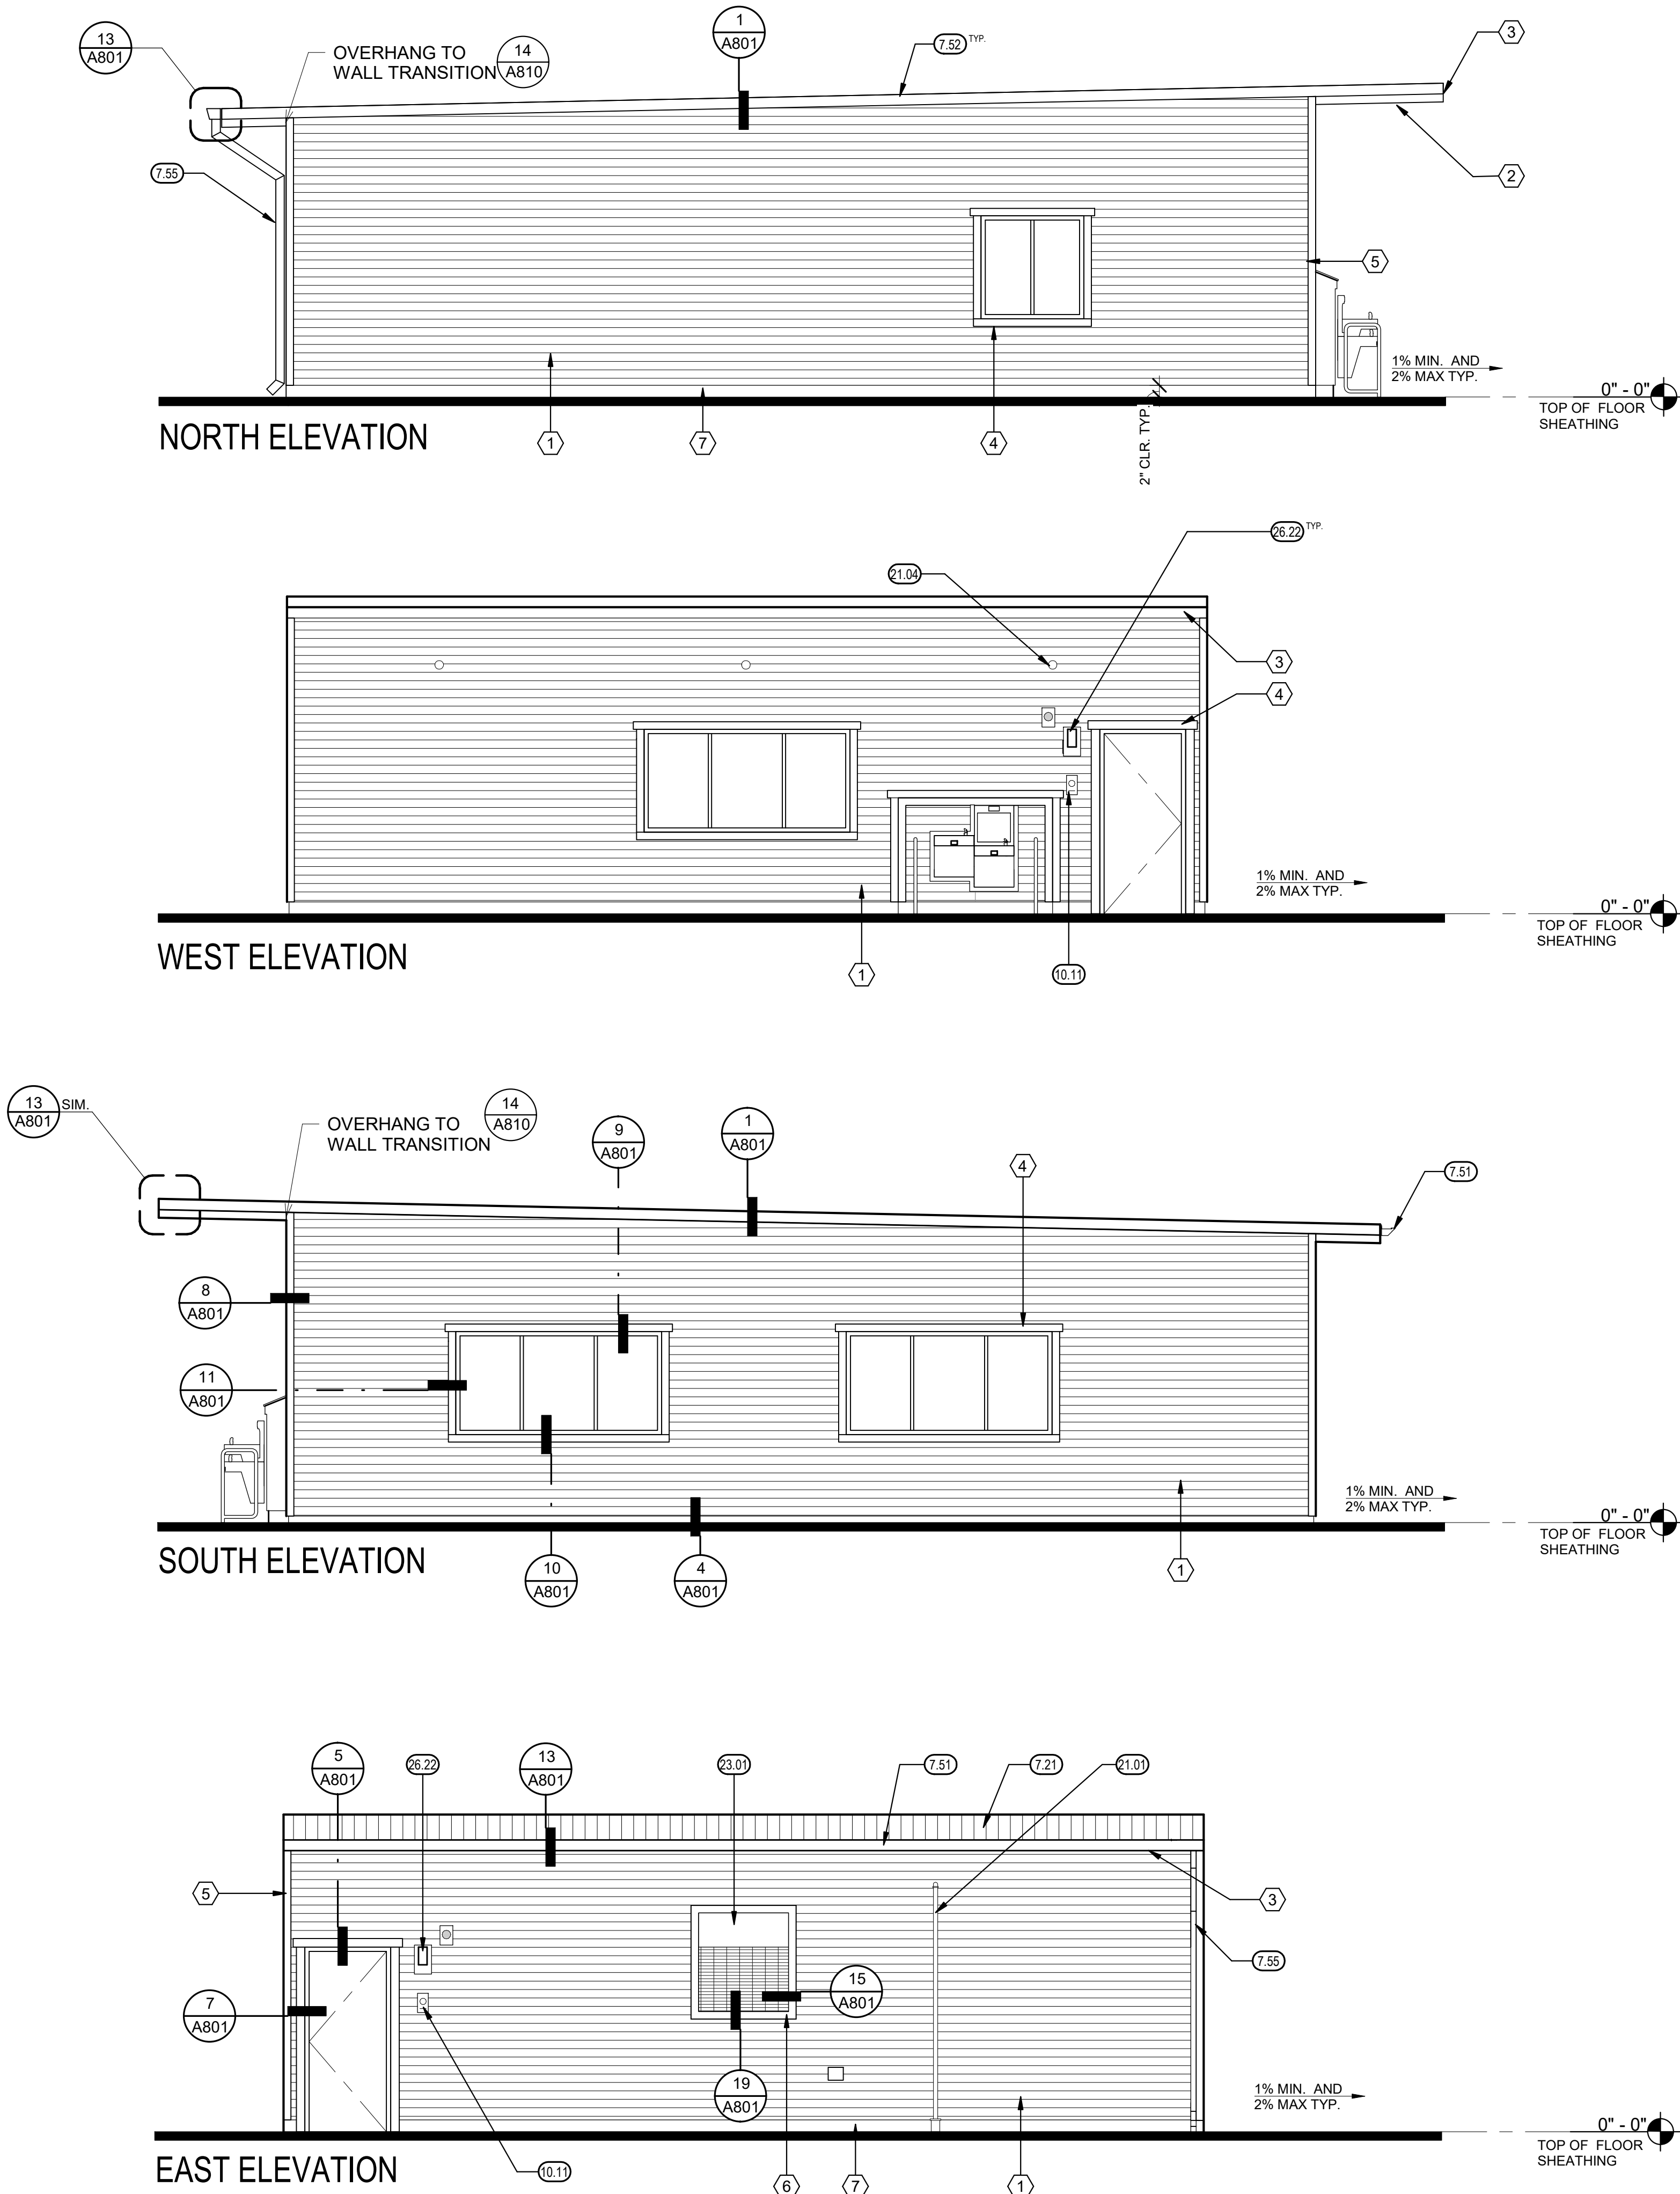

EXTERIOR ELEVATIONS

1/4" = 1'-0"

4

KEYNOTES

- 7.21 STANDING SEAM METAL ROOF AND FLASHING, PROVIDED AND INSTALLED OFF SITE BY CLASS LEASING. SEE RELOCATABLE DRAWINGS FOR ADDITIONAL INFORMATION
- 7.51 GUTTER PROVIDED BY CLASS LEASING. SITE CONTRACTOR TO REMOVE AND SALVAGE FOR RE-INSTALLATION AFTER FINISHES HAVE BEEN INSTALLED
- 7.52 PRE-FINISHED METAL FLASHING TRIM PROVIDED AND INSTALLED BY CLASS LEASING OFF SITE. SITE CONTRACTOR TO REMOVE AND SALVAGE FOR RE-INSTALLATION AFTER FINISHES HAVE BEEN INSTALLED
- 7.55 SHEET METAL DOWN SPOUT (SPILL AT GRADE) AND BRACKETS PROVIDED BY CLASS LEASING. SITE CONTRACTOR TO REMOVE AND SALVAGE FOR RE-INSTALLATION AFTER FINISHES HAVE BEEN INSTALLED.
- 10.11 SIGNAGE BY SITE CONTRACTOR, SEE SIGNAGE PLAN ON A200 FOR ADDITIONAL INFORMATION
- 21.01 FIRE SPRINKLER RISER, SEE CIVIL AND FIRE SPRINKLER DRAWINGS
- 21.04 FIRE SPRINKLER CLEAN OUTS, SEE FIRE SUPPRESSION DRAWINGS
- 23.01 HVAC UNIT, SEE NEW RELOCATABLE CLASSROOM BUILDING DRAWINGS
- 26.22 EXTERIOR LIGHT PROVIDED BY CLASS LEASING. SITE CONTRACTOR TO REMOVE AND SALVAGE FOR RE-INSTALLATION AFTER FINISHES HAVE BEEN INSTALLED

EXTERIOR FINISH SCHEDULE


MARK	MATERIAL	DETAIL
①	FIBER CEMENT BOARD, LAP SIDING (PRIMED FOR PAINT) FINISH TEXTURE: SMOOTH EXTERIOR PAINT: MATCH EXISTING CAMPUS COLORS ICC ESR - 2290	2 / A801
②	FIBER CEMENT SOFFIT PANEL (PRIMED FOR PAINT) FINISH TEXTURE: SMOOTH EXTERIOR PAINT: MATCH EXISTING CAMPUS COLORS ICC ESR - 2273	13 / A801
③	FIBER CEMENT TRIM BOARD (PRIMED FOR PAINT) FINISH TEXTURE: SMOOTH EXTERIOR PAINT: MATCH EXISTING CAMPUS COLORS ICC ESR - 2273	13 / A801
④	1X4 DOOR AND WINDOW TRIM EXTERIOR PAINT: MATCH EXISTING CAMPUS COLORS	
⑤	1X4 CORNER TRIM EXTERIOR PAINT: MATCH EXISTING CAMPUS COLORS	
⑥	1X4 TRIM AT HVAC UNIT EXTERIOR PAINT: MATCH EXISTING CAMPUS COLORS	
⑦	1X6 BASE TRIM AT FINISH GRADE EXTERIOR PAINT: MATCH EXISTING CAMPUS COLORS	
NOTE: MINIMUM OF 3 PAINT COLORS FOR THE BUILDING		

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☐ FLS ☐ ACS ☐
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.	
B	07/31/2024
C	11/01/2024



TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED




ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
EXTERIOR ELEVATIONS

PROJECT NO.

23-12899

DRAWING

A300



The diagram illustrates the experimental setup. It shows a horizontal surface divided into three sections. The left section is labeled 'CARPET' and is represented by a dense pattern of short vertical lines. The middle section is labeled 'FLUSH' and is represented by a single vertical line with two downward-pointing arrows. The right section is labeled 'WALK OFF MAT' and is represented by a pattern of longer, more widely spaced vertical lines.

WALL FRAMING AND WALL FINISHES BY CLASS LEASING




















RUBBER TOP SET BASE BY SITE CONTRACTOR

FLOORING, SEE 12 / A200

TYPICAL BASE AT WALL BOARD

TABLE 11B-703.5.5 (VISUAL CHARACTER HEIGHT)		
HEIGHT TO FINISH FLOOR OR GROUND FROM BASELINE OF CHARACTER	HORIZONTAL VIEWING DISTANCE	MINIMUM CHARACTER HEIGHT
40 INCHES TO LESS THAN OR EQUAL TO 70 INCHES	LESS THAN 72 INCHES	5/8 INCHES
	72 INCHES AND GREATER	5/8 INCHES, PLUS 1/8 INCH PER FOOT OF VIEWING DISTANCE ABOVE 72 INCHES
GREATER THAN 70 INCHES TO LESS THAN OR EQUAL TO 120 INCHES	LESS THAN 180 INCHES	2 INCHES
	180 INCHES AND GREATER	2 INCHES, PLUS 1/8 INCH PER FOOT OF VIEWING DISTANCE ABOVE 180 INCHES
GREATER THAN 120 INCHES	LESS THAN 21 FEET	3 INCHES
	21 FEET AND GREATER	3 INCHES, PLUS 1/8 INCH PER FOOT OF VIEWING DISTANCE ABOVE 21 FOOT

$$1\frac{1}{2}'' = 1'-0''$$

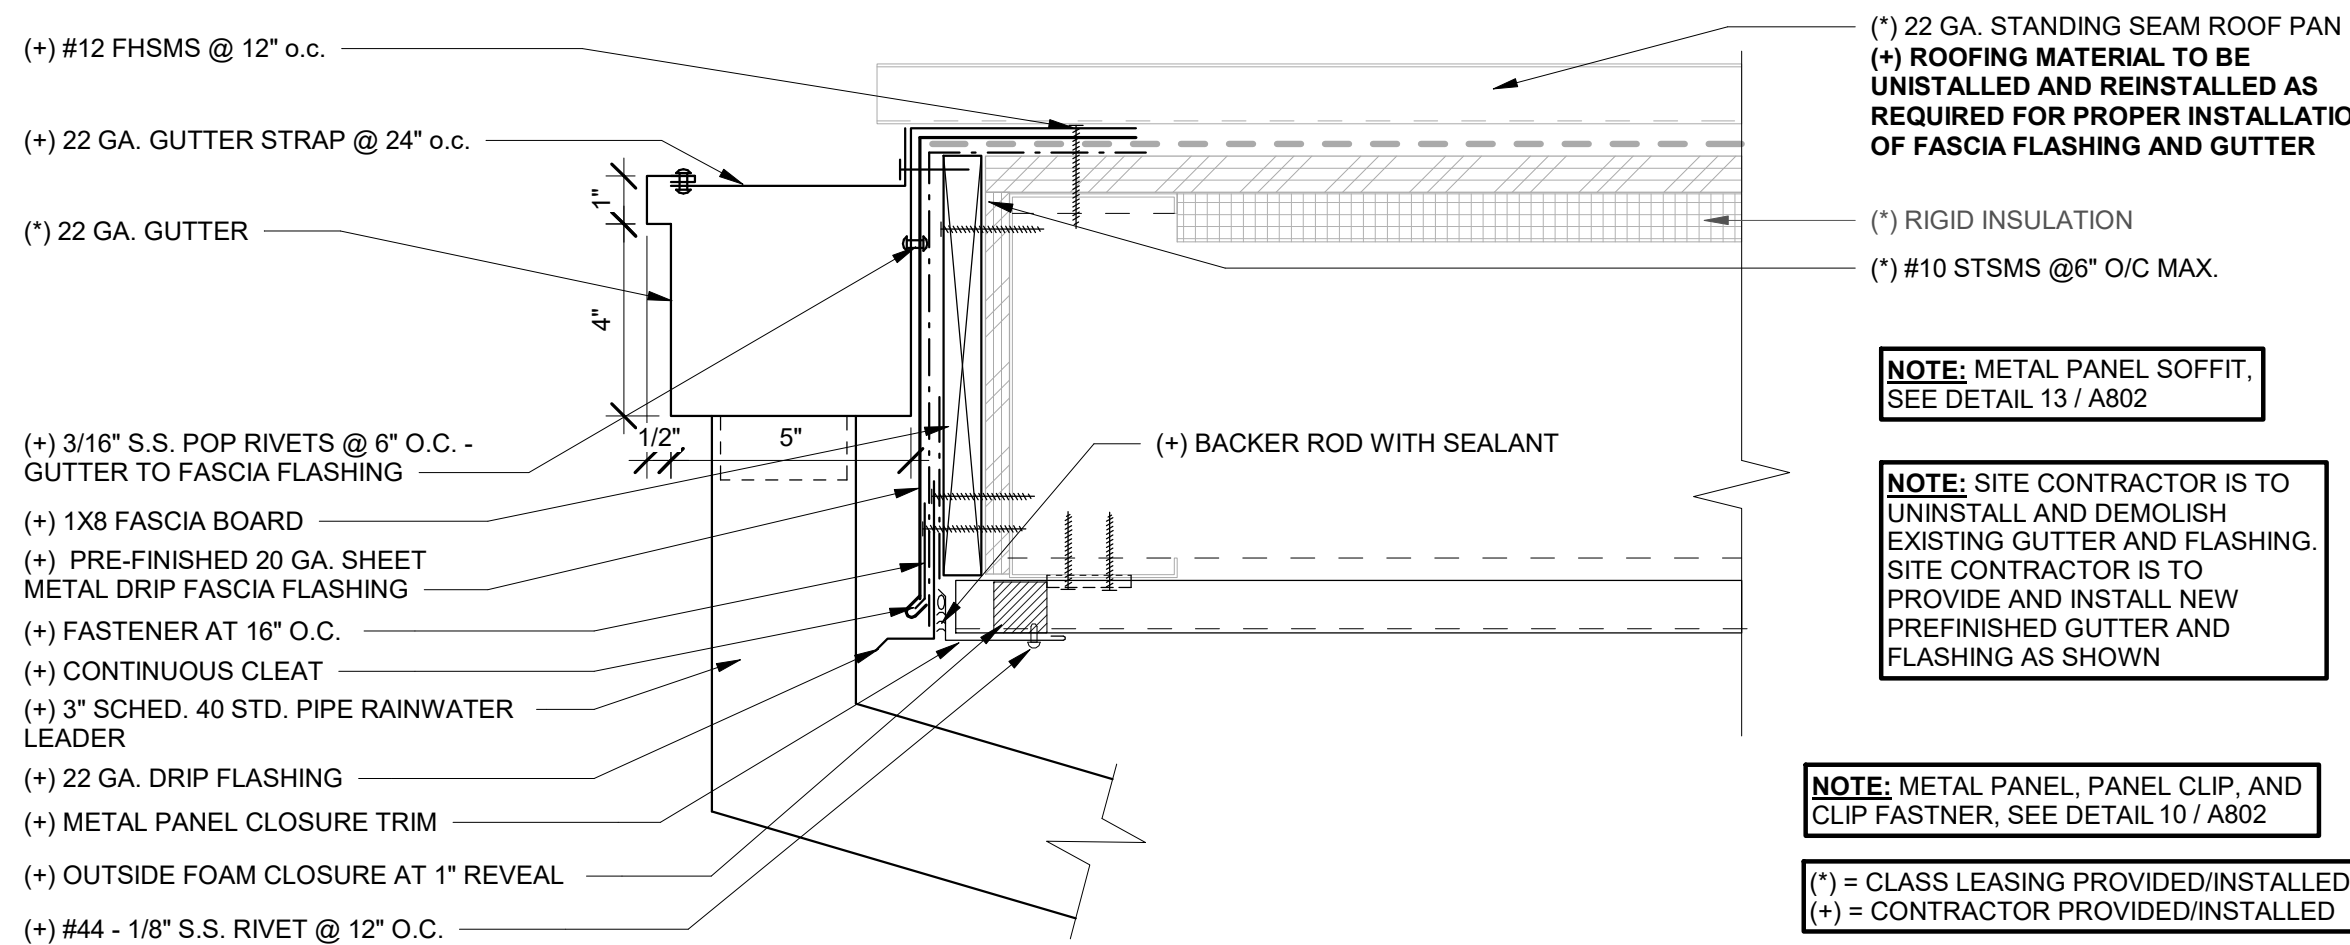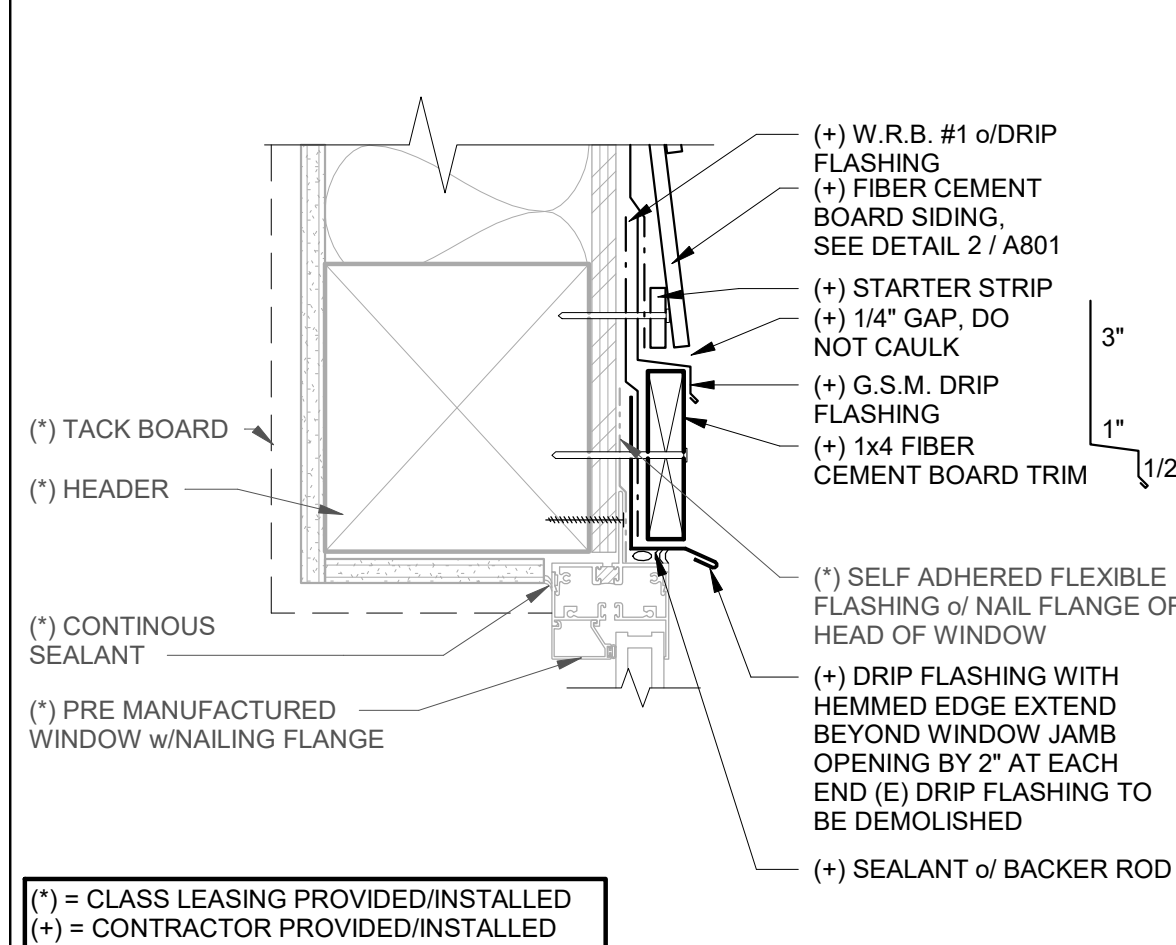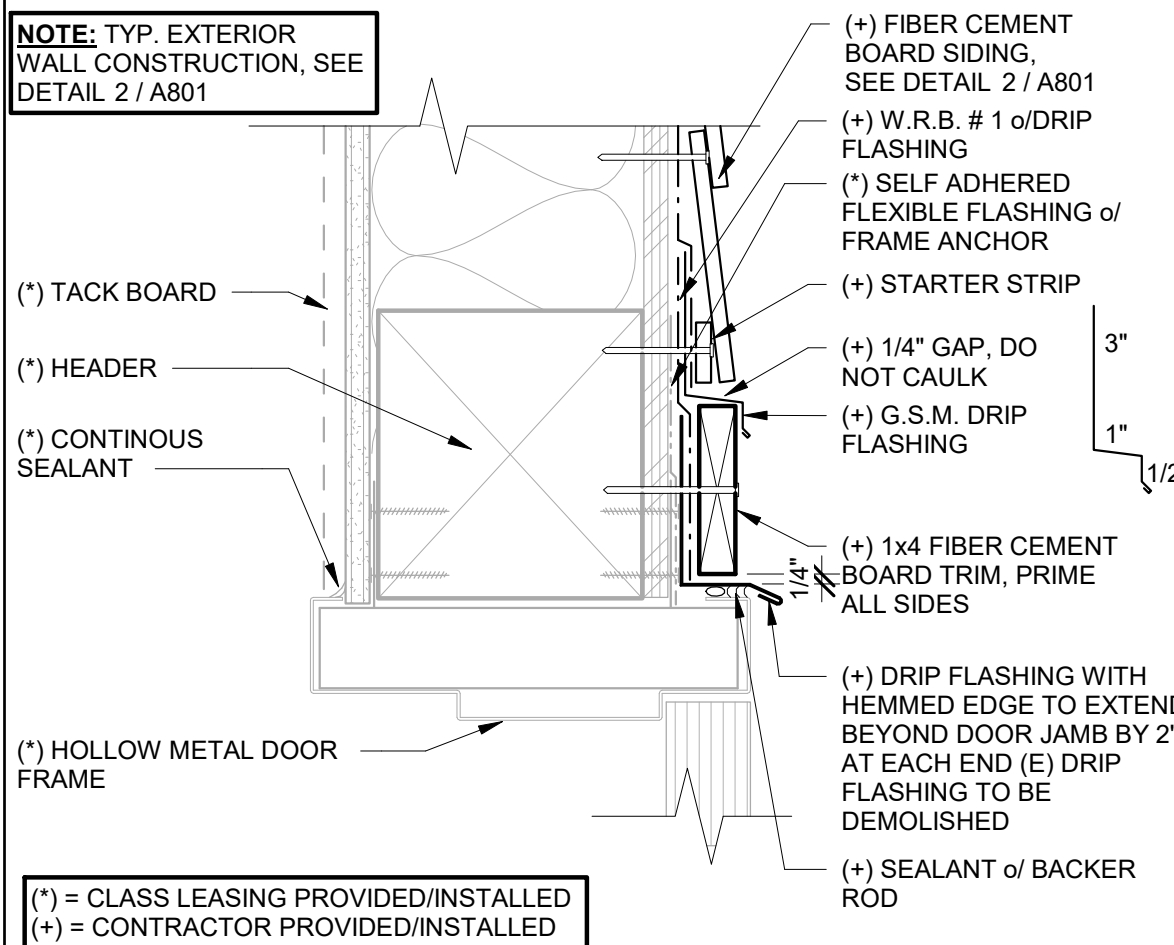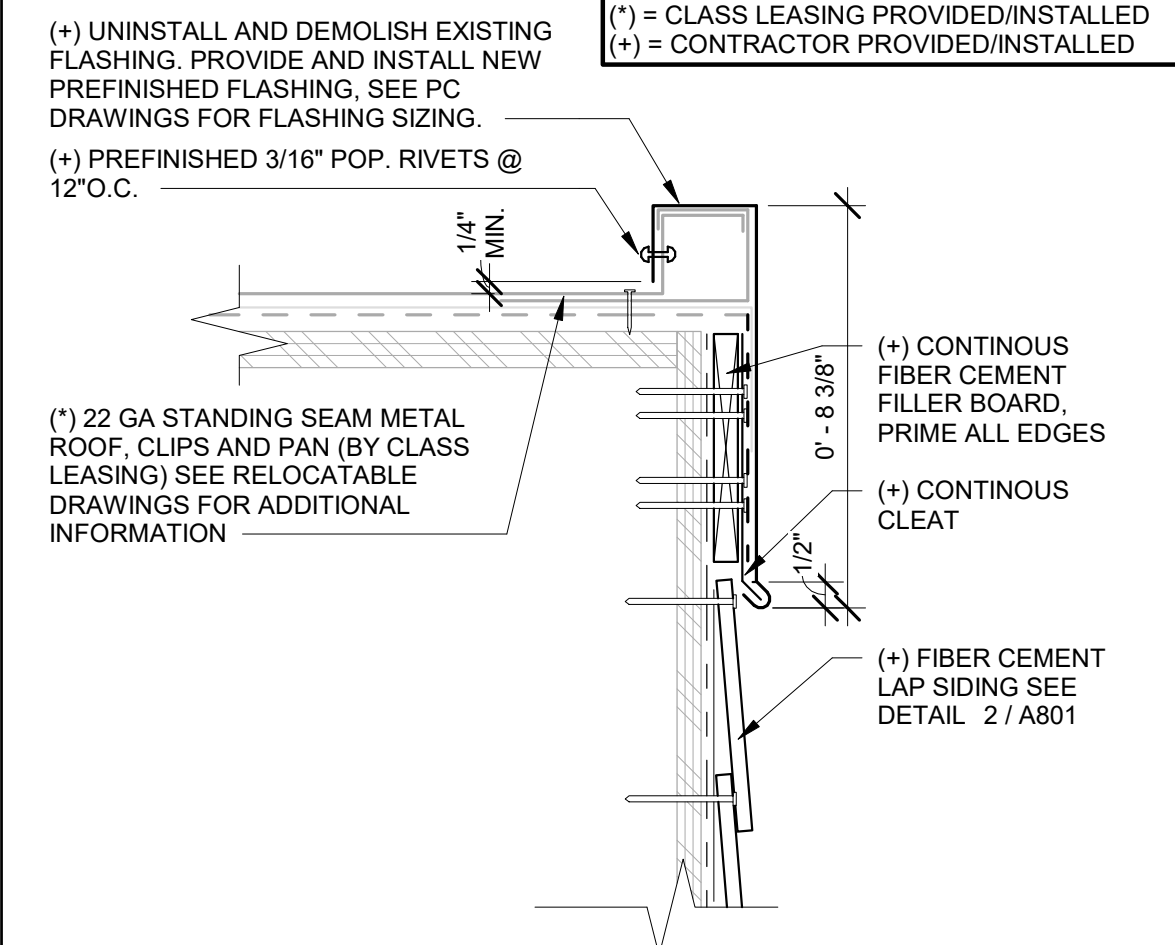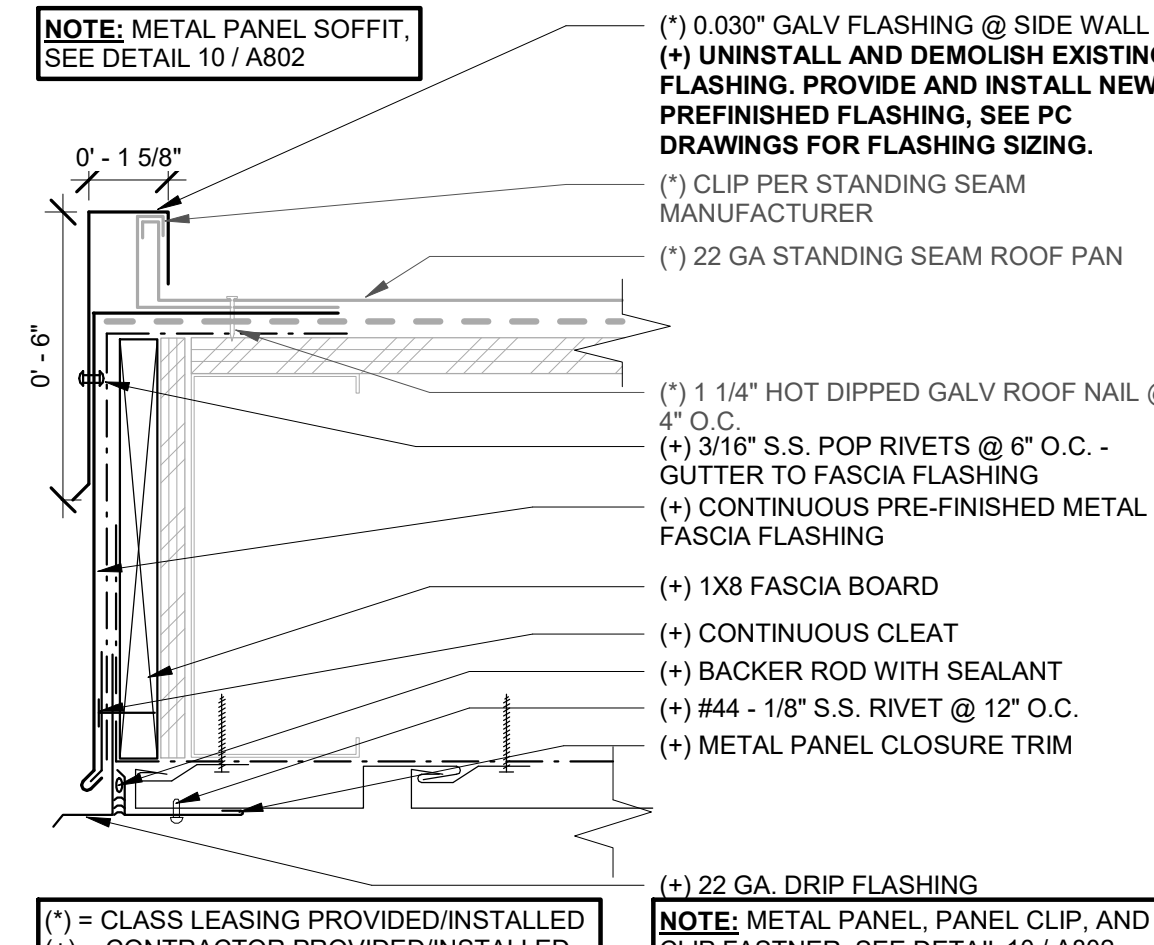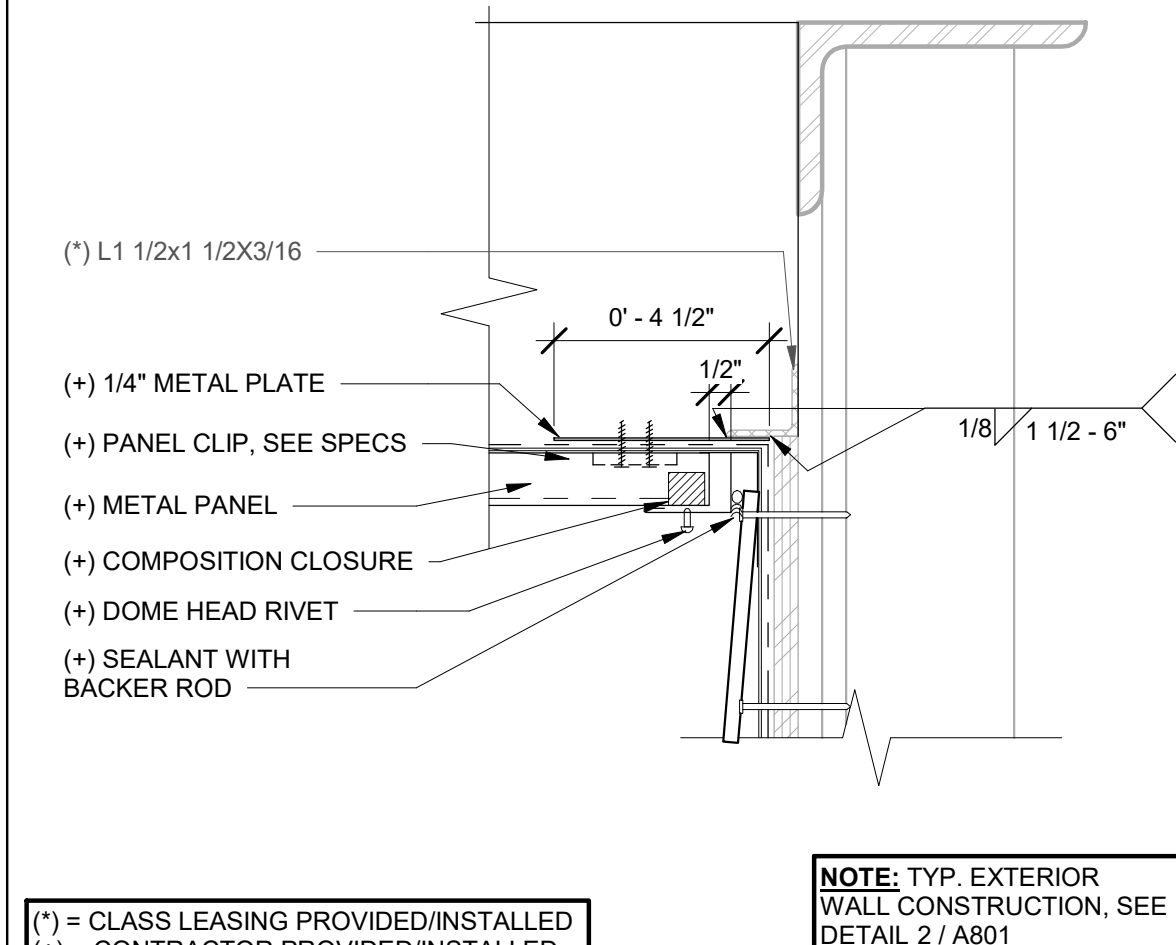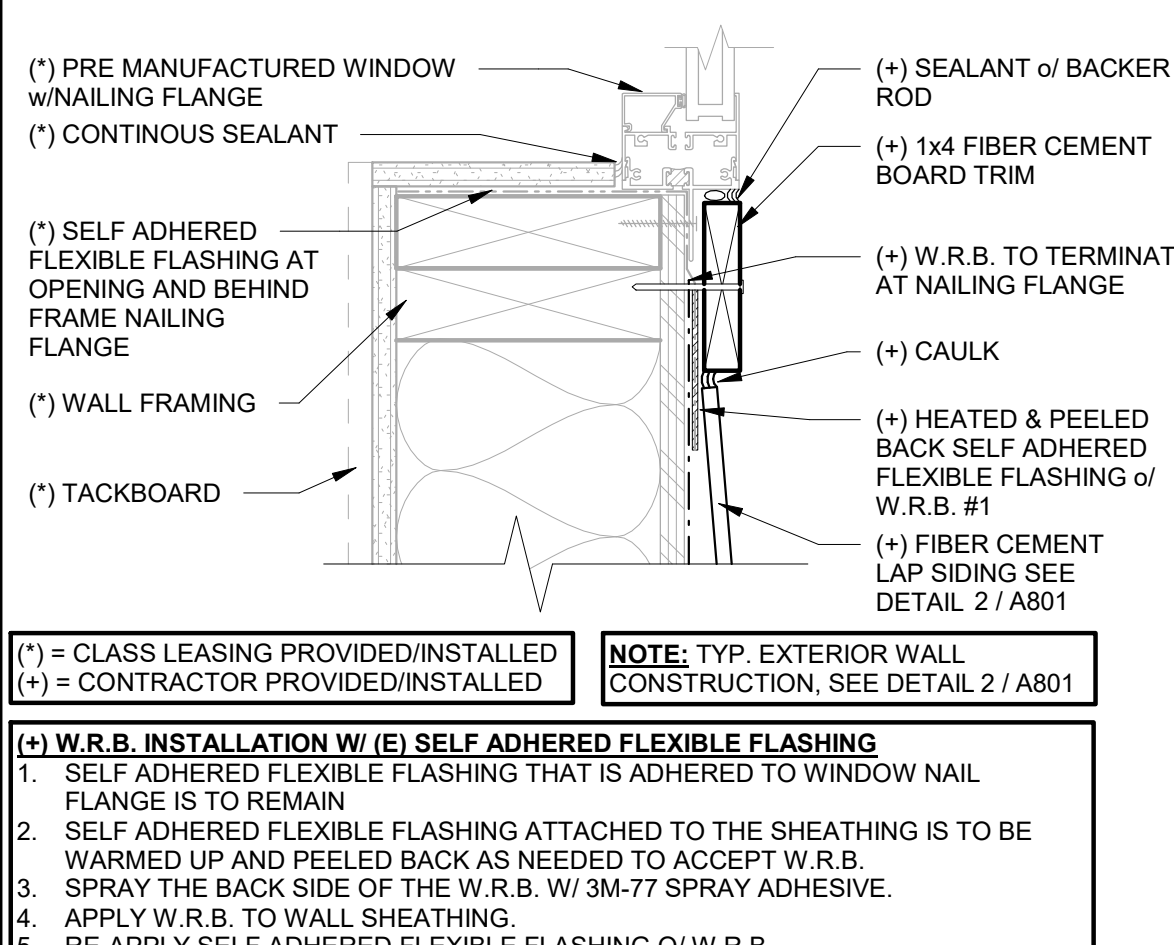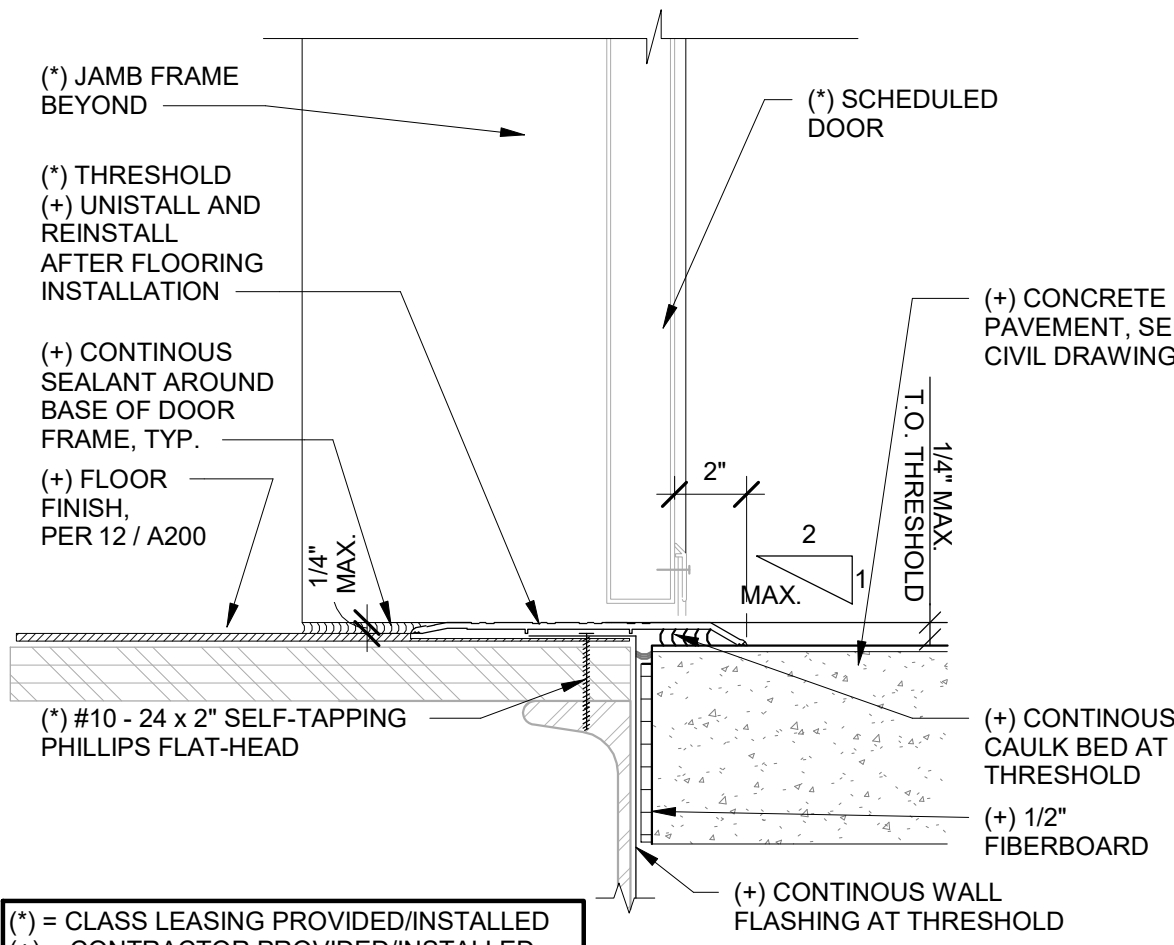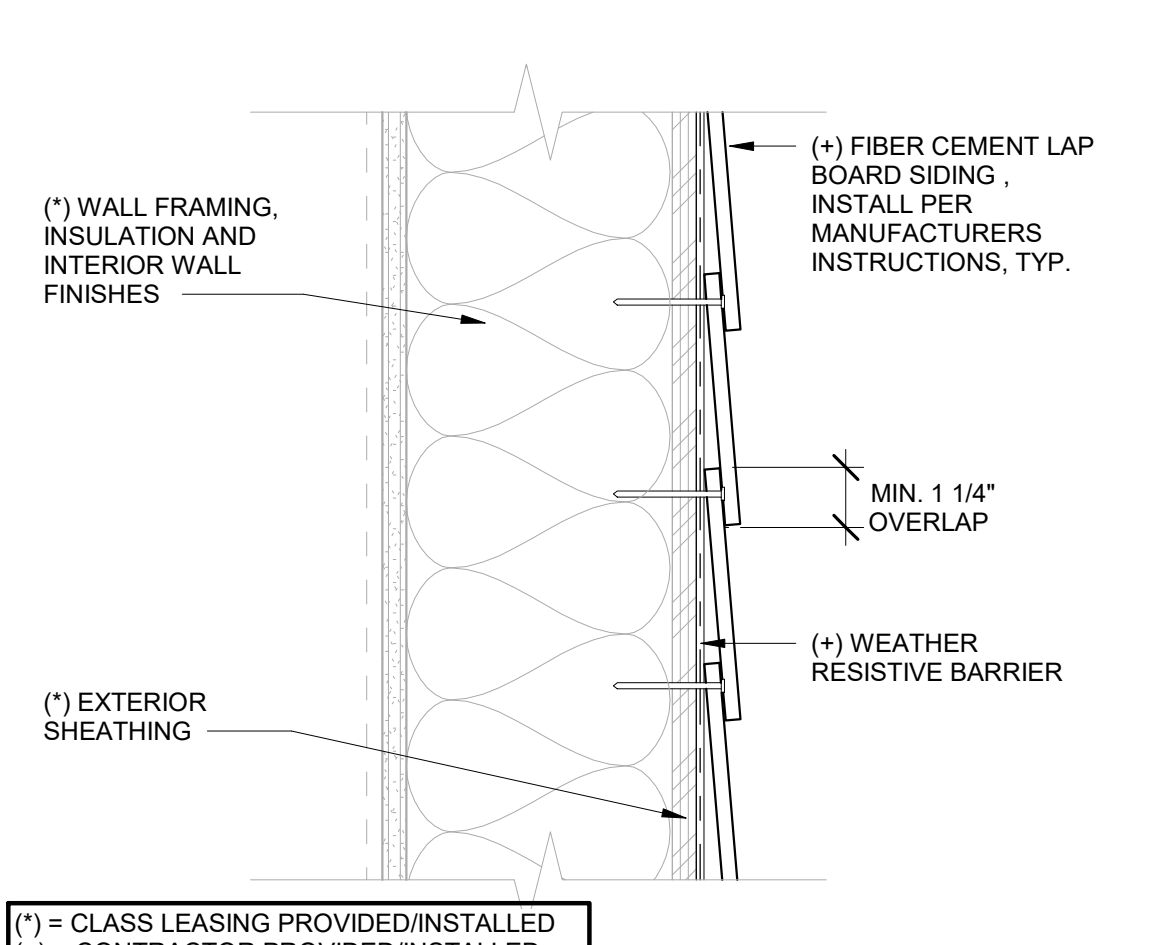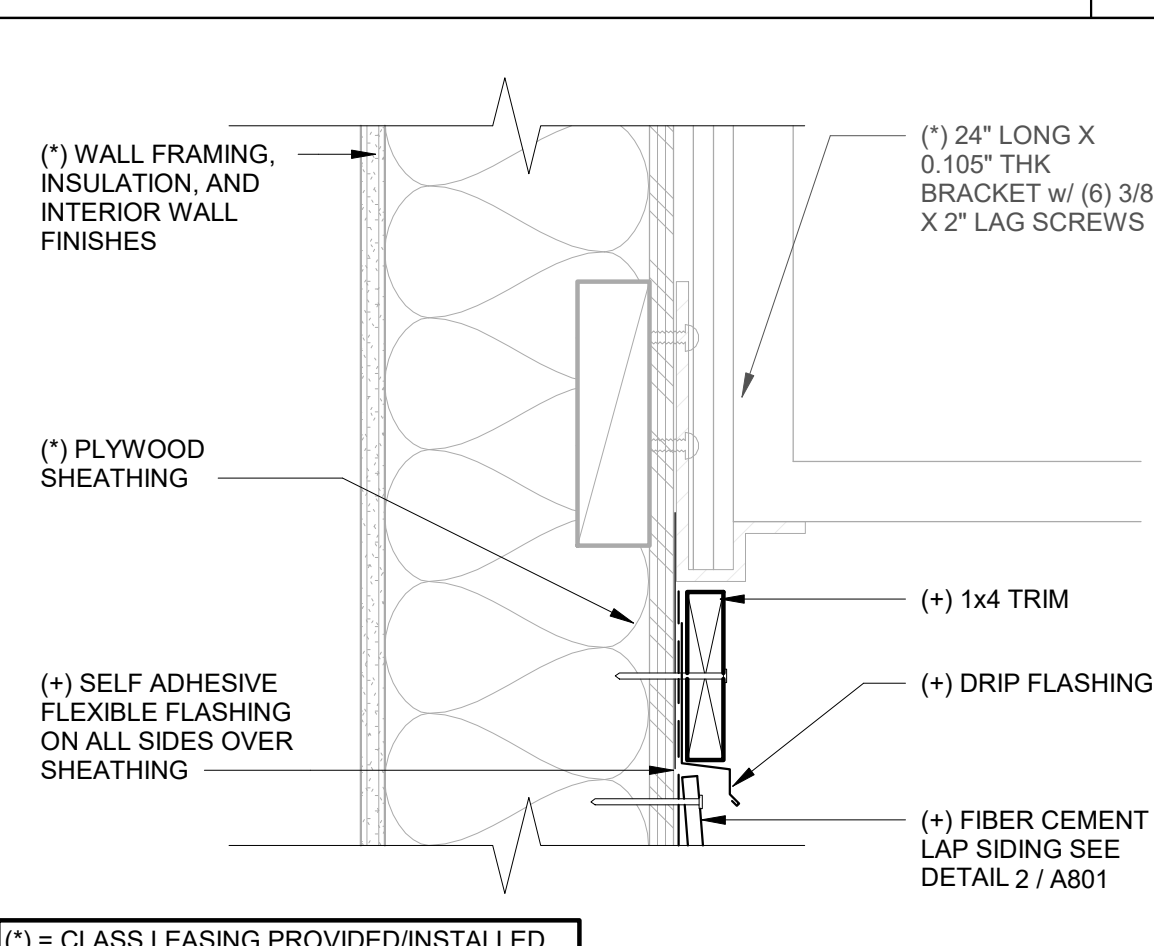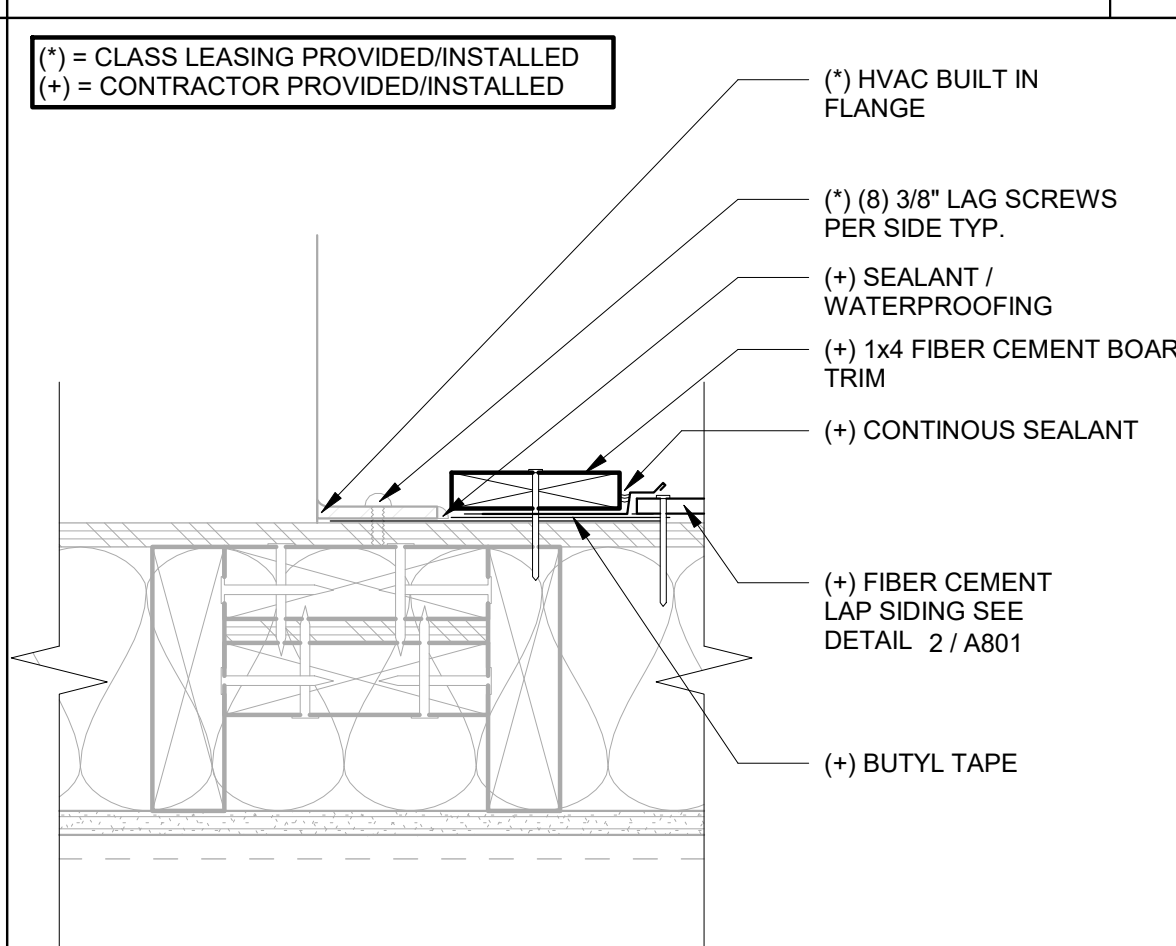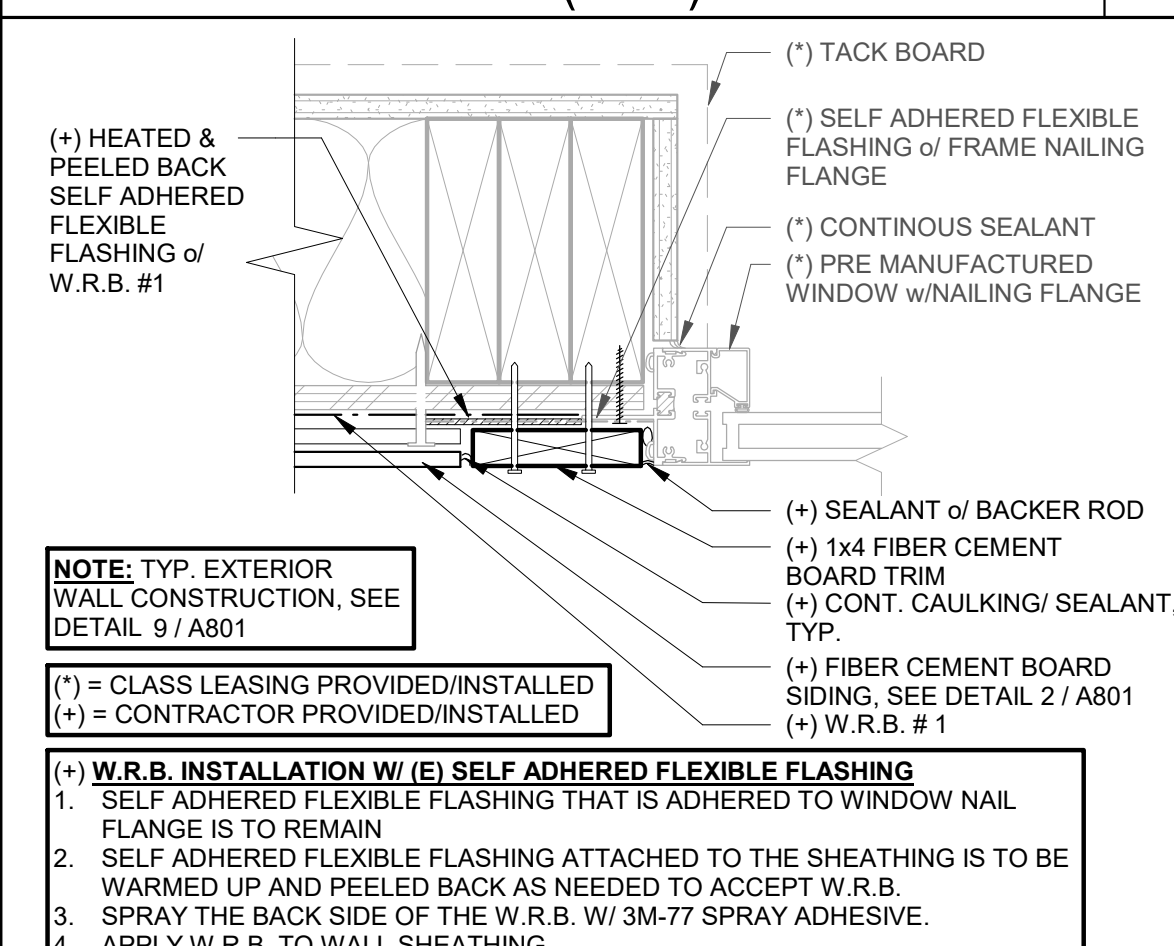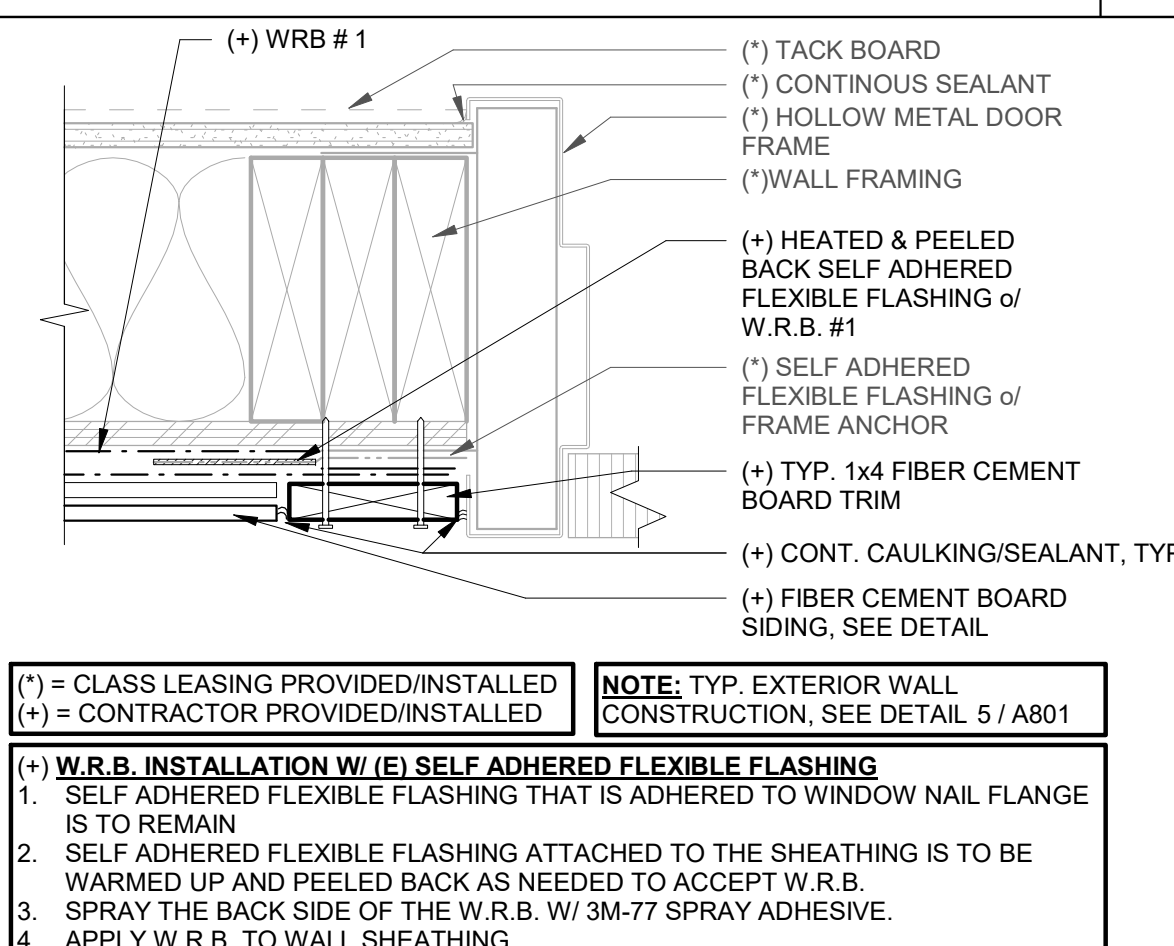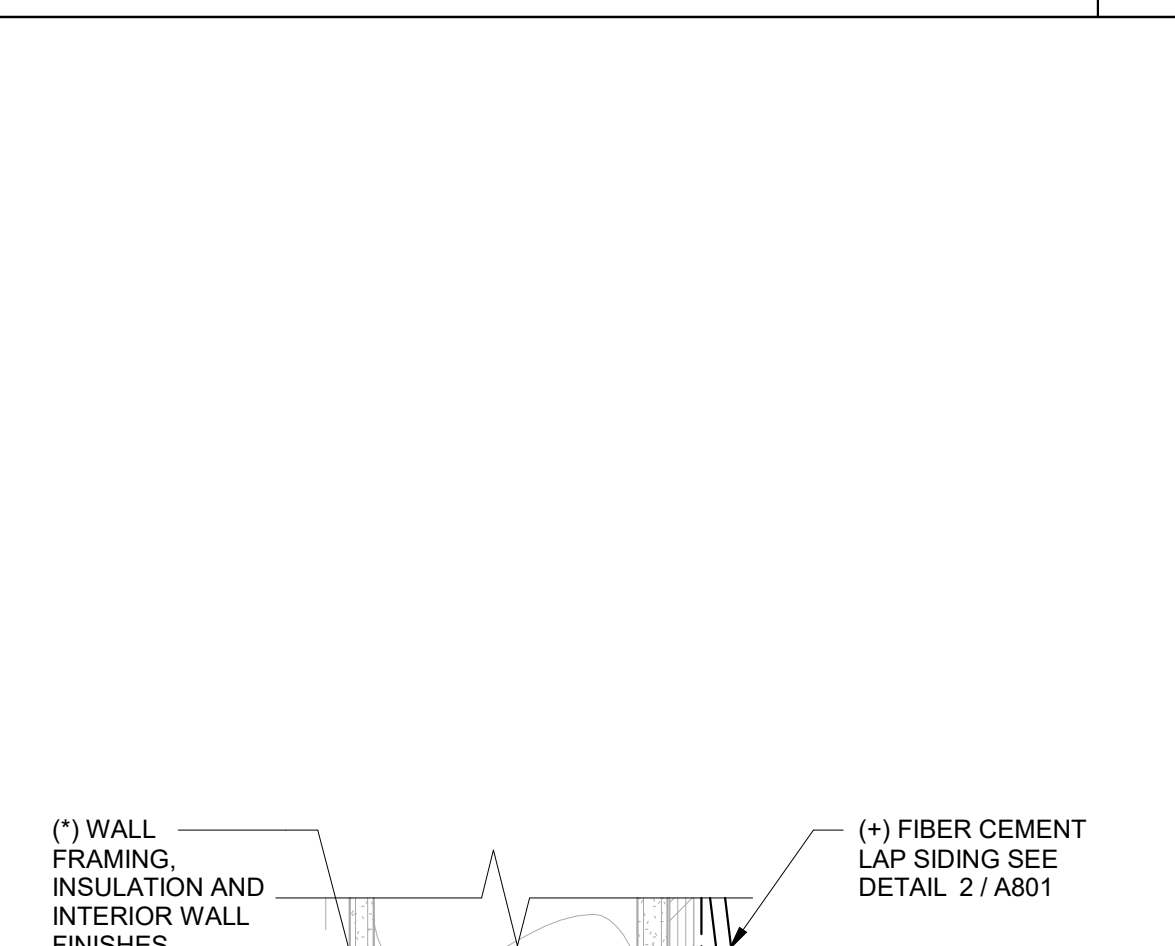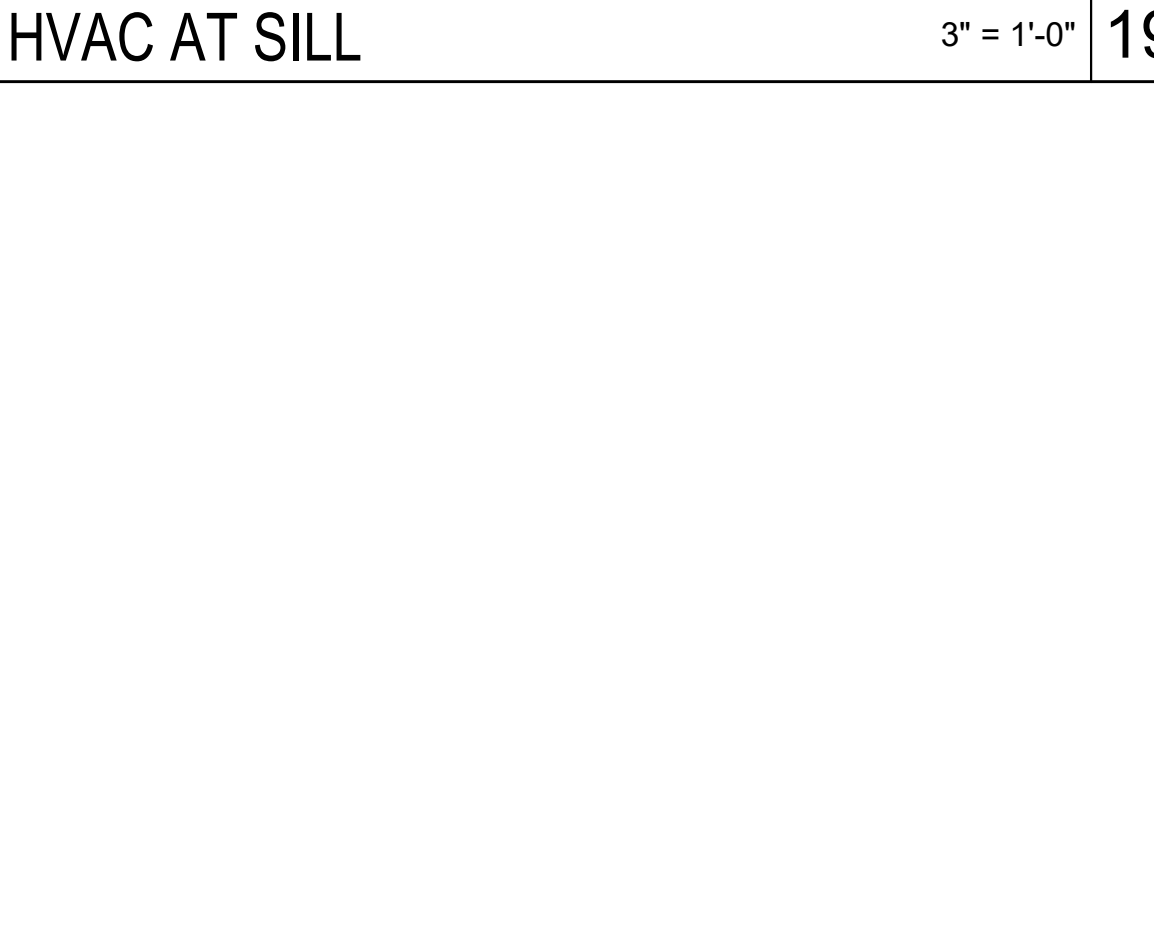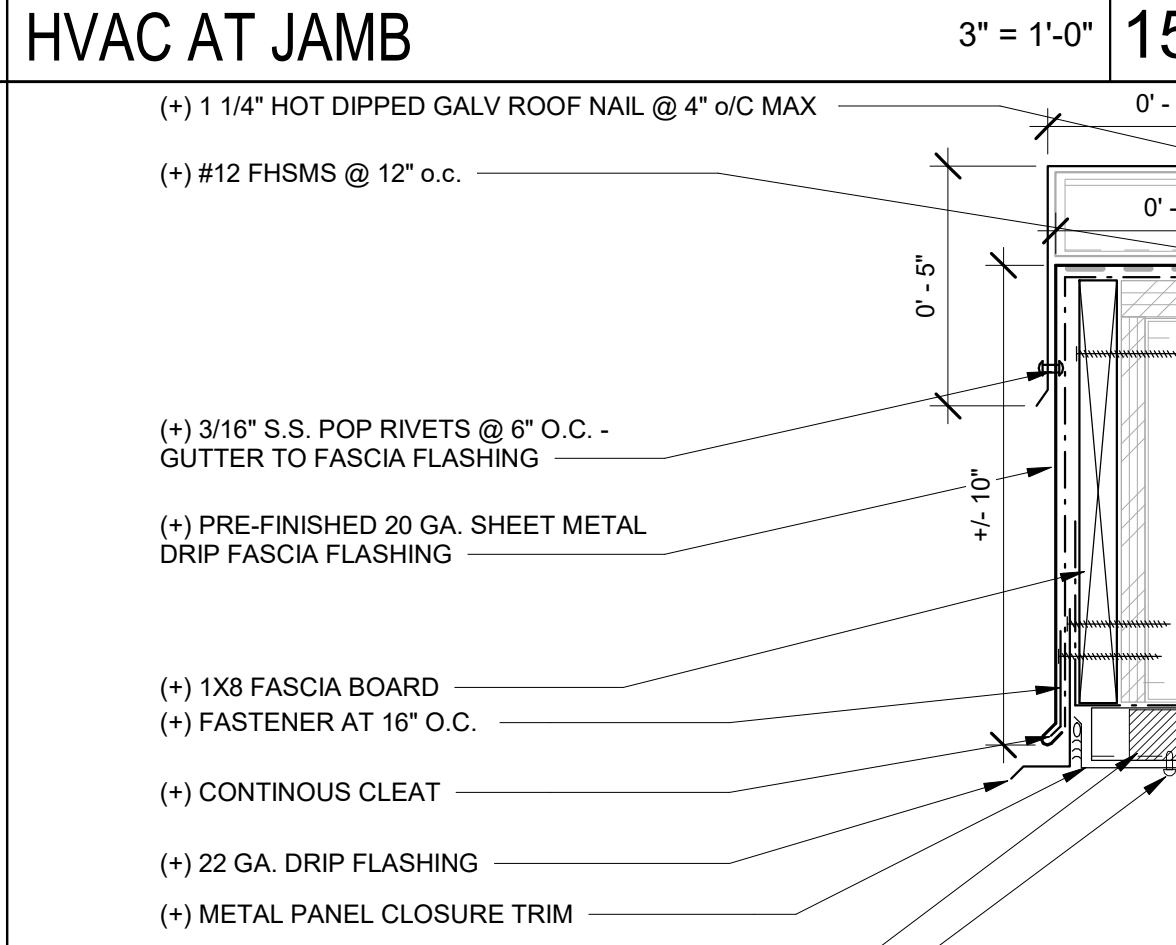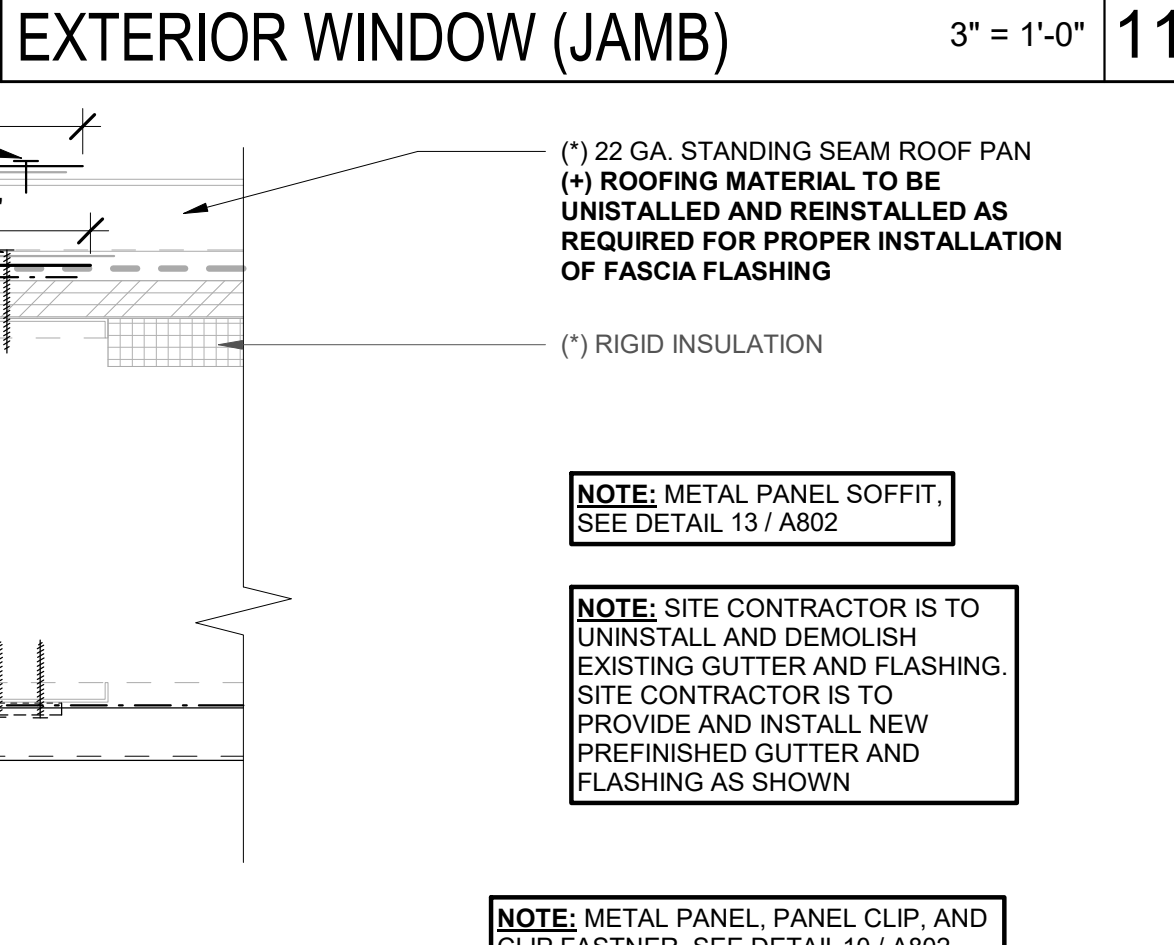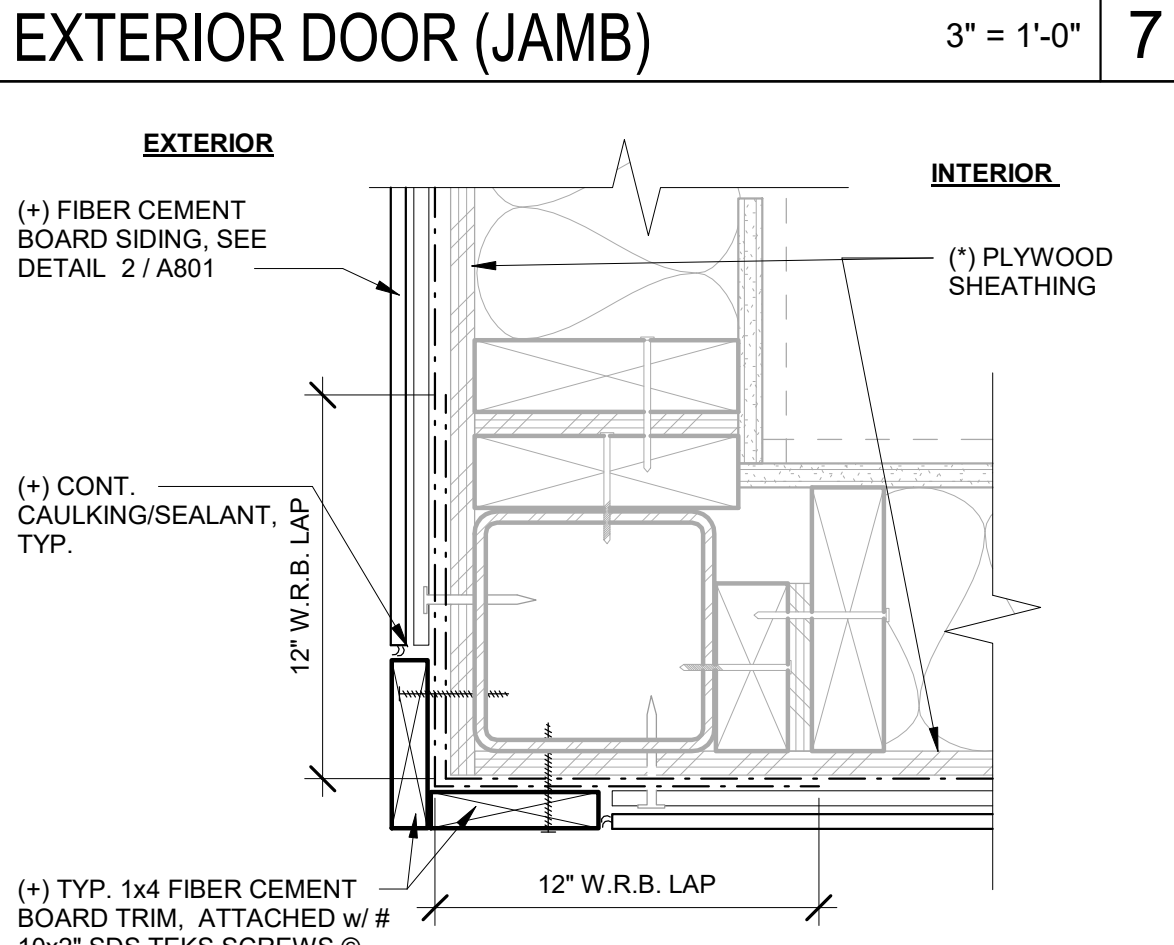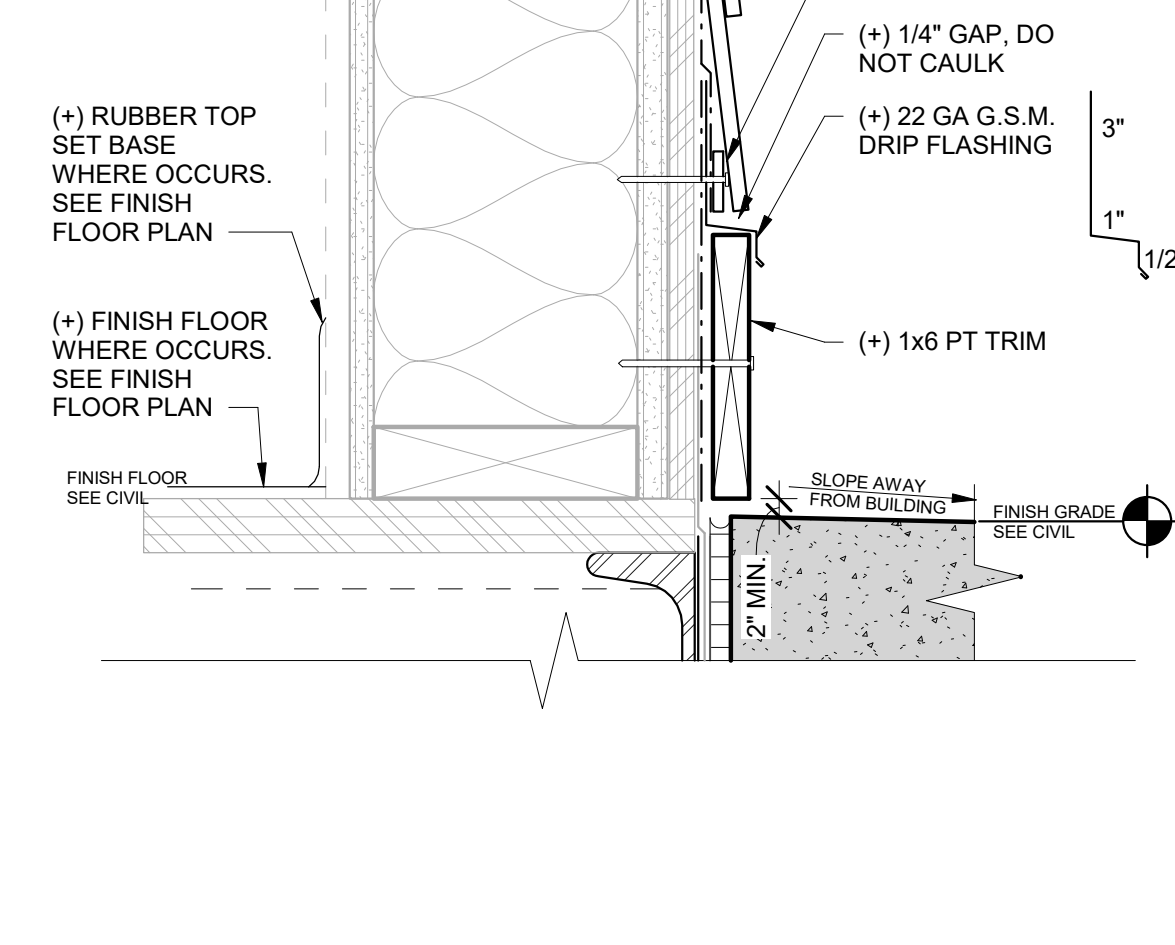 <p>(*) #12 FHMS @ 12" o.c.</p> <p>(*) 22 GA. GUTTER STRAP @ 24" o.c.</p> <p>(*) 22 GA. GUTTER</p> <p>(*) 3/16" S.S. POP RIVETS @ 6" O.C. - GUTTER TO FASCIA FLASHING</p> <p>(+) 1X8 FASCIA BOARD</p> <p>(+) PRE-FINISHED 20 GA. SHEET METAL DRIP FASCIA FLASHING</p> <p>(+) FASTENER AT 16" O.C.</p> <p>(+) CONTINUOUS CLEAT</p> <p>(+) 3" SCHED. 40 STD. PIPE RAINWATER LEADER</p> <p>(+) 22 GA. DRIP FLASHING</p> <p>(+) METAL PANEL CLOSURE TRIM</p> <p>(+) OUTSIDE FOAM CLOSURE AT 1" REVEAL</p> <p>(*) #44 - 1/8" S.S. RIVET @ 12" O.C.</p> <p>(*) 22 GA. STANDING SEAM ROOF PAN</p> <p>(+) ROOFING MATERIAL TO BE UNINSTALLED AND REINSTALLED AS REQUIRED FOR PROPER INSTALLATION OF FASCIA FLASHING AND GUTTER</p> <p>(*) RIGID INSULATION</p> <p>(*) #10 STSMS @6" O/C MAX.</p> <p>NOTE: METAL PANEL SOFFIT, SEE DETAIL 13 / A802</p> <p>NOTE: SITE CONTRACTOR IS TO UNINSTALL AND DEMOLISH EXISTING GUTTER AND FLASHING. SITE CONTRACTOR IS TO PROVIDE AND INSTALL NEW PREFINISHED GUTTER AND FLASHING AS SHOWN</p> <p>NOTE: METAL PANEL, PANEL CLIP, AND CLIP FASTNER, SEE DETAIL 10 / A802</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>(*) TACK BOARD</p> <p>(*) HEADER</p> <p>(*) CONTINUOUS SEALANT</p> <p>(*) PRE MANUFACTURED WINDOW w/NAILING FLANGE</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>(+) W.R.B. #1 w/DRIP FLASHING</p> <p>(+) FIBER CEMENT BOARD SIDING, SEE DETAIL 2 / A801</p> <p>(+) STARTER STRIP</p> <p>(+) 1/4" GAP, DO NOT CAULK</p> <p>(+) G.S.M. DRIP FLASHING</p> <p>(+) 1x4 FIBER CEMENT BOARD TRIM</p> <p>(*) SELF ADHERED FLEXIBLE FLASHING w/ NAIL FLANGE OF HEAD OF WINDOW</p> <p>(+) DRIP FLASHING WITH HEMMED EDGE EXTEND BEYOND WINDOW JAMB OPENING BY 2" AT EACH END (E) DRIP FLASHING TO BE DEMOLISHED</p> <p>(+) SEALANT w/ BACKER ROD</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>(*) TACK BOARD</p> <p>(*) HEADER</p> <p>(*) CONTINUOUS SEALANT</p> <p>(*) HOLLOW METAL DOOR FRAME</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>(+) FIBER CEMENT BOARD SIDING, SEE DETAIL 2 / A801</p> <p>(+) W.R.B. #1 w/DRIP FLASHING</p> <p>(*) SELF ADHERED FLEXIBLE FLASHING w/ FRAME ANCHOR</p> <p>(+) STARTER STRIP</p> <p>(+) 1/4" GAP, DO NOT CAULK</p> <p>(+) G.S.M. DRIP FLASHING</p> <p>(+) 1x4 FIBER CEMENT BOARD TRIM, PRIME ALL SIDES</p> <p>(+) DRIP FLASHING WITH HEMMED EDGE TO EXTEND BEYOND DOOR JAMB BY 2" AT EACH END (E) DRIP FLASHING TO BE DEMOLISHED</p> <p>(+) SEALANT w/ BACKER ROD</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>(*) UNINSTALL AND DEMOLISH EXISTING FLASHING. PROVIDE AND INSTALL NEW PREFINISHED FLASHING, SEE PC DRAWINGS FOR FLASHING SIZING.</p> <p>(+) PREFINISHED 3/16" POP. RIVETS @ 12" O.C.</p> <p>(*) 22 GA STANDING SEAM METAL ROOF, CLIPS AND PAN (BY CLASS LEASING) SEE RELOCATABLE DRAWINGS FOR ADDITIONAL INFORMATION</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>(+) CONTINUOUS FIBER CEMENT FILLER BOARD, PRIME ALL EDGES</p> <p>(+) CONTINUOUS CLEAT</p> <p>(+) FIBER CEMENT LAP SIDING SEE DETAIL 2 / A801</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>							
GUTTER AT STANDING SEAM			3" = 1'-0"	13	EXTERIOR WINDOW (HEAD)	3" = 1'-0"	9	EXTERIOR DOOR (HEAD)	3" = 1'-0"	5	SIDE WALL FLASHING @ ROOFING	3" = 1'-0"	1			
 <p>NOTE: METAL PANEL SOFFIT, SEE DETAIL 10 / A802</p> <p>(*) 0.030" GALV FLASHING @ SIDE WALL</p> <p>(+) UNINSTALL AND DEMOLISH EXISTING FLASHING. PROVIDE AND INSTALL NEW PREFINISHED FLASHING, SEE PC DRAWINGS FOR FLASHING SIZING.</p> <p>(*) CLIP PER STANDING SEAM MANUFACTURER</p> <p>(*) 22 GA STANDING SEAM ROOF PAN</p> <p>(*) 1 1/4" HOT DIPPED GALV ROOF NAIL @ 4" O.C.</p> <p>(+) 3/16" S.S. POP RIVETS @ 6" O.C. - GUTTER TO FASCIA FLASHING</p> <p>(+) CONTINUOUS PRE-FINISHED METAL FASCIA FLASHING</p> <p>(+) 1X8 FASCIA BOARD</p> <p>(+) CONTINUOUS CLEAT</p> <p>(+) BACKER ROD WITH SEALANT</p> <p>(*) #44 - 1/8" S.S. RIVET @ 12" O.C.</p> <p>(+) METAL PANEL CLOSURE TRIM</p> <p>(*) 22 GA. DRIP FLASHING</p> <p>NOTE: METAL PANEL, PANEL CLIP, AND CLIP FASTNER, SEE DETAIL 10 / A802</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>(*) L1 1/2x1 1/2X3/16</p> <p>(+) 1/4" METAL PLATE</p> <p>(+) PANEL CLIP, SEE SPECS</p> <p>(+) METAL PANEL</p> <p>(+) COMPOSITION CLOSURE</p> <p>(+) DOME HEAD RIVET</p> <p>(+) SEALANT WITH BACKER ROD</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>NOTE: TYP. EXTERIOR WALL CONSTRUCTION, SEE DETAIL 2 / A801</p>			 <p>(*) PRE MANUFACTURED WINDOW w/NAILING FLANGE</p> <p>(*) CONTINUOUS SEALANT</p> <p>(*) SELF ADHERED FLEXIBLE FLASHING AT OPENING AND BEHIND FRAME NAILING FLANGE</p> <p>(*) WALL FRAMING</p> <p>(*) TACKBOARD</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>NOTE: TYP. EXTERIOR WALL CONSTRUCTION, SEE DETAIL 2 / A801</p> <p>(+) SEALANT w/ BACKER ROD</p> <p>(+) 1x4 FIBER CEMENT BOARD TRIM</p> <p>(+) W.R.B. TO TERMINATE AT NAILING FLANGE</p> <p>(+) CAULK</p> <p>(+) HEATED & PEELED BACK SELF ADHERED FLEXIBLE FLASHING w/ W.R.B. #1</p> <p>(+) FIBER CEMENT LAP SIDING SEE DETAIL 2 / A801</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>(+) W.R.B. INSTALLATION W/ (E) SELF ADHERED FLEXIBLE FLASHING</p> <p>1. SELF ADHERED FLEXIBLE FLASHING THAT IS ADHERED TO WINDOW NAIL FLANGE IS TO REMAIN</p> <p>2. SELF ADHERED FLEXIBLE FLASHING ATTACHED TO THE SHEATHING IS TO BE WARMED UP AND PEELED BACK AS NEEDED TO ACCEPT W.R.B.</p> <p>3. SPRAY THE BACK SIDE OF THE W.R.B. W/ 3M-77 SPRAY ADHESIVE.</p> <p>4. APPLY W.R.B. TO WALL SHEATHING.</p> <p>5. RE-APPLY SELF ADHERED FLEXIBLE FLASHING w/ W.R.B.</p>			 <p>(*) JAMB FRAME BEYOND</p> <p>(*) THRESHOLD</p> <p>(+) UNINSTALL AND REINSTALL AFTER FLOORING INSTALLATION</p> <p>(+) CONTINUOUS SEALANT AROUND BASE OF DOOR FRAME, TYP.</p> <p>(+) FLOOR FINISH, PER 12 / A200</p> <p>(*) #10 - 24 x 2" SELF-TAPPING PHILLIPS FLAT-HEAD</p> <p>(*) SCHEDULED DOOR</p> <p>(+) CONCRETE PAVEMENT, SEE CIVIL DRAWINGS</p> <p>(+) CONTINUOUS WALL FLASHING AT THRESHOLD</p> <p>(+) 1/2" FIBERBOARD</p> <p>(+) CONTINUOUS CAULK BED AT THRESHOLD</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>(*) WALL FRAMING, INSULATION AND INTERIOR WALL FINISHES</p> <p>(*) EXTERIOR SHEATHING</p> <p>(+) FIBER CEMENT LAP SIDING, INSTALL PER MANUFACTURERS INSTRUCTIONS, TYP.</p> <p>(+) WEATHER RESISTIVE BARRIER</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>				
MTL. ROOFING TO MTL. PANEL			3" = 1'-0"	17	METAL PANEL AT SIDING	3" = 1'-0"	14	EXTERIOR WINDOW (SILL)	3" = 1'-0"	10	TYPICAL EXTERIOR THRESHOLD	3" = 1'-0"	6	TYPICAL LAP SIDING	3" = 1'-0"	2
 <p>(*) WALL FRAMING, INSULATION, AND INTERIOR WALL FINISHES</p> <p>(*) PLYWOOD SHEATHING</p> <p>(+) SELF ADHESIVE FLEXIBLE FLASHING ON ALL SIDES OVER SHEATHING</p> <p>(*) 24" LONG X 0.105" THK BRACKET w/ (6) 3/8" X 2" LAG SCREWS</p> <p>(+) 1x4 TRIM</p> <p>(+) DRIP FLASHING</p> <p>(+) FIBER CEMENT LAP SIDING SEE DETAIL 2 / A801</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>(*) HVAC BUILT IN FLANGE</p> <p>(*) (8) 3/8" LAG SCREWS PER SIDE TYP.</p> <p>(+) SEALANT / WATERPROOFING</p> <p>(+) 1x4 FIBER CEMENT BOARD TRIM</p> <p>(+) CONTINUOUS SEALANT</p> <p>(+) FIBER CEMENT LAP SIDING SEE DETAIL 2 / A801</p> <p>(+) BUTYL TAPE</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>(*) TACK BOARD</p> <p>(*) SELF ADHERED FLEXIBLE FLASHING w/ FRAME NAILING FLANGE</p> <p>(*) CONTINUOUS SEALANT</p> <p>(*) PRE MANUFACTURED WINDOW w/NAILING FLANGE</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>NOTE: TYP. EXTERIOR WALL CONSTRUCTION, SEE DETAIL 9 / A801</p> <p>(+) SEALANT w/ BACKER ROD</p> <p>(+) 1x4 FIBER CEMENT BOARD TRIM</p> <p>(+) CONT. CAULKING/ SEALANT, TYP.</p> <p>(+) FIBER CEMENT BOARD SIDING, SEE DETAIL 2 / A801</p> <p>(+) W.R.B. #1</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>(+) W.R.B. INSTALLATION W/ (E) SELF ADHERED FLEXIBLE FLASHING</p> <p>1. SELF ADHERED FLEXIBLE FLASHING THAT IS ADHERED TO WINDOW NAIL FLANGE IS TO REMAIN</p> <p>2. SELF ADHERED FLEXIBLE FLASHING ATTACHED TO THE SHEATHING IS TO BE WARMED UP AND PEELED BACK AS NEEDED TO ACCEPT W.R.B.</p> <p>3. SPRAY THE BACK SIDE OF THE W.R.B. W/ 3M-77 SPRAY ADHESIVE.</p> <p>4. APPLY W.R.B. TO WALL SHEATHING.</p> <p>5. RE-APPLY SELF ADHERED FLEXIBLE FLASHING w/ W.R.B.</p>			 <p>(+) WRB #1</p> <p>(*) TACK BOARD</p> <p>(*) CONTINUOUS SEALANT</p> <p>(*) HOLLOW METAL DOOR FRAME</p> <p>(*) WALL FRAMING</p> <p>(+) HEATED & PEELED BACK SELF ADHERED FLEXIBLE FLASHING w/ W.R.B. #1</p> <p>(*) SELF ADHERED FLEXIBLE FLASHING w/ FRAME ANCHOR</p> <p>(+) TYP. 1x4 FIBER CEMENT BOARD TRIM</p> <p>(+) CONT. CAULKING/SEALANT, TYP.</p> <p>(+) FIBER CEMENT BOARD SIDING, SEE DETAIL</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>NOTE: TYP. EXTERIOR WALL CONSTRUCTION, SEE DETAIL 5 / A801</p> <p>(+) W.R.B. INSTALLATION W/ (E) SELF ADHERED FLEXIBLE FLASHING</p> <p>1. SELF ADHERED FLEXIBLE FLASHING THAT IS ADHERED TO WINDOW NAIL FLANGE IS TO REMAIN</p> <p>2. SELF ADHERED FLEXIBLE FLASHING ATTACHED TO THE SHEATHING IS TO BE WARMED UP AND PEELED BACK AS NEEDED TO ACCEPT W.R.B.</p> <p>3. SPRAY THE BACK SIDE OF THE W.R.B. W/ 3M-77 SPRAY ADHESIVE.</p> <p>4. APPLY W.R.B. TO WALL SHEATHING.</p> <p>5. RE-APPLY SELF ADHERED FLEXIBLE FLASHING w/ W.R.B.</p>			 <p>(*) WALL FRAMING, INSULATION AND INTERIOR WALL FINISHES</p> <p>(+) FIBER CEMENT LAP SIDING SEE DETAIL 2 / A801</p> <p>(+) STARTER STRIP</p> <p>(+) 1/4" GAP, DO NOT CAULK</p> <p>(+) 22 GA G.S.M. DRIP FLASHING</p> <p>(+) 1x6 PT TRIM</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>				
HVAC AT SILL			3" = 1'-0"	19	HVAC AT JAMB	3" = 1'-0"	15	EXTERIOR WINDOW (JAMB)	3" = 1'-0"	11	EXTERIOR DOOR (JAMB)	3" = 1'-0"	7			
 <p>(*) 1 1/4" HOT DIPPED GALV ROOF NAIL @ 4" o/c MAX</p> <p>(*) #12 FHMS @ 12" o.c.</p> <p>(*) 3/16" S.S. POP RIVETS @ 6" O.C. - GUTTER TO FASCIA FLASHING</p> <p>(+) PRE-FINISHED 20 GA. SHEET METAL DRIP FASCIA FLASHING</p> <p>(+) 1X8 FASCIA BOARD</p> <p>(+) FASTENER AT 16" O.C.</p> <p>(+) CONTINUOUS CLEAT</p> <p>(+) 22 GA. DRIP FLASHING</p> <p>(+) METAL PANEL CLOSURE TRIM</p> <p>(+) OUTSIDE FOAM CLOSURE AT 1" REVEAL</p> <p>(*) #44 - 1/8" S.S. RIVET @ 12" O.C.</p> <p>(*) 22 GA. STANDING SEAM ROOF PAN</p> <p>(+) ROOFING MATERIAL TO BE UNINSTALLED AND REINSTALLED AS REQUIRED FOR PROPER INSTALLATION OF FASCIA FLASHING</p> <p>(*) RIGID INSULATION</p> <p>NOTE: METAL PANEL SOFFIT, SEE DETAIL 13 / A802</p> <p>NOTE: SITE CONTRACTOR IS TO UNINSTALL AND DEMOLISH EXISTING GUTTER AND FLASHING, SITE CONTRACTOR IS TO PROVIDE AND INSTALL NEW PREFINISHED GUTTER AND FLASHING AS SHOWN</p> <p>NOTE: METAL PANEL, PANEL CLIP, AND CLIP FASTNER, SEE DETAIL 10 / A802</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>(*) TACK BOARD</p> <p>(*) SELF ADHERED FLEXIBLE FLASHING w/ FRAME NAILING FLANGE</p> <p>(*) CONTINUOUS SEALANT</p> <p>(*) PRE MANUFACTURED WINDOW w/NAILING FLANGE</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>NOTE: TYP. EXTERIOR WALL CONSTRUCTION, SEE DETAIL 9 / A801</p> <p>(+) SEALANT w/ BACKER ROD</p> <p>(+) 1x4 FIBER CEMENT BOARD TRIM</p> <p>(+) CONT. CAULKING/ SEALANT, TYP.</p> <p>(+) FIBER CEMENT BOARD SIDING, SEE DETAIL 2 / A801</p> <p>(+) W.R.B. #1</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>(*) TACK BOARD</p> <p>(*) SELF ADHERED FLEXIBLE FLASHING w/ FRAME NAILING FLANGE</p> <p>(*) CONTINUOUS SEALANT</p> <p>(*) PRE MANUFACTURED WINDOW w/NAILING FLANGE</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p> <p>NOTE: TYP. EXTERIOR WALL CONSTRUCTION, SEE DETAIL 9 / A801</p> <p>(+) SEALANT w/ BACKER ROD</p> <p>(+) 1x4 FIBER CEMENT BOARD TRIM</p> <p>(+) CONT. CAULKING/ SEALANT, TYP.</p> <p>(+) FIBER CEMENT BOARD SIDING, SEE DETAIL 2 / A801</p> <p>(+) W.R.B. #1</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>EXTERIOR</p> <p>(+) FIBER CEMENT BOARD SIDING, SEE DETAIL 2 / A801</p> <p>(+) CONT. CAULKING/SEALANT, TYP.</p> <p>12" W.R.B. LAP</p> <p>12" W.R.B. LAP</p> <p>INTERIOR</p> <p>(*) PLYWOOD SHEATHING</p> <p>(+) TYP. 1x4 FIBER CEMENT BOARD TRIM, ATTACHED w/ # 10x2" SDS TEKs SCREWS @ 24" O.C. MAX (3) THREADS MIN. THOUGH THE STEEL</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>			 <p>(+) RUBBER TOP SET BASE WHERE OCCURS. SEE FINISH FLOOR PLAN</p> <p>(+) FINISH FLOOR WHERE OCCURS. SEE FINISH FLOOR PLAN</p> <p>FINISH FLOOR SEE CIVIL</p> <p>FINISH GRADE SEE CIVIL</p> <p>SLOPE AWAY FROM BUILDING</p> <p>2" MIN</p> <p>(*) = CLASS LEASING PROVIDED/INSTALLED (+) = CONTRACTOR PROVIDED/INSTALLED</p>				
METAL ROOF AT HIGH END			3" = 1'-0"	12	TYP. BLDG CORNER TRIM	3" = 1'-0"	8	SIDING AT FINISH GRADE	3" = 1'-0"	4						

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☐ FLS ☐ ACS ☐
DATE: 11/26/2024

TETER, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

07/31/2024

DSA SUBMITTAL

11/01/2024

DSA BACKCHECK SUBMITTAL

MARK

DATE

DESCRIPTION

LICENSED ARCHITECT
No. C28898
STATE OF CALIFORNIA

TETER, INC.

FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO

ARCHITECTS ENGINEERS CONNECTED

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA


DRAWING TITLE
EXTERIOR DETAILS (LAP SIDING)

PROJECT NO.
23-12899


DRAWING
A801

\\tetr-file1\Users\dylan.seaton_TET\Documents\12899-A-STOCKTON PEYTON ELEM ELOP.dylan.seaton.FLU7Z.rvt


PLOT DATE: 11/22/2024 10:33:43 AM

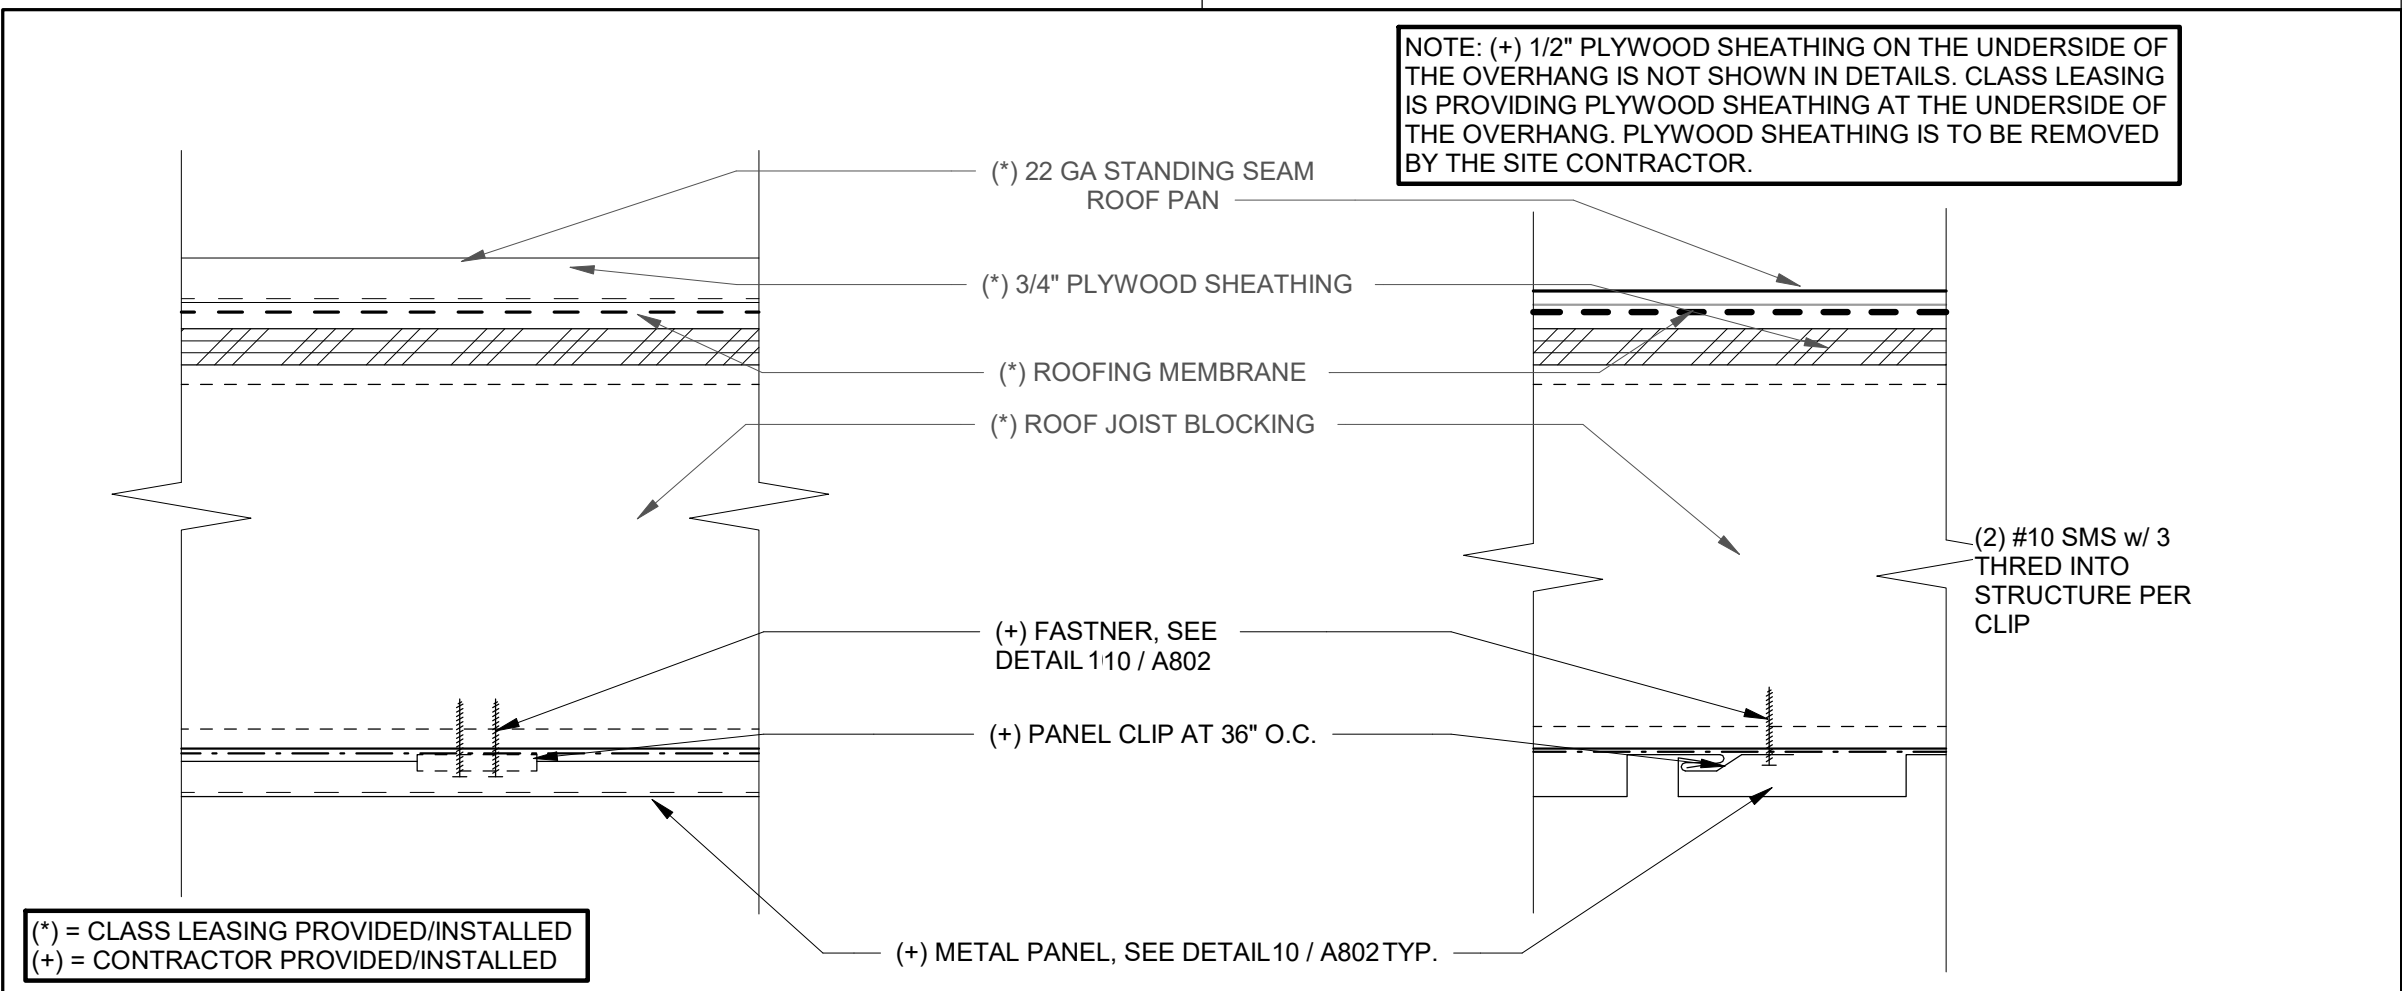


TYP. ROOF OVERHANG 3" = 1'-0" 13

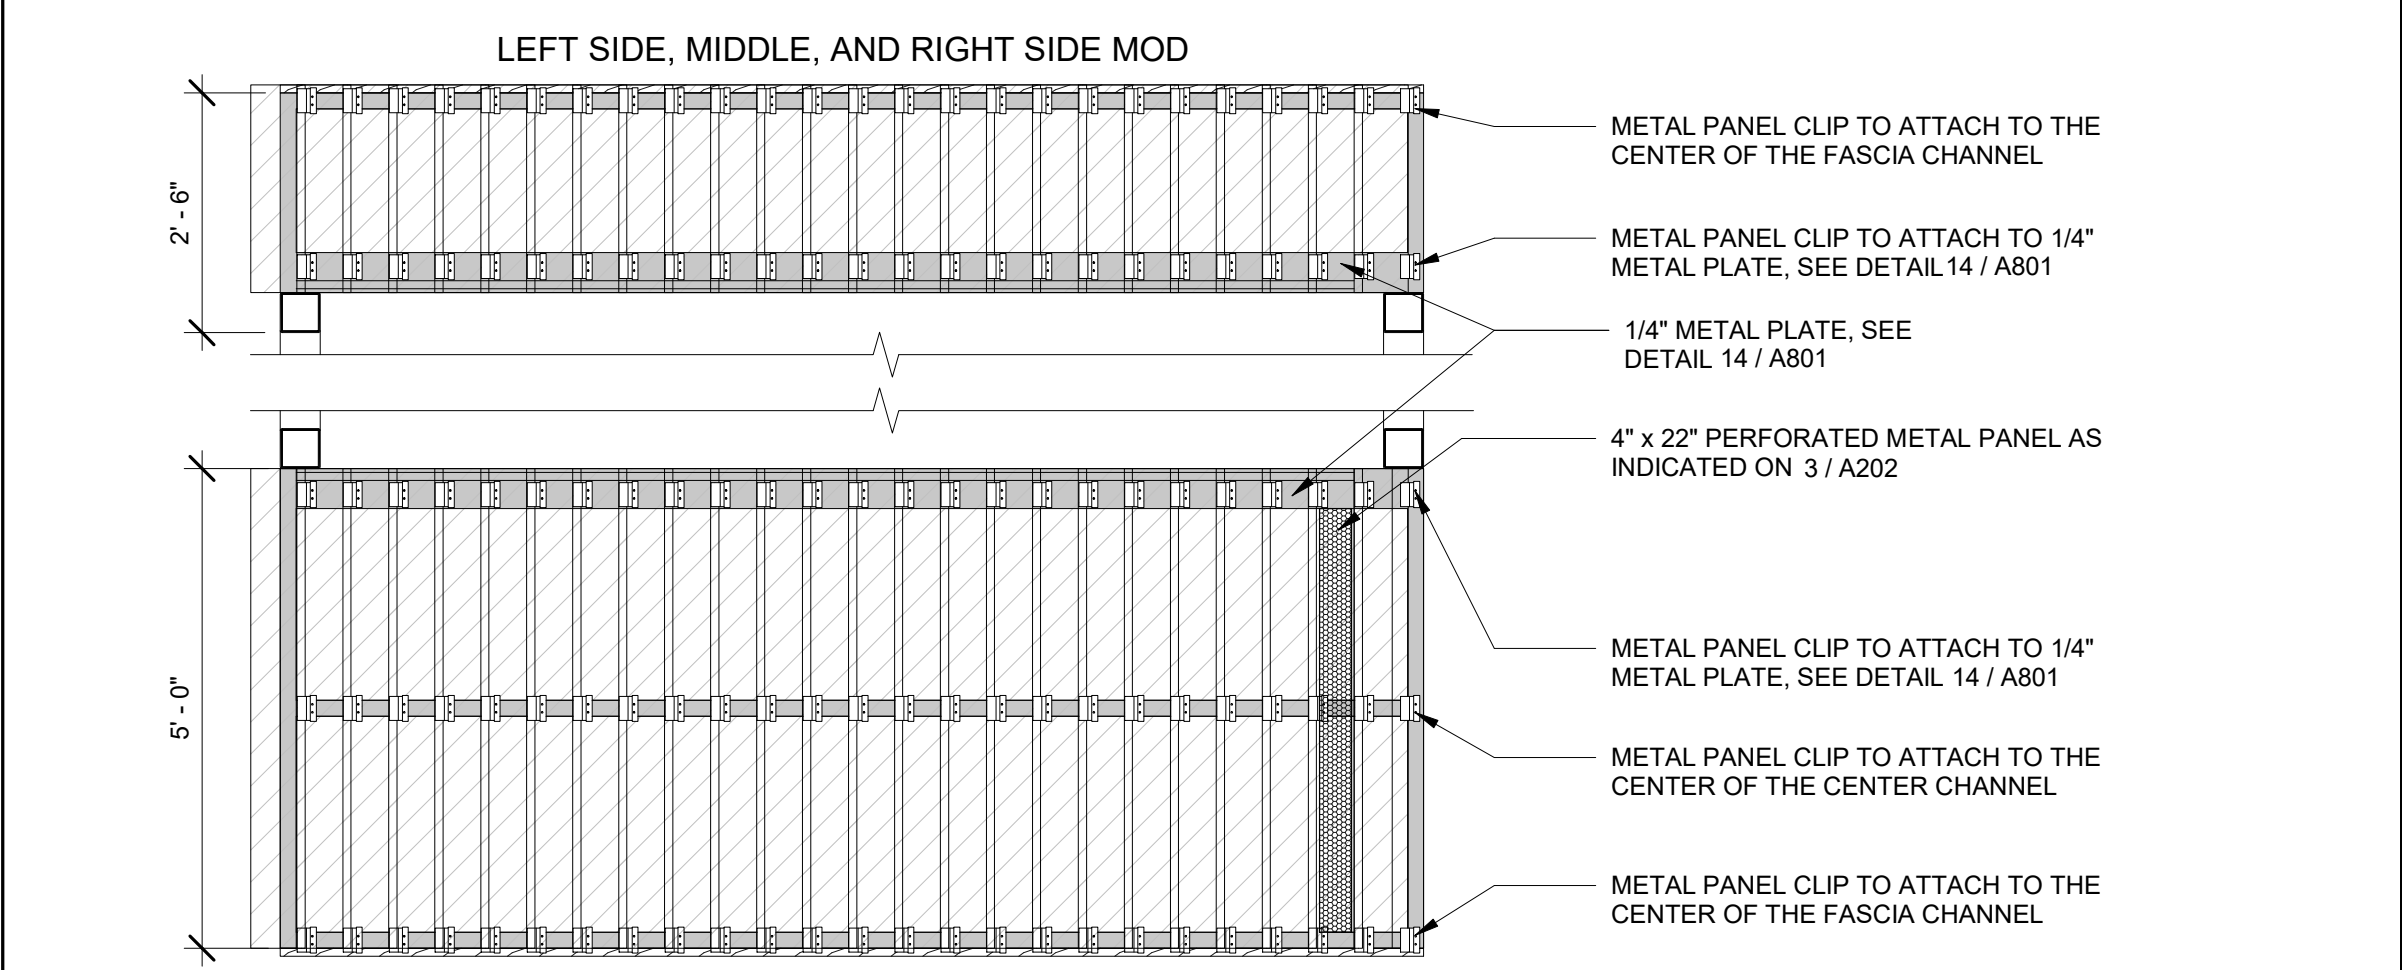


CLIP ATTACHMENT POINTS 1/2" = 1'-0" 14

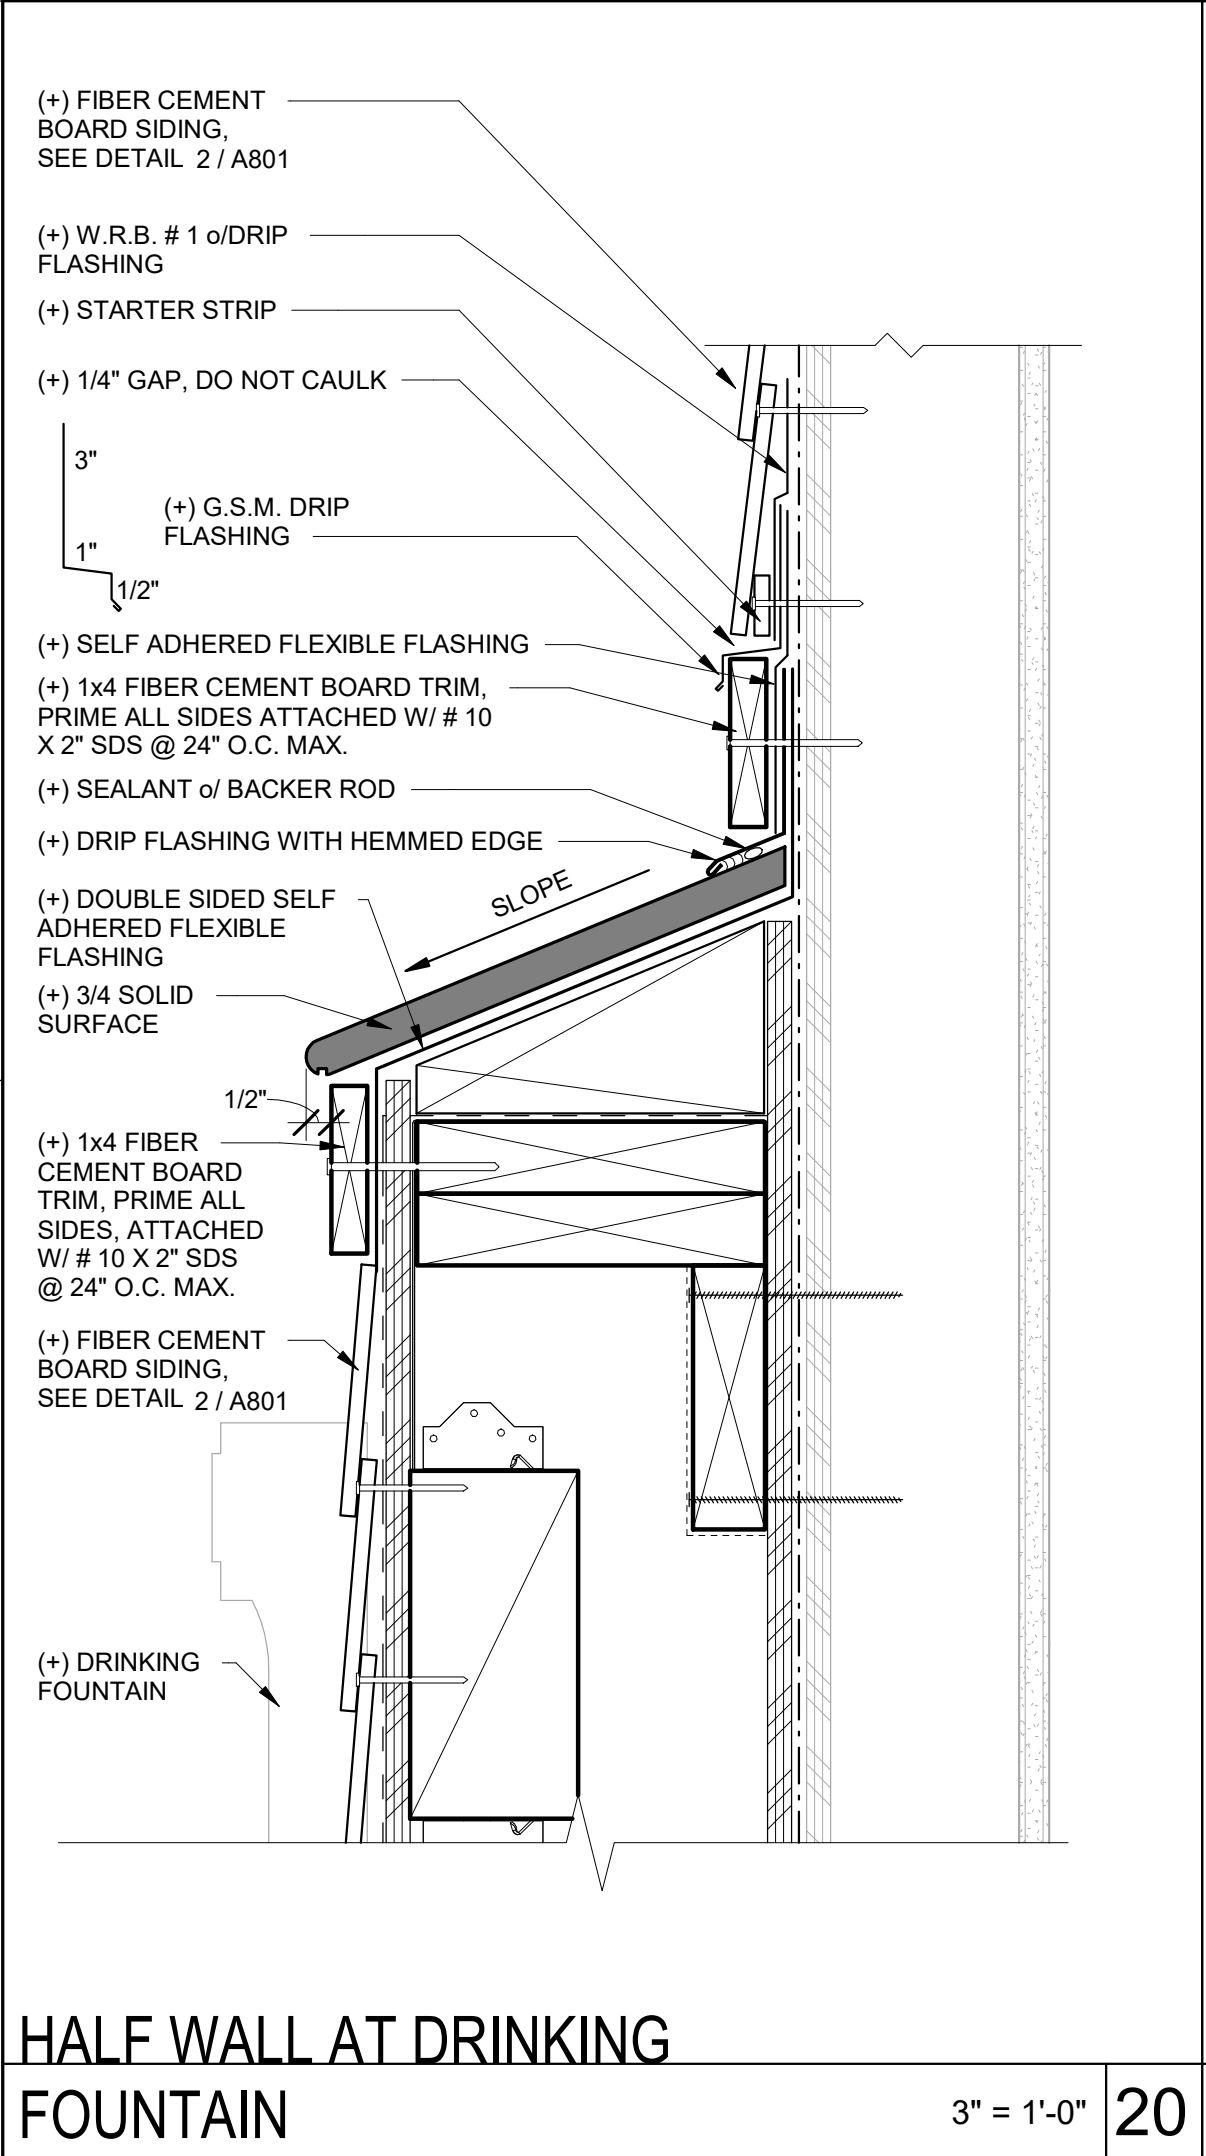


HALF WALL AT DRINKING FOUNTAIN 3" = 1'-0" 20

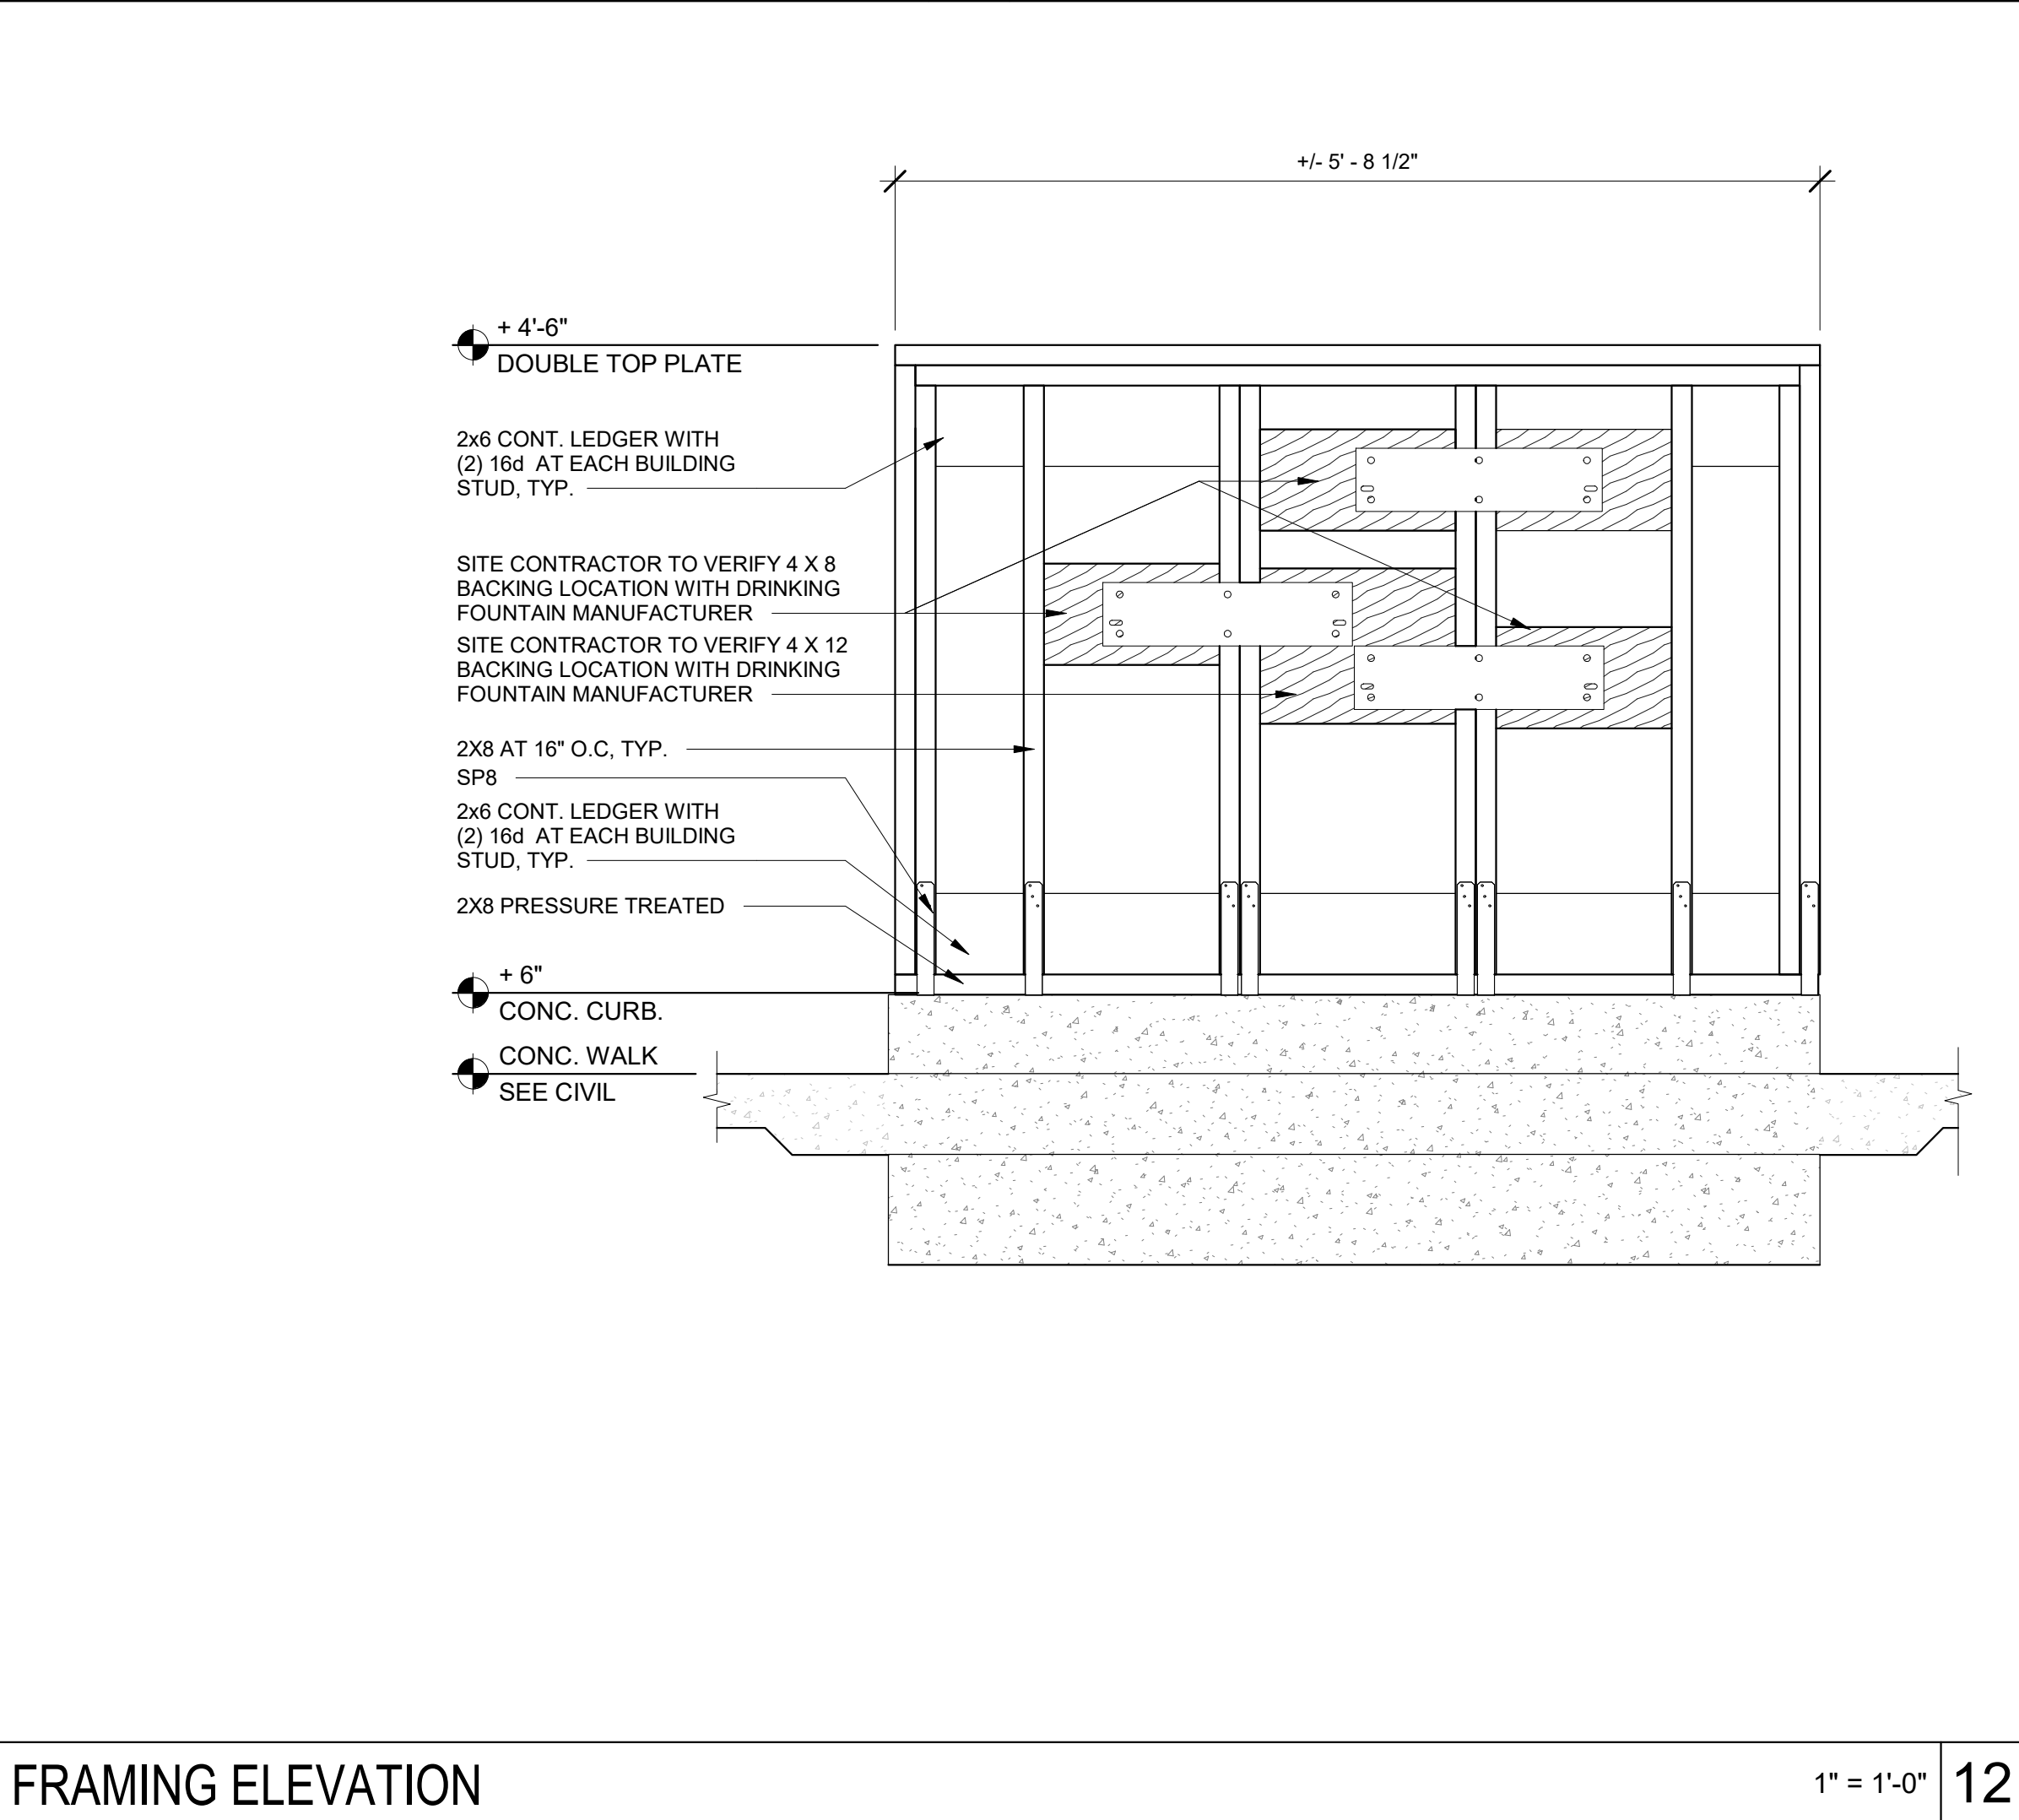


FRAMING ELEVATION 1" = 1'-0" 12

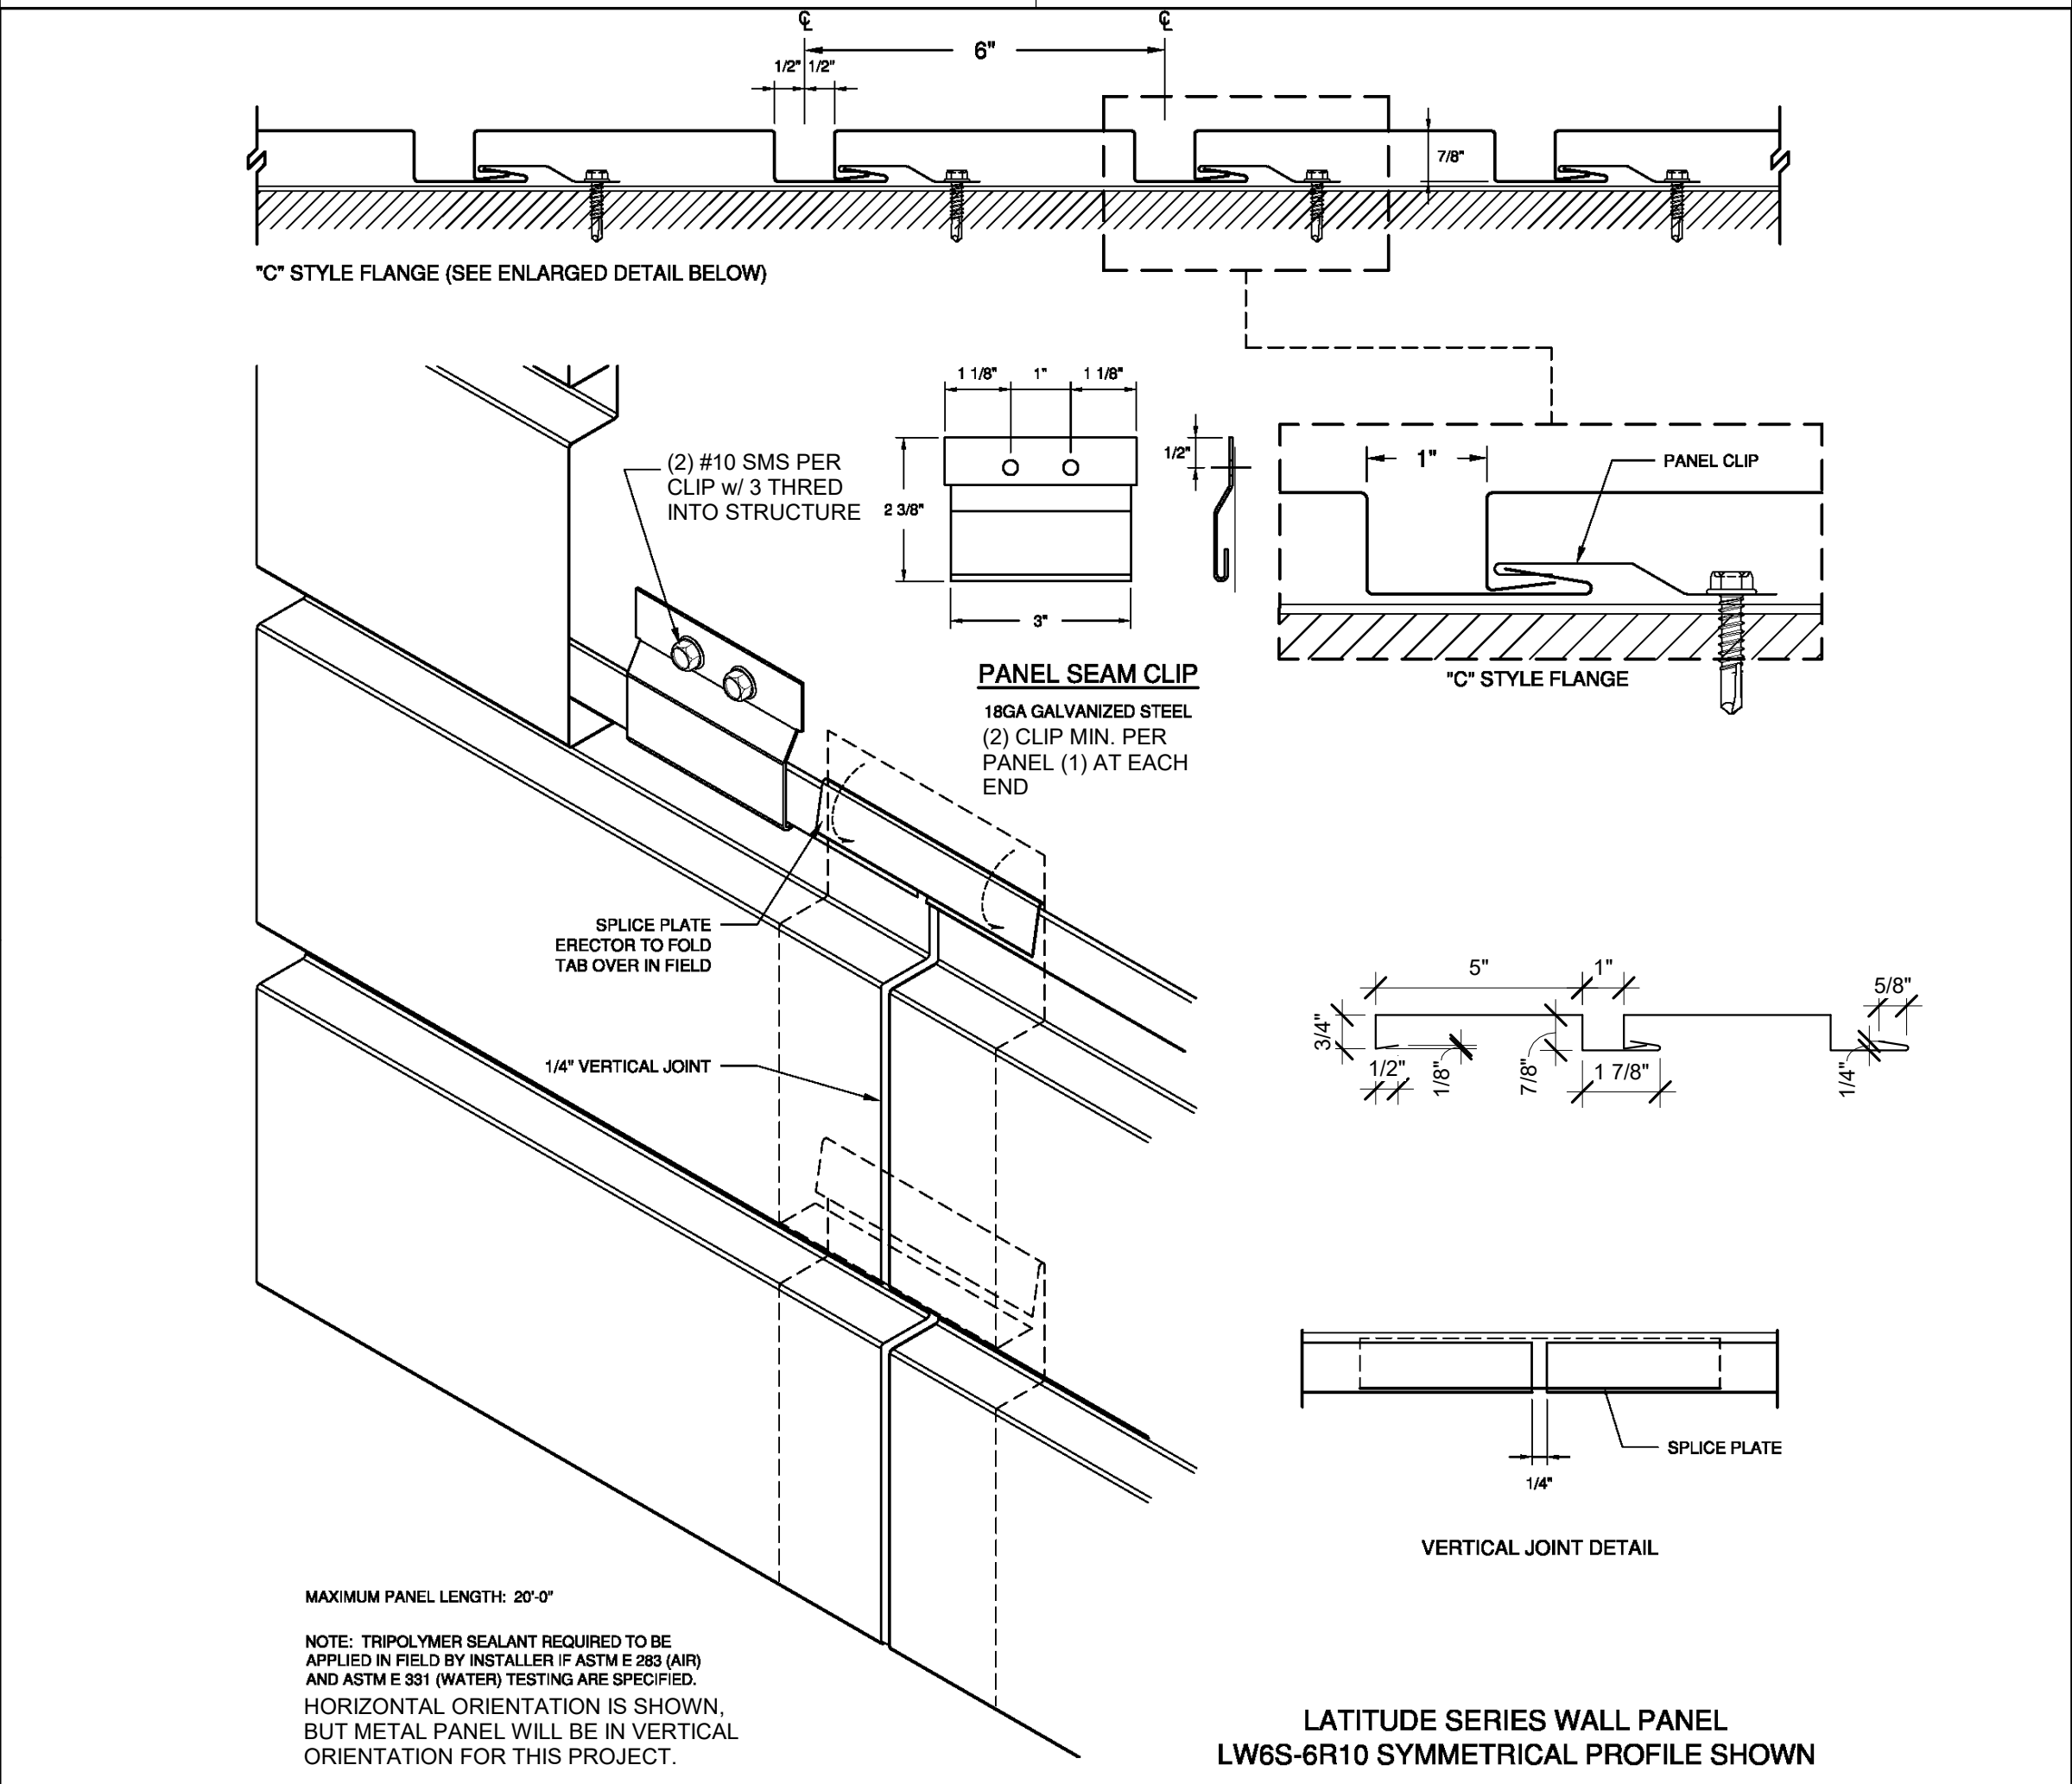

METAL PANEL SYSTEM N.T.S. 10

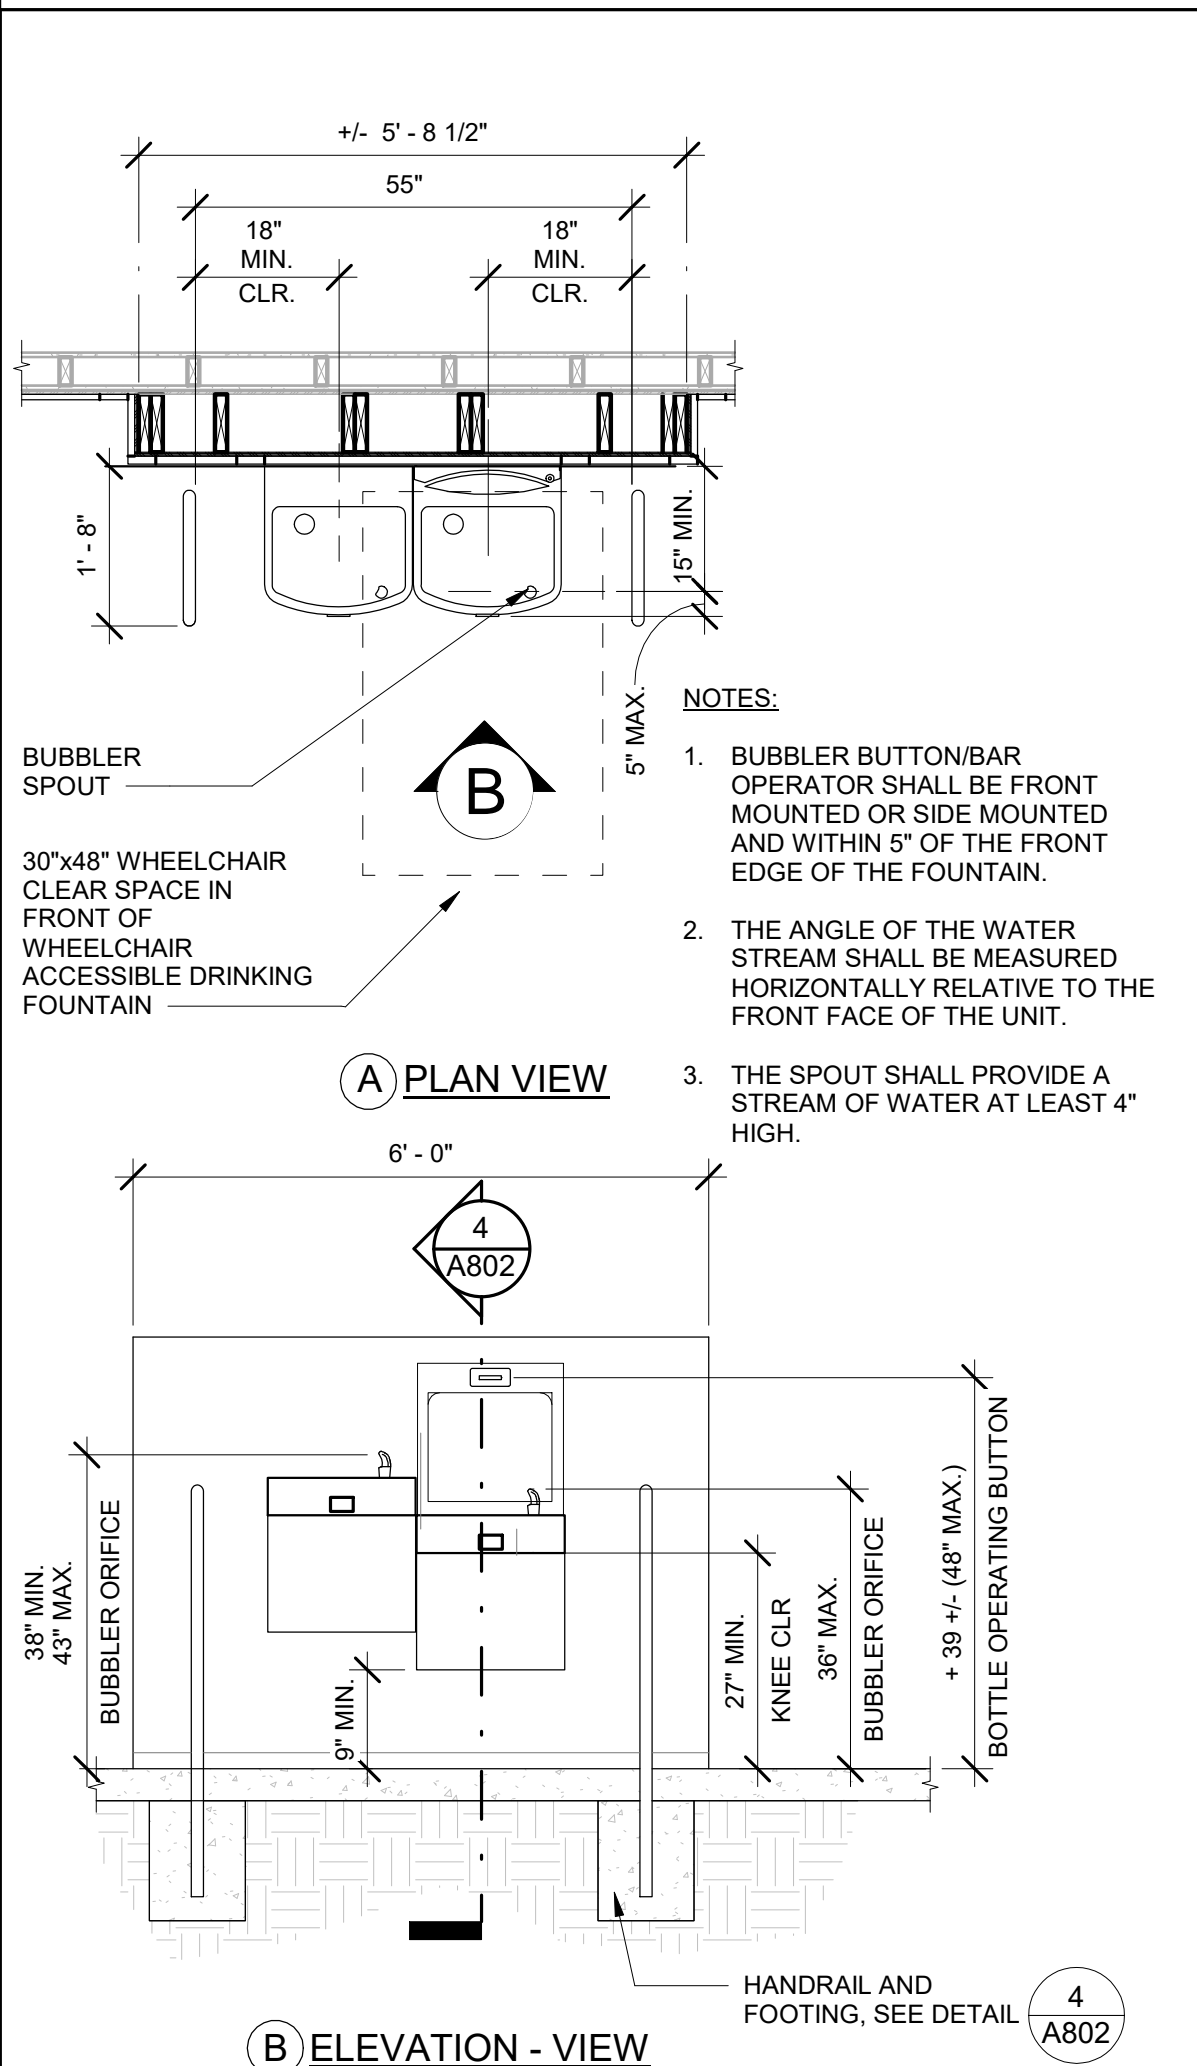


ACCESSIBLE DRINKING FOUNTAIN 1/2" = 1'-0" 2

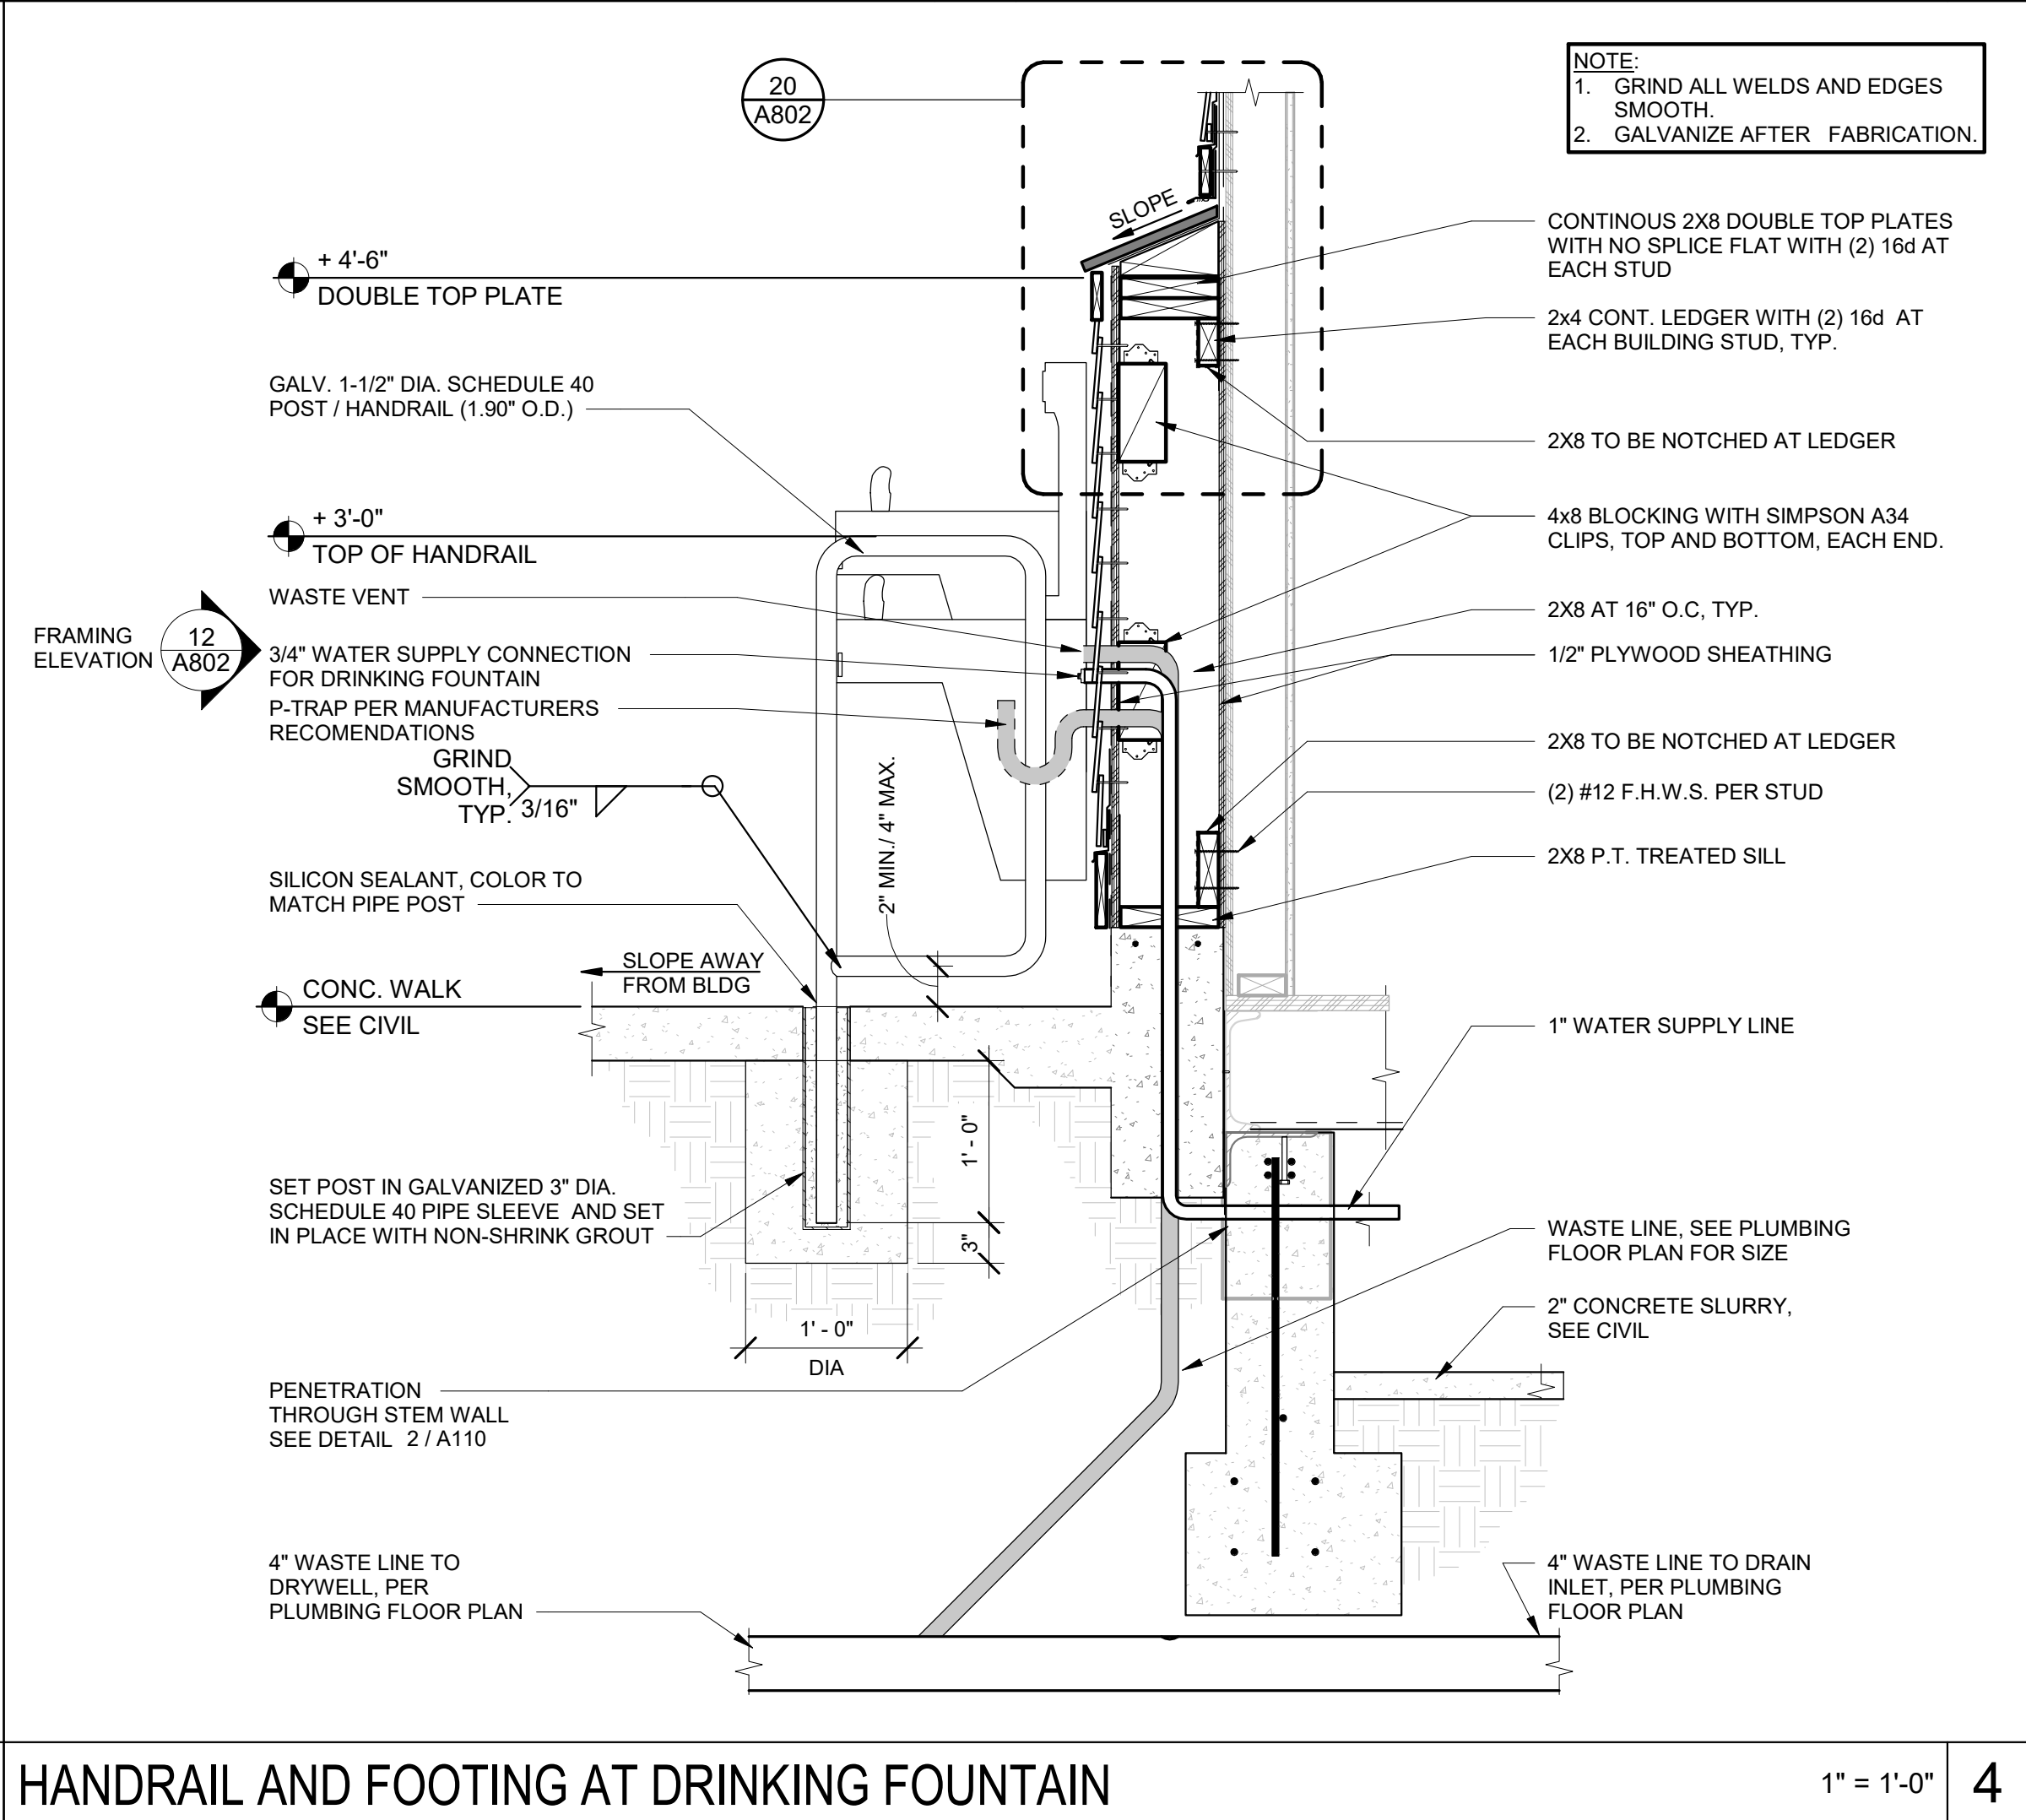



HANDRAIL AND FOOTING AT DRINKING FOUNTAIN 1" = 1'-0" 4

TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

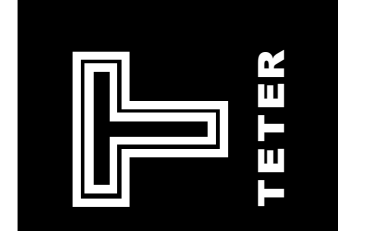


ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLD BROOK DR
STOCKTON, CA
DRAWING TITLE
EXTERIOR DETAIL

PROJECT NO.
23-12899
DRAWING
A802

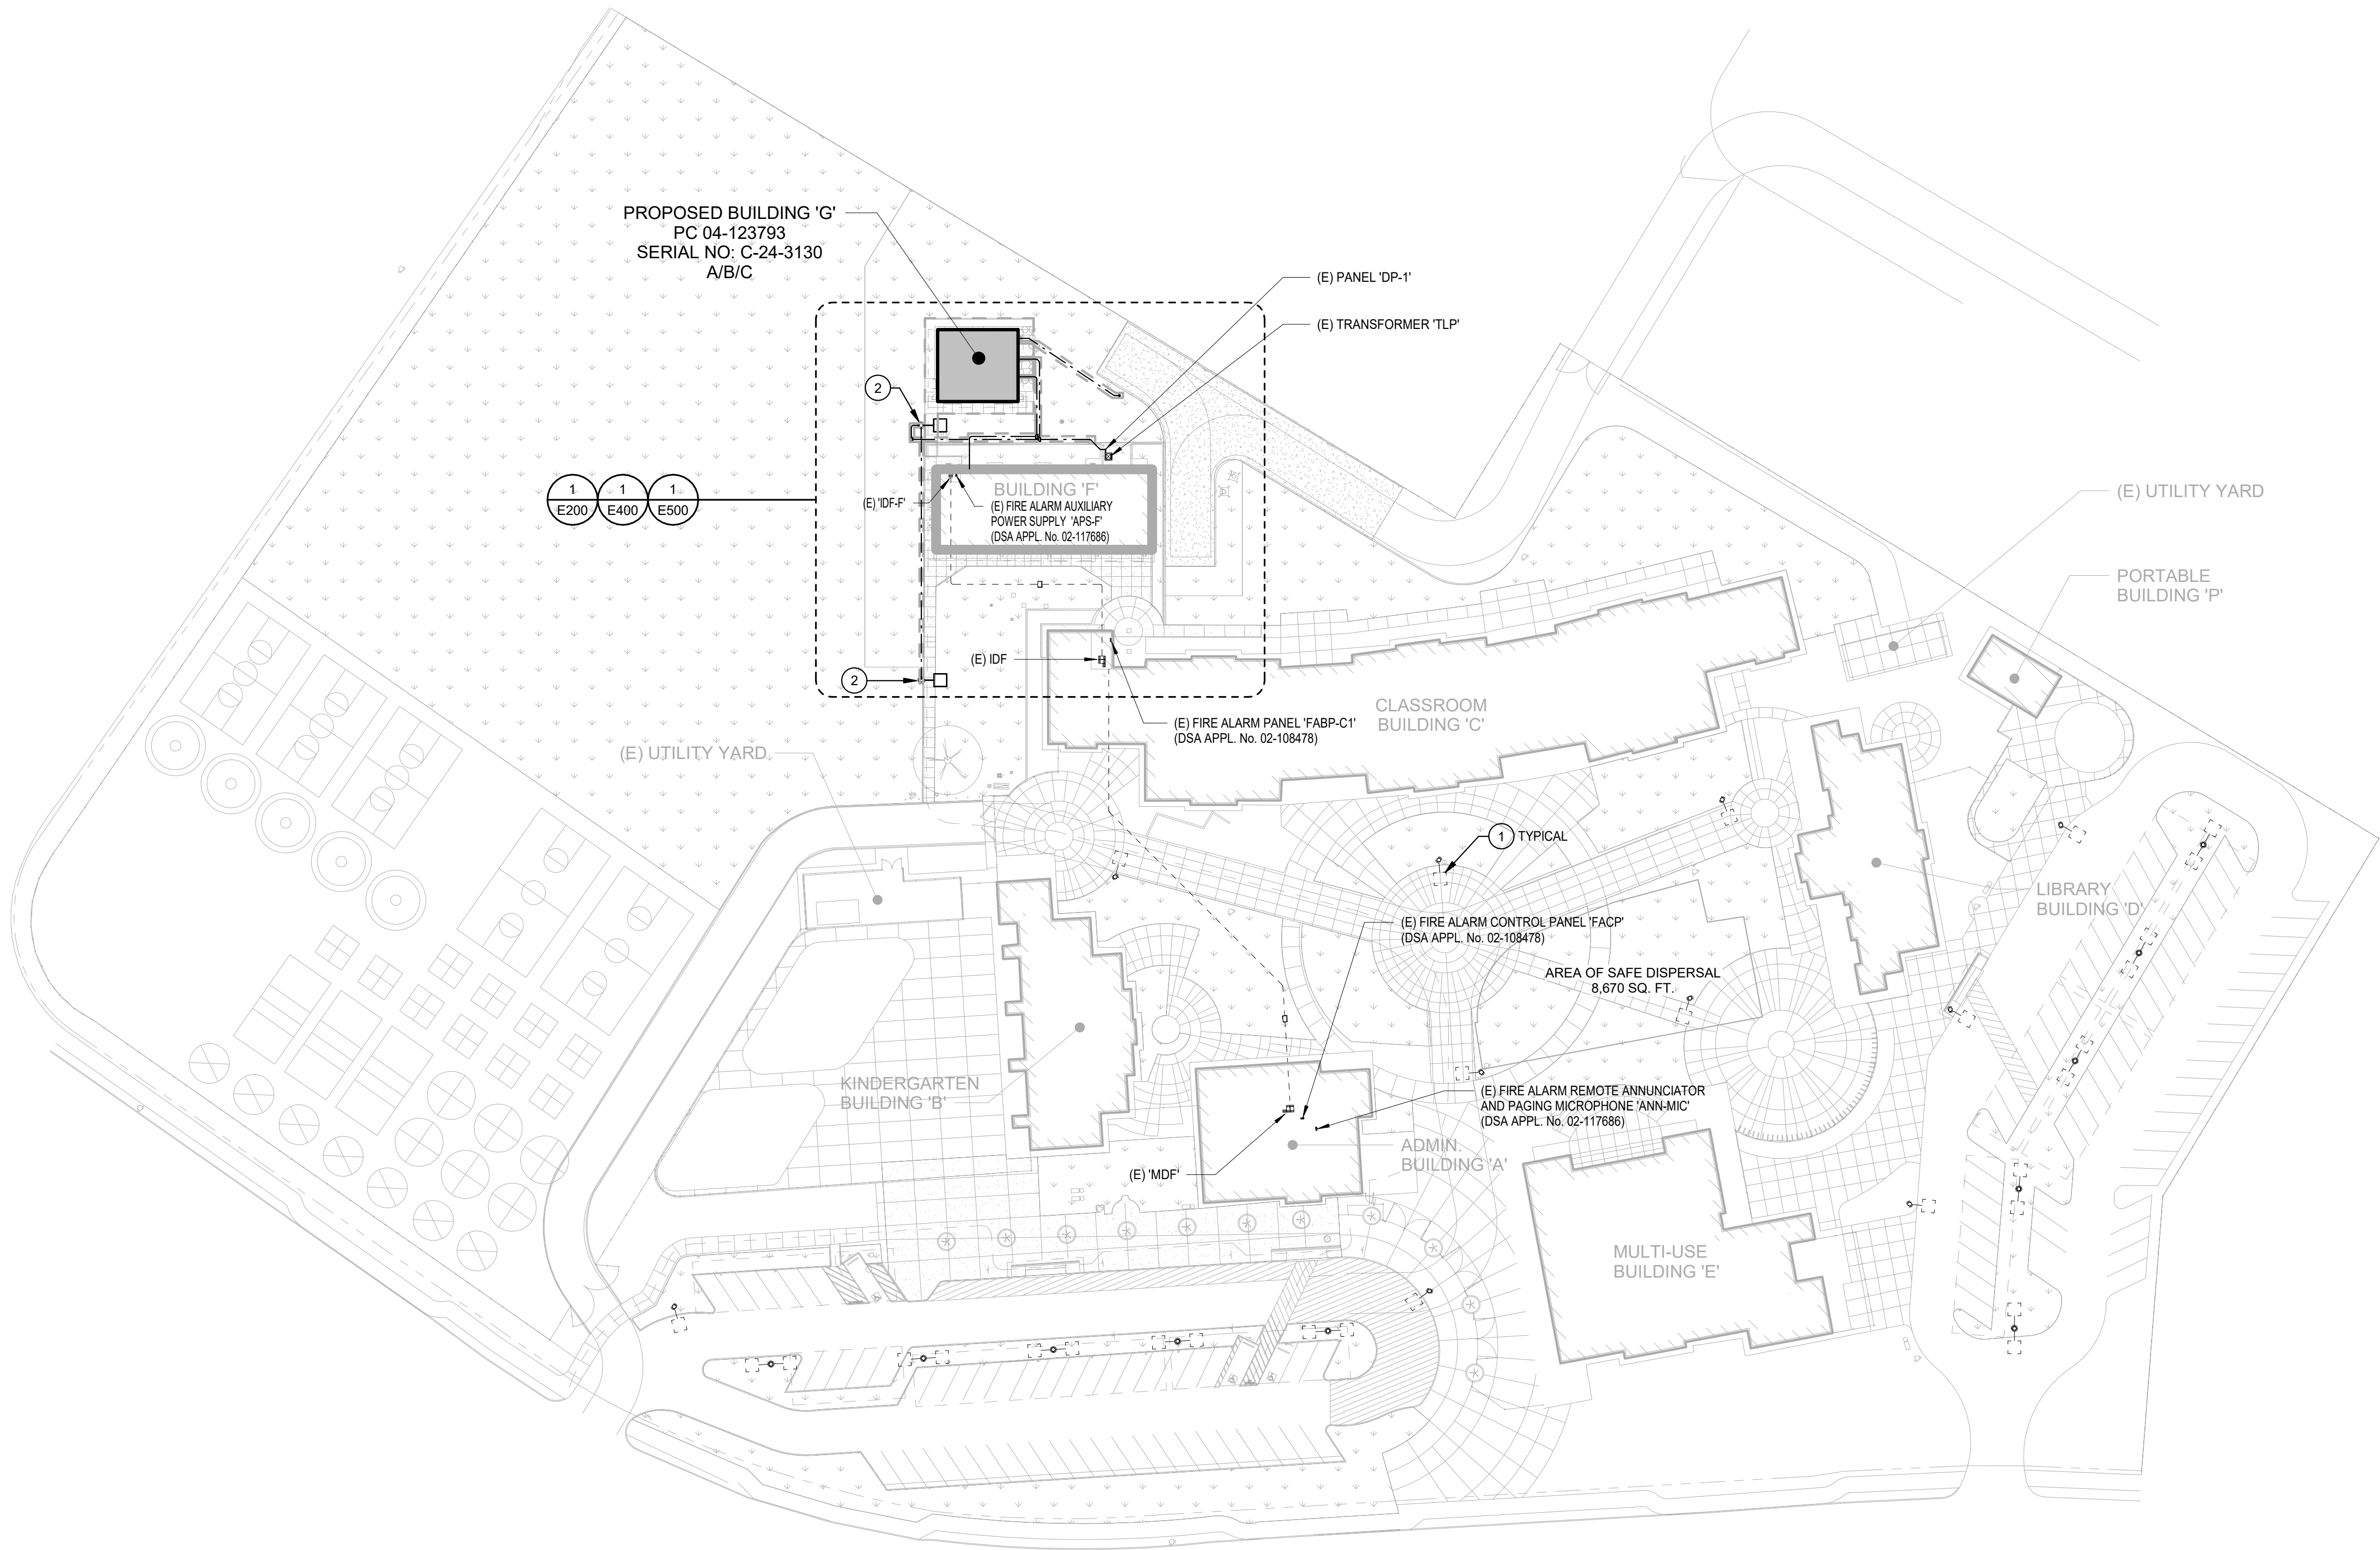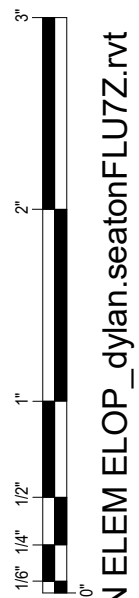

ELECTRICAL SITE PLAN



1" = 50'-0"

1

KEYNOTES

- EXISTING POLE MOUNTED LIGHT FIXTURE (TYPICAL U.O.N.).
- NEW POLE MOUNTED LIGHT FIXTURE PER ENLARGED POWER & LIGHTING PLAN 1/E200.


GENERAL NOTES

- PROVIDE ELECTRICAL FEEDERS PER SINGLE LINE DIAGRAM.
- PROVIDE PULLBOXES PER DETAIL 8/E600.
- SITE CONDUITS OF TRADE SIZE 2" AND LARGER SHALL BE GROUPED AND INSTALLED PER DETAIL 7/E600. SITE CONDUITS SHALL BE INSTALLED A MINIMUM OF 36" BELOW FINAL GRADE TO TOP OF CONDUIT.
- SPECIAL PRECAUTION SHALL BE TAKEN WHEN TRENCHING TO LOCATE, PROTECT AND PRESERVE EXISTING UNDERGROUND UTILITIES. ANY DAMAGE CAUSED DURING THE COURSE OF CONSTRUCTION SHALL BE IMMEDIATELY REPAIRED.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☐ FLS ☐ ACS ☐
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL




TETER, INC.

FRESNO HEADQUARTERS

VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO

ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLDBROOK ST.
STOCKTON, CA


PROJECT NO.

23-12899


DRAWING

E100

DRAWING TITLE
ELECTRICAL SITE PLAN

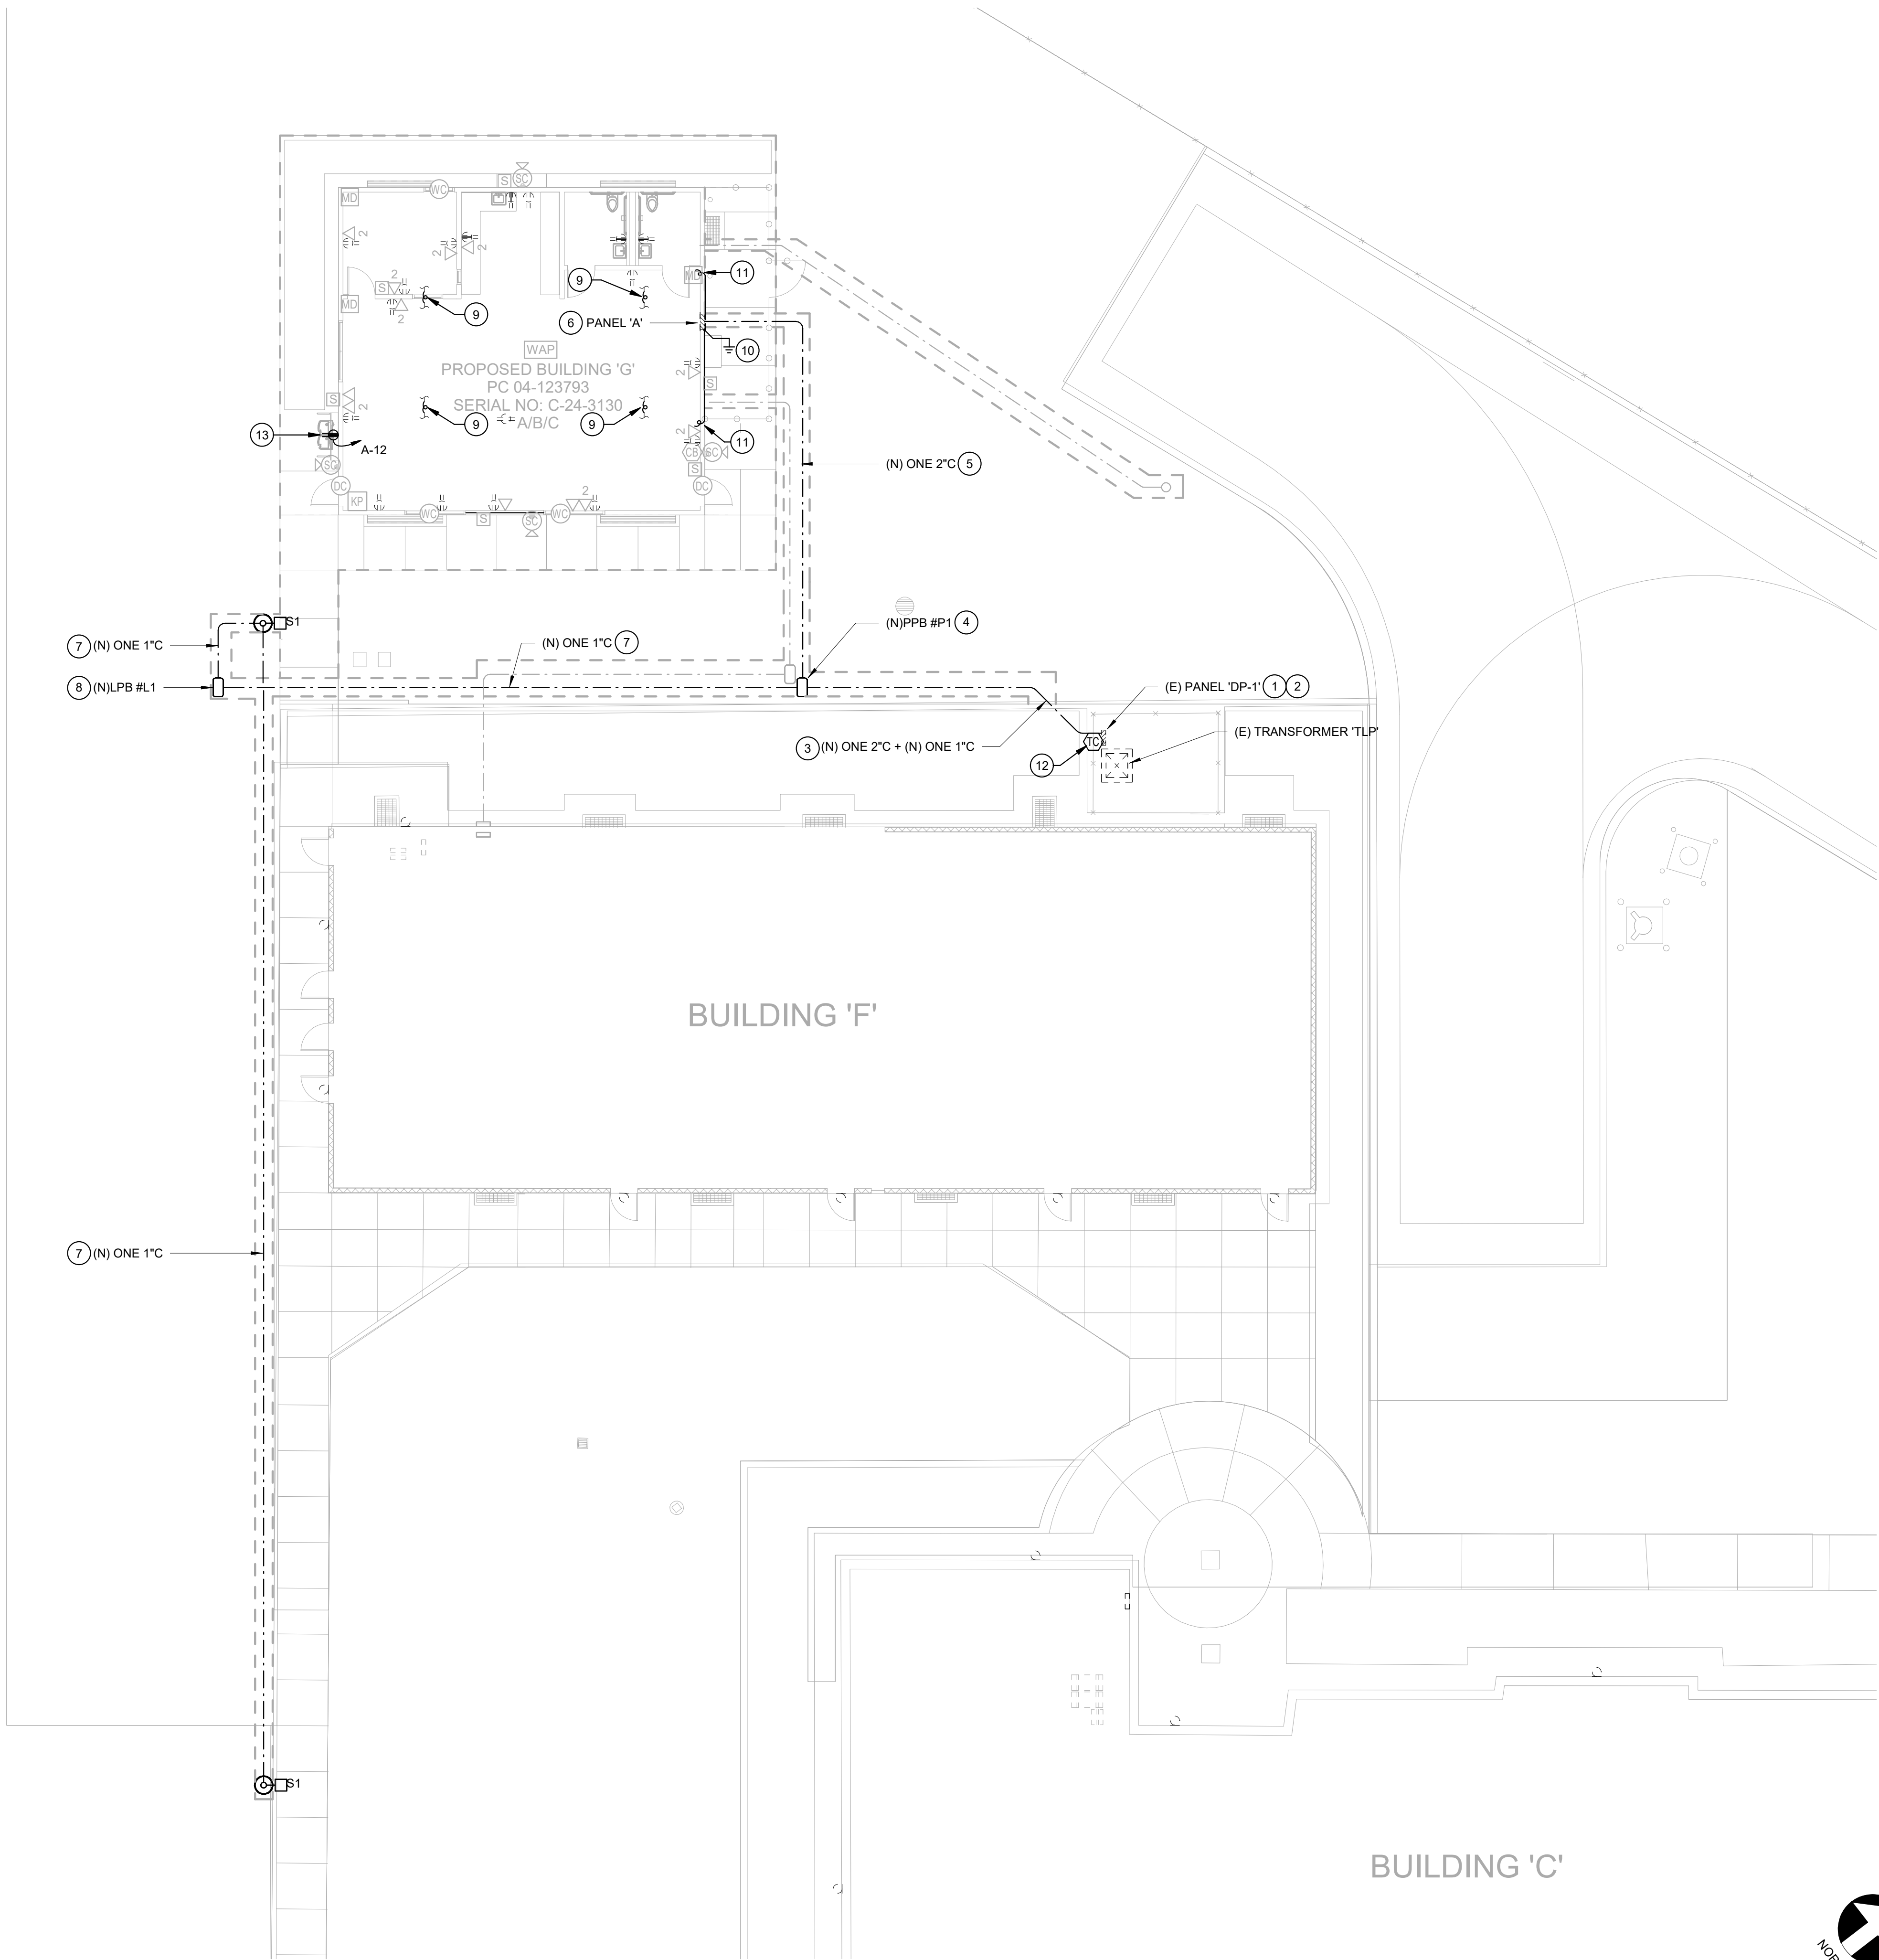

ENLARGED POWER & LIGHTING PLAN



1" = 10'-0"

1

KEYNOTES

- 1 PROVIDE NEW 100A, 2-POLE CIRCUIT BREAKER AT EXISTING DISTRIBUTION PANEL 'DP-1', AND CONNECT NEW FEEDER TO NEW RELOCATABLE BUILDING. REFER TO SINGLE LINE DIAGRAM 2/E600.
- 2 PROVIDE NEW 20A, 1-POLE CIRCUIT BREAKER AT EXISTING DISTRIBUTION PANEL 'DP-1', AND CONNECT NEW BRANCH SITE LIGHTING CIRCUIT. REFER TO SINGLE LINE DIAGRAM 2/E600.
- 3 PROVIDE ONE (N) 2"C WITH 3 #2 CU THWN, AND 1 #6 CU GND, AND ONE (N) 1"C WITH 2 #10 CU THWN AND 1 #10 CU GND.
- 4 PROVIDE (N) UNDERGROUND POWER PULL BOX PER DETAIL 8/E600.
- 5 PROVIDE ONE (N) 2"C WITH 3 #2 CU THWN, AND 1 #6 CU GND.
- 6 CONNECT PANEL AT NEW RELOCATABLE BUILDING PER SINGLE LINE DIAGRAM 2/E600.
- 7 PROVIDE ONE (N) 1"C WITH 2 #10 CU THWN AND 1 #10 CU GND.
- 8 PROVIDE (N) UNDERGROUND LIGHTING PULL BOX PER DETAIL 8/E600.
- 9 RECONNECT (E) POWER AND LIGHTING BRANCH CIRCUIT CONNECTIONS BETWEEN BUILDING MODULES.
- 10 PROVIDE SYSTEM GROUND FACILITIES PER DETAILS 3/E600 AND 4/E600.
- 11 PROVIDE GROUNDING LUGS ON BOTH SIDES OF RIGID METAL BEAMS AND BOND SECTIONS OF RELOCATABLE BUILDING TOGETHER WIT 1 #6 CU BONDING JUMPER.
- 12 PROVIDE (N) ASTONOMIC ELECTRONIC 1-CIRCUIT TIME CLOCK WITH NEMA 3R ENCLOSURE, INTERMATIC #ET90115CR OR EQUIVALENT. CONNECT TIME CLOCK FOR ON/OFF CONTROL OF (N) BRANCH SITE LIGHTING CIRCUIT. MOUNT TIME CLOCK TO (E) POST STRUT ASSEMBLY.
- 13 PROVIDE (N) WEATHERPROOF G.F.C.I. DUPLEX RECEPTACLE FOR DRINKING FOUNTAINS AND CONNECT TO NEW BRANCH CIRCUIT.


GENERAL NOTES

- A. PROVIDE ELECTRICAL FEEDERS PER SINGLE LINE DIAGRAM.
- B. PENETRATIONS THROUGH WALLS, CEILINGS, FLOORS, AND/OR ROOFS SHALL BE SEALED.
- C. TRENCH AND BACKFILL PER ARCHITECTURAL PLANS, SPECIFICATIONS, AND DETAIL 7/E600. SITE CONDUITS SHALL BE INSTALLED A MINIMUM OF 36" BELOW FINAL GRADE TO TOP OF CONDUIT.
- D. SPECIAL PRECAUTION SHALL BE TAKEN WHEN TRENCHING TO LOCATE, PROTECT AND PRESERVE EXISTING UNDERGROUND UTILITIES. ANY DAMAGE CAUSED DURING THE COURSE OF CONSTRUCTION SHALL BE IMMEDIATELY REPAIRED.

IDENTIFICATION STAMP	
DIV. OF THE STATE ARCHITECT	
APP. 02-122690	INC.
REVIEWED FOR	
SS <input type="checkbox"/>	FLS <input type="checkbox"/> ACS <input type="checkbox"/>
DATE: 11/26/2024	

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. The document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL



TETER, INC.

FRESNO HEADQUARTERS

VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO

ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLDBROOK ST.
STOCKTON, CA


PROJECT NO.

23-12899


DRAWING

E200

DRAWING TITLE
ENLARGED POWER & LIGHTING PLAN

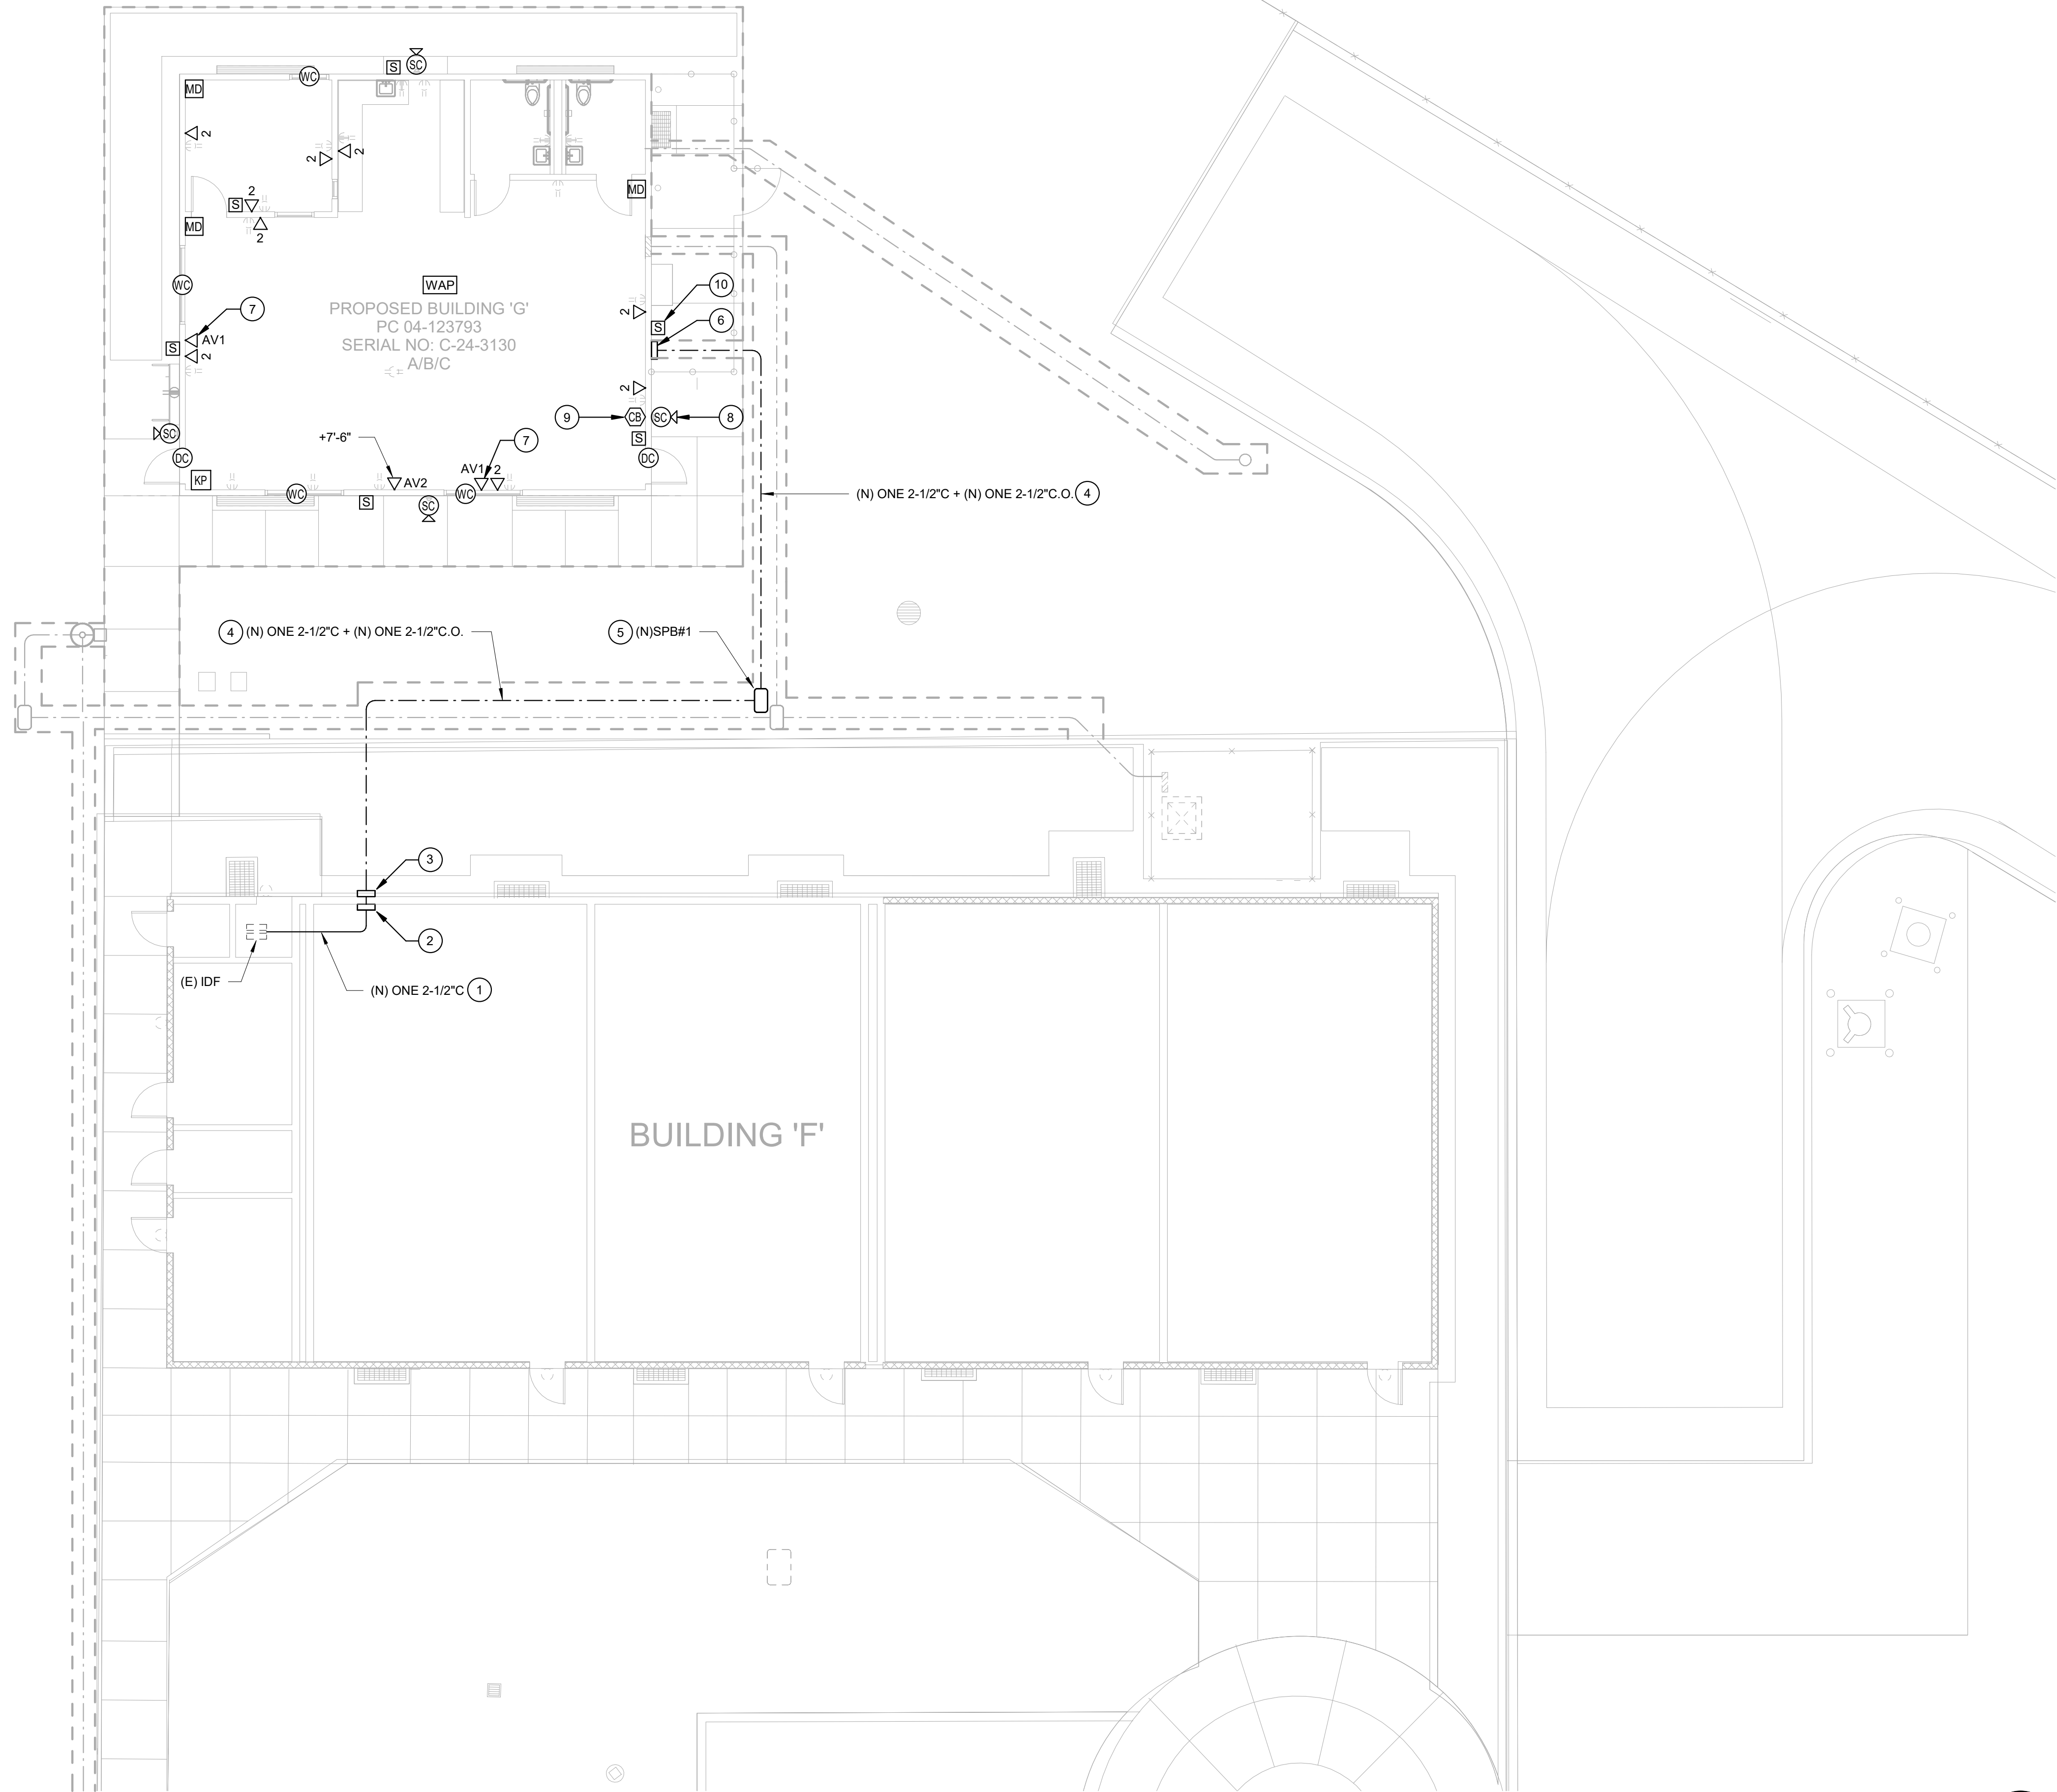

ENLARGED SIGNAL PLAN



1/8" = 1'-0"

1

KEYNOTES

- 1 PROVIDE ONE (N) 2-1/2"C WITH THIRTY-ONE (31) TYPE 'D' CABLES TO NEW RELOCATABLE BUILDING.
- 2 PROVIDE (N) 14" SQ. X 6" DEEP NEMA TYPE 1 SCREW COVER CAN ON INTERIOR SIDE OF BUILDING WALL.
- 3 PROVIDE (N) 14" SQ. X 6" DEEP NEMA TYPE 3R SCREW COVER CAN ON EXTERIOR SIDE OF BUILDING WALL.
- 4 PROVIDE ONE (N) 2-1/2"C WITH THIRTY-ONE (31) TYPE 'D' CABLES, AND ONE (N) 2-1/2"C.O.
- 5 PROVIDE (N) UNDERGROUND SIGNAL PULL BOX PER DETAIL 8/E600.
- 6 PROVIDE (N) 14" SQ. X 6" DEEP NEMA TYPE 3R SCREW COVER CAN ON EXTERIOR BUILDING WALL FOR PENETRATION ONTO ACCESSIBLE ATTIC SPACE.
- 7 PROVIDE ONE (N) TYPE 'H' CABLE FROM EACH 'AV1' HDMI JACK TO 'AV2' HDMI JACKS.
- 8 PROVIDE ONE TYPE 'D' CABLE BACK TO IDF. TYPICAL OF ALL SECURITY CAMERA LOCATIONS.
- 9 PROVIDE ONE TYPE 'D' CABLE BACK TO IDF, FROM CALL BUTTON.
- 10 PROVIDE ONE TYPE 'D' CABLE BACK TO IDF. TYPICAL OF ALL INTERIOR AND EXTERIOR SPEAKER LOCATIONS.

GENERAL NOTES

- A. PENETRATIONS THROUGH WALLS, CEILINGS, FLOORS, AND/OR ROOFS SHALL BE SEALED.
- B. TRENCH AND BACKFILL PER ARCHITECTURAL PLANS, SPECIFICATIONS, AND DETAIL 7/E600. SITE CONDUITS SHALL BE INSTALLED A MINIMUM OF 36" BELOW FINAL GRADE TO TOP OF CONDUIT.
- C. SPECIAL PRECAUTION SHALL BE TAKEN WHEN TRENCHING TO LOCATE, PROTECT AND PRESERVE EXISTING UNDERGROUND UTILITIES. ANY DAMAGE CAUSED DURING THE COURSE OF CONSTRUCTION SHALL BE IMMEDIATELY REPAIRED.

SECURITY AND ACCESS ROUGH-IN NOTES

- A. SECURITY AND ACCESS SYSTEM ROUGH-IN REQUIREMENTS:
 - a. AT DOOR CONTACT LOCATIONS - DRILL 1/2" HOLE IN STRIKE SIDE OF DOOR FRAME AND THROUGH HEADER, INSTALL A PULL WIRE BETWEEN OPENING IN DOOR FRAME AND ACCESSIBLE ATTIC.
 - b. AT MOTION DETECTOR LOCATIONS - INSTALL A SINGLE-GANG OUTLET BOX WITH A SINGLE-GANG TRIM-RING IN WALL AT 84" A.F.F., INSTALL ONE 1/2"C INTO ACCESSIBLE ATTIC SPACE. INSTALL A PULL WIRE BETWEEN OUTLET BOX AND ACCESSIBLE ATTIC.
 - c. AT KEYPAD LOCATIONS - INSTALL A SINGLE-GANG OUTLET BOX WITH A SINGLE-GANG TRIM-RING IN WALL AT 48" A.F.F. TO TOP OF BOX. INSTALL ONE 3/4"C INTO ACCESSIBLE ATTIC SPACE. INSTALL A PULL WIRE BETWEEN OUTLET BOX AND ACCESSIBLE ATTIC.
 - d. AT CARD READER LOCATIONS - INSTALL A SINGLE-GANG OUTLET BOX WITH A SINGLE-GANG TRIM-RING IN WALL AT 48" A.F.F. TO TOP OF BOX. INSTALL ONE 3/4"C INTO ACCESSIBLE ATTIC SPACE. INSTALL A PULL WIRE BETWEEN OUTLET BOX AND ACCESSIBLE ATTIC.


TELECOMMUNICATION CABLING NOTES

- A. CONDUIT AND JUNCTION BOXES PROVIDED BY BUILDING MANUFACTURER.
- B. PROVIDE THREADED SET SCREW CONNECTORS WITH POLYPROPYLENE BUSHINGS AT EACH END OF CONDUIT SYSTEMS USED FOR TELECOMMUNICATION CABLE INSTALLATION. BUSHINGS SHALL BE INSTALLED AND INSPECTED PRIOR TO CABLE INSTALLATION.
- C. EACH TELECOMMUNICATION CABLE SHALL BE HOMERUN FROM THE TELECOMMUNICATION OUTLET TO A PATCH PANEL LOCATED IN THE IDF IN THE ADJACENT BUILDING.
- D. TELECOMMUNICATION CABLES SHALL BE NEATLY BUNDLED WITH VELCRO STRAPS AT 36"C.O.
- E. TELECOMMUNICATION CABLES SHALL BE INDEPENDENTLY SUPPORTED FROM J-HOOKS WITHIN THE ACCESSIBLE ATTIC SPACE WHERE THEY ARE NOT WITHIN CONDUIT.
- F. TELECOMMUNICATION CABLES SHALL BE TERMINATED WITH MODULAR JACKS ON PATCH PANELS IN THE TELECOMMUNICATION ENCLOSURE AND ON MODULAR JACKS AT THE TELECOMMUNICATION OUTLETS.
- G. TELECOMMUNICATION CABLE SERVING WIRELESS ACCESS POINTS SHALL BE TERMINATED WITH PLUG TYPE CONNECTORS AT THE LOCATION OF THE WIRELESS ACCESS POINT.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

MARK	DATE	DESCRIPTION
B	07/31/2024	DSA SUBMITTAL
C	11/01/2024	DSA BACKCHECK SUBMITTAL




TETER, INC.

FRESNO HEADQUARTERS

VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO

ARCHITECTS ENGINEERS CONNECTED



ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLDBROOK ST.
STOCKTON, CA

PROJECT NO.

23-12899

DRAWING


E400

DRAWING TITLE
ENLARGED SIGNAL PLAN





- A. THE LOCATION OF AUTOMATIC DETECTORS, MANUAL PULL STATIONS AND OTHER FIRE ALARM EQUIPMENT AND DEVICES, AS SHOWN ON PLAN, ARE FOR REFERENCE ONLY, AND DO NOT CONSTITUTE SHOP DRAWINGS WHICH ARE REQUIRED FOR REVIEW AND APPROVAL.
- B. ALL DRAWINGS ARE DIAGRAMMATIC ONLY, AND SHALL NOT BE USED IN DETERMINING ACTUAL CONDUIT ROUTING. THE CONTRACTOR SHALL VERIFY ALL CONDUIT ROUTING CONDITIONS AT THE PROJECT SITE AS CONSTRUCTION PROGRESSES.
- C. ALL FIRE ALARM DATA, COMMUNICATIONS AND INITIATING CIRCUITS SHALL BE INSTALLED UTILIZING SOLID COPPER CONDUCTORS WITH OUTER COVERING COLORS PER THE SPECIFICATIONS AND AS SHOWN ON THE DRAWINGS. ALL SMOKE DAMPER AND REMOTE TROUBLE INDICATOR CIRCUITS SHALL BE YELLOW. ALL CIRCUITS SHALL BE INDIVIDUALLY LABELED, BOTH AT THE DEVICE END AND AT THE SIGNAL TERMINAL CABINET AND/OR FIRE ALARM MASTER PANEL TERMINATION POINT.
- D. ALL FIRE ALARM CIRCUITS SHALL BE CONTINUOUS FROM DEVICE TO DEVICE. SPLICES ARE NOT ALLOWED UNLESS IN COVERED JUNCTION BOXES ON APPROVED TERMINAL BLOCKS. "T" TAPPING IS ALLOWED ONLY IN INITIATION LOOPS CONNECTING ADDRESSABLE DEVICES AND ONLY UNDER THESE CONDITIONS. UNDER NO CIRCUMSTANCES SHALL "T" TAPPING BE PERMITTED BETWEEN CONVENTIONAL DEVICES.
- E. SMOKE DETECTORS SHALL BE INSTALLED AHEAD FROM AIR SUPPLY GRILLES AT A MINIMUM DISTANCE OF 3' PER NFPA 72 29.8.3.4 OR GREATER AS RECOMMENDED BY THE MANUFACTURER.
- F. CONTRACTOR SHALL SYNCHRONIZE TWO OR MORE STROBES IN ONE ROOM AND TWO OR MORE SPEAKERS WITHIN HEARING OF EACH OTHER.
- G. THE FIRE ALARM SYSTEM SHALL CONFORM TO THE 2022 CALIFORNIA ELECTRICAL CODE (CEC) ARTICLE 780 AND THE 2022 CALIFORNIA FIRE CODE (CFC) § 105.7 & § 907, AND CALIFORNIA BUILDING CODE (CBC) 907.

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used in whole or in part, for any other project without prior written authorization.



PROJECT NO.
23-12899
DRAWING


E500

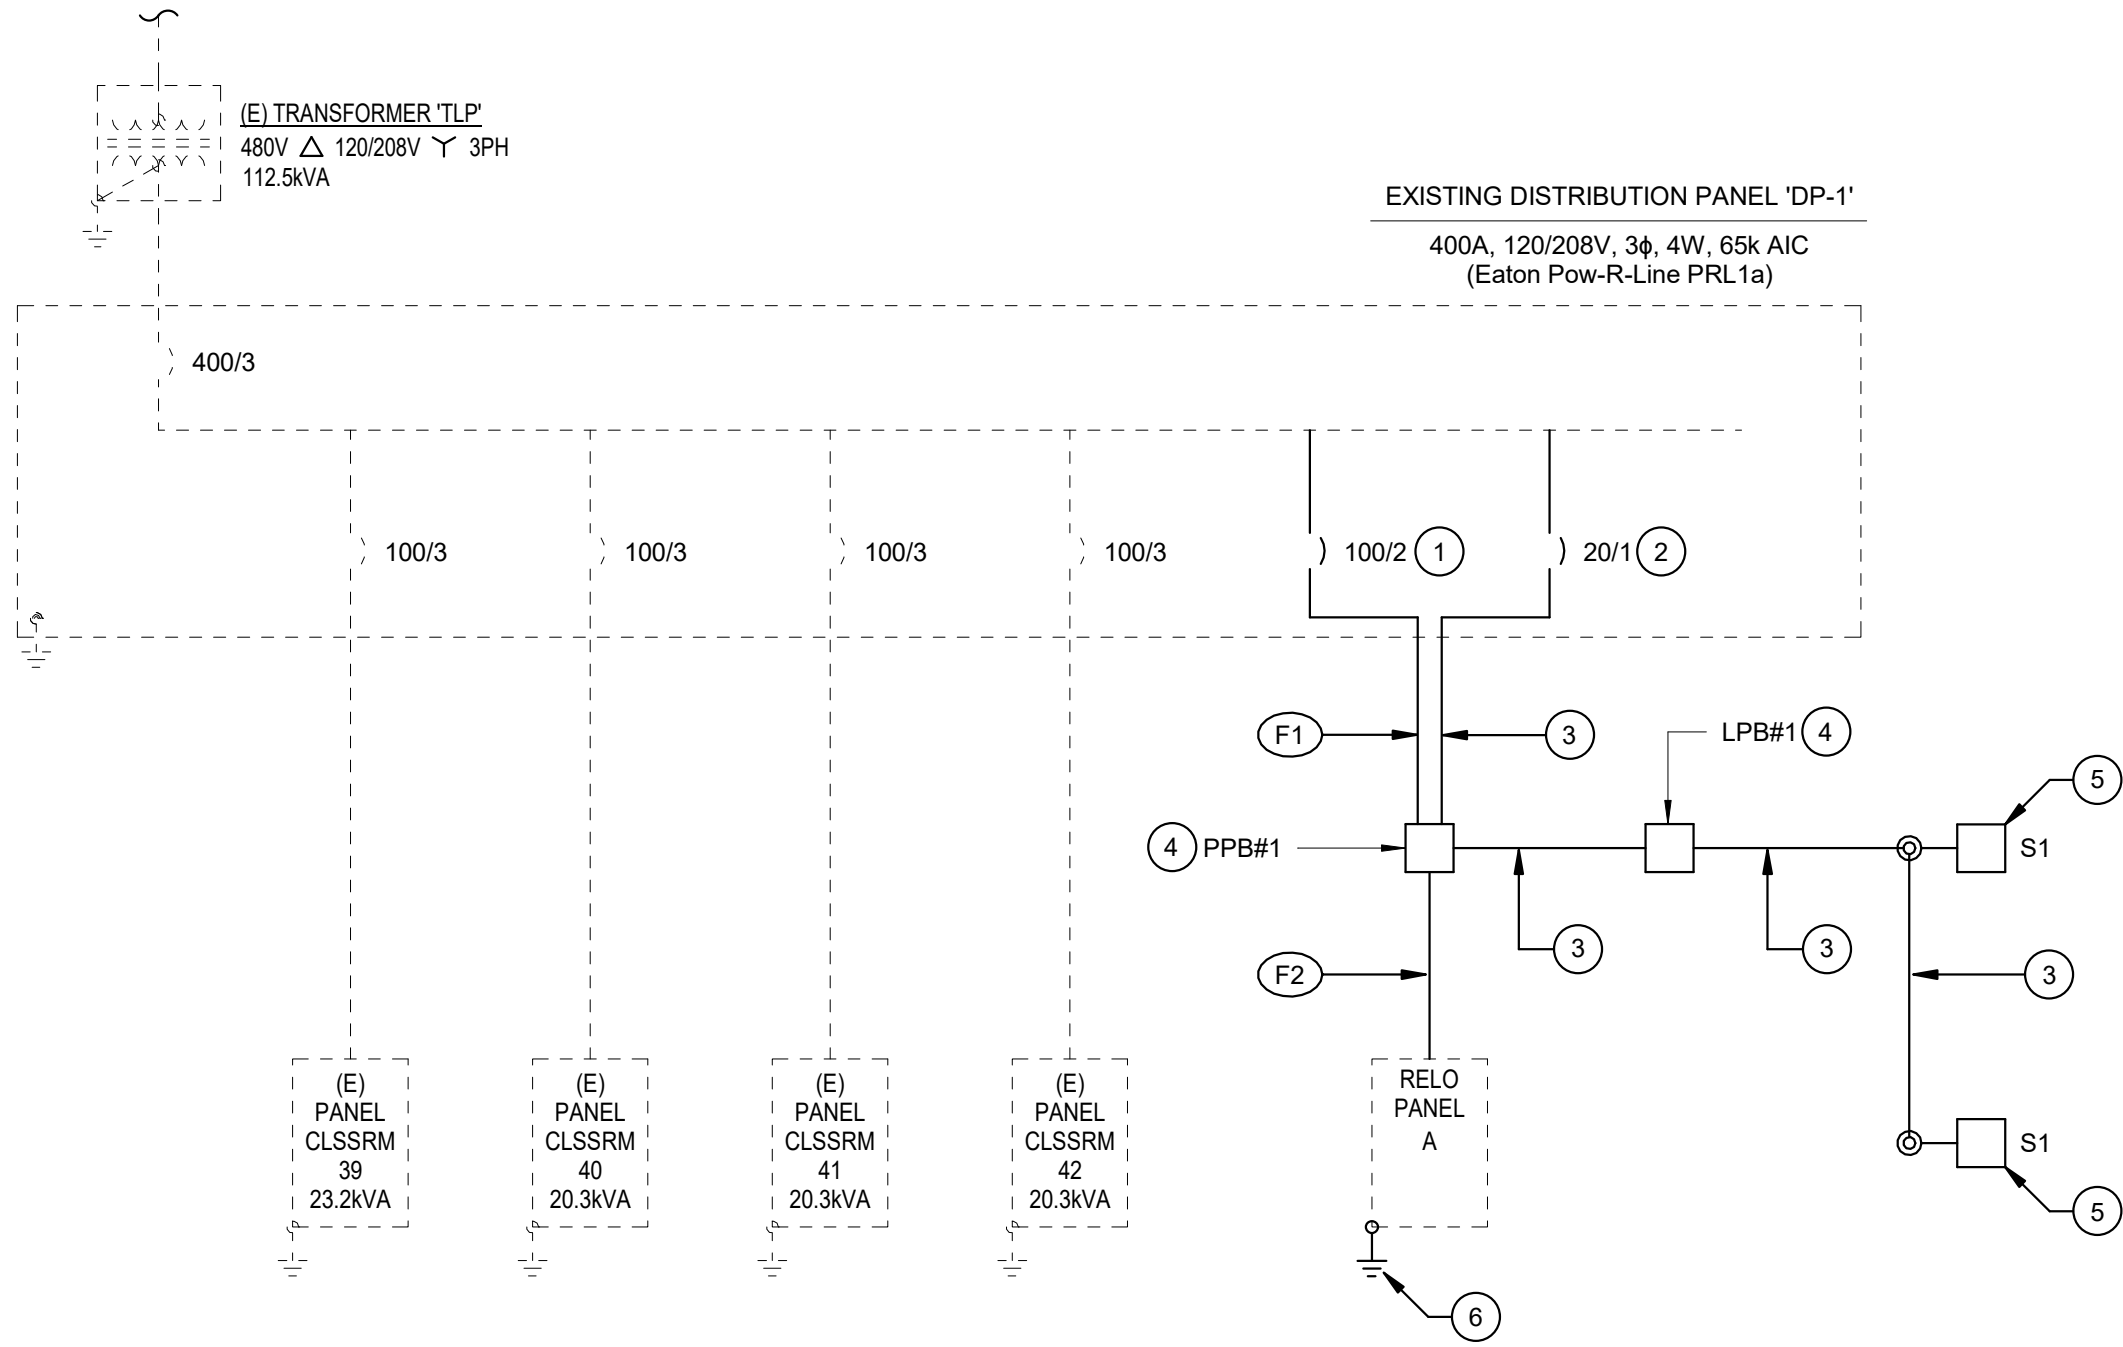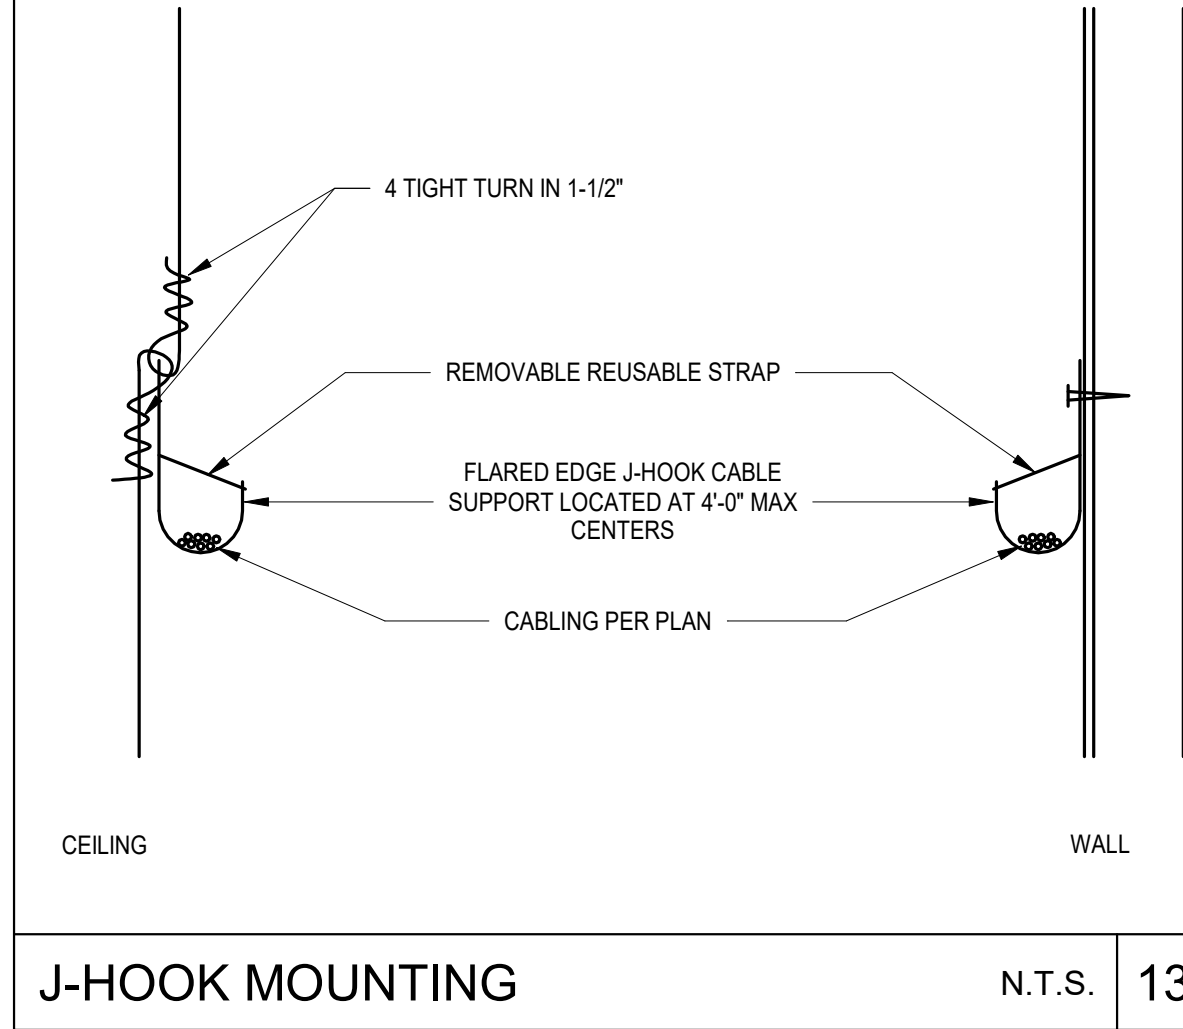

FEEDER SCHEDULE						
FEEDER	ORIGIN	DESTINATION	CONDUIT	CONDUCTORS	CALCULATED VOLTAGE DROP	REMARKS
F1	(E) DISTRIBUTION PANEL 'DP-1'	(N) UNDERGROUND PULL BOX PPB#1	2" C	3#2 CU THWN, 1#6 CU GND	1.15%	FEEDER
F2	(N) UNDERGROUND PULL BOX PPB#1	PANEL 'A' AT NEW RELO. BLDG.	2" C	3#2 CU THWN, 1#6 CU GND	1.15%	FEEDER


SINGLE LINE DIAGRAM

N.T.S. 2

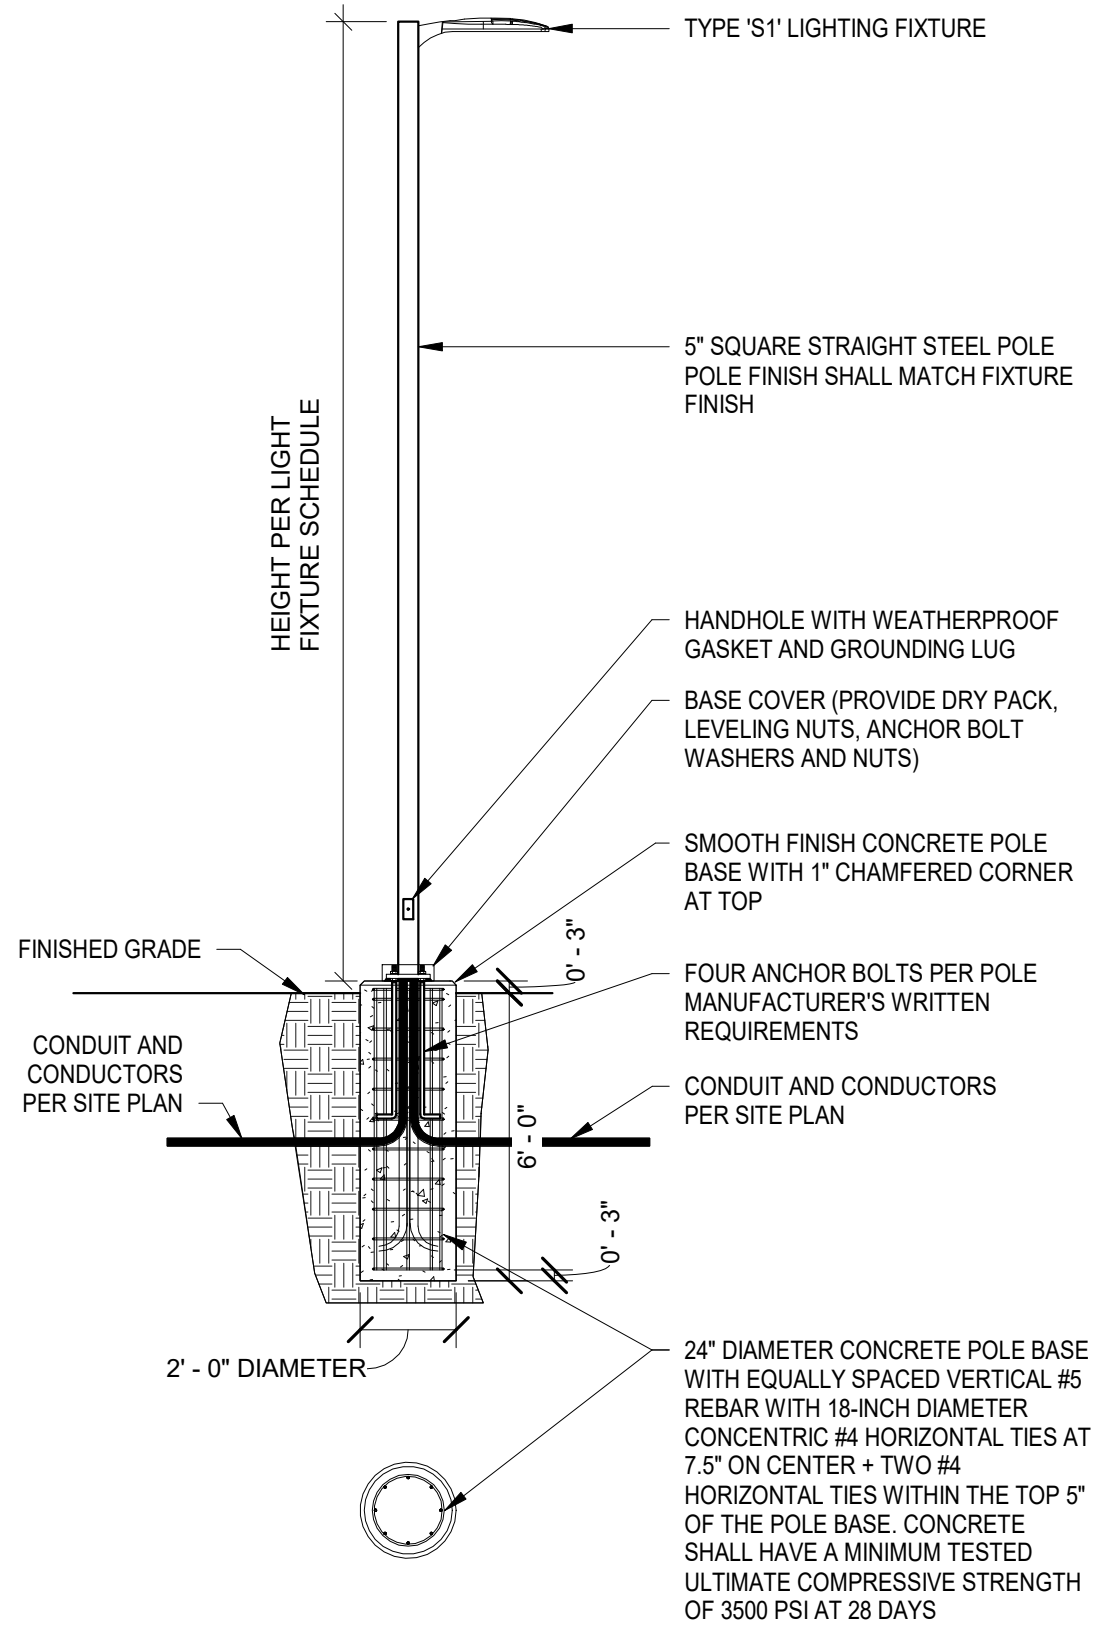


POLE FIXTURE MOUNTING

N.T.S. 12

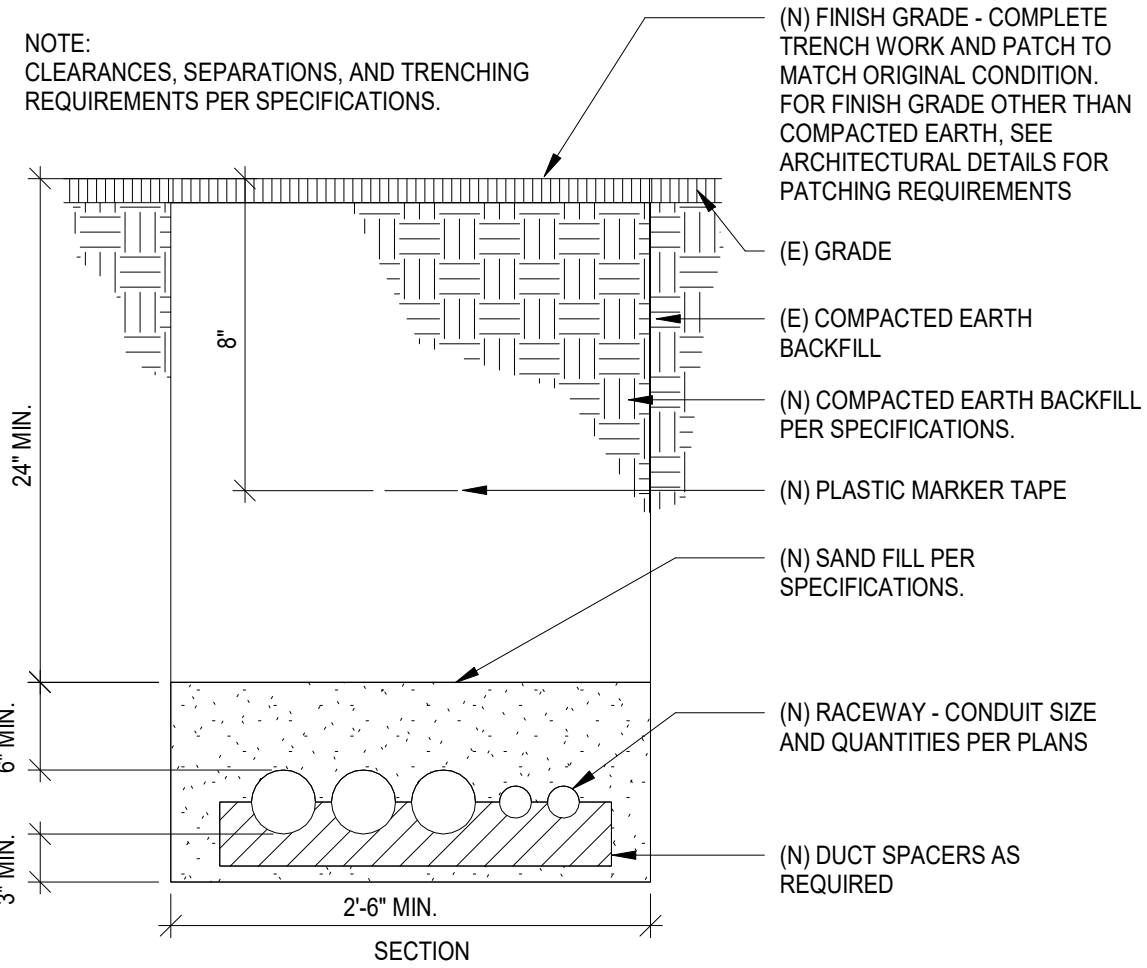

TYPICAL TRENCH SECTION

N.T.S. 7

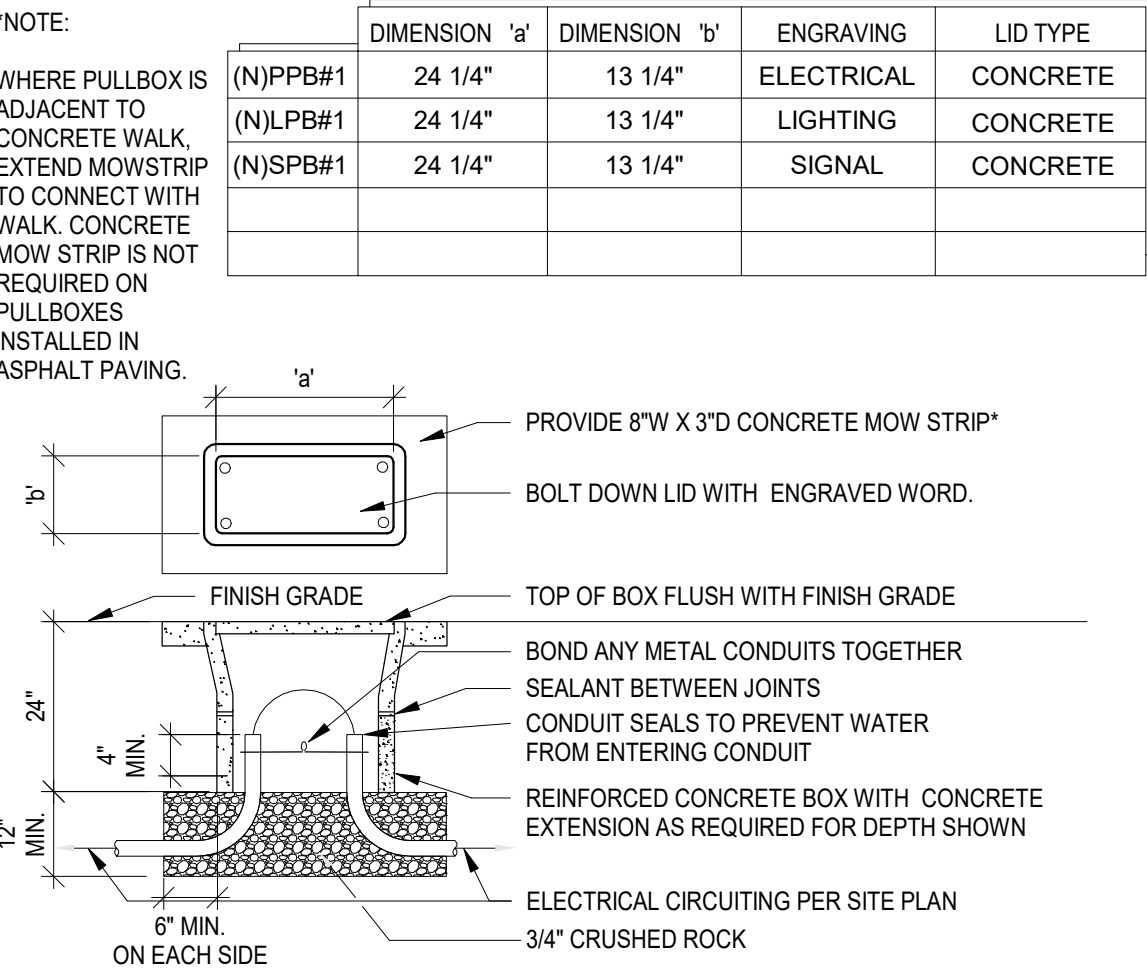

U.G. PULL BOX


N.T.S. 8

KEYNOTES

- 1 PROVIDE (N) 100A, 2-POLE, CIRCUIT BREAKER AT EXISTING DISTRIBUTION PANEL 'DP-1', AND CONNECT TO (N) FEEDER. MATCH EXISTING CIRCUIT BREAKER TYPE AND A.I.C. RATING.
- 2 PROVIDE NEW 20A, 1-POLE, CIRCUIT BREAKER AT EXISTING DISTRIBUTION PANEL 'DP-1', AND CONNECT NEW BRANCH SITE LIGHTING CIRCUIT. MATCH EXISTING CIRCUIT BREAKER TYPE AND A.I.C. RATING.
- 3 ONE (N) 1" C WITH 2 #10 CUTHWN, AND 1 #10 CU GND.
- 4 PROVIDE (N) UNDERGROUND PULL BOX PER DETAIL 8/E600.
- 5 CONNECT (N) POLE MOUNTED LIGHT FIXTURE.
- 6 PROVIDE GROUNDING ELECTRODE SYSTEM AT RELOCATABLE BUILDING POWER PANEL PER DETAILS 3/E600 AND 4/E600.

GROUNDING SYSTEM NOTES

N.T.S. 3

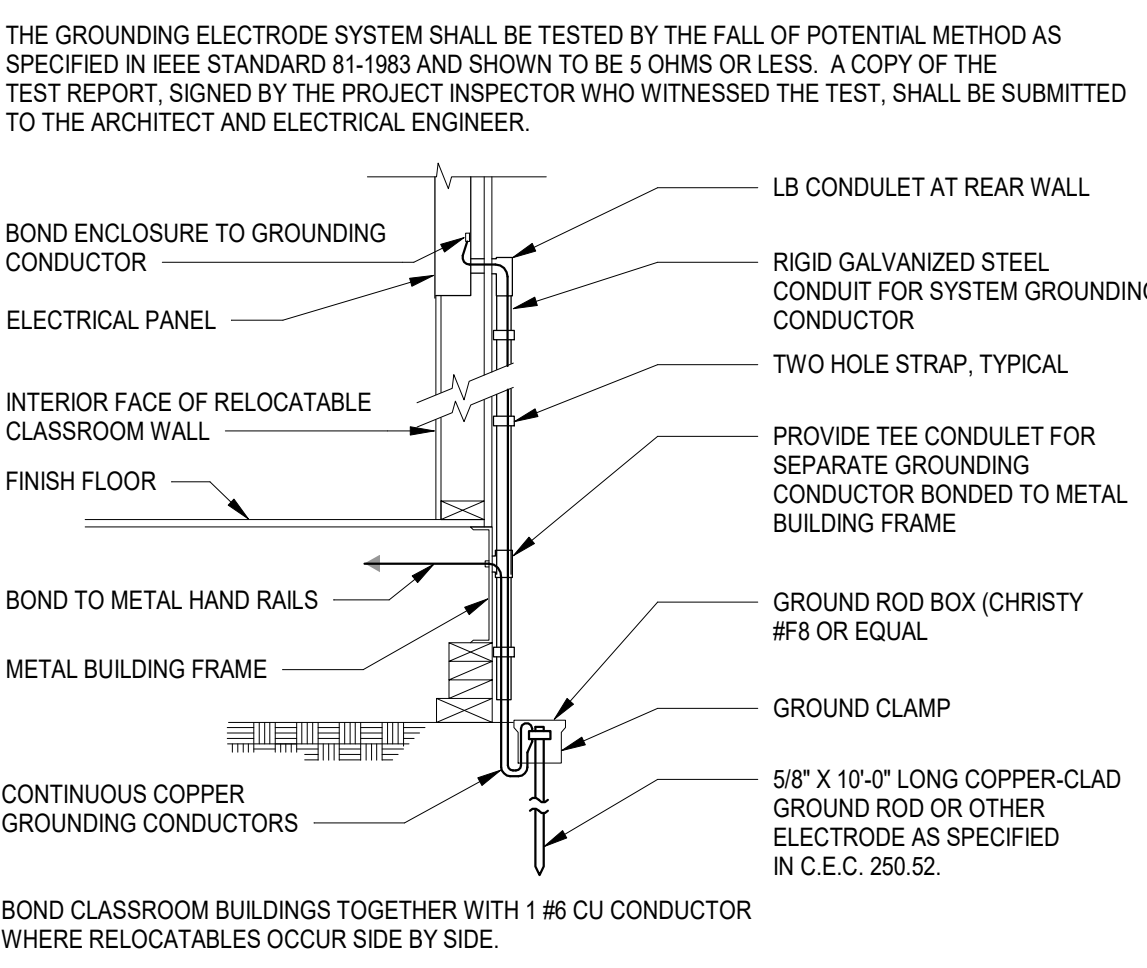


RELOCATABLE BUILDING GROUND


N.T.S. 4

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☐ FLS ☐ ACS ☐
DATE: 11/26/2024

TETER, INC. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.	
B	07/31/2024
C	11/01/2024

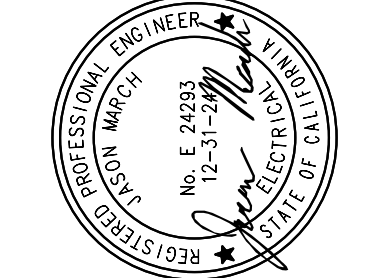

TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

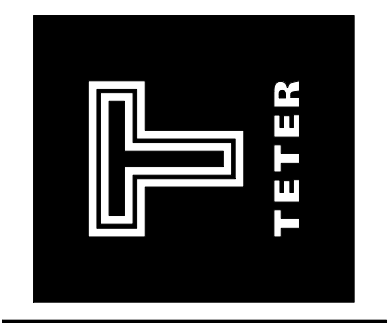












ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLDBROOK ST.
STOCKTON, CA
DRAWING TITLE
ELECTRICAL DETAILS & DIAGRAMS

PROJECT NO.
23-12899
DRAWING
E600

FIRE ALARM SYSTEM DESCRIPTION	
<p>THE FIRE ALARM SYSTEM DESCRIBED BY THESE DRAWINGS AND ASSOCIATED SPECIFICATIONS IS A MANUAL AND AUTOMATIC SYSTEM. THIS SYSTEM UTILIZES SMOKE DETECTORS ON CEILINGS AND IN THE ROOMS HOUSING THE FIRE ALARM SYSTEM EQUIPMENT WITH FIRE SPRINKLERS THROUGHOUT THE BUILDING. FIRE SPRINKLERS SHALL BE INSTALLED IN ATTICS IN LIEU OF HEAT DETECTORS. THE SYSTEM IS ADDRESSABLE AND IS WIRED CLASS 'B' WITHIN THE BUILDINGS AND CLASS 'B' BETWEEN BUILDINGS.</p>	
FIRE ALARM APPROVAL	
<p>THE FIRE ALARM SYSTEM DESIGN IS A "COMPLETE PLAN SUBMITTAL" PER DSA FIRE ALARM SUBMITTAL GUIDELINES. THE CONTRACTOR SHALL INSTALL THE SYSTEM AS SHOWN AND AS HEREIN SPECIFIED. IF ANY SUBSTITUTION OF FIRE ALARM EQUIPMENT IS TO BE REQUESTED, SUCH REQUEST SHALL BE MADE A MINIMUM OF TWO WEEKS PRIOR TO PROJECT BID DATE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SUBMITTING THE SUBSTITUTION PER THE DSA GUIDELINES AND SHALL PAY ALL ADDITIONAL COSTS REQUIRED TO ACCOMMODATE REVIEW OF THE SUBSTITUTED FIRE ALARM SYSTEM BY DSA. WHETHER OR NOT SUCH APPROVAL IS GIVEN, THE CONTRACTOR'S SUBMITTAL SHALL INCLUDE MANUFACTURER'S CATALOG CUT SHEETS AND CFM LISTING SHEETS FOR THE INDIVIDUAL COMPONENTS COMPRISING THE SUBSTITUTED FIRE ALARM SYSTEM. BATTERY LOAD CALCULATIONS AND VOLTAGE DROP CALCULATIONS FOR EACH SIGNALING CIRCUIT.</p>	
APPLICABLE CODES AND STANDARDS	
<p>2022 CA BUILDING CODE - CCR, TITLE 24, PART 2, VOLUMES 1 & 2 (2021 IBC AND CALIFORNIA AMENDMENTS) 2022 CA ELECTRICAL CODE - CCR, TITLE 24, PART 3 (2020 NEC AND CALIFORNIA AMENDMENTS) 2022 CA MECHANICAL CODE - CCR, TITLE 24, PART 4 (2021 UMC AND CALIFORNIA AMENDMENTS) 2022 CA PLUMBING CODE - CCR, TITLE 24, PART 5 (2021 UPC AND CALIFORNIA AMENDMENTS) 2022 CA FIRE CODE - CCR, TITLE 24, PART 9 (2021 IFC AND CALIFORNIA AMENDMENTS) 2022 CA REFERENCE STANDARDS CODE - CCR, TITLE 24, PART 12 2022 NFPA 13, INSTALLATION OF SPRINKLER SYSTEMS AND 2022 CALIFORNIA AMENDMENTS 2022 NFPA 72, NATIONAL FIRE ALARM CODE, AND 2022 CALIFORNIA AMENDMENTS PUBLIC SAFETY, STATE FIRE MARSHAL REGULATIONS - CCR, TITLE 19 DSA GUIDELINES FOR LIFE AND LIFE SAFETY SYSTEMS, DIVISION OF THE STATE ARCHITECT OFFICE OF REGULATION SERVICES.</p>	
FIRE ALARM GENERAL NOTES	
<ol style="list-style-type: none"> UNDERGROUND AND EXTERIOR CONDUITS WILL HAVE WATERTIGHT FITTINGS. (CEC 110.11 AND CEC 300.6) OUTLETS ON OPPOSITE SIDES OF A FIRE RATED WALL SHALL BE INSTALLED WITH A MINIMUM HORIZONTAL SPACING OF TWO FEET. FIRE ALARM DEVICE MOUNTING HEIGHTS SHALL BE AS FOLLOWS: <ol style="list-style-type: none"> PULL STATION - OPERABLE PART OF A MANUALLY ACTUATED ALARM INITIATING DEVICE SHALL BE NOT LESS THAN 42" FROM FINISHED FLOOR, CUBIT TOP OF BOX SHALL NOT BE MORE THAN 48" FROM FINISHED FLOOR. (CBC 11B 308.1.1, NFPA 72 17.4.5) INTERIOR AUDIBLE NOTIFICATION APPLIANCE - AT LEAST 90° TO THE TOP OF DEVICE ABOVE FINISHED FLOOR AND NOT LESS THAN 6" BELOW FINISHED CEILING. (NFPA 72 18.4.8.1) WALL-MOUNTED STROBE OR SPEAKER/STROBE - AT LEAST 90° TO BOTTOM OF LENS AND NOT GREATER THAN 96" TO TOP OF LENS ABOVE FINISHED FLOOR. (NFPA 72 18.5.5.1) AUDIBLE SIGNAL DEVICES OF A FIRE ALARM SYSTEM INTENDED TO ALERT ALL OCCUPANTS SHALL BE SO LOCATED AND UNOBSTRUCTED AS TO CAUSE A LEVEL OF AUDIBILITY OF AT LEAST 15 dBA ABOVE AVERAGE AMBIENT SOUND LEVEL BUT NOT LESS THAN 75 dBA AT TEN FEET, OR MORE THAN 110 dBA IN TOTAL. (NFPA 72 18.4.3.1, 18.4.1.2 AND CFC 907.5.2.12) AMBIENT NOISE LEVELS SHALL BE CONSTRUED TO MEAN THAT WHICH CAN NORMALLY BE EXPECTED TO EXIST WHEN THE FACILITY, BUILDING, ROOM OR AREA IS FUNCTIONING UNDER NORMAL OPERATIVE OR WORKING CONDITIONS. (CFC 907.5.2.1) AUDIBLE DEVICES SHALL SOUND THE CA UNIFORM FIRE ALARM SIGNAL IN TEMPORAL MODE. PROVIDE AT LEAST ONE EXTERIOR AUDIBLE DEVICE ON BUILDING FOR E OCCUPANCIES. (CFC 907.5.2.13) EMERGENCY VOICE/ALARM COMMUNICATION SYSTEM SHALL COMPLY WITH CBC 907.2.3 AND NFPA 72 24.4.2 VISUAL DEVICES SHALL NOT EXCEED TWO FLASHES PER SECOND AND SHALL NOT BE SLOWER THAN ONE FLASH EVERY SECOND. (NFPA 72 18.5.3.1) AUTOMATIC SMOKE DETECTION SHALL BE PROVIDED AT THE LOCATION OF EACH FIRE ALARM CONTROL UNIT, NOTIFICATION APPLIANCE CIRCUIT POWER EXTENDER AND SUPERVISING STATION TRANSMITTING EQUIPMENT TO PROVIDE NOTIFICATION OF FIRE AT THAT LOCATION. (NFPA 72 10.4.4) BRANCH CIRCUITS PROTECTING FIRE ALARM EQUIPMENT SHALL BE LABELED PER NFPA 72 10.6.5.2.2 AND SHALL INCLUDE A LISTED CIRCUIT BREAKER LOCKING DEVICE PER NFPA 72 10.6.5.4 COMPLETE THE NFPA 72 RECORD OF COMPLETION, TESTING ALL DEVICES AND APPLIANCE, PRINT AND FILE THE COMPLETED RECORD OF COMPLETION TO THE OWNER (SCHOOL DISTRICT), ARCHITECT, LOCAL FIRE AUTHORITY, AND DSA VIA THE PROJECT INSPECTOR. TESTING OF THE ENTIRE SYSTEM SHALL BE MADE IN THE PRESENCE OF THE LOCAL FIRE AUTHORITY AND THE DSA INSPECTOR OF RECORD (IOR). FINAL TEST SHALL INCLUDE READ OUT VERIFICATION FORM FROM CENTER STATION. THE AUTOMATIC ALARM SYSTEM SHALL BE INSTALLED, TESTED, AND MAINTAINED IN ACCORDANCE WITH THE STATE FIRE MARSHAL'S REGULATIONS (CFC 907.8.5, NFPA 72 14.4.1.1, NFPA 72 14.5) 	
FIRE ALARM CODES AND NOTES	

FIRE ALARM SYSTEM		
DEVICE	ACTIVATE EVACUATION SIGNALS/STROBES	SHUTDOWN FIRE/SMOKE DAMPER, OR ACTIVATION SMOKE VENT RELEASE
FIRE ALARM PANEL SYSTEM TROUBLE		
SMOKE DETECTOR	×	×
HEAT DETECTOR	×	
WATER FLOW SWITCH	×	
VALVE TAMPER SWITCH		

FIRE ALARM OPERATIONAL MATRIX

FIRE ALARM SYSTEM EQUIPMENT LEGEND	
SYMBOL	DESCRIPTION
	EXISTING FIRE ALARM CONTROL PANEL 'FACP': EDWARDS EST3 SERIES W/ AUTOMATIC CHARGING SYSTEM C.S.F.M. #7165-1657-0186
	EXISTING FIRE ALARM REMOTE ANNUNCIATOR AND PAGING MICROPHONE: EDWARDS 3-LCDANN, 3-21S/IGY, 3-REMICA 4NN/8 C.S.F.M. #7120-1657-0193
	EXISTING FIRE ALARM AUXILIARY POWER SUPPLY 'APS-F' WITH AUTOMATIC CHARGING SYSTEM, SYNCHRONIZATION OUTPUT MODULE, AND INTEGRAL AUDIO AMPLIFIER: EDWARDS #APS-10A, C.S.F.M. #7300-1657-0229 EDWARDS #SIGA-CG15, C.S.F.M. #7300-1657-0121 EDWARDS #SIGA-AA50, C.S.F.M. #7300-1657-0121
	NEW ADDRESSABLE SMOKE DETECTOR AND BASE (ON CEILING): EDWARDS #SIGA-OSD, C.S.F.M. #7272-1657-0511 EDWARDS #SIGA-SB, C.S.F.M. #7300-1657-0120
	NEW RELAY MODULE: EDWARDS #SIGA-CR C.S.F.M. #7300-1657-0121
	NEW ADDRESSABLE SUPERVISED DUAL INPUT MODULE: EDWARDS #SIGA-CT2 C.S.F.M. #7300-1657-0121
	NEW SPEAKER/STROBE ANNUNCIATOR - WALL MOUNTED (XX REPRESENTS CANDELA) EDWARDS #G4SVRF, C.S.F.M. #7320-1657-0516
	NEW VOICE EVACUATION SYSTEM SPEAKER (OUTDOOR - WEATHERPROOF) EDWARDS #WG4RF-S, WG4RTS C.S.F.M. #7320-1657-0289
	FIRE ALARM BELL (ON WALL @ +80" MINIMUM U.O.N.)
	TAMPER SWITCH AT FIRE SPRINKLER RISER AND DOUBLE CHECK DETECTOR ASSEMBLY. SPECIFIED UNDER FIRE PROTECTION DRAWINGS.
	FLOW SWITCH AT FIRE SPRINKLER RISER SPECIFIED UNDER FIRE PROTECTION DRAWINGS.

FIRE ALARM LEGEND	N.T.S.		
<table><tr><td>FIRE ALARM MONITORING NOTE</td></tr><tr><td>AUTOMATIC FIRE ALARM SYSTEMS SHALL TRANSMIT THE ALARM, SUPERVISORY AND TROUBLE SIGNALS TO AN APPROVED SUPERVISING STATION AS REQUIRED BY NFPA 72 AS AMENDED BY CFC CHAPTER 60. THE SUPERVISING STATION SHALL BE LISTED AS EITHER UUFX OR UJJS BY UNDERWRITERS LABORATORY OR SHALL MEET THE REQUIREMENTS OF FACTORY MUTUAL RESEARCH APPROVAL STANDARD 3011. SUPERVISION OF SYSTEM AND LEASED TELEPHONE LINES SHALL BE ARRANGED BY OWNER.</td></tr></table>		FIRE ALARM MONITORING NOTE	AUTOMATIC FIRE ALARM SYSTEMS SHALL TRANSMIT THE ALARM, SUPERVISORY AND TROUBLE SIGNALS TO AN APPROVED SUPERVISING STATION AS REQUIRED BY NFPA 72 AS AMENDED BY CFC CHAPTER 60. THE SUPERVISING STATION SHALL BE LISTED AS EITHER UUFX OR UJJS BY UNDERWRITERS LABORATORY OR SHALL MEET THE REQUIREMENTS OF FACTORY MUTUAL RESEARCH APPROVAL STANDARD 3011. SUPERVISION OF SYSTEM AND LEASED TELEPHONE LINES SHALL BE ARRANGED BY OWNER.
FIRE ALARM MONITORING NOTE			
AUTOMATIC FIRE ALARM SYSTEMS SHALL TRANSMIT THE ALARM, SUPERVISORY AND TROUBLE SIGNALS TO AN APPROVED SUPERVISING STATION AS REQUIRED BY NFPA 72 AS AMENDED BY CFC CHAPTER 60. THE SUPERVISING STATION SHALL BE LISTED AS EITHER UUFX OR UJJS BY UNDERWRITERS LABORATORY OR SHALL MEET THE REQUIREMENTS OF FACTORY MUTUAL RESEARCH APPROVAL STANDARD 3011. SUPERVISION OF SYSTEM AND LEASED TELEPHONE LINES SHALL BE ARRANGED BY OWNER.			
FIRE ALARM MONITORING NOTE	N.T.S.		

OPERATIONAL MATRIX		
SHUTDOWN HVAC EQUIPMENT	ANNUNCIATE AT BUILDING FACP AND ALL REMOTE ANNUNCIATORS	SEND SIGNAL TO CENTRAL STATION
	X	X
	X	X
	X	X
	X	X
	SUPERVISORY	SUPERVISORY

N.T.S.

SB575 - GREEN OAKS FAMILY ACADEMY ELEMENTARY SCHOOL FIRE PROTECTION ACT REQUIREMENTS FOR AUTOMATIC FIRE ALARM SYSTEMS	
THE FIRE DETECTION AND ALARM SYSTEM FOR THE AREAS AND/OR BUILDINGS WITHIN THE SCOPE OF WORK OF THIS PROJECT:	
<input checked="" type="checkbox"/>	COMPLIES WITH SB575
<input type="checkbox"/>	A FULLY-AUTOMATIC SYSTEM HAS BEEN DESIGNED FOR ALL AREAS, OR
<input checked="" type="checkbox"/>	THE AREAS AND/OR BUILDINGS ARE SPRINKLERED ABOVE THE CEILING, SO HEAT DETECTORS ARE EXEMPTED FROM ABOVE-CEILING AREAS. THE SYSTEM IS OTHERWISE FULLY AUTOMATIC.
<input checked="" type="checkbox"/>	AN AUTOMATIC DIALER TO A UL-APPROVED CENTRAL STATION:
<input checked="" type="checkbox"/>	IS EXISTING, OR
<input type="checkbox"/>	IS INCLUDED AS PART OF THIS PROJECT.
<input type="checkbox"/>	IS EXEMPT FROM SB575
<input type="checkbox"/>	THE TOTAL PROJECT CONSTRUCTION VALUE IS LESS THAN \$200,000, OR
<input type="checkbox"/>	THE PROJECT CONSISTS OF ONLY MODULAR BUILDINGS WHICH ARE TEMPORARY; THESE BUILDINGS SHALL BE REMOVED NO MORE THAN THREE YEARS FROM THE INSTALLATION DATE UNLESS A THREE-YEAR EXTENSION IS APPROVED BY DSA, OR
<input type="checkbox"/>	THE PROJECT IS NOT FUNDED UNDER CHAPTER 12.5 OF THE LEROY F. GREENE SCHOOL FACILITIES ACT. IT WILL BE 100% FUNDED BY LOCAL FUNDS.

SB575

	N.T.S.	9
<p>12" MIN. 15" MAX.</p> <p>SMOKE DETECTOR (*)</p> <p>(*) SMOKE DETECTORS SHALL BE INSTALLED A MINIMUM OF 36" FROM SUPPLY AND RETURN GRILLES AND SHALL NOT BE LOCATED IN DIRECT AIRFLOW</p> <p>WALL</p> <p>FINISH CEILING</p> <p>VISUAL DEVICE</p> <p>AUDIBLE DEVICE</p> <p>6" MIN.</p> <p>96" MAX TO TOP OF LENS</p> <p>80" MIN. TO BOTTOM OF LENS</p> <p>90" MIN.</p> <p>MANUAL PULL STATION</p> <p>THE TOP OF A WALL-MOUNTED AUDIBLE DEVICE SHALL BE AT LEAST 6" BELOW FINISH CEILING AND, WHERE CEILING HEIGHT IS AT LEAST 8'-0", AT LEAST 90" A.F.F.</p> <p>THE BOTTOM OF A WALL-MOUNTED AUDIO/VISUAL AND VISUAL DEVICES SHALL BE AT LEAST 80" A.F.F. TO BOTTOM OF LENS AND NO MORE THAN 96" A.F.F. TO TOP OF LENS OR 6" BELOW CEILING - WHICHEVER IS LESS.</p> <p>FINISH FLOOR</p> <p>FIRE ALARM</p> <p>PULL STATION</p> <p>48" MAX. TO TOP OF BOX</p>		


FIRE ALARM DEVICE ELEVATIONS		N.T.S.		10	
EXISTING FIRE ALARM CONTROL PANEL 'FACP-A' B					
QTY.	DEVICE	DESCRIPTION			
1	EST3	(E) FIRE ALARM CONTROL PANEL			
1	3-PPS/M	Power Supply			
1	3-CPU3	Central Processor			
1	3-RS8B	Communications Card			
1	3-LCDXL	Event LED Module			
2	3-SDDC1	Dual SIGA Controller (1)			
1	3-ASU	Audio Source Unit			
1	3-MODCOM	DACT Module			
1	3-TA20x	20W Zone Amplifier			
1	3-12/S1GY	Annunciation Module			
1	3-ANNPCU3	Remote Annunciator CPU			
1	3-LCDANN	Remote Annunciator			
1	3-ANNSM	Annun. Support Module			
1	3-REMICA	Remote Microphone			
1	3-EVPWRA	Graphics Power			
2	3-EVDVRA	Graphics Driver			
35	GRAPHIC LEDS	Graphics LEDs			
TOTALS					
TOTAL ALARM AMP-HOURS (15 MIN.) =		0.25	HR	x	2.791
TOTAL STANDBY AMP-HOURS (24 HR) =		24	HR	x	1.497
TOTAL REQUIRED AMP-HOURS =					
TOTAL DESIGN AMP-HOURS WITH 25% SAFETY FACTOR =					
NEW BATTERIES					

EXISTING FIRE ALARM CONTROL PANEL 'FACP-A' NOTES:

1) THE SIGA DEVICE CONTROLLER IS CALCULATED WITH THE MAXIMUM SIGNATURE AREA (TOTAL CAPACITY FOR ALL ADDRESSABLE DEVICES).

NAC '35N' VOLTAGE DROP CALCULATION		
QTY.	DEVICE	DESCRIPTION
3	SV15	Multi-Candela Speaker Strobe (15cd) Edwards #G4SVRF
1	SV110	Multi-Candela Speaker Strobe (110cd) Edwards #G4SVRF
		TOTAL CURRENT ADDED TO CIRCUIT
LENGTH OF WIRE FROM FACP TO LAST DEVICE (IN FEET) =		
ACTUAL CALCULATED VOLTAGE DROP (IN VDC) =		12 AWG 6530 CIRCULAR MILS
CIRCUIT VOLTAGE CALCULATED AT LAST DEVICE (IN VDC) =		
PERCENT VOLTAGE DROP (%) =		
VOLTAGE DROP FORMULA:		
VOLTAGE DROP = $2 \times 10.8 \times \text{LENGTH OF CIRCUIT TO FARTHEST DEVICE} \times \text{CURRENT WIRE SIZE IN C.M.}$		
COMPUTED WITH TOTAL CURRENT ON CIRCUIT AT MAXIMUM LENGTH (CLASS A CIRCUIT).		

KEYNOTES

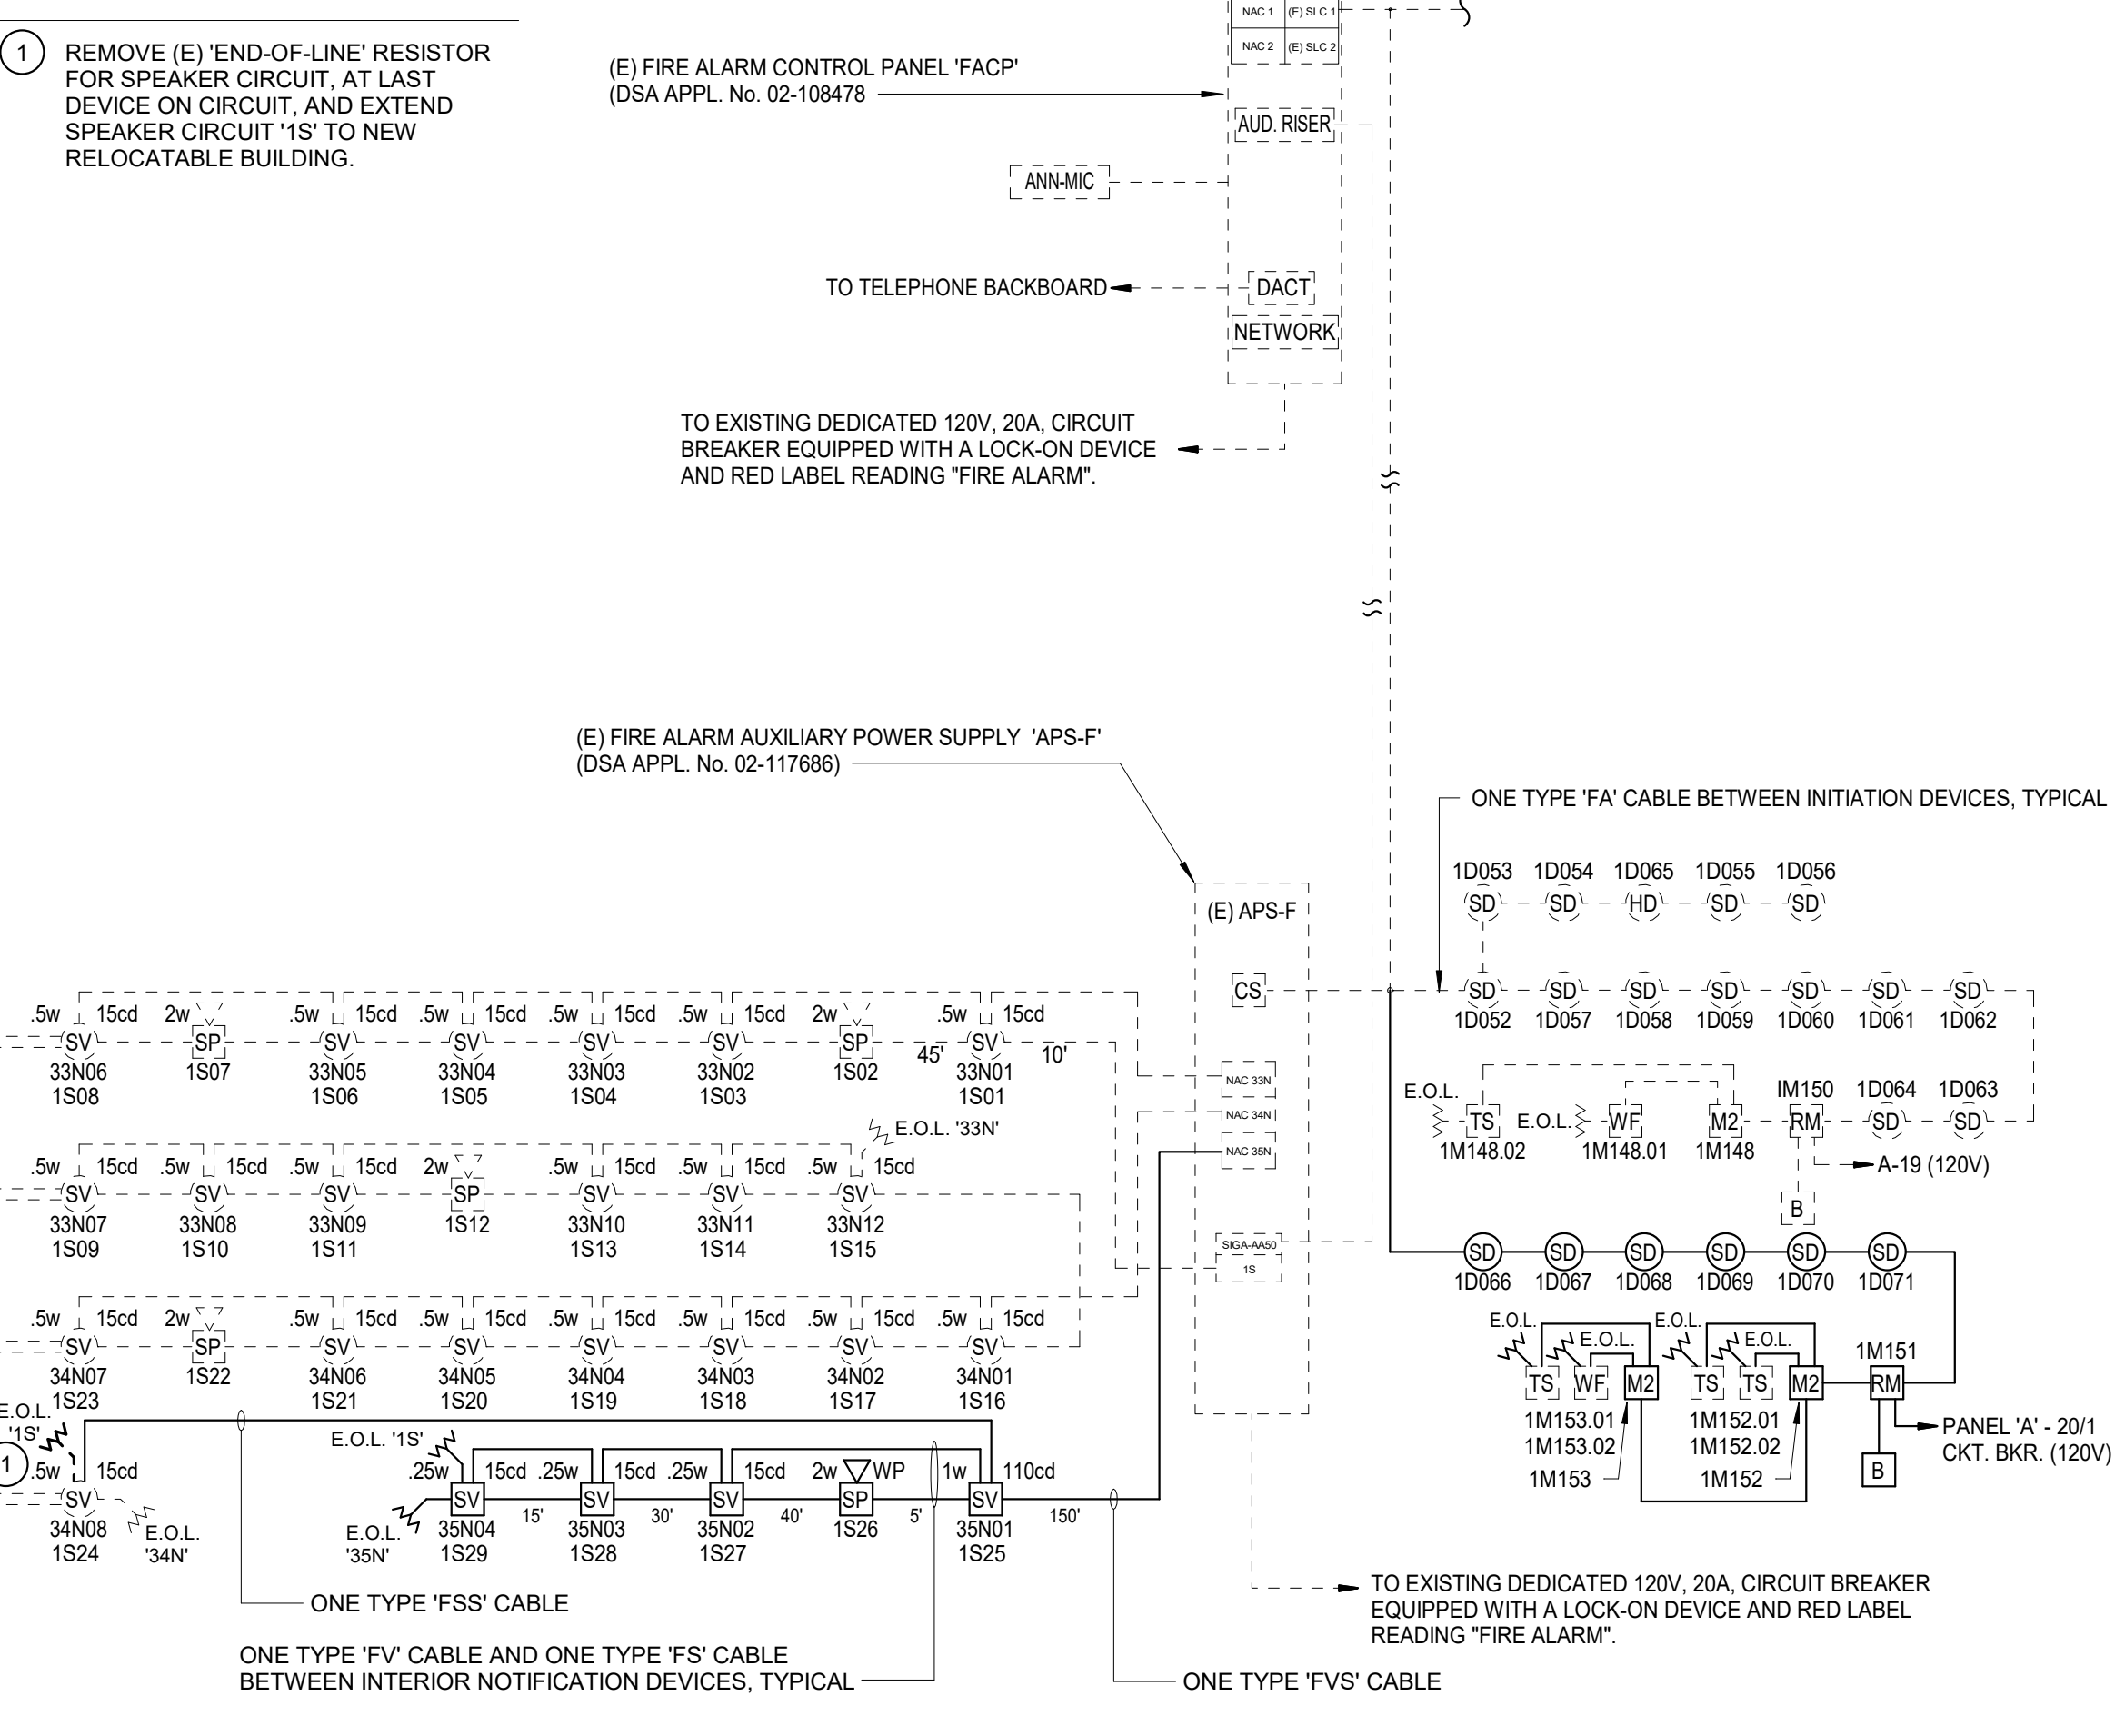

FIRE ALARM RISER DIAGRAM

WIRING CALCULATIONS

STANDBY CURRENT	ALARM CURRENT/D EVICE	ALARM CURRENT
-----	-----	-----
0.0000	0.0000	0.0000
0.1550	0.1650	0.1650
0.0980	0.0980	0.0980
0.0480	0.0500	0.0500
0.5280	0.3360	0.6720
0.0800	0.0800	0.0800
0.0600	0.0950	0.0950
0.0620	1.1200	1.1200
0.0020	0.0360	0.0360
0.1440	0.1440	0.1440
0.1820	0.1820	0.1820
0.0100	0.0100	0.0100
0.0640	0.0640	0.0640
0.0010	0.0120	0.0120
0.0100	0.0050	0.0100
0.0525	0.0015	0.0525
1.4965	2.3985	2.7905
=	0.6976 A-H	


(E) FIRE ALARM AUXILIARY POWER SUPPLY 'APS-F' BATTERY CALCULATION

QTY.	DEVICE	DESCRIPTION	STANDBY CURRENT	ALARM CURRENT/D EVICE	ALARM CURRENT
1	APS-F	[E] Fire Alarm Auxiliary Power Supply, Edwards #APS10A	0.1050	0.2700	0.2700
1	SIGA-AA50	[E] Fire Alarm Amplifier, Edwards #SIGA-AA50 [2]	0.0020	2.8000	2.8000
1	NAC-33N	[E] NAC Circuit 33N	-----	0.6930	0.6930
1	NAC-34N	[E] NAC Circuit 34N	-----	0.5040	0.5040
STROBE CURRENT (NAC 35N)					
3	SV15	Multi-Candela Speaker Strobe (15cd) Edwards #G4SVRF	-----	0.0280	0.0840
1	SV110	Multi-Candela Speaker Strobe (110cd) #G4SVRF	-----	0.0280	0.0280
SPEAKER CURRENT (CKT 1S)					
3	SP-1/4W	Multi-Candela Speaker Strobe (.25w) Edwards #G4SVRF	-----	-----	----- (3)
19	SP-1/2W	Multi-Candela Speaker Strobe (.5w) Edwards #G4SVRF	-----	-----	----- (3)
1	SP-1W	Multi-Candela Speaker Strobe (1w) Edwards #G4SVRF	-----	-----	----- (3)
5	SP-2W	External Weatherproof Speaker (2W) Edwards #WG4RF-S/WG4RTS	-----	-----	----- (3)
TOTALS			0.1070	4.3230	4.3790
TOTAL ALARM AMP-HOURS [15 MIN.] = 0.25 HR x 4.379 A			=	1.0948 A-H	
TOTAL STANDBY AMP-HOURS [24 HRS] = 24 HR x 0.107 A			=	2.5680 A-H	
TOTAL REQUIRED AMP-HOURS =			=	3.6628 A-H	
TOTAL DESIGN AMP-HOURS WITH 25% SAFETY FACTOR =			=	4.5784 A-H	
EXISTING BATTERIES				7.000 A-H	

</

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC:
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒
DATE: 11/26/2024

B	07/31/2024	DSA SUBMITTAL			

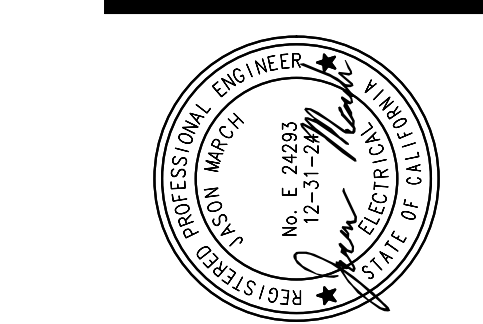

TETER, INC.

FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO

ARCHITECTS ENGINEERS CONNECTED

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLDBROOK ST.
STOCKTON, CA
DRAWING TITLE
FIRE ALARM RISER DIAGRAM & CALCULATIONS

PROJECT NO.
23-12899

DRAWING
E710

FIRE ALARM CABLE SCHEDULE					
CABLE DESIGNATION	DESCRIPTION	MANUFACTURER & CATALOG #	OUTER JACKET COLOR	SYSTEM	USE
'FAS'	1 PR, #16 AWG STRANDED UNSHIELDED AQUASEAL FPL	WEST PENN #AQC225	BLACK	FIRE ALARM	SITE ADDRESSABLE SLC LOOP CABLE - EXTERIOR/OUTDOOR
'FA'	1 PR, #16 AWG SOLID UNSHIELDED FPL	WEST PENN #D990	RED	FIRE ALARM	ADDRESSABLE SLC LOOP CABLE - INTERIOR
'FSS'	1 PR, #14 AWG SOLID SHIELDED, FPL	WEST PENN #AQC295	BLACK	FIRE ALARM	AUDIBLE (SPEAKER) NOTIFICATION APPLIANCE CIRCUIT - EXTERIOR/OUTDOOR
'FS'	1 PR, #14 AWG SOLID SHIELDED, FPLP	WEST PENN #60992B	RED	FIRE ALARM	AUDIBLE (SPEAKER) NOTIFICATION APPLIANCE CIRCUIT - INTERIOR
'FVS'	1 PR, #12 STRANDED UNSHIELDED FPL	WEST PENN #AQ227	BLACK	FIRE ALARM	VISUAL (STROBE) NOTIFICATION APPLIANCE CIRCUIT - EXTERIOR/OUTDOOR
'FV'	1 PR, #12 SOLID UNSHIELDED FPLP	WEST PENN #60995B	RED	FIRE ALARM	VISUAL (STROBE) NOTIFICATION APPLIANCE CIRCUIT - INTERIOR

FIRE ALARM CABLE SCHEDULE		N.T.S.	13																		
<div>TELECOMMUNICATION CABLE SCHEDULE</div> <table><tr><th>CABLE DESIGNATION</th><th>DESCRIPTION</th><th>MANUFACTURER & CATALOG #</th><th>OUTER JACKET COLOR</th><th>SYSTEM</th><th>USE</th></tr><tr><td>'D'</td><td>4 UTP #24 AWG CATEGORY 6 FILLED OUTDOOR</td><td>COMMSCOPE MEDIA 6 #6NF4+</td><td>BLACK</td><td>DATA</td><td>HORIZONTAL DATA CABLE - OUTDOOR</td></tr><tr><td>'H'</td><td>ACTIVE FIBER OPTIC HDMI CABLE</td><td>CHROMIS #AOC-18G-R-OBXP OR EQUIVALENT</td><td>BLACK</td><td>VIDEO</td><td>BUILDING HDM1 CABLE MM</td></tr></table>				CABLE DESIGNATION	DESCRIPTION	MANUFACTURER & CATALOG #	OUTER JACKET COLOR	SYSTEM	USE	'D'	4 UTP #24 AWG CATEGORY 6 FILLED OUTDOOR	COMMSCOPE MEDIA 6 #6NF4+	BLACK	DATA	HORIZONTAL DATA CABLE - OUTDOOR	'H'	ACTIVE FIBER OPTIC HDMI CABLE	CHROMIS #AOC-18G-R-OBXP OR EQUIVALENT	BLACK	VIDEO	BUILDING HDM1 CABLE MM
CABLE DESIGNATION	DESCRIPTION	MANUFACTURER & CATALOG #	OUTER JACKET COLOR	SYSTEM	USE																
'D'	4 UTP #24 AWG CATEGORY 6 FILLED OUTDOOR	COMMSCOPE MEDIA 6 #6NF4+	BLACK	DATA	HORIZONTAL DATA CABLE - OUTDOOR																
'H'	ACTIVE FIBER OPTIC HDMI CABLE	CHROMIS #AOC-18G-R-OBXP OR EQUIVALENT	BLACK	VIDEO	BUILDING HDM1 CABLE MM																
TELECOM CABLE SCHEDULE		N.T.S.	14																		
<div>LIGHTING FIXTURE SCHEDULE</div> <table><tr><th>FIXTURE DESIGNATION</th><th>FIXTURE VOLTAGE</th><th>FIXTURE WATTAGE</th><th>MOUNTING</th><th>DRIVER & COLOR TEMP</th><th>DESCRIPTION</th><th>MANUFACTURER</th><th>CATALOG #</th></tr><tr><td>S1</td><td>120 V</td><td>86</td><td>POLE PER 12/E600</td><td>LED - 4000K</td><td>15' SINGLE HEAD, 4" SQUARE POLE, SITE AREA LED LIGHT</td><td>GARCO LIGHTING</td><td>GL13-MRI-2-85LA-8035-NW-UNV-**SPA **MATCH FIXTURE FINISH TO EXISTING FIXTURES</td></tr></table>				FIXTURE DESIGNATION	FIXTURE VOLTAGE	FIXTURE WATTAGE	MOUNTING	DRIVER & COLOR TEMP	DESCRIPTION	MANUFACTURER	CATALOG #	S1	120 V	86	POLE PER 12/E600	LED - 4000K	15' SINGLE HEAD, 4" SQUARE POLE, SITE AREA LED LIGHT	GARCO LIGHTING	GL13-MRI-2-85LA-8035-NW-UNV-**SPA **MATCH FIXTURE FINISH TO EXISTING FIXTURES		
FIXTURE DESIGNATION	FIXTURE VOLTAGE	FIXTURE WATTAGE	MOUNTING	DRIVER & COLOR TEMP	DESCRIPTION	MANUFACTURER	CATALOG #														
S1	120 V	86	POLE PER 12/E600	LED - 4000K	15' SINGLE HEAD, 4" SQUARE POLE, SITE AREA LED LIGHT	GARCO LIGHTING	GL13-MRI-2-85LA-8035-NW-UNV-**SPA **MATCH FIXTURE FINISH TO EXISTING FIXTURES														
LIGHT FIXTURE SCHEDULE		N.T.S.	15																		

CODES, RULES & REGULATIONS	
ALL WORK SHOWN HEREIN SHALL COMPLY WITH THE CURRENT REGULATIONS OF THE CALIFORNIA STATE FIRE MARSHAL, CALIFORNIA BUILDING CODE, TITLES 8 AND 19 THROUGH 24, SERVING UTILITY RULES, AND ALL OTHER APPLICABLE STATE ORDINANCES. NOTHING IN THESE PLANS OR SPECIFICATIONS SHALL BE INTERPRETED AS TO PERMIT ANY WORK NOT IN CONFORMANCE WITH THESE CODES, RULES AND REGULATIONS. WHERE WORK OF A GREATER DEGREE IS INDICATED IN THESE PLANS OR SPECIFICATIONS, THAT REQUIREMENT SHALL GOVERN SUCH WORK.	
C.E.C. TITLE 24 COMPLIANCE	
THE LIGHTING AND LIGHTING CONTROL SYSTEMS DESIGN DEPICTED HEREIN IS IN COMPLIANCE WITH REQUIREMENTS OF THE CURRENT CALIFORNIA ENERGY COMMISSION EFFICIENCY STANDARDS FOR NONRESIDENTIAL BUILDINGS.	
GENERAL NOTES (TYPICAL)	
1. REFER TO THE ARCHITECTURAL REFLECTED CEILING PLAN FOR THE EXACT LOCATION OF ALL CEILING MOUNTED ELECTRICAL EQUIPMENT.	
2. REFER TO THE MECHANICAL AND PLUMBING PLANS FOR THE EXACT LOCATION OF ALL MECHANICAL, HVAC AND PLUMBING EQUIPMENT.	
3. VERIFY THE EXACT LOCATION OF ALL FLOOR BOXES AND ASSOCIATED TRENCH, BACKFILL AND SAWCUTTING REQUIREMENTS WITH THE ARCHITECT PRIOR TO COMMENCEMENT OF ANY ROUGH-IN WORK FOR THIS EQUIPMENT.	
4. COORDINATE ELECTRICAL PANEL AND TERMINAL CABINET LOCATIONS AND ROUTING OF UNDERGROUND CONDUITS WITH THE ARCHITECTURAL AND STRUCTURAL DRAWINGS PRIOR TO COMMENCEMENT OF ANY ROUGH-IN WORK FOR THIS EQUIPMENT.	
5. COORDINATE ALL ELECTRICAL WORK WITH OTHER TRADES WHOSE WORK WILL IMPACT PLACEMENT OR CONNECTION OF ELECTRICALLY POWERED EQUIPMENT REGARDLESS OF RESPONSIBILITY FOR SUPPLYING EQUIPMENT.	
MEP COMPONENT ANCHORAGE NOTE	
ALL MECHANICAL, PLUMBING, AND ELECTRICAL COMPONENTS SHALL BE ANCHORED AND INSTALLED PER THE DETAILS ON THE DSA APPROVED CONSTRUCTION DOCUMENTS. THE FOLLOWING COMPONENTS SHALL BE ANCHORED OR BRACED TO MEET THE FORCE AND DISPLACEMENT REQUIREMENTS PRESCRIBED IN THE 2022 CBC, SECTIONS 1617A.1.18 THROUGH 1617A.1.26 AND ASCE 7-16 CHAPTERS 13, 26 AND 30.	
1. ALL PERMANENT EQUIPMENT AND COMPONENTS.	
2. TEMPORARY, MOVEABLE OR MOBILE EQUIPMENT THAT IS PERMANENTLY ATTACHED (E.G., HARD WIRED) TO THE BUILDING UTILITY SERVICES SUCH AS ELECTRICITY, GAS OR WATER, "PERMANENTLY ATTACHED" SHALL INCLUDE ALL ELECTRICAL CONNECTIONS EXCEPT PLUGS FOR 110/220 VOLT RECEPTACLES HAVING FLEXIBLE CABLE.	
3. TEMPORARY, MOVABLE OR MOBILE EQUIPMENT EQUIPMENT WHICH IS HEAVIER THAN 400 POUNDS OR HAS A CENTER OF MASS LOCATED 4 FEET OR MORE ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT IS REQUIRED TO BE RESTRAINED IN A MANNER APPROVED BY DSA.	
THE FOLLOWING MECHANICAL AND ELECTRICAL COMPONENTS SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE BUT NEED NOT DEMONSTRATE DESIGN COMPLIANCE WITH THE REFERENCES NOTED ABOVE. THESE COMPONENTS SHALL HAVE FLEXIBLE CONNECTIONS PROVIDED BETWEEN THE COMPONENT AND ASSOCIATED DUCTWORK, PIPING, AND CONDUIT. FLEXIBLE CONNECTIONS MUST ALLOW MOVEMENT IN BOTH TRANSVERSE AND LONGITUDINAL DIRECTIONS:	
A. COMPONENTS WEIGHING LESS THAN 400 POUNDS AND HAVE A CENTER OF MASS LOCATED 4 FEET OR LESS ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT.	
B. COMPONENTS WEIGHING LESS THAN 20 POUNDS, OR IN THE CASE OF DISTRIBUTED SYSTEMS, LESS THAN 5 POUNDS PER FOOT, WHICH ARE SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.	
THE ANCHORAGE OF ALL MECHANICAL, ELECTRICAL AND PLUMBING COMPONENTS SHALL BE SUBJECT TO THE APPROVAL OF THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR STRUCTURAL ENGINEER DELEGATED RESPONSIBILITY AND ACCEPTANCE BY DSA. THE PROJECT INSPECTOR WILL VERIFY THAT ALL COMPONENTS AND EQUIPMENT HAVE BEEN ANCHORED IN ACCORDANCE WITH THE ABOVE REQUIREMENTS.	
PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM BRACING NOTE:	
PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS SHALL BE BRACED TO COMPLY WITH THE FORCES AND DISPLACEMENTS PRESCRIBED IN ASCE 7-16 SECTION 13.3 AS DEFINED IN ASCE 7-16 SECTION 13.6.5, 13.6.6, 13.6.7, 13.6.8; AND 2022 CBC, SECTIONS 1617A.1.24, 1617A.1.25, AND 1617A.1.26.	
THE METHOD OF SHOWING BRACING AND ATTACHMENTS TO THE STRUCTURE FOR THE IDENTIFIED DISTRIBUTION SYSTEM ARE AS NOTED BELOW. WHEN BRACING AND ATTACHMENTS ARE BASED ON A PREAPPROVED INSTALLATION GUIDE (E.G., OSHPD OPM FOR 2013 CBC OR LATER), COPIES OF THE BRACING SYSTEM INSTALLATION GUIDE OR MANUAL SHALL BE AVAILABLE ON THE JOBSITE PRIOR TO THE START OF AND DURING THE HANGING AND BRACING OF THE DISTRIBUTION SYSTEMS. THE STRUCTURAL ENGINEER OF RECORD SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.	
MECHANICAL PIPING (MP), MECHANICAL DUCTS (MD), PLUMBING PIPING (PP), AND ELECTRICAL DISTRIBUTION SYSTEMS (E):	
MP <input type="checkbox"/> MD <input type="checkbox"/> PP <input type="checkbox"/> E <input checked="" type="checkbox"/> OPTION 1: DETAILED ON THE APPROVED DRAWINGS WITH PROJECT SPECIFIC NOTES AND DETAILS	
MP <input type="checkbox"/> MD <input type="checkbox"/> PP <input type="checkbox"/> E <input type="checkbox"/> OPTION 2: SHALL COMPLY WITH HCAI (OSHPD) PREAPPROVAL (OPM#) _____, AS INCLUDED IN THESE DRAWINGS WITH PROJECT-SPECIFIC NOTES AND DETAILS.	
GENERAL NOTES	
N.T.S.	12

ELECTRICAL SYMBOL LEGEND		
DIMENSIONS INDICATED ARE MEASURED TO CENTERLINE OF ENCLOSURE, UNLESS OTHERWISE NOTED		
NOTE: SOME SYMBOLS SHOWN MAY NOT APPLY TO THIS PROJECT		
SYMBOL	DESCRIPTION	SYMBOL
E.P.	DENOTES EXPLOSION PROOF CONSTRUCTION	\$ a
D.T.	DENOTES DUST TIGHT CONSTRUCTION	\$ 2
O.C.	DENOTES SPACING DIMENSION ON CENTER LINE OF DEVICE	\$ 3
R.T.	DENOTES RAIN TIGHT CONSTRUCTION	\$ 4
U.G.	DENOTES UNDERGROUND INSTALLATION	\$
V.P.	DENOTES VAPOR TIGHT CONSTRUCTION	
W.P.	DENOTES WEATHERPROOF CONSTRUCTION	(M)
W.T.	DENOTES WATER TIGHT CONSTRUCTION	(M) W
A.F.F.	DENOTES ABOVE FINISHED FLOOR	(P)
A.F.G.	DENOTES ABOVE FINISHED GRADE	(RP)
F.B.O.	DENOTES FURNISHED BY OTHERS	(C)
U.O.N.	DENOTES UNLESS OTHERWISE NOTED	(CA)
(E)	DENOTES EXISTING TO REMAIN, NO WORK U.O.N.	(C) L
(N)	DENOTES NEW	(DS)
1	ELECTRICAL KEYNOTES: DENOTES KEYNOTE #1 OF NOTES ON SAME SHEET	(nb)
A-3	CIRCUIT HOME RUN: DENOTES PANEL A, CKT. #3, .34°C MINIMUM, U.O.N.	(ns)
1	CIRCUIT FEEDER: DENOTES FEEDER 'F'1 PER SYSTEM FEEDER SCHEDULE	(AD)
---	CONDUIT IN ATTIC/WALL: DENOTES 3/4"2H12 AWG CU THWN, 1#12 CU GND, U.O.N.	(TC)
---	CONDUIT IN FLOOR/G: DENOTES 3/4"2H12 AWG CU THWN, 1#12 CU GND, U.O.N.	(PC)
---	DENOTES EXISTING CONDUIT RUN TO REMAIN	(T)
---	CONDUIT RUN - STUBBED, CAPPED AND LABELED.	
---	CONDUIT RUN: DENOTES 3/4" - 3 #12 AWG CU THWN + 1 #12 CU GND, U.O.N.	---
---	CONDUIT RUN: DENOTES 3/4" - 4 #12 AWG CU THWN + 1 #12 CU GND, U.O.N.	---
---	CONDUIT RUN: DENOTES 3/4" - 5 #12 AWG CU THWN + 1 #12 CU GND, U.O.N.	---
---	CONDUIT RUN: DENOTES 1" - 6 #12 AWG CU THWN + 1 #12 CU GND, U.O.N.	---
(V) (D)	SEPARATE POWER AND DATA FLOOR BOXES (2)	(2)
(V) (D)	FLUSH FLOOR BOX WITH DEVICE(S) INSTALLED PER PLANS, U.O.N. (2)	(2)
(S)	TAMPER-RESISTANT SINGLE RECEPTACLE IN WALL @ +18", U.O.N.	(S)
(S)	TAMPER-RESISTANT DUPLEX RECEPTACLE IN WALL @ +18", U.O.N.	(S)
(S)	TAMPER-RESISTANT DUPLEX GFI RECEPTACLE, IN WALL @ +18", U.O.N.	(S)
(S)	TAMPER-RESISTANT SWITCHED GFCI RECEPTACLE IN WALL @ +18" A.F.F. U.O.N. (OCC. SENSOR OR WALL SWITCH CONTROLLED)	(S)
(S) VP	TAMPER-RESISTANT WEATHER-RESISTANT (WR) DUPLEX GFCI RECEPTACLE W/ W.P. COVER @ +18", U.O.N.	(S) VP
(S)	TAMPER-RESISTANT DUPLEX ISOLATED GROUND RECEPTACLE IN WALL @ +18", U.O.N. (7)	(S)
(S)	TAMPER-RESISTANT QUADRUPLX RECEPTACLE IN WALL @ +18", U.O.N.	(S)
(S)	SPECIAL PURPOSE ELECTRICAL OUTLET PER PLAN IN WALL @ 18" U.O.N.	(S)
(S)	DUPLEX RECEPTACLE FLUSH IN CEILING	(S)
(S)	TAMPER-RESISTANT QUADRUPLX RECEPTACLE IN WALL @ +18" A.F.F. U.O.N. ONE UNSWITCHED RECEPTACLE AND ONE SWITCHED (OCC. SENSOR CONTROLLED) RECEPTACLE	(S)
(S)	JUNCTION BOX	(S)
(S)	JUNCTION BOX WITH FLEXIBLE CONDUIT CONNECTION TO EQUIPMENT	(S)
(S)	NON-FUSIBLE DISCONNECT SWITCH	(S)
(S)	FUSIBLE DISCONNECT SWITCH	(S)
(S)	FUSIBLE DISCONNECT SWITCH WITH INTEGRAL MAGNETIC STARTER	(S)
(S)	ELECTRIC MOTOR	(S)
(S)	EXHAUST FAN OR FRACTIONAL HORSEPOWER MOTOR	(S)
(S)	SURFACE MOUNTED RACEWAY, MOUNT @ +18" A.F.F. U.O.N.	(S)
(S)	RECESSED LED LIGHTING FIXTURE	(S)
(S)	RECESSED LED LIGHTING FIXTURE WITH EMERGENCY BATTERY BACKUP	(S)
(S)	SURFACE MOUNTED LED LIGHTING FIXTURE	(S)
(S)	SURFACE MOUNTED LED LIGHTING FIXTURE WITH EMERGENCY BATTERY BACKUP	(S)
(S)	SURFACE MOUNTED LED STRIP LIGHT	(S)
(S)	SURFACE MOUNTED LED STRIP LIGHT WITH EMERGENCY BATTERY BACKUP	(S)
(S)	POST TOP MOUNTED LIGHTING FIXTURE	(S)
(S)	WALL MOUNTED LIGHTING FIXTURE	(S)
(S)	WALL MOUNTED LIGHTING FIXTURE WITH EMERGENCY BATTERY BACKUP	(S)
(S)	CEILING MOUNTED LIGHTING FIXTURE	(S)
(S)	CEILING MOUNTED LIGHTING FIXTURE WITH EMERGENCY BATTERY BACKUP	(S)
(S)	RECESSED LIGHTING FIXTURE	(S)
(S)	RECESSED FIXTURE WITH EMERGENCY BATTERY BACKUP	(S)
(S)	SURFACE MOUNTED ROUND LIGHTING FIXTURE	(S)
(S)	SURFACE MOUNTED ROUND LIGHTING FIXTURE WITH EMERGENCY BATTERY BACKUP	(S)
(S)	ILLUMINATED EXIT SIGN MOUNTED ON CEILING	(S)
(S)	ILLUMINATED EXIT SIGN MOUNTED ON WALL	(S)
(S)	LOW LEVEL PHOTO LUMINESCENT EXIT SIGN MOUNTED ON WALL	(S)
(S)	POLE MOUNTED EXTERIOR LIGHTING FIXTURE	(S)
(S)	COMBINATION VOICE AND DATA OUTLET IN WALL, WITH TWO 'D' CABLES TO IDF + TWO 'T' CABLES TO TELEPHONE BACKBOARD (1) (6)	(S)
(S)	DATA OUTLET IN WALL @ +18" U.O.N. WITH 'D' CABLES TO IDF OR MDF (SUBSCRIPT INDICATES QUANTITY OF CABLES AND STATION SIDE JACKS) (1) (6)	(S)
(S)	TELEVISION OUTLET IN WALL @ +18", U.O.N. (1)	(S)
(S)	MICROPHONE OUTLET IN WALL @ +18", U.O.N. (1)	(S)
(S)	SPEAKER OUTLET IN WALL @ +18", U.O.N. (1)	(S)
(S)	INTERCOMMUNICATIONS HANDSET ON WALL @ +48" TO TOP OF BOX U.O.N.	(S)
(S)	WIRELESS ACCESS POINT LOCATION, PROVIDE TWO TYPE 'D' CABLES TO IDF OR MDF	(S)
ELECTRICAL SYMBOLS NOTES:		
(1) RUN 1" C CONCEALED IN WALL AND STUB INTO ACCESSIBLE ATTIC SPACE ABOVE NEAREST T-BAR CEILING, U.O.N.		
(2) RUN 1" C TO NEAREST WALL, THEN RISE CONCEALED IN WALL AND STUB INTO ACCESSIBLE ATTIC SPACE ABOVE NEAREST T-BAR CEILING, U.O.N. FOR SINGLE SYSTEMS INDIVIDUAL FLOORBOXES, WHERE MULTIPLE SYSTEMS OCCUR WITHIN A COMMON FLOOR BOX, RUN TWO 1" C PER ABOVE.		
(3) SYSTEM IS ROUGH IN ONLY, PROVIDE BACKBOX, BLANK COVERPLATE AND CONDUIT STUB PER DETAIL PLANS.		
(4) IN ADDITION TO CONDUITS SHOWN ON PLANS, STUB ONE 1 1/4" C, ONE 1" C, AND TWO 3/4" C (SPARE) INTO ACCESSIBLE ATTIC SPACE ABOVE NEAREST T-BAR CEILING, U.O.N. THIS REQUIREMENT APPLIES TO EACH POWER AND LIGHTING PANEL INDICATED FLUSH MOUNTED ON POWER PLAN.		
(5) IN ADDITION TO CONDUITS SHOWN ON PLANS, STUB ONE 1" C AND TWO 3/4" C (SPARE) INTO ACCESSIBLE ATTIC SPACE ABOVE NEAREST T-BAR CEILING U.O.N. REQUIREMENT APPLIES TO EACH SIGNAL SYSTEM T.C. INDICATED FLUSH MOUNTED ON SIGNAL PLAN.		
(6) 4S BACKBOX WITH SINGLE GANG TRIM AND COVERPLATE.		
(7) ORANGE DEVICE (ISOLATED GROUND DUPLEX RECEPT. ONLY) WITH ENGRAVED WORDING ON COVER PLATE ABOVE ISOLATED GROUND RECEPT.;"COMPUTER ONLY".		
SYMBOL LEGEND AND NOTES		
		N.T.S.
		4

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS ☐ FLS ☐ ACS ☐
DATE: 11/26/2024

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.

07/31/2024
B
DSA SUBMITTAL

DESCRIPTION
DATE
11/01/2024
MARK
C
DSA BACKCHECK SUBMITTAL

TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLDBROOK ST.
STOCKTON, CA

DRAWING TITLE
ELECTRICAL LEGEND, NOTES, & SCHEDULES

PROJECT NO.
23-12899
DRAWING
E800

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

Outdoor Lighting

CERTIFICATE OF COMPLIANCE

NRCC-LTO-E

This document is used to demonstrate compliance with requirements in 110.9, 130.0, 130.2, 140.7, and 141.0(b)(2), for outdoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e)(6), 180.1(a) and 180.2(b)(4B) for outdoor lighting scopes using the prescriptive path for multifamily and mixed-use occupancies. Multifamily includes dormitory and senior living facilities.

Project Name: 12899 - Stockton ELOP Peyton

Report Page: (Page 1 of 7)

Project Address: 12899 - Stockton ELOP Peyton

Date Prepared: 2024-08-05 17:55:40 04:00

A. GENERAL INFORMATION

01 Project Location (city)

Stockton

04 Total Illuminated Hardscape Area (ft²)

10748

02 Climate Zone

12

03 Outdoor Lighting Zone per Title 24 Part 1, 10.11.4 or as designated by Authority Having Jurisdiction (AHJ):

☐ Z-0: Very Low - Undeveloped Parkland

☐ Z-1: Low - Rural Areas

☐ Z-2: Moderate - Urban Clusters

☐ Z-3: Moderately High - Urban Areas

☐ Z-4: High - Must be reviewed by CA Energy Commission for Approval

05 Occupancy Types within Project

☐ School or Classroom

B. PROJECT SCOPE

This table includes outdoor lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.7 / 170.2(e)(6) or 141.0(b)(2) / 180.2(b)(4B) for alterations.

My Project Consists of:

01

☒ New Lighting System

Must Comply with Allowances from 140.7 / 170.2(e)(6)

☐ Altered Lighting System

Is your alteration increasing the connected lighting load (Watts)?

☐ Yes

☐ No

02

03

% of Existing Luminaires Being Altered¹

☐ < 10%

☐ >= 10% and < 50%

☐ >= 50%

04

Sum Total of Luminaires Being Added or Altered

05

Calculation Method

¹ FOOTNOTES: % of Existing Luminaires Being Altered = (Sum Total of Luminaires Being Added or Altered / Existing Luminaires within the Scope of the Permit Application) x 100.

Generated Date/Time:

Documentation Software: Energy Code Ace

Report Version: 2022.0.000

Compliance ID: 216855-0824-0002

Schema Version: rev 20220101

Report Generated: 2024-08-05 14:55:42

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

Outdoor Lighting

CERTIFICATE OF COMPLIANCE

NRCC-LTO-E

This document is used to demonstrate compliance with requirements in 110.9, 130.0, 130.2, 140.7, and 141.0(b)(2), for outdoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e)(6), 180.1(a) and 180.2(b)(4B) for outdoor lighting scopes using the prescriptive path for multifamily and mixed-use occupancies. Multifamily includes dormitory and senior living facilities.

Project Name: 12899 - Stockton ELOP Peyton

Report Page: (Page 4 of 7)

Project Address: 12899 - Stockton ELOP Peyton

Date Prepared: 2024-08-05 17:55:40 04:00

G. SHIELDING REQUIREMENTS (BUG)

This table includes fixtures of >=6,200 initial lumens indicated on Table F as needing to comply with Shielding Requirements. Maximum lumens can be found in Title 24, Part 11, Section 5.106.8.

01

02

03

04

05

06

07

08

09

10

11

12

Name or Item Tag

Complete Luminaire Description

Mounting Height¹

Max Allowable Backlight Rating¹

Backlight Rating Per Design

Lighting type

Max Allowable Uplight Rating¹

Uplight Rating Per Design

Mounting Height¹

Max Allowable Glare Rating¹

Glare Rating Per Design

Pass

Fail

01

02

03

04

05

06

07

08

09

10

11

12

S1

15' LED Pole light

2 MH from property line

No Limit

B2

Area Lighting

U0

U0

> 2 MH from property line

G3

G1

☐

☐

¹ FOOTNOTES: Mounting Height is labeled MH in this table.

² Authority Having Jurisdiction may ask for Luminaire cut sheets or other documentation to confirm luminaire type, uplight ratings and glare ratings used for compliance per 130.2(b) / 160.5(c).

³ BUG ratings with a lower number than the "Max Allowable" are compliant. Ex. If Max Allowable is Bug Rating B4, then B0, B1, B2 and B3 are all compliant.

H. OUTDOOR LIGHTING CONTROLS

This table demonstrates compliance with controls requirements for all new or altered luminaires installed as part of the permit application. For alteration projects, luminaires which are existing to remain (ie untouched) and luminaires which are removed and reinstalled (whichever only) do not need to be included in this table even if they are within the spaces covered by the permit application.

Outdoor lighting for nonresidential buildings, parking garages and common service areas in multifamily buildings must be documented separately from outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit.

Mandatory Controls for Nonresidential Occupancies, Parking Garages & Common Areas in Multifamily Buildings

01

02

03

04

05

Area Description

Shut-Off 130.2(c)(1) / 160.5(c)

Auto-Schedule 130.2(c)(2) / 160.5(c)

Motion Sensor 130.2(c)(3) / 160.5(c)

Field Inspector

General Hardscape: "S1"

Astronomical Timer

Provided

NA: Not permitted by H&LS

Pass

Fail

¹ FOOTNOTE: Text has been abbreviated, please refer to Table 160.5.A to confirm compliance with the specific light source technologies listed.

² Authority having jurisdiction may ask for cut sheets or other documentation to confirm compliance of light source.

³ Recessed luminaires marked for use in fire-rated installations, and recessed luminaires installed in non-insulated ceilings are exempted from ii and iii.

Generated Date/Time:

Documentation Software: Energy Code Ace

Report Version: 2022.0.000

Compliance ID: 216855-0824-0002

Schema Version: rev 20220101

Report Generated: 2024-08-05 14:55:42

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

Outdoor Lighting

CERTIFICATE OF COMPLIANCE

NRCC-LTO-E

This document is used to demonstrate compliance with requirements in 110.9, 130.0, 130.2, 140.7, and 141.0(b)(2), for outdoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e)(6), 180.1(a) and 180.2(b)(4B) for outdoor lighting scopes using the prescriptive path for multifamily and mixed-use occupancies. Multifamily includes dormitory and senior living facilities.

Project Name: 12899 - Stockton ELOP Peyton

Report Page: (Page 7 of 7)

Project Address: 12899 - Stockton ELOP Peyton

Date Prepared: 2024-08-05 17:55:40 04:00

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name:

Jason March

Signature Date:

09/10/2024

Company:

TETER, INC.

Address:

10000 STOCKDALE HWY #350

City/State/Zip:

BAKERSFIELD, CA 93311

Phone:

661.843.8400

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

1. The information provided on this Certificate of Compliance is true and correct.

2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).

3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.

4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.

5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation provided to the building owner at occupancy.

Responsible Designer Name:

Jason March

Date Signed:

09/10/2024

Company:

TETER, INC.

Address:

10000 STOCKDALE HWY #350

City/State/Zip:

BAKERSFIELD, CA 93311

Phone:

661.843.8400

Generated Date/Time:

Documentation Software: Energy Code Ace

Report Version: 2022.0.000

Compliance ID: 216855-0824-0002

Schema Version: rev 20220101

Report Generated: 2024-08-05 14:55:42

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

Outdoor Lighting

CERTIFICATE OF COMPLIANCE

NRCC-LTO-E

This document is used to demonstrate compliance with requirements in 110.9, 130.0, 130.2, 140.7, and 141.0(b)(2), for outdoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e)(6), 180.1(a) and 180.2(b)(4B) for outdoor lighting scopes using the prescriptive path for multifamily and mixed-use occupancies. Multifamily includes dormitory and senior living facilities.

Project Name: 12899 - Stockton ELOP Peyton

Report Page: (Page 2 of 7)

Project Address: 12899 - Stockton ELOP Peyton

Date Prepared: 2024-08-05 17:55:40 04:00

C. COMPLIANCE RESULTS

Results in this table are automatically calculated from data input and calculations in Tables F through N. Note: If any cell on this table says "COMPLIES with Exceptional Conditions" refer to Table D. Exceptional Conditions for guidance or see applicable Table referenced below.

Calculations of Total Allowed Lighting Power (Watts) 140.7 / 170.2(e)(6) or 141.0(b)(2) / 180.2(b)(4B)

01

02

03

04

05

06

07

08

09

General Hardscape Allowance 140.7(d)(1) / 170.2(e)(6) (See Table I)

+

Per Application 140.7(d)(2) / 170.2(e)(6) (See Table J)

+

Sales Frontage 140.7(d)(2) / 170.2(e)(6) (See Table K)

+

Ornamental 140.7(d)(2) / 170.2(e)(6) (See Table L)

+

Per Specific Area 140.7(d)(2) / 170.2(e)(6) (See Table M)

OR

Existing Power Allowance 141.0(b)(2) / 180.2(b)(4B) (See Table N)

=

Total Allowed (Watts)

≥

Total Actual (Watts)

07 must be >= 08

771.92

+

+

+

+

OR

=

771.92

≥

172

COMPLIES

Shielding Compliance (See Table G for Details)

COMPLIES

Controls Compliance (See Table H for Details)

COMPLIES

D. EXCEPTIONAL CONDITIONS

This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS

This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

Generated Date/Time:

Documentation Software: Energy Code Ace

Report Version: 2022.0.000

Compliance ID: 216855-0824-0002

Schema Version: rev 20220101

Report Generated: 2024-08-05 14:55:42

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

Outdoor Lighting

CERTIFICATE OF COMPLIANCE

NRCC-LTO-E

This document is used to demonstrate compliance with requirements in 110.9, 130.0, 130.2, 140.7, and 141.0(b)(2), for outdoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e)(6), 180.1(a) and 180.2(b)(4B) for outdoor lighting scopes using the prescriptive path for multifamily and mixed-use occupancies. Multifamily includes dormitory and senior living facilities.

Project Name: 12899 - Stockton ELOP Peyton

Report Page: (Page 5 of 7)

Project Address: 12899 - Stockton ELOP Peyton

Date Prepared: 2024-08-05 17:55:40 04:00

I. LIGHTING POWER ALLOWANCE (per 140.7 / 170.2(e))

This table includes areas using allowance calculations per 140.7 / 170.2(e). General Hardscape Allowance is per Table 140.7-A / Table 170.2-A while "Use it or lose it" Allowances are per Table 140.7-B / Table 170.2-B. Indicate which allowances are being used to expand sections for user input. Luminaires that qualify for one of the "Use it or lose it" allowances shall not qualify for another "Use it or lose it" allowance. Outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit are included in Table H, and are not included here. All other multifamily outdoor lighting is included here.

Calculated General Hardscape Lighting Power Allowance per Table 140.7-A for Nonresidential & Hotel/Motel

01

General Hardscape Allowance Table I (below)

☒ Per Application Table J

☐ Sales Frontage Table K

☐ Ornamental Table L

☐ Per Specific Area Table M

02

03

04

05

06

07

08

09

Area Description

Illuminated Area (ft²)

Allowed Density (W/ft²)

Area Allowance (Watts)

Perimeter Length (ft)

Allowed Density (W/ft)

Linear Allowance (Watts)

Total General AWA + LWA (Watts)

General Hardscape

10748.51

0.021

225.72

1481

0.2

296.2

521.92

Initial Wattage Allowance for Entire Site (Watts):

250

Instances of Initial Wattage Allowance (L2 0 only):

771.92

Total General Hardscape Allowance (Watts):

771.92

J. LIGHTING ALLOWANCE: PER APPLICATION

This section does not apply to this project.

K. LIGHTING ALLOWANCE: SALES FRONTAGE

This section does not apply to this project.

L. LIGHTING ALLOWANCE: ORNAMENTAL

This section does not apply to this project.

Generated Date/Time:

Documentation Software: Energy Code Ace

Report Version: 2022.0.000

Compliance ID: 216855-0824-0002

Schema Version: rev 20220101

Report Generated: 2024-08-05 14:55:42

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

Outdoor Lighting

CERTIFICATE OF COMPLIANCE

NRCC-LTO-E

This document is used to demonstrate compliance with requirements in 110.9, 130.0, 130.2, 140.7, and 141.0(b)(2), for outdoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e)(6), 180.1(a) and 180.2(b)(4B) for outdoor lighting scopes using the prescriptive path for multifamily and mixed-use occupancies. Multifamily includes dormitory and senior living facilities.

Project Name: 12899 - Stockton ELOP Peyton

Report Page: (Page 3 of 7)

Project Address: 12899 - Stockton ELOP Peyton

Date Prepared: 2024-08-05 17:55:40 04:00

F. OUTDOOR LIGHTING FIXTURE SCHEDULE

For new or altered lighting systems demonstrating compliance with 140.7 / 170.2(e)(6) all new luminaires being installed and any existing luminaires remaining or being moved within the spaces covered by the permit application are included in the Table below. For altered lighting systems using the Existing Power method per 141.0(b)(2), only new luminaires being installed and replacement luminaires being installed as part of the project scope are included (ie, existing luminaires remaining or existing luminaires being moved are not included). Outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit are included in Table H, and are not included here. All other multifamily outdoor lighting is included here.

Designed Wattage:

01

02

03

04

05

06

07

08

09

10

Name or Item Tag

Complete Luminaire Description

Watts per luminaire¹,²

How is Wattage determined

Total Number Luminaires²

Luminaire Status³

Excluded per 140.7(a) / 170.2(e)(6A)

Design Watts

Cutoff Req. > 6,200 initial lumen output 130.2(b) / 160.5(c)¹,⁴

Field Inspector

S1

15' LED Pole light

☐ Linear

86

Mfr. Spec

2

New

☐

172

Provided

☐

☐

Total Design Watts:

172

¹ NOTES: Selections with a * require a note in the space below explaining how compliance is achieved.

² Luminaire is lighting a stave. EXCEPTION 2 to 130.2(b)

³ FOOTNOTES: Authority Having Jurisdiction may ask for Luminaire cut sheets to confirm wattage used for compliance per 130.0(d) / 160.5(b).

⁴ For linear luminaires, wattage should be indicated as W/ft instead of Watts/luminaire. Total linear feet should be indicated in column 05 instead of number of luminaires.

⁵ Select "New" for new luminaires in a new outdoor lighting project, or for added luminaires in an alteration. Select "Altered" for replacement luminaires in an alteration. Select "Existing to Remain" for existing luminaires within the project scope that are not being altered and are remaining. Select "Existing to be Replaced" for existing luminaires which are being removed and reinstalled as part of the project scope.

⁶ Compliance with mandatory shielding requirements is required for luminaires with initial lumen output >= 6,200 unless exempted by 130.2(b) / 160.5(c).

Generated Date/Time:

Documentation Software: Energy Code Ace

Report Version: 2022.0.000

Compliance ID: 216855-0824-0002

Schema Version: rev 20220101

Report Generated: 2024-08-05 14:55:42

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

Outdoor Lighting

CERTIFICATE OF COMPLIANCE

NRCC-LTO-E

This document is used to demonstrate compliance with requirements in 110.9, 130.0, 130.2, 140.7, and 141.0(b)(2), for outdoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e)(6), 180.1(a) and 180.2(b)(4B) for outdoor lighting scopes using the prescriptive path for multifamily and mixed-use occupancies. Multifamily includes dormitory and senior living facilities.

Project Name: 12899 - Stockton ELOP Peyton

Report Page: (Page 6 of 7)

Project Address: 12899 - Stockton ELOP Peyton

Date Prepared: 2024-08-05 17:55:40 04:00

M. LIGHTING ALLOWANCE: PER SPECIFIC AREA

This section does not apply to this project.

N. EXISTING CONDITIONS POWER ALLOWANCE (alterations only)

This section does not apply to this project.

O. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION

Selections have been made based on information provided in this document. If any selection has been changed by permit applicant, an explanation should be included in Table E. Additional Remarks: These documents must be provided to the building inspector during construction and must be completed through an Acceptance Test Technician Certification Provider (ATTCP). For more information visit: <http://www.energy.ca.gov/title24/attcp/providers.html>

Form/Title

Systems/Spaces To Be Field Verified

NRCA-LTO-E - Must be submitted for all buildings

P. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in this document. If any selection has been changed by permit applicant, an explanation should be included in Table E. Additional Remarks: These documents must be provided to the building inspector during construction and must be completed through an Acceptance Test Technician Certification Provider (ATTCP). For more information visit: <http://www.energy.ca.gov/title24/attcp/providers.html>

Form/Title

General Hardscape: "S1"

NRCA-LTO-E - Must be submitted for all outdoor lighting controls except for alterations where controls are added to <= 20 luminaires.

Generated Date/Time:

Documentation Software: Energy Code Ace

Report Version: 2022.0.000

Compliance ID: 216855-0824-0002

Schema Version: rev 20220101

Report Generated: 2024-08-05 14:55:42

Teter, Inc. expressly reserves its common law copyright and other property rights in these plans. This document, the ideas and designs incorporated herein, as an instrument of professional service, is not to be used for any other project without prior written authorization.	DS SUBMITTAL	DESCRIPTION	DS BACKCHECK SUBMITTAL
B	07/31/2024	MARK	DATE
C	11/01/2024	MARK	DATE

TETER, INC.
FRESNO HEADQUARTERS
VISALIA | BAKERSFIELD | MODESTO | SAN LUIS OBISPO
ARCHITECTS ENGINEERS CONNECTED

ELOP RELOCATABLE CLASSROOM
PEYTON ELEMENTARY
2525 GOLDBROOK ST.
STOCKTON, CA
DRAWING TITLE
CALIFORNIA ENERGY COMPLIANCE FORMS

PROJECT NO.

23-12899

DRAWING

E900

C:\Users\User\Documents\200303 - Aries, 24x40 PC - MainFile - Low Seismic 6.7 - CESAR24.D63.rvt 6/15/2021 11:48:48 PM

Sheet List	
Sheet Number	Sheet Name
Cover	
A0.0.1	PROJECT OPTIONS SCHEDULE
A0.1	TYPICAL KEY PLAN AND SCHEDULES, GEN NOTES,
A0.2	SIGNAGE AND SYMBOLS
A0.3	DSA-103 T&I CONCRETE FLOORS
A0.4	DSA-103 T&I PLYWOOD FLOORS
A0.5	CALGREEN SPECS
A0.6	CAL GREEN CHECKLIST
A0.7	CAL GREEN CHECKLIST
A0.8	CAL GREEN CHECKLIST
Architectural	
A0.0	COVER SHEET
A1.0	24x40 FLOOR PLAN
A1.1	36x40 FLOOR PLAN
A1.2	48x40 thru 120x40 FLOOR PLAN
A2.1(A)	ARCHITECTURAL DETAILS (WOOD FRAMING SHTG FINISH)
A2.1(B)	ARCHITECTURAL WUI DETAILS (WOOD FRAMING SHTG FINISH)
A2.2	ARCHITECTURAL DETAILS (WOOD FRAMING PLASTER FINISH)
A2.5(A)	ARCHITECTURAL DETAILS (1-HR WOOD FRAMING SHTG FINISH)
A2.5(B)	ARCHITECTURAL WUI DETAILS (1-HR WOOD FRAMING SHTG FINISH)
A2.6	ARCHITECTURAL DETAILS (1-HR WOOD FRAMING PLASTER FINISH)
A2.7	WUI NOTES AND CRITERIA
A2.9	ARCHITECTURAL DETAILS (FLOOR)
A2.9.1	DETERIORATION PROG-NON WOOD FINISH SIDING CONC FLOOR-WD STUDB
A2.9.2	DETERIORATION PROG- STUCCO EXTERIOR FINISH CONC FLOOR-WD STUDB
A2.9.3	DETERIORATION PROG-NON WOOD FINISH SIDING WOOD FLOOR-WD STUDB
A2.9.4	DETERIORATION PROG- STUCCO EXTERIOR FINISH WOOD FLR-WD STUDB
A2.9.9	DETERIORATION T-111 EXTERIOR FINISH WOOD FLR-WOOD STUDB
A3.0	ADDITIONAL FIRE RATING DETAILS AND NOTES
A3.0.1	FIRE SEPARATION & PENETRATION DETAILS
A3.1	SINGLE OCC. BATHROOM
A3.1.1	SINGLE OCC. BATHROOM AGE GROUP
A3.1.2	SINGLE OCC. BATHROOM COMBINED AGE GROUP
A3.2	RCP
A3.2.1	CEILING NOTES
A3.3	CEILING DETAILS (T-GRID)
A3.4	CEILING DETAILS (GYP BOARD)
A4.0.1	ROOF PLAN MONO SLOPE (STANDING SEAM)
A4.0.2	ROOF PLAN DUAL SLOPE (STANDING SEAM)
A4.1	ROOF DETAILS (STANDING SEAM)
A4.2.1	ROOF PLAN MONO SLOPE (EPDM)
A4.2.2	ROOF PLAN DUAL SLOPE (EPDM)
A4.3	ROOF DETAILS (EPDM)
A4.4.1	ROOF PLAN w/ PARAPET MONO SLOPE (EPDM)
A4.4.5	ARCHITECTURAL DETAILS (PARAPET)
A5.0	SIDEWALL ELEVATION
A5.1	ENDWALL ELEVATIONS
A5.2	INTERIOR ELEVATIONS
A6.0	SECTION - STANDING SEAM (MONO)
A6.0.1	SECTION - STANDING SEAM (DUAL)
A6.1	SECTION - EPDM (DUAL)
A6.2	SECTION
A6.3	SECTION - EPDM (MONO)
A7.0	ADDITIONAL OPTION DETAILS
A7.1	ADDITIONAL OPTION DETAILS
A7.2	ADDITIONAL OPTION DETAILS
MEP	
E0.1	ELECTRICAL GENERAL NOTES
E1.0	ELECTRICAL PLAN 24x40
E1.1	ELECTRICAL SCHEDULES 24x40
E1.2	ELECTRICAL PLAN 36x40
E1.3	ELECTRICAL SCHEDULE 36x40
E1.4	ELECTRICAL PLAN 48x40 thru 120x40
E1.5	ELECTRICAL SCHEDULE 48x40
M0.1	MISCELLANEOUS NOTES & DETAILS
M0.2	MISCELLANEOUS NOTES & DETAILS
M2.9	24x40' T24 CZ 14 (WALL AC)
M2.10	24x40' T24 CZ 14 (WALL AC)
M2.11	24x40' T24 CZ 15 (WALL AC)
M2.12	24x40' T24 CZ 15 (WALL AC)
M2.13	24x40' T24 CZ 16 (WALL AC)
M2.14	24x40' T24 CZ 16 (WALL AC)
M3.3	ENVELOPE AND NOTES
M5.1	MECHANICAL CEILING PLAN 24x40
M5.2	MECHANICAL ROOF MOUNT 24x40
M6.1	MECHANICAL CEILING PLAN 36x40
M6.2	MECHANICAL ROOF MOUNT 36x40
M7.1	MECHANICAL CEILING PLAN 48x40 thru 120x40
M7.2	MECHANICAL ROOF MOUNT 48x40 thru 120x40
P1.0	TYPICAL PLUMBING DETAILS
Foundation	
F1.10	WOOD FOUNDATION NOTES SCHED FOR BLDG W/ 50+16
F1.11	WOOD FOUNDATION PLAN 24x40 BLDG W/ 50+15
F1.12	WOOD FOUNDATION PLAN 36x40 BLDG W/ 50+15
F1.13	WOOD FOUNDATION PLAN 48x40 BLDG W/ 50+15
F1.14	MOULINE "B" W/ EXTERIOR WALLS BACK TO BACK 160 PSF
F1.15	WOOD FOUNDATION NOTES SCHED FOR BLDG W/ 100PSF
F1.21	WOOD FOUNDATION PLAN 24x40 BLDG W/ 160 PSF
F1.22	WOOD FOUNDATION PLAN 36x40 BLDG W/ 160 PSF
F1.23	WOOD FOUNDATION PLAN 48x40 BLDG W/ 160 PSF
F1.24	MOULINE "B" W/ EXTERIOR WALLS BACK TO BACK 160 PSF
F1.30	WOOD FOUNDATION NOTES SCHED FOR BLDG W/ 160 PSF
F1.31	WOOD FOUNDATION PLAN 24x40 BLDG W/ 160 PSF
F1.32	WOOD FOUNDATION PLAN 36x40 BLDG W/ 160 PSF
F1.33	WOOD FOUNDATION PLAN 48x40 BLDG W/ 160 PSF
F1.34	MOULINE "B" W/ EXTERIOR WALL BACK TO BACK 160 PSF
F1.40	WOOD FOUNDATION DETAILS
F2.10	CONCRETE FOUNDATION PLAN
F2.20	CONCRETE FOUNDATION DETAILS
F2.22	CONCRETE FOUNDATION DETAILS
F2.23	CONCRETE FOUNDATION DETAILS
Structural	
S0.1	STRUCTURAL GEN NOTES
S1.0.4	WD SHITG FLR FRWG PLAN (50+1 5 PSF)
S1.1.1	CONC FLR FRWG PLAN (50+15 PSF)
S1.1.3	CONC FLR FRWG PLAN (160 PSF)
S1.2	STRUCTURAL DETAILS (FLOOR)
S3.0.1	MONO SLOPE ROOF FRMG PLAN
S3.0.2	DUAL SLOPE ROOF FRMG PLAN
S3.0.3	MONO SLOPE ROOF FRMG PLAN CROSS-STRAP OPT.
S3.0.4	DUAL SLOPE ROOF FRMG PLAN CROSS-STRAP OPT.
S3.1	STRUCTURAL DETAILS (ROOF)
S3.2	ROOF DETAILS (SOFFIT/ PARAPET)
S3.3	ROOF PERIMETER TRUSS
S4.1	WD WALL FRAMING ELEVATIONS
S4.2	WALL DETAILS (WOOD FRAMING)
S4.4	TYP FRAMING
S4.5	FRAMING SCHEDULES
S5.0	LONG. SECTION - (MONO)
S5.1	LONG SECTION - (DUAL)
S6.0	AWNING FRAMING

ARCHITECTURAL

⑥ General Architectural Sheets 1/4" = 1'-0" GENERAL ARCHITECTURAL SHEETS															Sheet		
COVER SHEET															A0.0		
PROJECT OPTIONS SCHEDULE															A0.0.1		
TYPICAL KEY PLAN AND SCHEDULE, GEN NOTES															A0.1		
SIGNAGE AND SYMBOLS															A0.2		
DSA-103 T&I CONCRETE FLOORS															A0.3		
DSA-103 T&I PLYWOOD FLOORS															A0.4		
CALGREEN SPEC'S															A0.5		
CALGREEN SHEET															A0.6		
CALGREEN SHEET															A0.7		
CALGREEN SHEET															A0.8		
⑤ Floor Plan Details 1/4" = 1'-0" ARCHITECTURAL FLOOR PLANS															Sheet		
✕ Floor Plans		<input type="checkbox"/> Floor Plan - 24'x40'													A1.0		
		✕ Floor Plan - 36'x40'													A1.1		
		<input type="checkbox"/> Floor Plan - 48'x40'													A1.2		
① Arch Floor Framing Details 1/4" = 1'-0" ARCHITECTURAL FLOOR FRAMING DETAILS																	
✕ Wood Floor <input type="checkbox"/> Concrete Floor										1	2	3	4	5	6	Sheet	
										7	8	9	10	11	12	A2.9	
② Wall Schedule 1/4" = 1'-0" ARCHITECTURAL WALL DETAILS																	
Wood Studs		Detail													Sheet		
		Door	ML	Window	Corner	HVAC	Top	PLT6"	SEP	1-HR OPT 1	1-HR OPT 2	EXT HDR	INT HDR				
✕ Sheating		8	9	2	3	4	5	11	1	16	17	5	x	x	10A	10B	A2.1(A)
✕ Sheating		8	9	2	3	4	5	11	1	16	17	5	x	x	10A	10B	A2.1(B)
□ Plaster		8	9	3	4	5	11	1	16	17	5	x	x	10A	10B		A2.2
✕ 1-HR Sheating		8	9	2	3	4	5	11	1	16	17	5	-	-	10A	-	A2.5(A)
✕ 1-HR Sheating		8	9	2	3	4	5	11	1	16	17	5	-	-	10A	-	A2.5(B)
□ 1-HR Plaster		8	9	2	3	4	5	11	1	16	17	4	-	-	10A	-	A2.6
✕ Additional Fire Rating Details and Notes															A3.0		
✕ Single OCC. Bathroom															A3.1		
✕ Single OCC. Bathroom															A3.1.1		

④ Ceiling Plans 1/4" = 1'-0"		ARCHITECTURAL CEILING PLANS				Sheet
Reflected Ceiling Plans:	<input type="checkbox"/> 24' x 40'	<input type="checkbox"/> 8 (2'x4') Recessed Light Fixture <input type="checkbox"/> 12 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light				A3.2
	<input checked="" type="checkbox"/> 36' x 40'	<input type="checkbox"/> 12 (2'x4') Recessed Light Fixture <input checked="" type="checkbox"/> 16 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light				A3.2
	<input type="checkbox"/> 48' x 40'	<input type="checkbox"/> 16 (2'x4') Recessed Light Fixture <input type="checkbox"/> 18 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light				A3.2
						A3.2
Ceiling Notes						A3.2.1
③ Ceiling Details 1/4" = 1'-0"						
ARCHITECTURAL CEILING DETAILS						
Ceiling Framing				Detail		Sheet
<input checked="" type="checkbox"/> T-GRID				SEE PLAN	SEE PLAN	A3.3
<input type="checkbox"/> Wood				1	2	A3.4
					5	Typ
⑦ Roof Plans 1/4" = 1'-0"		ARCHITECTURAL ROOF PLANS				
<input checked="" type="checkbox"/> Mono		<input type="checkbox"/> EPDM <input checked="" type="checkbox"/> Standing Seam <input type="checkbox"/> Parapet				Sheet A4.2.1 A4.0.1 A4.4.1
<input type="checkbox"/> Dual		<input type="checkbox"/> EPDM <input type="checkbox"/> Standing Seam				A4.2.2 A4.0.2
②② Roof Details 1/4" = 1'-0"		ARCHITECTURAL ROOF DETAILS				
<input checked="" type="checkbox"/> Mono		<input type="checkbox"/> EPDM <input checked="" type="checkbox"/> Standing Seam <input type="checkbox"/> Parapet				Sheet A4.3 A4.1 A4.5
<input type="checkbox"/> Dual		<input type="checkbox"/> EPDM <input type="checkbox"/> Standing Seam				A4.3 A4.1
⑧ Arch Building Section 1/4" = 1'-0"		ARCHITECTURAL BUILDING SECTION				
<input checked="" type="checkbox"/> Mono		<input type="checkbox"/> EPDM <input checked="" type="checkbox"/> Standing Seam				Sheet A6.3 A6.0
<input type="checkbox"/> Dual		<input type="checkbox"/> EPDM <input type="checkbox"/> Standing Seam				A6.1 A6.0.1
Section						A6.2

ARCHITECTURAL

13	Exterior Elevations 1/4" = 1'-0"		ARCHITECTURAL EXTERIOR ELEVATIONS						
			Detail		Sheet	Detail		Sheet	
	Exterior Elevations:	□ 24'x40'	Left	Right			Front	Rear	
		□ Mono Slope	1	2	A5.0		1	2	A5.1
		□ Parapet Roof - Mono Slope	3	4	A5.0		3	4	A5.1
		□ Dual Slope	5	6	A5.0		1	2	A5.1
		✕ 36'x40'							
		✕ Mono Slope	1	2	A5.0		5	6	A5.1
		□ Parapet Roof - Mono Slope	3	4	A5.0		7	8	A5.1
		□ Dual Slope	5	6	A5.0		5	6	A5.1
		□ 48'x40'- 120'X40'							
	□ Mono Slope	1	2	A5.0		9	10	A5.1	
	□ Parapet Roof - Mono Slope	3	4	A5.0		11	12	A5.1	
	□ Dual Slope	5	6	A5.0		9	10	A5.1	
14	Interior Elevations 1/4" = 1'-0"		ARCHITECTURAL INTERIOR ELEVATIONS						
			Detail				Sheet		
Interior Elevations:		Left	Right	Front	Rear				
	□ 24'x40'	1	2	3	4	A5.2			
	✕ 36'x40'	1	2	5	6	A5.2			
	□ 48'x40'- 120'X40'	1	2	8	7	A5.2			
23	ADDITIONAL OPTIONS DETAILS 1/4" = 1'-0"		ADDITIONAL OPTIONS DETAILS						
			Sheet						
	ADDITIONAL OPTIONS DETAILS						A7.0		
	ADDITIONAL OPTIONS DETAILS						A7.1		
	ADDITIONAL OPTIONS DETAILS						A7.2		

MEP

<div><div>9</div><div>Plumbing 1/4" = 1'-0"</div></div>		PLUMBING		Sheet	
✕ Plumbing Details and Schedules				P1.0	
<div><div>10</div><div>Mechanical 1/4" = 1'-0"</div></div>		MECHANICAL		Sheet	
MISCELLANEOUS NOTES & DETAILS			M0.1		
Mechanical Plans:	□ 24' x 40'	□ Wall Mount	Ceiling Plan	Roof Plan	
		□ Roof Mount	M5.1	M5.2	
	✕ 36' x 40'	✕ Wall Mount	M5.1	M5.2	
		□ Roof Mount	M6.1	M6.2	
	□ 48' x 40'	□ Wall Mount	M6.1	M6.2	
		□ Roof Mount	M7.1	M7.2	
	□ 60' x 40'	□ Wall Mount	M7.1	M7.2	
		□ Roof Mount	A0.1		
	□ 72' x 40'	□ Wall Mount			
		□ Roof Mount			
	□ 84' x 40'	□ Wall Mount			
		□ Roof Mount			
□ 96' x 40'	□ Wall Mount				
	□ Roof Mount				
□ 108' x 40'	□ Wall Mount				
	□ Roof Mount				
□ 120' x 40'	□ Wall Mount				
	□ Roof Mount				

(1) Electrical 1/4" = 1'-0"	ELECTRICAL		Sheet	
Reflected Ceiling Plans:	□ 24' x 40'	□ 8 (2'x4') Recessed Light Fixture □ 12 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light	E1.0	E1.1
	✕ 36' x 40'	□ 12 (2'x4') Recessed Light Fixture □ 18 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light		
	□ 48' x 40'	□ 16 (2'x4') Recessed Light Fixture □ 24 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light	E1.2	E1.3
	□ 60' x 40'	□ 20 (2'x4') Recessed Light Fixture □ 30 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light	E1.4	E1.5
	□ 72' x 40'	□ 24 (2'x4') Recessed Light Fixture □ 36 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light		
	□ 84' x 40'	□ 28 (2'x4') Recessed Light Fixture □ 42 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light		
	□ 96' x 40'	□ 32 (2'x4') Recessed Light Fixture □ 48 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light		
	□ 108' x 40'	□ 36 (2'x4') Recessed Light Fixture □ 54 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light		
	□ 120' x 40'	□ 40 (2'x4') Recessed Light Fixture □ 60 (1'x8') Pendant Light w/ 4 (1'x16') Recessed Light		

STRUCTURAL

(15) Foundations Plans 1/4" = 1'-0"		FOUNDATION		
x Wood Foundation Plan:	Wood Foundation NOTES SCHED FOR BLDG W/ 50+15			Sheet
	□ 24'x40' (50+15 PSF)			F1.10
	□ 24'x40' (100 PSF)			F1.11
	□ 24'x40' (150 PSF)			F1.21
				F1.31
	x 36'x40' (50+15 PSF)			F1.12
	□ 36'x40' (100 PSF)			F1.22
	□ 36'x40' (150 PSF)			F1.32
	□ 48'x40' (50+15 PSF)			F1.13
	□ 48'x40' (100 PSF)			F1.23
	□ 48'x40' (150 PSF)			F1.33
Wood Foundation Details			F1.40	
x Concrete Foundation Plan				F2.10
x Concrete Above Grade Foundation Details				F2.20
x Concrete Below Grade Foundation Details				F2.22
				F2.23
(16) General Structural Sheets 1/4" = 1'-0"		GENERAL STRUCTURAL SHEETS		Sheet
STRUCTURAL GEN NOTES				S0.1
(17) Floor Framing Plans 1/4" = 1'-0"		STRUCTURAL FLOOR FRAMING PLANS		
x Wood Sheathing Floor:	x (50+15 PSF)			Sheet
	□ (100 PSF)			S1.01
	□ (150 PSF)			S1.02
				S1.03
□ Concrete Framing Floor:	□ (50+15 PSF)			S1.1.1
	□ (100 PSF)			S1.1.2
	□ (150 PSF)			S1.1.3
(19) Floor Framing Details 1/4" = 1'-0"		STRUCTURAL FLOOR FRAMING DETAILS		Sheet
x Wood Framing				S1.2
□ Concrete Framing				S1.2
(18) Roof Framing Plans 1/4" = 1'-0"		STRUCTURAL ROOF FRAMING PLANS		Sheet
x Mono Slope Roof Framing				S3.0.1
□ Dual Slope Roof Framing				S3.0.2
STRUCTURAL DETAILS ROOF				Sheet
STRUCTURAL DETAILS				S3.1
ROOF DETAILS(SOFFIT/ PARRAPET)				S3.2
ROOF PERIMETER TRUSS				S3.3
(20) Wall Framing Details 1/4" = 1'-0"		STRUCTURAL WALL FRAMING DETAILS		
x Wood:				Sheet
x Framing Elevation				S4.1
x Wall Details				S4.2
□ Typ Framing:				S4.4
□ Framing Schedule:				S4.5


<div> <div>21</div> <div>Building Section</div> <div>1/4" = 1'-0"</div> </div>	STRUCTURAL BUILDING SECTION	Sheet
<input checked="" type="checkbox"/> Mono		S5.0
<input type="checkbox"/> Dual		S5.1

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-12-2020 INC:
REVIEWED FOR
SS ☒ PLS ☒ ACS ☒
DATE: 1/7/2024



PROFESSIONAL STAMP

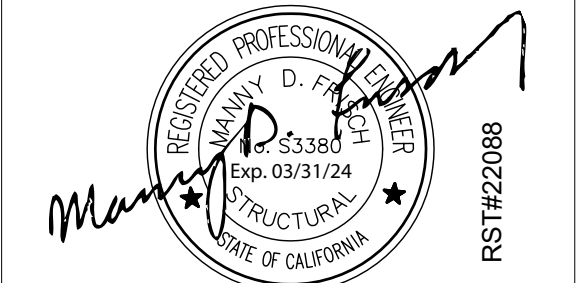


02/16/24

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



~~ORIGINAL PC STATE AGENCY APPROVAL~~

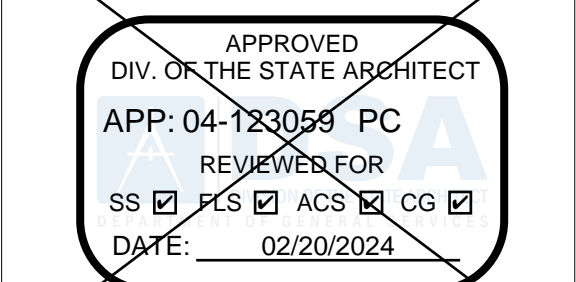

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT

CODE: 2019 CBC

A separate project application for construction is required

PROJECT TITLE	PC 2022 CBC: 24' x 40' EXPANDABLE TO 120' x 40'
---------------	---

SHEET TITLE
**PROJECT OPTIONS
SCHEDULE**

PROJECT NUMBER

22088

DRAWN BY
rMc/SC

CHECKED BY	RH/RT
------------	-------


DATE	06/15/2021
------	------------

SHEET NO.

A0.0.1

C:\Users\User\Documents\20033 - Aries, 24x40 PC - MainFile - Low Seismic_6.7_CESAR24D63.rvt
6/15/2021 11:49:02 PM

Door Schedule							
Mark	Type	Width	Height	Door Material	Frame Type	Wall Thickness	Hardware
1	D1	3' - 0"	7' - 0"	18GA Hollow Metal	Knock Down	5 1/4"	HW1
2	D	3' - 0"	7' - 0"	18GA Hollow Metal	Knock Down	5 1/4"	HW2
3	D	3' - 0"	7' - 0"	Solid Core Wood Legacy	Knock Down	5 1/2"	HW3

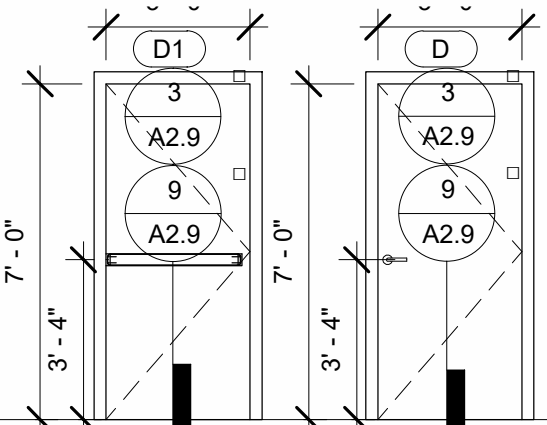


- ALL DOORS SHALL COMPLY WITH CBC SECTION 11B-404 AND BE 1 3/4" THK (UNO)
- CENTER ALL DOOR LEVERS FOR ACCESS AND LOCKING @ 40" ABOVE FINISH FLOOR. ALL HARDWARE SHALL OPEN FROM THE INTERIOR AND NOT REQUIRE ANY SPECIFIC KNOWLEDGE OF THE HARDWARE OR REQUIRE ANY SPECIAL EFFORT FOR EGRESS. THE LEVER OF LEVER-ACTUATED LEVERS OR LOCKS SHALL BE CURVED WITH A RETURN TO WITHIN 1/2" OF THE FACE OF THE DOOR TO PREVENT CATCHING ON THE CLOTHING (etc.) OF PERSONS DURING EGRESS. THE LEVER OF LEVER-ACTUATED LEVERS OR LOCKS SHALL EXTEND AT A MINIMUM OF ONE-HALF THE DOOR WIDTH.
- PER CBC 1010.1.10 FOR ANY ROOM CONFIGURATION WHICH PROVIDES AN OCCUPANT LOAD OF 50 OR GREATER SHALL NOT BE PROVIDED WITH A LATCH OR LOCK UNLESS IT IS PANIC HARDWARE OR FIRE EXIT HARDWARE AND COMPLY WITH ALL REQUIREMENTS OF SECTION 11B-309 OF THE CBC. ALL HARDWARE SHALL COMPLY WITH HARDWARE SCHEDULE THIS SHEET.
- PER CBC 11B-309.4 THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 POUNDS (22.2 N) MAX.
- PER CBC 11B-404.2.8.2 DOOR SPRING HINGES SHALL BE ADJUSTED SO THAT FROM THE OPEN POSITION OF 70 DEGREES, THE DOOR SHALL MOVE TO THE CLOSE POSITION IN 1.5 SECONDS MINIMUM. ALL CLOSER MUST COMPLY WITH CBC 11B-404.2.8.1 - DOOR CLOSER AND GATE CLOSERS SHALL BE ADJUSTED SO THAT FROM AN OPEN POSITION OF 90 DEGREES, THE TIME REQUIRED TO MOVE THE DOOR TO A POSITION OF 12 DEGREES FROM THE LATCH IS 5 SECONDS OR LESS.
- THE MAXIMUM AREA OF EXTERIOR WALL OPENING PER CBC TABLE 705.8 AND THE FIRE PROTECTION FOR EXTERIOR WALL PER CBC TABLE 602. ALL FIRE PROTECTION BASED ON THE FIRE SEPARATION DISTANCE.
- DOOR LOCATION MAY VARY BASED ON PROJECT REQUIREMENTS.
- (PH) ON PLANS THE SHEET INDICATES REQUIRED PANIC HARDWARE.
- PROVIDE EXIT SIGNS AS REQUIRED PER CBC SECTION 1013.4. SEE DETAILS PER A0.2
- ALL EXIT DOORS SHALL BE OPENABLE FROM INSIDE W/O ANY USE OF SPECIAL TOOLS, KNOWLEDGE OR EFFORT.

9 Doors

Window Schedule						
Mark	Type	Height x Width	Function	Type Comments	Glazing	Source
A	W1	4'-0" x 8'-0"	XOX	Clear Anodized Alum. Frame	*DP	Manufacturer
B	W2	4'-0" x 4'-0"	XO	Clear Anodized Alum. Frame	*DP	Manufacturer
C	W3	21ø		SOLAR TUBE		Manufacturer
D	W4	21ø		SOLAR TUBE		Manufacturer


NFRC LABELS SHALL STAY ON THE FENESTRATION PRODUCTS UNTIL THE INSPECTOR HAS VERIFIED THAT THE INSTALLED U-FACTOR, SHGC, AND VT MATCH THE WINDOW SCHEDULE

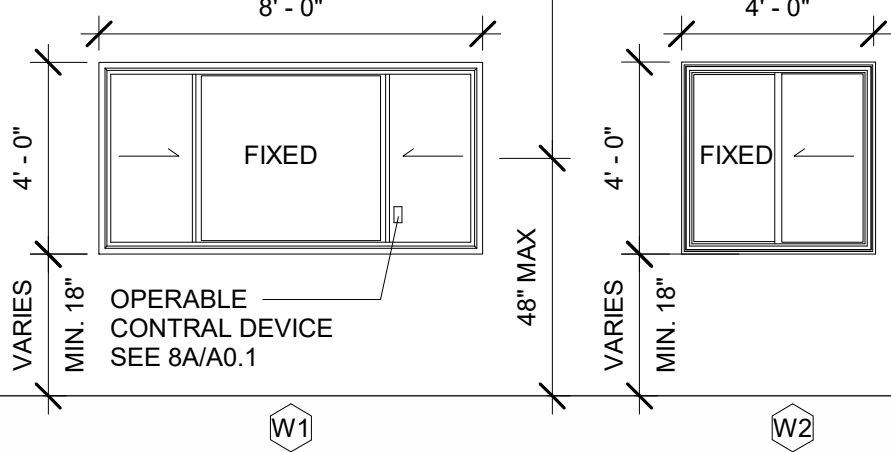


WINDOW LOCATION MAY VARY BASED ON PROJECT REQUIREMENTS. SAFETY GLAZING MUST BE APPROPRIATELY MARKED AND IDENTIFIED. WINDOW - 3/4" INSULATING GLASS UNIT PERFORMANCE U-VALUE : 0.35 SHGC : 0.24 VT : 0.5

ABBREVIATIONS:
DP - DUAL PANE
T - TEMPERED GLASS

NEW BUILDINGS THAT ARE INCLUDED IN PUBLIC SCHOOLS (KINDERGARTEN THROUGH 12TH GRADE) SHALL INCLUDE LOCKS THAT ALLOW DOORS TO CLASSROOMS AND ANY ROOM WITH AN OCCUPANCY OF FIVE OR MORE PERSONS TO BE LOCKED FROM THE INSIDE. THE LOCKS SHALL CONFORM TO THE SPECIFICATION AND REQUIREMENTS FOUND IN SECTION 1010.1.9 Education Code 17075.50.

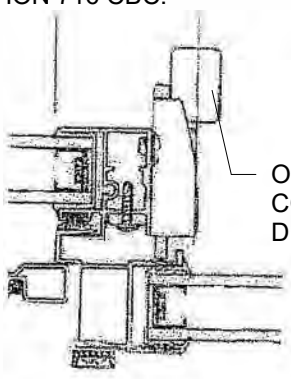

8 Windows

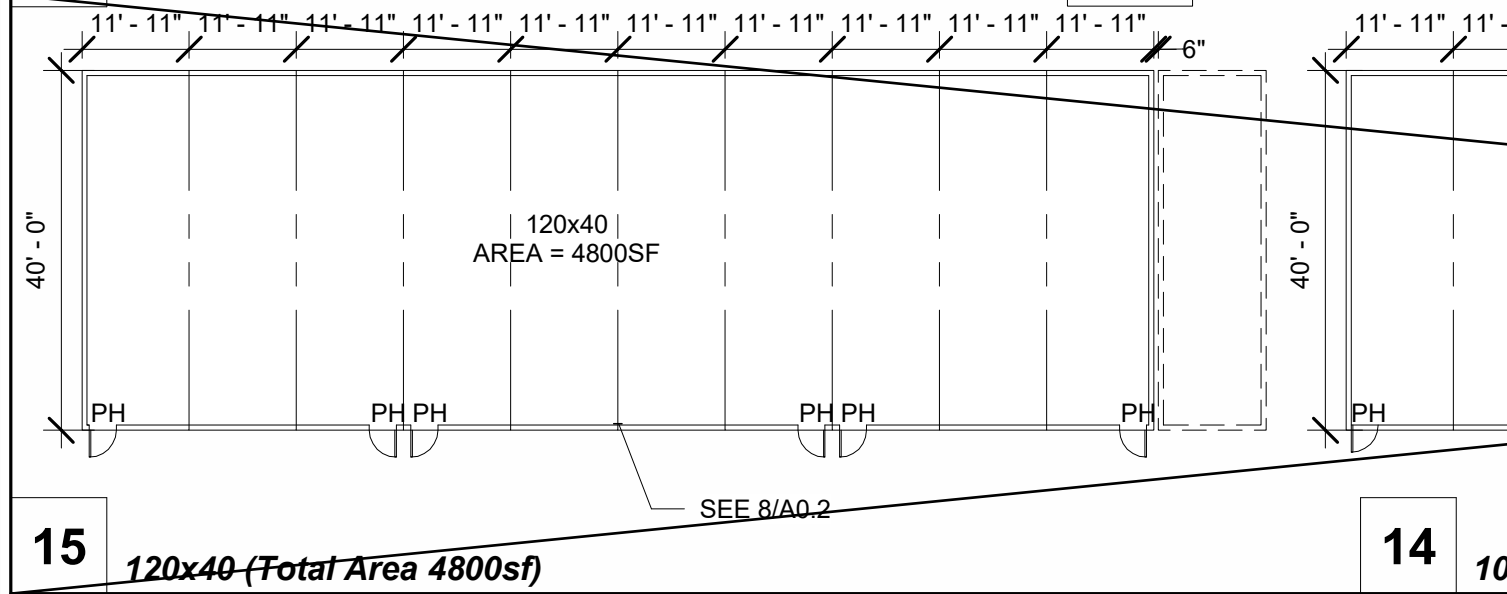

- PLACE (2) PERMANENT METAL IDENTIFICATION LABELS ON EACH MODULE. CLIMATE ZONE DATA INCLUDED ON LABEL
(1) LABEL AT REAR EXTERIOR
(1) LABEL ABOVE CEILING LINE AT INTERIOR FRAME.
LABELS WILL BE MECHANICALLY FASTENED AND SHOW THE DSA APPLICATION NUMBER, MANUFACTURERS NAME AND SERIAL NUMBER, DESIGN LIVE LOAD FOR ROOF AND FLOOR FRAMING, WIND SPEED, EXPOSURE CATEGORY, AND Kz1 = 1.0 PER 2022 CBC
- VINYL TACKBOARD TO HAVE A CLASS 1 FLAME SPREAD RATING AND COMPLY WITH A SMOKE DENSITY OF 175
- VERIFIED ALL DIMENSIONS PRIOR TO CONSTRUCTION
- SEE INTERIOR ELEVATIONS FOR ALL REQUIRED EGRESS SIGNAGE AND FIRE ALARM SYSTEM COMPONENTS
- WHEN RELOCATING OR REMOVING INTERIOR PARTITIONS (2) EXITS OR EXIT ACCESS DOORWAYS FROM ANY SPACE SHALL BE PROVIDED. EXIT DOORS MUST BE SEPERATED BY A DISTANCE APART EQUAL TO OR NOT LESS THAN ONE-HALF OF THE MAXIMUM OVERALL DIAGONAL DIMENSION FOR ALL NONSPRINKLERED BUILDINGS. EXIT DOORS MUST BE SEPERATED BY A DISTANCE APART EQUAL TO OR NOT LESS THAN ONE-THIRD OF THE MAXIMUM OVERALL DIAGONAL DIMENSION FOR ALL SPRINKLERED BUILDINGS. ALL EXIT AND EXIT ACCESS DOORWAYS MUST COMPLY WITH CBC SECTION 1015 EXIT AND EXIT ACCESS DOORWAYS AND CBC SECTION 1016 EXIT ACCESS TRAVEL DISTANCE.
- OCCUPANCY LOAD SIGNS SHALL BE POSTING AND COMPLY WITH CBC SECTION 1004.3
- SEE ADDITIONAL PC FOR ACCESS RAMPS AND STAIRS. WHERE RAMP IS AGAINST THE WALL AT PLASTER EXTERIOR OR ADJACENT TO ANY ABRASIVE SURFACE THEN A SMOOTH TROWEL SURFACE MUST BE PROVIDED AT THESE LOCATIONS OR AN ALTERNATIVE APPLICATION THAT COMPLIES WITH CBC SECTION 11B-505.8
- ALL SURFACES ADJACENT TO HANDRAILS SHALL NOT HAVE ANY SHARP, ABRASIVE, OR PROTRUDING COMPONENTS
- HANDRAIL GRIPPING SURFACES AND ANY SURFACES ADJACENT TO THEM SHALL BE FREE OF SHARP OR ABRASIVE ELEMENTS AND SHALL HAVE ROUNDED EDGES. PER 11B-505.8
- FOR PLASTER WALLS PROVIDE CONTROL JOINTS AT ALL MODLINES, ENDWALLS @ 2'-0" FROM EDGE, 10'-0" o/c @ SIDEWALLS, AND ABOVE AND BELOW ALL OPENING. SEE EXTERIOR ELEVATIONS. ALL MATERIALS, MEANS, METHODS, AND PROCEDURES OF CONSTRUCTION USED TO PROTECT JOINTS SHALL COMPLY WITH FIRE RATED WALL ASSEMBLY PER CBC SECTION 703.2 - FIRE RESISTANCE RATING AND CBC SECTION 705 - EXTERIOR WALLS
- FOR HVAC UNITS WHICH HEIGHT FROM GRADE TO BOTTOM OF UNIT EXCEEDS 27" AND LOCATED IN PEDESTRIAN PATH OF TRAVEL, A PROTECTION RAIL AROUND THE HVAC UNIT WILL BE PROVIDED. PER MNF INSTALLATION INSTRUCTIONS. SEE 4/A7.2 OR 5/A7.2.

2

A0.1 GENERAL NOTES

MOISTURE PROTECTION INSULATION:

MATERIAL:
INSULATING MATERIAL FOR WALLS, CEILINGS, AND FLOORS SHALL BE FIBERGLASS BATTS (UNFACED) AND SHALL COMPLY WITH CBC 2022.
(CLASS A = 0-25 FLAME SPREAD;) SMOKE DEVELOPMENT DENSITY LESS THAN 450.

INSULATION VALUES

SEE TITLE 24 SHEETS FOR REQUIRED INSULATION VALUES PER CLIMATE ZONE

EXTERIOR WALL INSULATION (MIN.)

X R-19 (2x6 STUD) JOHNS MANSVILLE OR EQUAL

INTERIOR WALL INSULATION (MIN.)

X R-13

FLOOR INSULATION (MIN.)

X CONCRETE SLAB WITH R-19 FIBERGLASS INSULATION
PLYWOOD FLOOR WITH R-19 FIBERGLASS INSULATION

ROOF INSULATION (MIN.)


X R-36 (EPDM)
X R-36 CONTINUOUS R-X (STANDING SEAM)

SEE ALT-D1

3

Insulation Specs

EMERGENCY EXIT AND PANIC HARDWARE: INDICATE ON DRAWINGS AND SPECIFICATIONS COMPLIANCE WITH SFM STANDARD 12-10-3, SECTION 12-10-302. (a) THE CROSS BAR SHALL EXTEND ACROSS NOT LESS THAN ONE-HALF THE WIDTH OF THE DOOR/GATE. (d) THE ENDS OF THE CROS-BAR SHALL BE CURVED, GUARDED OR OTHERWISE DESIGNED TO PREVENT CATCHING ON THE CLOTHING OF PERSONS DURING EGRESS. **PROVIDE CUT-SHEETS OF PANIC HARDWARE** PROVIDE THE ASSEMBLY DESIGN NUMBER FOR ALL FIRE-RATED CONSTRUCTION COMPONENTS. INSTALLATION DETAILS MUST BE COORDINATED WITH THE DESIGN NUMBERS. CUSTOM DESIGNS WHICH COMBINE COMPONENTS FROM VARIOUS DESIGNS BUT HAVE NOT BEEN TESTED AS A LISTED ASSEMBLY WILL NOT BE ACCEPTABLE.

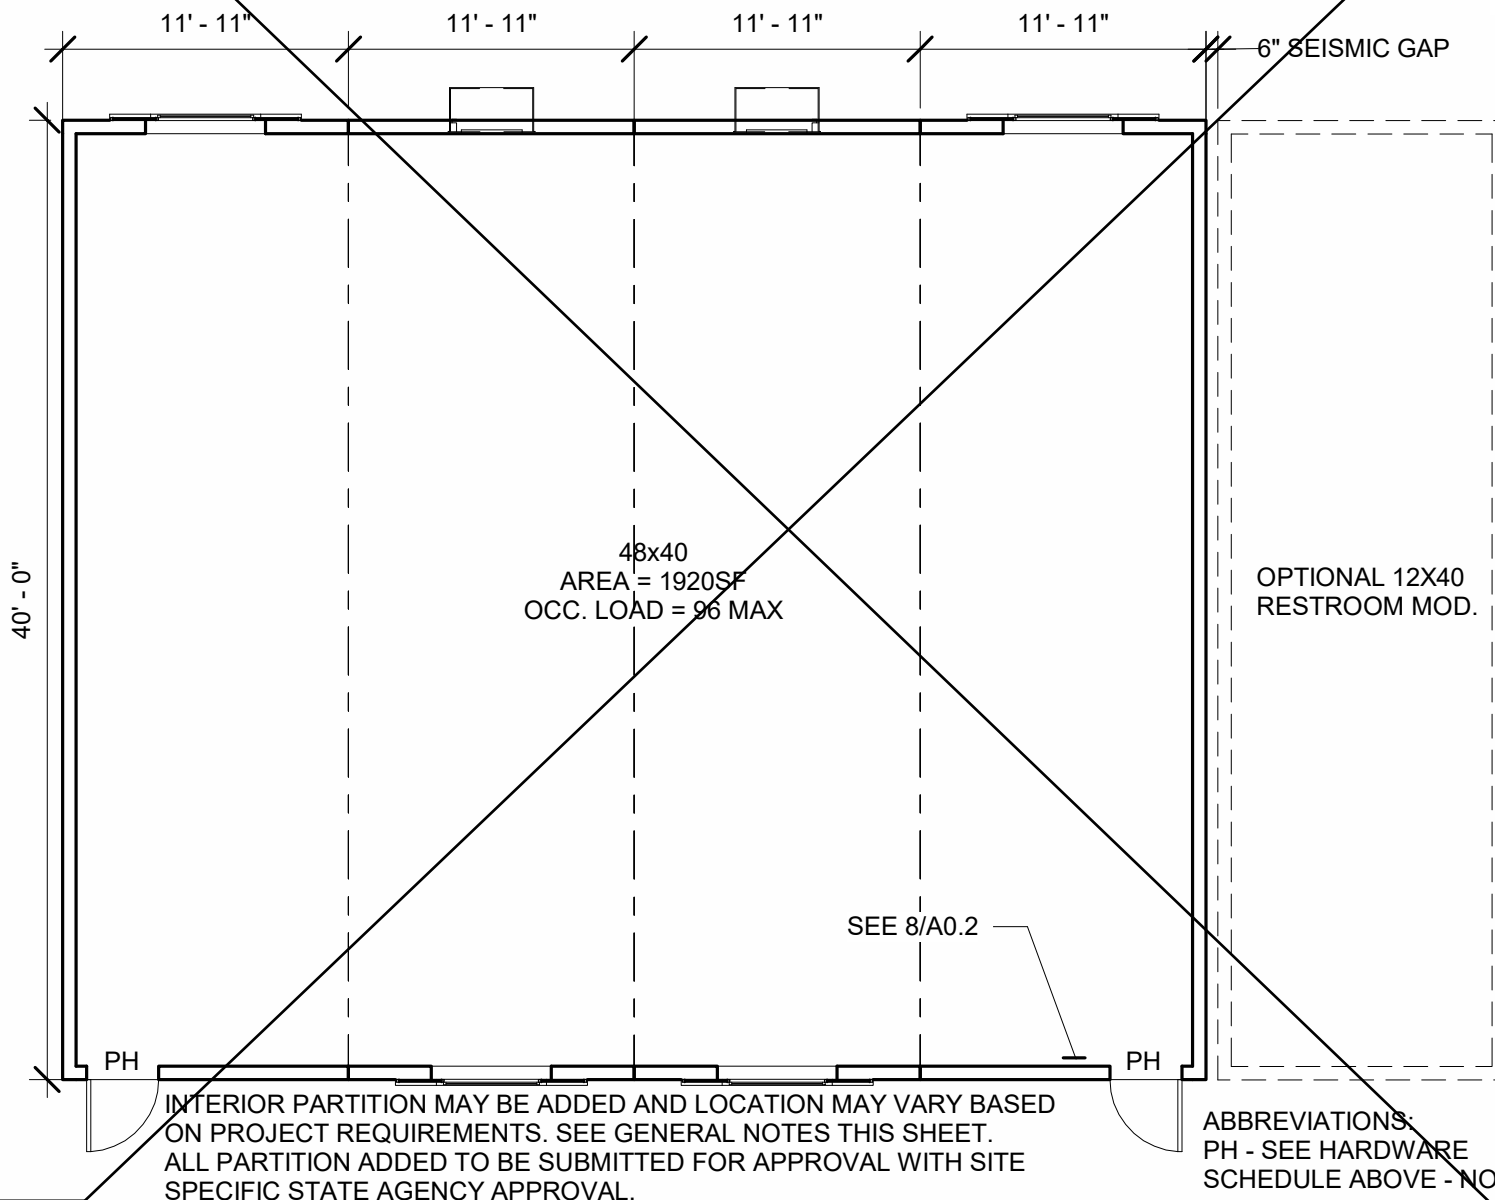

4

48x40 (Total Area 1920sf)

5 Finishes and Materials

Room Number		Flooring		Wall Finish				Ceiling		Notes
		Floor	Base	Front	Left	Rear	Right	Type	Ht.	
CLASSROOM	Carp.	4" TS	Tack	Tack	Tack	Tack	Tack	CP	8'-6"	
CLASSROOM w/ PH	Carp.	4" TS	Tack	Tack	Tack	Tack	Tack	CP	8'-6"	
SINGLE OCC.	SV	6" TS	FRP	FRP	FRP	FRP	FRP	CP	8'-0"	
SINGLE OCC.	SV	SC	FRP	FRP	FRP	FRP	FRP	GBP	8'-0"	

Abbreviations:

FLOORING:

CARP: COMPLYING WITH GROUP 1; TYPE "A" OR TYPE "B"; CLASS 2; DENSITY 4600; DIRECT GLUE DOWN

SV: SHEET VINYL FLOORING

VCT: VINYL COMPOSITION TILE

BASE

4" TS: 4" TOP SET BASE

6" TS: 6" TOP SET BASE

6" SC: SELF COVE

WALLS

TACK: 1/2" VINYL TACKBOARD CLASS 1 OVER 1/2" GYPSUM BOARD BACKING

FRP: 1/8" FIBER REINFORCED PANEL OVER 1/2" WATER RESISTANT GYPSUM BOARD

GYP: 1/2" GYPSUM BOARD; TAPE; TEXTURE; PAINTED FINISH

PLY: 1/2" PLYWOOD FINISH

NF: NO FINISH SC: 6" SELF-COVE BASE

CEILING

CP: ACOUSTICAL LAY IN GRID CEILING PANELS

HC: 5/8" GYPSUM BOARD; TAPE; TEXTURE; PAINTED FINISH


GBP: 1/2" GYPSUM BOARD WASHABLE PANELS (PAINTED)

Finishes Notes

- ALL FINISHES SHALL COMPLY WITH CBC, TITLE 19, AND C.F.C
- PER ASTM D2047 ALL FLOORING WITH A COEFFICIENT OF FRICTION OF A MINIMUM OF 0.6 WILL BE CONSIDERED TO OBTAIN THE INTENT OF A SLIP RESISTANCE SURFACE.
- FLOORING CONTRACTOR IS RESPONSIBLE FOR SUB-FLOORING PREPARATION. ALL PLYWOOD TO BE APA RATED AND COMPLY WITH PS-19. PLYWOOD SURFACE TO BE CARPETED IS TO BE PLUGGED AND SANDED BY FLOORING CONTRACTOR. ALL DEFORMITIES OCCURRING DUE TO STANDARD CONSTRUCTION PRACTICES SHALL BE PLUGGED AND SANDED BY FLOOR CONTRACTOR. MATELINE JOINTS TO BE A MAX OF 1/8" AND SHALL BE PLUGGED AND SANDED BY FLOORING CONTRACTORS.
- ALL CARPET AND FLOOR FINISH MUST COMPLY PER CBC SECTION 11B-302 FLOOR AND GROUND SURFACES. ALL CHANGES IN ELEVATION SHALL COMPLY WITH CBC SECTION 11B-303 CHANGES IN LEVELS

6

Finishes and Materials

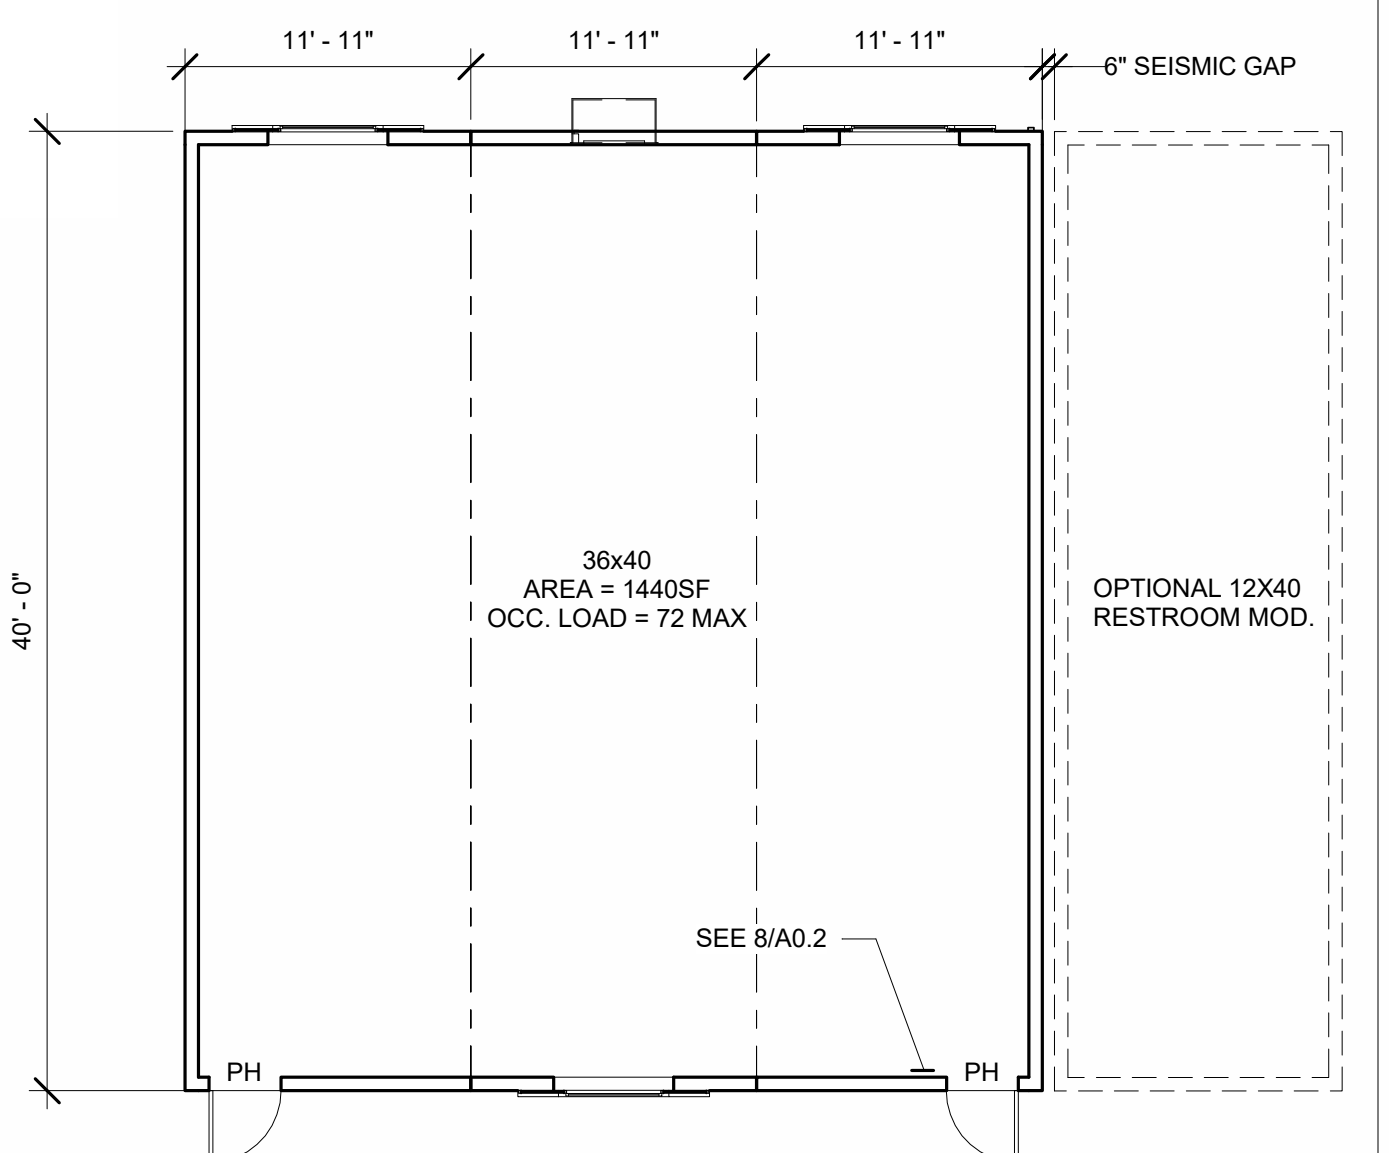


INTERIOR PARTITION MAY BE ADDED AND LOCATION MAY VARY BASED ON PROJECT REQUIREMENTS. SEE GENERAL NOTES THIS SHEET.
ALL PARTITION ADDED TO BE SUBMITTED FOR APPROVAL WITH SITE SPECIFIC STATE AGENCY APPROVAL.
ABBREVIATIONS:
PH - SEE HARDWARE SCHEDULE ABOVE - NO.2

7

36x40 (Total Area 1440sf)

7 Door Hardware

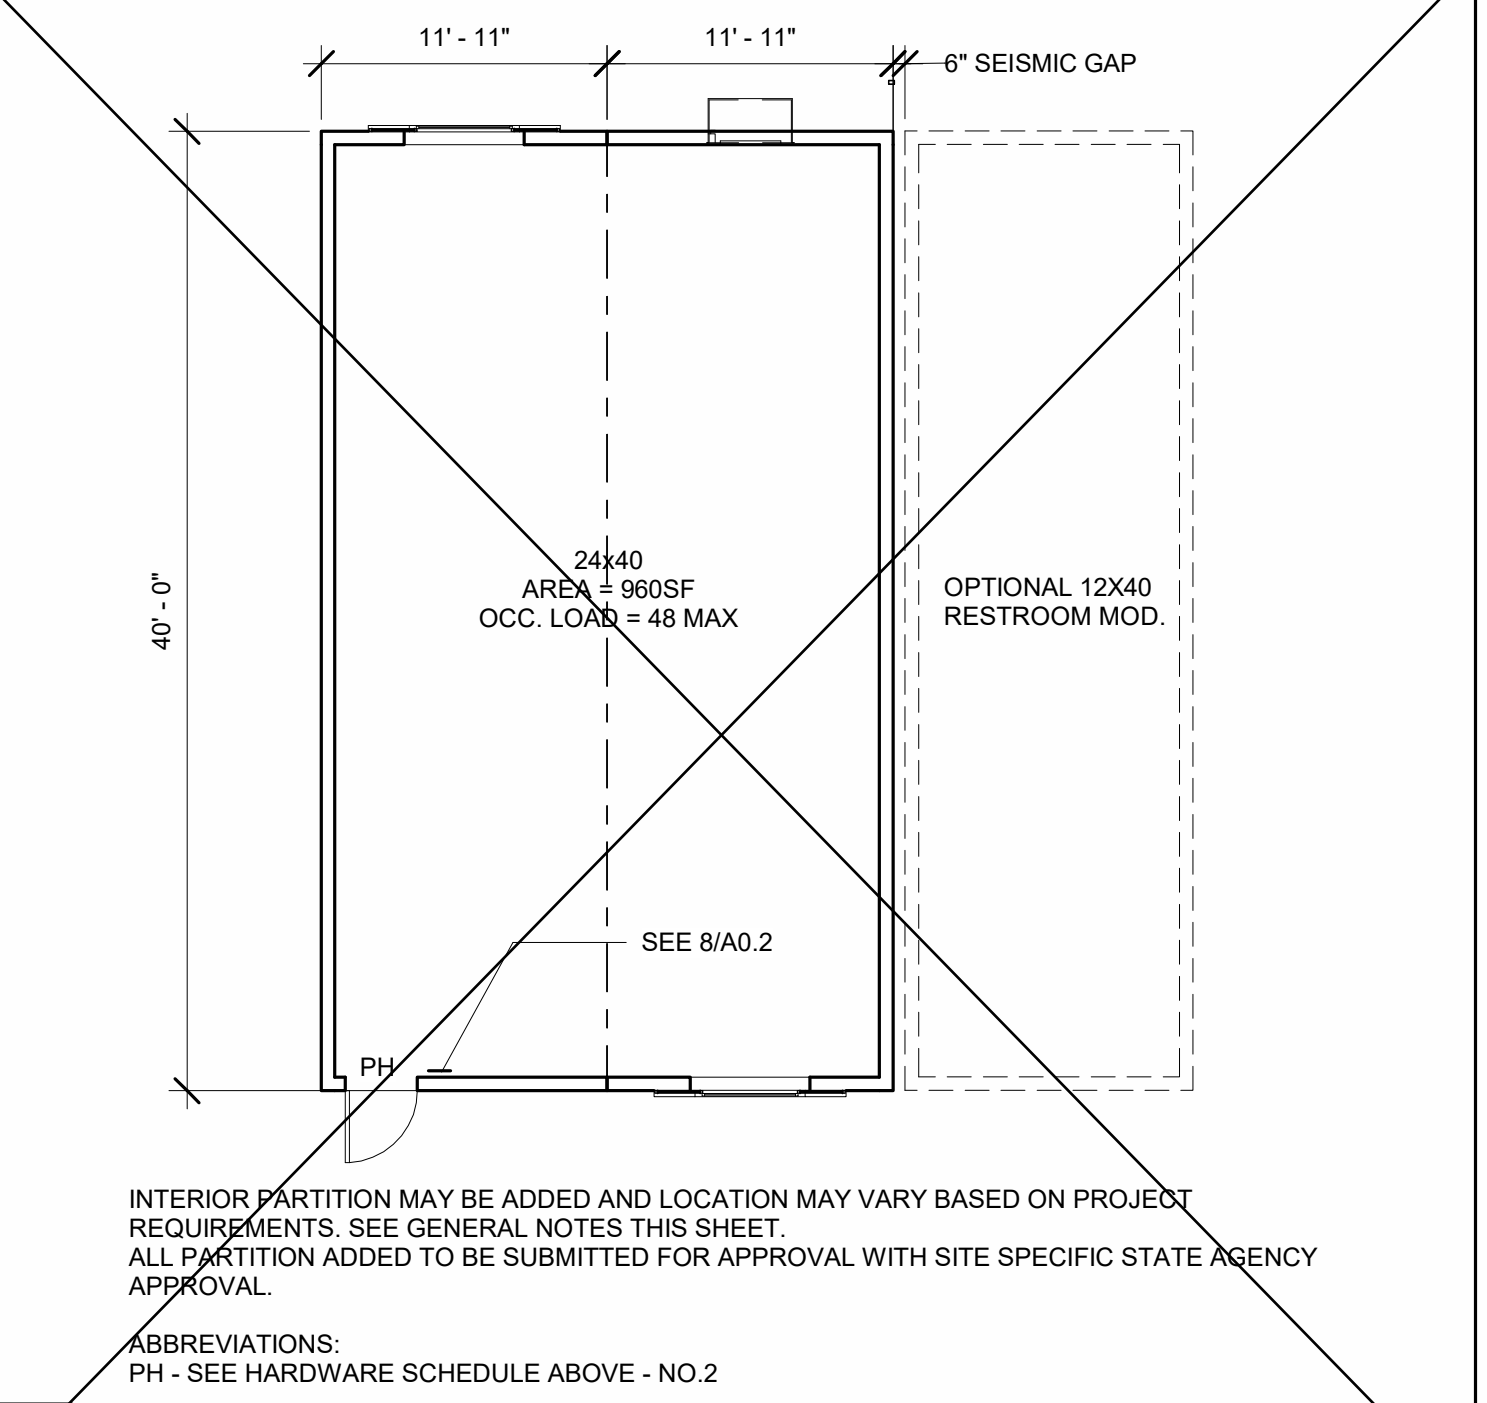

INTERIOR PARTITION MAY BE ADDED AND LOCATION MAY VARY BASED ON PROJECT REQUIREMENTS. SEE GENERAL NOTES THIS SHEET.
ALL PARTITION ADDED TO BE SUBMITTED FOR APPROVAL WITH SITE SPECIFIC STATE AGENCY APPROVAL.
ABBREVIATIONS:
PH - SEE HARDWARE SCHEDULE ABOVE - NO.2

8

24x40 (Total Area 960sf)

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-123058 PC
REVIEWED FOR
SS ☐ PLS ☒ ACS ☐
DATE: 02/20/2024

PROJECT TITLE
PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
TYPICAL KEY PLAN
AND SCHEDULES,
GEN NOTES,

PROJECT NUMBER
22088

DRAWN BY
rMc/SC

CHECKED BY
RH/RT

DATE

SHEET NO.
A0.1

SHEET OF

PROFESSIONAL STAMP

REGISTERED PROFESSIONAL ARCHITECT
MANNY D. FROST
13380
03/31/24
STATE OF CALIFORNIA
02/16/24
RST #22088


THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT
Class Leasing
1651 Junitia Street, San Jacinto, CA 92583
Voice (951) 943-1908 Fax (951) 943-5768

Revision Schedule		
#	Description	Date

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

5 1/4" = 1'-0" Sign Notes

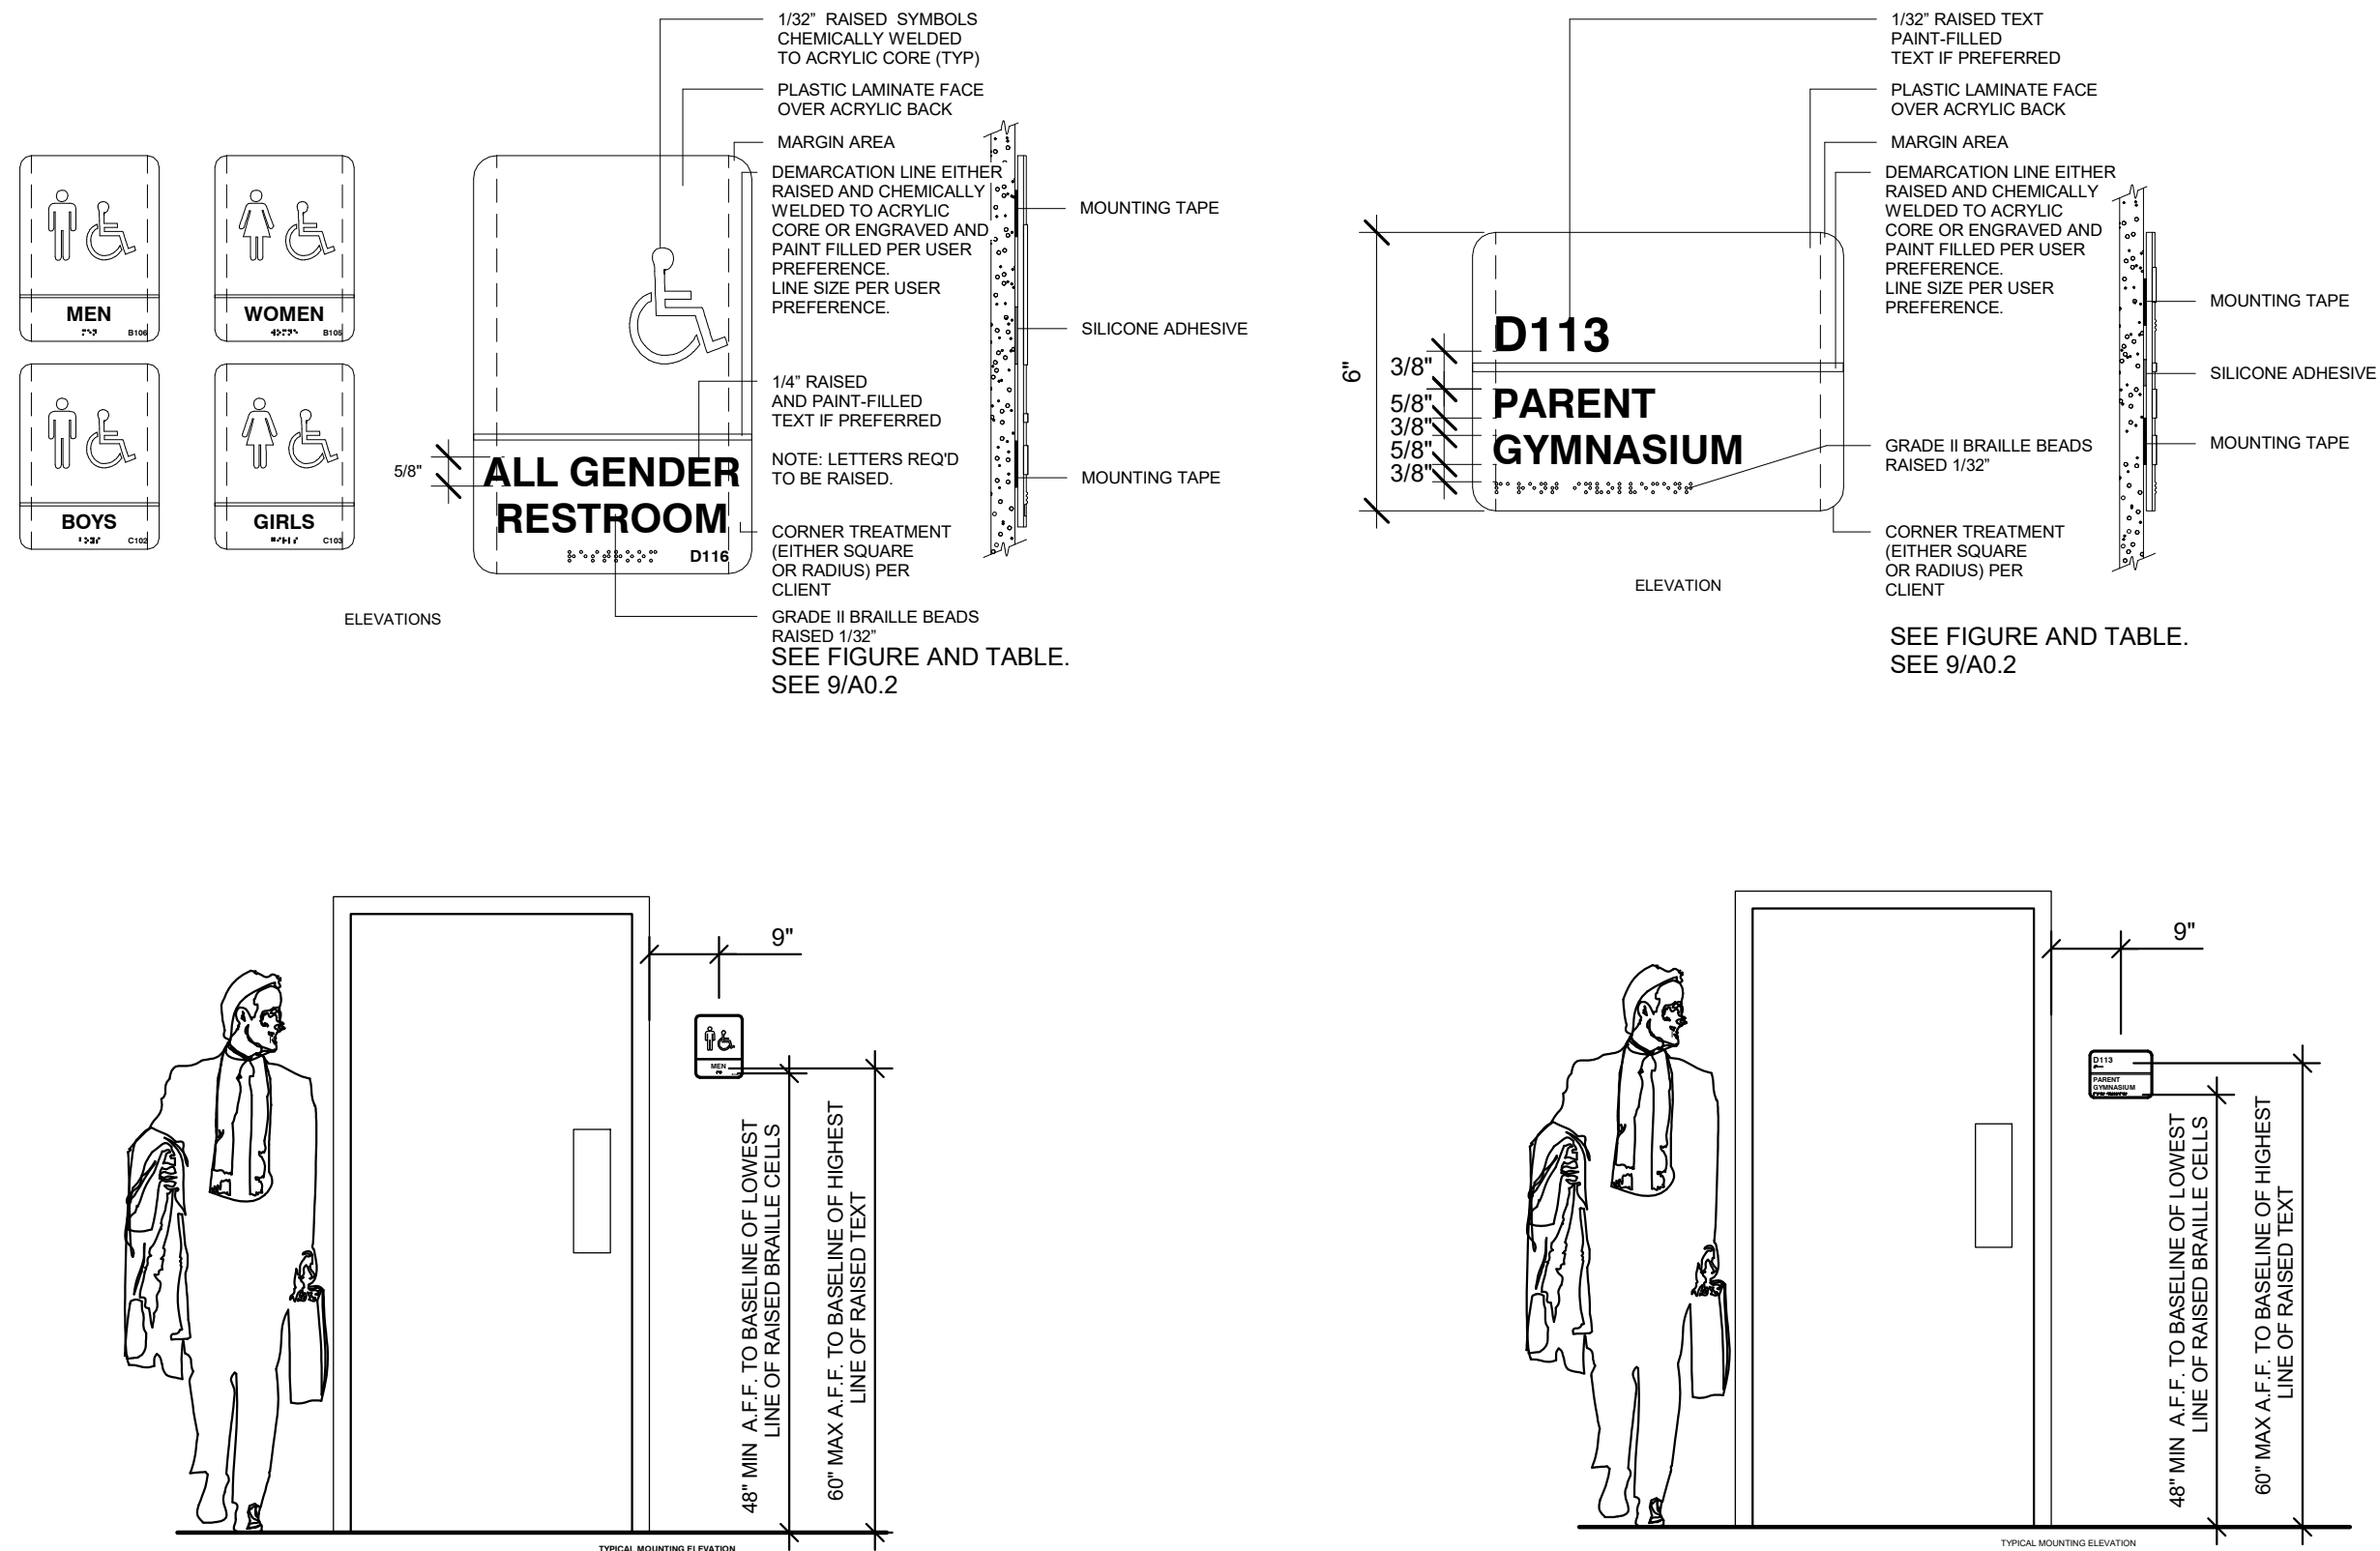

4 1/2" = 1'-0" Signage (OFOI - UNO)

11B.703.2.6 Stroke Thickness for raised characters. Stroke thickness of the uppercase letter "I" shall be 15 percent maximum of the height of the character.

11B.703.2.7 Character Spacing. Character spacing shall be measured between the two closest points of adjacent raised characters within a message, excluding word spaces. Where characters have rectangular cross sections, spacing between individual raised characters shall be 1/8 inch (3.2 mm) minimum and 4 times the raised character stroke width maximum. Where characters have other cross sections, spacing between individual raised characters shall be 1/16 inch (1.6 mm) minimum and 4 times the raised character stroke width maximum at the base of the cross sections, and 1/8 inch (3.2 mm) minimum and 4 times the raised character stroke width maximum at the top of the cross sections. Characters shall be separated from raised borders and decorative elements 3/8 inch (9.5 mm) minimum.

11B.703.2.8 Line Spacing. Spacing between the baselines of separate lines of raised characters within a message shall be 135 percent minimum and 170 percent maximum of the raised character height.

11B.703.3 Braille. Braille shall be contracted (Grade 2) and shall comply with 703.3 and 703.4.

11B.703.3.1 Dimensions and Capitalization. Braille dots shall have a domed or rounded shape and shall comply with Table 703.3.1. The indication of an uppercase letter or letters shall only be used before the first word of sentences, proper nouns and names, individual letters of the alphabet, initials, and acronyms.

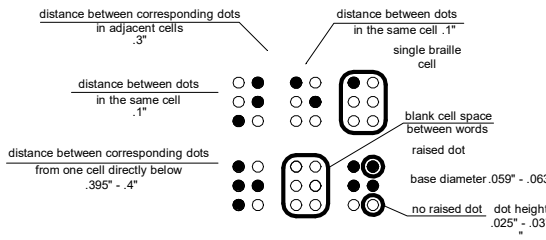


Figure 703.3.1 Braille Measurement

11B.703.3.2 Position. Braille shall be positioned below the corresponding text. If text is multi-lined, braille shall be placed below the entire text. Braille shall be separated 3/8 inch (9.5 mm) minimum from any other tactile characters and 3/8 inch (9.5 mm) minimum from raised borders and decorative elements.




Figure 703.3.2 Position of Braille

11B.703.4 Installation Height and Location. Signs with tactile characters shall comply with 703.4.

11B.703.4.1 Height Above Finish Floor or Ground. Tactile characters on signs shall be located 48 inches (1220 mm) minimum above the finish floor or ground surface, measured from the baseline of the lowest braille character and 60 inches (1525 mm) maximum above the finish floor or ground surface, measured from the baseline of the highest tactile character.

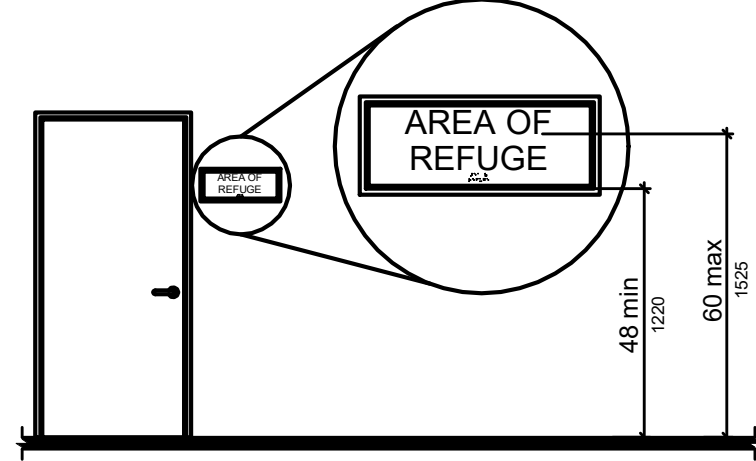


Figure 703.4.1 Height of Tactile Characters Above Finish Floor or Ground

11B.703.4.2 Location. Where a tactile sign is provided at a door, the sign shall be located alongside the door at the latch side. Where a tactile sign is provided at double doors with one active leaf, the sign shall be located on the inactive leaf. Where a tactile sign is provided at double doors with two active leaves, the sign shall be located to the right of the right hand door. Where there is no wall space at the latch side of a single door or at the right side of double doors, signs shall be located on the nearest adjacent wall. Signs containing tactile characters shall be located so that a clear floor space of 18 inches (455 mm) minimum by 18 inches (455 mm) minimum, centered on the tactile characters, is provided beyond the arc of any door swing between the closed position and 45 degree open position.

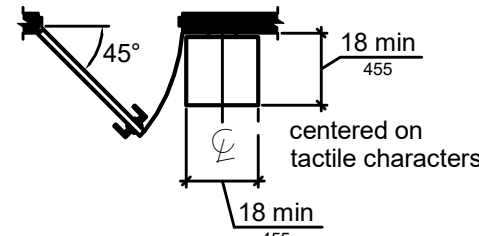


Figure 703.4.2 Location of Tactile Signs at Doors

11B.703.5 Visual Characters. Visual characters shall comply with 703.5.

11B.703.5.1 Finish and Contrast. Characters and their background shall have a non-glare finish. Characters shall contrast with their background with either light characters on a dark background or dark characters on a light background.

11B.703.5.2 Case. Characters shall be uppercase or lowercase or a combination of both.

11B.703.5.3 Style. Characters shall be conventional in form. Characters shall not be italic, oblique, script, highly decorative, or of other unusual forms.

11B.703.5.4 Character Proportions. Characters shall be selected from fonts where the width of the uppercase letter "O" is 60 percent minimum and 110 percent maximum of the height of the uppercase letter "I".

11B.703.5.5 Character Height. Minimum character height shall comply with Table 703.5.5. Viewing distance shall be measured as the horizontal distance between the character and an obstruction preventing further approach towards the sign. Character height shall be based on the uppercase letter "I".

11B.703.5.6 Height From Finish Floor or Ground. Visual characters shall be 40 inches (1015 mm) minimum above the finish floor or ground.

11B.703.5.7 Stroke Thickness. Stroke thickness of the uppercase letter "I" shall be 10 percent minimum and 20 percent maximum of the height of the character.

11B.703.5.8 Character Spacing. Character spacing shall be measured between the two closest points of adjacent characters, excluding word spaces. Spacing between individual characters shall be 10 percent minimum and 35 percent maximum of character height.

11B.703.5.9 Line Spacing. Spacing between the baselines of separate lines of characters within a message shall be 135 percent minimum and 170 percent maximum of the character height.

11B.703.6 Pictograms. Pictograms shall comply with 703.6.

11B.703.6.1 Pictogram Field. Pictograms shall have a field height of 6 inches (150 mm) minimum. Characters and braille shall not be located in the pictogram field.







Figure 703.6.1 Pictogram Field dark-on-light

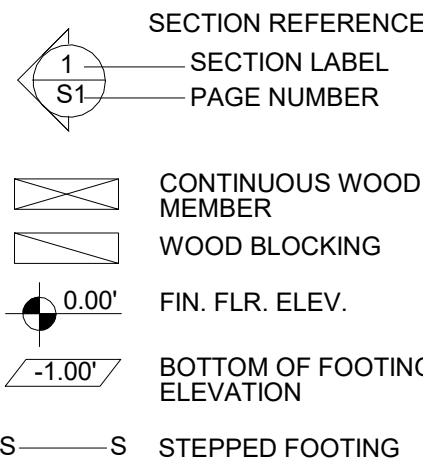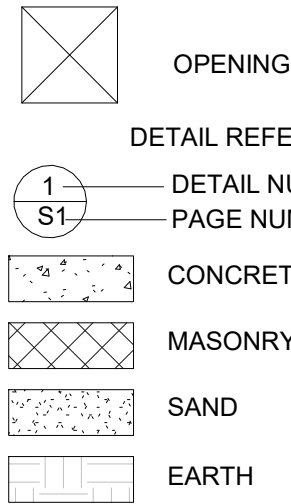


THE "INTERNATIONAL SYMBOL FOR ACCESS FOR HEARING LOSS" PROPORTIONS SHALL BE APPROXIMATE CBC FIGURE 11B-703.7.2.4

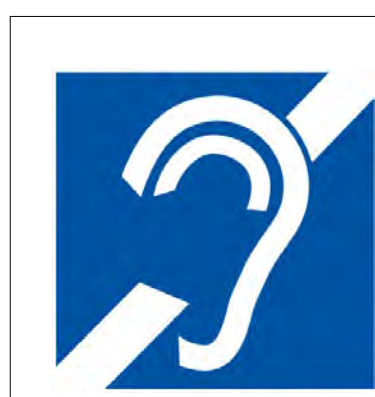

"INFORMATION TO BE PROVIDED WHEN BUILDINGS ARE SITE LOCATED"

REQUIRED PER 11B-219 & 11B-706 (SEE FLOOR PLANS FOR MORE INFO)

NOTE: TEXT ON THIS SIGN IN VISUAL

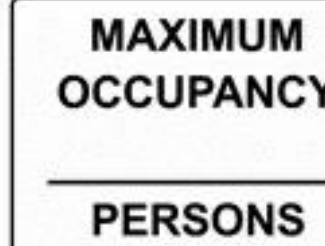

OCCUPANT LOAD SIGN REQUIRED PER DSA BU11-08.



EVERY ROOM OR SPACE WHICH IS USED FOR ASSEMBLY, CLASSROOM, DINING OR SIMILAR PURPOSES HAVING AN OCCUPANT LOAD OF 50 OR MORE SHALL HAVE THE OCCUPANT LOAD OF THE ROOM OR SPACE POSTED IN A CONSPICUOUS PLACE, NEAR THE MAIN EXIT OR EXIT ACCESS DOORWAY

7 1" = 1'-0" Assistive Listening System Symbol

8 1" = 1'-0" EQUIPMENT ANCHORAGE

BRAILLE DIMENSIONS


MEASUREMENT RANGE	MINIMUM IN INCHES MAXIMUM IN INCHES
Dot base diameter	0.059 (1.5mm) to 0.063 (1.6mm)
Distance between two dots in the same cell ¹	0.100 (2.5 mm)
Distance between corresponding dots in adjacent cells ¹	0.300 (7.6 mm)
Dot height	0.025 (0.6 mm) to 0.037 (0.09mm)
Distance between corresponding dots from once cell directly below ¹	0.395 (10 mm) to 0.400 (10.2 mm)

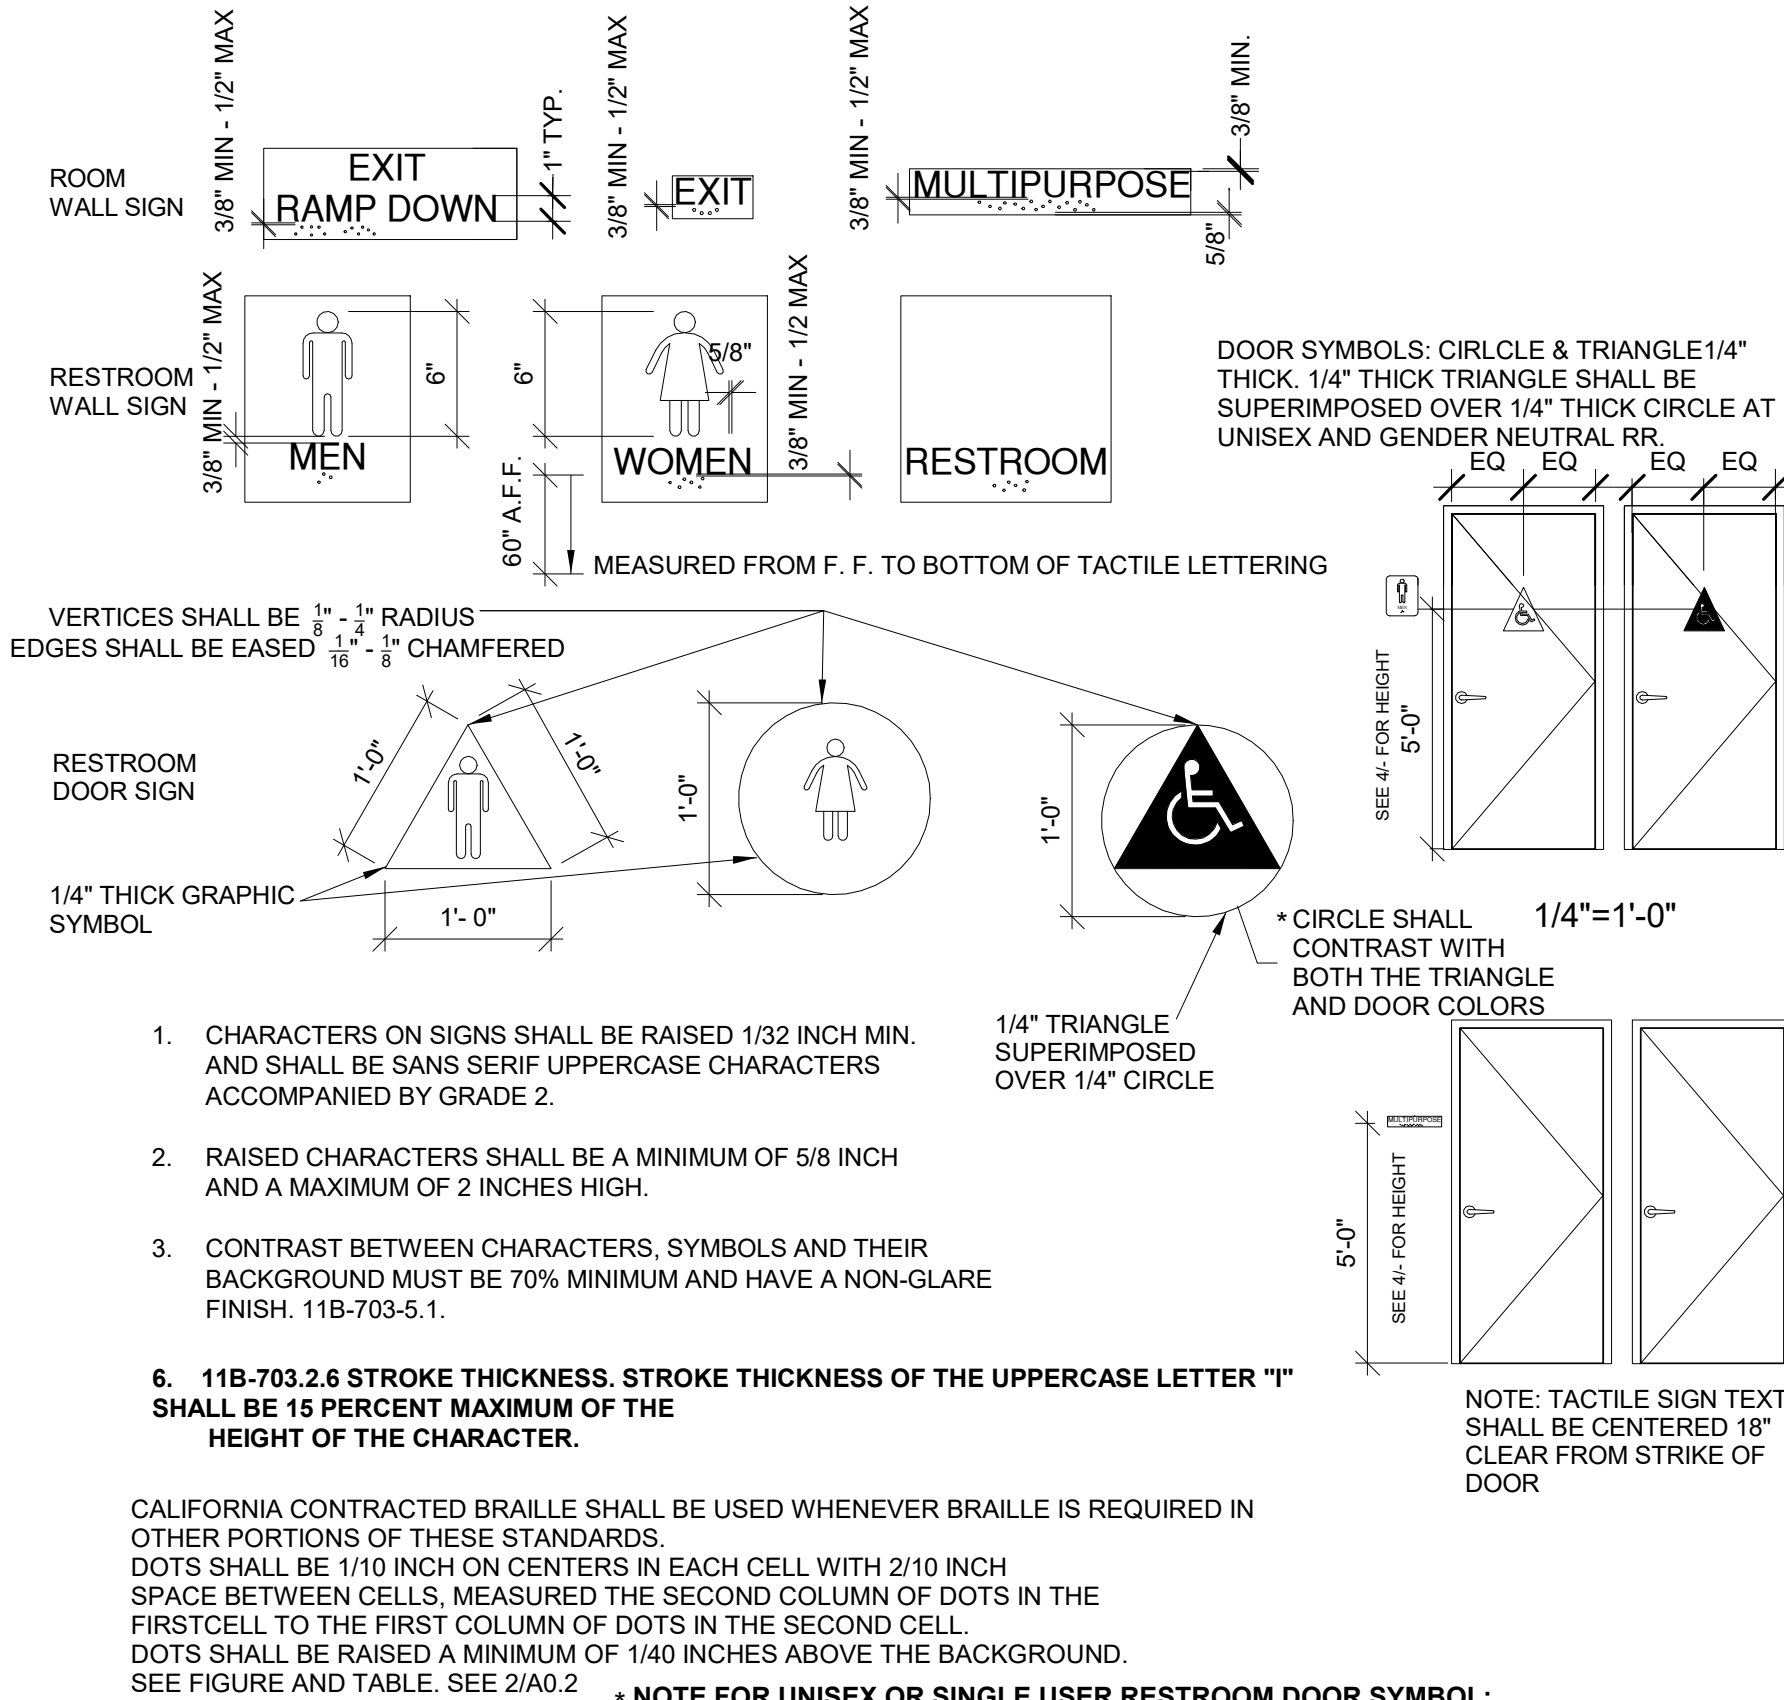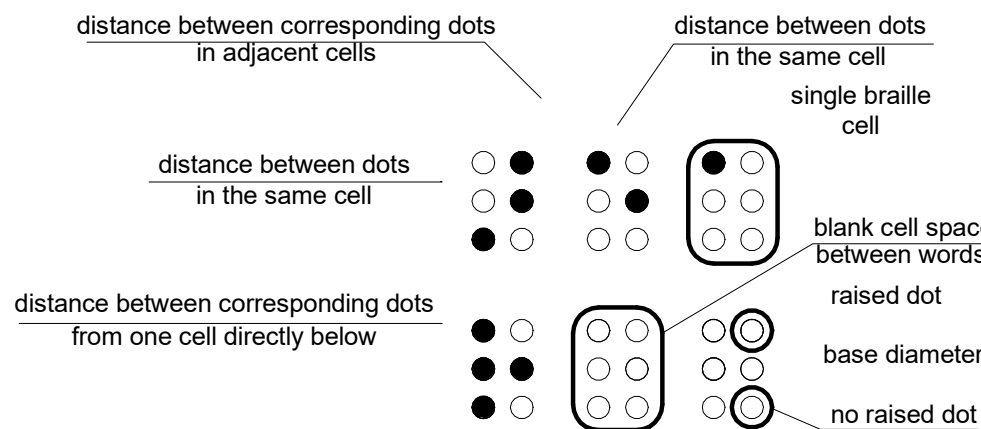

3 1/4" = 1'-0" Signage and Notes

9 1/2" = 1'-0" BRAILLE DIMENSIONS

PROJECT SPECIFIC STATE AGENCY APPROVAL

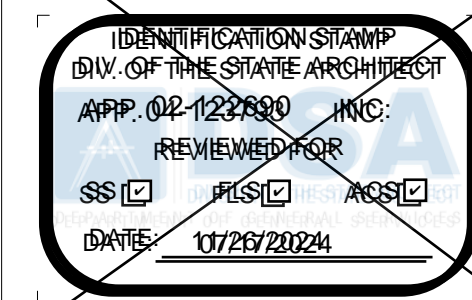

PROFESSIONAL STAMP




THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



ORIGINAL PC STATE AGENCY APPROVAL

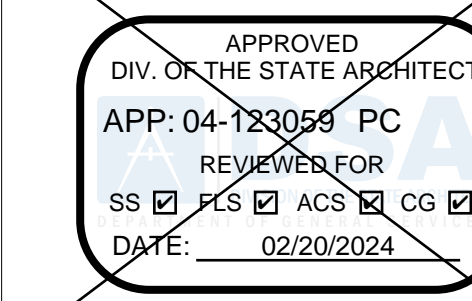

Revision Schedule

Description Date

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE

PC 2022 CBC: 24' x 40' EXPANDABLE TO 120' x 40'

SHEET TITLE

SIGNAGE AND SYMBOLS

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY

RH/RT

DATE

SHEET NO.

A0.2

SHEET OF

C:\Users\user\Documents\20230333_A\Aves-24x40-PC-ManFile-LowSeismic_b7_05ESAS240630333.dwg, 11:49:06 PM 6/5/2021 11:49:06 PM

DEFAULT CONCRETE MIX DESIGN FOR BELOW GRADE NORMAL WEIGHT CONCRETE						
CONCRETE ELEMENT	MAXIMUM W/C/M RATIO	MINIMUM COMPRESSIVE STRENGTH, f _c (PSI)	CEMENTITIOUS MATERIALS - TYPES (ASTM C150)	MAX AGGREGATE SIZE	TARGET AIR CONTENT (%)	
					CONCRETE NOT EXPOSED TO FREEZING AND THAWING CYCLES	CONCRETE EXPOSED TO FREEZING AND THAWING CYCLES
FOUNDATION	0.45	4,500	TYPE V PLUS POZZOLAN OR SLAG CEMENT	1" - 1/4"	N/A	6
FOUNDATION VENTS & ACCESS WELLS	0.45	4,500	TYPE V PLUS POZZOLAN OR SLAG CEMENT	3/8"	N/A	7.5
				1/2"	N/A	7
				1/4" - 3/8"	N/A	4

NOTE:
(1) THE QUALITY CONTROL CONCRETE MIX DESIGN REQUIREMENTS MAY BE SELECTED AND USED FOR CONSTRUCTION PROVIDED THAT THE PC CHAIRMAN(S) DO NOT REQUIRE A SITE-SPECIFIC GEOTECHNICAL REPORT THAT QUANTIFIES SULFATE CONTENT IN THE SOIL OR PC-4, SECTION 3.1.
(2) DOCUMENTATION OF CONCRETE MIXTURES (MATERIALS) SHALL BE IN ACCORDANCE WITH ACI 318, SECTION 3.4.4.
(3) CEMENT SHALL BE CONFORMED TO THE PC PART 2, SECTION 200.4.1.
(4) THE FOUNDATION DESIGN HAS BEEN PREPARED USING A MINIMUM 28 DAY COMPRESSIVE CONCRETE STRENGTH (F_C) OF 3000 PSI.

1 SCALE
DEFAULT CONCRETE MIX DESIGN

EXPOSURE CATEGORY: FREEZING AND THAWING (F)						
EXPOSURE CLASS	CONDITION	MAXIMUM W/C/M	MINIMUM F _C	REQUIRED AIR CONTENT (%)		LIMITS ON CEMENTITIOUS MATERIALS
				MAX AGGREGATE SIZE (IN)	THAW AIR CONTENT (%)	
F0	CONCRETE NOT EXPOSED TO FREEZING AND THAWING CYCLES	0.55	3500	N/A	N/A	N/A
				3/4"	5.5	
				1/2"	4.5	
F1	CONCRETE EXPOSED TO FREEZING AND THAWING CYCLES WITH LIMITED EXPOSURE TO WATER	0.55	3500	3/4"	6.5	N/A
				1/2"	5.5	
				3/8"	4.5	
F2	CONCRETE EXPOSED TO FREEZING AND THAWING CYCLES WITH FREQUENT EXPOSURE TO WATER	0.45	4500	3/4"	7.5	N/A
				1/2"	6.5	
				3/8"	5.5	
F3	CONCRETE EXPOSED TO FREEZING AND THAWING CYCLES WITH FREQUENT EXPOSURE TO WATER AND EXPOSURE TO DEWING CHEMICALS	0.4	5000	3/4"	8.5	ACI 318, SECTION 36.4.2.3(b)
				1/2"	7.5	
				3/8"	6.5	

A.1 WITH OUT GEOTECH REPORT
Maximum water/cement ratio of 0.45; minimum compressive strength of 4,500 pounds per square inch (psi); Type V cement plus pozzolan or slag cement complying with Footnote 7 of ACI table 19.3.2.1; prohibition of admixtures containing calcium chloride; and 4" max slump.

A.2 Optional (Site-Specific) concrete Strength: WITH GEOTECH REPORT
When the PC drawings require a site-specific geotechnical report that quantifies sulfate content in the soil, the PC drawings shall require a concrete mix shall comply with one of the following based on the exposure class for each category from ACI 318 Table 19.3.2.1 below
(The minimum compressive strength shall not be less than 3500 psi with 4" max Slump)

EXPOSURE CATEGORY: SULFATE (S)						
EXPOSURE CLASS	CONDITION	MAXIMUM W/C/M	MINIMUM F _C	CEMENTITIOUS MATERIALS TYPES		
				ASTM C150	ASTM C595	ASTM C1157
S0	SO ₄ ²⁻ < 0.10	0.55	3500	NO TYPE RESTRICTION	NO TYPE RESTRICTION	NO RESTRICTION
S1	0.10 ≤ SO ₄ ²⁻ < 0.20	0.50	4000	II	TYPES WITH (MS) DESIGNATION	MS
S2	0.20 ≤ SO ₄ ²⁻ < 0.30	0.45	4500	V	TYPES WITH (HS) DESIGNATION	HS
S3 (OPTION 1)	SO ₄ ²⁻ > 0.30	0.45	4500	V PLUS POZZOLAN OR SLAG CEMENT	HS PLUS POZZOLAN OR SLAG CEMENT	NOT PERMITTED
S3 (OPTION 2)	SO ₄ ²⁻ > 0.30	0.50	5000	V	TYPES WITH (HS) DESIGNATION	HS

EXPOSURE CATEGORY: IN CONTACT WITH WATER (W)					
EXPOSURE CLASS		CONDITION	MAXIMUM W/CM	MINIMUM F _C	ADDITIONAL REQUIREMENTS
■	W0	CONCRETE DRY IN SERVICE OR CONCRETE IN CONTACT WITH WATER AND LOW PERMEABILITY IS NOT REQUIRED	0.55	3500	N/A
■	W1	CONCRETE IN CONTACT WITH WATER AND LOW PERMEABILITY IS REQUIRED	0.50	3500	AGGREGATES ARE NOT ALKALI-SILICA OR ALKALI-CARBONATE REACTIVE
■	W2	CONCRETE IN CONTACT WITH WATER AND LOW PERMEABILITY IS REQUIRED	0.50	4000	AGGREGATES ARE NOT ALKALI-SILICA OR ALKALI-CARBONATE REACTIVE

EXPOSURE CATEGORY: CORROSION PROTECTION OF REINFORCEMENT						
EXPOSURE CLASS		CONDITION	MAXIMUM W/CM	MINIMU M Fc	MAXIMUM WATER-SOLUBLE CHLORIDE (ON (CL) CONTENT IN CONCRETE, PERCENT BY WEIGHT OF CEMENT (NON-PRESTRESSED CONCRETE)	ADDITIONAL REQUIREMENTS
■	C0	CONCRETE NOT EXPOSED TO MOISTURE OR TO AN EXTERNAL SOURCE OF	0.55	3500	1.00	N/A
■	C1	CONCRETE EXPOSED TO MOISTURE BUT NOT TO AN EXTERNAL SOURCE OF CHLORIDES	0.55	3500	0.30	N/A
■	C2	CONCRETE EXPOSED TO MOISTURE AND AN EXTERNAL SOURCE OF CHLORIDES (DEFICING	0.40	5000	0.15	CONCRETE COVER PER ACI 318, SECTION 20.5

NOTE:
(1) THE QUALITY CONTROL CONCRETE MIX DESIGN REQUIREMENTS MAY BE SELECTED AND USED FOR CONSTRUCTION PROVIDED THAT THE PC CHAIRMAN(S) DO NOT REQUIRE A SITE-SPECIFIC GEOTECHNICAL REPORT THAT QUANTIFIES SULFATE CONTENT IN THE SOIL OR PC-4, SECTION 3.1.
(2) DOCUMENTATION OF CONCRETE MIXTURES (MATERIALS) SHALL BE IN ACCORDANCE WITH ACI 318, SECTION 3.4.4.
(3) CEMENT SHALL BE CONFORMED TO THE PC PART 2, SECTION 200.4.1.
(4) THE FOUNDATION DESIGN HAS BEEN PREPARED USING A MINIMUM 28 DAY COMPRESSIVE CONCRETE STRENGTH (F_C) OF 3000 PSI.
(5) THE FOUNDATION DESIGN HAS BEEN PREPARED USING A MINIMUM 28 DAY COMPRESSIVE CONCRETE STRENGTH (F_C) OF 3000 PSI.

SCALE
ALTERNATIVE CONCRETE MIX-DESIGN: SITE-SPECIFIC

NOT IN USE

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS, 2022 CBC

Application Number: 11-11111 School Name: School District: 1
Date Created: 2023-05-16 13:25:31
DSA File Number: 1 Increment Number:

2022 CBC

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A (2022 CBC).

**NOTE: Undefined section and table references found in this document are from the CBC, or California Building Code.

KEY TO COLUMNS			
1. TYPE		2. PERFORMED BY	
Continuous – Indicates that a continuous special inspection is required		GE (Geotechnical Engineer) – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative.	
Periodic – Indicates that a periodic special inspection is required		LOR (Laboratory of Record) – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335.	
Test – Indicates that a test is required		PI (Project Inspector) – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.	
		SI (Special Inspection) – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.	
C1. CAST-IN-PLACE CONCRETE			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1910A.1.
<input checked="" type="checkbox"/> b. Identify, sample, and test reinforcing steel.	Test	LOR	1910A.2; ACI 318-19 Ch.20 and Section 26.6.1.2; DSA IR 17-10. (See Appendix (end of this form) for exemptions.)
<input checked="" type="checkbox"/> c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6; ACI 318-19 Sections 26.5 & 26.12.
<input checked="" type="checkbox"/> d. Test concrete (f'c).	Test	LOR	1905A.1.17; ACI 318-19 Section 26.12.
<input checked="" type="checkbox"/> e. Batch plant inspection: Continuous	See Notes	SI	Default of 'Continuous' per 1705A.3.3. If approved by DSA, batch plant inspection may be reduced to 'Periodic' subject to requirements in Section 1705A.3.3.1, or eliminated per 1705A.3.3.2. See IR 17-13. (See Appendix (end of this form) for exemptions.)
S/A1. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify identification of all materials and: • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements.	Periodic	*	Table 1705A.2.1 Item 3a 3c: 2202A.1; AISI S100-20 Section A3.1 & A3.2, AISI S240-20 Section A3 & A5, AISI S220-20 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
<input checked="" type="checkbox"/> b. Test unidentified materials	Test	LOR	2202A.1.
<input checked="" type="checkbox"/> c. Examine seam welds of HSS shapes	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/> d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic	SI	Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).
S/A3. WELDING:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic	SI	1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3.
<input checked="" type="checkbox"/> b. Verify weld filler material manufacturer's certificate of compliance.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/> c. Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.
S/A4. SHOP WELDING (IN ADDITION TO SECTION S/A3):			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1 4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/> b. Inspect single-pass fillet welds ≤ 5/16", floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/> c. Inspect welding of stairs and railing systems.	Periodic	SI	1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.
Test or Special Inspection	Type	Performed By	Code References and Notes
S/A6. NONDESTRUCTIVE TESTING:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Ultrasonic	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input checked="" type="checkbox"/> b. Magnetic Particle	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.

- Structural Testing and Inspection: Laboratory Verified Report Form DSA 291
- Concrete Batch Plant Inspection: Laboratory Verified Report Form DSA 291
- Shop Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

NOTE:
THE EXAMPLE OF FORM DSA-103s SHOWN ON THIS SHEET ARE FOR ILLUSTRATION PURPOSE ONLY. A FORM DSA-103 IS TO BE COMPLETED FOR EACH APPLICATION THAT THIS PC BEING INCORPORATED INTO AND EXAMPLE FORM DSA-103s ARE TO BE CROSSED OUT ON THIS DRAWING.

2 DSA-103 CONCRETE FLOOR (STOCKPILE)

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS, 2022 CBC

Application Number: 11-11111 School Name: School District: 1
Date Created: 2023-05-16 13:35:53
DSA File Number: 1 Increment Number:

2022 CBC

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A (2022 CBC).

**NOTE: Undefined section and table references found in this document are from the CBC, or California Building Code.

KEY TO COLUMNS			
1. TYPE	2. PERFORMED BY		
Continuous – Indicates that a continuous special inspection is required	GE (Geotechnical Engineer) – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative.		
Periodic – Indicates that a periodic special inspection is required	LOR (Laboratory of Record) – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335.		
Test – Indicates that a test is required	PI (Project Inspector) – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.		
	SI (Special Inspection) – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.		
Geotechnical Reports: Project does NOT have and does NOT require a geotechnical report			
S1. GENERAL:			
Test or Special Inspection	Type	Performed By	Code References and Notes
a. Verify that: • Site has been prepared properly prior to placement of controlled fill and/or excavations for foundations. • Foundation excavations are extended to proper depth and have reached proper material. • Materials below footings are adequate to achieve the design bearing capacity.	See Notes	PI	Refer to specific items identified in the Appendix listing exemptions for limitations. Placement of controlled fill exceeding 12" depth under foundations is not permitted without a geotechnical report.
S2. SOIL COMPACTION AND FILL:			
Test or Special Inspection	Type	Performed By	Code References and Notes
a. Verify use of proper materials, densities and inspect lift thicknesses, placement and compaction during placement of fill.	Continuous	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.
b. Compaction testing.	Test	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.
C1. CAST-IN-PLACE CONCRETE			
Test or Special Inspection	Type	Performed By	Code References and Notes
a. Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1910A.1.
b. Identify, sample, and test reinforcing steel	Test	LOR	1910A.2; ACI 318-19 Ch.20 and Section 26.6.1.2; DSA IR 17-10. (See Appendix (end of this form) for exemptions.)
c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6; ACI 318-19 Sections 26.5 & 26.12.
d. Test concrete (F _c).	Test	LOR	1905A.1.17; ACI 318-19 Section 26.12.
e. Batch plant inspection: Continuous	See Notes	SI	Default of 'Continuous' per 1705A.3.3. If approved by DSA, batch plant inspection may be reduced to 'Periodic' subject to requirements in Section 1705A.3.3.1, or eliminated per 1705A.3.3.2. See IR 17-13. (See Appendix (end of this form) for exemptions.)
C5. POST-INSTALLED ANCHORS:			
Test or Special Inspection	Type	Performed By	Code References and Notes
a. Inspect installation of post-installed anchors	See Notes	SI*	1617A.1.19, Table 1705A.3 Item 4a (Continuous) & 4b (Periodic), 1705A.3.8 (See Appendix (end of this form) for exemptions), ACI 318-14 Sections 17.8 & 26.13. * May be performed by the project inspector when specifically approved by DSA.
b. Test post-installed anchors.	Test	LOR	1910A.5. (See Appendix (end of this form) for exemptions.)
S/A1. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES			
Test or Special Inspection	Type	Performed By	Code References and Notes
a. Verify identification of all materials and: • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements.	Periodic	*	Table 1705A.2.1 Item 3a 3c: 2202A.1; AISI S100-20 Section A3.1 & A3.2, AISI S240-20 Section A3 & A5, AISI S220-20 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
b. Test unidentified materials	Test	LOR	2202A.1.
c. Examine seam welds of HSS shapes	Periodic	SI	DSA IR 17-3.
d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic	SI	Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).
S/A3. WELDING:			
Test or Special Inspection	Type	Performed By	Code References and Notes
a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic	SI	1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3.
b. Verify weld filler material manufacturer's certificate of compliance.	Periodic	SI	DSA IR 17-3.
c. Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.
S/A4. SHOP WELDING (IN ADDITION TO SECTION S/A3):			
Test or Special Inspection	Type	Performed By	Code References and Notes
a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1 4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
b. Inspect single-pass fillet welds < 5/16", floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
c. Inspect welding of stairs and railing systems.	Periodic	SI	1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.
d. Verification of reinforcing steel weldability other than ASTM A706.	Periodic	SI	1705A.3.1; AWS D1.8; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
e. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b; 1705A.3.1, Table 1705A.3 Item 2, 1903A.8; AWS D1.4; DSA IR 17-3.
Test or Special Inspection	Type	Performed By	Code References and Notes
S/A5. FIELD WELDING (IN ADDITION TO SECTION S/A4):			
a. Inspect single-pass fillet welds < 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a.3; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
b. Inspect floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Item 5a.6; AISC 360-16 (AISC 341-16 as applicable); AWS D1.3; DSA IR 17-3.
Test or Special Inspection	Type	Performed By	Code References and Notes
S/A6. NONDESTRUCTIVE TESTING:			
Test or Special Inspection	Type	Performed By	Code References and Notes
a. Ultrasonic	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.
b. Magnetic Particle	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.


- Structural Testing and Inspection: Laboratory Verified Report Form DSA 291
- Concrete Batch Plant Inspection: Laboratory Verified Report Form DSA 291
- Post-Installed Anchors: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292
- Shop Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292
- Field Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

NOTES:
THE EXAMPLE OF FORM DSA-103s SHOWN ON THIS SHEET ARE FOR ILLUSTRATION PURPOSE ONLY. A FORM DSA-103 IS TO BE COMPLETED FOR EACH APPLICATION THAT THIS PC BEING INCORPORATED INTO AND EXAMPLE FORM DSA-103s ARE TO BE CROSSED OUT ON THIS DRAWING.

IF THERE IS A GEOTECHNICAL REPORT, THE GEOTECH ENGINEER SHOULD DO THE INSPECTION INSTEAD OF PROJECT INSPECTOR (PI).

1 DSA-103 CONCRETE FLOOR (CONCRETE FOUNDATION)

PROJECT SPECIFIC STATE AGENCY APPROVAL

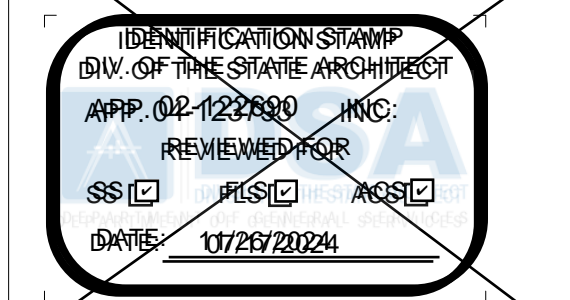

PROFESSIONAL STAMP



THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS, 2022 CBC

Application Number: 11-11111 School Name: School District: 1
DSA File Number: Increment Number: Date Created: 2023-05-16 13:57:04

2022 CBC

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A (2022 CBC).

****NOTE:** Undefined section and table references found in this document are from the CBC, or California Building Code.

KEY TO COLUMNS

1. TYPE	2. PERFORMED BY
Continuous – Indicates that a continuous special inspection is required	GE (Geotechnical Engineer) – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative. LOR (Laboratory of Record) – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335. PI (Project Inspector) – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.
Periodic – Indicates that a periodic special inspection is required	SI (Special Inspection) – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.
Test – Indicates that a test is required	
S/A1. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES	
<input checked="" type="checkbox"/> Test or Special Inspection	Type Performed By Code References and Notes
<input checked="" type="checkbox"/> a. Verify identification of all materials and: • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements.	Periodic * Table 1705A.2.1 Item 3a 3c, 2202A.1; AISI S100-20 Section A3.1 & A3.2, AISI S240-20 Section A3 & A5, AISI S220-20 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
<input checked="" type="checkbox"/> b. Test unidentified materials	Test LOR 2202A.1.
<input checked="" type="checkbox"/> c. Examine seam welds of HSS shapes	Periodic SI DSA IR 17-3.
<input checked="" type="checkbox"/> d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic SI Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).
S/A3. WELDING:	
Test or Special Inspection	Type Performed By Code References and Notes
<input checked="" type="checkbox"/> a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic SI 1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3.
<input checked="" type="checkbox"/> b. Verify weld filler material manufacturer's certificate of compliance.	Periodic SI DSA IR 17-3.
<input checked="" type="checkbox"/> c. Verify WPS, welder qualifications and equipment.	Periodic SI DSA IR 17-3.
S/A4. SHOP WELDING (IN ADDITION TO SECTION S/A3):	
Test or Special Inspection	Type Performed By Code References and Notes
<input checked="" type="checkbox"/> a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous SI Table 1705A.2.1 Items 5a.1 4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/> b. Inspect single-pass fillet welds ≤ 5/16", floor and roof deck welds.	Periodic SI 1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/> c. Inspect welding of stairs and railing systems.	Periodic SI 1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.
Test or Special Inspection	Type Performed By Code References and Notes
S/A6. NONDESTRUCTIVE TESTING:	
Test or Special Inspection	Type Performed By Code References and Notes
<input checked="" type="checkbox"/> a. Ultrasonic	Test LOR 1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input checked="" type="checkbox"/> b. Magnetic Particle	Test LOR 1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.

1. Structural Testing and Inspection: Laboratory Verified Report Form DSA 291

2. Shop Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

NOTE:
THE EXAMPLE OF FORM DSA-103s SHOWN ON THIS SHEET ARE FOR ILLUSTRATION PURPOSE ONLY. A FORM DSA-103 IS TO BE COMPLETED FOR EACH APPLICATION THAT THIS PC BEING INCORPORATED INTO AND EXAMPLE FORM DSA-103s ARE TO BE CROSSED OUT ON THIS DRAWING.

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS, 2022 CBC

Application Number: 11-11111 School Name: School District: 1
DSA File Number: Increment Number: Date Created: 2023-05-16 14:08:48

2022 CBC

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A (2022 CBC).

****NOTE:** Undefined section and table references found in this document are from the CBC, or California Building Code.

KEY TO COLUMNS

1. TYPE	2. PERFORMED BY
Continuous – Indicates that a continuous special inspection is required	GE (Geotechnical Engineer) – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative. LOR (Laboratory of Record) – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335. PI (Project Inspector) – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.
Periodic – Indicates that a periodic special inspection is required	SI (Special Inspection) – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.
Test – Indicates that a test is required	

Geotechnical Reports: Project does NOT have and does NOT require a geotechnical report

S1. GENERAL:	Type	Performed By	Code References and Notes
Test or Special Inspection			
<input checked="" type="checkbox"/> a. Verify that: • Site has been prepared properly prior to placement of controlled fill and/or excavations for foundations. • Foundation excavations are extended to proper depth and have reached proper material. • Materials below footings are adequate to achieve the design bearing capacity.	See Notes	PI	Refer to specific items identified in the Appendix listing exemptions for limitations. Placement of controlled fill exceeding 12" depth under foundations is not permitted without a geotechnical report.
S2. SOIL COMPACTION AND FILL:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify use of proper materials, densities and inspect lift thicknesses, placement and compaction during placement of fill.	Continuous	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.
<input checked="" type="checkbox"/> b. Compaction testing.	Test	LOR*	* Under the supervision of a geotechnical engineer or LOR's engineering manager. Refer to specific items identified in the Appendix listing exemptions for limitations.

C1. CAST-IN-PLACE CONCRETE

Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1910A.5.
<input checked="" type="checkbox"/> b. Identify, sample, and test reinforcing steel.	Test	LOR	1910A.2; ACI 318-19 Ch.20 and Section 26.6.1.2; DSA IR 17-10. (See Appendix (end of this form) for exemptions.)
<input checked="" type="checkbox"/> c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6, ACI 318-19 Sections 26.5 & 26.12.
<input checked="" type="checkbox"/> d. Test concrete (f _c).	Test	LOR	1905A.1.17; ACI 318-19 Section 26.12.
<input checked="" type="checkbox"/> e. Batch plant inspection: Continuous	See Notes	SI	Default of 'Continuous' per 1705A.3.3. If approved by DSA, batch plant inspection may be reduced to 'Periodic' subject to requirements in Section 1705A.3.3.1, or eliminated per 1705A.3.3.2. See IR 17-13. (See Appendix (end of this form) for exemptions.)

C5. POST-INSTALLED ANCHORS:

Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Inspect installation of post-installed anchors	See Notes	SI*	1617A.1.19, Table 1705A.3 Item 4a (Continuous) & 4b (Periodic), 1705A.3.8 (See Appendix (end of this form) for exemptions), ACI 308-14 Sections 17.8 & 26.13. * May be performed by the project inspector when specifically approved by DSA.
<input checked="" type="checkbox"/> b. Test post-installed anchors.	Test	LOR	1910A.5. (See Appendix (end of this form) for exemptions.)

S/A1. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES

Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify identification of all materials and: • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements.	Periodic	SI	Table 1705A.2.1 Item 3a 3c, 2202A.1; AISI S100-20 Section A3.1 & A3.2, AISI S240-20 Section A3 & A5, AISI S220-20 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
<input checked="" type="checkbox"/> b. Test unidentified materials	Test	LOR	2202A.1.
<input checked="" type="checkbox"/> c. Examine seam welds of HSS shapes	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/> d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic	SI	Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).
S/A3. WELDING:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic	SI	1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3.
<input checked="" type="checkbox"/> b. Verify weld filler material manufacturer's certificate of compliance.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/> c. Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.

S/A4. SHOP WELDING (IN ADDITION TO SECTION S/A3):

Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Item 5a.1 4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/> b. Inspect single-pass fillet welds ≤ 5/16", floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/> c. Inspect welding of stairs and railing systems.	Periodic	SI	1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.
<input checked="" type="checkbox"/> d. Verification of reinforcing steel weldability other than ASTM A206.	Periodic	SI	1705A.3.1; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input checked="" type="checkbox"/> e. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8; AWS D1.4; DSA IR 17-3.

S/A5. FIELD WELDING (IN ADDITION TO SECTION S/A3):

Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> b. Inspect single-pass fillet welds ≤ 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a.5; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
Test or Special Inspection	Type	Performed By	Code References and Notes

S/A6. NONDESTRUCTIVE TESTING:

Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Ultrasonic	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input checked="" type="checkbox"/> b. Magnetic Particle	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.

1. Structural Testing and Inspection: Laboratory Verified Report Form DSA 291

2. Concrete Batch Plant Inspection: Laboratory Verified Report Form DSA 291

3. Post-Installed Anchors: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

4. Shop Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

5. Field Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

NOTES:
THE EXAMPLE OF FORM DSA-103s SHOWN ON THIS SHEET ARE FOR ILLUSTRATION PURPOSE ONLY. A FORM DSA-103 IS TO BE COMPLETED FOR EACH APPLICATION THAT THIS PC BEING INCORPORATED INTO AND EXAMPLE FORM DSA-103s ARE TO BE CROSSED OUT ON THIS DRAWING.

IF THERE IS A GEOTECHNICAL REPORT, THE GEOTECH ENGINEER SHOULD DO THE INSPECTION INSTEAD OF PROJECT INSPECTOR (PI).

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS, 2022 CBC

Application Number: 11-11111 School Name: School District: 1
DSA File Number: Increment Number: Date Created: 2023-05-16 14:19:31

2022 CBC

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A (2022 CBC).

****NOTE:** Undefined section and table references found in this document are from the CBC, or California Building Code.

KEY TO COLUMNS

1. TYPE	2. PERFORMED BY
Continuous – Indicates that a continuous special inspection is required	GE (Geotechnical Engineer) – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative. LOR (Laboratory of Record) – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335. PI (Project Inspector) – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.
Periodic – Indicates that a periodic special inspection is required	SI (Special Inspection) – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.
Test – Indicates that a test is required	
S/A1. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES	
Test or Special Inspection	Type Performed By Code References and Notes
<input checked="" type="checkbox"/> a. Verify identification of all materials and: • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements.	Periodic * Table 1705A.2.1 Item 3a 3c, 2202A.1; AISI S100-20 Section A3.1 & A3.2, AISI S240-20 Section A3 & A5, AISI S220-20 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
<input checked="" type="checkbox"/> b. Test unidentified materials	Test LOR 2202A.1.
<input checked="" type="checkbox"/> c. Examine seam welds of HSS shapes	Periodic SI DSA IR 17-3.
<input checked="" type="checkbox"/> d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic SI Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).
S/A3. WELDING:	
Test or Special Inspection	Type Performed By Code References and Notes
<input checked="" type="checkbox"/> a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic SI 1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3.
<input checked="" type="checkbox"/> b. Verify weld filler material manufacturer's certificate of compliance.	Periodic SI DSA IR 17-3.
<input checked="" type="checkbox"/> c. Verify WPS, welder qualifications and equipment.	Periodic SI DSA IR 17-3.
S/A4. SHOP WELDING (IN ADDITION TO SECTION S/A3):	
Test or Special Inspection	Type Performed By Code References and Notes
<input checked="" type="checkbox"/> a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous SI Table 1705A.2.1 Items 5a.1 4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/> b. Inspect single-pass fillet welds ≤ 5/16", floor and roof deck welds.	Periodic SI 1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/> c. Inspect welding of stairs and railing systems.	Periodic SI 1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.
Test or Special Inspection	Type Performed By Code References and Notes
S/A5. FIELD WELDING (IN ADDITION TO SECTION S/A3):	
Test or Special Inspection	Type Performed By Code References and Notes
<input type="checkbox"/> a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous SI Table 1705A.2.1 Items 5a.1 4; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/> b. Inspect single-pass fillet welds ≤ 5/16".	Periodic SI Table 1705A.2.1 Item 5a.5; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
Test or Special Inspection	Type Performed By Code References and Notes
S/A6. NONDESTRUCTIVE TESTING:	
Test or Special Inspection	Type Performed By Code References and Notes
<input checked="" type="checkbox"/> a. Ultrasonic	Test LOR 1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input checked="" type="checkbox"/> b. Magnetic Particle	Test LOR 1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.


1. Structural Testing and Inspection: Laboratory Verified Report Form DSA 291

2. Shop Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

3. Field Welding Inspection: Laboratory Verified Report Form DSA 291, or, for independently contracting SI, Special Inspection Verified Report Form DSA 292

NOTE:
THE EXAMPLE OF FORM DSA-103s SHOWN ON THIS SHEET ARE FOR ILLUSTRATION PURPOSE ONLY. A FORM DSA-103 IS TO BE COMPLETED FOR EACH APPLICATION THAT THIS PC BEING INCORPORATED INTO AND EXAMPLE FORM DSA-103s ARE TO BE CROSSED OUT ON THIS DRAWING.

PROJECT SPECIFIC STATE AGENCY APPROVAL

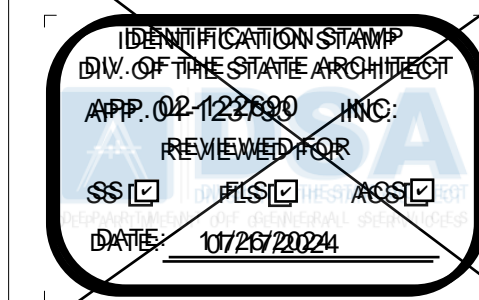

PROFESSIONAL STAMP




THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



ORIGINAL PC STATE AGENCY APPROVAL

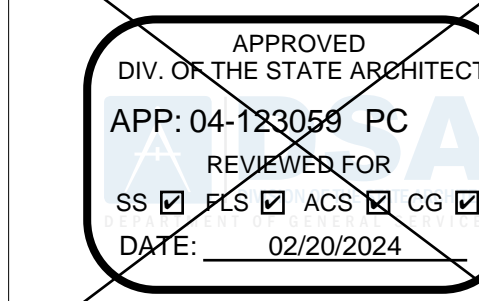

Revision Schedule

Description Date

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE

PC 2022 CBC: 24' x 40' EXPANDABLE TO 120' x 40'

SHEET TITLE

DSA-103 T&I PLYWOOD FLOORS

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY

RH/RT

DATE

SHEET NO.

A0.4

SHEET OF</

UL U419 OR UL U465 (OR EQ) TO BE USED FOR INT. STC RATING. WOOD STUD MAY BE USED ILO OF MTL STUD (WHEN NON-RATED WALLS ARE BEING APPLIED "X" BOARD IS NOT REQUIRED -STC RATINGS STILL APPLY)

	<div>Fire Test</div> <div>UL U419 or MEA 81-98-M</div> <div>Steel Stud (Non-loadbearing) Interior Partitions Sound Test: RAL-TL11-125</div>	<div>Fire Rating</div> <div>1 hr.</div>	<div>STC</div> <div>40</div>	<div>Thickness (in.)</div> <div>4-7/8"</div>	<div><ul style="list-style-type: none">• Gypsum Board - 5/8 in. thick gypsum board applied vertically or horizontally. - SHEETROCK Brand FIRECODE Core (Type X)• Steel Studs - 3-5/8 in. wide min. 25 gauge steel studs @ max 24 in. OC - 362S125-18• Gypsum Board - 5/8 in. thick gypsum board applied vertically or horizontally. - SHEETROCK Brand FIRECODE Core (Type X)</div> <div>Visit U419</div>
	<div>Fire Test</div> <div>UL U465</div> <div>Steel Stud (Non-loadbearing) Interior Partitions Sound Test: RAL-TL11-125</div>	<div>Fire Rating</div> <div>1 hr.</div>	<div>STC</div> <div>40</div>	<div>Thickness (in.)</div> <div>4-7/8"</div>	<div><ul style="list-style-type: none">• Gypsum Board - 5/8 in. thick board, applied vertically, attached to studs with 1 in. long, Type S-12 screws, spaced 8 in. OC along the edges and 12 in. OC of the board - SHEETROCK Brand FIRECODE Core (Type X)• Steel Studs - 3-5/8 in. wide min. 25 gauge steel. Attached to floor and ceiling with fasteners, 24 in. OC - 362S125-18• Gypsum Board - 5/8 in. thick gypsum board applied vertically or horizontally. - SHEETROCK Brand FIRECODE Core (Type X)</div> <div>Visit U465</div>

UL U457 (OR EQ) TO BE USED FOR EXT. STC RATING . WOOD STUD MAY BE USED ILO OF MTL STUD

	<div>Fire Test</div> <div>UL U457</div> <div>Steel Stud (Non-loadbearing) Interior Partitions Sound Test: USG-840222</div>	<div>Fire Rating</div> <div>1 hr.</div>	<div>STC</div> <div>50</div>	<div>Thickness (in.)</div> <div>4-3/4"</div>	<div><ul style="list-style-type: none">• Cement Board - 1/2 thick board, square edge - DUROCK Brand Cement Board Next Gen• Steel Studs - 3-5/8 in. wide by 1-1/4 in. deep, min. 20 gauge steel, max 16 in. OC - 362S125-30• Batts and Blankets - 3 in. mineral wool batt insulation• Gypsum Board - 5/8 in. thick gypsum board applied vertically - SHEETROCK Brand FIRECODE Core (Type X)</div> <div>Visit U457 U457</div>
--	---	---	------------------------------	--	---

ACOUSTIC CONTROL- When the Pre-check building is site adapted, the building and site features need to comply with the CALGreen Code, Section 5.507.4 for the specific site location, and when PC building is place adjacent to another PC building, the adjoining wall section for interior sound transmission must meet the minimum requirement of a STC rating of 40 (per 2022 CALGreen Code, Section 507.4.3).

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-122690 INC:
REVIEWED FOR
SS ☐ PLS ☐ ACS ☐
DATE: 07/29/2024

R&S TAVARES ASSOCIATES
DESIGN & CONSULTING • PROJECT MGT
11590 W BERNARDO COURT, SUITE 100
SAN DIEGO, CA 92127
WWW.RSTAVARES.COM

PROFESSIONAL STAMP

REGISTERED PROFESSIONAL ARCHITECT
MANNY D. FROST
63380
03/31/24
STATE OF CALIFORNIA
02/16/24

RST#22088

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT

CL Class Leasing

1651 Juanita Street, San Jacinto, CA 92583
Voice (951) 943-1908 Fax (951) 943-5768

ORIGINAL PC STATE AGENCY APPROVAL

APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-123058 PC
REVIEWED FOR
SS ☒ PLS ☒ ACS ☒ CG ☒
DATE: 02/20/2024

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE

PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE

CALGREEN SPEC'S

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY

RH/RT

DATE

SHEET NO.

A0.5

SHEET OF

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

NONRESIDENTIAL MANDATORY MEASURES, SHEET 1 (January 2023)

Y	N/A	RESPON. PARTY	CHAPTER 3 GREEN BUILDING SECTION 301 GENERAL 301.1 SCOPE. Buildings shall be designed to include the green building measures specified as mandatory in the application checklists contained in this code. Voluntary green building measures are also included in the application checklists and may be included in the design and construction of structures covered by this code, but are not required unless adopted by a city, county, or city and county as specified in Section 101.7. 301.3 NONRESIDENTIAL ADDITIONS AND ALTERATIONS. [BSC-CG] The provisions of individual sections of Chapter 5 apply to newly constructed buildings, building additions of 1,000 square feet or greater, and/or building alterations with a permit valuation of \$200,000 or above (for occupancies within the authority of California Building Standards Commission). Code sections relevant to additions and alterations shall only apply to the portions of the building being added or altered within the scope of the permitted work. A code section will be designated by a banner to indicate where the code section only applies to newly constructed buildings [N] or to additions and/or alterations [A]. When the code section applies to both, no banner will be used. 301.3.1 Nonresidential additions and alterations that cause updates to plumbing fixtures only: Note: On and after January 1, 2014, certain commercial real property, as defined in Civil Code Section 1101.3, shall have its noncompliant plumbing fixtures replaced with appropriate water-conserving plumbing fixtures under specific circumstances. See Civil Code Section 1101.1 et seq. for definitions, types of commercial real property affected, effective dates, circumstances necessitating replacement of noncompliant plumbing fixtures, and duties and responsibilities for ensuring compliance. 301.3.2 Waste Diversion. The requirements of Section 5.408 shall be required for additions and alterations whenever a permit is required for work. 301.4 PUBLIC SCHOOLS AND COMMUNITY COLLEGES. (see GBSC) 301.5 HEALTH FACILITIES. (see GBSC) SECTION 302 MIXED OCCUPANCY BUILDINGS 302.1 MIXED OCCUPANCY BUILDINGS. In mixed occupancy buildings, each portion of a building shall comply with the specific green building measures applicable to each specific occupancy. SECTION 303 PHASED PROJECTS 303.1 PHASED PROJECTS. For shell buildings and others constructed for future tenant improvements, or those code measures relevant to the building components and systems considered to be new construction (or newly constructed) shall apply. 303.1.1 Initial Tenant Improvements. The provisions of this code shall apply only to the initial tenant improvements to a project. Subsequent tenant improvements shall comply with the scoping provisions in Section 301.3 non-residential additions and alterations. ABBREVIATION DEFINITIONS: HCD Department of Housing and Community Development BSC California Building Standards Commission DSA-SS Division of the State Architect, Structural Safety OSHPD Office of Statewide Health Planning and Development LR Low Rise HR High Rise AA Additions and Alterations N New CHAPTER 5 NONRESIDENTIAL MANDATORY MEASURES DIVISION 5.1 PLANNING AND DESIGN SECTION 5.101 GENERAL 5.101.1 SCOPE The provisions of this chapter outline planning, design and development methods that include environmentally responsible site selection, building design, building siting and development to protect, restore and enhance the environmental quality of the site and respect the integrity of adjacent properties. SECTION 5.102 DEFINITIONS 5.102.1 DEFINITIONS The following terms are defined in Chapter 2 (and are included here for reference) CUTOFF LUMINAIRES. Luminaires whose light distribution is such that the candela per 1000 lamp lumens does not numerically exceed 25 (2.5 percent) at an angle of 90 degrees above nadir, and 100 (10 percent) at a vertical angle of 80 degrees above nadir. This applies to all lateral angles around the luminaire. LOW-EMITTING AND FUEL EFFICIENT VEHICLES. Eligible vehicles are limited to the following: 1. Zero emission vehicle (ZEV), enhanced advanced technology PZEV (enhanced AT ZEV) or transitional zero emission vehicles (TZE) regulated under CCR, Title 13, Section 1962. 2. High-efficiency vehicles, regulated by U.S. EPA, bearing a fuel economy and greenhouse gas rating of 9 or 10 as regulated under 40 CFR Section 600 Subpart D. NEIGHBORHOOD ELECTRIC VEHICLE (NEV). A motor vehicle that meets the definition of "low-speed vehicle" either in Section 385.5 of the Vehicle Code or in 49CFR571.500 (as it existed on July 1, 2000), and is certified to zero-emission vehicle standards. TENANT-OCCUPANTS. Building occupants who inhabit a building during its normal hours of operation as permanent occupants, such as employees, as distinguished from customers and other transient visitors. VANPOOL VEHICLE. Eligible vehicles are limited to any motor vehicle, other than a motortruck or truck tractor, designed for carrying more than 10 but not more than 15 persons including the driver, which is maintained and used primarily for the nonprofit work-related transportation of adults for the purpose of ridesharing. Note: Source: Vehicle Code, Division 1, Section 668 ZEV. Any vehicle certified to zero-emission standards. SECTION 5.106 SITE DEVELOPMENT 5.106.1 STORM WATER POLLUTION PREVENTION FOR PROJECTS THAT DISTURB LESS THAN ONE ACRE OF LAND. Newly constructed projects and additions which disturb less than one acre of land, and are not part of a larger common plan of development or sale, shall prevent the pollution of storm water runoff from the construction activities through one or more of the following measures: 5.106.1.1 Local ordinance. Comply with a lawfully enacted storm water management and/or erosion control ordinance. 5.106.1.2 Best Management Practices (BMPs). Prevent the loss of soil through wind or water erosion by implementing an effective combination of erosion and sediment control and good housekeeping BMPs. 1. Soil loss BMPs that should be considered for implementation as appropriate for each project include, but are not limited to, the following: a. Scheduling construction activity during dry weather, when possible. b. Preservation of natural features, vegetation, soil, and buffers around surface waters. c. Drainage swales or lined ditches to control stormwater flow. d. Mulching or hydroseeding to stabilize disturbed soils. e. Erosion control to protect slopes. f. Protection of storm drain inlets (gravel bags or catch basin inserts). g. Perimeter sediment control (perimeter silt fence, fiber rolls). h. Sediment trap or sediment basin to retain sediment on site. i. Stabilized construction exits. j. Wind erosion control. k. Other soil loss BMPs acceptable to the enforcing agency. 2. Good housekeeping BMPs to manage construction equipment, materials, non-stormwater discharges and wastes that should be considered for implementation as appropriate for each project include, but are not limited to, the following: a. Dewatering activities. b. Material handling and waste management. c. Building materials stockpile management. d. Management of washout areas (concrete, paints, stucco, etc.). e. Control of vehicle/equipment fueling to contractor's staging area. f. Vehicle and equipment cleaning performed off site. g. Spill prevention and control. h. Other housekeeping BMPs acceptable to the enforcing agency.
---	-----	---------------	--

Y	N/A	RESPON. PARTY	5.106.2 STORMWATER POLLUTION PREVENTION FOR PROJECTS THAT DISTURB ONE OR MORE ACRES OF LAND. Comply with all lawfully enacted stormwater discharge regulations for projects that (1) disturb one acre or more of land, or (2) disturb less than one acre of land but are part of a larger common plan of development or sale. Note: Projects that (1) disturb one acre or more of land, or (2) disturb less than one acre of land but are part of the larger common plan of development or sale must comply with the post-construction requirements detailed in the applicable National Pollutant Discharge Elimination System (NPDES) General permit for Stormwater Discharges Associated with Construction and Land Disturbance Activities issued by the State Water Resources Control Board or the Lahontan Regional Water Quality Control Board (for projects in the Lake Tahoe Hydrologic Unit). The NPDES permits require postconstruction runoff (post-project hydrology) to match the preconstruction runoff (pre-project hydrology) with the installation of postconstruction stormwater management measures. The NPDES permits emphasize runoff reduction through on-site stormwater use, interception, evapotranspiration, and infiltration through nonstructural controls, such as Low Impact Development (LID) practices, and conversation design measures. Stormwater volume that cannot be addressed using nonstructural practices is required to be captured in structural practices and be approved by the enforcing agency. Refer to the current applicable permits on the State Water Resources Control Board website at: www.waterboards.ca.gov/constructionstormwater. Consideration to the stormwater runoff management measures should be given during the initial design process for appropriate integration into site development. 5.106.4 BICYCLE PARKING. For buildings within the authority of California Building Standards Commission as specified in Section 103, comply with Section 5.106.4.1. For buildings within the authority of the Division of the State Architect pursuant to Section 105, comply with Section 5.106.4.2 5.106.4.1 Bicycle parking. [BSC-CG] Comply with Sections 5.106.4.1.1 and 5.106.4.1.2; or meet the applicable local ordinance, whichever is stricter. 5.106.4.1.1 Short-term bicycle parking. If the new project or an addition or alteration is anticipated to generate visitor traffic, provide permanently anchored bicycle racks within 200 feet of the visitors' entrance, readily visible to passers-by, for 5% of new visitor motorized vehicle parking spaces being added, with a minimum of one two-bike capacity rack. Exception: Additions or alterations which add nine or less visitor vehicular parking spaces. 5.106.4.1.2 Long-term bicycle parking. For new buildings with tenant spaces that have 10 or more tenant-occupants, provide secure bicycle parking for 5 percent of the tenant-occupant vehicular parking spaces with a minimum of one bicycle parking facility. 5.106.4.1.3 For additions or alterations that add 10 or more tenant-occupant vehicular parking spaces, provide secure bicycle parking for 5 percent of the tenant vehicular parking spaces being added, with a minimum of one bicycle parking facility. 5.106.4.1.4 For new shell buildings in phased projects provide secure bicycle parking for 5 percent of the anticipated tenant-occupant vehicular parking spaces with a minimum of one bicycle parking facility. 5.106.4.1.5 Acceptable bicycle parking facility for Sections 5.106.4.1.2, 5.106.4.1.3, and 5.106.4.1.4 shall be convenient from the street and shall meet one of the following: 1. Covered, lockable enclosures with permanently anchored racks for bicycles; 2. Lockable bicycle rooms with permanently anchored racks; or 3. Lockable, permanently anchored bicycle lockers. Note: Additional information on recommended bicycle accommodations may be obtained from Sacramento Area Bicycle Advocates. 5.106.4.2 Bicycle parking. [DSA-SS] For public schools and community colleges, comply with Sections 5.106.4.2.1 and 5.106.4.2.2 5.106.4.2.1 Student bicycle parking. Provide permanently anchored bicycle racks conveniently accessed with a minimum of four two-bike capacity racks per new building. 5.106.4.2.2 Staff bicycle parking. Provide permanent, secure bicycle parking conveniently accessed with a minimum of two staff bicycle parking spaces per new building. Acceptable bicycle parking facilities shall be convenient from the street or staff parking area and shall meet one of the following: 1. Covered, lockable enclosures with permanently anchored racks for bicycles; 2. Lockable bicycle rooms with permanently anchored racks; or 3. Lockable, permanently anchored bicycle lockers. 5.106.5.3 Electric vehicle (EV) charging. [N] Construction to provide electric vehicle infrastructure and facilitate electric vehicle charging shall comply with Section 5.106.5.3.1 and shall be provided in accordance with regulations in the California Building Code and the California Electrical Code. Exceptions: 1. On a case-by-case basis where the local enforcing agency has determined compliance with this section is not feasible based upon one of the following conditions: a. Where there is no local utility power supply b. Where the local utility is unable to supply adequate power. c. Where there is evidence suitable to the local enforcement agency substantiating the local utility infrastructure design requirements, directly related to the implementation of Section 5.106.5.3, may adversely impact the construction cost of the project. 2. Parking spaces accessible only by automated mechanical car parking systems are not required to comply with this code section 5.106.5.3.1 EV capable spaces. [N] EV capable spaces shall be provided in accordance with Table 5.106.5.3.1 and the following requirements: 1. Raceways complying with the California Electrical Code and no less than 1-inch (25 mm) diameter shall be provided and shall originate at a service panel or a subpanel(s) serving the area, and shall terminate in close proximity to the proposed location of the EV capable and into a suitable listed cabinet, box enclosure or equivalent. A common raceway may be used to serve multiple EV charging spaces. 2. A service panel or subpanel (s) shall be provided with panel space and electrical load capacity for a dedicated 208/240 volt, 40-ampere minimum branch circuit for each EV capable space, with delivery of 30-ampere minimum to an installed EVSE at each EVCS. 3. The electrical system and any on-site distribution transformers shall have sufficient capacity to supply full rated amperage at each EV capable space. 4. The service panel or subpanel circuit directory shall identify the reserved overcurrent protective devices space(s) as "EV CAPABLE." The raceway termination location shall be permanently and visibly marked as "EV CAPABLE." Note: A parking space served by electric vehicle supply equipment or designed as a future EV charging space shall count as at least one standard automobile parking space only for the purpose of complying with any applicable minimum parking space requirements established by an enforcement agency. See vehicle Code Section 22511.2 for further details. TABLE 5.106.5.3.1 <table border="1"> <thead> <tr> <th>TOTAL NUMBER OF ACTUAL PARKING SPACES</th> <th>NUMBER OF REQUIRED EV CAPABLE SPACES</th> <th>NUMBER OF EVCS (EV CAPABLE SPACES PROVIDED WITH EVSE)/2</th> </tr> </thead> <tbody> <tr> <td>0-9</td> <td>0</td> <td>0</td> </tr> <tr> <td>10-25</td> <td>2</td> <td>0</td> </tr> <tr> <td>26-50</td> <td>8</td> <td>2</td> </tr> <tr> <td>51-75</td> <td>13</td> <td>3</td> </tr> <tr> <td>76-100</td> <td>17</td> <td>4</td> </tr> <tr> <td>101-150</td> <td>25</td> <td>6</td> </tr> <tr> <td>151-200</td> <td>35</td> <td>9</td> </tr> <tr> <td>201 AND OVER</td> <td>20% of total¹</td> <td>25% of EV capable spaces¹</td> </tr> </tbody> </table> 1. Where there is insufficient electrical supply. 2. The number of required EVCS (EV capable spaces provided with EVSE) in column 3 count towards the total number of required EV capable spaces shown in column 2. 5.106.5.3.2 Electric vehicle charging stations (EVCS) EV capable spaces shall be provided with EVSE to create EVCS in the number indicated in Table 5.106.5.3.1. The EVCS required by Table 5.106.5.3.1 may be provided with EVSE in any combination of Level 2 and Direct Current Fast Charging (DCFC), except that at least one Level 2 EVSE shall be provided. One EV charger with multiple connectors capable of charging multiple EVs simultaneously shall be permitted if the electrical load capacity required by Section 5.106.5.3.1 for each EV capable space is accumulatively supplied to the EV charger. The installation of each DCFC EVSE shall be permitted to reduce the minimum number of required EV capable spaces without EVSE by five and reduce proportionally the required electrical load capacity to the service panel or subpanel.	TOTAL NUMBER OF ACTUAL PARKING SPACES	NUMBER OF REQUIRED EV CAPABLE SPACES	NUMBER OF EVCS (EV CAPABLE SPACES PROVIDED WITH EVSE)/2	0-9	0	0	10-25	2	0	26-50	8	2	51-75	13	3	76-100	17	4	101-150	25	6	151-200	35	9	201 AND OVER	20% of total ¹	25% of EV capable spaces ¹
TOTAL NUMBER OF ACTUAL PARKING SPACES	NUMBER OF REQUIRED EV CAPABLE SPACES	NUMBER OF EVCS (EV CAPABLE SPACES PROVIDED WITH EVSE)/2																												
0-9	0	0																												
10-25	2	0																												
26-50	8	2																												
51-75	13	3																												
76-100	17	4																												
101-150	25	6																												
151-200	35	9																												
201 AND OVER	20% of total ¹	25% of EV capable spaces ¹																												

Y	N/A	RESPON. PARTY	5.106.5.3.3 Use of automatic load management systems (ALMS). ALMS shall be permitted for EVCS. When ALMS is installed, the required electrical load capacity specified in Section 5.106.5.3.1 for each EVCS may be reduced when served by an EVSE controlled by an ALMS. Each EVSE controlled by an ALMS shall deliver a minimum 30 amperes to an EV when charging one vehicle and shall deliver a minimum 3.3 kW while simultaneously charging multiple EVs. 5.106.5.3.4 Accessible EVCS. When EVSE is installed, accessible EVSC shall be provided in accordance with the <i>California Building Code</i> , Chapter 11B, Section 11B-228.3. Note: For EVCS signs, refer to Caltrans Traffic Operations Policy Directive 13-01 (Zero Emission Vehicle Signs and Pavement Markings) or its successor(s). 5.106.5.4 Electric Vehicle (EV) charging: medium-duty and heavy-duty. [N] Construction shall comply with section 5.106.5.4.1 to facilitate future installation of electric vehicle supply equipment (EVSE). Construction for warehouses, grocery stores and retail stores with planned off-street loading spaces shall also comply with Section 5.106.5.4.1 for future installation of medium- and heavy-duty EVSE. Exceptions: 1. On a case-by-case basis where the local enforcing agency has determined compliance with this section is not feasible based upon one of the following conditions: a. Where there is no local utility power supply. b. Where the local utility is unable to supply adequate power. c. Where there is evidence suitable to the local enforcing agency substantiating that additional local utility infrastructure design requirements, directly related to the implementation of Section 5.106.5.3, may adversely impact the construction cost of the project. When EVSE(s) is/are installed, it shall be in accordance with the <i>California Building Code</i> , the <i>California Electrical Code</i> and as follows: 5.106.5.4.1 Electric vehicle charging readiness requirements for warehouse, grocery stores and retail stores with planned off-street loading spaces. [N] In order to avoid future demolition when adding EV charging supply and distribution equipment, spare raceways(s) or busway(s) and adequate capacity for transformers(s), service panel(s) or subpanel(s) shall be installed at the time of construction in accordance with the California Electrical Code. Construction plans and specifications shall include but are not limited to, the following: 1. The transformer, main service equipment and subpanel shall meet the minimum power requirement in Table 5.106.5.4.1 to accommodate the dedicated branch circuits for the future installation of EVSE. 2. The construction documents shall indicate on or more location(s) convenient to the planned offstreet loading space(s) reserved for medium- and heavy-duty ZEV charging cabinets and charging dispensers, and a pathway reserved for routing of conduit from the termination of the raceway(s) or busway(s) to the charging cabinet(s) and dispenser(s) as shown in Table 5.106.5.4.1. 3. Raceway(s) or busway(s) originating at a main service panel or a subpanel(s) serving the area where potential future medium- and heavy-duty EVSE will be located and shall terminate in close proximity to the potential future location of the charging equipment for medium- and heavy-duty vehicles. 4. The raceway(s) or busway(s) shall be sufficient size to carry the minimum additional system load to the future location of the charging for medium- and heavy-duty ZEVs as shown in Table 5.106.5.4.1. TABLE 5.106.5.4.1 RACEWAY CONDUIT AND PANEL POWER REQUIREMENTS FOR MEDIUM- AND HEAVY-DUTY EVSE [N] <table border="1"> <thead> <tr> <th>BUILDING TYPE</th> <th>BUILDING SIZE (SQ. FT.)</th> <th>NUMBER OF OFF-STREET LOADING SPACES</th> <th>ADDITIONAL CAPACITY REQUIRED (KVA) FOR RACEWAY & BUSWAY AND TRANSFORMER & PANEL</th> </tr> </thead> <tbody> <tr> <td rowspan="2">Grocery</td> <td>10,000 to 90,000</td> <td>1 or 2</td> <td>200</td> </tr> <tr> <td>Greater than 90,000</td> <td>3 or Greater</td> <td>400</td> </tr> <tr> <td rowspan="2">Retail</td> <td>10,000 to 135,000</td> <td>1 or 2</td> <td>200</td> </tr> <tr> <td>Greater than 135,000</td> <td>3 or Greater</td> <td>400</td> </tr> <tr> <td rowspan="2">Warehouse</td> <td>20,000 to 256,000</td> <td>1 or 2</td> <td>200</td> </tr> <tr> <td>Greater than 256,000</td> <td>3 or Greater</td> <td>400</td> </tr> </tbody> </table> 5.106.8 LIGHT POLLUTION REDUCTION. [N] 1 Outdoor lighting systems shall be designed and installed to comply with the following: 1. The minimum requirements in the California Energy Code for Lighting Zones 0-4 as defined in Chapter 10, Section 10-114 of the California Administrative Code; and 2. Backlight (B) ratings as defined in IES TM-15-11 (shown in Table A-1 in Chapter 8); 3. Uplight and Glare ratings as defined in California Energy Code (shown in Tables 130.2-A and 130.2-B in Chapter 8) and 4. Allowable BUG ratings not exceeding those shown in Table 5.106.8. [N] or Comply with a local ordinance lawfully enacted pursuant to Section 101.7, whichever is more stringent. Exceptions: [N] 1. Luminaires that qualify as exceptions in Sections 130.2 (b) and 140.7 of the California Energy Code. 2. Emergency lighting. 3. Building facade meeting the requirements in Table 140.7-B of the California Energy Code, Part 6. 4. Custom lighting features as allowed by the local enforcing agency, as permitted by Section 101.8 Alternate materials, designs and methods of construction. 5. Luminaires with less than 6,200 initial luminaire lumens. TABLE 5.106.8 [N] MAXIMUM ALLOWABLE BACKLIGHT, UPLIGHT AND GLARE (BUG) RATINGS ^{1,2} <table border="1"> <thead> <tr> <th>ALLOWABLE RATING</th> <th>LIGHTING ZONE L0</th> <th>LIGHTING ZONE L21</th> <th>LIGHTING ZONE L22</th> <th>LIGHTING ZONE L23</th> <th>LIGHTING ZONE L24</th> </tr> </thead> <tbody> <tr> <td>MAXIMUM ALLOWABLE BACKLIGHT RATING ²</td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>Luminaire greater than 2 mounting heights (MH) from property line</td> <td>N/A</td> <td>No Limit</td> <td>No Limit</td> <td>No Limit</td> <td>No Limit</td> </tr> <tr> <td>Luminaire back hemisphere is 1-2 MH from property line</td> <td>N/A</td> <td>B2</td> <td>B3</td> <td>B4</td> <td>B4</td> </tr> <tr> <td>Luminaire back hemisphere is 0.5-1 MH from property line</td> <td>N/A</td> <td>B1</td> <td>B2</td> <td>B3</td> <td>B3</td> </tr> <tr> <td>Luminaire back hemisphere is less than 0.5 MH from property line</td> <td>N/A</td> <td>B0</td> <td>B0</td> <td>B1</td> <td>B2</td> </tr> <tr> <td>MAXIMUM ALLOWABLE UPLIGHT RATING (U)</td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>For area lighting ¹</td> <td>N/A</td> <td>U0</td> <td>U0</td> <td>U0</td> <td>U0</td> </tr> <tr> <td>For all other outdoor lighting, including decorative luminaires</td> <td>N/A</td> <td>U1</td> <td>U2</td> <td>U3</td> <td>UR</td> </tr> </tbody> </table>	BUILDING TYPE	BUILDING SIZE (SQ. FT.)	NUMBER OF OFF-STREET LOADING SPACES	ADDITIONAL CAPACITY REQUIRED (KVA) FOR RACEWAY & BUSWAY AND TRANSFORMER & PANEL	Grocery	10,000 to 90,000	1 or 2	200	Greater than 90,000	3 or Greater	400	Retail	10,000 to 135,000	1 or 2	200	Greater than 135,000	3 or Greater	400	Warehouse	20,000 to 256,000	1 or 2	200	Greater than 256,000	3 or Greater	400	ALLOWABLE RATING	LIGHTING ZONE L0	LIGHTING ZONE L21	LIGHTING ZONE L22	LIGHTING ZONE L23	LIGHTING ZONE L24	MAXIMUM ALLOWABLE BACKLIGHT RATING ²						Luminaire greater than 2 mounting heights (MH) from property line	N/A	No Limit	No Limit	No Limit	No Limit	Luminaire back hemisphere is 1-2 MH from property line	N/A	B2	B3	B4	B4	Luminaire back hemisphere is 0.5-1 MH from property line	N/A	B1	B2	B3	B3	Luminaire back hemisphere is less than 0.5 MH from property line	N/A	B0	B0	B1	B2	MAXIMUM ALLOWABLE UPLIGHT RATING (U)						For area lighting ¹	N/A	U0	U0	U0	U0	For all other outdoor lighting, including decorative luminaires	N/A	U1	U2	U3	UR
BUILDING TYPE	BUILDING SIZE (SQ. FT.)	NUMBER OF OFF-STREET LOADING SPACES	ADDITIONAL CAPACITY REQUIRED (KVA) FOR RACEWAY & BUSWAY AND TRANSFORMER & PANEL																																																																															
Grocery	10,000 to 90,000	1 or 2	200																																																																															
	Greater than 90,000	3 or Greater	400																																																																															
Retail	10,000 to 135,000	1 or 2	200																																																																															
	Greater than 135,000	3 or Greater	400																																																																															
Warehouse	20,000 to 256,000	1 or 2	200																																																																															
	Greater than 256,000	3 or Greater	400																																																																															
ALLOWABLE RATING	LIGHTING ZONE L0	LIGHTING ZONE L21	LIGHTING ZONE L22	LIGHTING ZONE L23	LIGHTING ZONE L24																																																																													
MAXIMUM ALLOWABLE BACKLIGHT RATING ²																																																																																		
Luminaire greater than 2 mounting heights (MH) from property line	N/A	No Limit	No Limit	No Limit	No Limit																																																																													
Luminaire back hemisphere is 1-2 MH from property line	N/A	B2	B3	B4	B4																																																																													
Luminaire back hemisphere is 0.5-1 MH from property line	N/A	B1	B2	B3	B3																																																																													
Luminaire back hemisphere is less than 0.5 MH from property line	N/A	B0	B0	B1	B2																																																																													
MAXIMUM ALLOWABLE UPLIGHT RATING (U)																																																																																		
For area lighting ¹	N/A	U0	U0	U0	U0																																																																													
For all other outdoor lighting, including decorative luminaires	N/A	U1	U2	U3	UR																																																																													

Y	N/A	RESPON. PARTY	MAXIMUM ALLOWABLE GLARE RATING ¹ (G) <table border="1"> <thead> <tr> <th>GLARE RATING ¹ (G)</th> <th>N/A</th> <th>G1</th> <th>G2</th> <th>G3</th> <th>G4</th> </tr> </thead> <tbody> <tr> <td>MAXIMUM ALLOWABLE GLARE RATING ¹ (G)</td> <td>N/A</td> <td>G0</td> <td>G1</td> <td>G1</td> <td>G2</td> </tr> <tr> <td>MAXIMUM ALLOWABLE GLARE RATING ¹ (G)</td> <td>N/A</td> <td>G0</td> <td>G0</td> <td>G1</td> <td>G1</td> </tr> <tr> <td>MAXIMUM ALLOWABLE GLARE RATING ¹ (G)</td> <td>N/A</td> <td>G0</td> <td>G0</td> <td>G0</td> <td>G1</td> </tr> </tbody> </table> 1. IESNA Lighting Zones 0 and 5 are not applicable; refer to Lighting Zones as defined in the <i>California Energy Code</i> and Chapter 10 of the <i>California Administrative Code</i> . 2. For property lines that abut public walkways, bikeways, plazas and parking lots, the property line may be considered to be 5 feet beyond the actual property line for purpose of determining compliance with this section. For property lines that abut public roadways and public transit corridors, the property line may be considered to be the centerline of the public roadway or public transit corridor for the purpose of determining compliance with this section. 3. General lighting luminaires in areas such as outdoor parking, sales or storage lots shall meet these reduced ratings. Decorative luminaires located in these areas shall meet U-value limits for "all other outdoor lighting" 5.106.8.1 Facing-Backlight Luminaires within 2MHz of a property line shall be oriented so that the nearest property line is behind the fixture, and shall comply with the backlight rating specified in Table 5.106.8 based on the lighting zone and distance to the nearest point of that property line. Exception: Corners. If two property lines (or two segments of the same property line) have equidistant point to the luminaire, then the luminaire may be oriented so that the intersection of the two lines (the corner) is directly behind the luminaire. The luminaire shall still use the distance to the nearest point(s) on the property lines to determine the required backlight rating. 5.106.8.2 Facing-Glare. For luminaires covered by 5.106.8.1, if a property line also exists within or extends into the front hemisphere within 2MHz of the luminaire then the luminaire shall comply with the more stringent glare rating specified in Table 5.106.8 based on the lighting zone and distance to the nearest point on the nearest property line within the front hemisphere. Note: [N] 1. See also <i>California Building Code</i> , Chapter 12, Section 1205.6 for college campus lighting requirements for parking facilities and walkways. 2. Refer to Chapter 8 (Compliance Forms, Worksheets and Reference Material) for IES TM-15-11 Table A-1, <i>California Energy Code</i> Tables 130.2-A and 130.2-B. 3. Refer to the <i>California Building Code</i> for requirements for additions and alterations. 5.106.10 GRADING AND PAVING. Construction plans shall indicate how site grading or a drainage system will manage all surface water flows to keep water from entering buildings. Examples of methods to manage surface water include, but are not limited to, the following: 1. Swales. 2. Water collection and disposal systems. 3. French drains. 4. Water retention gardens. 5. Other water measures which keep surface water away from buildings and aid in groundwater recharge. Exception: Additions and alterations not altering the drainage path. 5.106.12 SHADE TREES [DSA-SS]. Shade Trees shall be planted to comply with Sections 5.106.12.1, 5.106.12.2, and 5.106.12.3. Percentages shown shall be measured at noon on the summer solstice. Landscape irrigation necessary to establish and maintain tree health shall comply with Section 5.304.6. 5.106.12.1 Surface parking areas. Shade tree plantings, minimum #10 container size or equal, shall be installed to provide shade over 50 percent of the parking area within 15 years. Exceptions: Surface parking area covered by solar photovoltaic shade structures with roofing materials that comply with Table A5.106.11.2.2 in Appendix A5 shall be permitted in whole or in part in lieu of shade tree planting. 5.106.12.2 Landscape areas. Shade tree plantings, minimum #10 container size or equal shall be installed to provide shade of 20% of the landscape area within 15 years. Exceptions: Playfields for organized sport activity are not included in the total area calculation. 5.106.12.3. Hardscape areas. Shade tree plantings, minimum #10 container size or equal shall be installed to provide shade over 20 percent of the hardscape area within 15 years. Exceptions: 1. Walks, hardscape areas covered by solar photovoltaic shade structures or shade structures with roofing materials that comply with Table A5.106.11.2.2 in Appendix A5 shall be permitted in whole or in part in lieu of shade tree planting. 2. Designated and marked play areas of organized sport activity are not included in the total area calculation. DIVISION 5.2 ENERGY EFFICIENCY SECTION 5.201 GENERAL 5.201.1 Scope [BSC-CG]. <i>California Energy Code [DSA-SS].</i> For the purposes of mandatory energy efficiency standards in this code, the California Energy Commission will continue to adopt mandatory building standards. DIVISION 5.3 WATER EFFICIENCY AND CONSERVATION SECTION 5.301 GENERAL 5.301.1 Scope. The provisions of this chapter shall establish the means of conserving water use indoors, outdoors and in wastewater conveyance. SECTION 5.302 DEFINITIONS 5.302.1 Definitions. The following terms are defined in Chapter 2 (and are included here for reference) EVAPOTRANSPIRATION ADJUSTMENT FACTOR (ETAF) [DSA-SS]. An adjustment factor when applied to reference evapotranspiration that adjusts for plant factors and irrigation efficiency, which are two major influences on the amount of water that needs to be applied to the landscape. FOOTPRINT AREA [DSA-SS]. The total area of the furthest exterior wall of the structure projected to natural grade, not including exterior areas such as stairs, covered walkways, patios and decks. METERING FAUCET. A self-closing faucet that dispenses a specific volume of water for each actuation cycle. The volume or cycle duration can be fixed or adjustable. GRAYWATER. Pursuant to Health and Safety Code Section 17922.12, "graywater" means untreated wastewater that has not been contaminated by any toilet discharge, has not been affected by infectious, contaminated, or unhealthy bodily wastes, and does not present a threat from contamination by unhealthful processing, manufacturing, or operating wastes. "Graywater" includes, but is not limited to wastewater from bathtubs, showers, bathroom washbasins, clothes washing machines and laundry tubs, but does not include waste water from kitchen sinks or dishwashers. MODEL WATER EFFICIENT LANDSCAPE ORDINANCE (MWLEO). The California ordinance regulating landscape design, installation and maintenance practices that will ensure commercial, multifamily and other developer installed landscapes greater than 2500 square feet meet an irrigation water budget developed based on landscaped area and climatological parameters. MODEL WATER EFFICIENT LANDSCAPE ORDINANCE (MWLEO), [HCD] The California model ordinance (California Code of Regulations, Title 23, Division 2, Chapter 2.7), regulating landscape design, installation and maintenance practices. Local agencies are required to adopt the updated MWLEO, or adopt a local ordinance at least as effective as the MWLEO. POTABLE WATER. Water that is drinkable and meets the U.S. Environmental Protection Agency (EPA) Drinking Water Standards. See definition in the California Plumbing Code, Part 5. POTABLE WATER, [HCD] Water that is satisfactory for drinking, culinary, and domestic purposes, and meets the U.S. Environmental Protection Agency (EPA) Drinking Water Standards and the requirements of the Health Authority Having Jurisdiction. RECYCLED WATER. Water which, as a result of treatment of waste, is suitable for a direct beneficial use or a controlled use that would not otherwise occur [Water Code Section 13050 (n)]. Simply put, recycled water is water treated to remove waste matter attaining a quality that is suitable to use the water again. SUBMETER, [HCD 1] A secondary device beyond a meter that measures water consumption of an individual rental unit within a multifamily residential structure or mixed-use residential and commercial structure. (See Civic Code Section 1954.202 (g) and Water code Section 517 for additional details.) WATER BUDGET. Is the estimated total landscape irrigation water use which shall not exceed the maximum applied water allowance calculated in accordance with the Department of Water Resources Model Efficient Landscape Ordinance (MWLEO).	GLARE RATING ¹ (G)	N/A	G1	G2	G3	G4	MAXIMUM ALLOWABLE GLARE RATING ¹ (G)	N/A	G0	G1	G1	G2	MAXIMUM ALLOWABLE GLARE RATING ¹ (G)	N/A	G0	G0	G1	G1	MAXIMUM ALLOWABLE GLARE RATING ¹ (G)	N/A	G0	G0	G0	G1
GLARE RATING ¹ (G)	N/A	G1	G2	G3	G4																						
MAXIMUM ALLOWABLE GLARE RATING ¹ (G)	N/A	G0	G1	G1	G2																						
MAXIMUM ALLOWABLE GLARE RATING ¹ (G)	N/A	G0	G0	G1	G1																						
MAXIMUM ALLOWABLE GLARE RATING ¹ (G)	N/A	G0	G0	G0	G1																						

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 02-123058 INC:
 REVIEWED FOR
 SS ☒ PLS ☒ ACS ☒
 DATE: 07/26/2024

R&S TAVARES ASSOCIATES
 DESIGN & CONSULTING PROJECT
 11590 W BERNARDO COURT, SUITE 100
 SAN DIEGO, CA 92127
 WWW.RSTAVARES.COM

PROFESSIONAL STAMP
 REGISTERED PROFESSIONAL ARCHITECT
 MANNY D. FROST
 63380
 03/31/24
 STATE OF CALIFORNIA
 RST#22088
 02/16/24

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT
 Class Leasing
 1651 Juanita Street, San Jacinto, CA 92583
 Voice (951) 943-1908 Fax (951) 943-5768

ORIGINAL PC STATE AGENCY APPROVAL
 APPROVED
 DIV. OF THE STATE ARCHITECT
 APP: 04-123058 PC
 REVIEWED FOR
 SS ☒ PLS ☒ ACS ☒ CG ☒
 DATE: 02/20/2024

Revision Schedule

#	Description	Date

PRE-CHECK (PC) DOCUMENT
 Code: 2022 CBC
 A separate project application for construction is required

PROJECT TITLE
 PC 2022 CBC: 24' x 40'
 EXPANDABLE TO
 120' x 40'

SHEET TITLE
 CAL GREEN CHECKLIST

PROJECT NUMBER
 22088

DRAWN BY
 rMc/SC

CHECKED BY
 RH/RT

DATE

SHEET NO.
 A0.6
 SHEET OF

C:\Users\Aria\Documents\200303 - Aries, 24x40 PC - MainFile - Low Seismic 6.7_CSEA24D63.rvt

6/5/2021 11:45:12 PM



California

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

NONRESIDENTIAL MANDATORY MEASURES, SHEET 2 (January 2023)

Y	N/A	RESPON. PARTY	Y	N/A	RESPON. PARTY	Y	N/A	RESPON. PARTY	Y	N/A	RESPON. PARTY	Y	N/A	RESPON. PARTY																																										
<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>																																											
SECTION 5.303 INDOOR WATER USE 5.303.1 METERS. Separate submeters or metering devices shall be installed for the uses described in Sections 503.1.1 and 503.1.2. 5.303.1.1 Buildings in excess of 50,000 square feet. Separate submeters shall be installed as follows: 1. For each individual leased, rented or other tenant space within the building projected to consume more than 100 gal/day (380 L/day), including, but not limited to, spaces used for laundry or cleaners, restaurant or food service, medical or dental office, laboratory, or beauty salon or barber shop. 2. Where separate submeters for individual building tenants are unfeasible, for water supplied to the following subsystems: a. Makeup water for cooling towers where flow through is greater than 500 gpm (30 L/s). b. Makeup water for evaporative coolers greater than 6 gpm (0.04 L/s). c. Steam and hot water boilers with energy input more than 500,000 Btu/h (147 kW). 5.303.1.2 Excess consumption. A separate submeter or metering device shall be provided for any tenant within a new building or within an addition that is projected to consume more than 1,000 gal/day. 5.303.3 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS. Plumbing fixtures (water closets and urinals) and fittings (faucets and showerheads) shall comply with the following: 5.303.3.1 Water Closets. The effective flush volume of all water closets shall not exceed 1.28 gallons per flush. Tank-type water closets shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Tank-Type Toilets. Note: The effective flush volume of dual flush toilets is defined as the composite, average flush volume of two reduced flushes and one full flush. 5.303.3.2 Urinals. 5.303.3.2.1 Wall-mounted Urinals. The effective flush volume of wall-mounted urinals shall not exceed 0.125 gallons per flush. 5.303.3.2.2 Floor-mounted Urinals. The effective flush volume of floor-mounted or other urinals shall not exceed 0.5 gallons per flush. 5.303.3.3 Showerheads. [BSC-CG] 5.303.3.3.1 Single showerhead. Showerheads shall have a maximum flow rate of not more than 1.8 gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Showerheads. 5.303.3.3.2 Multiple showerheads serving one shower. When a shower is served by more than one showerhead, the combined flow rate of all the showerheads and/or other shower outlets controlled by a single valve shall not exceed 1.8 gallons per minute at 80 psi, or the shower shall be designed to allow only one shower outlet to be in operation at a time. Note: A hand-held shower shall be considered a showerhead. 5.303.3.4 Faucets and fountains. 5.303.3.4.1 Nonresidential Lavatory faucets. Lavatory faucets shall have a maximum flow rate of not more than 0.5 gallons per minute at 60 psi. 5.303.3.4.2 Kitchen faucets. Kitchen faucets shall have a maximum flow rate of not more than 1.8 gallons per minute at 60 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, but not to exceed 2.2 gallons per minute at 60 psi, and must default to a maximum flow rate of 1.8 gallons per minute at 60 psi. 5.303.3.4.3 Wash fountains. Wash fountains shall have a maximum flow rate of not more than 1.8 gallons per minute/20 [rim space (inches) at 60 psi]. 5.303.3.4.4 Metering faucets. Metering faucets shall not deliver more than 0.20 gallons per cycle. 5.303.3.4.5 Metering faucets for wash fountains. Metering faucets for wash fountains shall have a maximum flow rate of not more than 0.20 gallons per minute/20 [rim space (inches) at 60 psi]. Note: Where compelling faucets are unavailable, aerators or other means may be used to achieve reduction. 5.303.3.4.6 Pre-rinse spray valve When installed, shall meet the requirements in the <i>California Code of Regulations</i> , Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) Table H-2, Section 1605.3 (h)(4)(A), and Section 1607 (d)(7), and shall be equipped with an integral automatic shutoff. FOR REFERENCE ONLY: The following table and code section have been reprinted from the <i>California Code of Regulations</i> , Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) and Section 1605.3 (h)(4)(A). <table><thead><tr><th colspan="2">TABLE H-2</th></tr><tr><th colspan="2">STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALVES MANUFACTURED ON OR AFTER JANUARY 28, 2019</th></tr><tr><th>PRODUCT CLASS [spray force in ounce force (ozf)]</th><th>MAXIMUM FLOW RATE (gpm)</th></tr></thead><tbody><tr><td>Product Class 1 (≤ 5.0 ozf)</td><td>1.00</td></tr><tr><td>Product Class 2 (> 5.0 ozf and ≤ 8.0 ozf)</td><td>1.20</td></tr><tr><td>Product Class 3 (> 8.0 ozf)</td><td>1.28</td></tr></tbody></table> 5.303.4 COMMERCIAL KITCHEN EQUIPMENT. 5.303.4.1 Food Waste Disposers. Disposers shall either modulate the use of water to no more than 1 gpm when the disposer is not in use (not actively grinding food waste/no-load) or shall automatically shut off after no more than 10 minutes of inactivity. Disposers shall use no more than 8 gpm of water. Note: This code section does not affect local jurisdiction authority to prohibit or require disposer installation. 5.303.5 AREAS OF ADDITION OR ALTERATION. For those occupancies within the authority of the California Building Standards Commission as specified in Section 103, the provisions of Section 5.303.3 and 5.303.4 shall apply to new fixtures in additions or areas of alteration to the building. 5.303.6 STANDARDS FOR PLUMBING FIXTURES AND FITTINGS. Plumbing fixtures and fittings shall be installed in accordance with the <i>California Plumbing Code</i> , and shall meet the applicable standards referenced in Table 1701.1 of the <i>California Plumbing Code</i> and in Chapter 6 of this code. SECTION 5.304 OUTDOOR WATER USE 5.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS. Nonresidential developments shall comply with a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWELO), whichever is more stringent. Notes: 1. The Model Water Efficient Landscape Ordinance (MWELO) is located in the California Code of Regulations, Title 23, Chapter 2.7, Division 2. 2. MWELO and supporting documents, including a water budget calculator, are available at: https://www.water.ca.gov/ . 5.304.6 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS. For public schools and community colleges, landscape projects as described in Sections 5.304.6.1 and 5.304.6.2 shall comply with the California Department of Water Resources Model Water Efficient Landscape Ordinance (MWELO) commencing with Section 490 of Chapter 2.7, Division 2, Title 23, <i>California Code of Regulations</i> , except that the evapotranspiration adjustment factor (ETAF) shall be 0.65 with an additional water allowance for special landscape areas (SLA) of 0.35. Exception: Any project with an aggregate landscape area of 2,500 square feet or less may comply with the prescriptive measures contained in Appendix D of the MWELO. 5.304.6.1 Newly constructed landscapes. New construction projects with an aggregate landscape area equal to or greater than 500 square feet. 5.304.6.2 Rehabilitated landscapes. Rehabilitated landscape projects with an aggregate landscape area equal to or greater than 1,200 square feet. DIVISION 5.4 MATERIAL CONSERVATION AND RESOURCE EFFICIENCY SECTION 5.401 GENERAL 5.401.1 SCOPE. The provisions of this chapter shall outline means of achieving material conservation and resource efficiency through protection of buildings from exterior moisture, construction waste diversion, employment of techniques to reduce pollution through recycling of materials, and building commissioning or testing and adjusting.															TABLE H-2		STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALVES MANUFACTURED ON OR AFTER JANUARY 28, 2019		PRODUCT CLASS [spray force in ounce force (ozf)]	MAXIMUM FLOW RATE (gpm)	Product Class 1 (≤ 5.0 ozf)	1.00	Product Class 2 (> 5.0 ozf and ≤ 8.0 ozf)	1.20	Product Class 3 (> 8.0 ozf)	1.28	SECTION 5.402 DEFINITIONS 5.402.1 DEFINITIONS. The following terms are defined in Chapter 2 (<i>and are included here for reference</i>) ADJUST. To regulate fluid flow rate and air patterns at the terminal equipment, such as to reduce fan speed or adjust a damper. BALANCE. To proportion flows within the distribution system, including sub-mains, branches and terminals, according to design quantities. BUILDING COMMISSIONING. A systematic quality assurance process that spans the entire design and construction process, including verifying that building systems and components are planned, designed, installed, tested, operated and maintained to meet the owner's project requirements. ORGANIC WASTE. Food waste, green waste, landscape and pruning waste, nonhazardous wood waste, and food soiled paper waste that is mixed in with food waste. TEST. A procedure to determine quantitative performance of a system or equipment SECTION 5.407 WATER RESISTANCE AND MOISTURE MANAGEMENT 5.407.1 WEATHER PROTECTION. Provide a weather-resistant exterior wall and foundation envelope as required by California Building Code Section 1402.2 (Weather Protection), manufacturer's installation instructions or local ordinance, whichever is more stringent. 5.407.2 MOISTURE CONTROL. Employ moisture control measures by the following methods. 5.407.2.1 Sprinklers. Design and maintain landscape irrigation systems to prevent spray on structures. 5.407.2.2 Entries and openings. Design exterior entries and/or openings subject to foot traffic or wind-driven rain to prevent water intrusion into buildings as follows: 5.407.2.2.1 Exterior door protection. Primary exterior entries shall be covered to prevent water intrusion by using nonabsorbent floor and wall finishes within at least 2 feet around and perpendicular to such openings plus at least one of the following: 1. An installed awning at least 4 feet in depth. 2. The door is protected by a roof overhang at least 4 feet in depth. 3. The door is recessed at least 4 feet. 4. Other methods which provide equivalent protection. 5.407.2.2.2 Flashing. Install flashings integrated with a drainage plane. SECTION 5.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING 5.408.1 CONSTRUCTION WASTE MANAGEMENT. Recycle and/or salvage for reuse a minimum of 65% of the non-hazardous construction and demolition waste in accordance with Section 5.408.1.1, 5.408.1.2 or 5.408.1.3, or meet a local construction and demolition waste management ordinance, whichever is more stringent. 5.408.1.1 Construction waste management plan. Where a local jurisdiction does not have a construction and demolition waste management ordinance, submit a construction waste management plan that: 1. Identifies the construction and demolition waste materials to be diverted from disposal by efficient usage, recycling, reuse on the project or salvage for future use or sale. 2. Determines if construction and demolition waste materials will be sorted on-site (source-separated) or bulk mixed (single stream). 3. Identifies diversion facilities where construction and demolition waste material collected will be taken. 4. Specifies that the amount of construction and demolition waste materials diverted shall be calculated by weight or volume, but not by both. 5.408.1.2 Waste Management Company. Utilize a waste management company that can provide verifiable documentation that the percentage of construction and demolition waste material diverted from the landfill complies with this section. Note: The owner or contractor shall make the determination if the construction and demolition waste material will be diverted by a waste management company. Exceptions to Sections 5.408.1.1 and 5.408.1.2: 1. Excavated soil and land-clearing debris. 2. Alternate waste reduction methods developed by working with local agencies if diversion or recycle facilities capable of compliance with this item do not exist. 3. Demolition waste meeting local ordinance or calculated in consideration of local recycling facilities and markets. 5.408.1.3 Waste stream reduction alternative. The combined weight of new construction disposal that does not exceed two pounds per square foot of building area may be deemed to meet the 65% minimum requirement as approved by the enforcing agency. 5.408.1.4 Documentation. Documentation shall be provided to the enforcing agency which demonstrates compliance with Sections 5.408.1.1, through 5.408.1.3. The waste management plan shall be updated as necessary and shall be accessible during construction for examination by the enforcing agency. Notes: 1. Sample forms found in "A Guide to the California Green Building Standards Code (Nonresidential)" located www.dgs.ca.gov/BSC/Resources/Page-Content/Building-Standards-Commission-Resources-List-Folder/CALGreen may be used to assist in documenting compliance with the waste management plan. 2. Mixed construction and demolition debris processors can be located at the California Department of Resources Recycling and Recovery (CalRecycle). 5.408.2 UNIVERSAL WASTE. [A] Additions and alterations to a building or tenant space that meet the scoping provisions in Section 301.3 for nonresidential additions and alterations, shall require verification that Universal Waste items such as fluorescent lamps and ballast and mercury containing thermostats as well as other California prohibited Universal Waste materials are disposed of properly and are diverted from landfills. A list of prohibited Universal Waste materials shall be included in the construction documents. Note: Refer to the Universal Waste Rule link at: http://www.dts.ca.gov/universalwaste/ 5.408.3 EXCAVATED SOIL AND LAND CLEARING DEBRIS. 100 percent of trees, stumps, rocks and associated vegetation and soils resulting primarily from land clearing shall be reused or recycled. For a phased project, such material may be stockpiled on site until the storage site is developed. Exception: Reuse, either on or off-site, of vegetation or soil contaminated by disease or pest infestation. Notes: 1. If contamination by disease or pest infestation is suspected, contact the County Agricultural Commissioner and follow its direction for recycling or disposal of the material. 2. For a map of know pest and/or disease quarantine zones, consult with the California Department of Food and Agriculture. (www.cdffa.ca.gov) SECTION 5.410 BUILDING MAINTENANCE AND OPERATIONS 5.410.1 RECYCLING BY OCCUPANTS. Provide readily accessible areas that serve the entire building and are identified for the depositing, storage and collection of non-hazardous materials for recycling, including (at a minimum) paper, corrugated cardboard, glass, plastics, organic waste, and metals or meet a lawfully enacted local recycling ordinance, if more restrictive. Exception: Rural jurisdictions that meet and apply for the exemption in Public Resources Code 42649.82 (a)(2)(A) et seq. shall also be exempt from the organic waste portion of this section. 5.410.1.1 Additions. All additions conducted within a 12-month period under single or multiple permits, resulting in an increase of 30% or more in floor area, shall provide recycling areas on site. Exception: Additions within a tenant space resulting in less than a 30% increase in the tenant space floor area. 5.410.1.2 Sample ordinance. Space allocation for recycling areas shall comply with Chapter 18, Part 3, Division 30 of the <i>Public Resources Code</i> . Chapter 18 is known as the California Solid Waste Reuse and Recycling Access Act of 1991 (Act). Note: A sample ordinance for use by local agencies may be found in Appendix A of the document at the CalRecycle's web site.										5.410.2 COMMISSIONING. [N] New buildings 10,000 square feet and over. For new buildings 10,000 square feet and over, building commissioning shall be included in the design and construction processes of the building project to verify that the building systems and components meet the owner's or owner representative's project requirements. Commissioning shall be performed in accordance with this section by trained personnel with experience on projects of comparable size and complexity. For I-occupancies that are not regulated by OSHPD or for I-occupancies and L-occupancies that are not regulated by the California Energy Code Section 100.0 Scope, all requirements in Sections 5.410.2 through 5.410.2.6 shall apply. Note: For energy-related systems under the scope (Section 100) of the California Energy Code, including heating, ventilation, air conditioning (HVAC) systems and controls, indoor lighting systems and controls, as well as water heating systems and controls, refer to California Energy Code Section 120.8 for commissioning requirements Commissioning requirements shall include: 1. Owner's or Owner representative's project requirements. 2. Basis of design. 3. Commissioning measures shown in the construction documents. 4. Commissioning plan. 5. Functional performance testing. 6. Documentation and training. 7. Commissioning report. Exceptions: 1. Unconditioned warehouses of any size. 2. Areas less than 10,000 square feet used for offices or other conditioned accessory spaces within unconditioned warehouses. 3. Tenant improvements less than 10,000 square feet as described in Section 303.1.1. 4. Open parking garages of any size, or open parking garage areas, of any size, within a structure. Note: For the purposes of this section, unconditioned shall mean a building, area, or room which does not provide heating and/or air conditioning. Informational Notes: 1. IAS AC 476 is an accreditation criteria for organizations providing training and/or certification of commissioning personnel. AC 476 is available to the Authority Having Jurisdiction as a reference for qualifications of commissioning personnel. AC 476 does not certify individuals to conduct functional performance tests or to adjust and balance systems. 2. Functional performance testing for heating, ventilation, air conditioning systems and lighting controls must be performed in compliance with the <i>California Energy Code</i> . 5.410.2.1 Owner's or Owner Representative's Project Requirements (OPR). [N] The expectations and requirements of the building appropriate to its phase shall be documented before the design phase of the project begins. This documentation shall include the following: 1. Environmental and sustainability goals. 2. Building sustainable goals. 3. Indoor environmental quality requirements. 4. Project program, including facility functions and hours of operation, and need for after hours operation. 5. Equipment and systems expectations. 6. Building operation and operation and maintenance (O&M) personnel expectations. 5.410.2.2 Basis of Design (BOD). [N] A written explanation of how the design of the building systems meets the OPR shall be completed at the design phase of the building project. The Basis of Design document shall cover the following systems: 1. Renewable energy systems. 2. Landscape irrigation systems. 3. Water reuse system. 5.410.2.3 Commissioning plan. [N] Prior to permit issuance a commissioning plan shall be completed to document how the project will be commissioned. The commissioning plan shall include the following: 1. General project information. 2. Commissioning goals. 3. Systems to be commissioned. Plans to test systems and components shall include: a. An explanation of the original design intent. b. Equipment and systems to be tested, including the extent of tests. c. Functions to be tested. d. Conditions under which the test shall be performed. e. Measurable criteria for acceptable performance. 4. Commissioning team information. 5. Commissioning process activities, schedules and responsibilities. Plans for the completion of commissioning shall be included. 5.410.2.4 Functional performance testing. [N] Functional performance tests shall demonstrate the correct installation and operation of each component, system and system-to-system interface in accordance with the approved plans and specifications. Functional performance testing reports shall contain information addressing each of the building components tested, the testing methods utilized, and include any readings and adjustments made. 5.410.2.5 Documentation and training. [N] A Systems Manual and Systems Operations Training are required, including Occupational Safety and Health Act (OSHA) requirements in <i>California Code of Regulations</i> (CCR), Title 8, Section 5142, and other related regulations. 5.410.2.5.1 Systems manual. [N] Documentation of the operational aspects of the building shall be completed within the systems manual and delivered to the building owner or representative. The systems manual shall include the following: 1. Site information, including facility description, history and current requirements. 2. Site contact information. 3. Basic operations and maintenance, including general site operating procedures, basic troubleshooting, recommended maintenance requirements, site events log. 4. Major systems. 5. Site equipment inventory and maintenance notes. 6. A copy of verifications required by the enforcing agency or this code. 7. Other resources and documentation, if applicable. 5.410.2.5.2 Systems operations training. [N] A program for training of the appropriate maintenance staff for each equipment type and/or system shall be developed and documented in the commissioning report and shall include the following: 1. System/equipment overview (what it is, what it does and with what other systems and/or equipment it interfaces). 2. Review and demonstration of servicing/preventive maintenance. 3. Review of the information in the Systems Manual. 4. Review of the record drawings on the system/equipment. 5.410.2.6 Commissioning report. [N] A report of commissioning process activities undertaken through the design and construction phases of the building project shall be completed and provided to the owner or representative. 5.410.4 TESTING AND ADJUSTING. New buildings less than 10,000 square feet. Testing and adjusting of systems shall be required for new buildings less than 10,000 square feet or new systems to serve an addition or alteration subject to Section 303.1. 5.410.4.2 (Reserved) Note: For energy-related systems under the scope (Section 100) of the California Energy Code, including heating, ventilation, air conditioning (HVAC) systems and controls, indoor lighting systems and controls, as well as water heating systems and controls, refer to California Energy Code Section 120.8 for commissioning requirements and Sections 120.5, 120.6, 130.4, and 140.9(b)3 for additional testing requirements of specific systems. 5.410.4.2 Systems. Develop a written plan of procedures for testing and adjusting systems. Systems to be included for testing and adjusting shall include at a minimum, as applicable to the project: 1. Renewable energy systems. 2. Landscape irrigation systems. 3. Water reuse systems. 5.410.4.3 Procedures. Perform testing and adjusting procedures in accordance with manufacturer's specifications and applicable standards on each system. 5.410.4.3.1 HVAC balancing. In addition to testing and adjusting, before a new space-conditioning system serving a building or space is operated for normal use, the system shall be balanced in accordance with the procedures defined by the Testing Adjusting and Balancing Bureau National Standards; the National Environmental Balancing Bureau Procedural Standards; Associated Air Balance Council National Standards or as approved by the enforcing agency.										5.410.4.4 Reporting. After completion of testing, adjusting and balancing, provide a final report of testing signed by the individual responsible for performing these services. 5.410.4.5 Operation and maintenance (O & M) manual. Provide the building owner or representative with detailed operating and maintenance instructions and copies of guarantees/warranties for each system. O & M instructions shall be consistent with OSHA requirements in CCR, Title 8, Section 5142, and other related regulations. 5.410.4.5.1 Inspections and reports. Include a copy of all inspection verifications and reports required by the enforcing agency.									
TABLE H-2																																																								
STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALVES MANUFACTURED ON OR AFTER JANUARY 28, 2019																																																								
PRODUCT CLASS [spray force in ounce force (ozf)]	MAXIMUM FLOW RATE (gpm)																																																							
Product Class 1 (≤ 5.0 ozf)	1.00																																																							
Product Class 2 (> 5.0 ozf and ≤ 8.0 ozf)	1.20																																																							
Product Class 3 (> 8.0 ozf)	1.28																																																							
<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>																																											
DIVISION 5.5 ENVIRONMENTAL QUALITY SECTION 5.501 GENERAL 5.501.1 SCOPE. The provisions of this chapter shall outline means of reducing the quantity of air contaminants that are odorous, irritating, and/or harmful to the comfort and well-being of a building's installers, occupants and neighbors. SECTION 5.502 DEFINITIONS 5.502.1 DEFINITIONS. The following terms are defined in Chapter 2 (<i>and are included here for reference</i>) ARTERIAL HIGHWAY. A general term denoting a highway primarily for through traffic usually on a continuous route. A-WEIGHTED SOUND LEVEL (dBA). The sound pressure level in decibels as measured on a sound level meter using the internationally standardized A-weighting filter or as computed from sound spectral data to which A-weighting adjustments have been made. 1 BTU/HOUR. British thermal units per hour, also referred to as Btu. The amount of heat required to raise one pound of water one degree Fahrenheit per hour, a common measure of heat transfer rate. A ton of refrigeration is 12,000 Btu, the amount of heat required to melt a ton (2,000 pounds) of ice at 32° Fahrenheit. COMMUNITY NOISE EQUIVALENT LEVEL (CNEL). A metric similar to the day-night average sound level (Ldn), except that a 5 decibel adjustment is added to the equivalent continuous sound exposure level for evening hours (7pm to 10pm) in addition to the 10 dB nighttime adjustment used in the Ldn. COMPOSITE WOOD PRODUCTS. Composite wood products include hardwood plywood, particleboard and medium density fiberboard. "Composite wood products" does not include hardboard, structural plywood, structural panels, structural composite lumber, oriented strand board, glued laminated timber, prefabricated wood I-joists or finger-jointed lumber, all as specified in California Code of Regulations (CCR), Title 17, Section 93120.1(a). Note: See CCR, Title 17, Section 93120.1. DAY-NIGHT AVERAGE SOUND LEVEL (Ldn). The A-weighted equivalent continuous sound exposure level for a 24-hour period with a 10 db adjustment added to sound levels occurring during nighttime hours (10p.m. to 7 a.m.). DECIBEL (db). A measure on a logarithmic scale of the magnitude of a particular quantity (such as sound pressure, sound power, sound intensity) with respect to a reference quantity. ELECTRIC VEHICLE (EV). An automotive-type vehicle for on-road use, such as passenger automobiles, buses, trucks, vans, neighborhood electric vehicles, electric motorcycles, and the like, primarily powered by an electric motor that draws current from a rechargeable storage battery, fuel cell, photovoltaic array, or other source of electric current. Plug-in hybrid electric vehicles (PHEV) are considered electric vehicles. For purposes of the <i>California Electric Code</i> , off-road, self-propelled electric vehicles, such as industrial trucks, hoists, lifts, transports, golf carts, airline ground support equipment, tractors, boats, and the like, are not included. ELECTRIC VEHICLE CHARGING STATION(S) (EVCS). One or more spaces intended for charging electric vehicles. ELECTRIC VEHICLE SUPPLY EQUIPMENT (EVSE). The conductors, including the ungrounded, grounded, and equipment grounding conductors and the electric vehicle connectors, attachment plugs, and all other fittings, devices, power outlets, or apparatus installed specifically for the purpose of transferring energy between the premises wiring and the electric vehicle. ENERGY EQUIVALENT (NOISE) LEVEL (Leq). The level of a steady noise which would have the same energy as the fluctuating noise level integrated over the time of period of interest. EXPRESSWAY. An arterial highway for through traffic which may have partial control of access, but which may or may not be divided or have grade separations at intersections. FREEWAY. A divided arterial highway with full control of access and with grade separations at intersections. GLOBAL WARMING POTENTIAL (GWP). The radiative forcing impact of one mass-based unit of a given greenhouse gas relative to an equivalent unit of carbon dioxide over a given period of time. Carbon dioxide is the reference compound with a GWP of one. GLOBAL WARMING POTENTIAL VALUE (GWP VALUE). A 100-year GWP value published by the Intergovernmental Panel on Climate Change (IPCC) in either its Second Assessment Report (SAR) (IPCC, 1995); or its Fourth Assessment A-3 Report (AR4) (IPCC, 2007). The SAR GWP values are found in column "SAR (100-yr)" of Table 2.14; the AR4 GWP values are found in column "100 yr" of Table 2.14. HIGH-GWP REFRIGERANT. A compound used as a heat transfer fluid or gas that is: (a) a chlorofluorocarbon, a hydrochlorofluorocarbon, a perfluorocarbon, a perfluoroether, or any compound or blend of compounds, with a GWP value equal to or greater than 150, or (B) any ozone depleting substance as defined in Title 40 of the Code of Federal Regulations, Part 82, sec.82.3 (as amended March 10, 2009). LONG RADIUS ELBOW. Pipe fitting installed between two lengths of pipe or tubing to allow a change of direction, with a radius 1.5 times the pipe diameter. LOW-GWP REFRIGERANT. A compound used as a heat transfer fluid or gas that: (A) has a GWP value less than 150, and (B) is not an ozone depleting substance as defined in Title 40 of the Code of Federal Regulations, Part 82, sec.82.3 (as amended March 10, 2009). MERV. Filter minimum efficiency reporting value, based on ASHRAE 52.2-1999. MAXIMUM INCREMENTAL REACTIVITY (MIR). The maximum change in weight of ozone formed by adding a compound to the "Base Reactive Organic Gas (ROG) Mixture" per weight of compound added, expressed to hundredths of a gram (g O ₃ /ROG). PRODUCT-WEIGHTED MIR (PWMIIR). The sum of all weighted-MIR for all ingredients in a product subject to this article. The PWMIIR is the total product reactivity expressed to hundredths of a gram of ozone formed per gram of product (excluding container and packaging). PSIG. Pounds per square inch, gauge. REACTIVE ORGANIC COMPOUND (ROC). Any compound that has the potential, once emitted, to contribute to ozone formation in the troposphere. SCHRADER ACCESS VALVES. Access fittings with a valve core installed. SHORT RADIUS ELBOW. Pipe fitting installed between two lengths of pipe or tubing to allow a change of direction, with a radius 1.0 times the pipe diameter. SUPERMARKET. For the purposes of Section 5.508.2, a supermarket is any retail food facility with 8,000 square feet or more conditioned area, and that utilizes either refrigerated display cases, or walk-in coolers or freezers connected to remote compressor units or condensing units. VOC. A volatile organic compound broadly defined as a chemical compound based on carbon chains or rings with vapor pressures greater than 0.1 millimeters of mercury at room temperature. These compounds typically contain hydrogen and may contain oxygen, nitrogen and other elements. See CCR Title 17, Section 94508(a) Note: Where specific regulations are cited from different agencies such as SCAQMD, ARB, etc., the VOC definition included in that specific regulation is the one that prevails for the specific measure in question. SECTION 5.503 FIREPLACES 5.503.1 FIREPLACES. Install only a direct-vent sealed-combustion gas or sealed wood-burning fireplace, or a sealed woodstove or pellet stove, and refer to residential requirements in the California Energy Code, Title 24, Part 6, Subchapter 7, Section 150. Woodstoves, pellet stoves and fireplaces shall comply with applicable local ordinances. 5.503.1.1 Woodstoves. Woodstoves and pellet stoves shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as applicable, and shall have a permanent label indicating they are certified to meet the emission limits. SECTION 5.504 POLLUTANT CONTROL 5.504.1 TEMPORARY VENTILATION. The permanent HVAC system shall only be used during construction if necessary to condition the building or areas of addition or alteration within the required temperature range for material and equipment installation. If the HVAC system is used during construction, use return air filters with a Minimum Efficiency Reporting Value (MERV) of 8, based on ASHRAE 52.2-1999, or an average efficiency of 30% based on ASHRAE 52.1-1992. Replace all filters immediately prior to occupancy, or, if the building is occupied during alteration, at the conclusion of construction. 5.504.3 Covering of duct openings and protection of mechanical equipment during construction. At the time of rough installation and during storage on the construction site until final startup of the heating, cooling and ventilation equipment, all duct and other related air distribution component openings shall be covered with tape, plastic, sheetmetal or other methods acceptable to the enforcing agency to reduce the amount of dust, water and debris which may enter the system.																																																								

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-123058 PC
REVIEWED FOR
SS ☐ PLS ☒ ACS ☐
DATE: 07/26/2024



PROFESSIONAL STAMP



THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



ORIGINAL PC STATE AGENCY APPROVAL

APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-123058 PC
REVIEWED FOR
SS ☐ PLS ☒ ACS ☒ CG ☒
DATE: 02/20/2024

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
CAL GREEN
CHECKLIST

PROJECT NUMBER
22088

DRAWN BY
rMc/SC

CHECKED BY
RH/RT

DATE


SHEET NO.

A0.7

SHEET OF

C:\Users\User\Documents\20033 - Aries, 24x40 PC - MainFile - Low Seismic 6.7_CESAR24.D63.rvt

6/15/2021 11:49:13 PM



California

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

NONRESIDENTIAL MANDATORY MEASURES, SHEET 3 (January 2023)

Y	NA	RESPON. PARTY																																																																		
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>																																																																		
5.504.4 FINISH MATERIAL POLLUTANT CONTROL. Finish materials shall comply with Sections 5.504.4.1 through 5.504.4.6.																																																																				
5.504.4.1 Adhesives, sealants and caulks. Adhesives, sealants, and caulks used on the project shall meet the requirements of the following standards: 1. Adhesives, adhesive bonding primers, adhesive primers, sealants, sealant primers and caulks shall comply with local or regional air pollution control or air quality management district rules where applicable, or SCAQMD Rule 1168 VOC limits, as shown in Tables 5.504.4.1 and 5.504.4.2. Such products also shall comply with the Rule 1168 prohibition on the use of certain toxic compounds (chloroform, ethylene dichloride, methylene chloride, perchloroethylene and trichloroethylene), except for aerosol products as specified in subsection 2, below. 2. Aerosol adhesives, and smaller unit sizes of adhesives, and sealant or caulking compounds (in units of product, less packaging, which do not weigh more than one pound and do not consist of more than 16 fluid ounces) shall comply with statewide VOC standards and other requirements, including prohibitions on use of certain toxic compounds, of <i>California Code of Regulations</i> , Title 17, commencing with Section 94507.																																																																				
<table><thead><tr><th colspan="2">TABLE 5.504.4.1 - ADHESIVE VOC LIMIT₂</th></tr><tr><th colspan="2">Less Water and Less Exempt Compounds in Grams per Liter</th></tr><tr><th>ARCHITECTURAL APPLICATIONS</th><th>CURRENT VOC LIMIT</th></tr></thead><tbody><tr><td>INDOOR CARPET ADHESIVES</td><td>50</td></tr><tr><td>CARPET PAD ADHESIVES</td><td>50</td></tr><tr><td>OUTDOOR CARPET ADHESIVES</td><td>150</td></tr><tr><td>WOOD FLOORING ADHESIVES</td><td>100</td></tr><tr><td>RUBBER FLOOR ADHESIVES</td><td>60</td></tr><tr><td>SUBFLOOR ADHESIVES</td><td>50</td></tr><tr><td>CERAMIC TILE ADHESIVES</td><td>65</td></tr><tr><td>VCT & ASPHALT TILE ADHESIVES</td><td>50</td></tr><tr><td>DRYWALL & PANEL ADHESIVES</td><td>50</td></tr><tr><td>COVE BASE ADHESIVES</td><td>50</td></tr><tr><td>MULTIPURPOSE CONSTRUCTION ADHESIVES</td><td>70</td></tr><tr><td>STRUCTURAL GLAZING ADHESIVES</td><td>100</td></tr><tr><td>SINGLE-PLY ROOF MEMBRANE ADHESIVES</td><td>250</td></tr><tr><td>OTHER ADHESIVES NOT SPECIFICALLY LISTED</td><td>50</td></tr><tr><td colspan="2">SPECIALTY APPLICATIONS</td></tr><tr><td>PVC WELDING</td><td>510</td></tr><tr><td>CPVC WELDING</td><td>490</td></tr><tr><td>ABS WELDING</td><td>325</td></tr><tr><td>PLASTIC CEMENT WELDING</td><td>250</td></tr><tr><td>ADHESIVE PRIMER FOR PLASTIC</td><td>550</td></tr><tr><td>CONTACT ADHESIVE</td><td>80</td></tr><tr><td>SPECIAL PURPOSE CONTACT ADHESIVE</td><td>250</td></tr><tr><td>STRUCTURAL WOOD MEMBER ADHESIVE</td><td>140</td></tr><tr><td>TOP & TRIM ADHESIVE</td><td>250</td></tr><tr><td colspan="2">SUBSTRATE SPECIFIC APPLICATIONS</td></tr><tr><td>METAL TO METAL</td><td>30</td></tr><tr><td>PLASTIC FOAMS</td><td>50</td></tr><tr><td>POROUS MATERIAL (EXCEPT WOOD)</td><td>50</td></tr><tr><td>WOOD</td><td>30</td></tr><tr><td>FIBERGLASS</td><td>80</td></tr></tbody></table> 1. IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER, THE ADHESIVE WITH THE HIGHEST VOC CONTENT SHALL BE ALLOWED. 2. FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THIS TABLE, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1168, www.arb.ca.gov/DRDB/SC/CURHTM/LR1168.PDF			TABLE 5.504.4.1 - ADHESIVE VOC LIMIT ₂		Less Water and Less Exempt Compounds in Grams per Liter		ARCHITECTURAL APPLICATIONS	CURRENT VOC LIMIT	INDOOR CARPET ADHESIVES	50	CARPET PAD ADHESIVES	50	OUTDOOR CARPET ADHESIVES	150	WOOD FLOORING ADHESIVES	100	RUBBER FLOOR ADHESIVES	60	SUBFLOOR ADHESIVES	50	CERAMIC TILE ADHESIVES	65	VCT & ASPHALT TILE ADHESIVES	50	DRYWALL & PANEL ADHESIVES	50	COVE BASE ADHESIVES	50	MULTIPURPOSE CONSTRUCTION ADHESIVES	70	STRUCTURAL GLAZING ADHESIVES	100	SINGLE-PLY ROOF MEMBRANE ADHESIVES	250	OTHER ADHESIVES NOT SPECIFICALLY LISTED	50	SPECIALTY APPLICATIONS		PVC WELDING	510	CPVC WELDING	490	ABS WELDING	325	PLASTIC CEMENT WELDING	250	ADHESIVE PRIMER FOR PLASTIC	550	CONTACT ADHESIVE	80	SPECIAL PURPOSE CONTACT ADHESIVE	250	STRUCTURAL WOOD MEMBER ADHESIVE	140	TOP & TRIM ADHESIVE	250	SUBSTRATE SPECIFIC APPLICATIONS		METAL TO METAL	30	PLASTIC FOAMS	50	POROUS MATERIAL (EXCEPT WOOD)	50	WOOD	30	FIBERGLASS	80
TABLE 5.504.4.1 - ADHESIVE VOC LIMIT ₂																																																																				
Less Water and Less Exempt Compounds in Grams per Liter																																																																				
ARCHITECTURAL APPLICATIONS	CURRENT VOC LIMIT																																																																			
INDOOR CARPET ADHESIVES	50																																																																			
CARPET PAD ADHESIVES	50																																																																			
OUTDOOR CARPET ADHESIVES	150																																																																			
WOOD FLOORING ADHESIVES	100																																																																			
RUBBER FLOOR ADHESIVES	60																																																																			
SUBFLOOR ADHESIVES	50																																																																			
CERAMIC TILE ADHESIVES	65																																																																			
VCT & ASPHALT TILE ADHESIVES	50																																																																			
DRYWALL & PANEL ADHESIVES	50																																																																			
COVE BASE ADHESIVES	50																																																																			
MULTIPURPOSE CONSTRUCTION ADHESIVES	70																																																																			
STRUCTURAL GLAZING ADHESIVES	100																																																																			
SINGLE-PLY ROOF MEMBRANE ADHESIVES	250																																																																			
OTHER ADHESIVES NOT SPECIFICALLY LISTED	50																																																																			
SPECIALTY APPLICATIONS																																																																				
PVC WELDING	510																																																																			
CPVC WELDING	490																																																																			
ABS WELDING	325																																																																			
PLASTIC CEMENT WELDING	250																																																																			
ADHESIVE PRIMER FOR PLASTIC	550																																																																			
CONTACT ADHESIVE	80																																																																			
SPECIAL PURPOSE CONTACT ADHESIVE	250																																																																			
STRUCTURAL WOOD MEMBER ADHESIVE	140																																																																			
TOP & TRIM ADHESIVE	250																																																																			
SUBSTRATE SPECIFIC APPLICATIONS																																																																				
METAL TO METAL	30																																																																			
PLASTIC FOAMS	50																																																																			
POROUS MATERIAL (EXCEPT WOOD)	50																																																																			
WOOD	30																																																																			
FIBERGLASS	80																																																																			
<table><thead><tr><th colspan="2">TABLE 5.504.4.2 - SEALANT VOC LIMIT</th></tr><tr><th colspan="2">Less Water and Less Exempt Compounds in Grams per Liter</th></tr><tr><th>SEALANTS</th><th>CURRENT VOC LIMIT</th></tr></thead><tbody><tr><td>ARCHITECTURAL</td><td>250</td></tr><tr><td>MARINE DECK</td><td>760</td></tr><tr><td>NONMEMBRANE ROOF</td><td>300</td></tr><tr><td>ROADWAY</td><td>250</td></tr><tr><td>SINGLE-PLY ROOF MEMBRANE</td><td>450</td></tr><tr><td>OTHER</td><td>420</td></tr><tr><td colspan="2">SEALANT PRIMERS</td></tr><tr><td>ARCHITECTURAL</td><td></td></tr><tr><td>NONPOROUS</td><td>250</td></tr><tr><td>POROUS</td><td>775</td></tr><tr><td>MODIFIED BITUMINOUS</td><td>500</td></tr><tr><td>MARINE DECK</td><td>760</td></tr><tr><td>OTHER</td><td>750</td></tr></tbody></table> NOTE: FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THESE TABLES, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1168. 5.504.4.3 Paints and coatings. Architectural paints and coatings shall comply with VOC limits in Table 1 of the ARB Architectural Coatings Suggested Control Measure, as shown in Table 5.504.4.3, unless more stringent local limits apply. The VOC content limit for coatings that do not meet the definitions for the specialty coatings categories listed in Table 5.504.4.3 shall be determined by classifying the coating as a Flat, Nonflat or Nonflat-High Gloss coating, based on its gloss, as defined in Subsections 4.21, 4.36 and 4.37 of the 2007 California Air Resources Board Suggested Control Measure, and the corresponding Flat, Nonflat or Nonflat-High Gloss VOC limit in Table 5.504.4.3 shall apply. 5.504.4.3.1 Aerosol Paints and coatings. Aerosol paints and coatings shall meet the PWMIR Limits for ROC in Section 94522(a)(3) and other requirements, including prohibitions on use of certain toxic compounds and ozone depleting substances, in Sections 94522(c)(2) and (d)(2) of <i>California Code of Regulations</i> , Title 17, commencing with Section 94520; and in areas under the jurisdiction of the Bay Area Air Quality Management District additionally comply with the percent VOC by weight of product limits of Regulation 8 Rule 49.			TABLE 5.504.4.2 - SEALANT VOC LIMIT		Less Water and Less Exempt Compounds in Grams per Liter		SEALANTS	CURRENT VOC LIMIT	ARCHITECTURAL	250	MARINE DECK	760	NONMEMBRANE ROOF	300	ROADWAY	250	SINGLE-PLY ROOF MEMBRANE	450	OTHER	420	SEALANT PRIMERS		ARCHITECTURAL		NONPOROUS	250	POROUS	775	MODIFIED BITUMINOUS	500	MARINE DECK	760	OTHER	750																																		
TABLE 5.504.4.2 - SEALANT VOC LIMIT																																																																				
Less Water and Less Exempt Compounds in Grams per Liter																																																																				
SEALANTS	CURRENT VOC LIMIT																																																																			
ARCHITECTURAL	250																																																																			
MARINE DECK	760																																																																			
NONMEMBRANE ROOF	300																																																																			
ROADWAY	250																																																																			
SINGLE-PLY ROOF MEMBRANE	450																																																																			
OTHER	420																																																																			
SEALANT PRIMERS																																																																				
ARCHITECTURAL																																																																				
NONPOROUS	250																																																																			
POROUS	775																																																																			
MODIFIED BITUMINOUS	500																																																																			
MARINE DECK	760																																																																			
OTHER	750																																																																			


Y	NA	RESPON. PARTY																																																																																				
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>																																																																																				
TABLE 5.504.4.3 - CONT.																																																																																						
GRAMS OF VOC PER LITER OF COATING, LESS WATER & LESS EXEMPT COMPOUNDS																																																																																						
<table><thead><tr><th>COATING CATEGORY</th><th>CURRENT VOC LIMIT</th></tr></thead><tbody><tr><td colspan="2">SPECIALTY COATINGS</td></tr><tr><td>ALUMINUM ROOF COATINGS</td><td>400</td></tr><tr><td>BASEMENT SPECIALTY COATINGS</td><td>400</td></tr><tr><td>BITUMINOUS ROOF COATINGS</td><td>50</td></tr><tr><td>BITUMINOUS ROOF PRIMERS</td><td>350</td></tr><tr><td>BOND BREAKERS</td><td>350</td></tr><tr><td>CONCRETE CURING COMPOUNDS</td><td>350</td></tr><tr><td>CONCRETE/MASONRY SEALERS</td><td>100</td></tr><tr><td>DRIVEWAY SEALERS</td><td>50</td></tr><tr><td>DRY FOG COATINGS</td><td>150</td></tr><tr><td>FAUX FINISHING COATINGS</td><td>350</td></tr><tr><td>FIRE RESISTIVE COATINGS</td><td>350</td></tr><tr><td>FLOOR COATINGS</td><td>100</td></tr><tr><td>FORM-RELEASE COMPOUNDS</td><td>250</td></tr><tr><td>GRAPHIC ARTS COATINGS (SIGN PAINTS)</td><td>500</td></tr><tr><td>HIGH-TEMPERATURE COATINGS</td><td>420</td></tr><tr><td>INDUSTRIAL MAINTENANCE COATINGS</td><td>250</td></tr><tr><td>LOW SOLIDS COATINGS₁</td><td>120</td></tr><tr><td>MAGNESITE CEMENT COATINGS</td><td>450</td></tr><tr><td>MASTIC TEXTURE COATINGS</td><td>100</td></tr><tr><td>METALLIC PIGMENTED COATINGS</td><td>500</td></tr><tr><td>MULTICOLOR COATINGS</td><td>250</td></tr><tr><td>PRETREATMENT WASH PRIMERS</td><td>420</td></tr><tr><td>PRIMERS, SEALERS, & UNDERCOATERS</td><td>100</td></tr><tr><td>REACTIVE PENETRATING SEALERS</td><td>350</td></tr><tr><td>RECYCLED COATINGS</td><td>250</td></tr><tr><td>ROOF COATINGS</td><td>50</td></tr><tr><td>RUST PREVENTATIVE COATINGS</td><td>250</td></tr><tr><td>SHELLACS:</td><td></td></tr><tr><td>CLEAR</td><td>730</td></tr><tr><td>OPAQUE</td><td>550</td></tr><tr><td colspan="2">SPECIALTY PRIMERS, SEALERS & UNDERCOATERS</td></tr><tr><td>STAINS</td><td>250</td></tr><tr><td>STONE CONSOLIDANTS</td><td>450</td></tr><tr><td>SWIMMING POOL COATINGS</td><td>340</td></tr><tr><td>TRAFFIC MARKING COATINGS</td><td>100</td></tr><tr><td>TUB & TILE REFINISH COATINGS</td><td>420</td></tr><tr><td>WATERPROOFING MEMBRANES</td><td>250</td></tr><tr><td>WOOD COATINGS</td><td>275</td></tr><tr><td>WOOD PRESERVATIVES</td><td>350</td></tr><tr><td>ZINC-RICH PRIMERS</td><td>340</td></tr></tbody></table> 1. GRAMS OF VOC PER LITER OF COATING, INCLUDING WATER & EXEMPT COMPOUNDS 2. THE SPECIFIED LIMITS REMAIN IN EFFECT UNLESS REVISED LIMITS ARE LISTED IN SUBSEQUENT COLUMNS IN THE TABLE. 3. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, ARCHITECTURAL COATINGS SUGGESTED CONTROL MEASURE, FEB. 1, 2008. MORE INFORMATION IS AVAILABLE FROM THE AIR RESOURCES BOARD. 5.504.4.3.2 Verification. Verification of compliance with this section shall be provided at the request of the enforcing agency. Documentation may include, but is not limited to, the following: 1. Manufacturer's product specification 2. Field verification of on-site product containers 5.504.4.4 Carpet Systems. All carpet installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350). See California Department of Public Health's website for certification programs and testing labs. https://www.cdph.ca.gov/Programs/CCDPHP/DEODD/EHLB/IAQ/Pages/VOC.aspx#material 5.504.4.4.1 Carpet cushion. All carpet cushion installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350). See California Department of Public Health's website for certification programs and testing labs. https://www.cdph.ca.gov/Programs/CCDPHP/DEODD/EHLB/IAQ/Pages/VOC.aspx#material 5.504.4.4.2 Carpet adhesive. All carpet adhesive shall meet the requirements of Table 5.504.4.1. 5.504.4.5 Composite wood products. Hardwood plywood, particleboard and medium density fiberboard composite wood products used on the interior or exterior of the buildings shall meet the requirements for formaldehyde as specified in ARB's Air Toxics Control Measure (ATCM) for Composite Wood (17 CCR 93120 et seq.). Those materials not exempted under the ATCM must meet the specified emission limits, as shown in Table 5.504.4.5. 5.504.4.5.3 Documentation. Verification of compliance with this section shall be provided as requested by the enforcing agency. Documentation shall include at least one of the following: 1. Product certifications and specifications. 2. Chain of custody certifications. 3. Product labeled and invoiced as meeting the Composite Wood Products regulation (see CCR, Title 17, Section 93120, et seq.). 4. Exterior grade products marked as meeting the PS-1 or PS-2 standards of the Engineered Wood Association, the Australian AS/NZS 2269 or European 636 3S standards. 5. Other methods acceptable to the enforcing agency.			COATING CATEGORY	CURRENT VOC LIMIT	SPECIALTY COATINGS		ALUMINUM ROOF COATINGS	400	BASEMENT SPECIALTY COATINGS	400	BITUMINOUS ROOF COATINGS	50	BITUMINOUS ROOF PRIMERS	350	BOND BREAKERS	350	CONCRETE CURING COMPOUNDS	350	CONCRETE/MASONRY SEALERS	100	DRIVEWAY SEALERS	50	DRY FOG COATINGS	150	FAUX FINISHING COATINGS	350	FIRE RESISTIVE COATINGS	350	FLOOR COATINGS	100	FORM-RELEASE COMPOUNDS	250	GRAPHIC ARTS COATINGS (SIGN PAINTS)	500	HIGH-TEMPERATURE COATINGS	420	INDUSTRIAL MAINTENANCE COATINGS	250	LOW SOLIDS COATINGS ₁	120	MAGNESITE CEMENT COATINGS	450	MASTIC TEXTURE COATINGS	100	METALLIC PIGMENTED COATINGS	500	MULTICOLOR COATINGS	250	PRETREATMENT WASH PRIMERS	420	PRIMERS, SEALERS, & UNDERCOATERS	100	REACTIVE PENETRATING SEALERS	350	RECYCLED COATINGS	250	ROOF COATINGS	50	RUST PREVENTATIVE COATINGS	250	SHELLACS:		CLEAR	730	OPAQUE	550	SPECIALTY PRIMERS, SEALERS & UNDERCOATERS		STAINS	250	STONE CONSOLIDANTS	450	SWIMMING POOL COATINGS	340	TRAFFIC MARKING COATINGS	100	TUB & TILE REFINISH COATINGS	420	WATERPROOFING MEMBRANES	250	WOOD COATINGS	275	WOOD PRESERVATIVES	350	ZINC-RICH PRIMERS	340
COATING CATEGORY	CURRENT VOC LIMIT																																																																																					
SPECIALTY COATINGS																																																																																						
ALUMINUM ROOF COATINGS	400																																																																																					
BASEMENT SPECIALTY COATINGS	400																																																																																					
BITUMINOUS ROOF COATINGS	50																																																																																					
BITUMINOUS ROOF PRIMERS	350																																																																																					
BOND BREAKERS	350																																																																																					
CONCRETE CURING COMPOUNDS	350																																																																																					
CONCRETE/MASONRY SEALERS	100																																																																																					
DRIVEWAY SEALERS	50																																																																																					
DRY FOG COATINGS	150																																																																																					
FAUX FINISHING COATINGS	350																																																																																					
FIRE RESISTIVE COATINGS	350																																																																																					
FLOOR COATINGS	100																																																																																					
FORM-RELEASE COMPOUNDS	250																																																																																					
GRAPHIC ARTS COATINGS (SIGN PAINTS)	500																																																																																					
HIGH-TEMPERATURE COATINGS	420																																																																																					
INDUSTRIAL MAINTENANCE COATINGS	250																																																																																					
LOW SOLIDS COATINGS ₁	120																																																																																					
MAGNESITE CEMENT COATINGS	450																																																																																					
MASTIC TEXTURE COATINGS	100																																																																																					
METALLIC PIGMENTED COATINGS	500																																																																																					
MULTICOLOR COATINGS	250																																																																																					
PRETREATMENT WASH PRIMERS	420																																																																																					
PRIMERS, SEALERS, & UNDERCOATERS	100																																																																																					
REACTIVE PENETRATING SEALERS	350																																																																																					
RECYCLED COATINGS	250																																																																																					
ROOF COATINGS	50																																																																																					
RUST PREVENTATIVE COATINGS	250																																																																																					
SHELLACS:																																																																																						
CLEAR	730																																																																																					
OPAQUE	550																																																																																					
SPECIALTY PRIMERS, SEALERS & UNDERCOATERS																																																																																						
STAINS	250																																																																																					
STONE CONSOLIDANTS	450																																																																																					
SWIMMING POOL COATINGS	340																																																																																					
TRAFFIC MARKING COATINGS	100																																																																																					
TUB & TILE REFINISH COATINGS	420																																																																																					
WATERPROOFING MEMBRANES	250																																																																																					
WOOD COATINGS	275																																																																																					
WOOD PRESERVATIVES	350																																																																																					
ZINC-RICH PRIMERS	340																																																																																					
<table><thead><tr><th colspan="2">TABLE 5.504.4.5 - FORMALDEHYDE LIMITS₁</th></tr><tr><th colspan="2">MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION</th></tr><tr><th>PRODUCT</th><th>CURRENT LIMIT</th></tr></thead><tbody><tr><td>HARDWOOD PLYWOOD VENEER CORE</td><td>0.05</td></tr><tr><td>HARDWOOD PLYWOOD COMPOSITE CORE</td><td>0.05</td></tr><tr><td>PARTICLE BOARD</td><td>0.09</td></tr><tr><td>MEDIUM DENSITY FIBERBOARD</td><td>0.11</td></tr><tr><td>THIN MEDIUM DENSITY FIBERBOARD₂</td><td>0.13</td></tr></tbody></table> 1. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, AIR TOXICS CONTROL MEASURE FOR COMPOSITE WOOD AS TESTED IN ACCORDANCE WITH ASTM E 1533. FOR ADDITIONAL INFORMATION, SEE CALIFORNIA CODE OF REGULATIONS, TITLE 17, SECTIONS 93120 THROUGH 93120.12. 2. THIN MEDIUM DENSITY FIBERBOARD HAS A MAXIMUM THICKNESS OF 5/16 INCHES (8 MM).			TABLE 5.504.4.5 - FORMALDEHYDE LIMITS ₁		MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION		PRODUCT	CURRENT LIMIT	HARDWOOD PLYWOOD VENEER CORE	0.05	HARDWOOD PLYWOOD COMPOSITE CORE	0.05	PARTICLE BOARD	0.09	MEDIUM DENSITY FIBERBOARD	0.11	THIN MEDIUM DENSITY FIBERBOARD ₂	0.13																																																																				
TABLE 5.504.4.5 - FORMALDEHYDE LIMITS ₁																																																																																						
MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION																																																																																						
PRODUCT	CURRENT LIMIT																																																																																					
HARDWOOD PLYWOOD VENEER CORE	0.05																																																																																					
HARDWOOD PLYWOOD COMPOSITE CORE	0.05																																																																																					
PARTICLE BOARD	0.09																																																																																					
MEDIUM DENSITY FIBERBOARD	0.11																																																																																					
THIN MEDIUM DENSITY FIBERBOARD ₂	0.13																																																																																					

Y	NA	RESPON. PARTY
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
5.504.4.6 Resilient flooring systems. Where resilient flooring is installed, at least 80 percent of floor area receiving resilient flooring shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350). See California Department of Public Health's website for certification programs and testing labs. https://www.cdph.ca.gov/Programs/CCDPHP/DEODD/EHLB/IAQ/Pages/VOC.aspx#material 5.504.4.6.1 Verification of compliance. Documentation shall be provided verifying that resilient flooring materials meet the pollutant emission limits. 5.504.4.7 Thermal insulation Comply with the requirements of the California Department of Public Health, "Standard Method of the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350). See California Department of Public Health's website for certification programs and testing labs. https://www.cdph.ca.gov/Programs/CCDPHP/DEODD/EHLB/IAQ/Pages/VOC.aspx#material 5.504.4.7.1 Verification of compliance. Documentation shall be provided verifying that thermal insulation materials meet the pollutant emission limits. 5.504.4.8 Acoustical ceiling and wall panels. Comply with the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specification 01350). See California Department of Public Health's website for certification programs and testing labs. 5.504.4.8.1 Verification of compliance. Documentation shall be provided verifying that acoustical finish materials meet the pollutant emission limits. 5.504.5.3 Filters. In mechanically ventilated buildings, provide regularly occupied areas of the building with air filtration media for outside and return air that provides at least a Minimum Efficiency Reporting Value (MERV) of 13. MERV 13 filters shall be installed prior to occupancy, and recommendations for maintenance with filters of the same value shall be included in the operation and maintenance manual. Exceptions: Existing mechanical equipment. 5.504.5.3.1 Labeling. Installed filters shall be clearly labeled by the manufacturer indicating the MERV rating. 5.504.7 ENVIRONMENTAL TOBACCO SMOKE (ETS) CONTROL. Where outdoor areas are provided for smoking, prohibit smoking within 25 feet of building entries, outdoor air intakes and operable windows and within the building as already prohibited by other laws or regulations; or as enforced by ordinances, regulations or policies of any city, county, city and county, California, campus of the California State University, or campus of the University of California, whichever are more stringent. When ordinances, regulations or policies are not in place, post signage to inform building occupants of the prohibitions. SECTION 5.505 INDOOR MOISTURE CONTROL 5.505.1 INDOOR MOISTURE CONTROL. Buildings shall meet or exceed the provisions of California Building Code, CCR, Title 24, Part 2, Sections 1202 (Ventilation) and Chapter 14 (Exterior Walls). For additional measures, see Section 5.407.2 of this code. SECTION 5.506 INDOOR AIR QUALITY 5.506.1 OUTSIDE AIR DELIVERY. For mechanically or naturally ventilated spaces in buildings, meet the minimum requirements of Section 120.1 (Requirements For Ventilation) of the <i>California Energy Code</i> , or the applicable local code, whichever is more stringent, and Division 1, Chapter 4 of CCR, Title 8. 5.506.2 CARBON DIOXIDE (CO₂) MONITORING. For buildings or additions equipped with demand control ventilation, CO ₂ sensors and ventilation controls shall be specified and installed in accordance with the requirements of the <i>California Energy Code</i> , Section 120(c)(4). 5.506.3 Carbon dioxide (CO₂) monitoring in classrooms. (DSA-SS) Each public K-12 school classroom, as listed in Table 120.1-A of the <i>California Energy Code</i> , shall be equipped with a carbon dioxide monitor or sensor that meets the following requirements: 1. The monitor or sensor shall be permanently affixed in a tamper-proof manner in each classroom between 3 and 6 feet (914 mm and 1829 mm) above the floor and at least 5 feet (1524 mm) away from door and operable windows. 2. When the monitor or sensor is not integral to an Energy Management Control System (EMCS), the monitor or sensor shall display the carbon dioxide readings on the device. When the sensor is integral to an EMCS, the carbon dioxide readings shall be available to and regularly monitored by facility personnel. 3. A monitor shall provide notification through a visual indicator on the monitor when the carbon dioxide levels in the classroom have exceeded 1,100ppm. A sensor integral to an EMCS shall provide notification to facility personnel through a visual and/or audible indicator when the carbon dioxide levels in the classroom have exceeded 1,100ppm. 4. The monitor or sensor shall measure carbon dioxide levels at minimum 15-minute intervals and shall maintain a record of previous carbon dioxide measurements of not less than 30 days duration. 5. The monitor or sensor used to measure carbon dioxide levels shall have the capacity to measure carbon dioxide levels with a range of 400ppm to 2000ppm or greater. 6. The monitor or sensor shall be certified by the manufacturer to be accurate within 75ppm at 1,000ppm carbon dioxide concentration and shall be certified by the manufacturer to require calibration no more frequently than once every 5 years. SECTION 5.507 ENVIRONMENTAL COMFORT 5.507.4 ACOUSTICAL CONTROL. Employ building assemblies and components with Sound Transmission Class (STC) values determined in accordance with ASTM E 90 and ASTM E 413, or Outdoor-Indoor Sound Transmission Class (OITC) determined in accordance with ASTM E 1532, using either the prescriptive or performance method in Section 5.507.4.1 or 5.507.4.2. Exception: Buildings with few or no occupants or where occupants are not likely to be affected by exterior noise, as determined by the enforcement authority, such as factories, stadiums, storage, enclosed parking structures and utility buildings. Exception: [DSA-SS] For public schools and community colleges, the requirements of this section and all subsections apply only to new construction. 5.507.4.1 Exterior noise transmission, prescriptive method. Wall and roof-ceiling assemblies exposed to the noise source making up the building or addition envelope or altered envelope shall meet a composite STC rating of at least 50 or a composite OITC rating of no less than 40, with exterior windows of a minimum STC of 40 or OITC of 30 in the following locations: 1. Within the 65 CNEL noise contour of an airport. Exceptions: 1. L _{eq} or CNEL for military airports shall be determined by the facility Air Installation Compatible Land Use Zone (AICUZ) plan. 2. L _{eq} or CNEL for other airports and heliports for which a land use plan has not been developed shall be determined by the local general plan noise element. 2. Within the 65 CNEL or L _{eq} noise contour of a freeway or expressway, railroad, industrial source or fixed-guideway source as determined by the Noise Element of the General Plan. 5.507.4.1.1 Noise exposure where noise contours are not readily available. Buildings exposed to a noise level of 65 dB L _{eq} - 1-hr during any hour of operation shall have building, addition or alteration exterior wall and roof-ceiling assemblies exposed to the noise source meeting a composite STC rating of at least 45 (or OITC 35), with exterior windows of a minimum STC of 40 (or OITC 30). 5.507.4.2 Performance Method. For buildings located as defined in Section 5.507.4.1, or 5.507.4.1.1, wall and roof-ceiling assemblies exposed to the noise source making up the building or addition envelope or altered envelope shall be constructed to provide an interior noise environment attributable to exterior sources that does not exceed an hourly equivalent noise level (Leq-1hr) of 50 dBA in occupied areas during any hour of operation. 5.507.4.2.1 Site Features. Exterior features such as sound walls or earth berms may be utilized as appropriate to the building, addition or alteration project to mitigate sound migration to the interior. 5.507.4.2.2 Documentation of Compliance. An acoustical analysis documenting complying interior soundlevels shall be prepared by personnel approved by the architect or engineer of record. 5.507.4.3 Interior sound transmission. Wall and floor-ceiling assemblies separating tenant spaces and tenant spaces and public places shall have an STC of at least 40. Note: Examples of assemblies and their various STC ratings may be found at the California Office of Noise Control: www.toolbase.org/PDF/CaseStudies/stc_ccc_ratings.pdf . SECTION 5.508 OUTDOOR AIR QUALITY 5.508.1 Ozone depletion and greenhouse gas reductions. Installations of HVAC, refrigeration and fire suppression equipment shall comply with Sections 5.508.1.1 and 5.508.1.2. 5.508.1.1 Chlorofluorocarbons (CFCs). Install HVAC, refrigeration and fire suppression equipment that do not contain CFCs. 5.508.1.2 Halons. Install HVAC, refrigeration and fire suppression equipment that do not contain Halons.		

Y	NA	RESPON. PARTY
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
5.508.2 Supermarket refrigerant leak reduction. New commercial refrigeration systems shall comply with the provisions of this section when installed in retail food stores 8,000 square feet or more conditioned area, and that utilize either refrigerated display cases, or walk-in coolers or freezers connected to remote compressor units or condensing units. The leak reduction measures apply to refrigeration systems containing high-global-warming potential (high-GWP) refrigerant with a GWP of 150 or greater. New refrigeration systems include both new facilities and the replacement of existing refrigeration systems in existing facilities. Exception: Refrigeration systems containing low-global warming potential (low-GWP) refrigerant with a GWP value less than 150 are not subject to this section. Low-GWP refrigerants are nonozone-depleting refrigerants that include ammonia, carbon dioxide (CO ₂), and potentially other refrigerants. 5.508.2.1 Refrigerant piping. Piping compliant with the California Mechanical Code shall be installed to be accessible for leak protection and repairs. Piping runs using threaded pipe, copper tubing with an outside diameter (OD) less than 1/4 inch, flared tubing connections and short radius elbows shall not be used in refrigerant systems except as noted below. 5.508.2.1.1 Threaded pipe. Threaded connections are permitted at the compressor rack. 5.508.2.1.2 Copper pipe. Copper tubing with an OD less than 1/4 inch may be used in systems with a refrigerant charge of 5 pounds or less. 5.508.2.1.2.1 Anchorage. One-fourth-inch OD tubing shall be securely clamped to a rigid base to keep vibration levels below 8 mils. 5.508.2.1.3 Flared tubing connections. Double-flared tubing connections may be used for pressure controls, valve pilot lines and oil. Exception: Single-flared tubing connections may be used with a multiring seal coated with industrial sealant suitable for use with refrigerants and tightened in accordance with manufacturer's recommendations. 5.508.2.1.4 Elbows. Short radius elbows are only permitted where space limitations prohibit use of long radius elbows. 5.508.2.2 Valves. Valves and fittings shall comply with the <i>California Mechanical Code</i> and as follows. 5.508.2.2.1 Pressure relief valves. For vessels containing high-GWP refrigerant, a rupture disc shall be installed between the outlet of the vessel and the inlet of the pressure relief valve. 5.508.2.2.1.1 Pressure detection. A pressure gauge, pressure transducer or other device shall be installed in the space between the rupture disc and the relief valve inlet to indicate a disc rupture or discharge of the relief valve. 5.508.2.2.2 Access valves. Only Schrader access valves with a brass or steel body are permitted for use. 5.508.2.2.2.1 Valve caps. For systems with a refrigerant charge of 5 pounds or more, valve caps shall be brass or steel and not plastic. 5.508.2.2.2.2 Seal caps. If designed for it, the cap shall have a neoprene O-ring in place. 5.508.2.2.2.2.1 Chain tethers. Chain tethers to lift over the stem are required for valves designed to have seal caps. Exception: Valves with seal caps that are not removed from the valve during stem operation. 5.508.2.3 Refrigerated service cases. Refrigerated service cases holding food products containing vinegar and salt shall have evaporator coils of corrosion-resistant material, such as stainless steel; or be coated to prevent corrosion from these substances. 5.508.2.3.1 Coil coating. Consideration shall be given to the heat transfer efficiency of coil coating to maximize energy efficiency. 5.508.2.4 Refrigerant receivers. Refrigerant receivers with capacities greater than 200 pounds shall be fitted with a device that indicates the level of refrigerant in the receiver. 5.508.2.5 Pressure testing. The system shall be pressure tested during installation prior to evacuation and charging. 5.508.2.5.1 Minimum pressure. The system shall be charged with regulated dry nitrogen and appropriate tracer gas to bring system pressure up to 300 psig minimum. 5.508.2.5.2 Leaks. Check the system for leaks, repair any leaks, and retest for pressure using the same gauge. 5.508.2.5.3 Allowable pressure change. The system shall stand, unaltered, for 24 hours with no more than a +/- one pound pressure change from 300 psig, measured with the same gauge. 5.508.2.6 Evacuation. The system shall be evacuated after pressure testing and prior to charging. 5.508.2.6.1 First vacuum. Pull a system vacuum down to at least 1000 microns (+/- 50 microns), and hold for 30 minutes. 5.508.2.6.2 Second vacuum. Pull a second system vacuum to a minimum of 500 microns and hold for 30 minutes. 5.508.2.6.3 Third vacuum. Pull a third vacuum down to a minimum of 300 microns, and hold for 24 hours with a maximum drift of 100 microns over a 24-hour period.		
CHAPTER 7 INSTALLER & SPECIAL INSPECTOR QUALIFICATIONS 702 QUALIFICATIONS 702.1 INSTALLER TRAINING. HVAC system installers shall be trained and certified in the proper installation of HVAC systems including ducts and equipment by a nationally or regionally recognized training or certification program. Uncertified persons may perform HVAC installations when under the direct supervision and responsibility of a person trained and certified to install HVAC systems or contractor licensed to install HVAC systems. Examples of acceptable HVAC training and certification programs include but are not limited to the following: 1. State certified apprenticeship programs. 2. Public utility training programs. 3. Training programs sponsored by trade, labor or statewide energy consulting or verification organizations. 4. Programs sponsored by manufacturing organizations. 5. Other programs acceptable to the enforcing agency. 702.2 SPECIAL INSPECTION [HCD]. When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition to other certifications or qualifications acceptable to the enforcing agency, the following certifications or education may be considered by the enforcing agency when evaluating the qualifications of a special inspector: 1. Certification by a national or regional green building program or standard publisher. 2. Certification by a statewide energy consulting or verification organization, such as HERS raters, building performance contractors, and home energy auditors. 3. Successful completion of a third party apprentice training program in the appropriate trade. 4. Other programs acceptable to the enforcing agency. Notes: 1. Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code. 2. HERS raters are special inspectors certified by the California Energy Commission (CEC) to rate homes in California according to the Home Energy Rating System (HERS). [BSC-CG] When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition, the special inspector shall have a certification from a recognized state, national or international association, as determined by the local agency. The area of certification shall be closely related to the primary job function, as determined by the local agency. Note: Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code. 703 VERIFICATIONS 703.1 DOCUMENTATION. Documentation used to show compliance with this code shall include but is not limited to, construction documents, plans, specifications, builder or installer certification, inspection reports, or other methods acceptable to the enforcing agency which demonstrate substantial conformance. When specific documentation or special inspection is necessary to verify compliance, that method of compliance will be specified in the appropriate section or identified applicable checklist.		



DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.



PROJECT SPECIFIC STATE AGENCY APPROVAL	
<div>IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT APP: 02-123058 INC. REVIEWED FOR SS <input type="checkbox"/> PLS <input checked="" type="checkbox"/> ACS <input type="checkbox"/> DATE: 07/26/2024</div>	
<div>R&S TAVARES ASSOCIATES DESIGN & CONSULTING ARCHITECT 11590 W BERNARDO COURT, SUITE 100 SAN DIEGO, CA 92137 WWW.R&STAVARES.COM</div>	
PROFESSIONAL STAMP	
<div>REGISTERED PROFESSIONAL ARCHITECT MANUEL D. FRIEDL 63380 03/31/24 STATE OF CALIFORNIA RS#2208</div> <div>02/16/24</div>	
THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©	
CLIENT	
<div>Class Leasing 1651 Junitia Street, San Jacinto, CA 92583 Voice (951) 943-1908 Fax (951) 943-5768</div>	
ORIGINAL PC STATE AGENCY APPROVAL	
<div>APPROVED DIV. OF THE STATE ARCHITECT APP: 04-123058 PC REVIEWED FOR SS <input type="checkbox"/> PLS <input checked="" type="checkbox"/> ACS <input checked="" type="checkbox"/> CG <input checked="" type="checkbox"/> DATE: 02/20/2024</div>	
Revision Schedule	
#	Description Date
PRE-CHECK (PC) DOCUMENT	
Code: 2022 CBC	
A separate project application for construction is required	
PROJECT TITLE	
PC 2022 CBC: 24' x 40' EXPANDABLE TO 120' x 40'	
SHEET TITLE	
CAL GREEN CHECKLIST	
PROJECT NUMBER	
22088	
DRAWN BY	rMc/SC
CHECKED BY	RH/RT
DATE	
SHEET NO.	
A0.8	
SHEET OF	

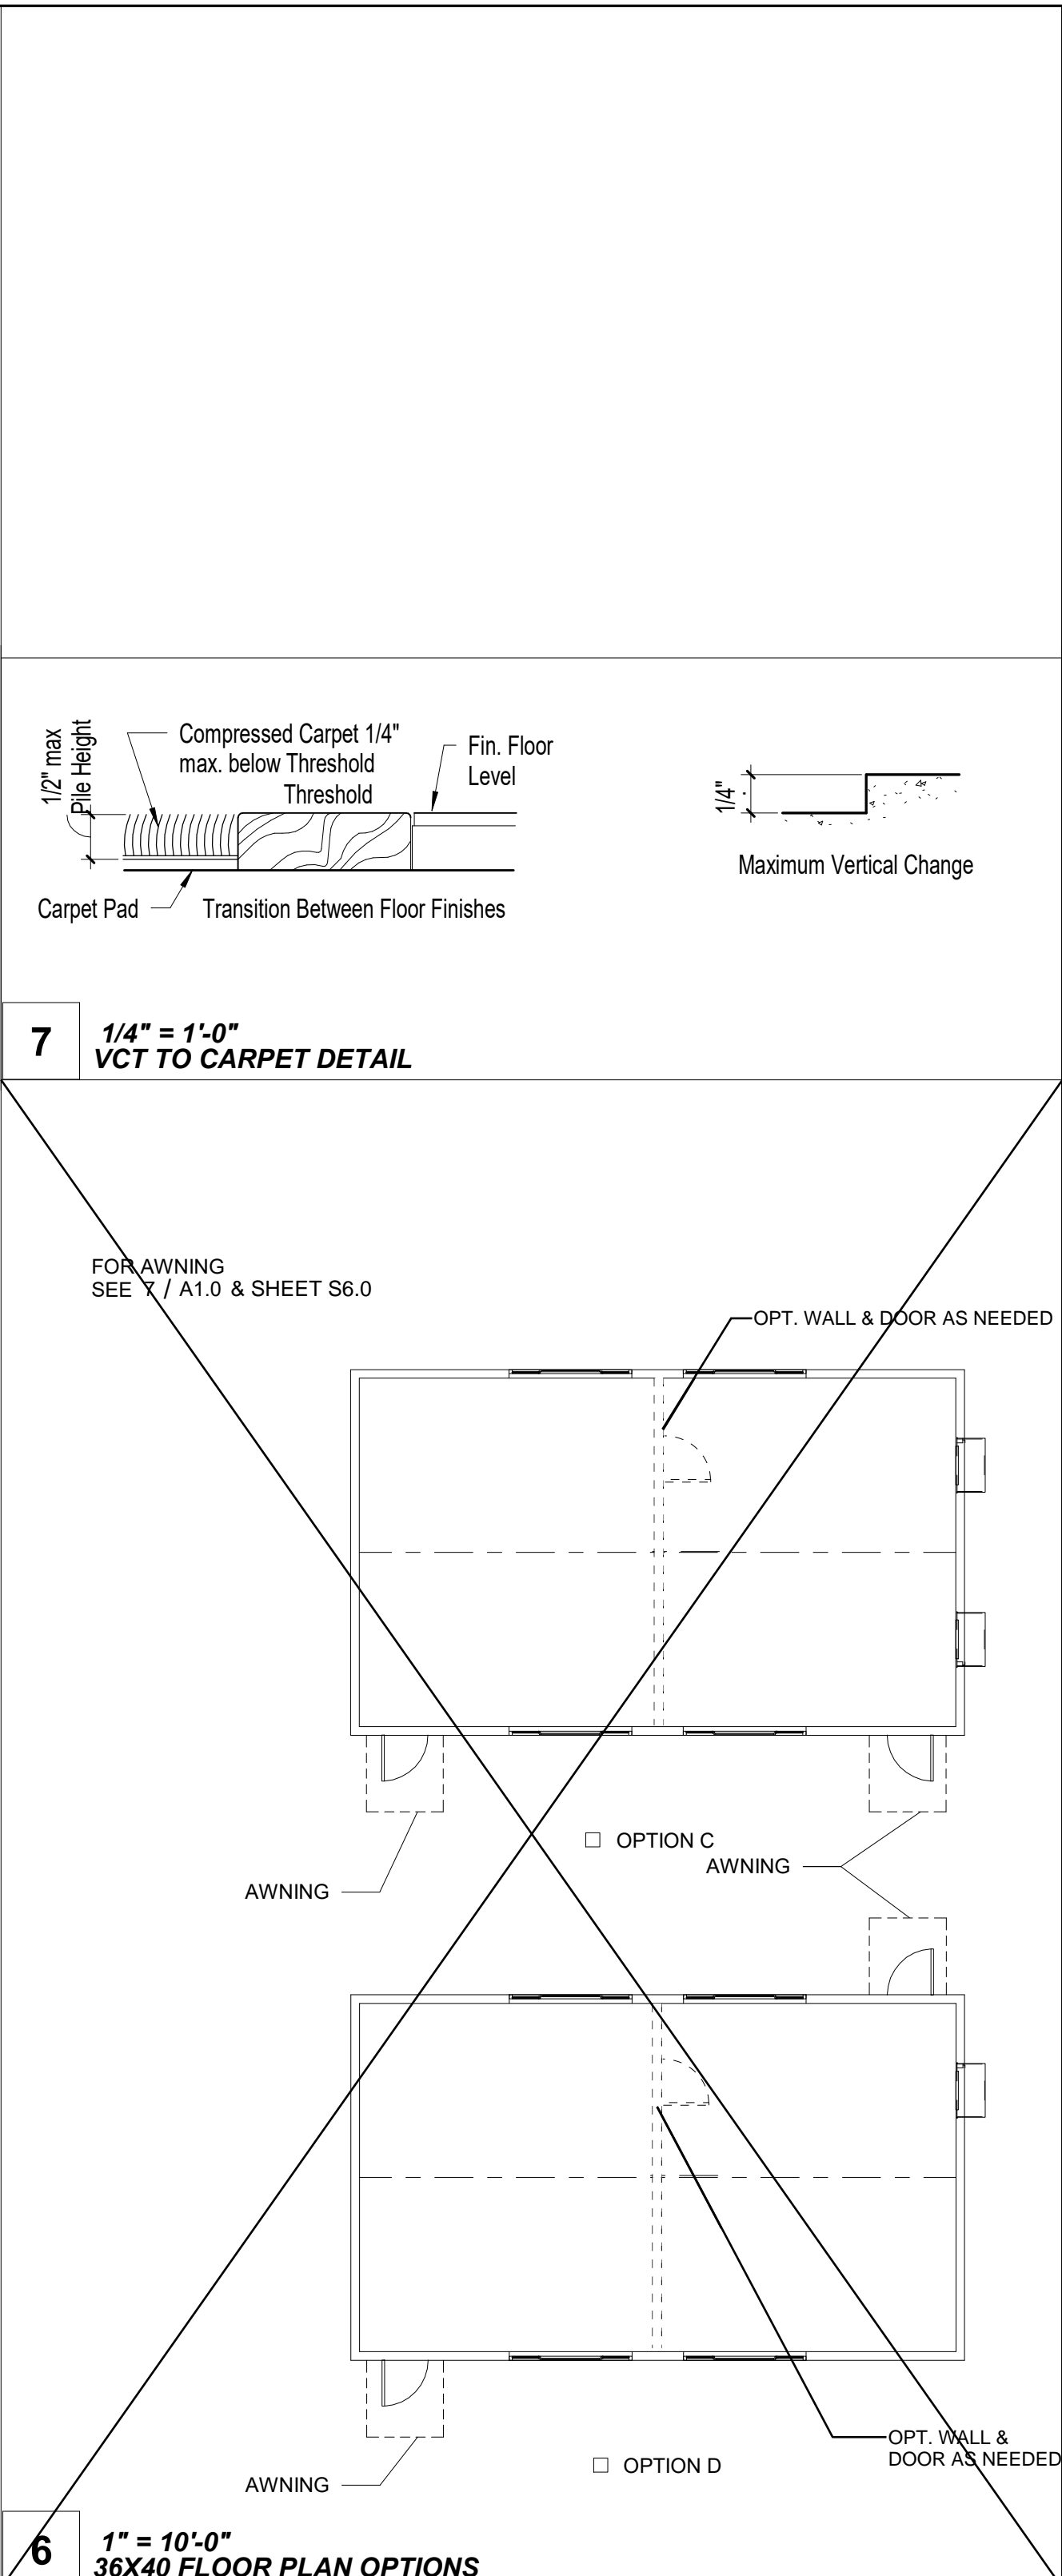

Roofing Schedule				
"SLOPE"	EDPM	Standing Seam	Parapet	Notes
Dual	<input type="checkbox"/> A4.2.2	<input type="checkbox"/> A4.0.2	N/A	
Mono	<input type="checkbox"/> A4.2.1	<input checked="" type="checkbox"/> A4.0.1	<input type="checkbox"/> A4.4.1	
HVAC Unit				
Keynote		Type	Type Comments	
<input checked="" type="checkbox"/> M1		Wall Mounted HVAC	See (M)-Sheets	
<input type="checkbox"/> M2		Roof Mounted HVAC	See (M)-Sheets	

6/15/2021 11:49:23 PM C:\Users\User\Documents\20093 - Aries, 24x40 PC - MainFile - Low Seismic 6.7_CESAR24D63.rvt

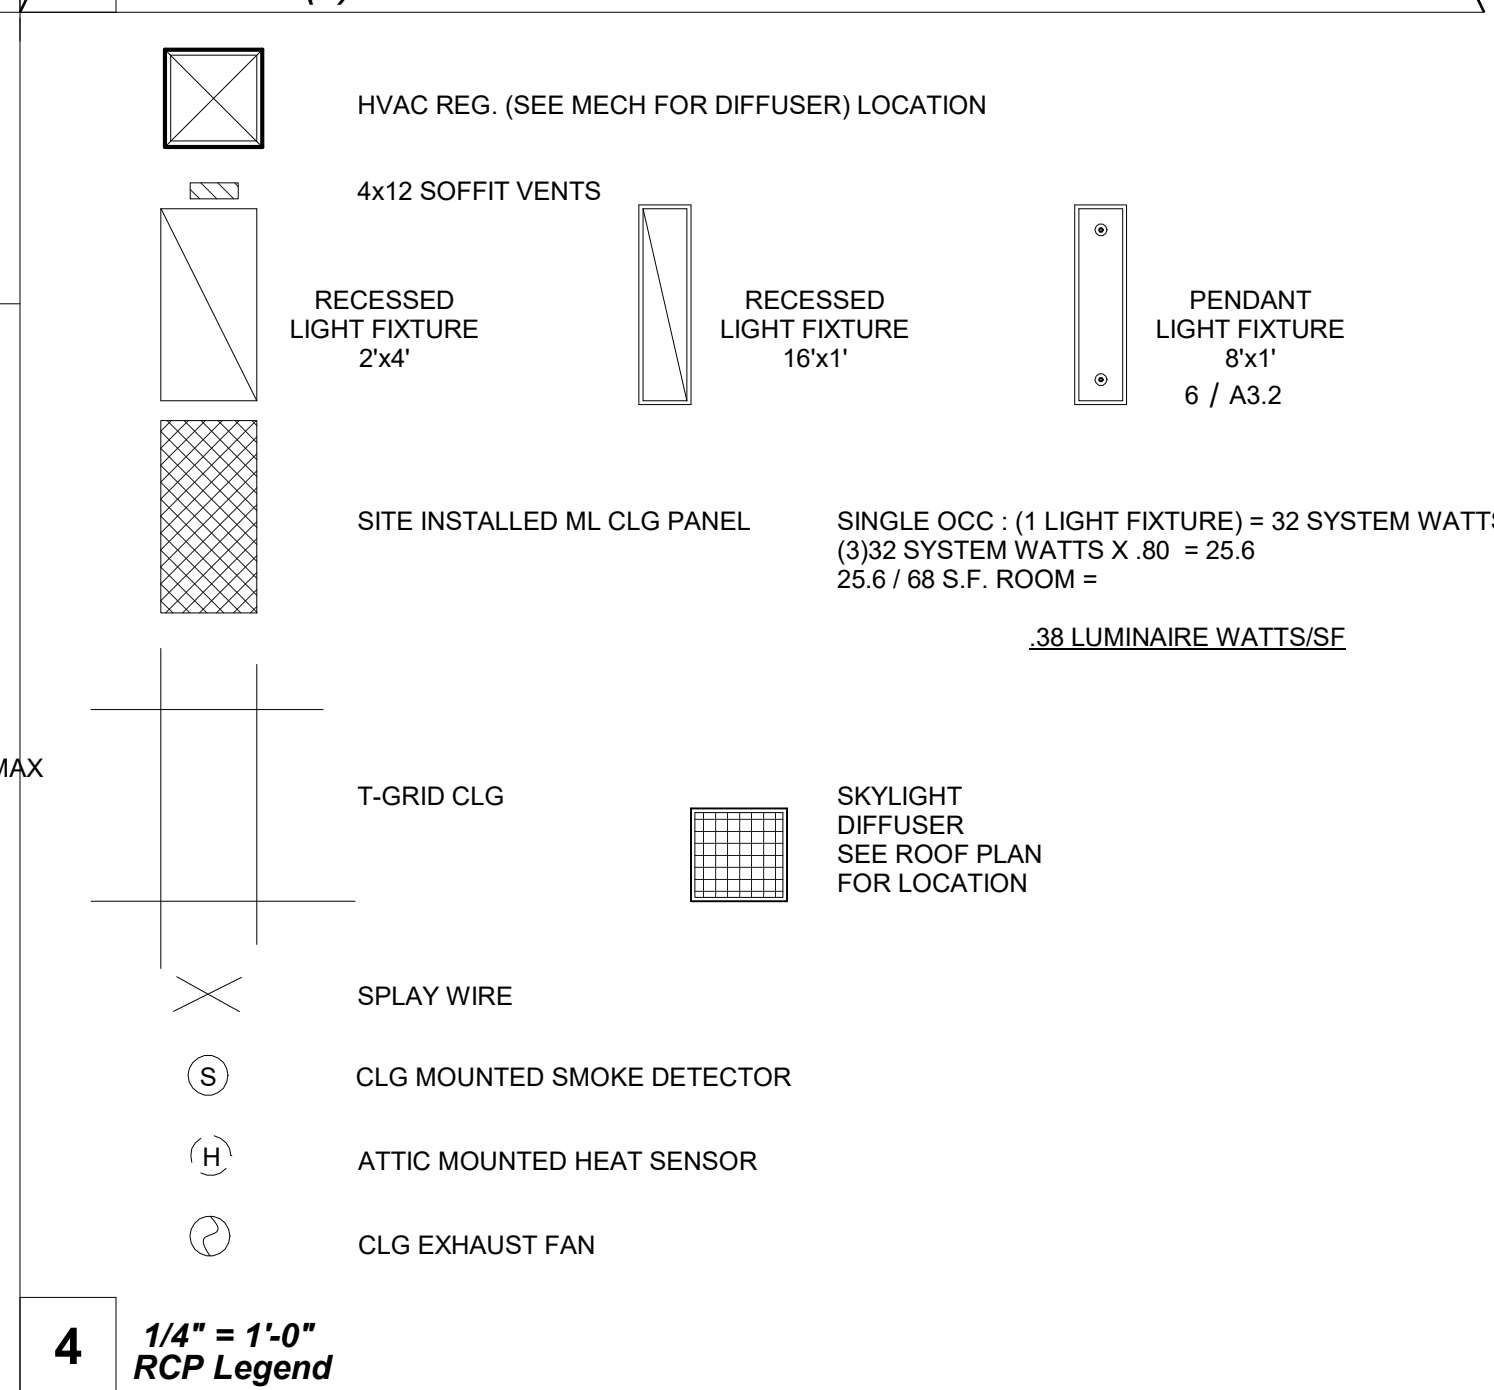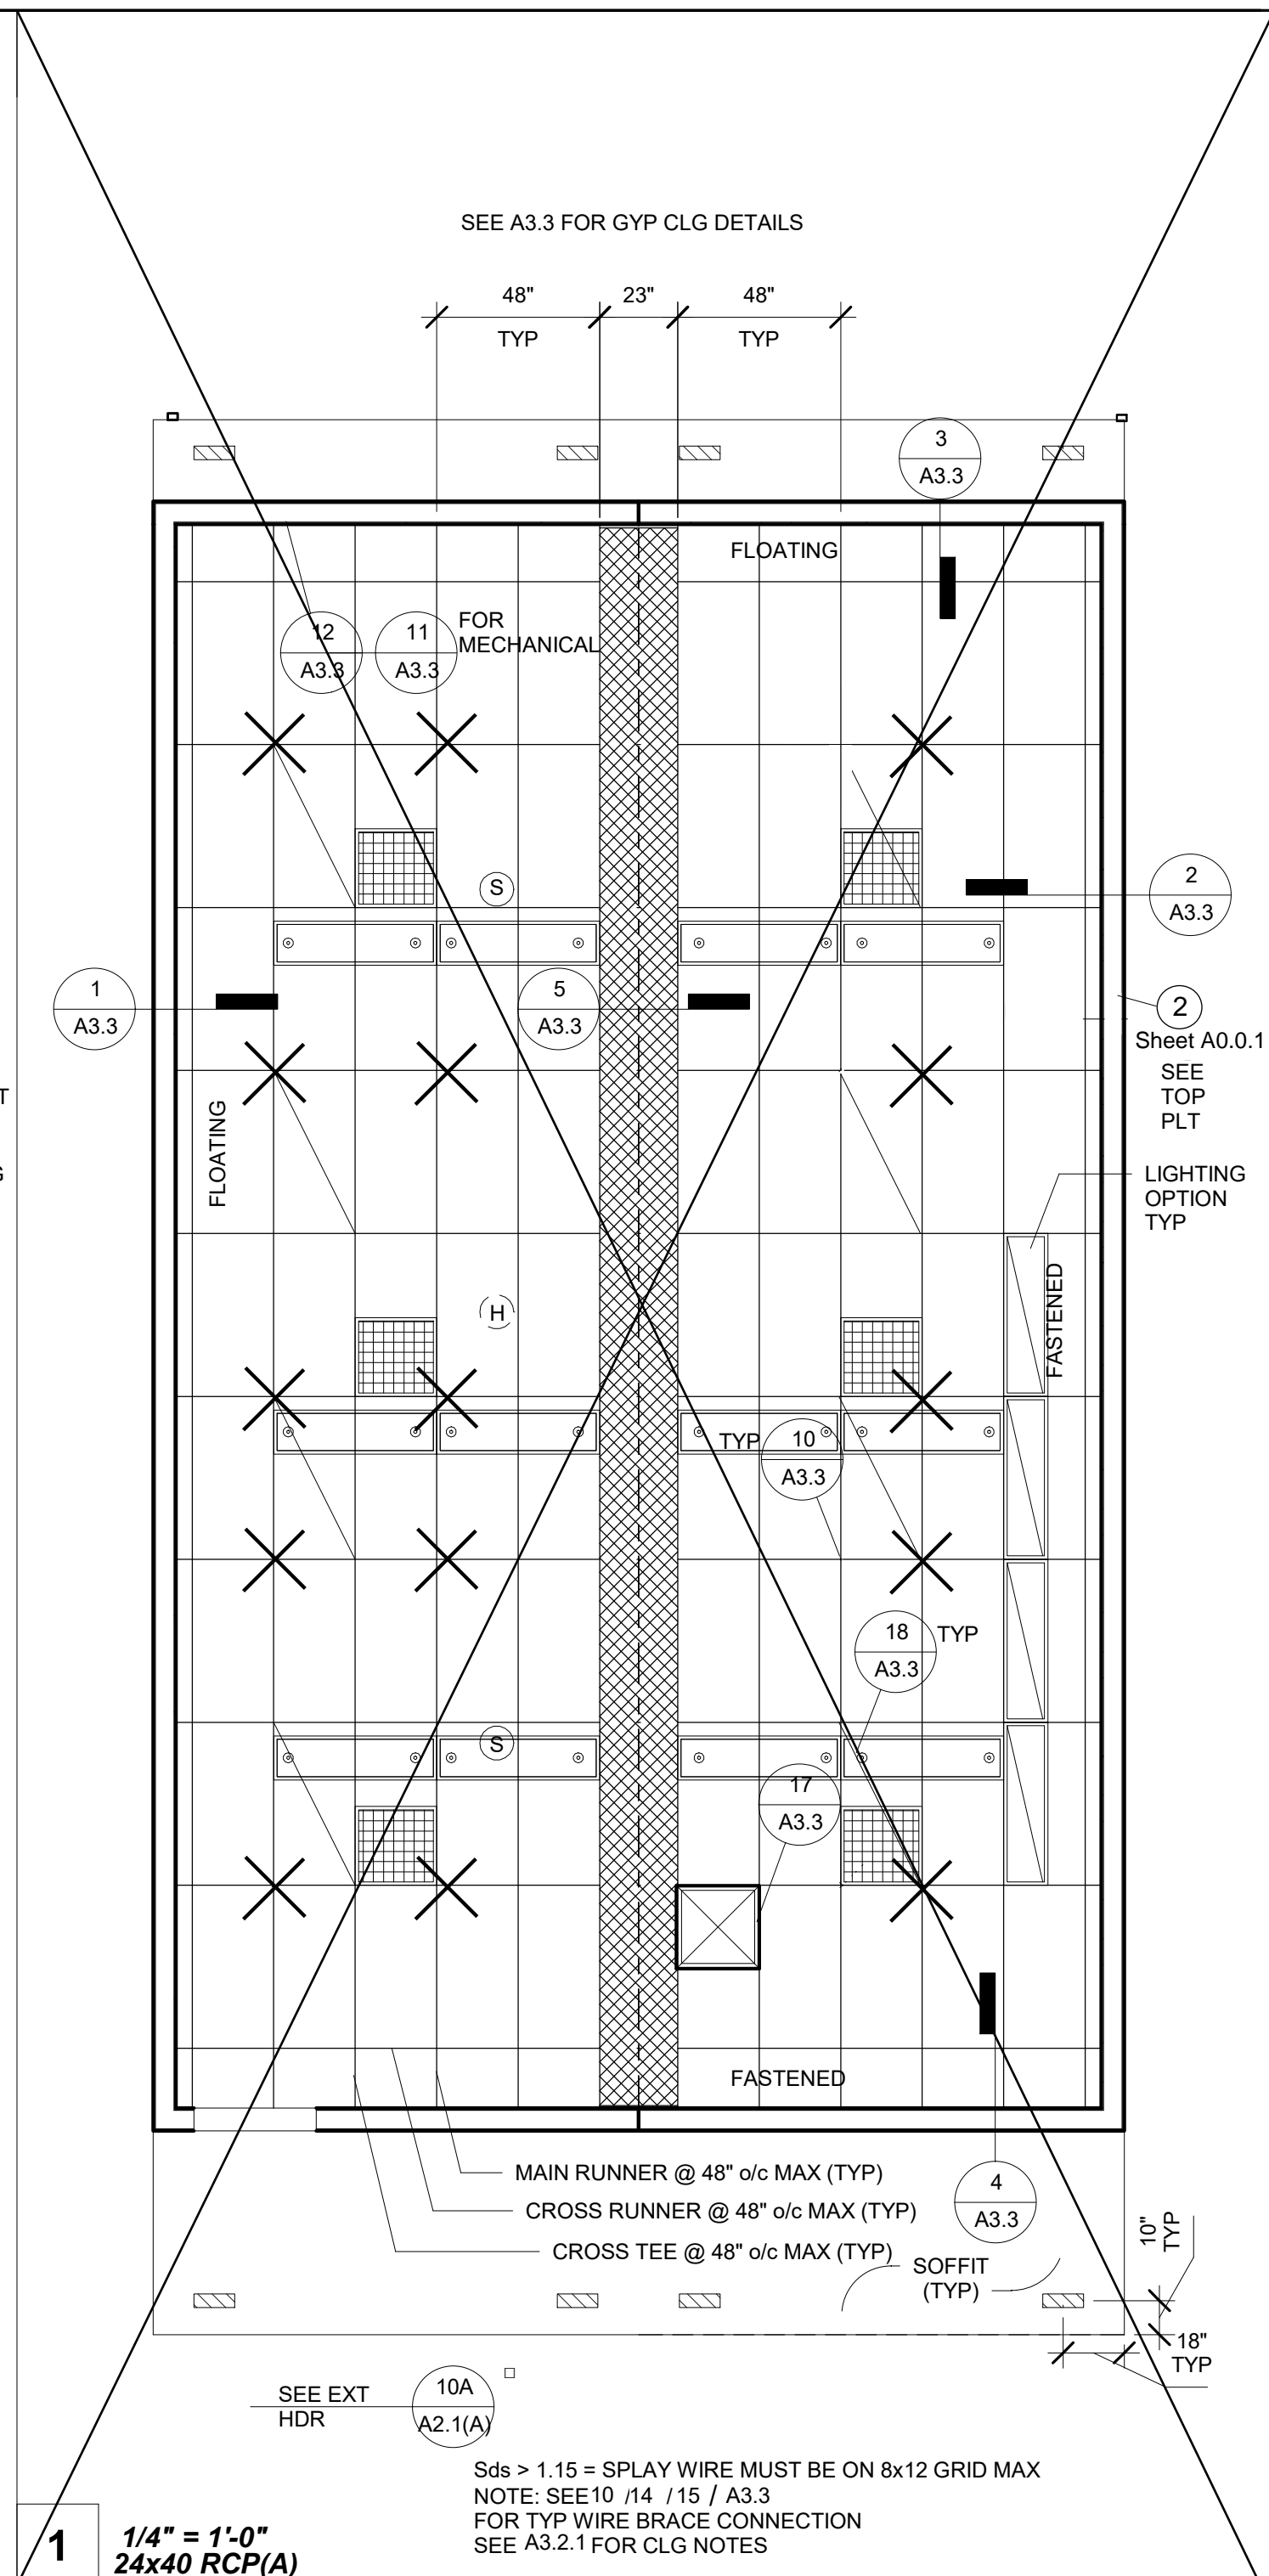

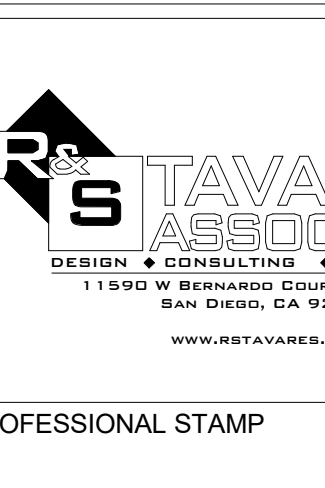PROJECT SPECIFIC STATE AGENCY APPROVAL 								
<p>R&S TAVARES ASSOCIATES <small>DESIGN • CONSULTING • PROJECT MGT</small> 11950 W. BERNARDINO COURT, SUITE 100 SAN DIEGO, CA 92127 WWW.RSTAVARES.COM</p>								
PROFESSIONAL STAMP								
<p>THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©</p>								
CLIENT								
 Class Leasing 1651 Juanita Street, San Jacinto, CA 92583 Voice (951) 943-1908 Fax (951) 943-5768								
ORIGINAL PC STATE AGENCY APPROVAL								
<p style="text-align: center;">APPROVED DIV. OF THE STATE ARCHITECT APP: 04-123059 PC REVIEWER FOR SS <input checked="" type="checkbox"/> PLS <input checked="" type="checkbox"/> ACS <input checked="" type="checkbox"/> CG <input checked="" type="checkbox"/> DATE: 02/20/2024</p>								
<p style="text-align: center;">Revision Schedule</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>#</th> <th>Description</th> <th>Date</th> </tr> </thead> <tbody> <tr> <td colspan="3" style="height: 100px;"></td> </tr> </tbody> </table>			#	Description	Date			
#	Description	Date						
<p style="text-align: center;">PRE-CHECK (PC) DOCUMENT</p> <p style="text-align: center;">Code: 2022 CBC</p> <p>A separate project application for construction is required</p>								
<p>PROJECT TITLE</p> <h2 style="margin: 0;">PC 2022 CBC: 24' x 40' EXPANDABLE TO 120' x 40'</h2>								
<p>SHEET TITLE</p> <h2 style="margin: 0; text-align: center;">RCP</h2>								
<p>PROJECT NUMBER</p> <p style="text-align: center;">22088</p>								
<p>DRAWN BY</p> <p style="text-align: center;">rMc/SC</p>								
<p>CHECKED BY</p> <p style="text-align: center;">RH/RT</p>								
<p>DATE</p>								
<p>SHEET NO.</p> <h1 style="margin: 0; text-align: center;">A3.2</h1>								
<p style="text-align: center;">SHEET OF</p>								

1. CEILING SYSTEM GENERAL NOTES

- 1.01 Ceiling system components shall comply with ASTM C635 and Section 5.1 of ASTM E580.
- 1.02 The ceiling grid system must be rated heavy duty as defined by ASTM C635.
- 1.03 Ceiling systems. The following ceiling system(s) is/are part of the scope of this project:
Manufacturer: ARMSTONG (OR EQUAL)
Product Name: PRELUDE XL AND PRELUDE XL HIGH RECYLED CONTENT (HRC)
Evaluation Report Type and Number: ICC ESR#1308
Main Runner Part, Model, or Catalog Number: 7301
Cross Runner Part, Model, Catalog Number: 4" CROSS T # XL7341 / 2" CROSS T # XL7328
- 1.04 Seismic Wall Clip: STANDARD 7/8" WALL ANGLE CLIP w/ BERC2 CLIP
Manufacturer's Model: 7810
- 1.05 Ceiling panels shall not support any luminaires, air terminals or devices.
- 1.06 For ceiling installations utilizing acoustical tile panels of mineral or glass fiber, it is not mandatory to provide 3/4" clearance between the acoustical tile panels and the wall on the sides of the ceiling which are free to slip. For all other ceiling panel types, provide 3/4" clearance between the ceiling panel and the wall on the sides of the ceiling free to slip. Clearance between ceiling grid runners/members and walls shall comply with the details on these drawings regardless of ceiling tile material.
2. MATERIALS
- 2.01 Ceiling wire shall be Class 1 zinc coated (galvanized) carbon steel conforming to ASTM A641. Wire shall be #12 gauge (0.106" diameter) with soft temper and minimum ultimate tensile strength = 70 ksi.
- 2.02 Galvanized sheet steel (including that used for metal stud and track compression struts/post) shall conform to ASTM A653, or other equivalent sheet steel listed in Section A3.1 of the North American Specification for the Design of Cold-Formed Steel Structural Members, (AISI S100). Material 43 mil (18 gauge) and lighter shall have minimum yield strength of 33 ksi. Material 54 mil (16 gauge) and heavier shall have a minimum yield strength of 50ksi.
- 2.03 Electrical metallic tube (EMT) shall be ANSI C80.3/UL 797 carbon steel with G90 galvanizing. EMT shall have minimum yield strength (F_y) of 30 ksi and minimum ultimate strength (F_u) of 48 ksi.
3. ATTACHMENT OF HANGER AND BRACING WIRES
- 3.01 Separate all ceiling hanger and bracing wires at least 6 inches from all unbraced ducts, pipes, conduit, etc.
- 3.02 Hanger and bracing wires shall not attach to or bend around obstructions including but not limited to piping, ductwork, conduit and equipment.

Detail Title:	REV: 09/21/2015	Detail No.
CEILING NOTES	REV: 03/2022	1.00

NOTE:
BERG2 2" BEAM-END RETAINING CLIP -Allows you to create a code-compliant Seismic D, E, F ceiling installation while eliminating the need to use 2" wall molding or spreader bars.

TABLE 1: LATERAL FORCE BRACE ASSEMBLY SPACING		
Design Spectral Acceleration Parameter, (S _{DS})	Brace Assembly Spacing	
	z/h ≤ 0.5 ^a	z/h > 0.5 ^{a,b}
S _{DS} ≤ 1.15	12'-0" x 12'-0"	12'-0" x 12'-0"
1.15 < S _{DS} ≤ 1.73	12'-0" x 12'-0"	8'-0" x 12'-0"
S _{DS} > 1.73	8'-0" x 12'-0"	8'-0" x 8'-0"
Footnotes: a. Where, as defined in ASCE 7 Section 13.3.1: z = height in structure of point of attachment of ceiling with respect to the base. h = average roof height of the structure with respect to the base. b. It shall be permitted to use the brace assembly spacing for "z/h > 0.5" for the full building height.		

SEE ALT SHEET FOR FINAL CONFIGURATION OF CEILING AND S_{DS} VALUE SITE SPECIFIC


- 3.03 Hanger wires that are more than one (horizontal) in six (vertical) out of plumb shall have counter-sloping wires.
- 3.04 Slack safety wires shall be considered hanger wires for installation and testing requirements.
- 3.05 Hanger and bracing wire anchorage to the structure shall be installed in such a manner that the direction of the anchorage aligns closely with the direction of the wire (e.g., bracing wire ceiling clips must be bent as shown in the details and rotated as required to align closely with the direction of the wire, screw eyes in wood must be installed so they align closely with the direction of the wire, etc.).
4. FASTENERS AND WELDING
- 4.01 Sheet metal screws shall comply with ASTM C1513 and ASME B18.6.3. Penetration of screws through joined material shall not be less than three exposed threads.
- 4.02 Expansion anchors shall be: NA
- 4.03 Power-Actuated Fasteners shall be: NA
- 4.04 If not otherwise specified in the evaluation report, power-actuated fasteners installed in steel shall be installed so the entire pointed end of the fastener is driven through the steel member
- 4.05 Power-actuated fasteners in concrete or masonry are not permitted for bracing wires.
- 4.06 Concrete reinforcement and prestressing tendons shall be located by non-destructive means prior to installing post-installed anchors.
- 4.07 Welding shall be in accordance with AWS D1.3 using E60XX series electrodes.
5. TESTING
- 5.01 All field testing must be performed in the presence of the project inspector.
- 5.02 Post-installed anchors in concrete used to support hanger wires shall be tested at a frequency of 10 percent. Power-actuated fasteners in concrete shall be field tested for 200 pounds in tension. All other post-installed anchors in concrete shall be tested in accordance with CBC Section 1910A.5.
- 5.03 Post-installed anchors in concrete used to attach bracing wires shall be tested at a frequency of 50 percent in accordance with CBC Section 1910A.5.
6. LUMINAIRES
- 6.01 All luminaires shall be positively attached to the ceiling suspension systems by mechanical means to resist a horizontal force equal to the weight of the luminaire. A minimum of two screws or approved fasteners are required at each luminaire, per ASTM E580 Section 5.3.1.
- 6.02 Surface-mounted luminaires shall be attached to the main runner with at least two positive clamping devices. The clamping device shall completely surround the supporting

Detail Title:	REV: 09/21/2015	Detail No.
CEILING NOTES	REV: 03/2022	1.00


- ceiling runner and be made of steel with a minimum thickness of #14 gauge. Rotational spring catches do not comply. A #12 gauge slack safety wire shall be connected from each clamping device to the structure above. Provide additional supports when a luminaire is 8 feet or longer or exceeds 56 pounds. Maximum spacing between supports shall not exceed 8 feet.
- 6.03 Luminaires weighing less than or equal to 10 pounds may besupported directly on the ceiling runners, shall have a minimum of one #12 gauge slack safety wire connected from the fixture housing to the structure above.
- 6.04 Luminaires weighing greater than 10 pounds but less than or equal to 56 pounds may be supported directly on the ceiling runners, but they shall have a minimum of two #12 gauge slack safety wires connected from the fixture housing at diagonal corners to the structure above.
Exception: All luminaires greater than two by four feet weighing less than 56 pounds shall have a #12 gauge slack safety wire at each corner.
- 6.05 All luminaires weighing greater than 56 pounds shall be independently supported by not less than four taut #12 gauge hanger wires (one at each corner) attached from the fixture housing to the structure above or other approved hangers. The four taut #12 gauge wires or other approved hangers, including their attachment to the structure above, shall be capable of supporting four times the weight of the fixture.
7. SERVICES WITHIN THE CEILING
- 7.01 All flexible sprinkler hose fitting mounting brackets, ceiling-mounted air terminals or other services shall be positively attached to the ceiling suspension systems by mechanical means. Screws or approved fasteners are required. A minimum of two attachments are required at each component.
- 7.02 Ceiling-mounted air terminals or other services weighing less than or equal to 20 pounds shall have one #12 gauge slack safety wire attached from the terminal or service to the structure above.
- 7.03 Flexible sprinkler hose fittings, ceiling-mounted air terminals or other services weighing more than 20 pounds but less than or equal to 56 pounds shall have two #12 gauge slack safety wires (at diagonal corners) connected from the terminal or service to the structure above.
- 7.04 Flexible sprinkler hose fittings, ceiling-mounted air terminals or other services weighing more than 56 pounds shall be supported directly from the structure above by not less than four taut #12 gauge hanger wires attached from the terminal or service to the structure above or other approved hangers.
8. OTHER DEVICES WITHIN THE CEILING
- 8.01 All lightweight miscellaneous devices, such as strobe lights, occupancy sensors, speakers, exit signs, etc., shall be attached to the ceiling grid. In addition, devices weighing more than 10 pounds shall have a #12 gauge slack safety wire anchored to the structure above. Devices weighing more than 20 pounds shall be supported independently from the strcure above.

Detail Title:	REV: 09/21/2015	Detail No.
CEILING NOTES	REV: 03/2022	1.00

NOTE:
1.ITEMS SHOWN WITH A MFR CALLOUT MAY BE SUBSTITUTED WITH AN OR EQUAL OR GREATER PRODUCT WITH DSA APPROVAL

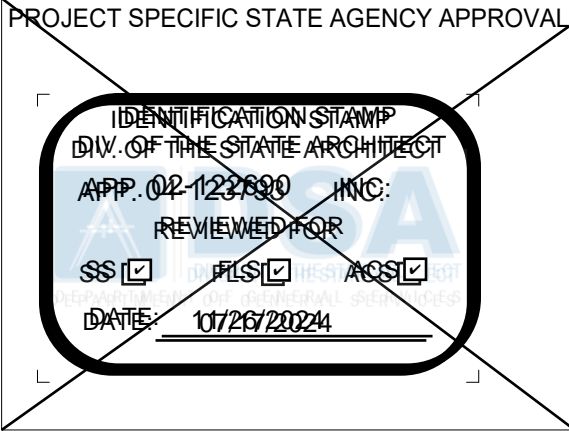


PROFESSIONAL STAMP

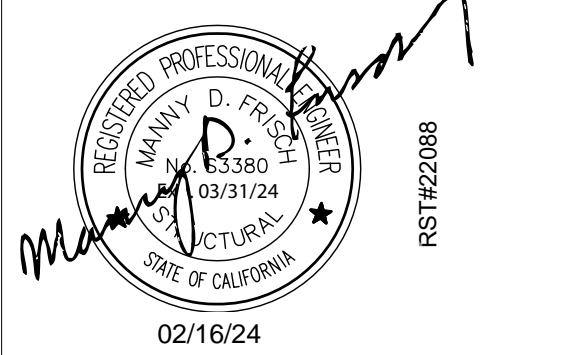




















THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT

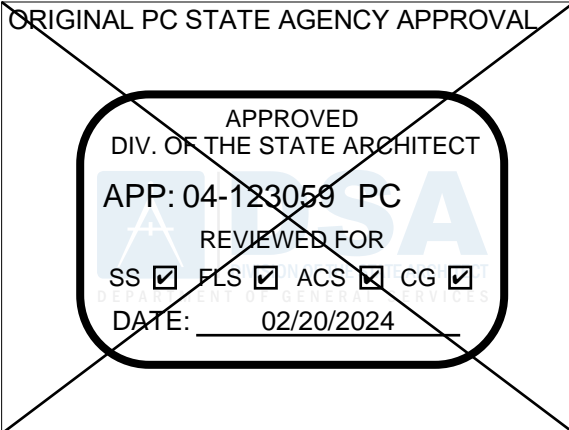


Revision Schedule		
#	Description	Date
PRE-CHECK (PC) DOCUMENT		
Code: 2022 CBC		
A separate project application for construction is required		
PROJECT TITLE		
PC 2022 CBC: 24' x 40' EXPANDABLE TO 120' x 40'		
SHEET TITLE		
CEILING NOTES		
PROJECT NUMBER		
22088		
DRAWN BY		
rMc/SC		
CHECKED BY		
RH/RT		
DATE		
SHEET NO.		
A3.2.1		
SHEET OF		

6/15/2021 11:15:03 PM C:\Users\User\Documents\20093 - Aries, 24x40 PC - MainFile - Low Seismic_6.7_CESAR24D63.rvt

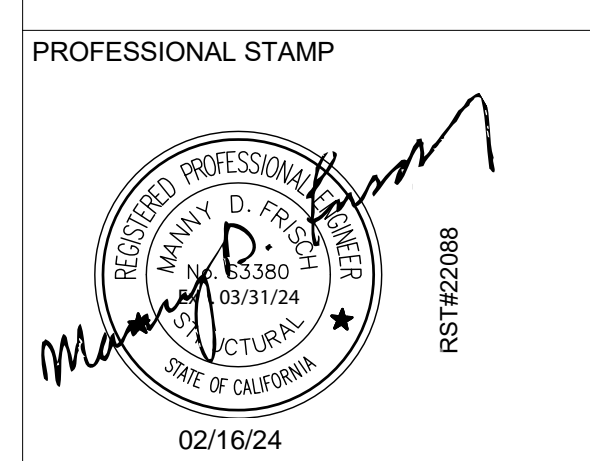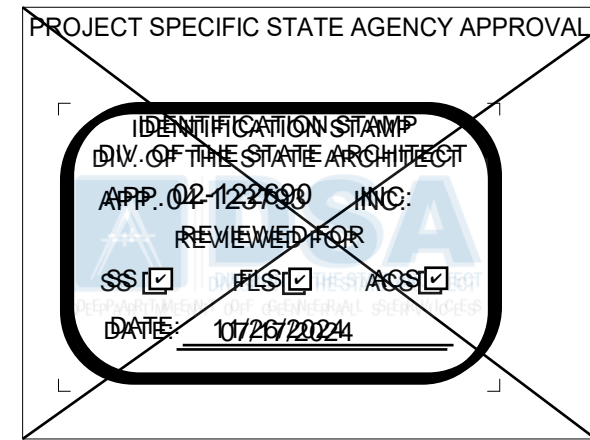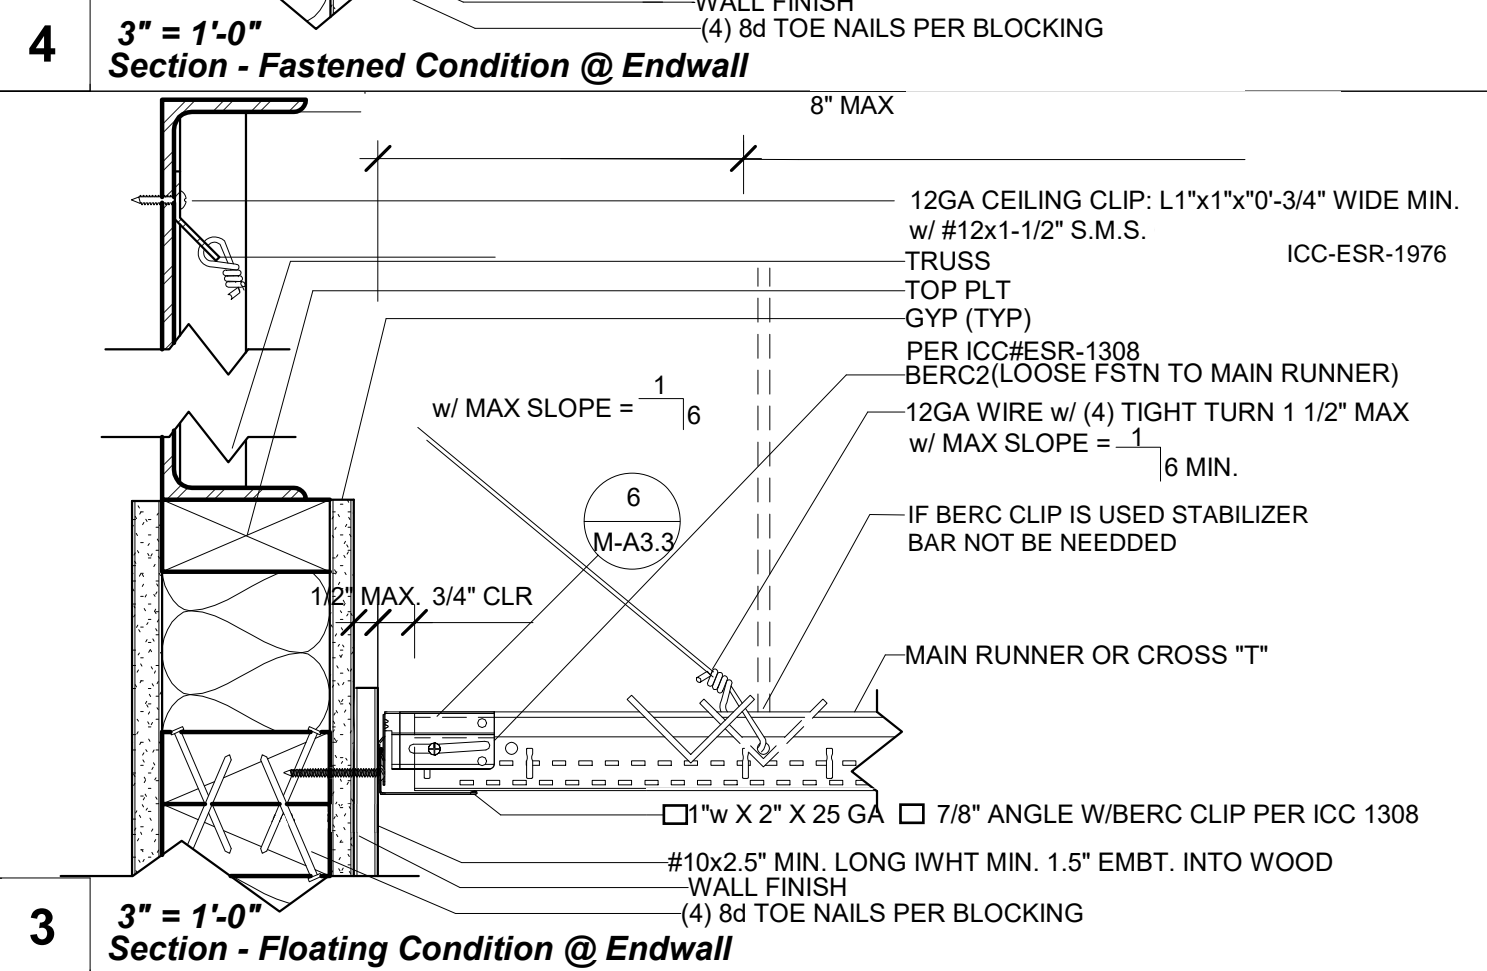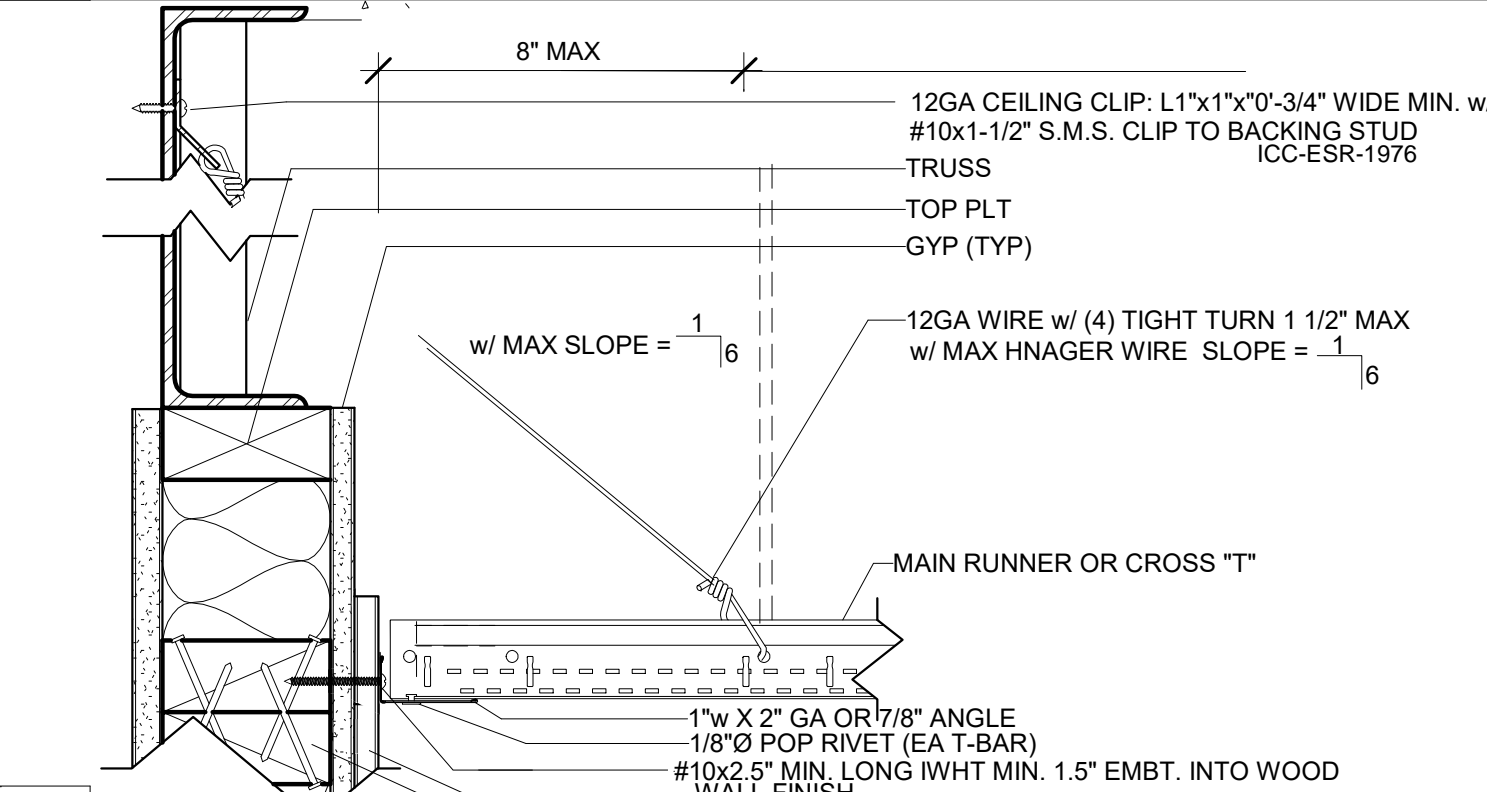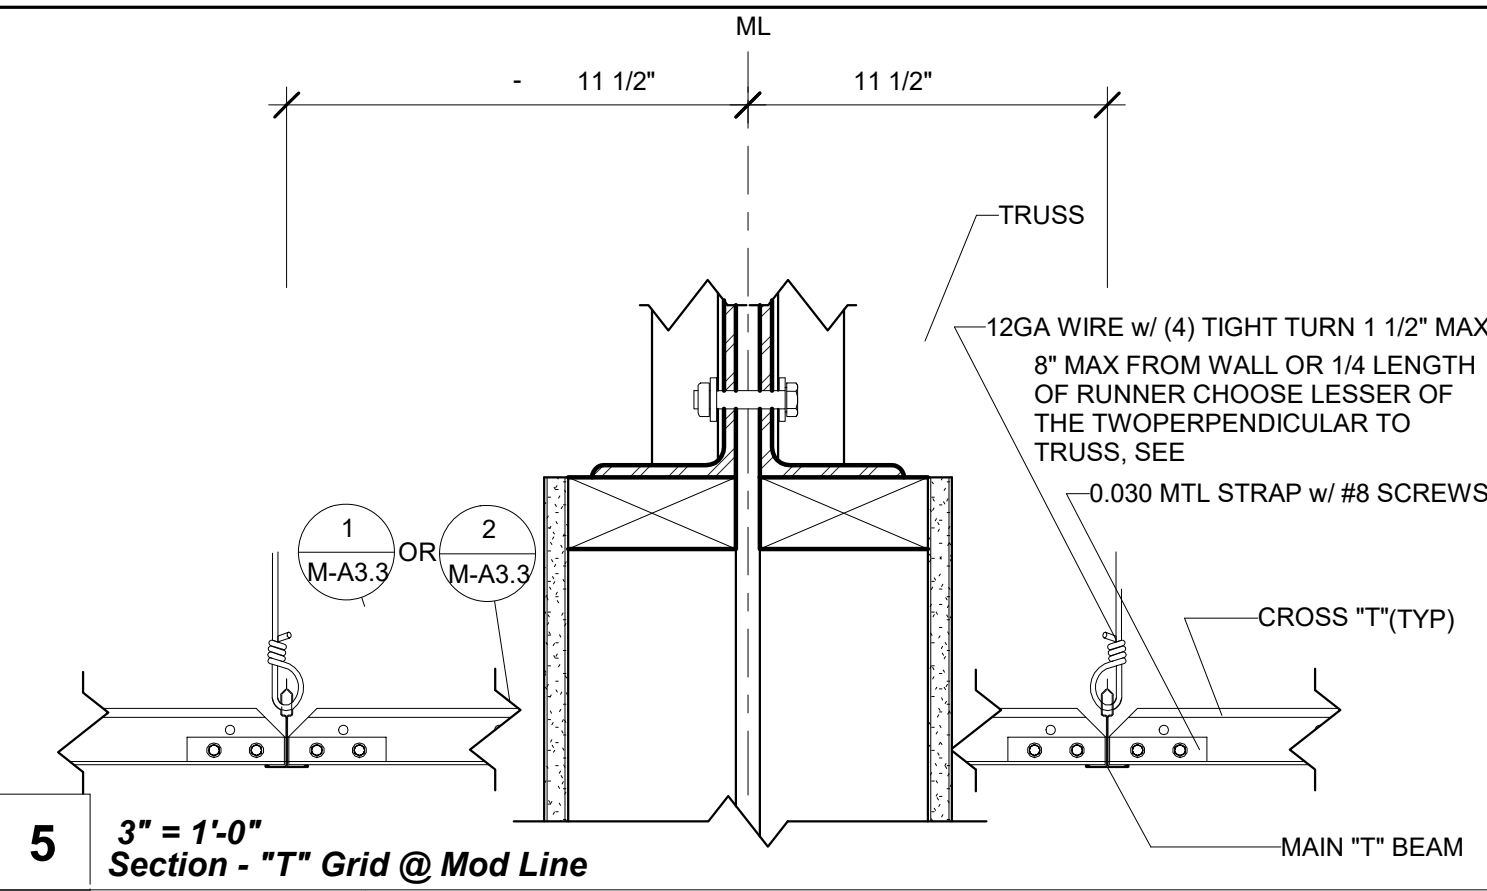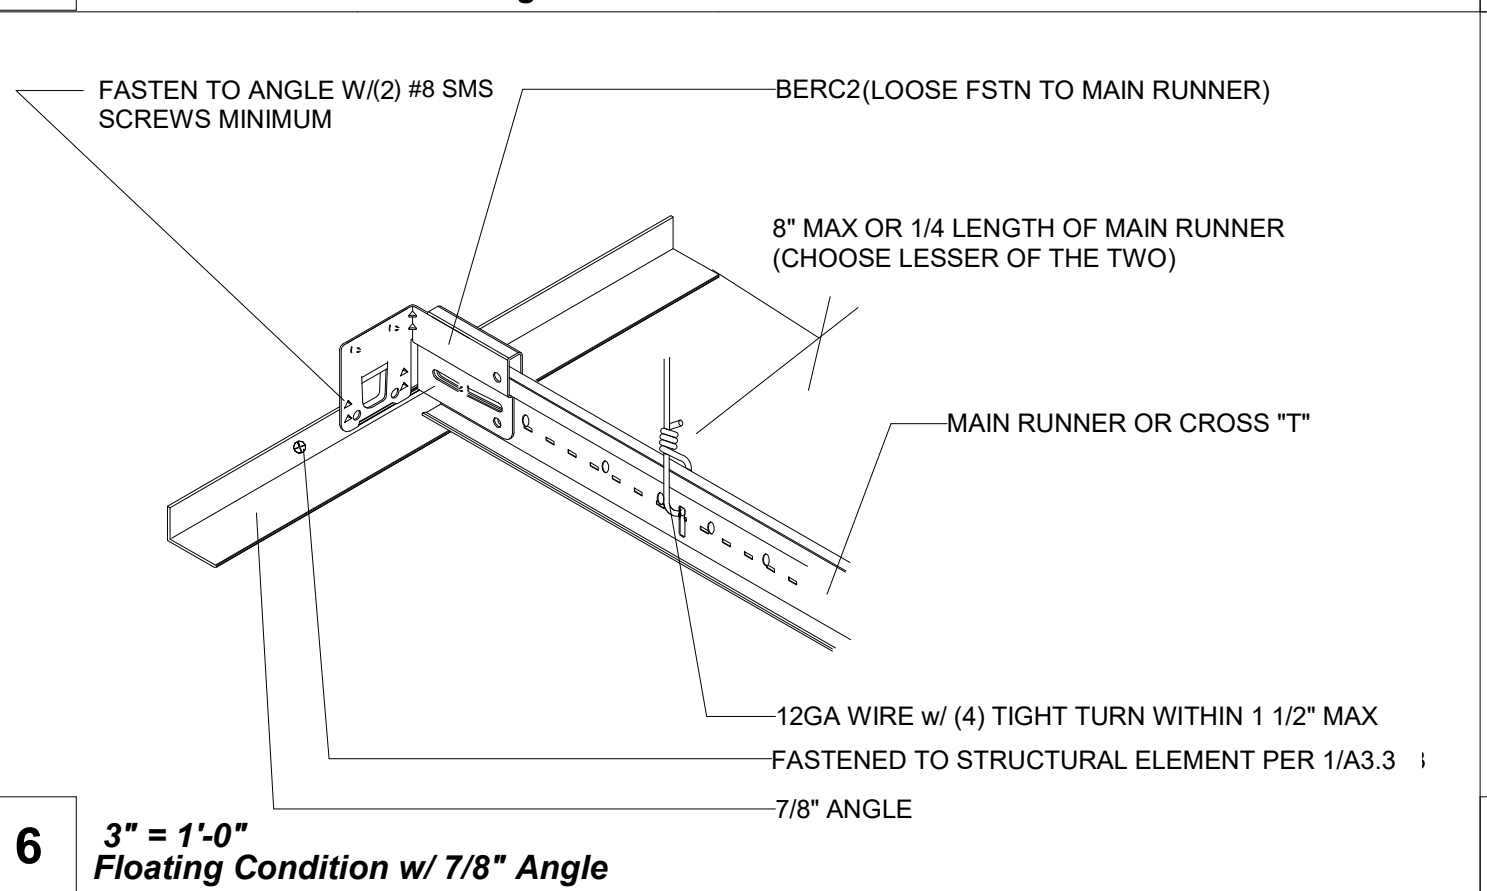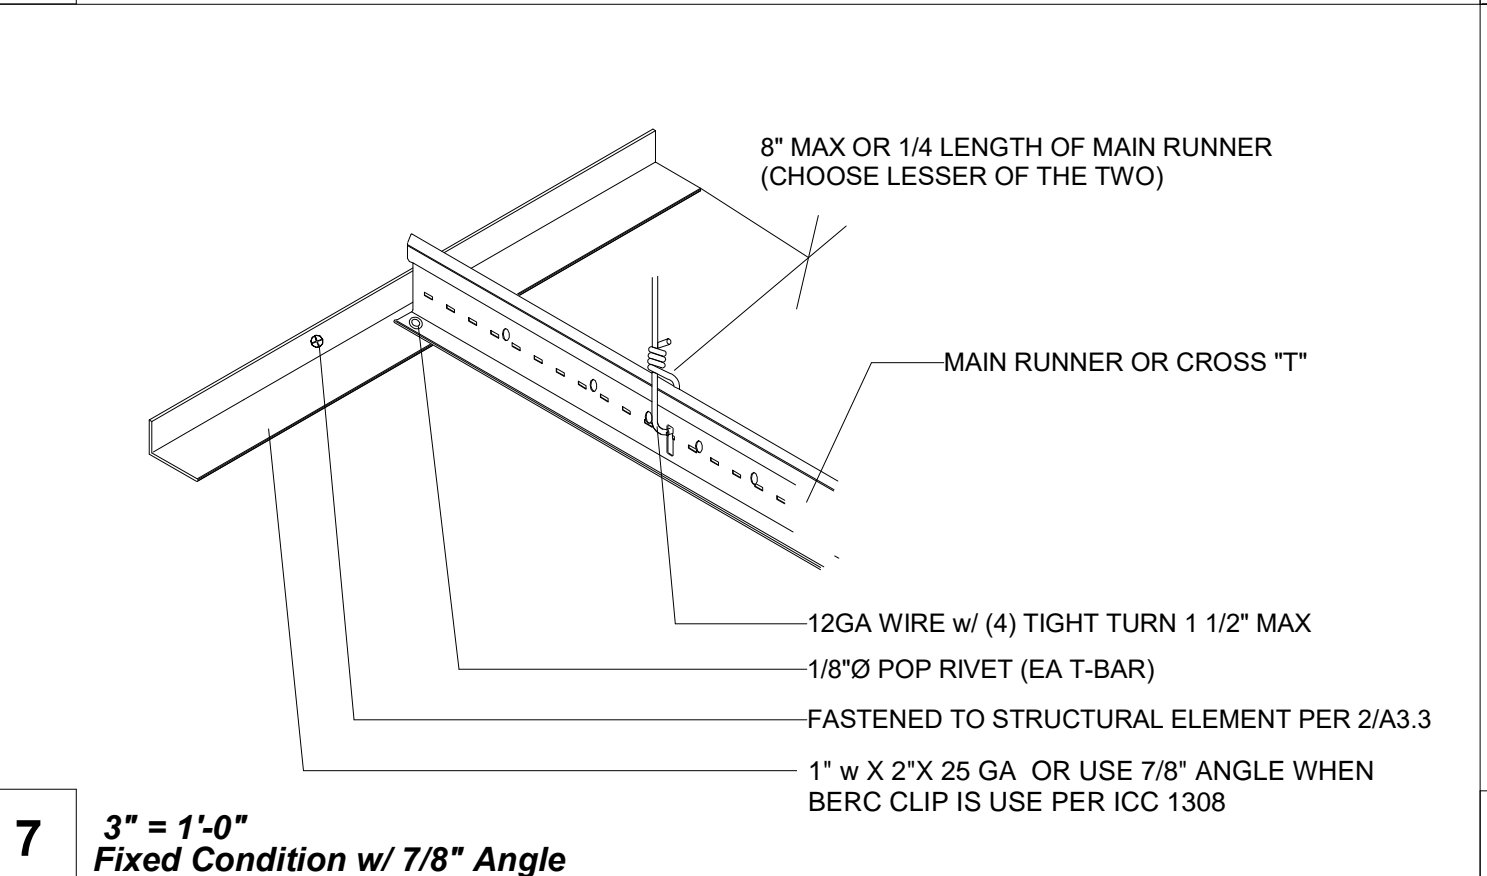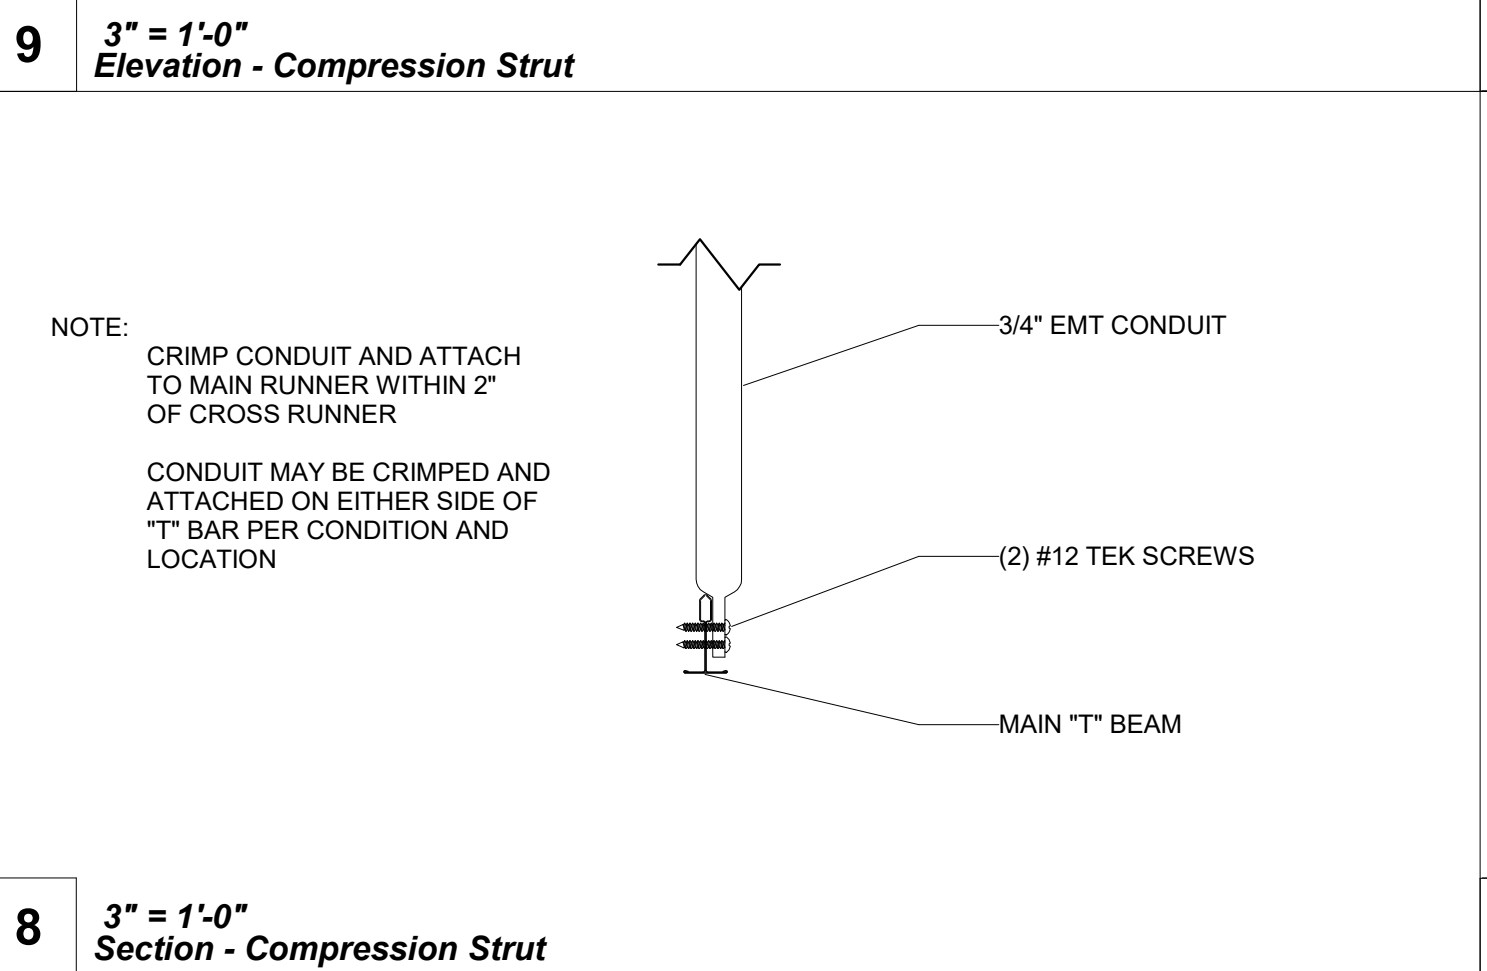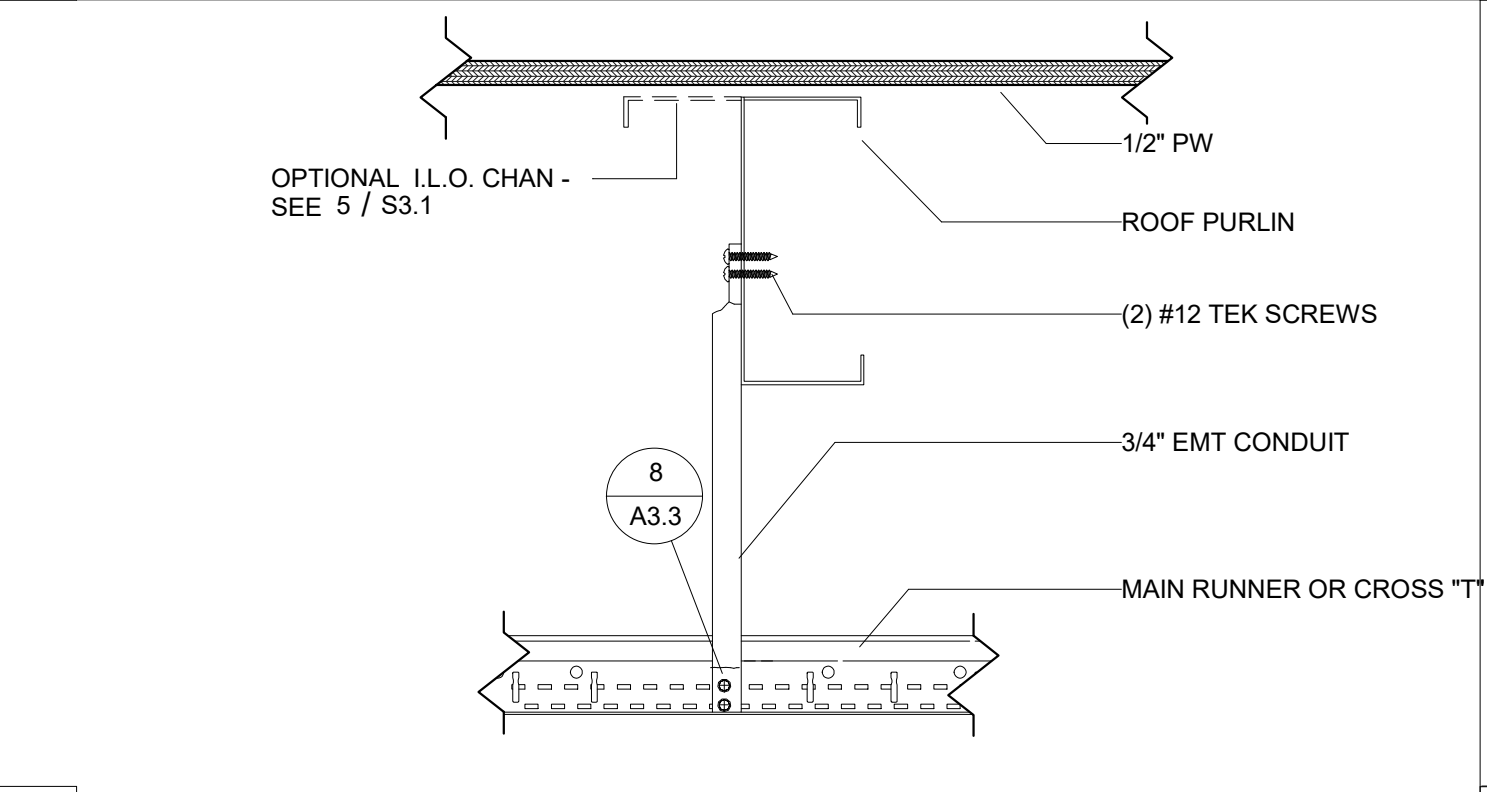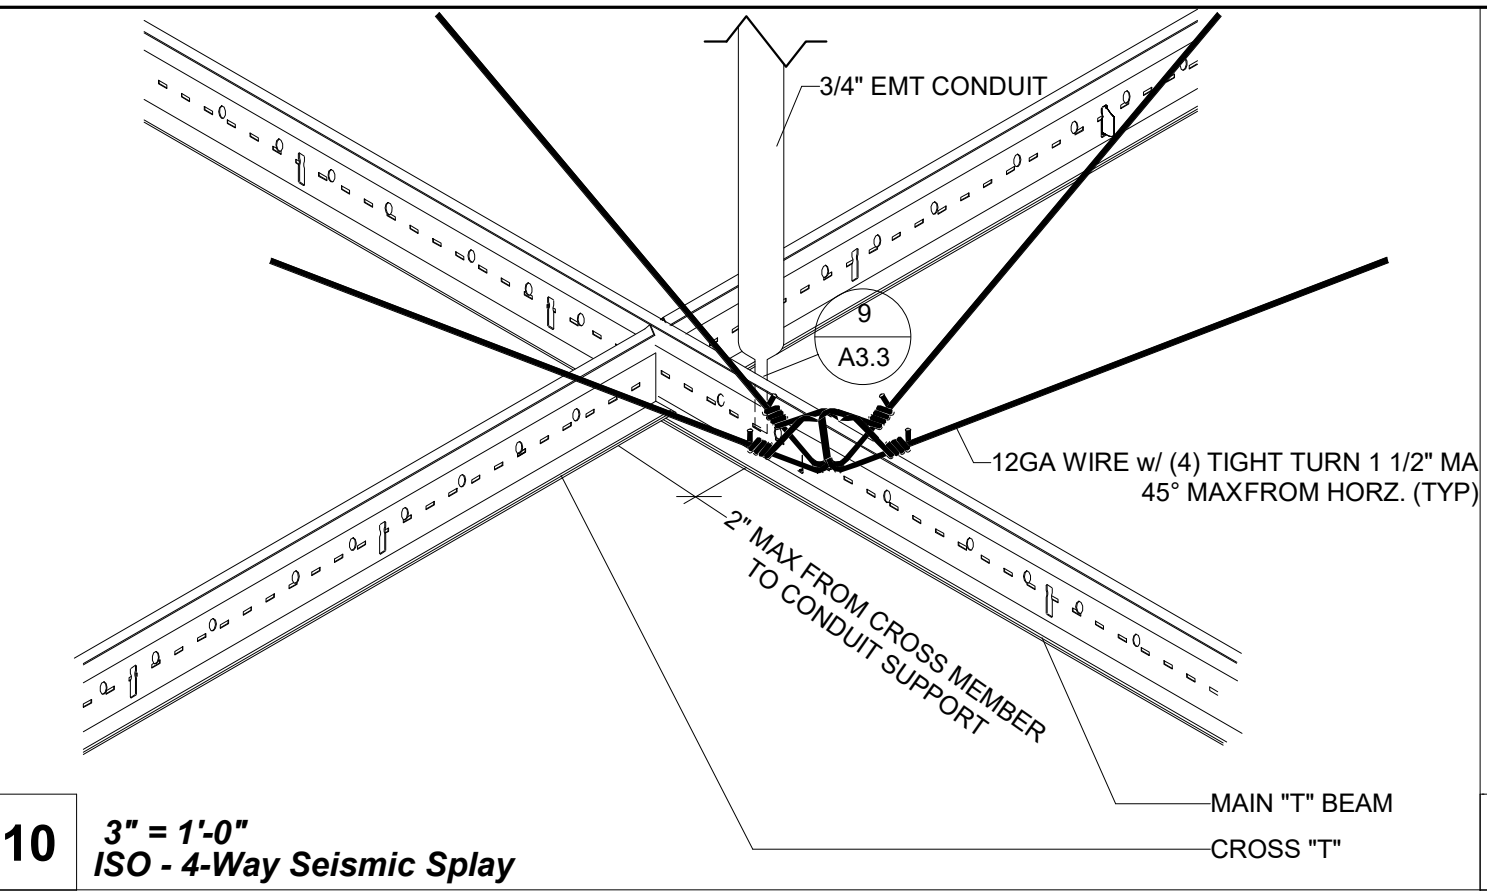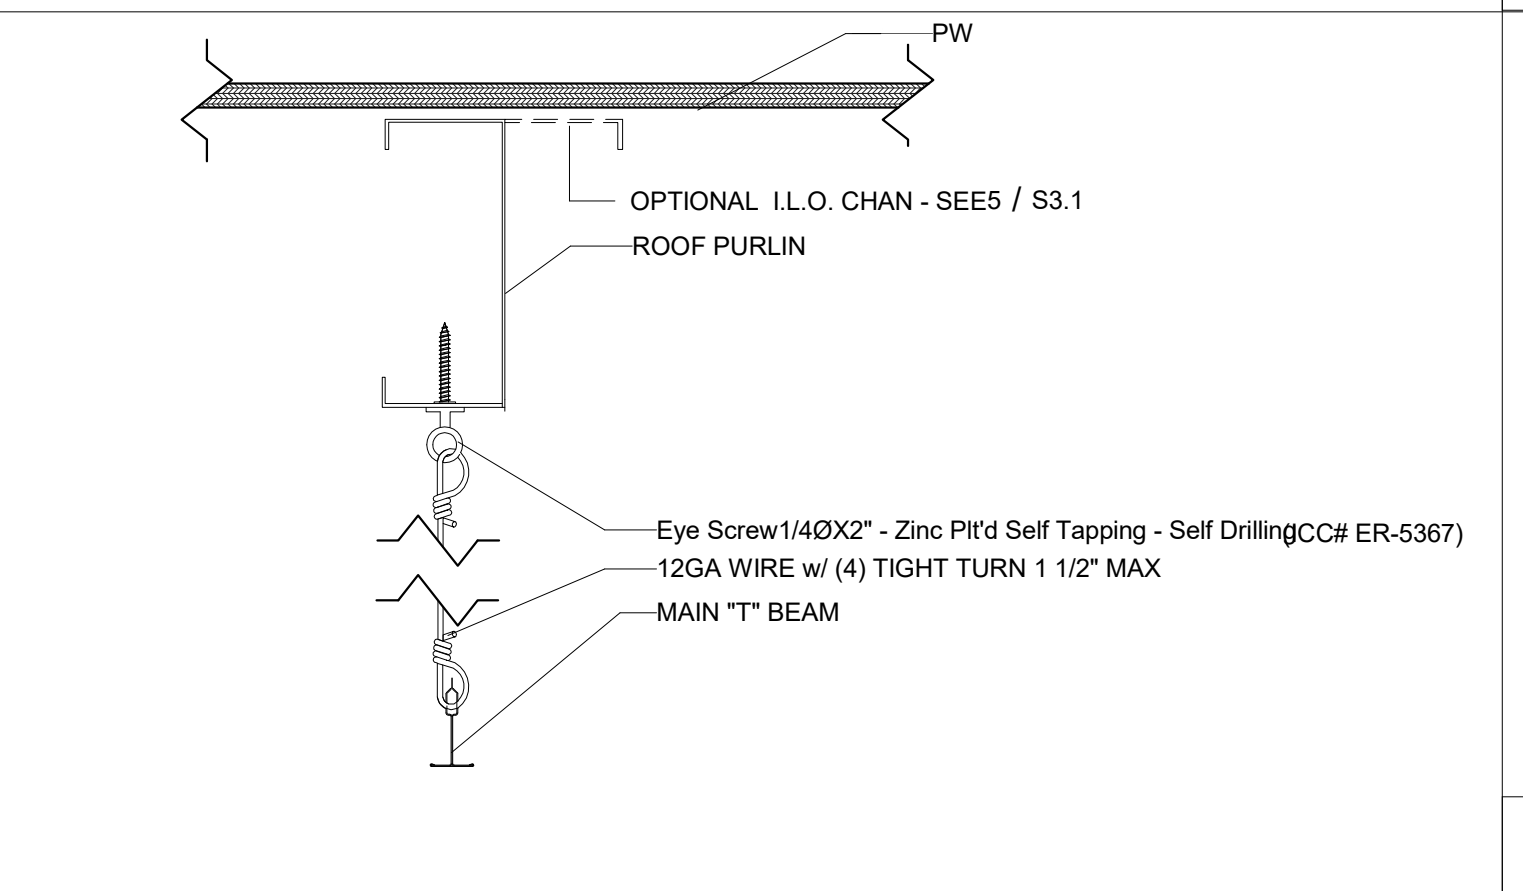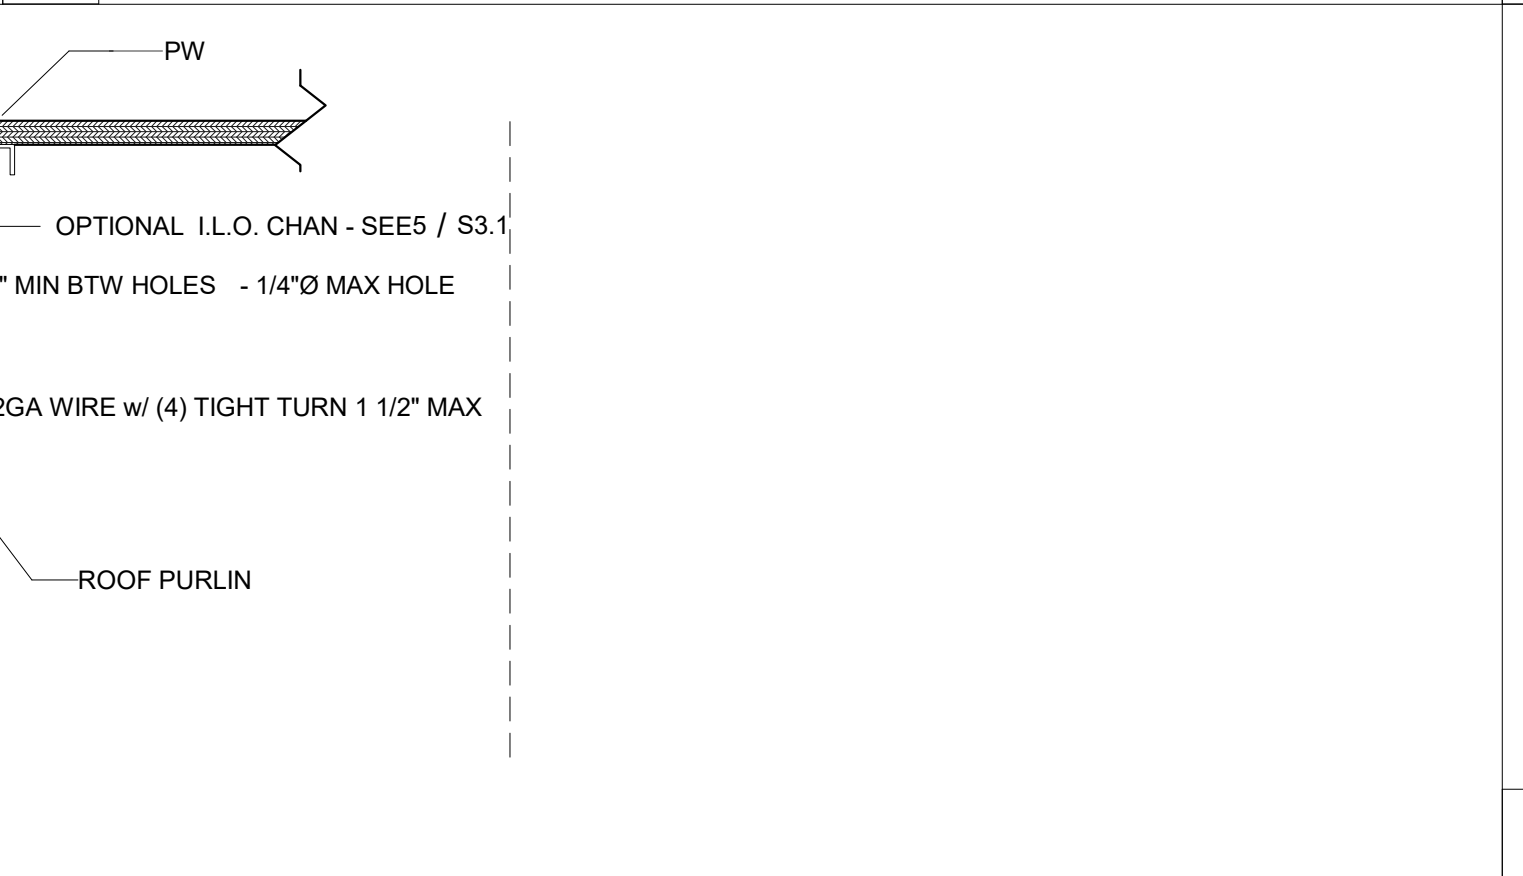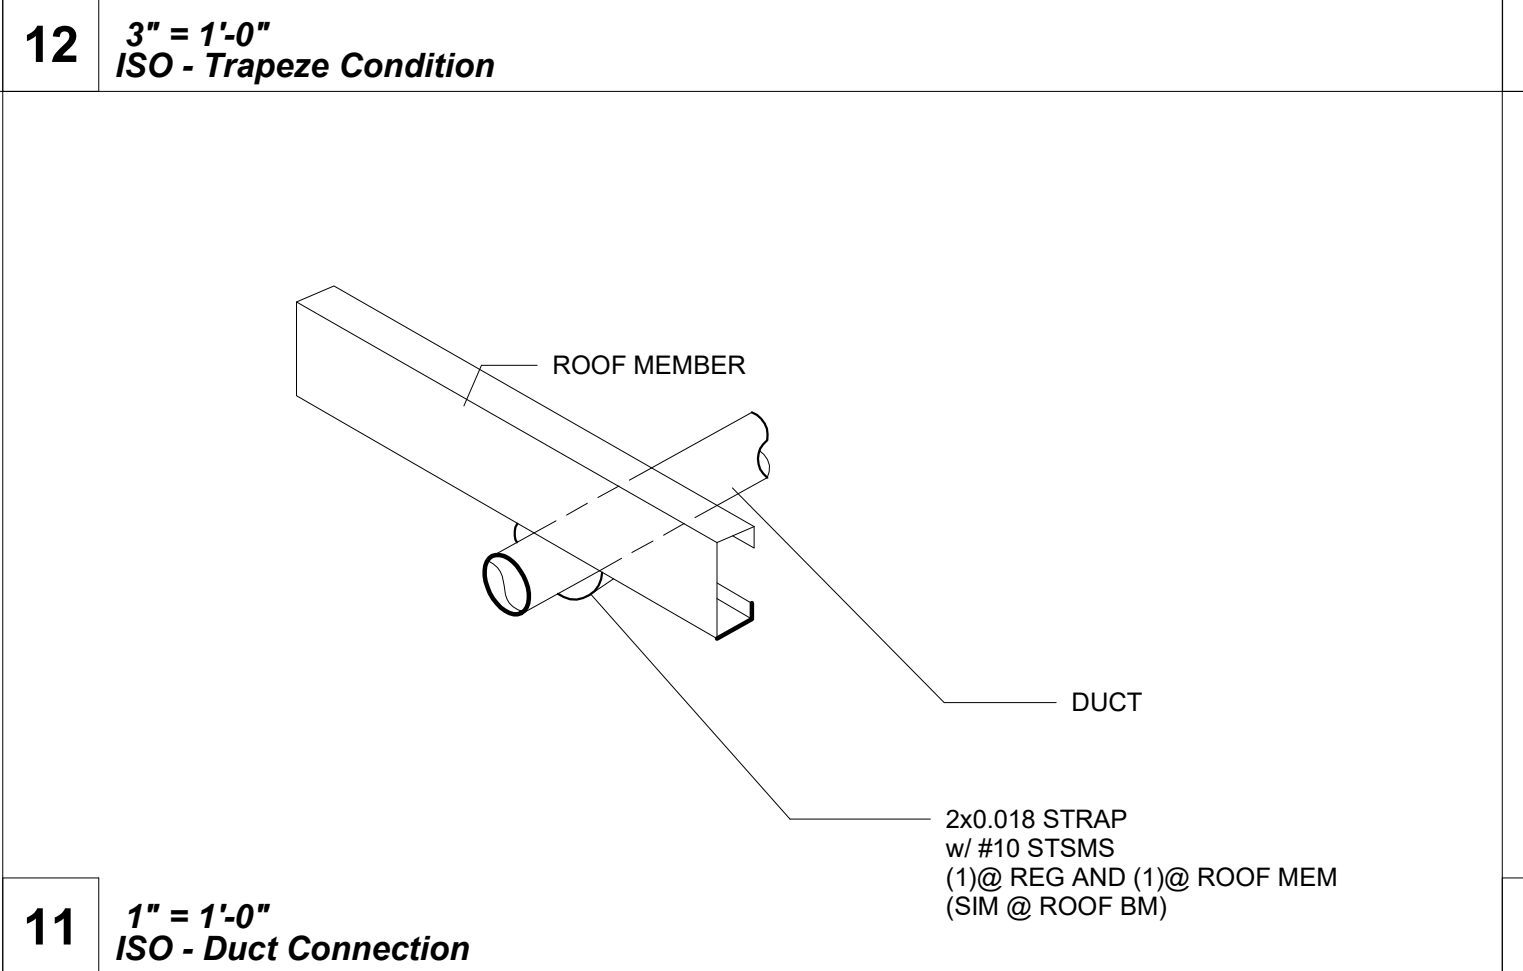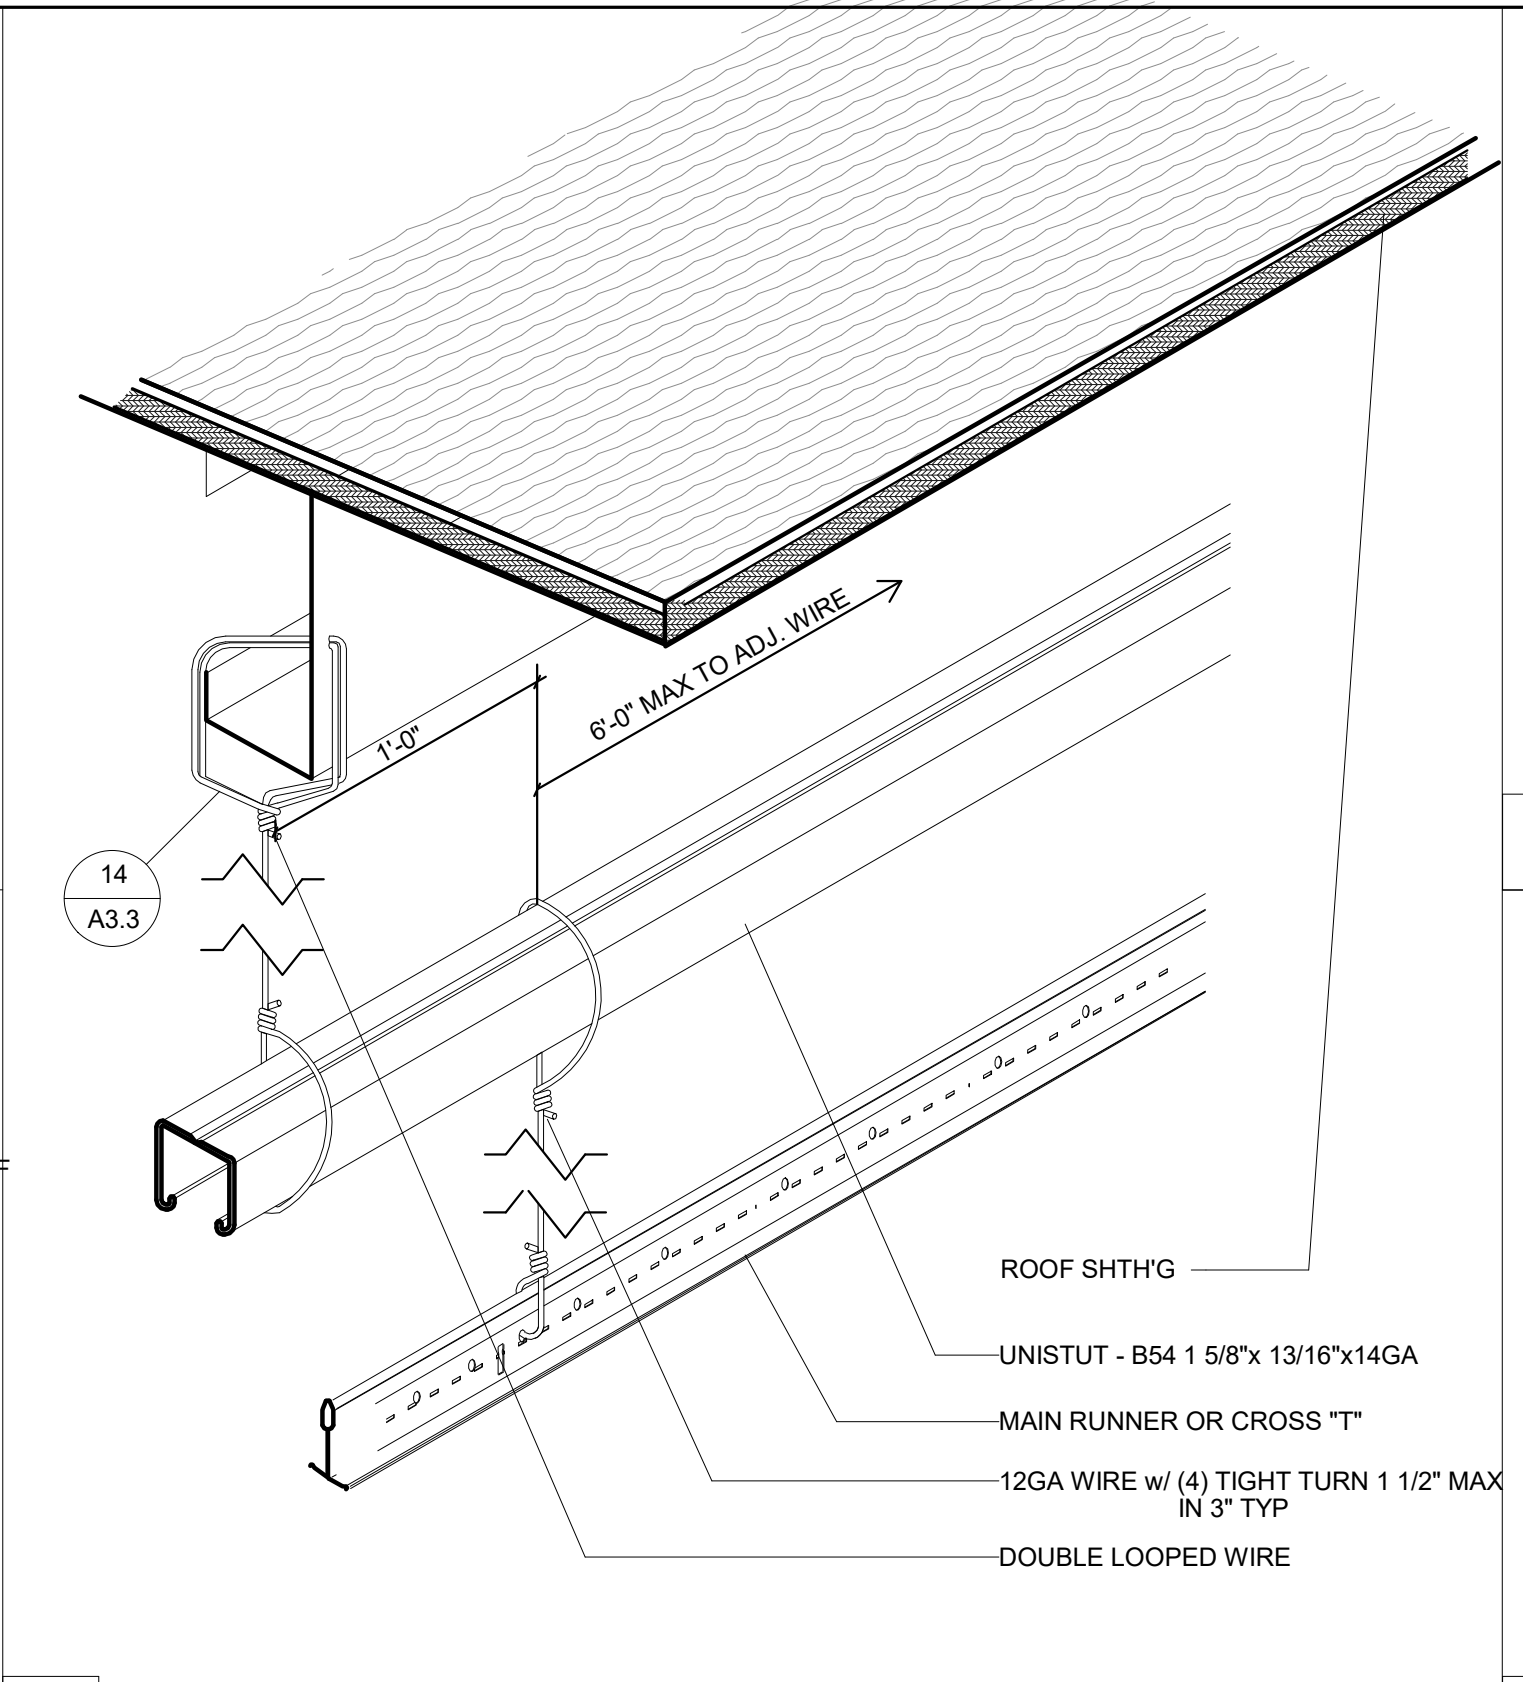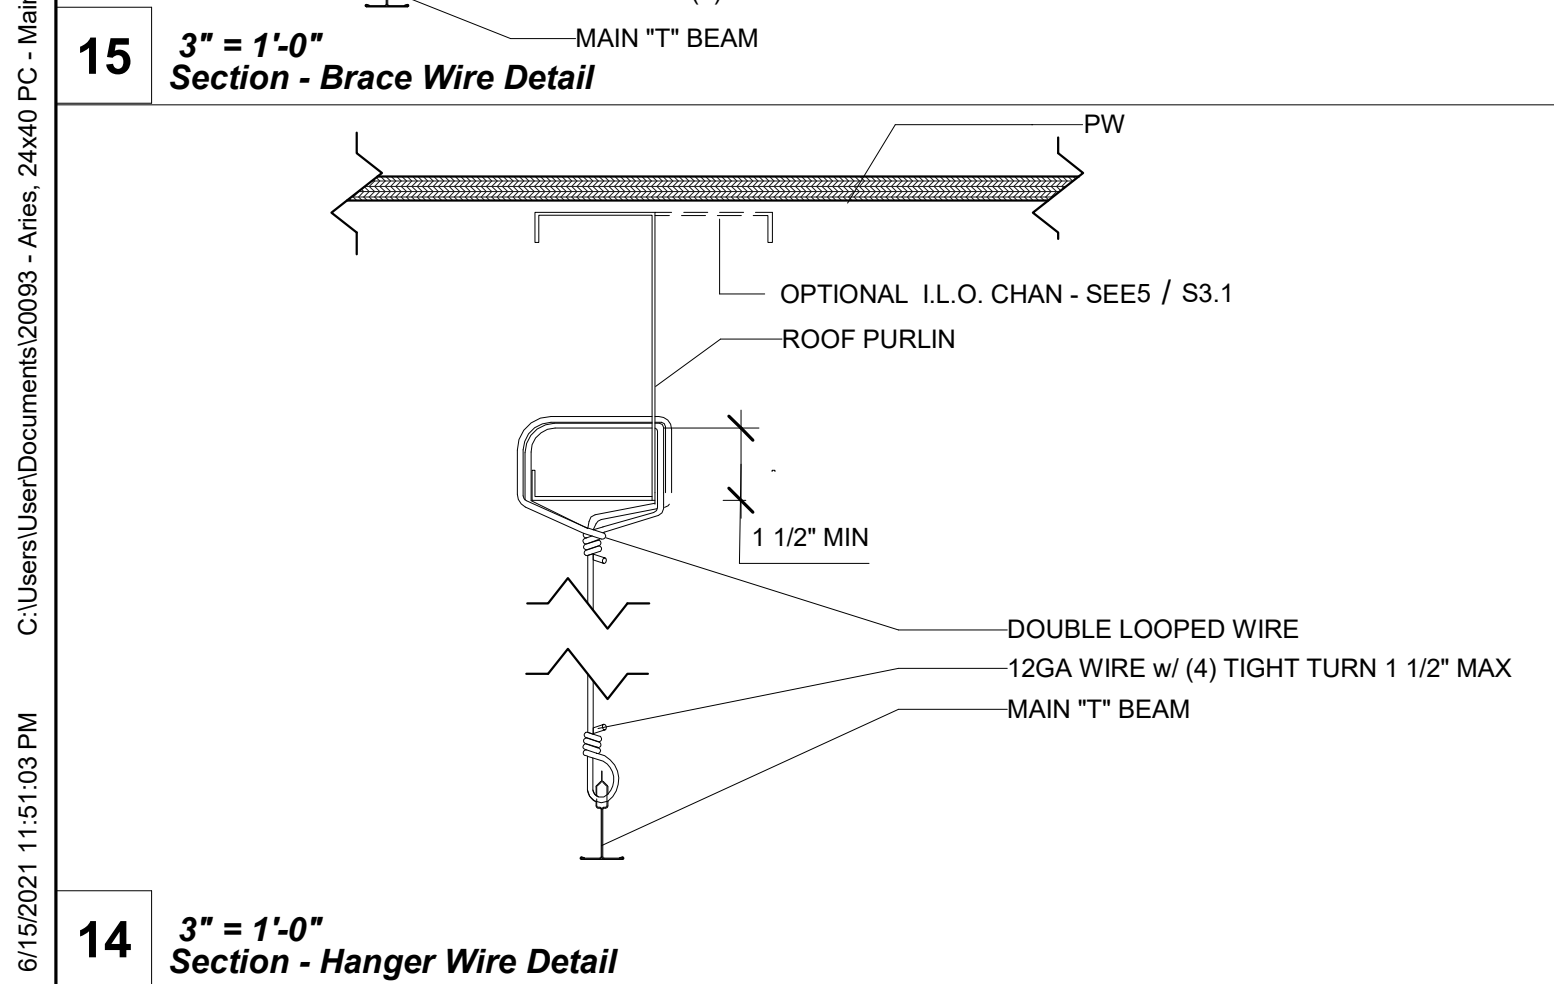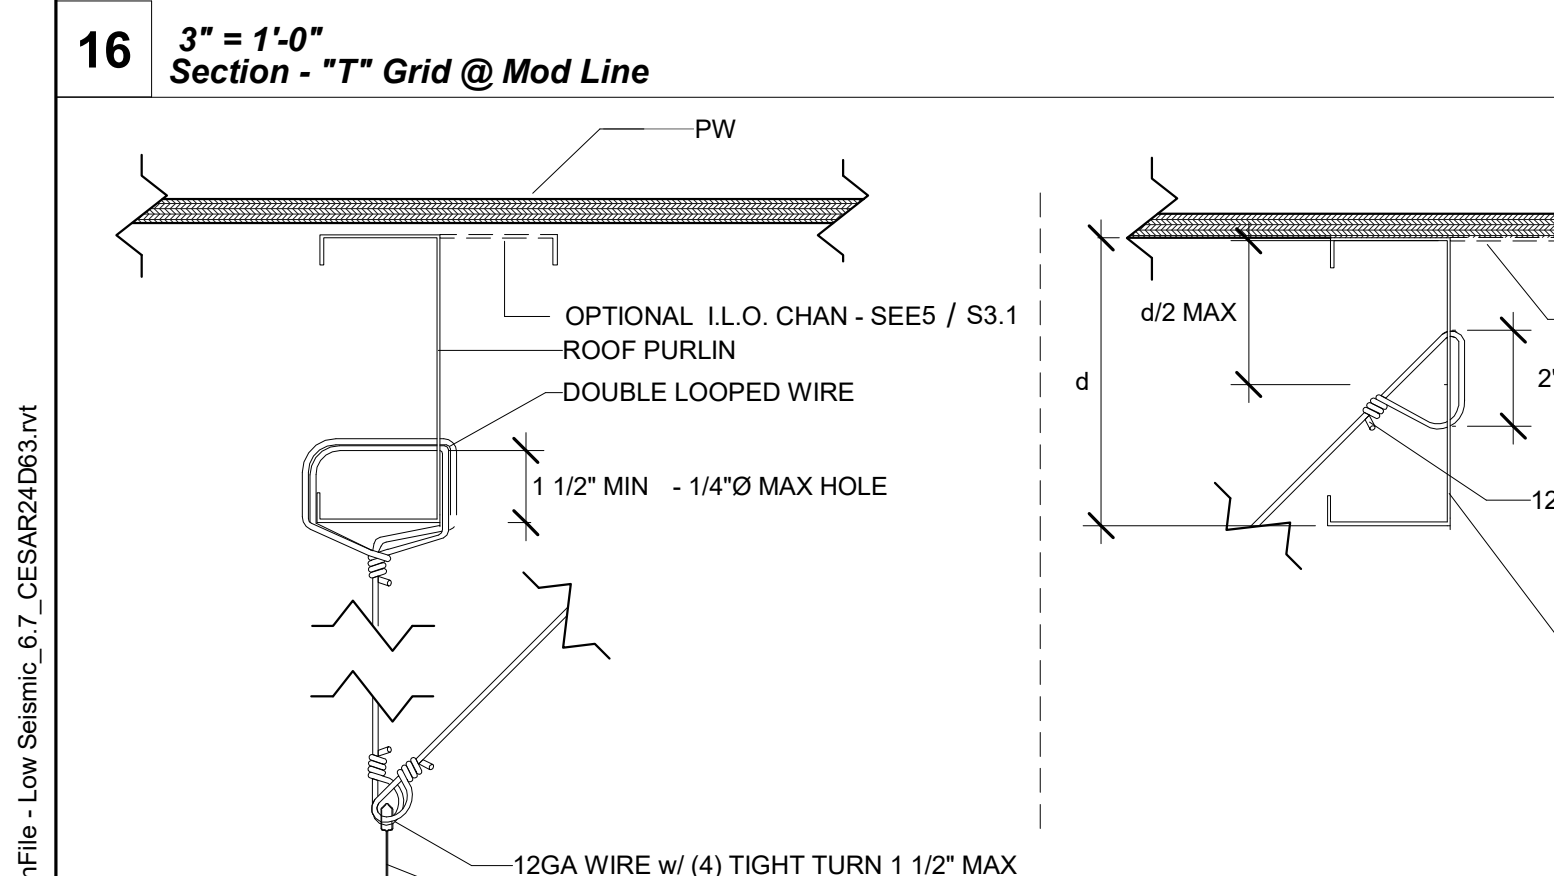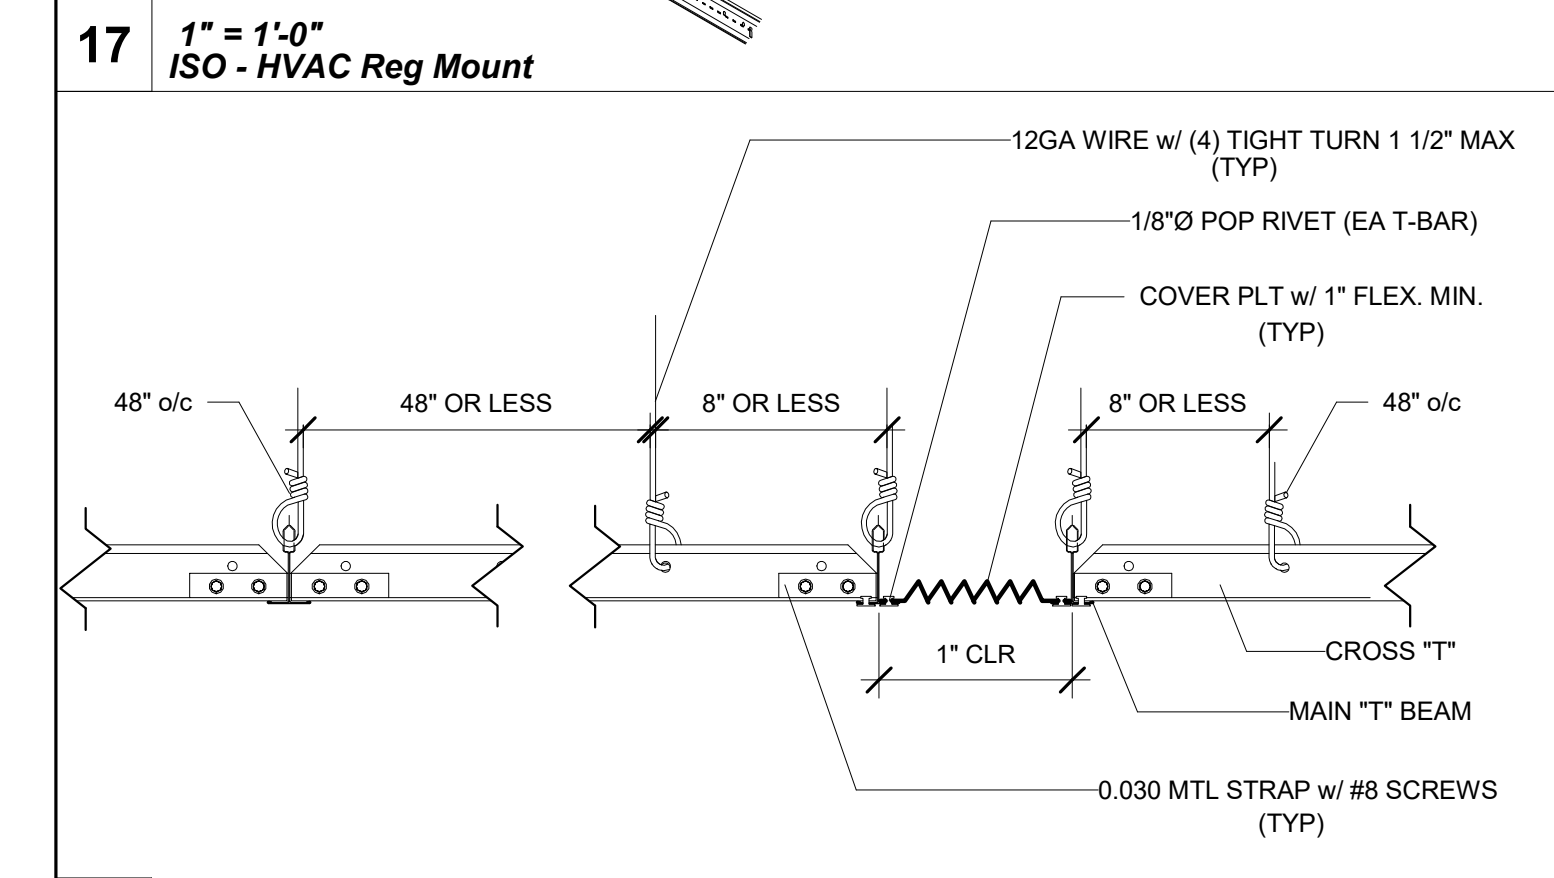
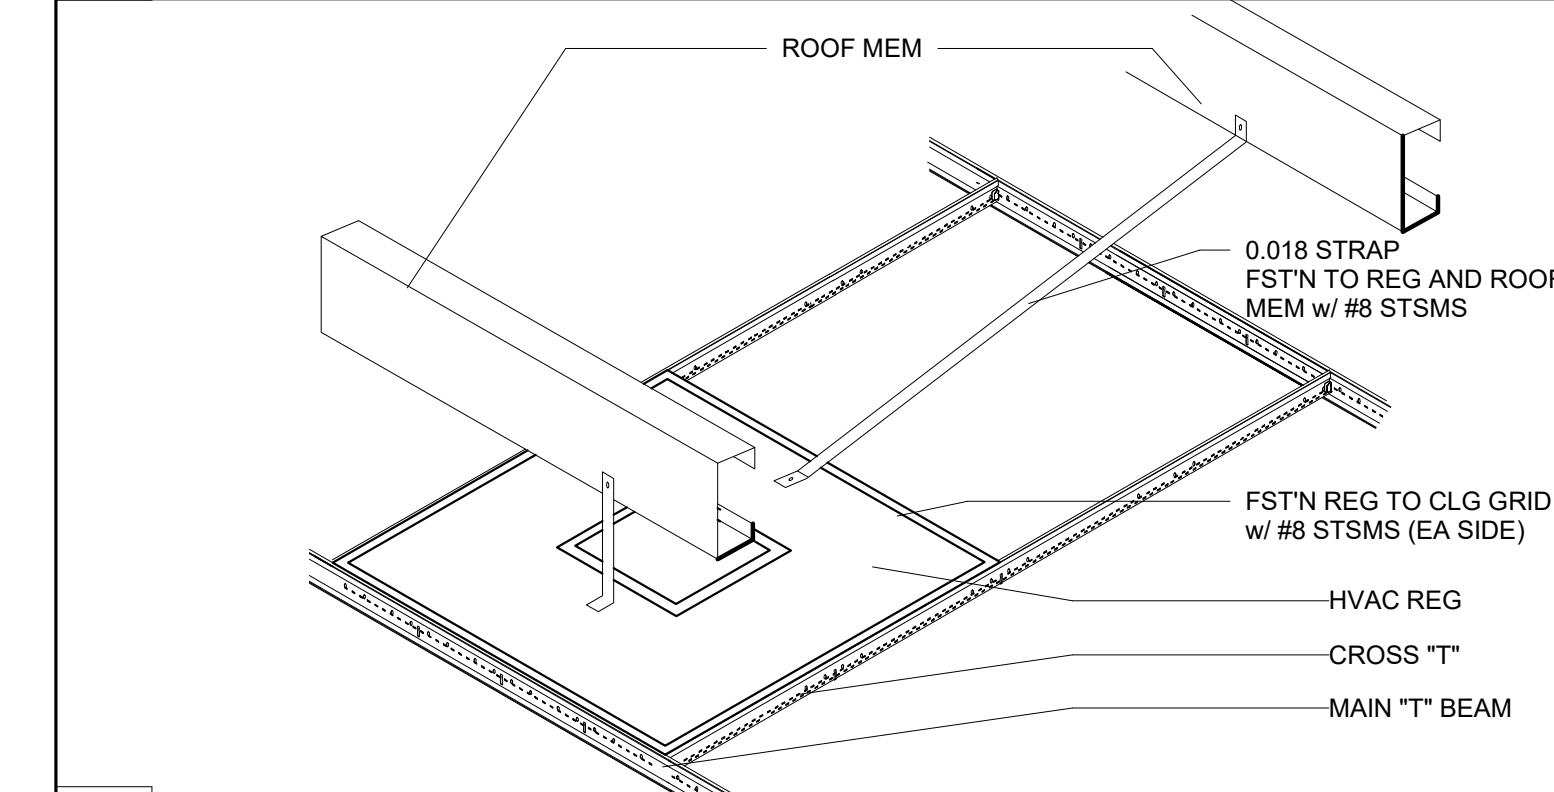
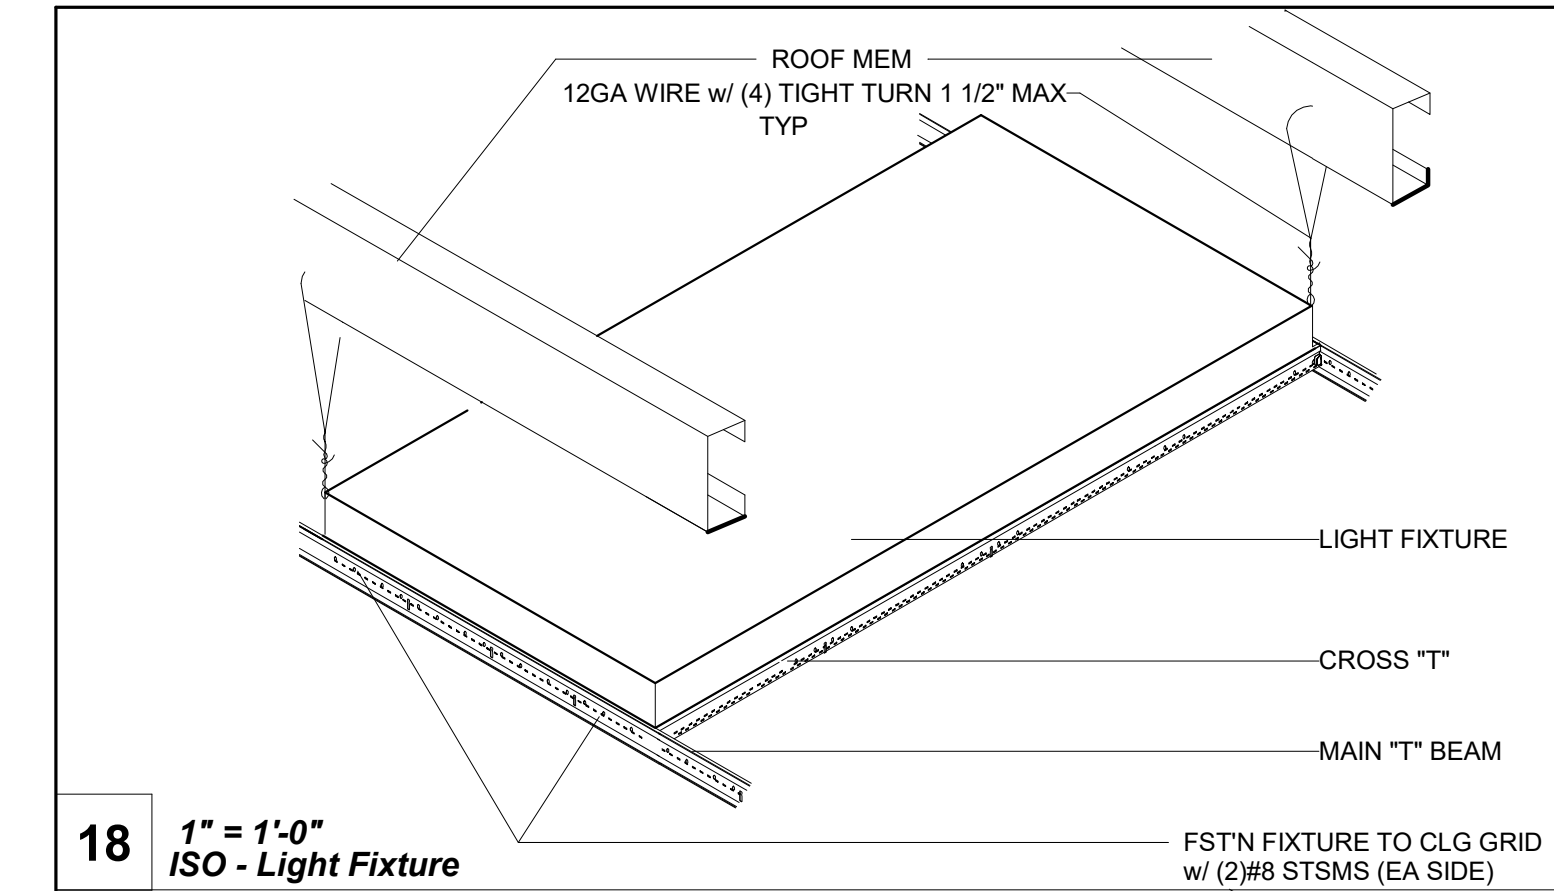


THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

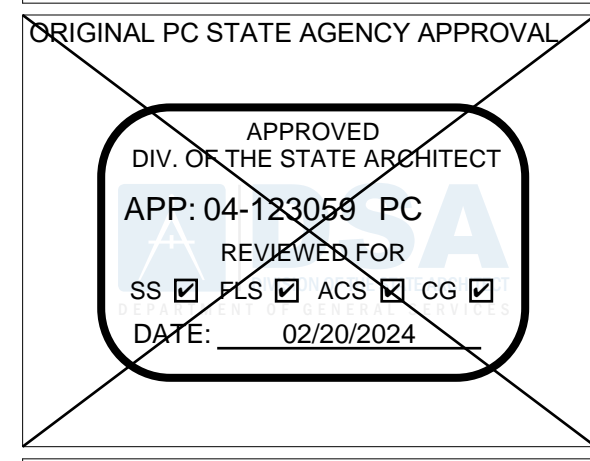

Revision Schedule		
#	Description	Date
PRE-CHECK (PC) DOCUMENT		
Code: 2022 CBC		
A separate project application for construction is required		
PROJECT TITLE		
PC 2022 CBC: 24' x 40'		
EXPANDABLE TO		
120' x 40'		
SHEET TITLE		
CEILING DETAILS		
(T-GRID)		

PROJECT NUMBER	
22088	
DRAWN BY	rMc/SC
CHECKED BY	RH/RT
DATE	
SHEET NO.	
A3.3	
SHEET	OF

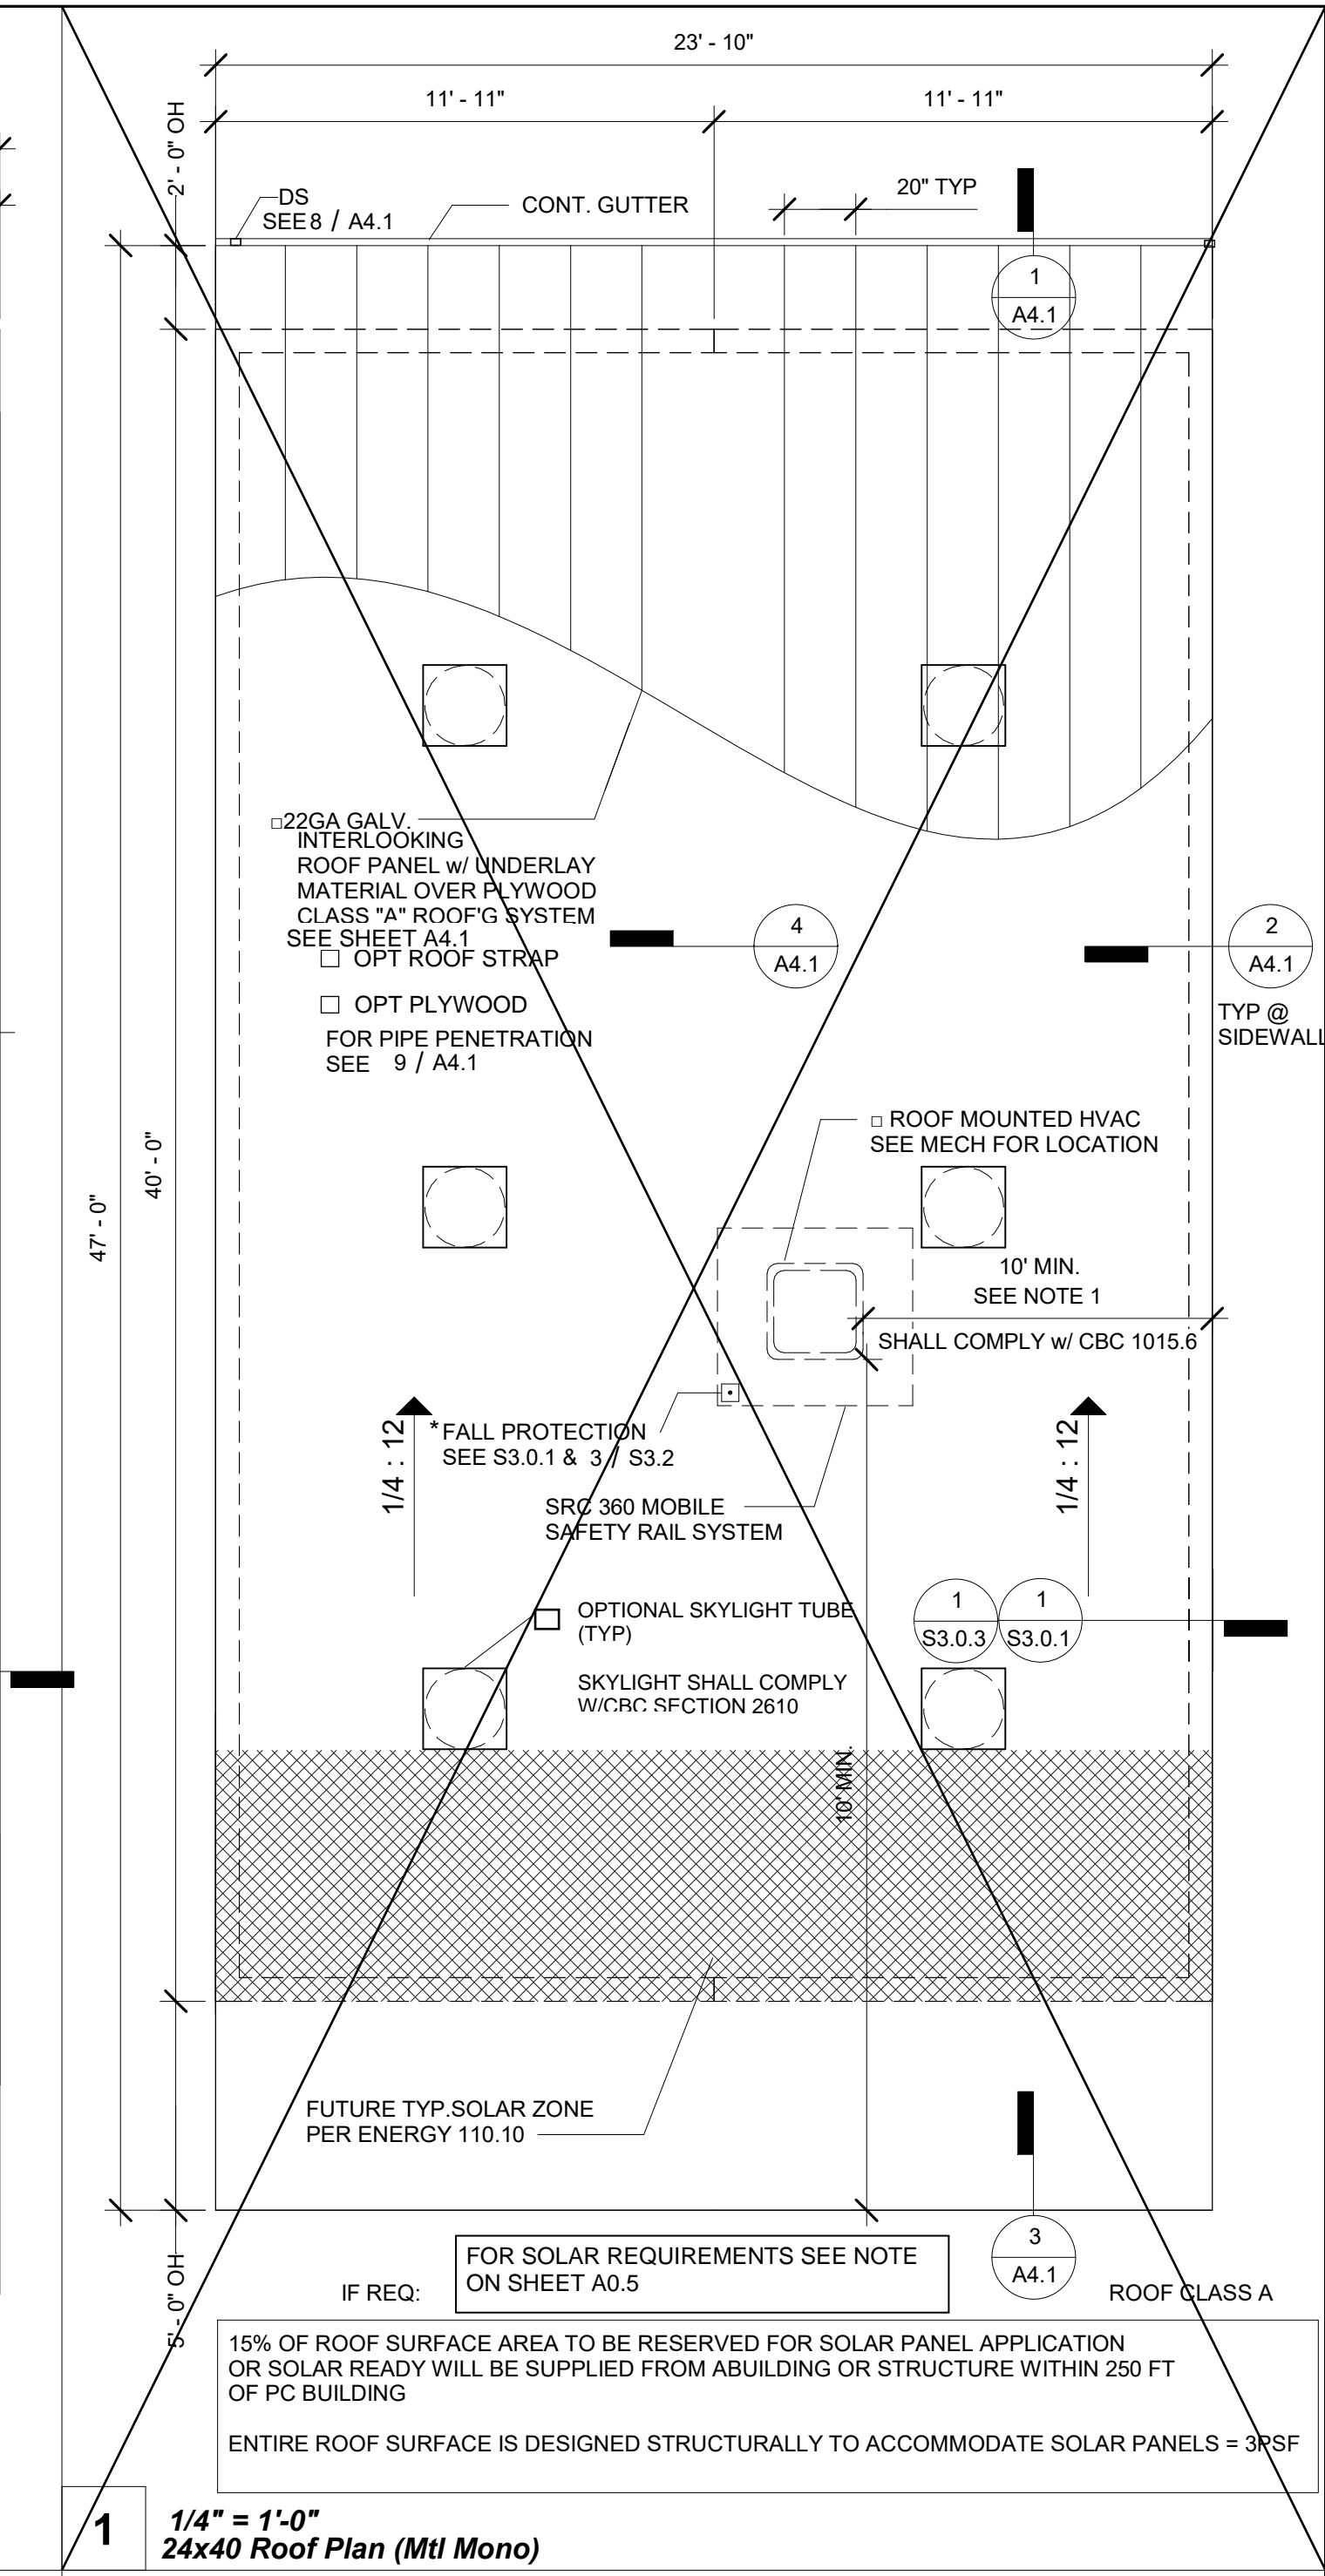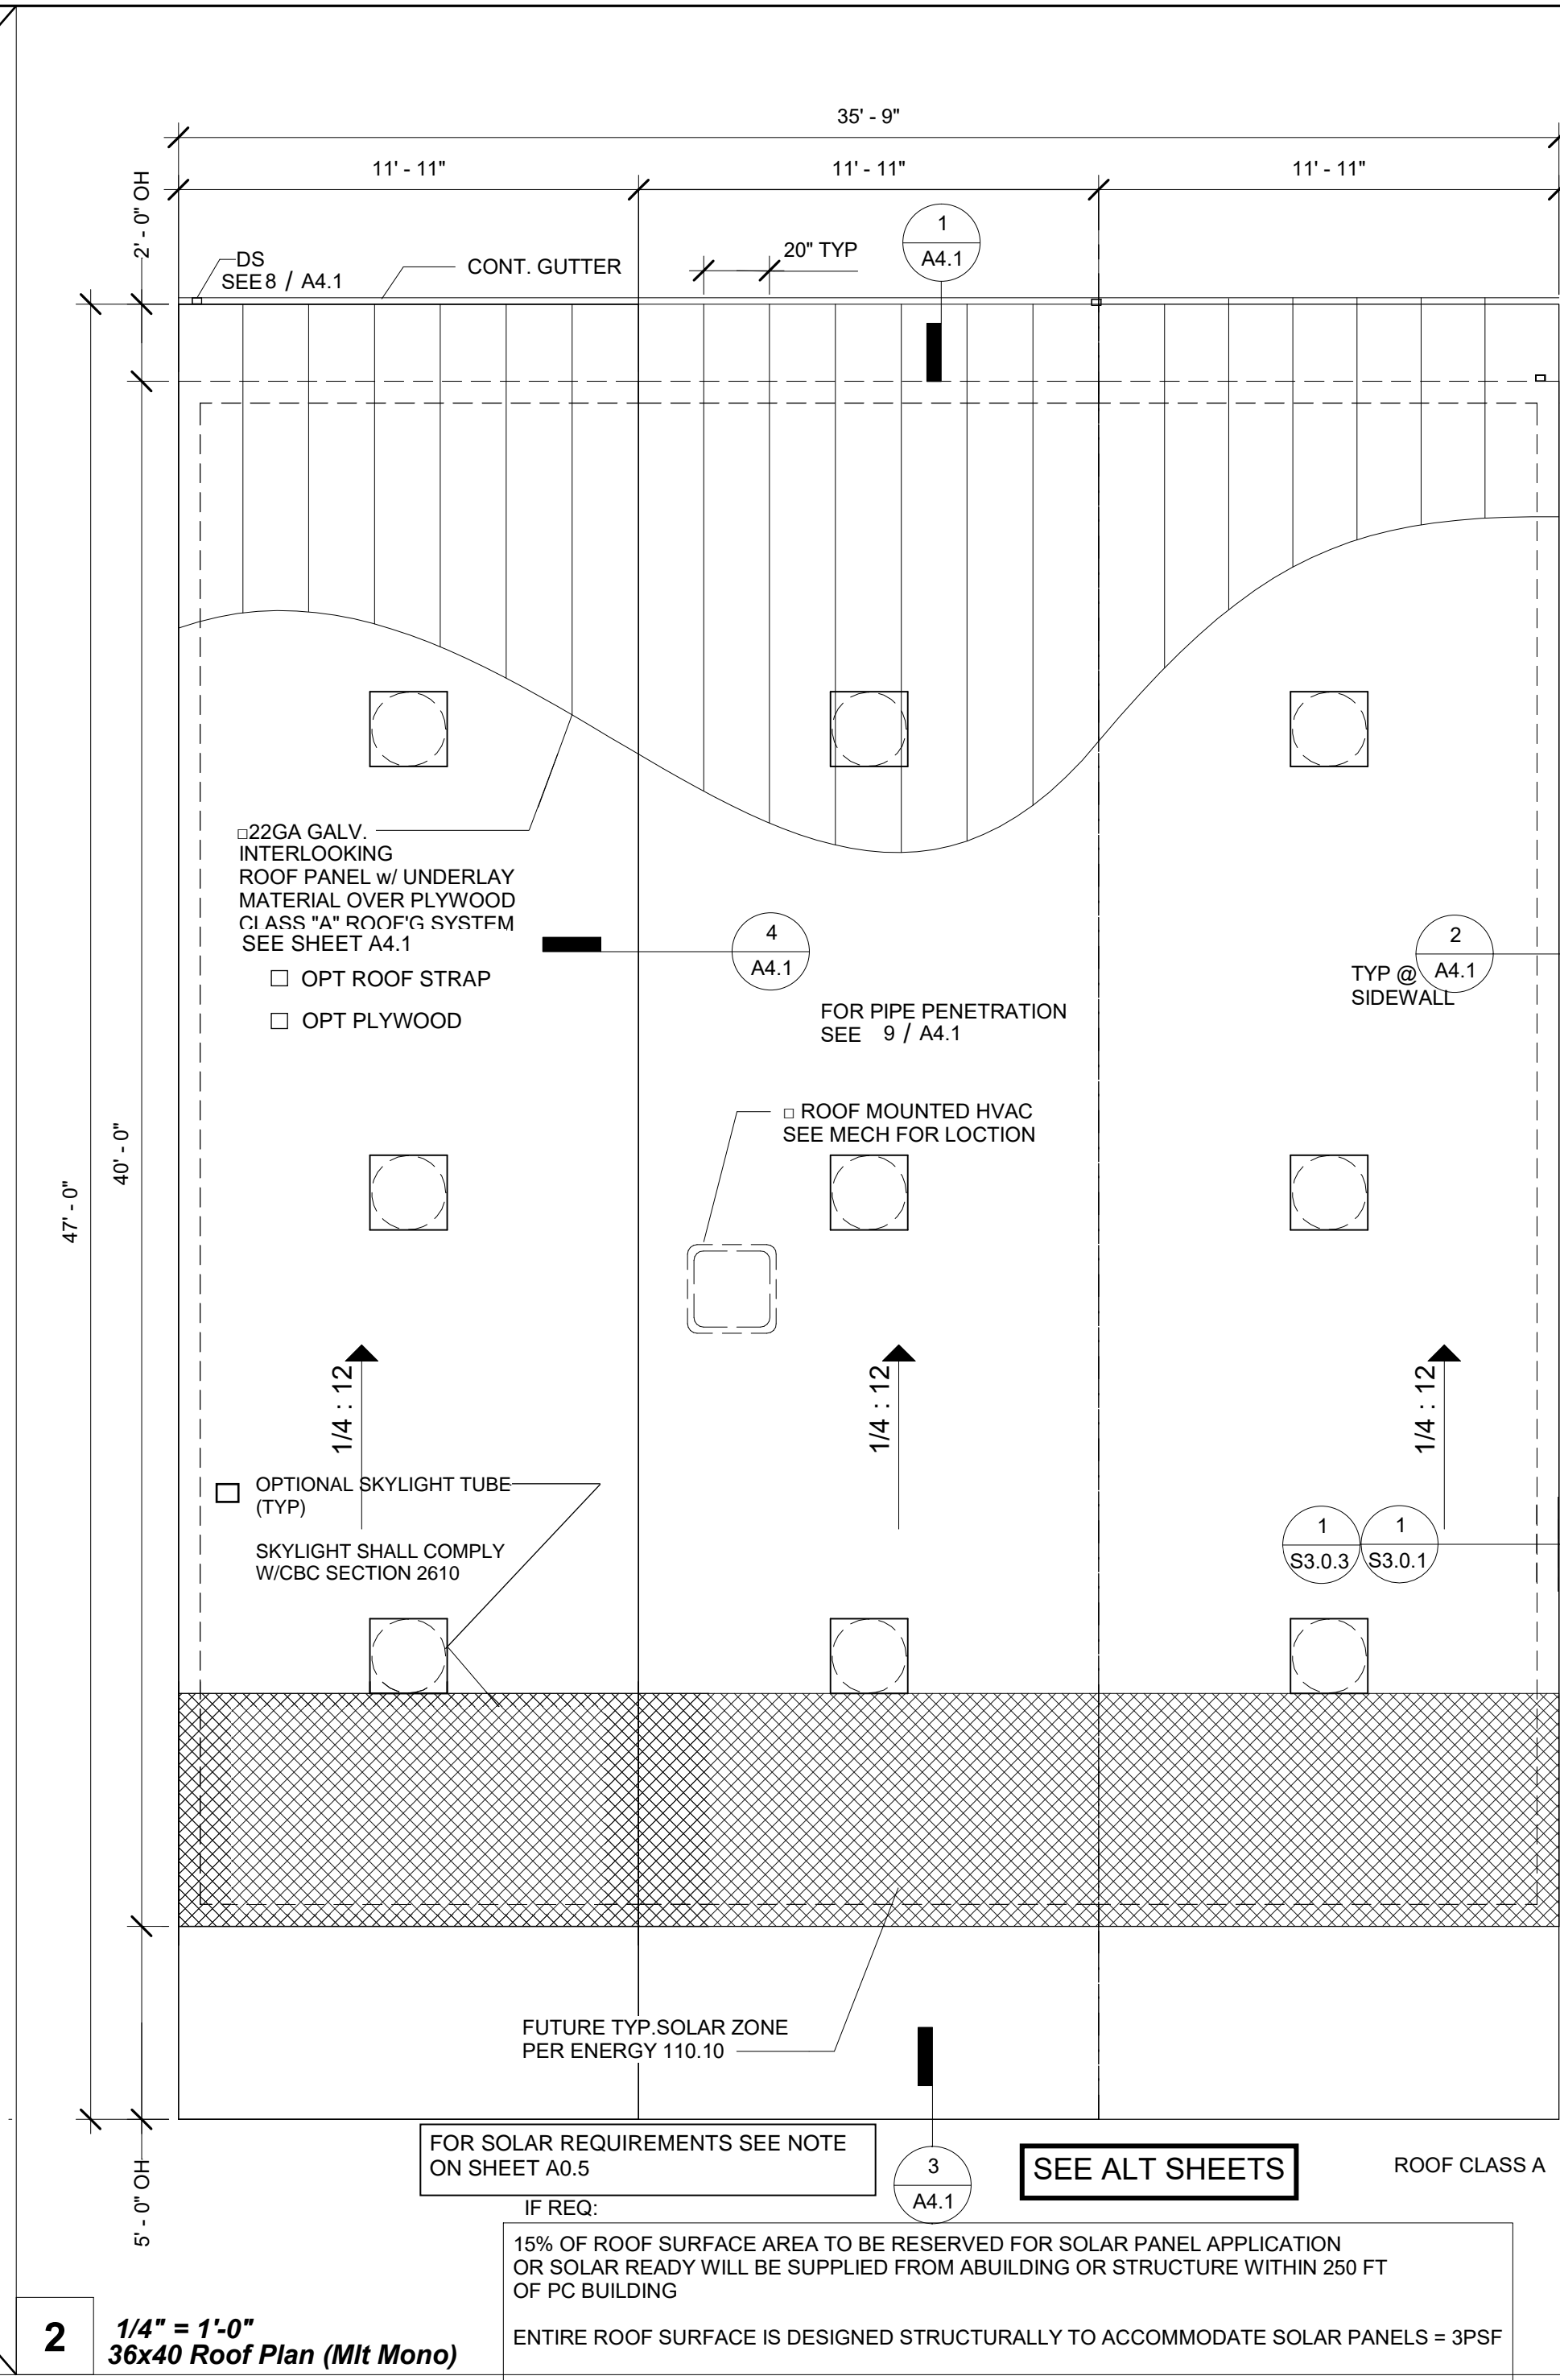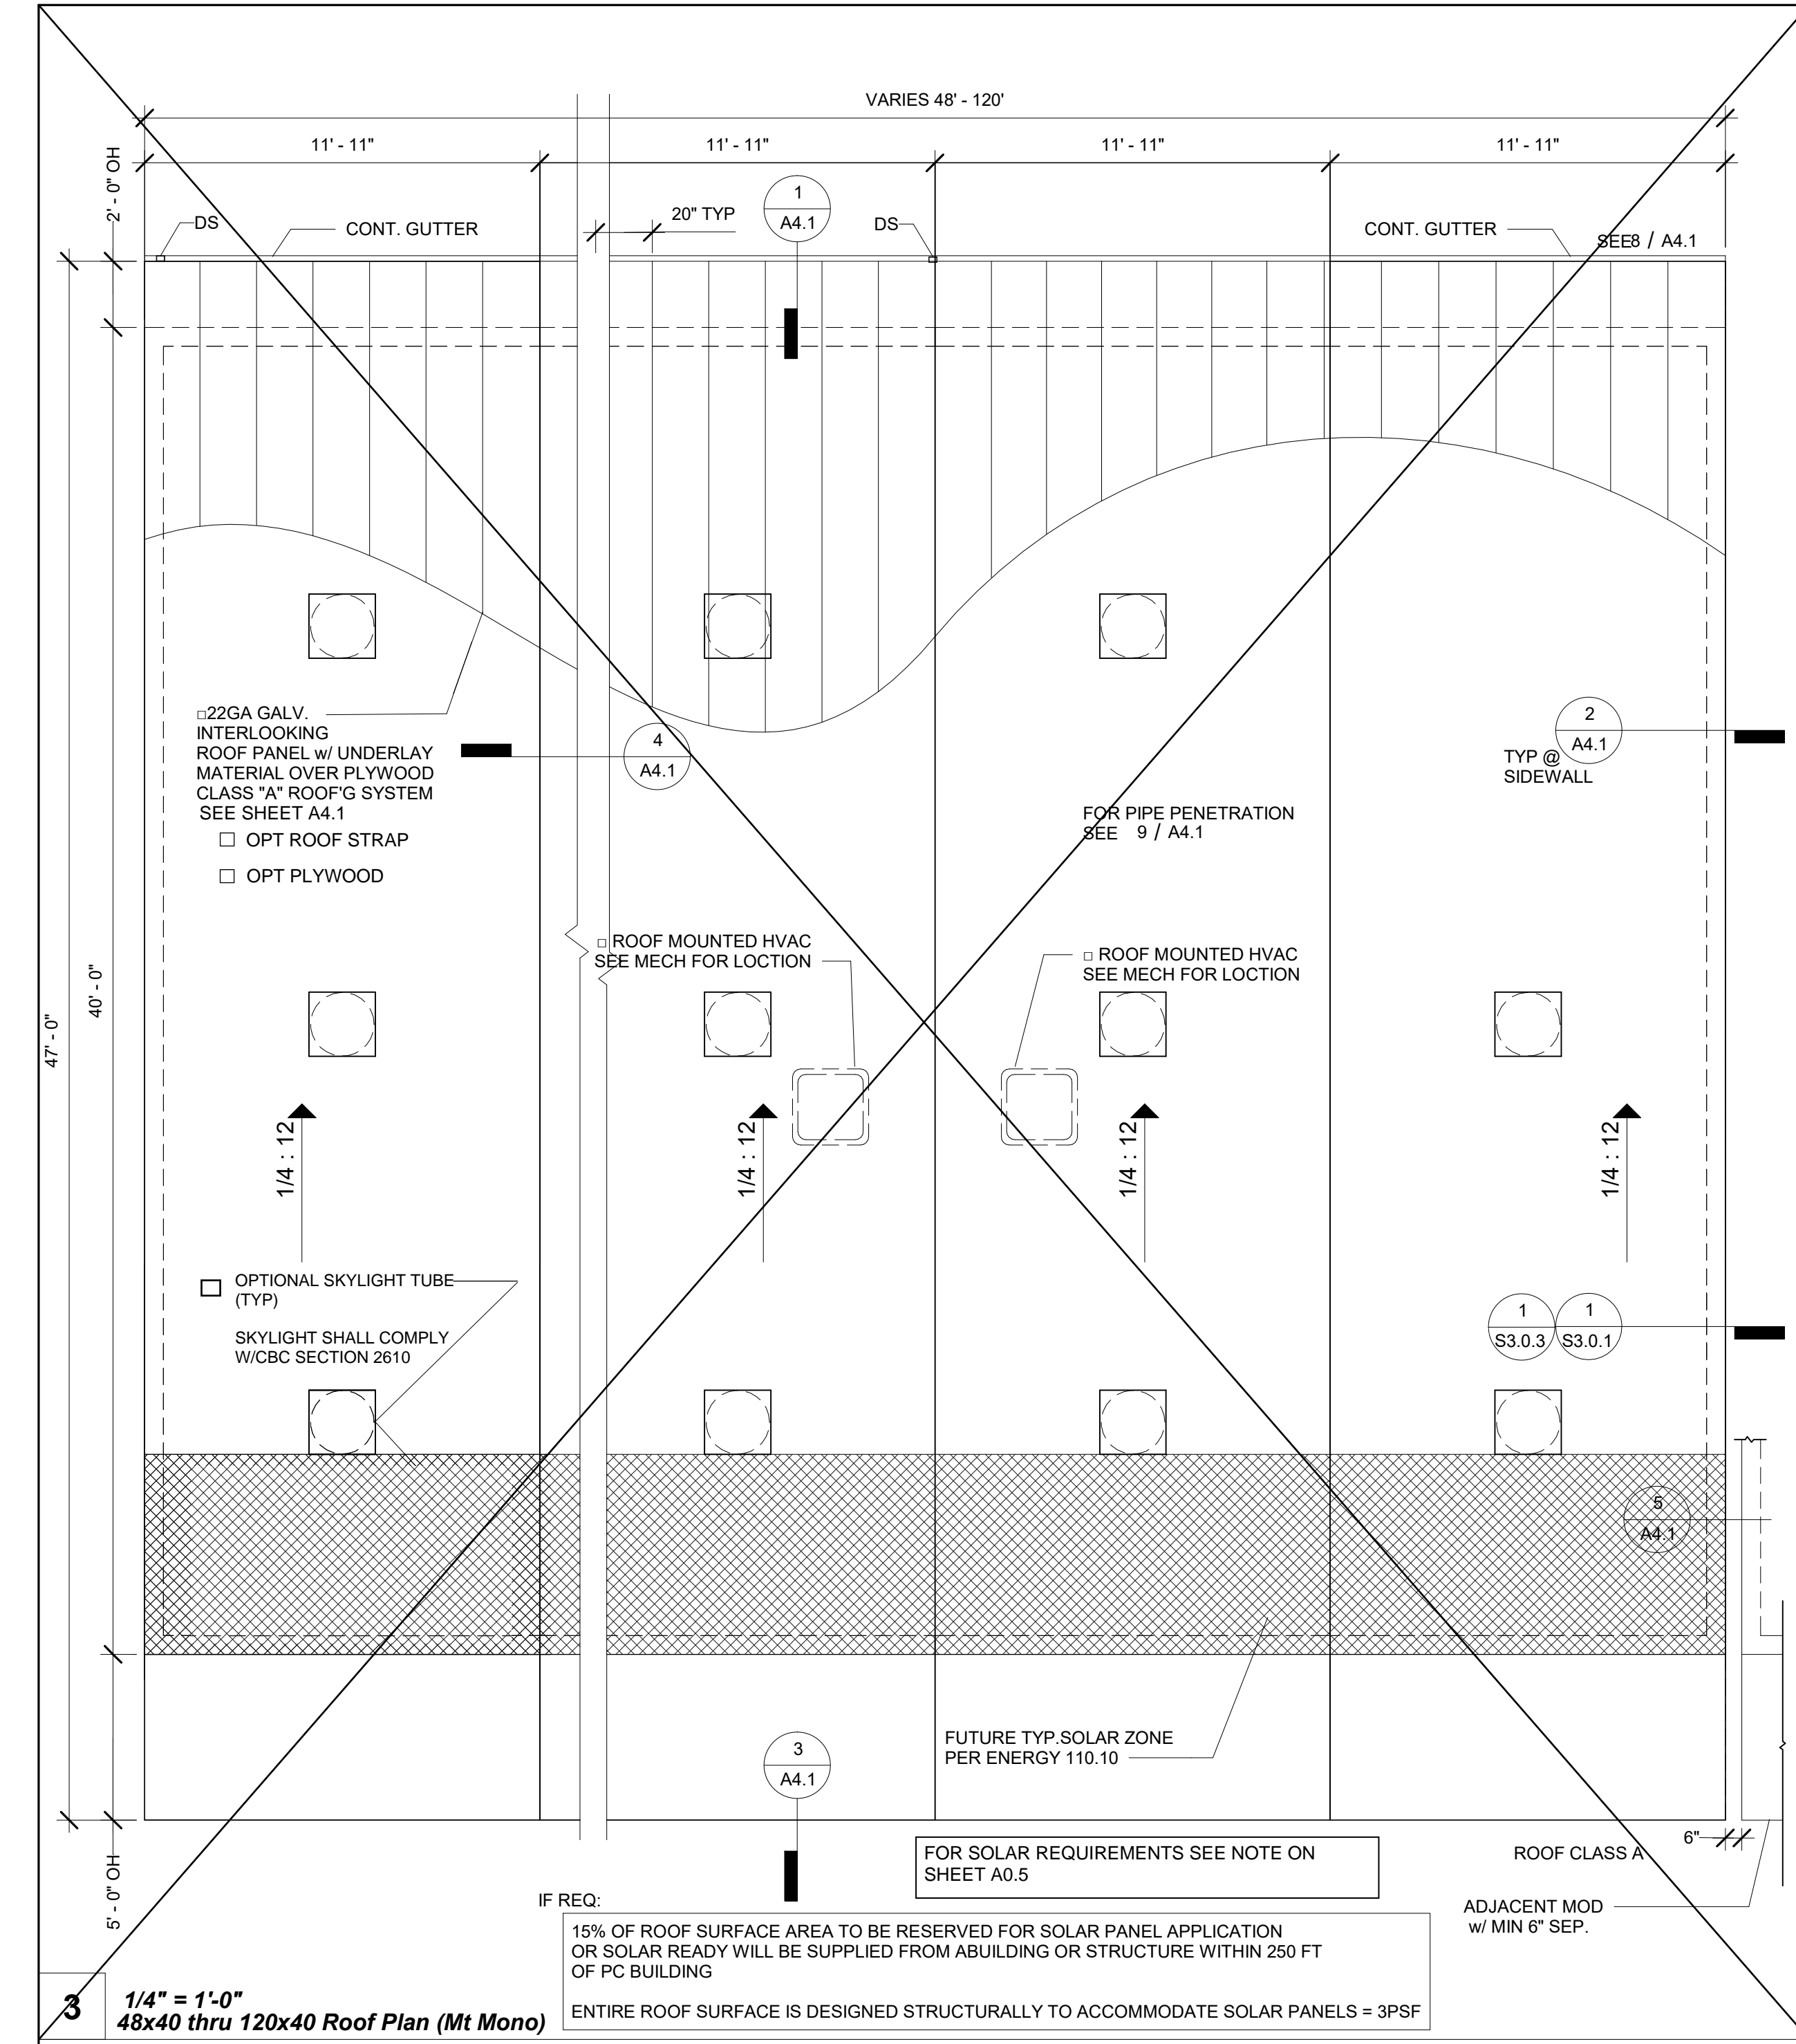

1202.3 Unvented Attic and Unvented Enclosed Rafter Assemblies

Unvented attics and unvented enclosed roof framing assemblies created by ceilings applied directly to the underside of the roof framing members/rafters and the structural roof sheathing at the top of the roof framing members shall be permitted where all of the following conditions are met:

- The unvented attic space is completely within the building thermal envelope.
- No interior Class I vapor retarders are installed on the ceiling side (attic floor) of the unvented attic assembly or on the ceiling side of the unvented enclosed roof framing assembly.
- Where wood shingles or shakes are used, not less than a 1/4-inch (6.4 mm) vented airspace separates the shingles or shakes and the roofing underlayment above the structural sheathing.
- In Climate Zones 14 and 16, any air-impermeable insulation shall be a Class II vapor retarder or shall have a Class II vapor retarder coating or covering in direct contact with the underside of the insulation.

See the California Energy Code, Figure 100.1-A — California Climate Zones.

4.1. [HCD 1 & HCD 2] In Climate Zones 14 and 16, a Class I or Class II vapor retarder shall be installed on the indirectly conditioned space side of all insulation in an unvented attic with air-permeable insulation, for condensation control.

5. Insulation shall be located in accordance with the following:

5.1. Item 5.1.1, 5.1.2, 5.1.3 or 5.1.4 shall be met, depending on the air permeability of the insulation directly under the structural roof sheathing. No insulation shall be required when roof tiles, wood shingles or wood shakes, or any other roofing system using battens and no continuous underlayment is installed. A continuous underlayment shall be considered to exist if sheathing, roofing paper, or any continuous layer having a perm rate of no more than one perm under the dry cup method is present.

5.1.1. Where only air-impermeable insulation is provided, it shall be applied in direct contact with the underside of the structural roof sheathing.

5.1.2. Where air-permeable insulation is provided inside the building thermal envelope, it shall be installed in accordance with

Item 5.1.1. In addition to the air-permeable insulation installed directly below the structural sheathing, rigid board or sheet insulation shall be installed directly above the structural roof sheathing in accordance with the R-values in Table 1202.3 for condensation control.

5.1.3. Where both air-impermeable and air-permeable insulation is provided, the air-impermeable insulation shall be applied in direct contact with the underside of the structural roof sheathing and shall be in accordance with the R-values in Table 1202.3 for condensation control. The air-permeable insulation shall be installed directly under the air-impermeable insulation.

5.1.4. Alternatively, sufficient rigid board or sheet insulation shall be installed directly above the structural roof sheathing to maintain the monthly average temperature of the underside of the structural roof sheathing above 45°F (7°C). For calculation purposes, an interior air temperature of 68°F (20°C) is assumed and the exterior air temperature is assumed to be the monthly average outside air temperature of the three coldest months.

5.2. Where preformed insulation board is used as the air-impermeable insulation layer, it shall be sealed at the perimeter of each individual sheet interior surface to form a continuous layer.

Exceptions:

- Section 1202.3 does not apply to special use structures or enclosures such as swimming pool enclosures, data processing centers, hospitals or art galleries.
- Section 1202.3 does not apply to enclosures in Climate Zones 14 and 16 that are humidified beyond 25 percent during the three coldest months.

TABLE 1202.3 INSULATION FOR CONDENSATION CONTROL	
CLIMATE ZONE	MINIMUM R-VALUE OF AIR-IMPERMEABLE INSULATION ^a
2B and 3B tile roof only	0 (none required)
1, 2A, 2B, 3A, 3B, 3C	R-5
4C	R-10
4A, 4B	R-15
5	R-20
6	R-25
7	R-30
8	R-35

^a Contributes to, but does not supersede, thermal resistance requirements for attic and roof assemblies in the California Energy Code.

NOTE: PER CBC 1015.6, - EXCEPTION, GUARDRAILS ARE NOT REQUIRED WHERE PERMANENT FALL RESTRAINT ANCHORAGE DEVICES ARE AFFIXED & SHALL BE PLACED NOT MORE THAN 10FT FROM THE ROOF EDGE.

ROOFS SHALL COMPLY WITH THE REQUIREMENTS OF CHAPTER 7A AND CHAPTER 15. ROOFS SHALL HAVE A ROOFING ASSEMBLY INSTALLED IN ACCORDANCE WITH ITS LISTING AND THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

* IF ROOF MOUNTED UNIT IS APPLIED

PV AREA FOR FIRE ACCESS REQ (PER IR 16-8)

3.2.1 General Requirements: A PV System shall be typically considered equipment. There is typically not an occupancy group classification, building area limitation, or type of construction assignment to a PV system.

a) PV equipment supported by non-combustible framing installed in locations dedicated for building frontage used for area increases per California Building Code (CBC), Chapter 5, Section 506, shall be limited in size and may be allowed on a case by case basis. Maximum area that may be allowed for such systems shall not exceed 1/3 of the horizontal projected area of each frontage.

b) Open sided PV systems and framing that are non-combustible and without use underneath may be considered equipment and may be placed next to DSA IR 16-8 Solar Photovoltaic and Thermal (updated 01-25-17) Systems Review and Approval Requirements Page 11 of 19 property lines. Signs may be required on or near the system prohibiting any use or storage underneath the equipment.

c) Combustible PV systems and framing and those with use underneath such as for assembly or parking, may need to comply with 2022 CBC, Table 602. These structures may include those that do and that do not have a roof underneath the PV system.

d) PV systems (both the frame and the array) shall not be placed in fire department access roads. (Per Title 24 CCR, Division 1, Chapter 1, Section 3.05 and 2022 CFC Chapter 5, Section 503.)

e) Access to a public way or safe dispersal area shall not be obstructed by the system or system framing. (CBC 1027.6 and 442.3)

f) PV systems that cover a lunch area or similar (occupant load less than 50), that are not used for assembly purposes shall be considered equipment. Playgrounds would also fall into this category regardless of total occupant load.

g) Any PV system that is installed above an assembly use (i.e. Group A-3 or A-5 occupancy classification) shall be considered an open sided building structure and all or portions of CBC provisions apply on a case by case basis. Such areas might include an outdoor amphitheater, bleacher or grandstand seating with concentrated occupant loads and heavy use.

h) Fire Department concern for the installation of roof mounted PV systems will be addressed by DSA review to the State Fire Marshal Solar Photovoltaic Installation Guideline available at:

<http://osfm.fire.ca.gov/pdf/reports/solarphotovoltaicguideline.pdf>

i) When a PV system, without riser framework, is installed directly on a rated roof assembly with a required classification greater than "Class C" found in CBC, Chapter 15, and f

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-122690 INC:
REVIEWED FOR
SS ☐ PLS ☐ ACS ☐
DATE: 10/26/2024

R&S TAVARES ASSOCIATES
DESIGN & CONSULTING • PROJECT MGT
11590 W BERNARDO COURT, SUITE 100
SAN DIEGO, CA 92127
WWW.RSTAVARES.COM

PROFESSIONAL STAMP

REGISTERED PROFESSIONAL ARCHITECT
MANUEL D. FLORES
63380
03/31/24
STATE OF CALIFORNIA
RST#22088
02/16/24

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT

Class Leasing
1651 Juanita Street, San Jacinto, CA 92583
Voice (951) 943-1908 Fax (951) 943-5768

ORIGINAL PC STATE AGENCY APPROVAL

APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-123058 PC
REVIEWED FOR
SS ☒ PLS ☒ ACS ☒ CG ☒
DATE: 02/20/2024

Revision Schedule
Description Date

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
ROOF PLAN MONO
SLOPE (STANDING SEAM)


PROJECT NUMBER
22088

DRAWN BY
rMc/SC

CHECKED BY
RH/RT

DATE

SHEET NO.
A4.0.1
SHEET OF

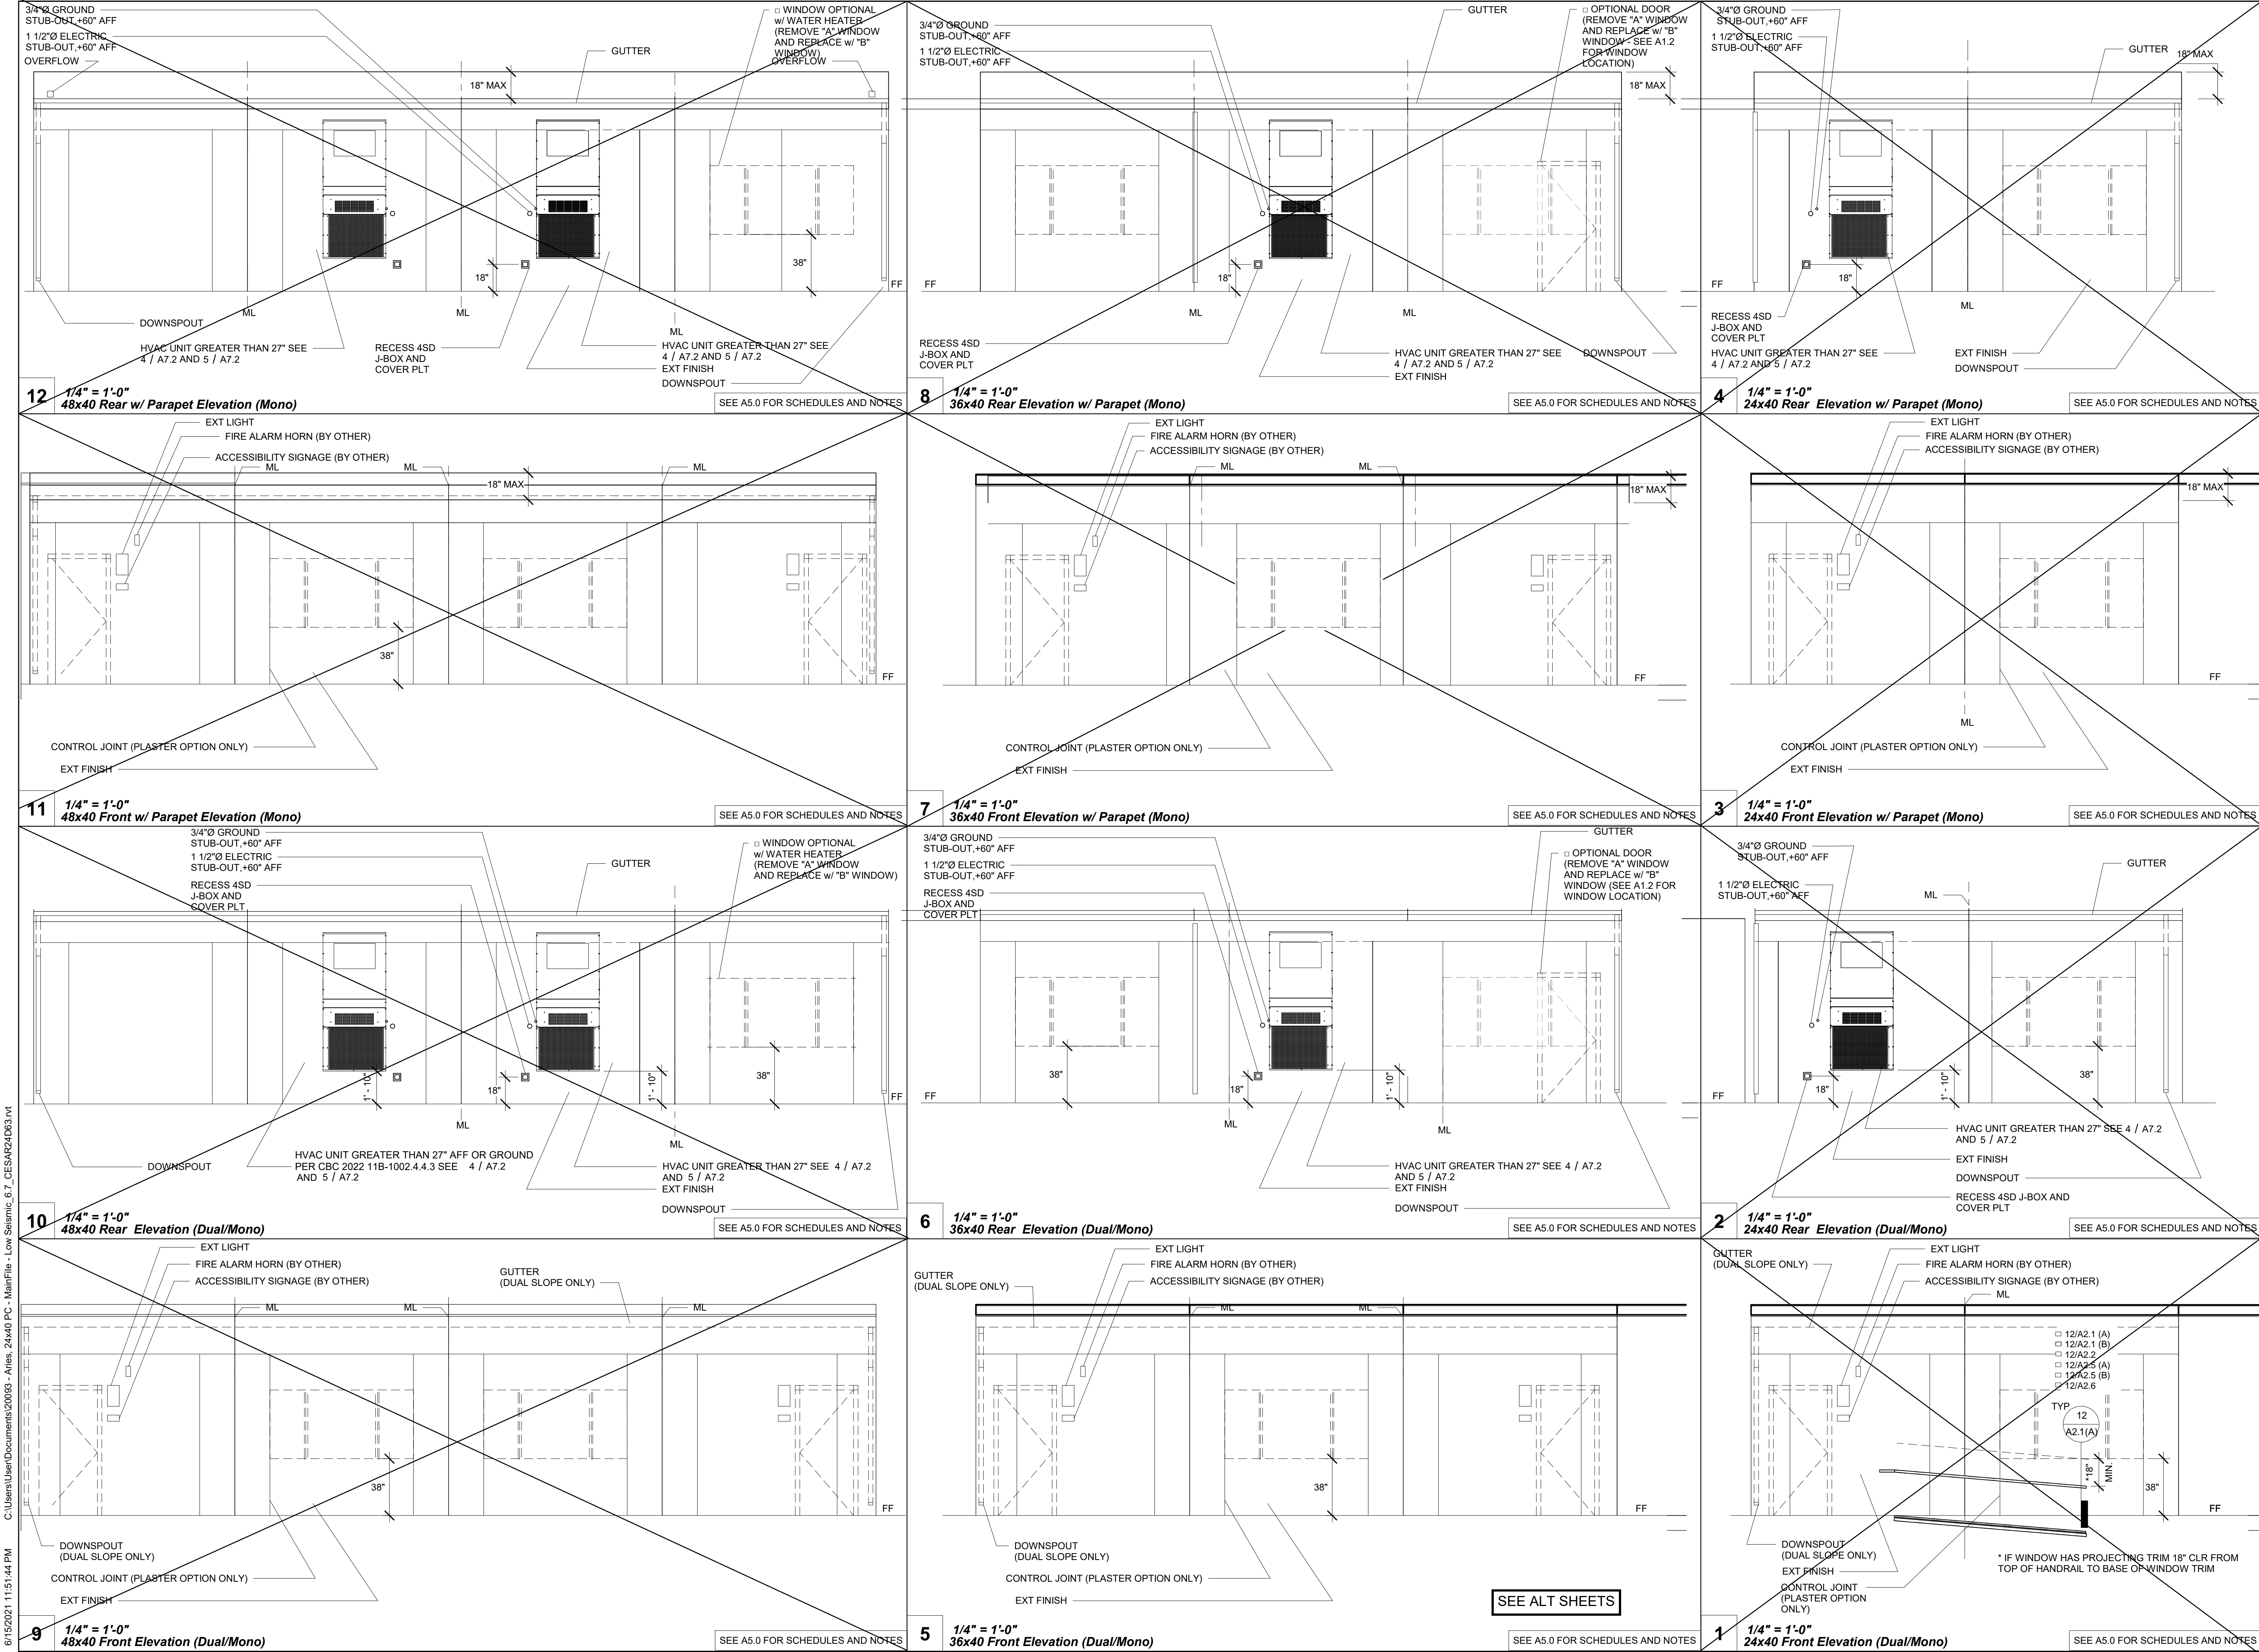

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-122630 INC.
REVIEWED FOR
SS ☐ PLS ☐ ACS ☐
DATE: 10/29/2024

R&S TAVARES ASSOCIATES
DESIGN & CONSULTING PROJECT MGT
11590 W BERNARDO COURT, SUITE 100
SAN DIEGO, CA 92127
WWW.RSTAVARES.COM

PROFESSIONAL STAMP

REGISTERED PROFESSIONAL ARCHITECT
MANNY D. FROST
63380
03/31/24
P.C.TURKEY
STATE OF CALIFORNIA
02/16/24

RST#22088

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT

Class Leasing

1651 Juanita Street, San Jacinto, CA 92583
Voice (951) 943-1908 Fax (951) 943-5768

ORIGINAL PC STATE AGENCY APPROVAL

APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-123058 PC
REVIEWED FOR
SS ☒ PLS ☒ ACS ☒ CG ☒
DATE: 02/20/2024

Revision Schedule		
#	Description	Date

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

PROJECT TITLE
**PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'**

SHEET TITLE
**ENDWALL
ELEVATIONS**

PROJECT NUMBER
22088


DRAWN BY
rMc/SC

CHECKED BY
RH/RT


DATE

SHEET NO.
A5.1


SHEET OF

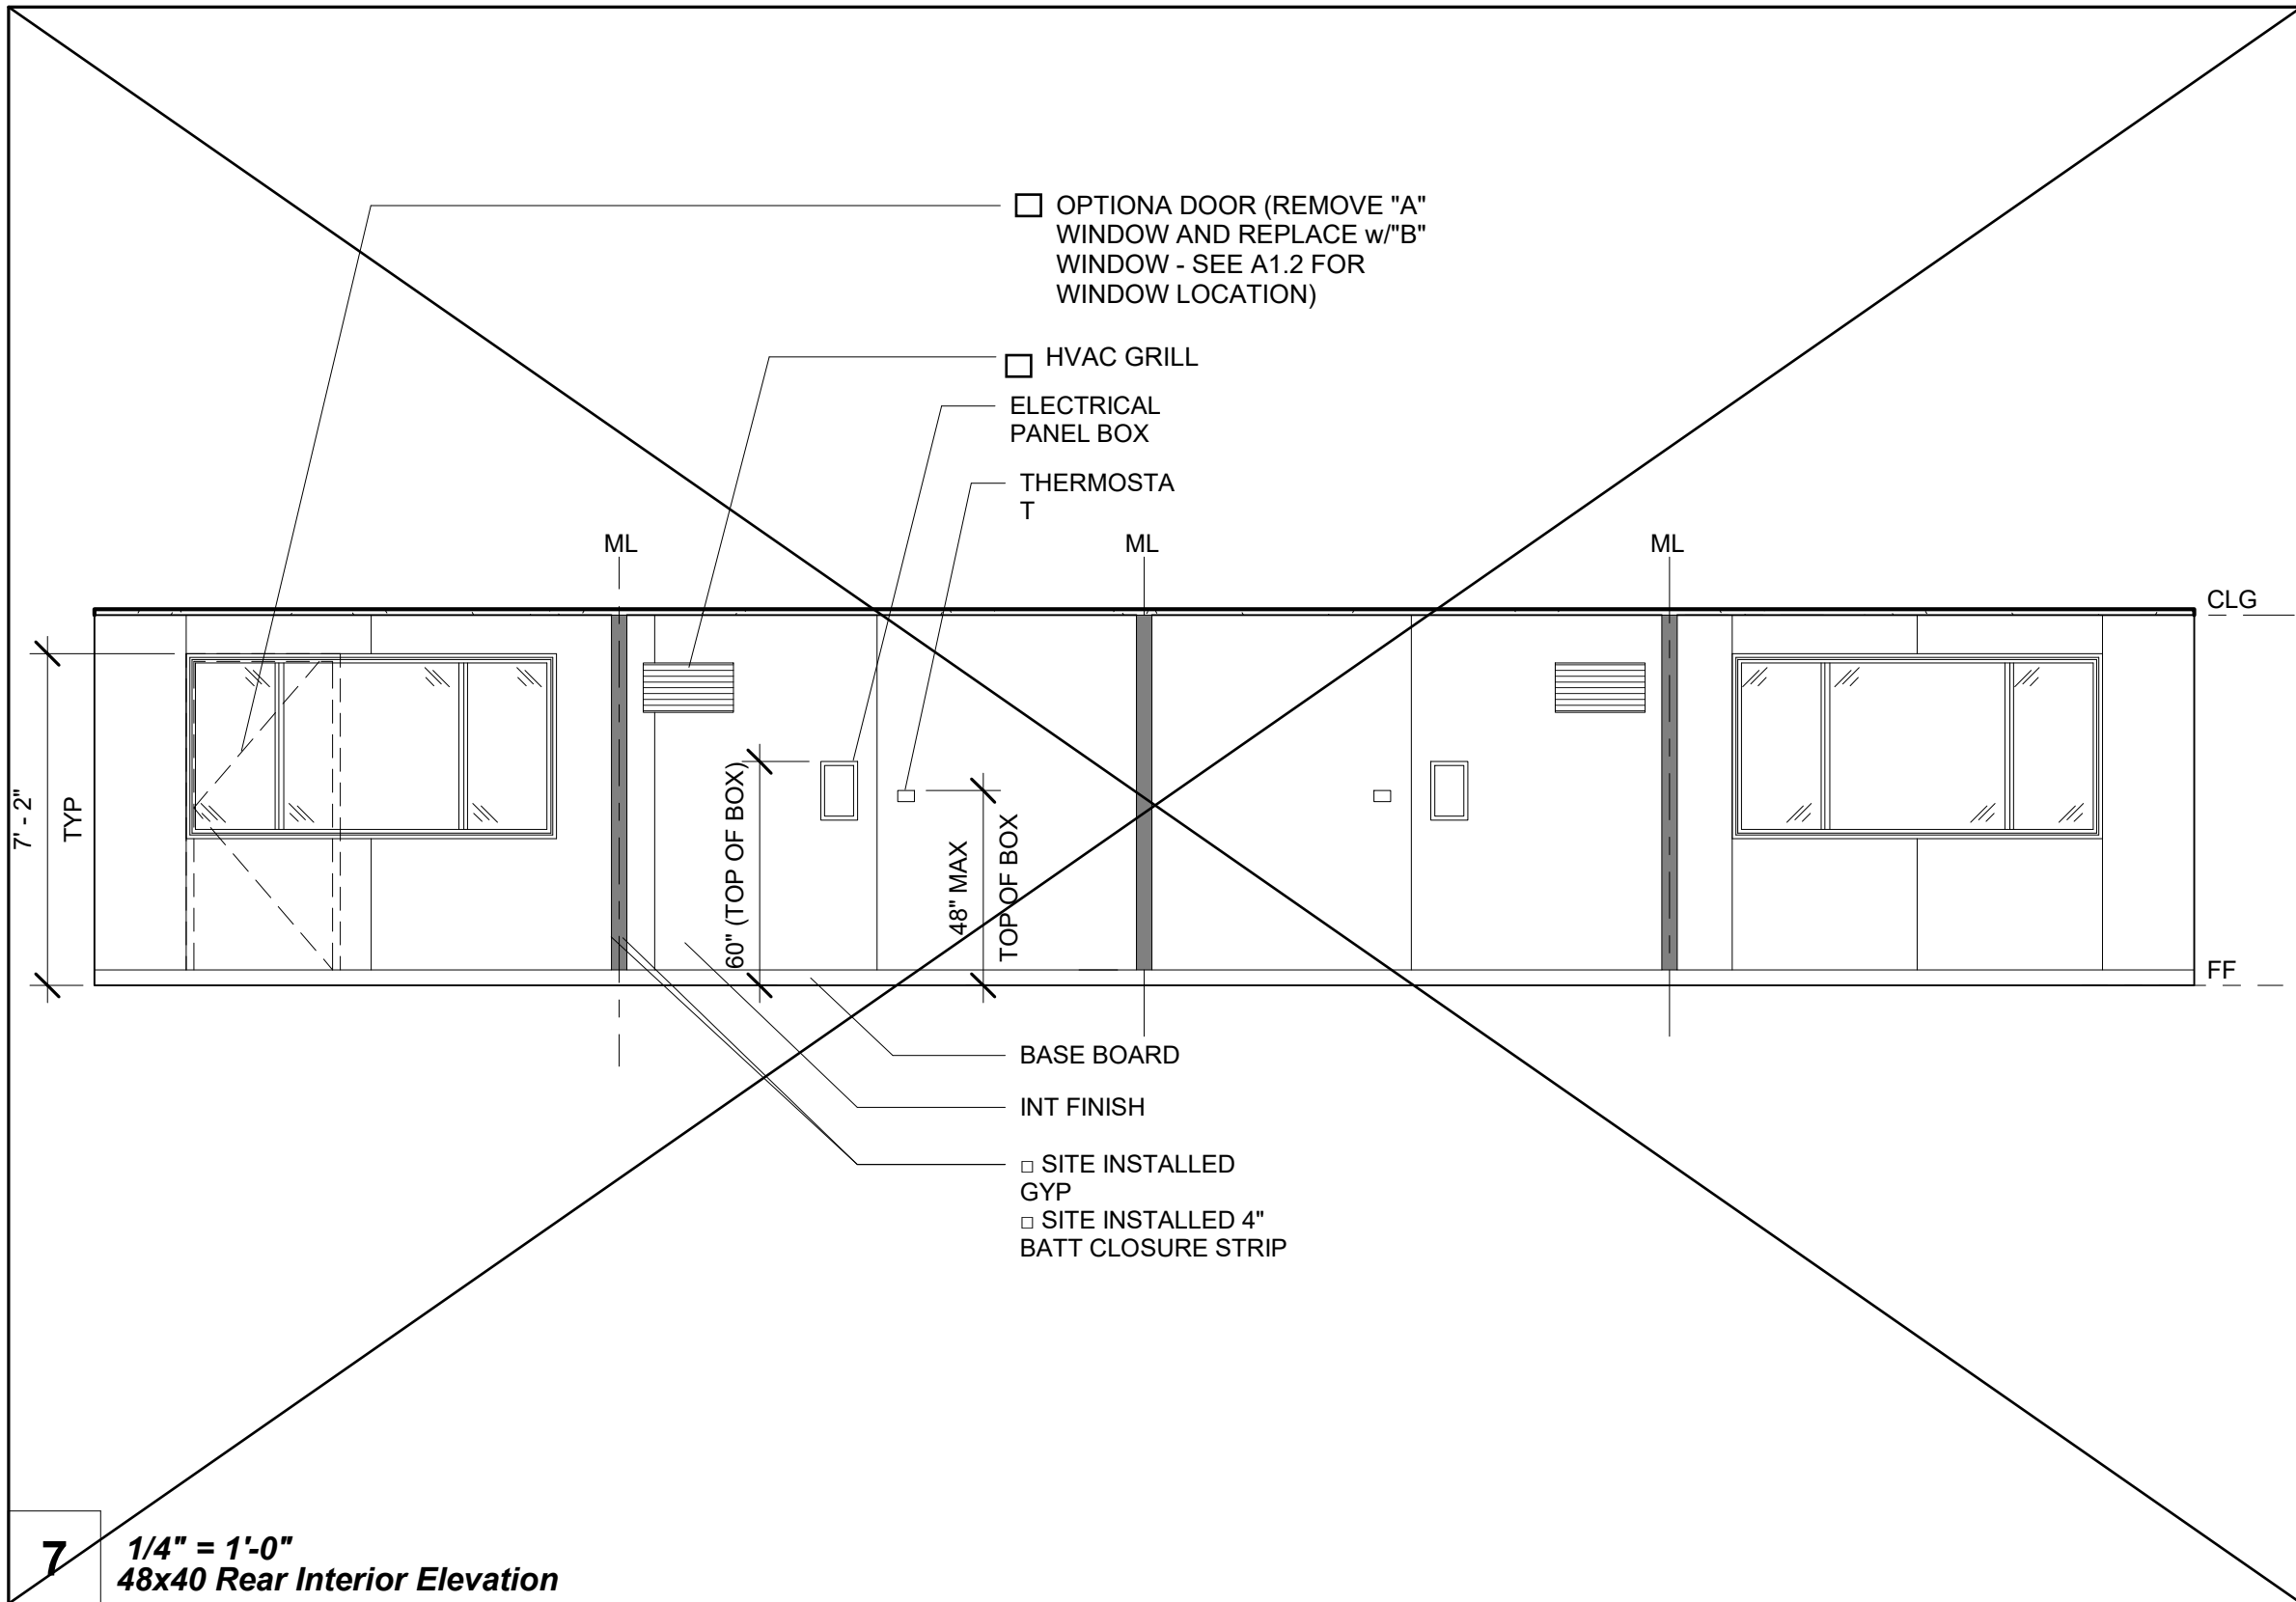


7 1/4" = 1'-0" 48x40 Rear Interior Elevation

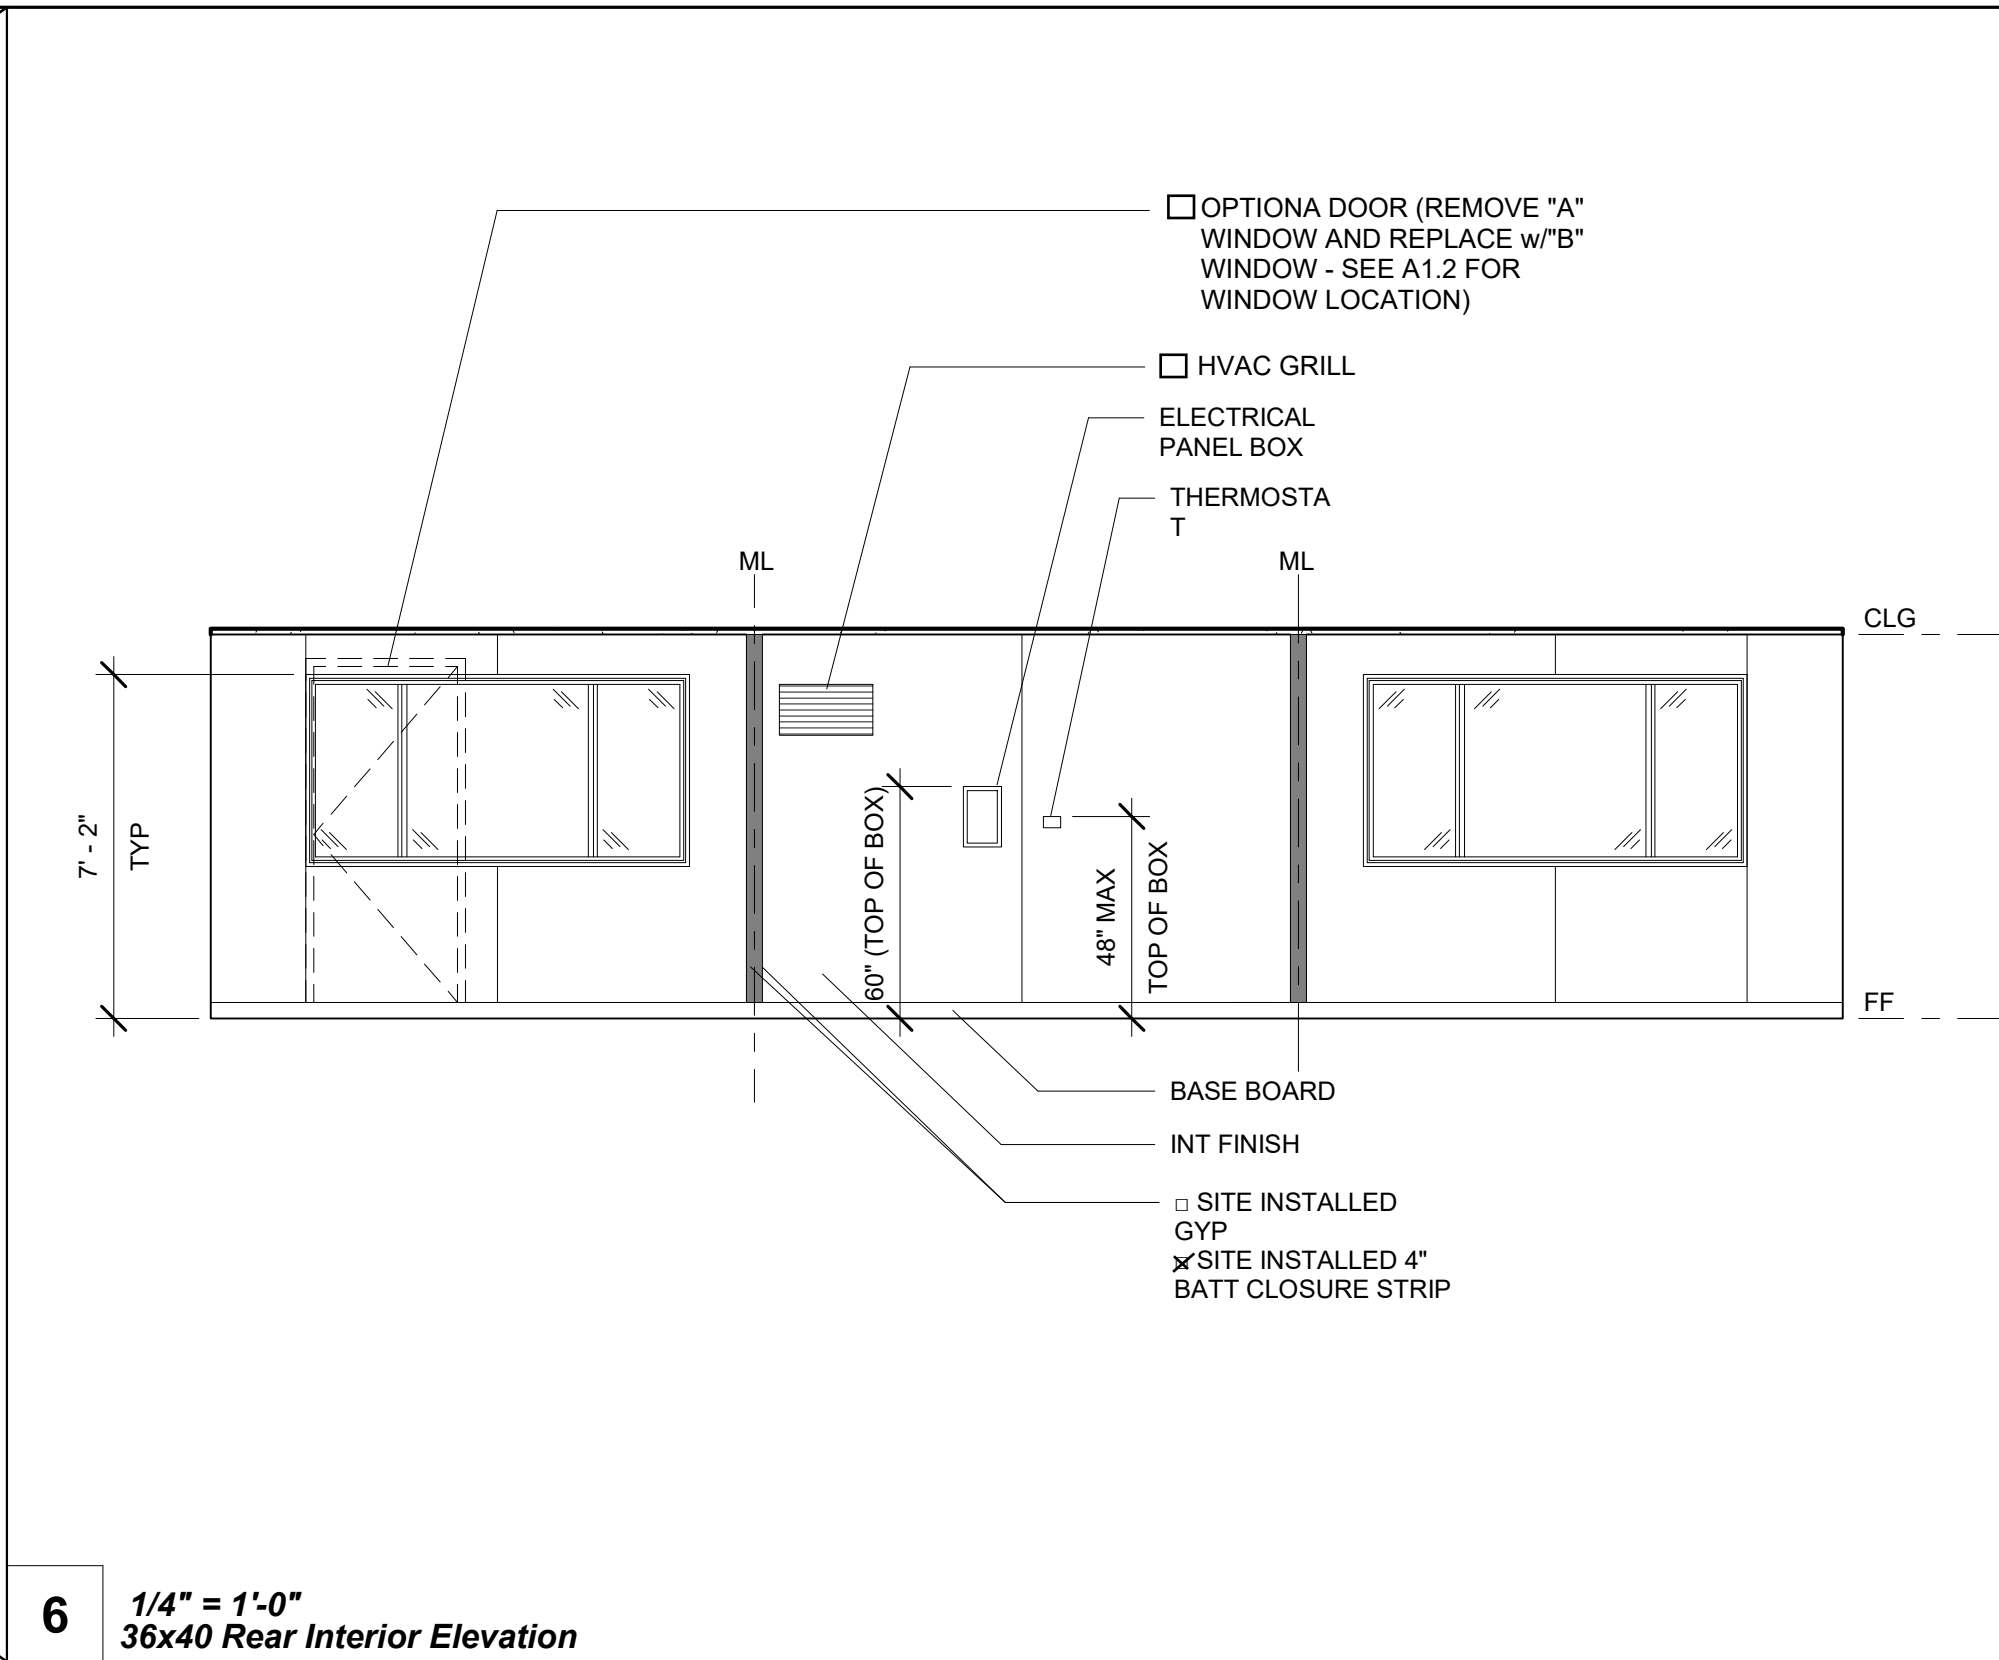


6 1/4" = 1'-0" 36x40 Rear Interior Elevation

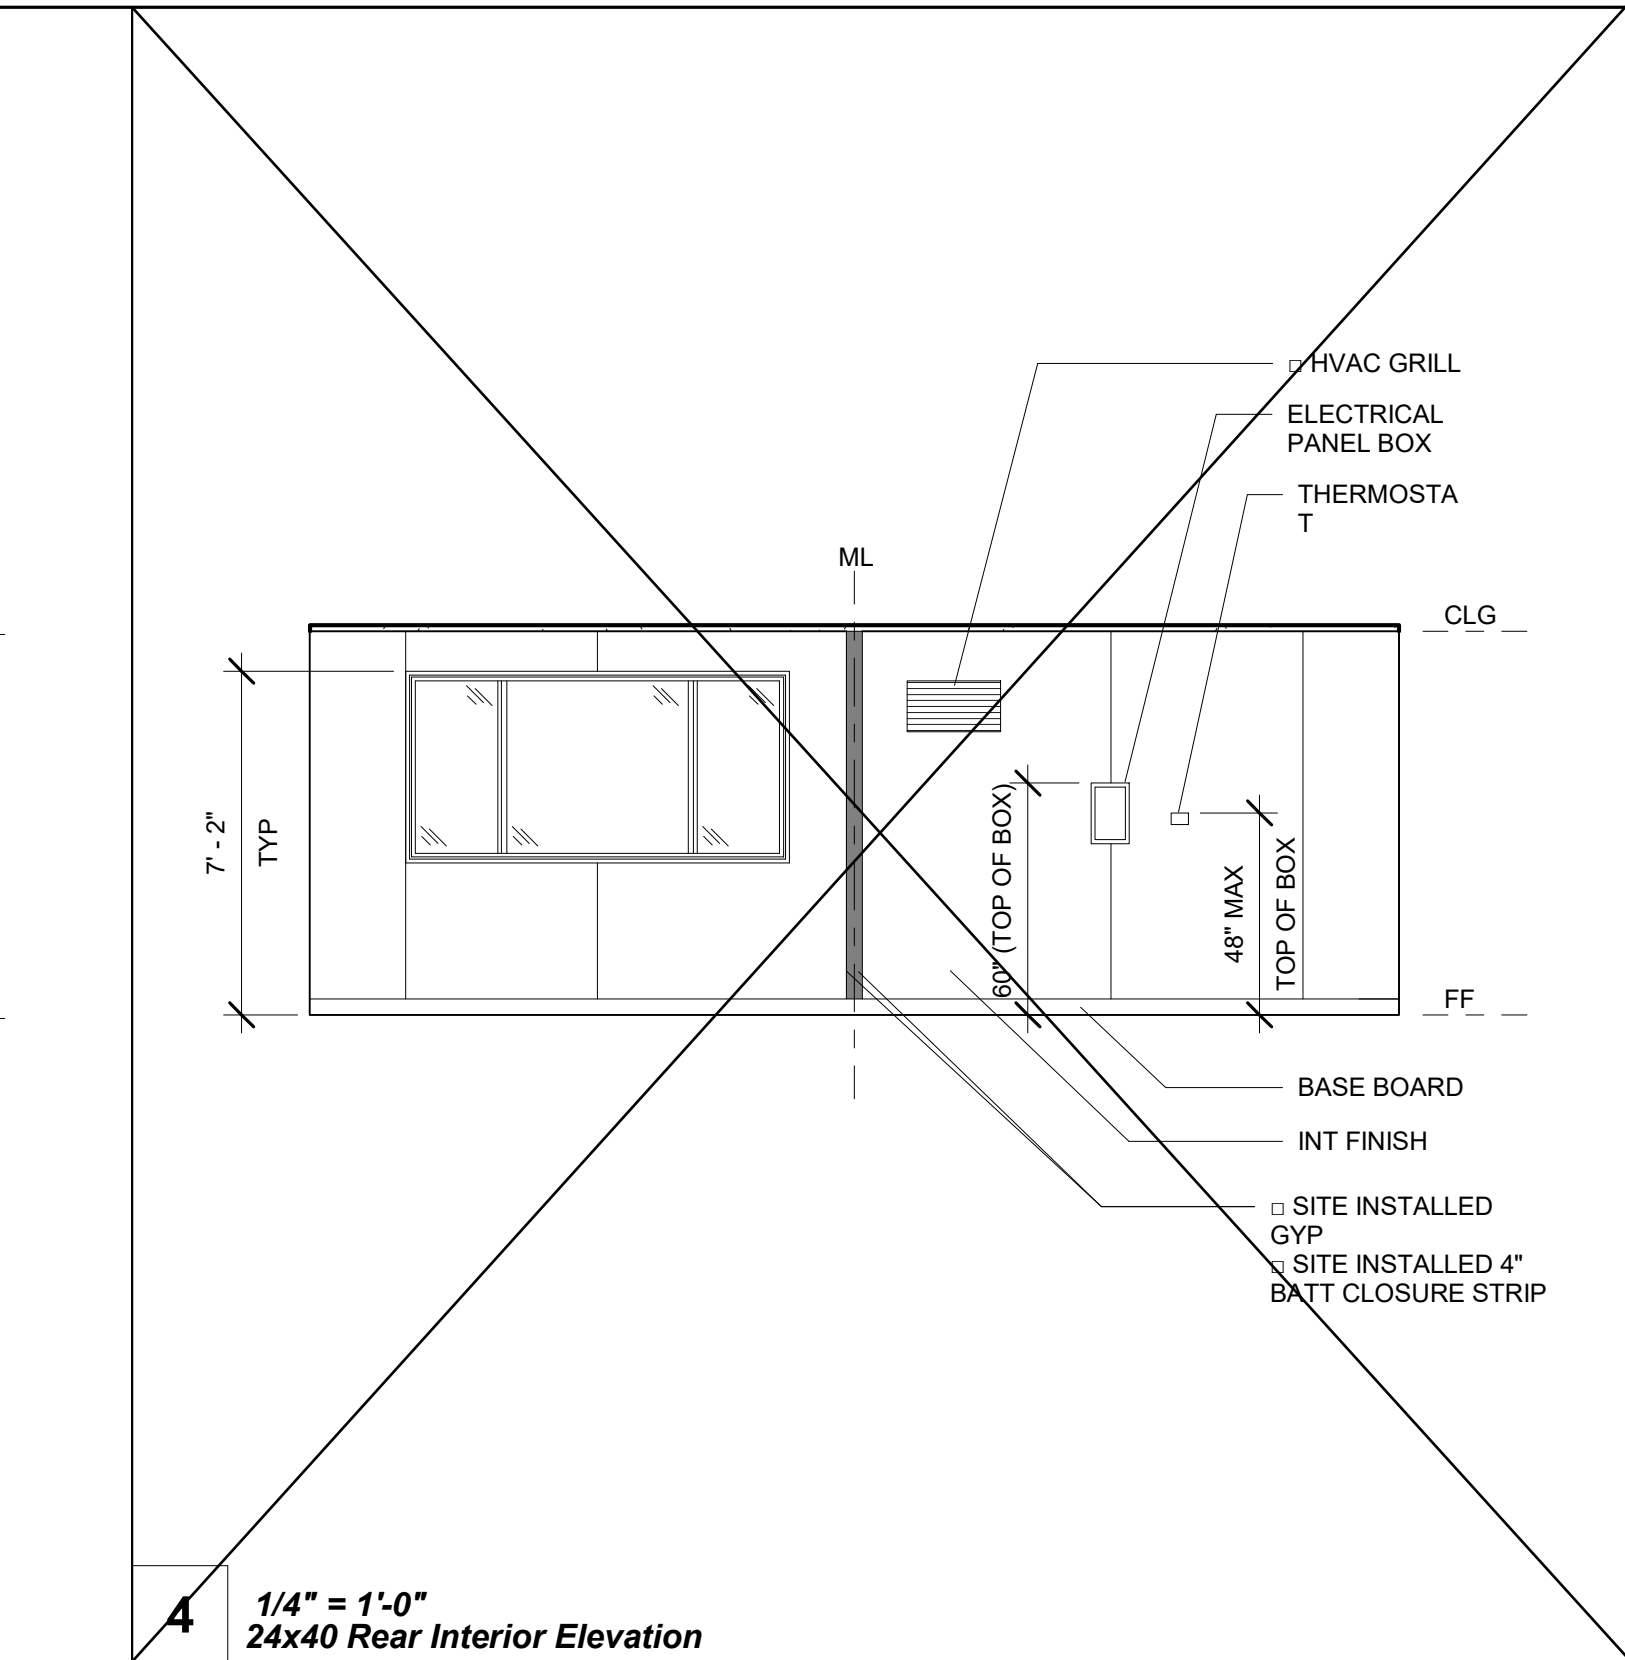


4 1/4" = 1'-0" 24x40 Rear Interior Elevation

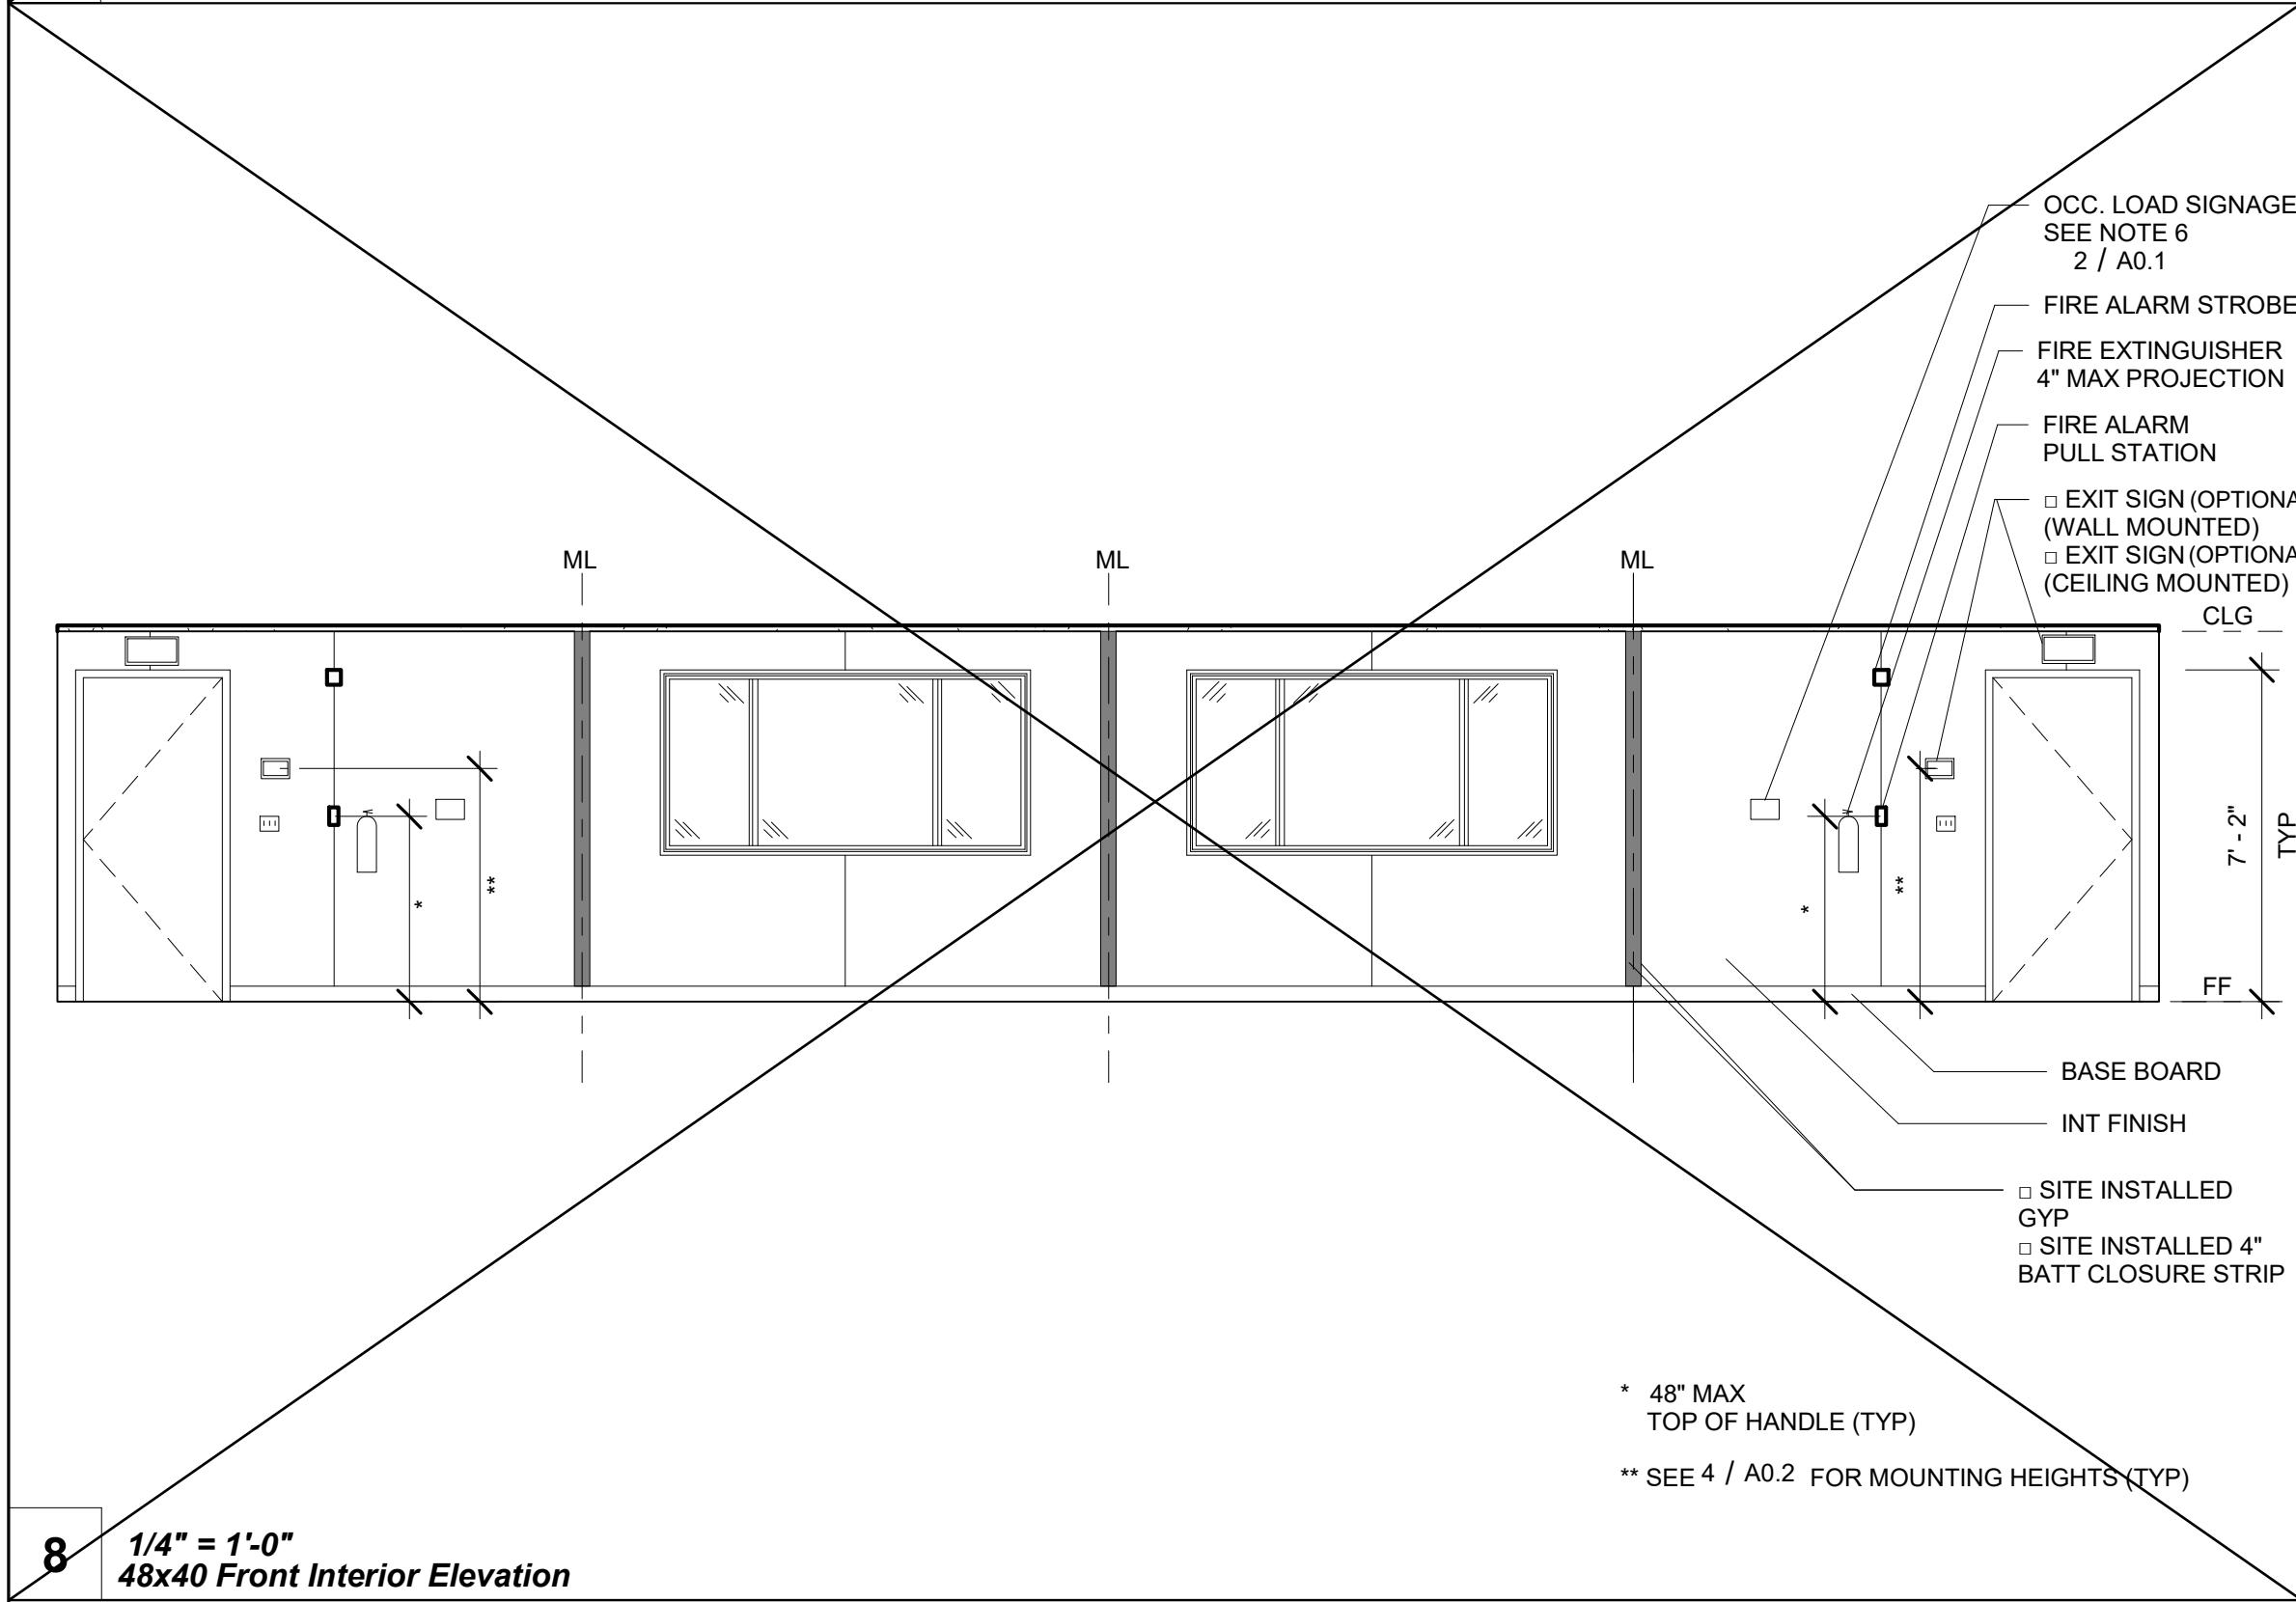


8 1/4" = 1'-0" 48x40 Front Interior Elevation

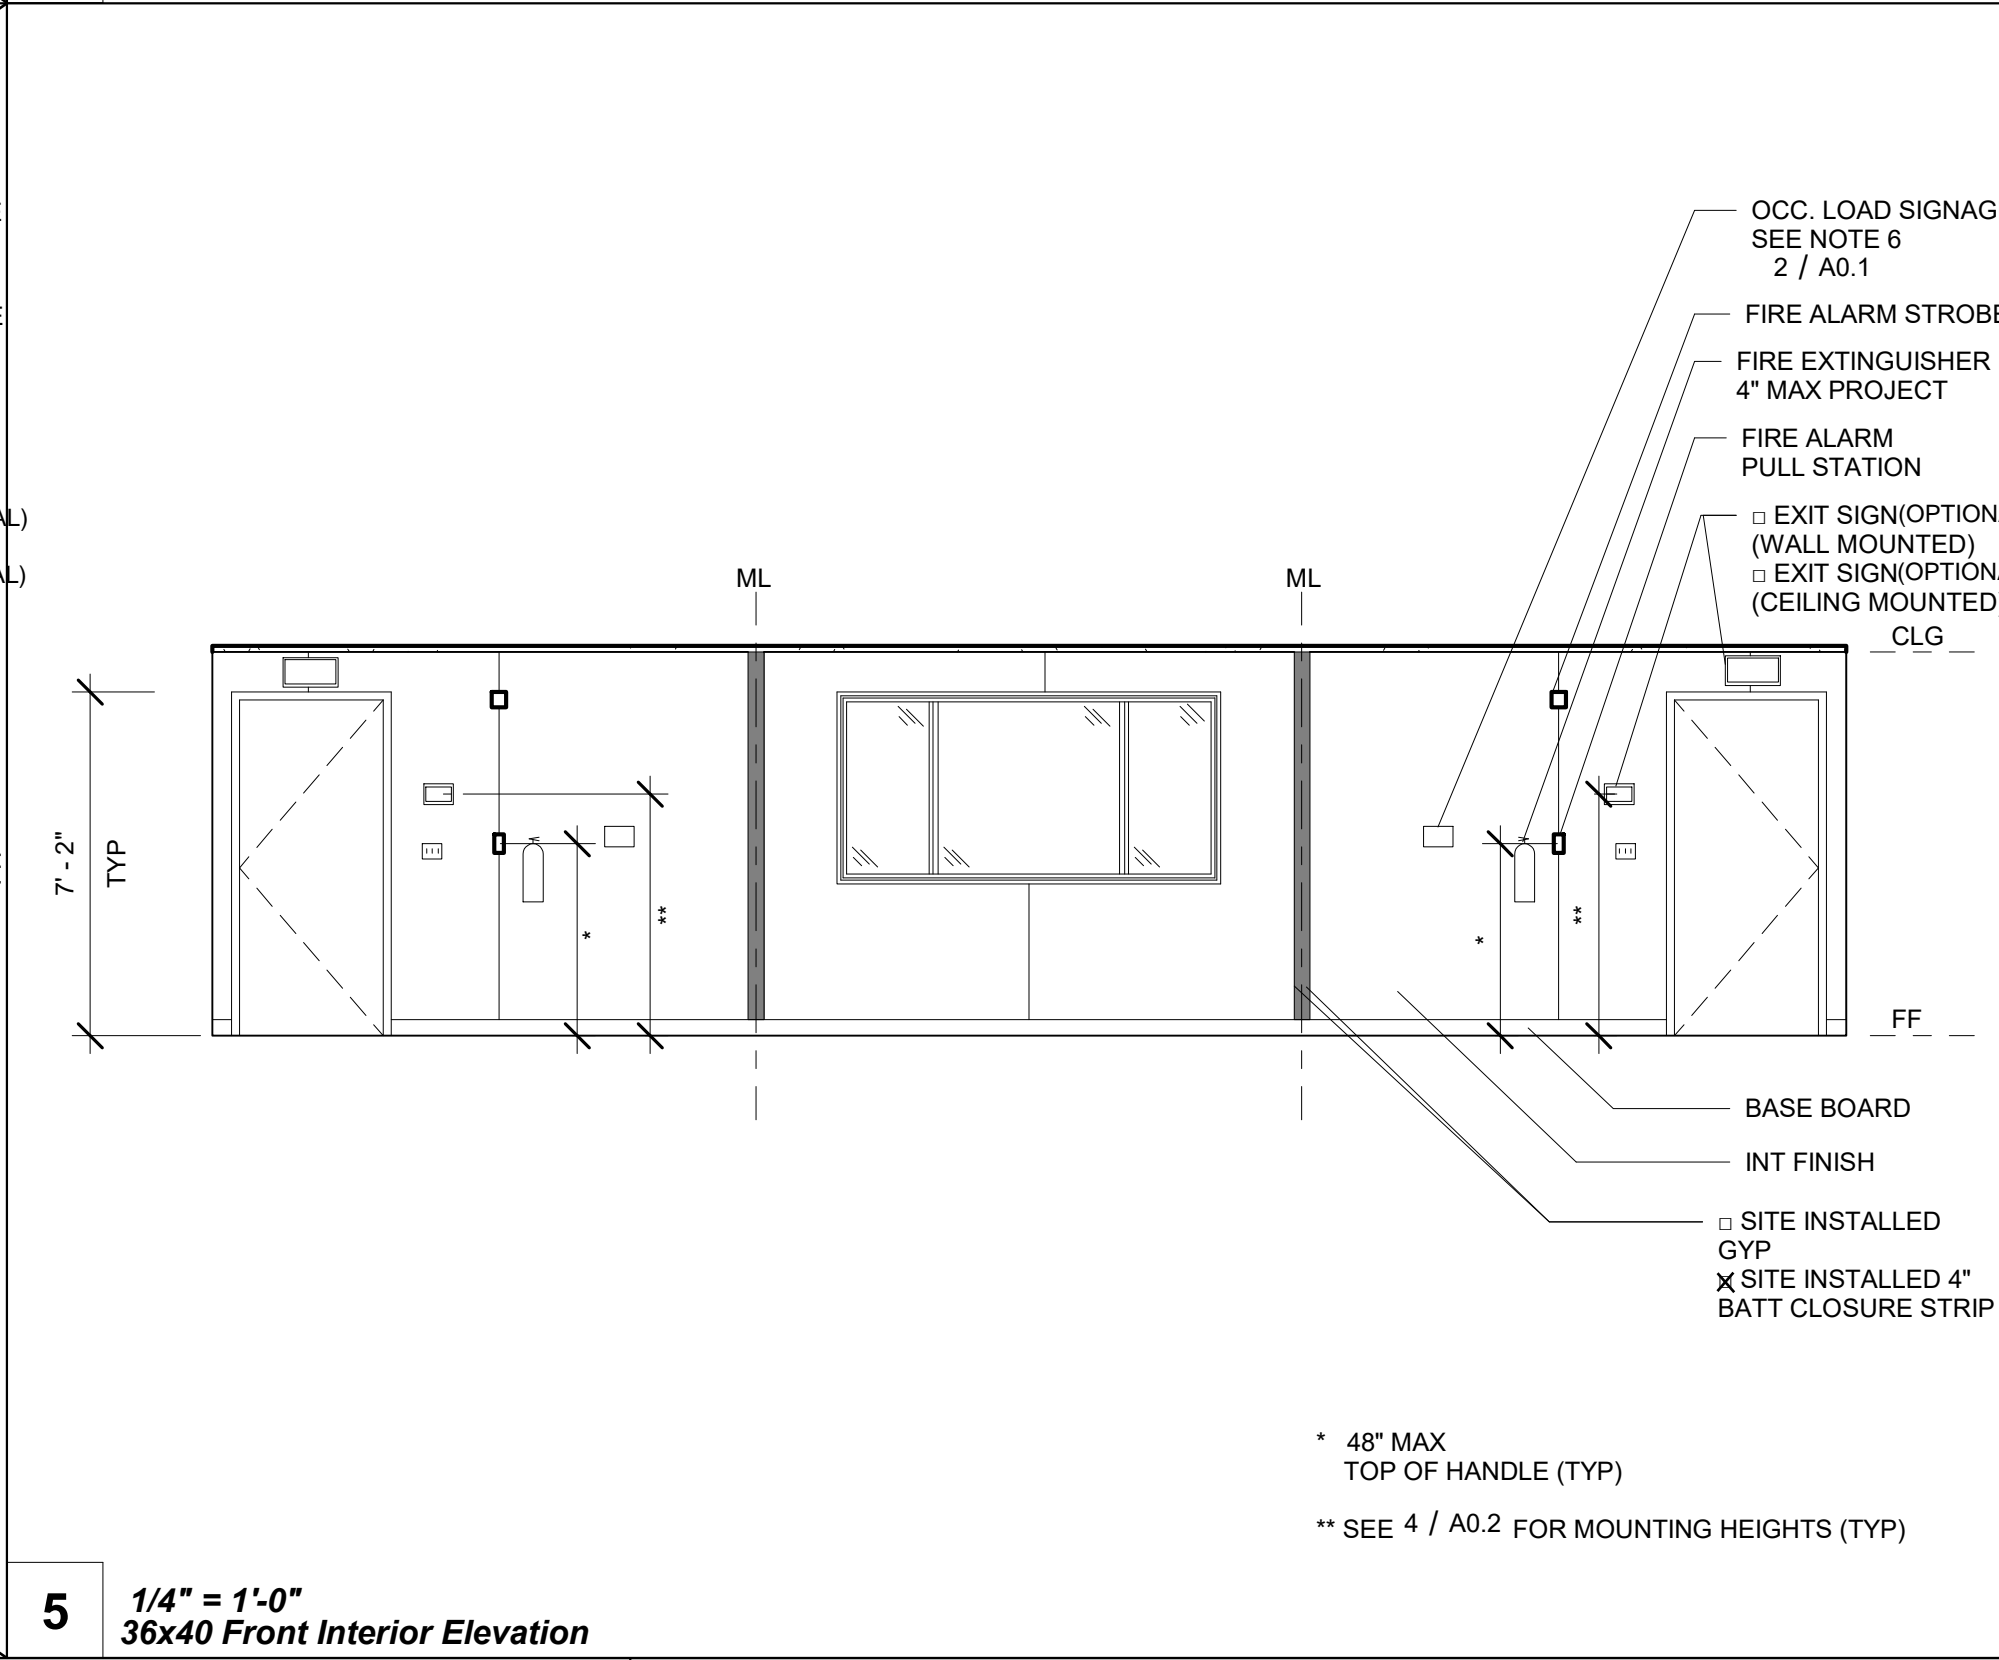


5 1/4" = 1'-0" 36x40 Front Interior Elevation

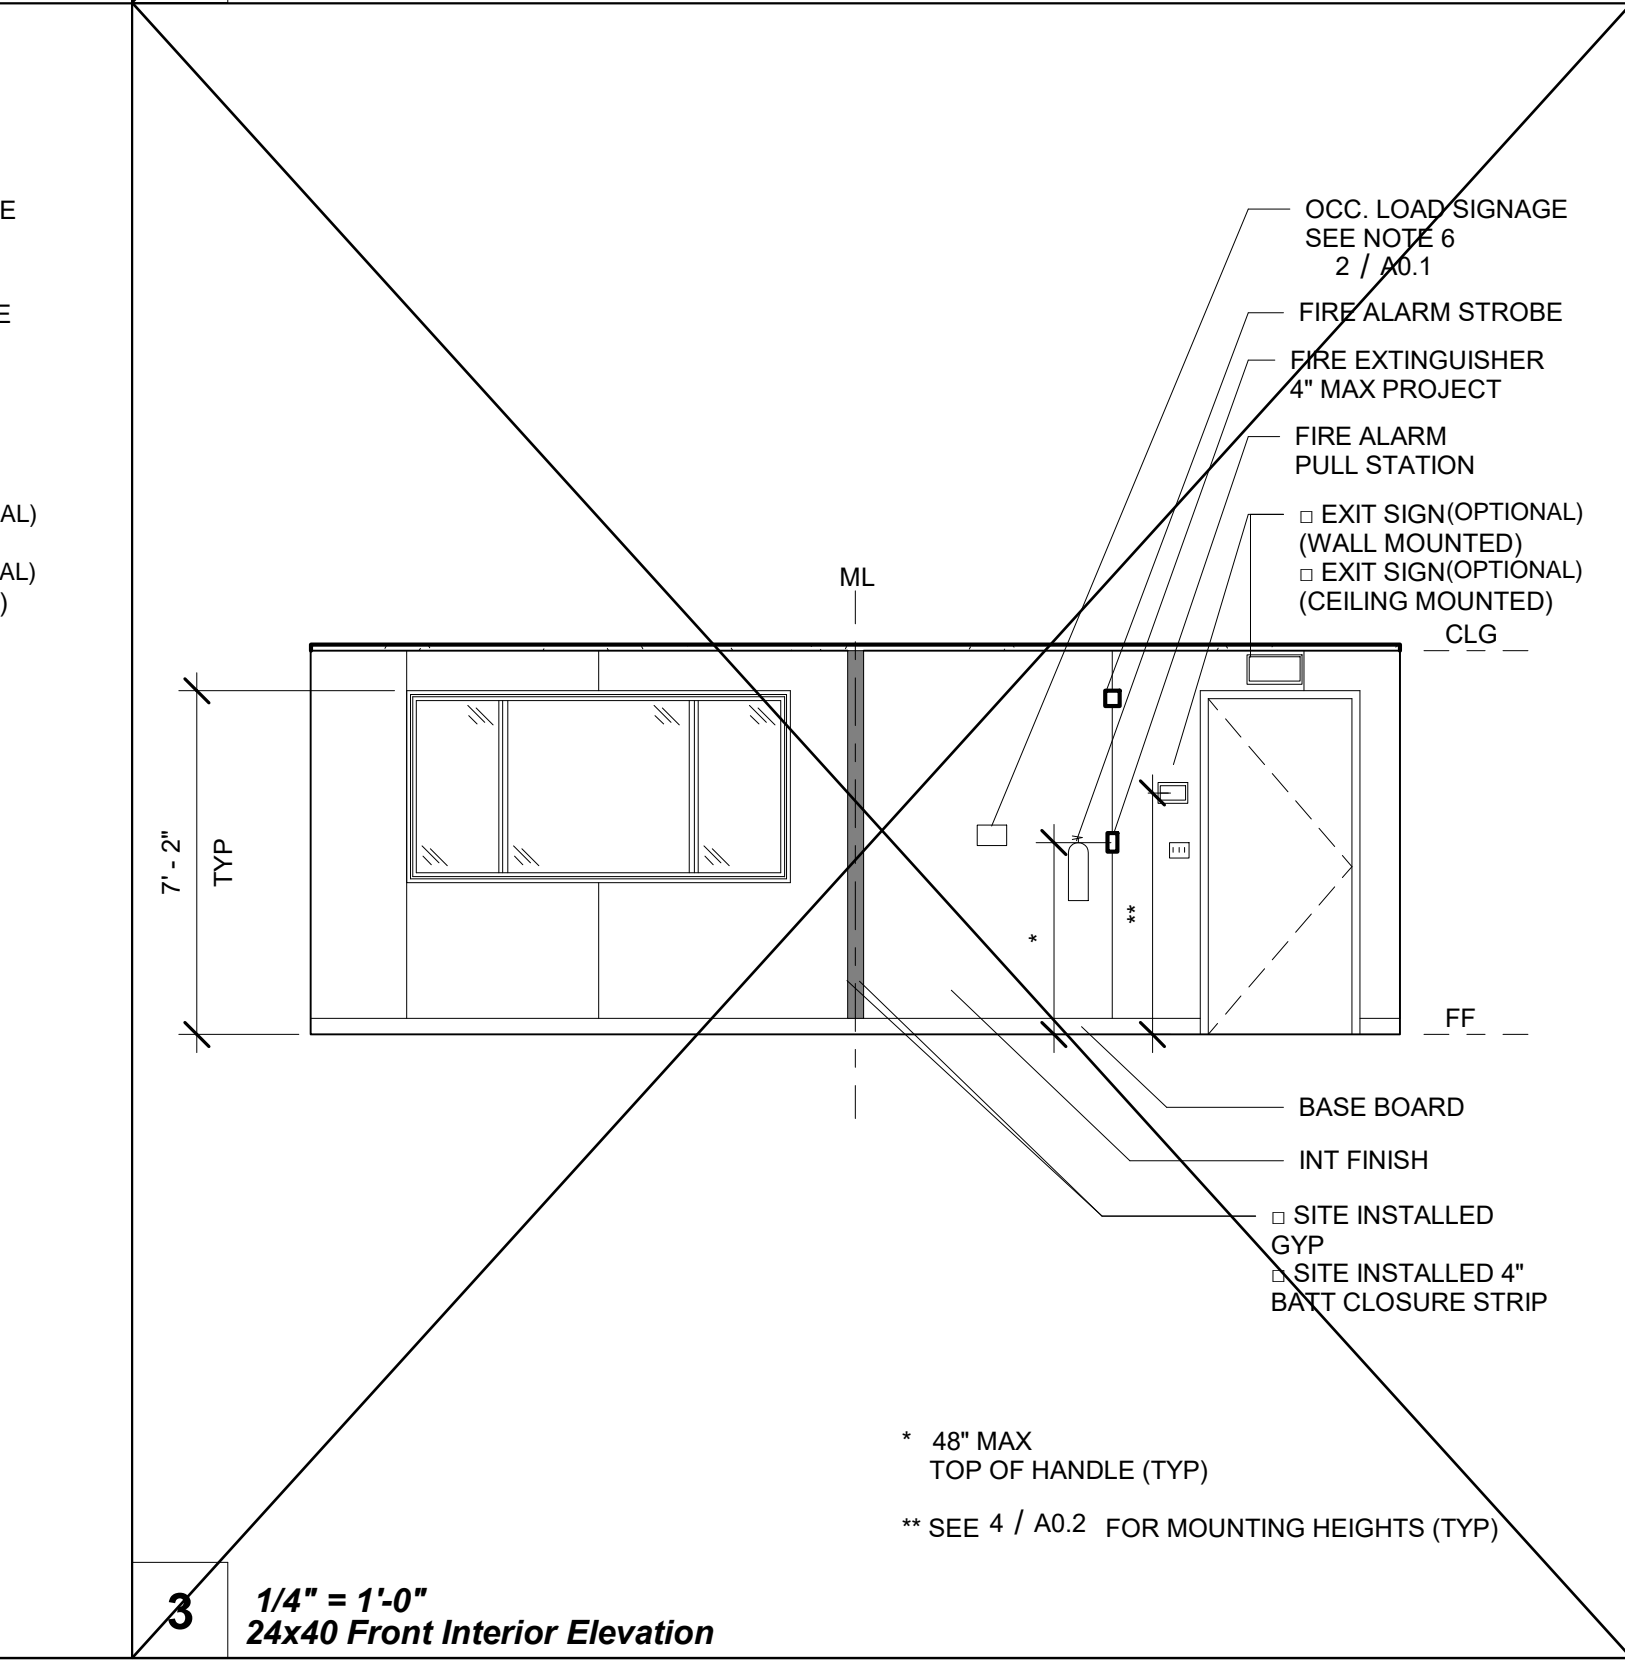

3 1/4" = 1'-0" 24x40 Front Interior Elevation

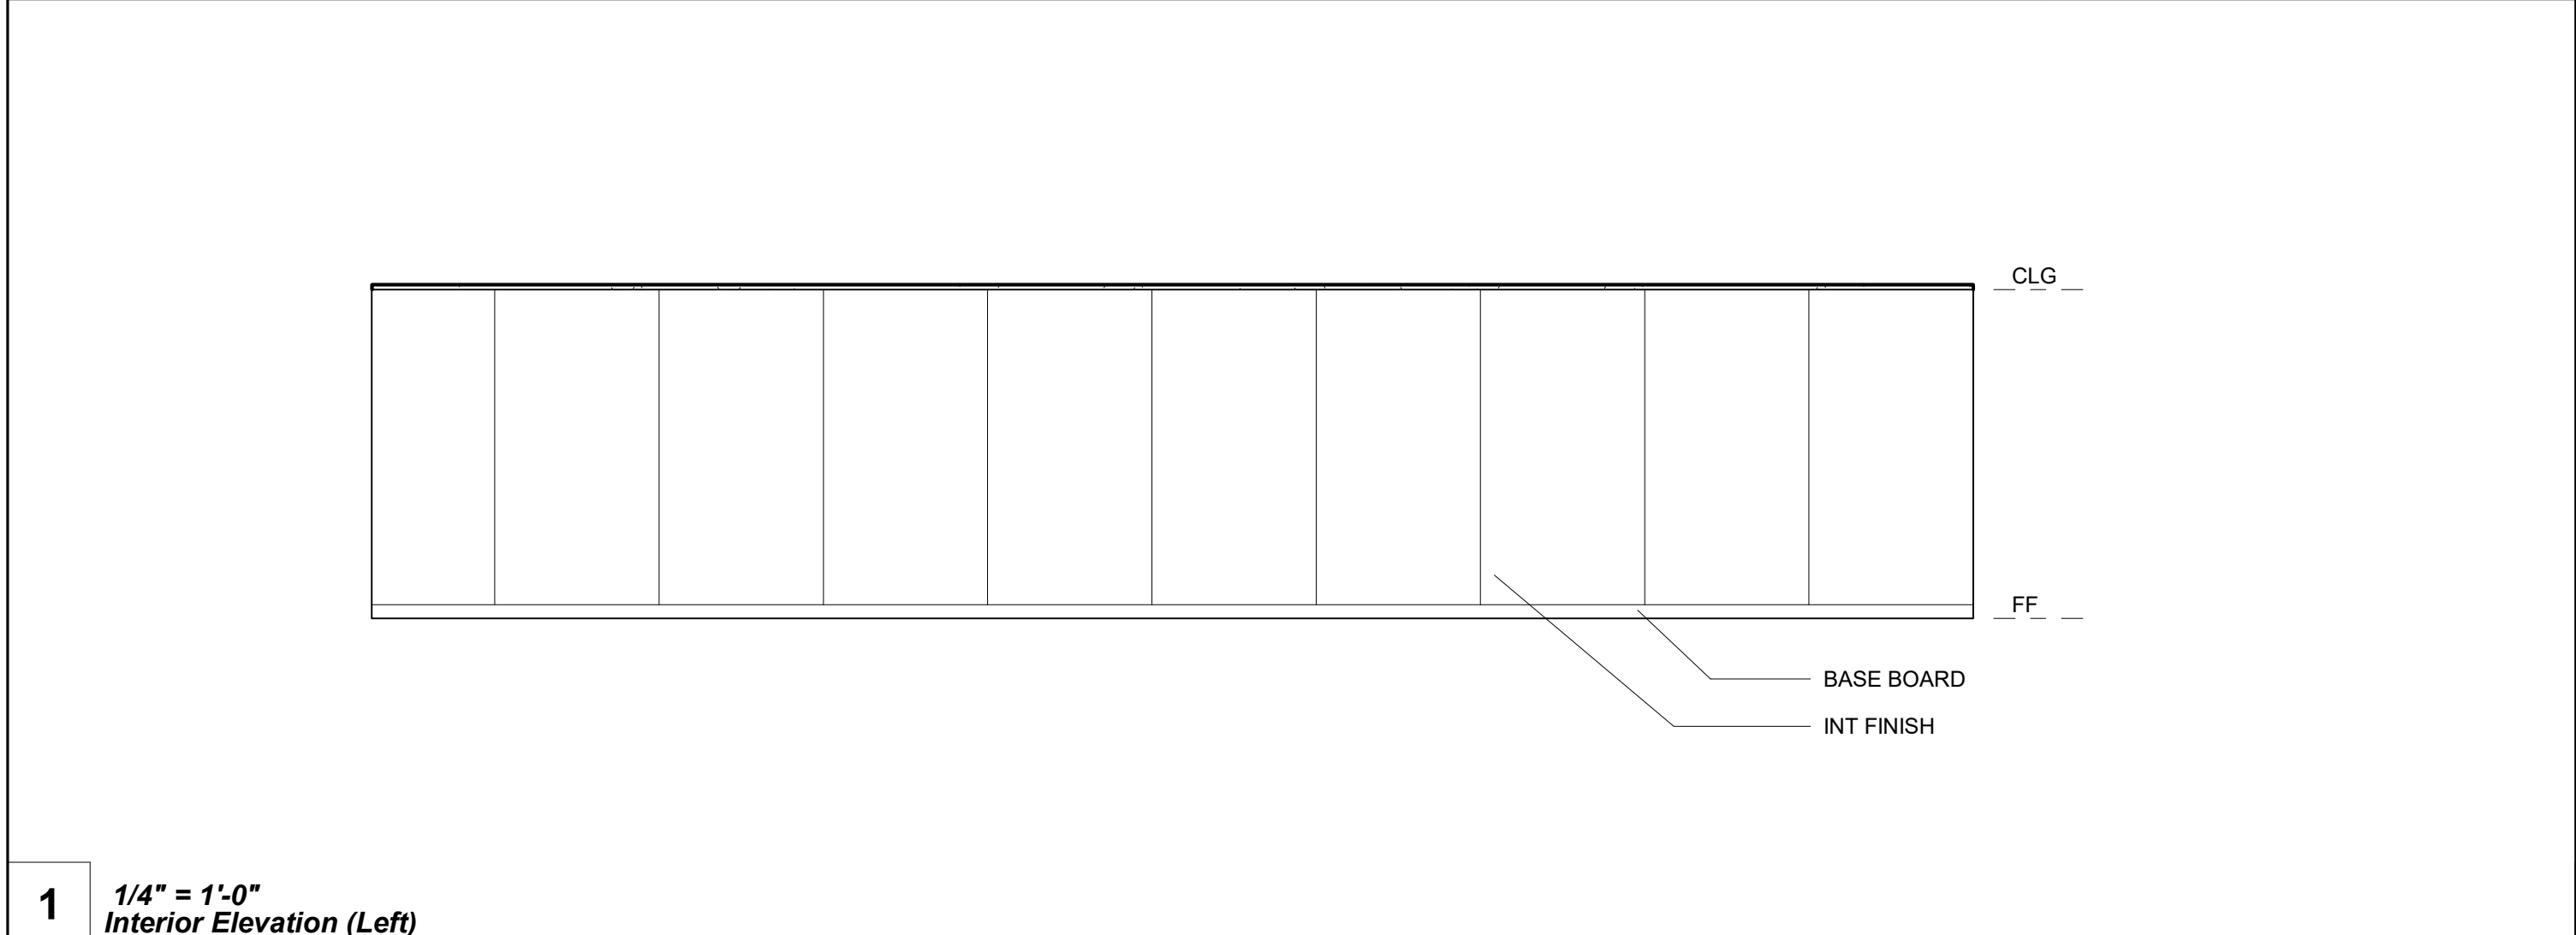

1 1/4" = 1'-0" Interior Elevation (Left)

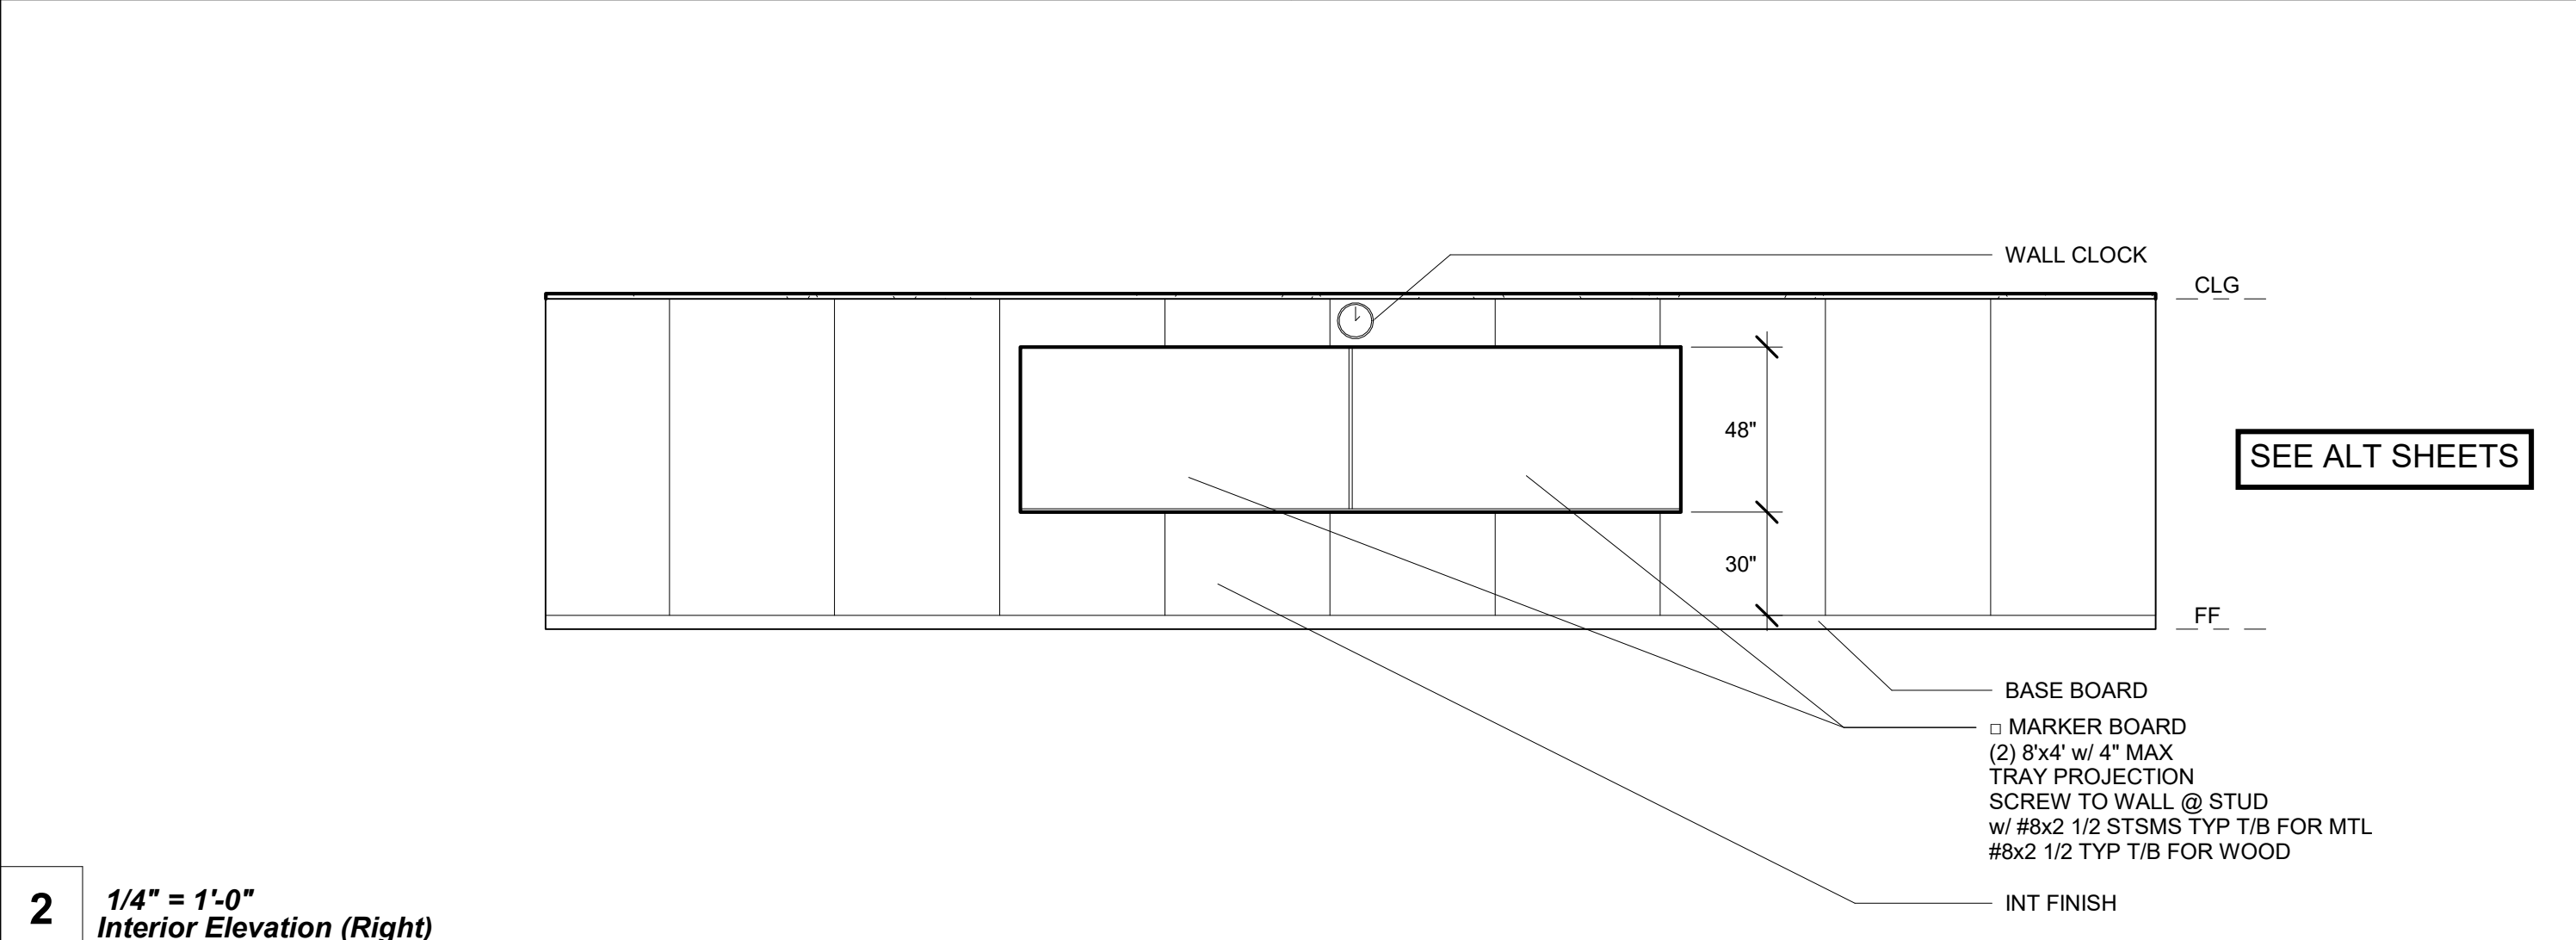

2 1/4" = 1'-0" Interior Elevation (Right)

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-123050 INC.
REVIEWED FOR
SS ☐ PLS ☐ ACS ☐
DATE: 07/29/2024

R&S TAVARES ASSOCIATES
DESIGN & CONSULTING • PROJECT MGT
11590 W BERNARDO COURT, SUITE 100
SAN DIEGO, CA 92127
WWW.RSTAVARES.COM

PROFESSIONAL STAMP
REGISTERED PROFESSIONAL ARCHITECT
MANNY D. FROST
C3380
03/31/24
CALIFORNIA
STATE OF CALIFORNIA
02/16/24
RST#22088

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT
Class Leasing
1651 Juanita Street, San Jacinto, CA 92583
Voice (951) 943-1908 Fax (951) 943-5768

ORIGINAL PC STATE AGENCY APPROVAL
APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-123050 PC
REVIEWED FOR
SS ☒ PLS ☒ ACS ☒ CG ☒
DATE: 02/20/2024

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
INTERIOR ELEVATIONS

PROJECT NUMBER
22088

DRAWN BY
rMc/SC

CHECKED BY
RH/RT

DATE

SHEET NO.
A5.2

SHEET OF

Note: For conditioned structures, roofing must be installed IAW 2022 CBC SECTION 1202.3

SEE 3/A0.1 & A4.0.1 FOR ROOF INSULATION (CONDITIONED UNITS ONLY)

3
A3.3
X T-GRID
GYP BOARD

7
A2.9
SEE ARCH FLOOR FRAMING

8'-6" 1/8"

FOR BURNING CHARACTERISTICS
SEE 3/A0.1

STANDING SEAM ROOF

TRUSS

CHANNEL

FASCIA

5' - 0"

CLG
X T-GRID SEE DETAILS ON SHEET A3.3
GYP SEE DETAILS ON SHEET A3.4

3
A3.3
X T-GRID
GYP BOARD

10A
A2.1(A)
SEE DOOR SCHEDULE


8'-6" 1/8"

X WD EXTERIOR FINISH
PLSTR EXTERIOR FINISH


FOR WUI DETAILS SEE
SHEETS A2.1(B)
A2.3(B)
A2.5(B)
A2.7(B)

3
A2.9
SEE ARCH FLOOR FRAMING

PROJECT SPECIFIC STATE AGENCY APPROVAL

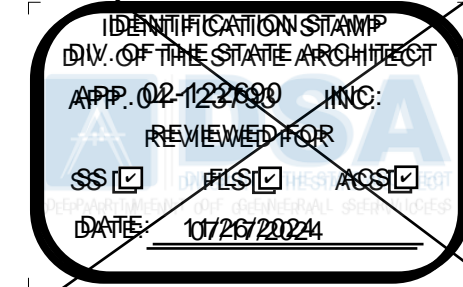

PROFESSIONAL STAMP

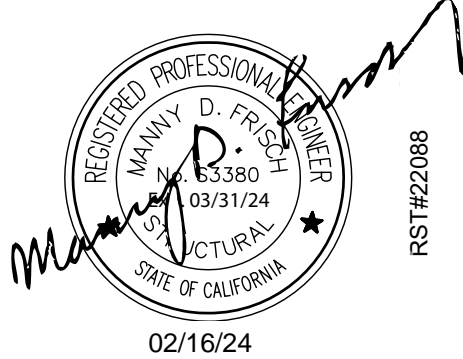


THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



ORIGINAL PC STATE AGENCY APPROVAL

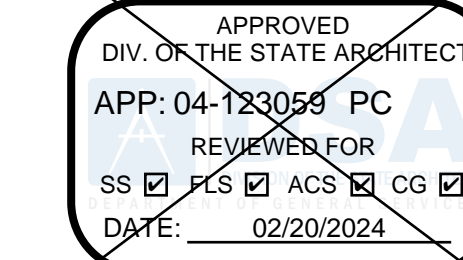

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE

PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE

SECTION -
STANDING SEAM
(MONO)

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY


RH/RT



DATE

SHEET NO.

A6.0

SHEET OF

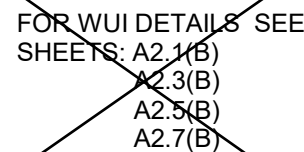

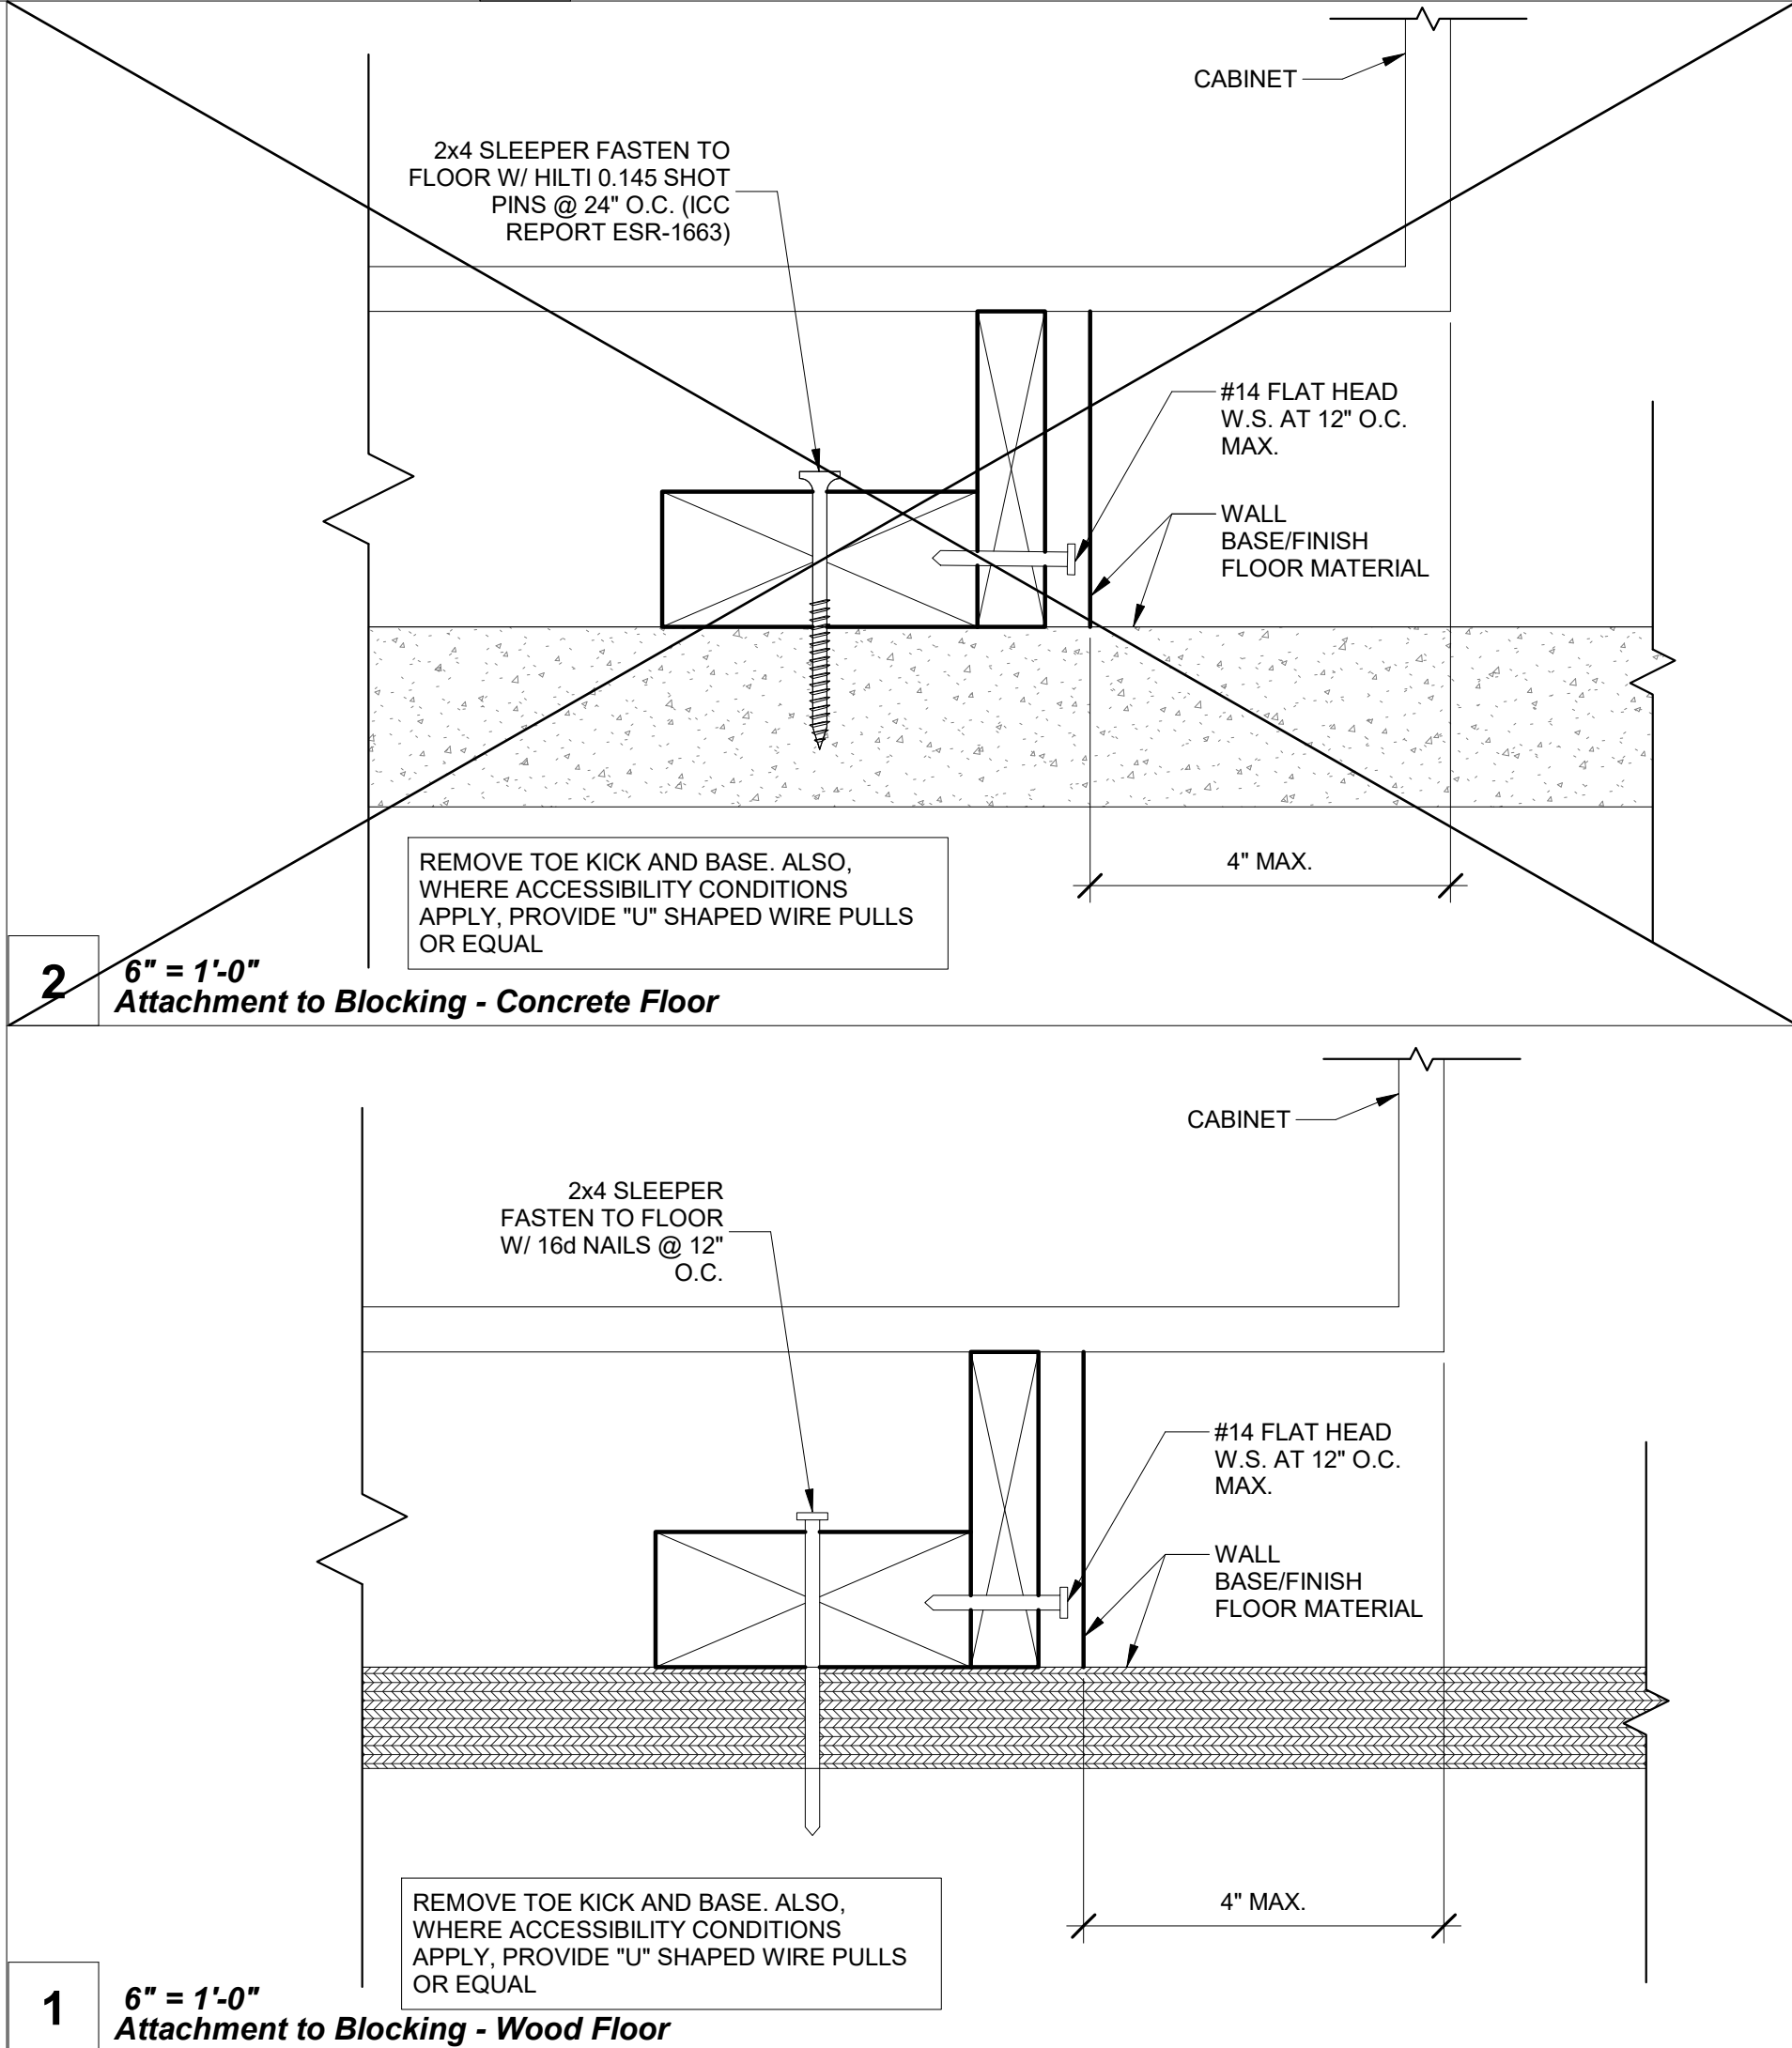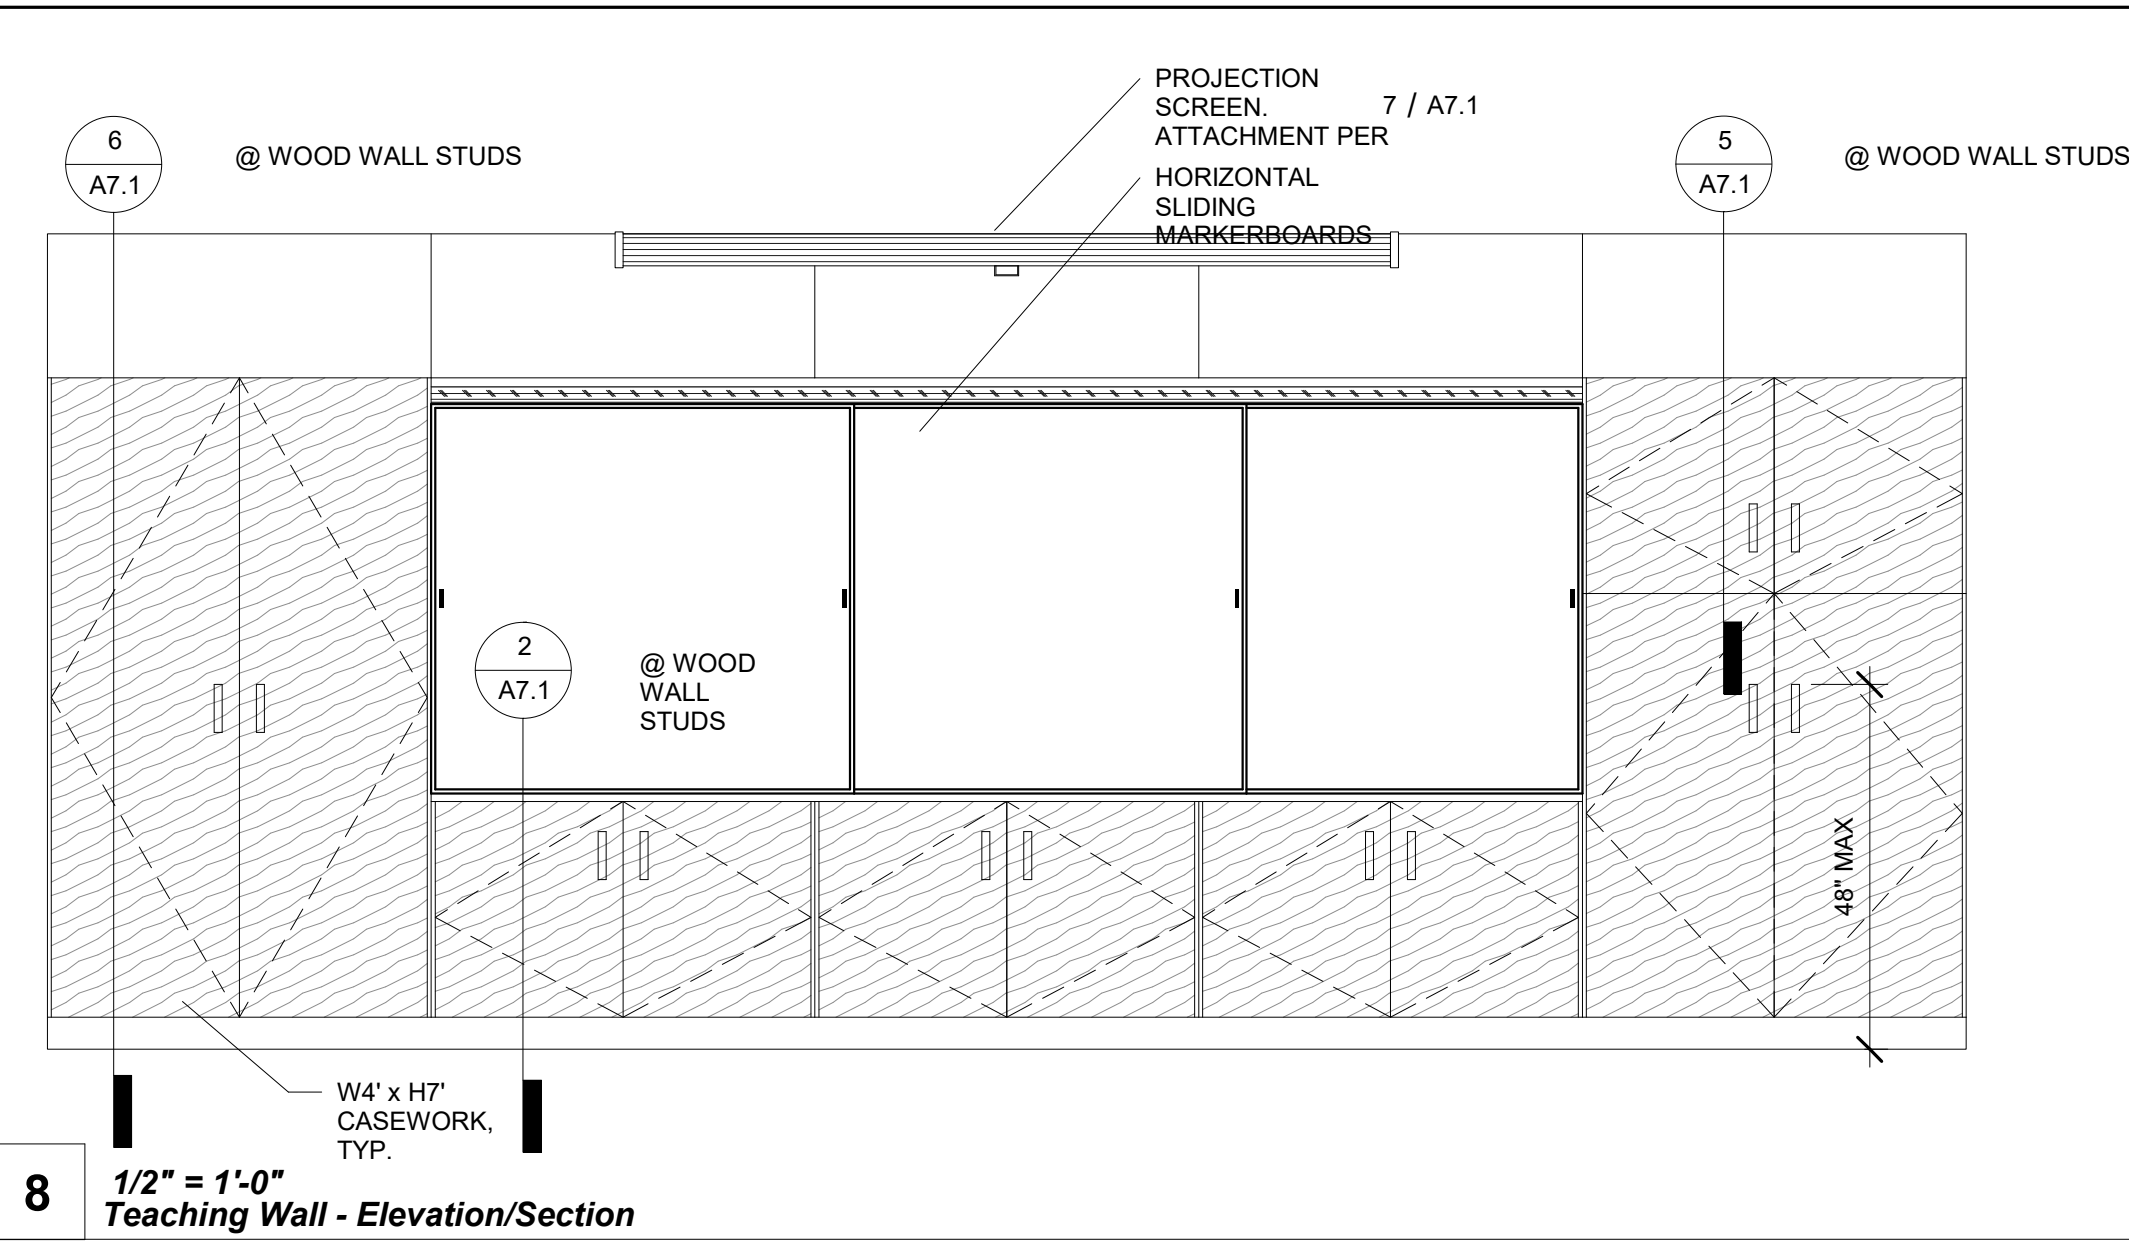

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP

DIV. OF THE STATE ARCHITECT

APP: 02-123050 INC:

REVIEWED FOR

SS ☐ PLS ☐ ACS ☐

DATE: 07/29/2024

R&S TAVARES ASSOCIATES

DESIGN • CONSULTING • PROJECT MGT

11590 W BERNARDO COURT, SUITE 100

SAN DIEGO, CA 92127

WWW.RSTAVARES.COM

PROFESSIONAL STAMP

REGISTERED PROFESSIONAL ARCHITECT

MANNY D. FROST

63380

03/31/24

STATE OF CALIFORNIA

RS1#22088

02/16/24

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT

Class Leasing

1651 Juanita Street, San Jacinto, CA 92583

Voice (951) 943-1908 Fax (951) 943-5768

ORIGINAL PC STATE AGENCY APPROVAL

APPROVED

DIV. OF THE STATE ARCHITECT

APP: 04-123050 PC

REVIEWED FOR

SS ☒ PLS ☒ ACS ☒ CG ☒

DATE: 02/20/2024

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE

PC 2022 CBC: 24' x 40' EXPANDABLE TO 120' x 40'

SHEET TITLE

ADDITIONAL OPTION DETAILS

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY

RH/RT

DATE








SHEET NO.

A7.0

SHEET

OF

6/15/2021 11:51:58 PM C:\Users\User\Documents\00093 - Aries, 24x40 PC - MainFile - Low Seismic_6.7_CESAR24D63.rvt

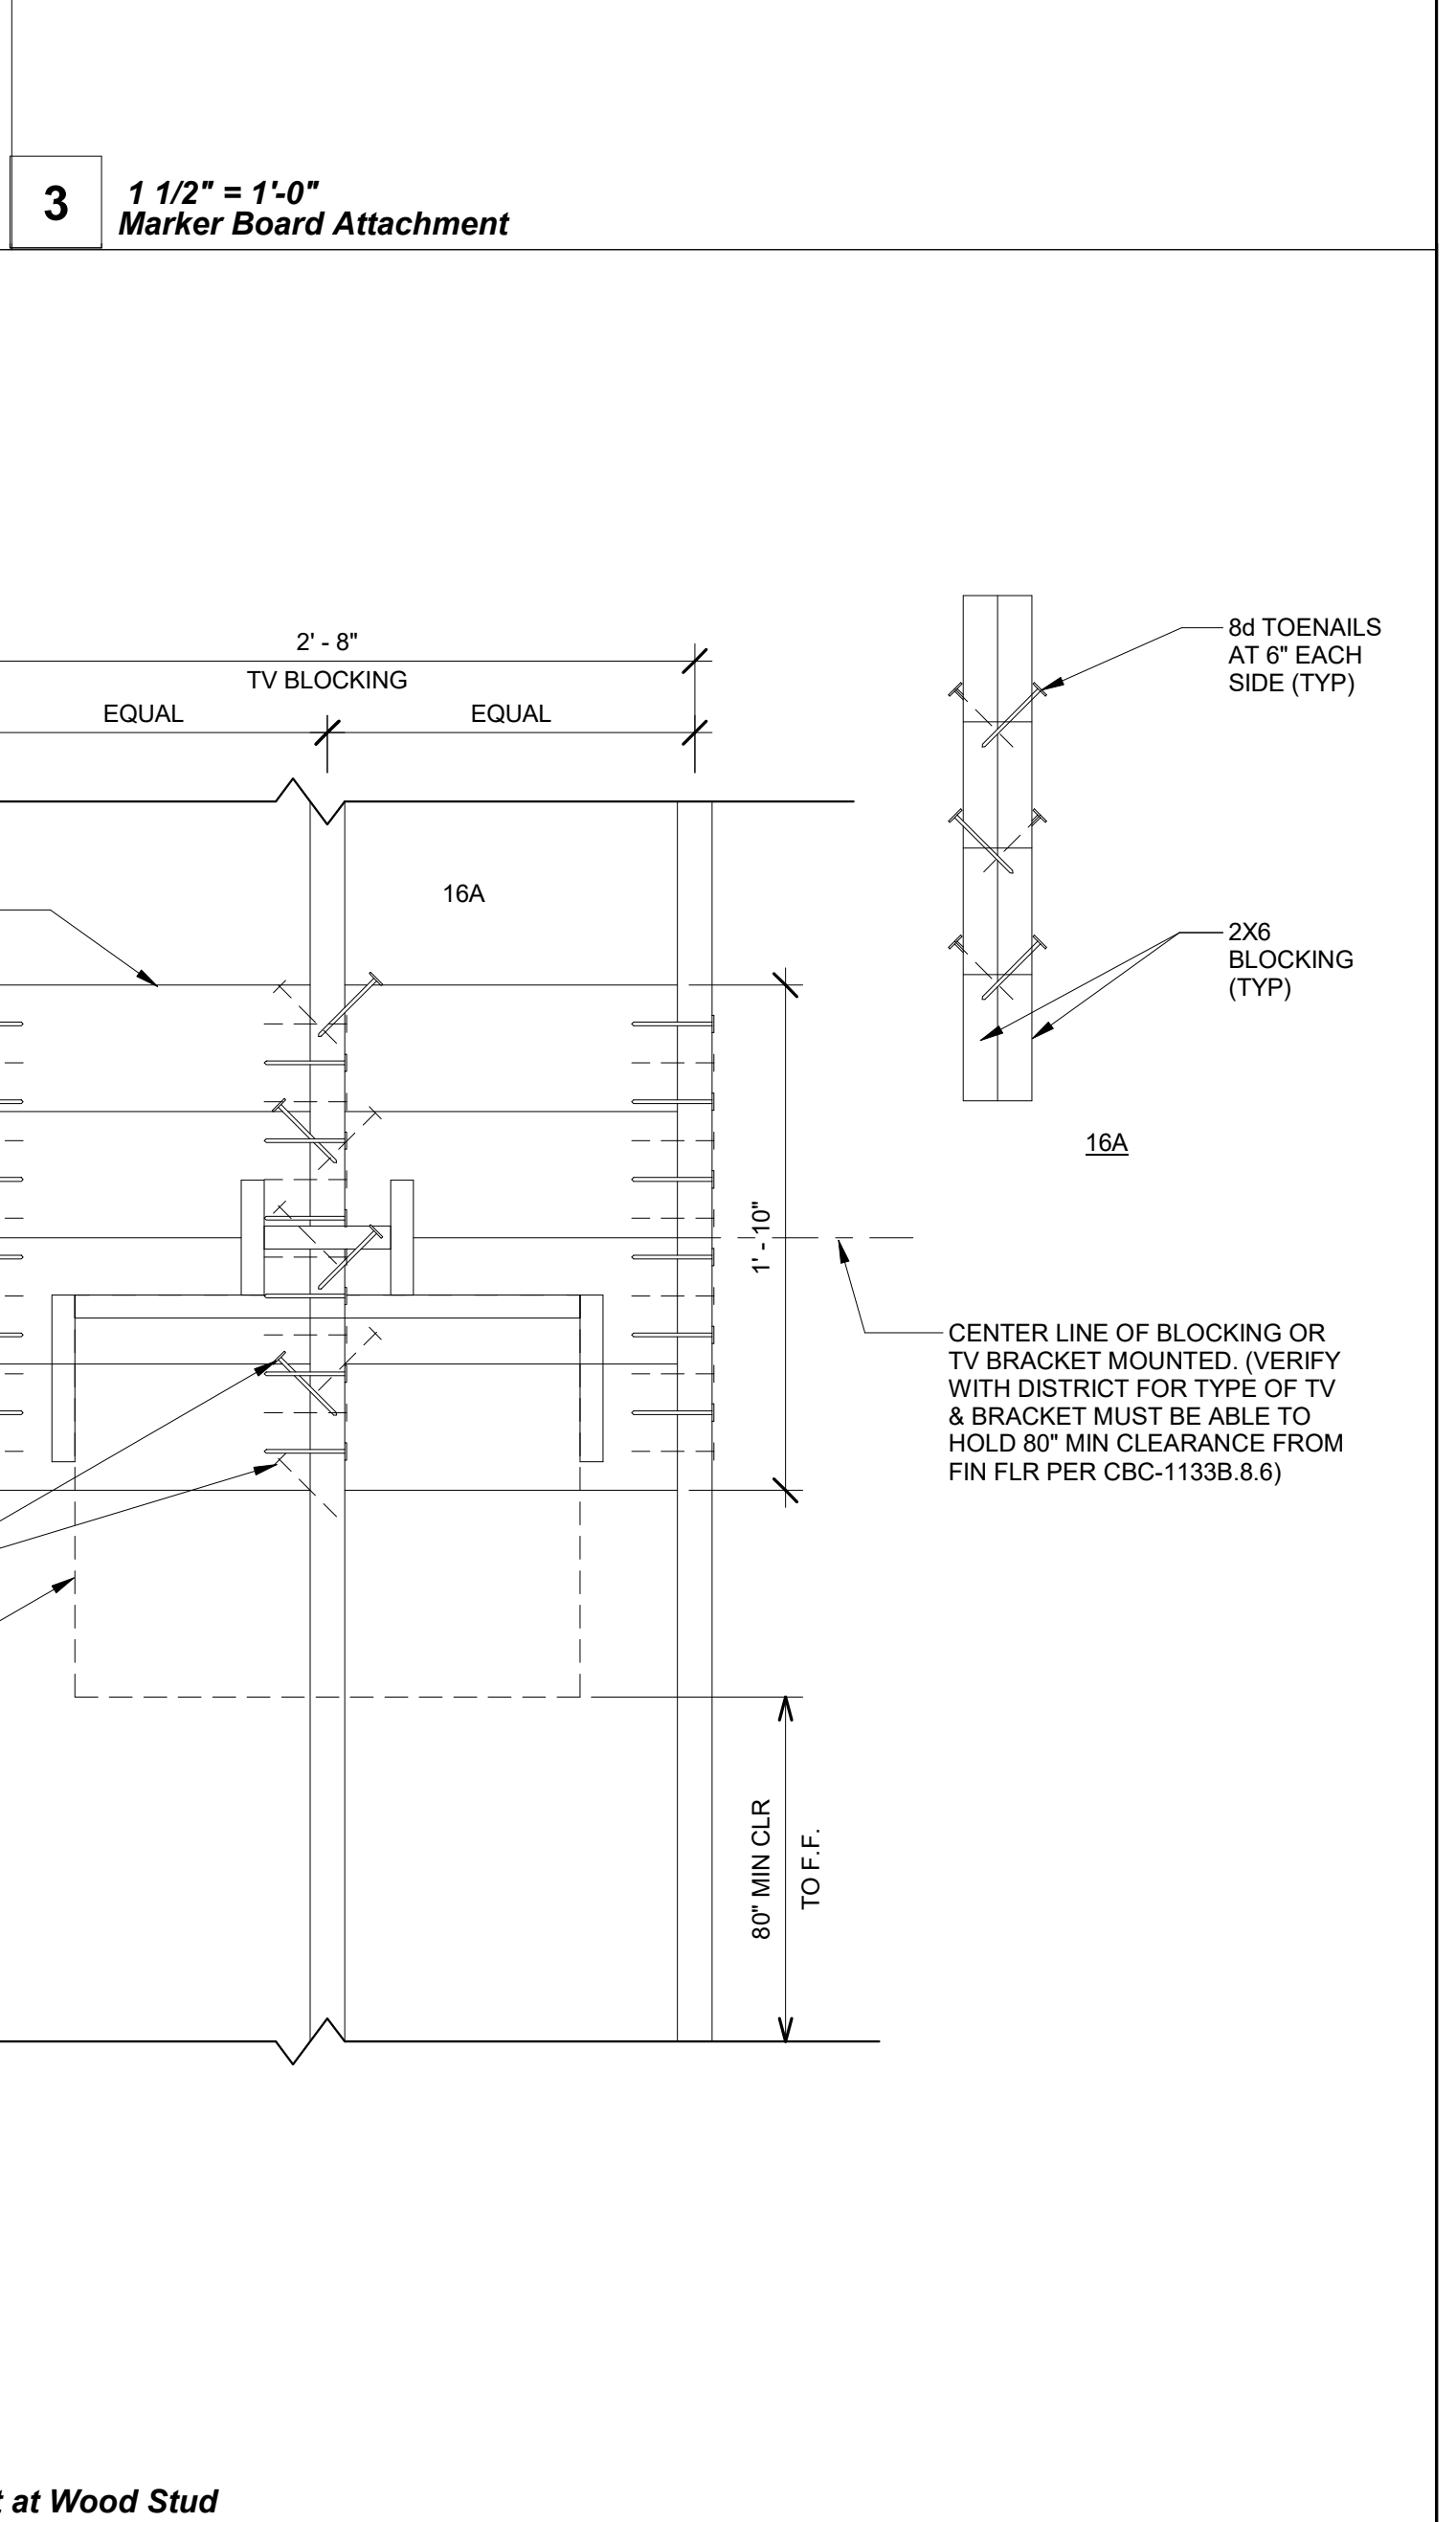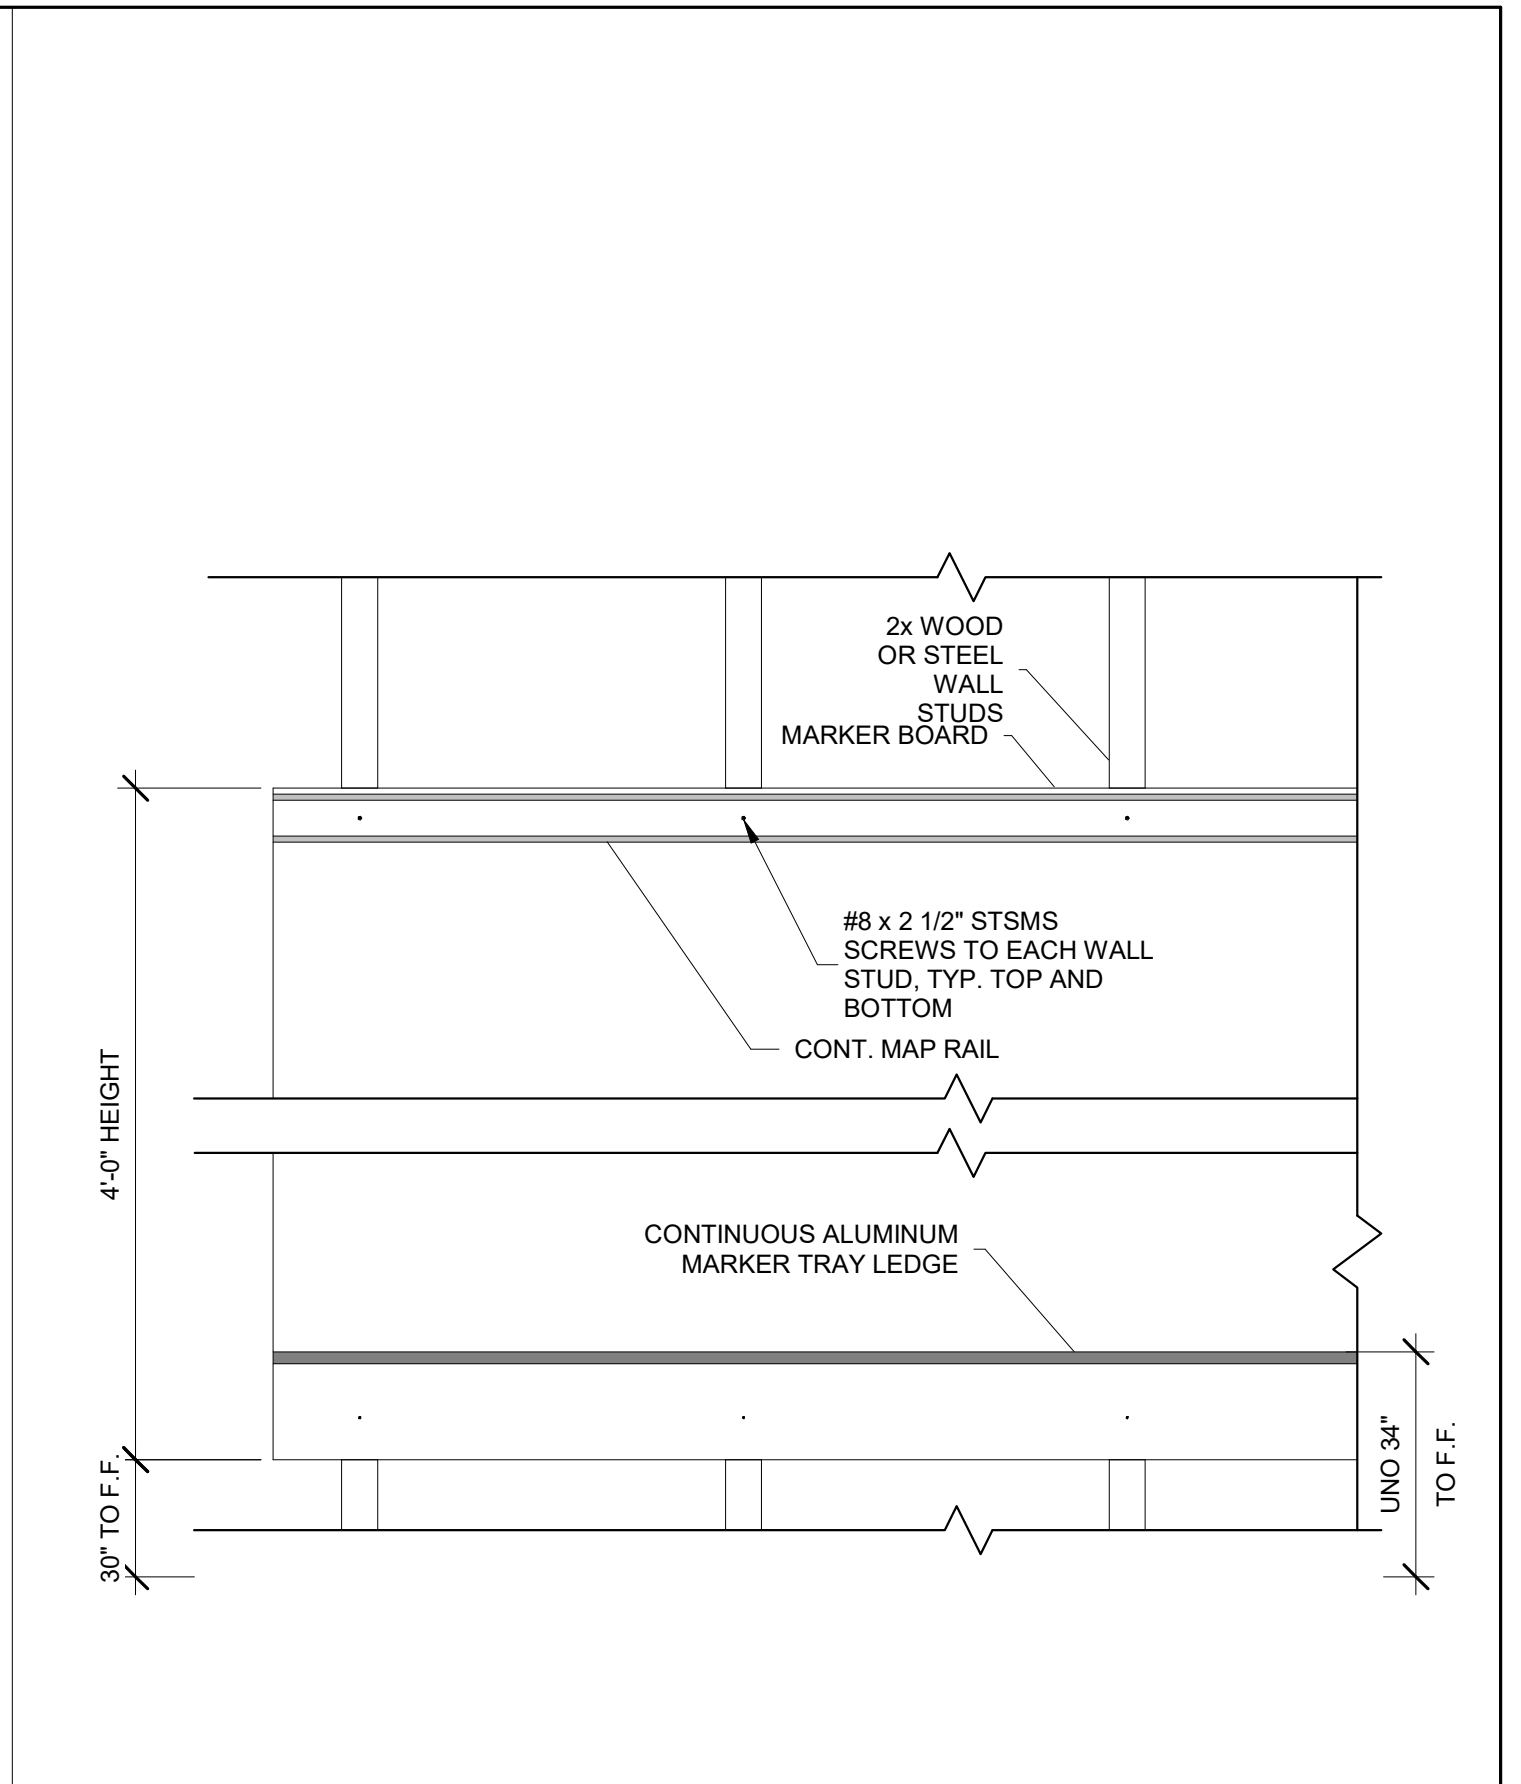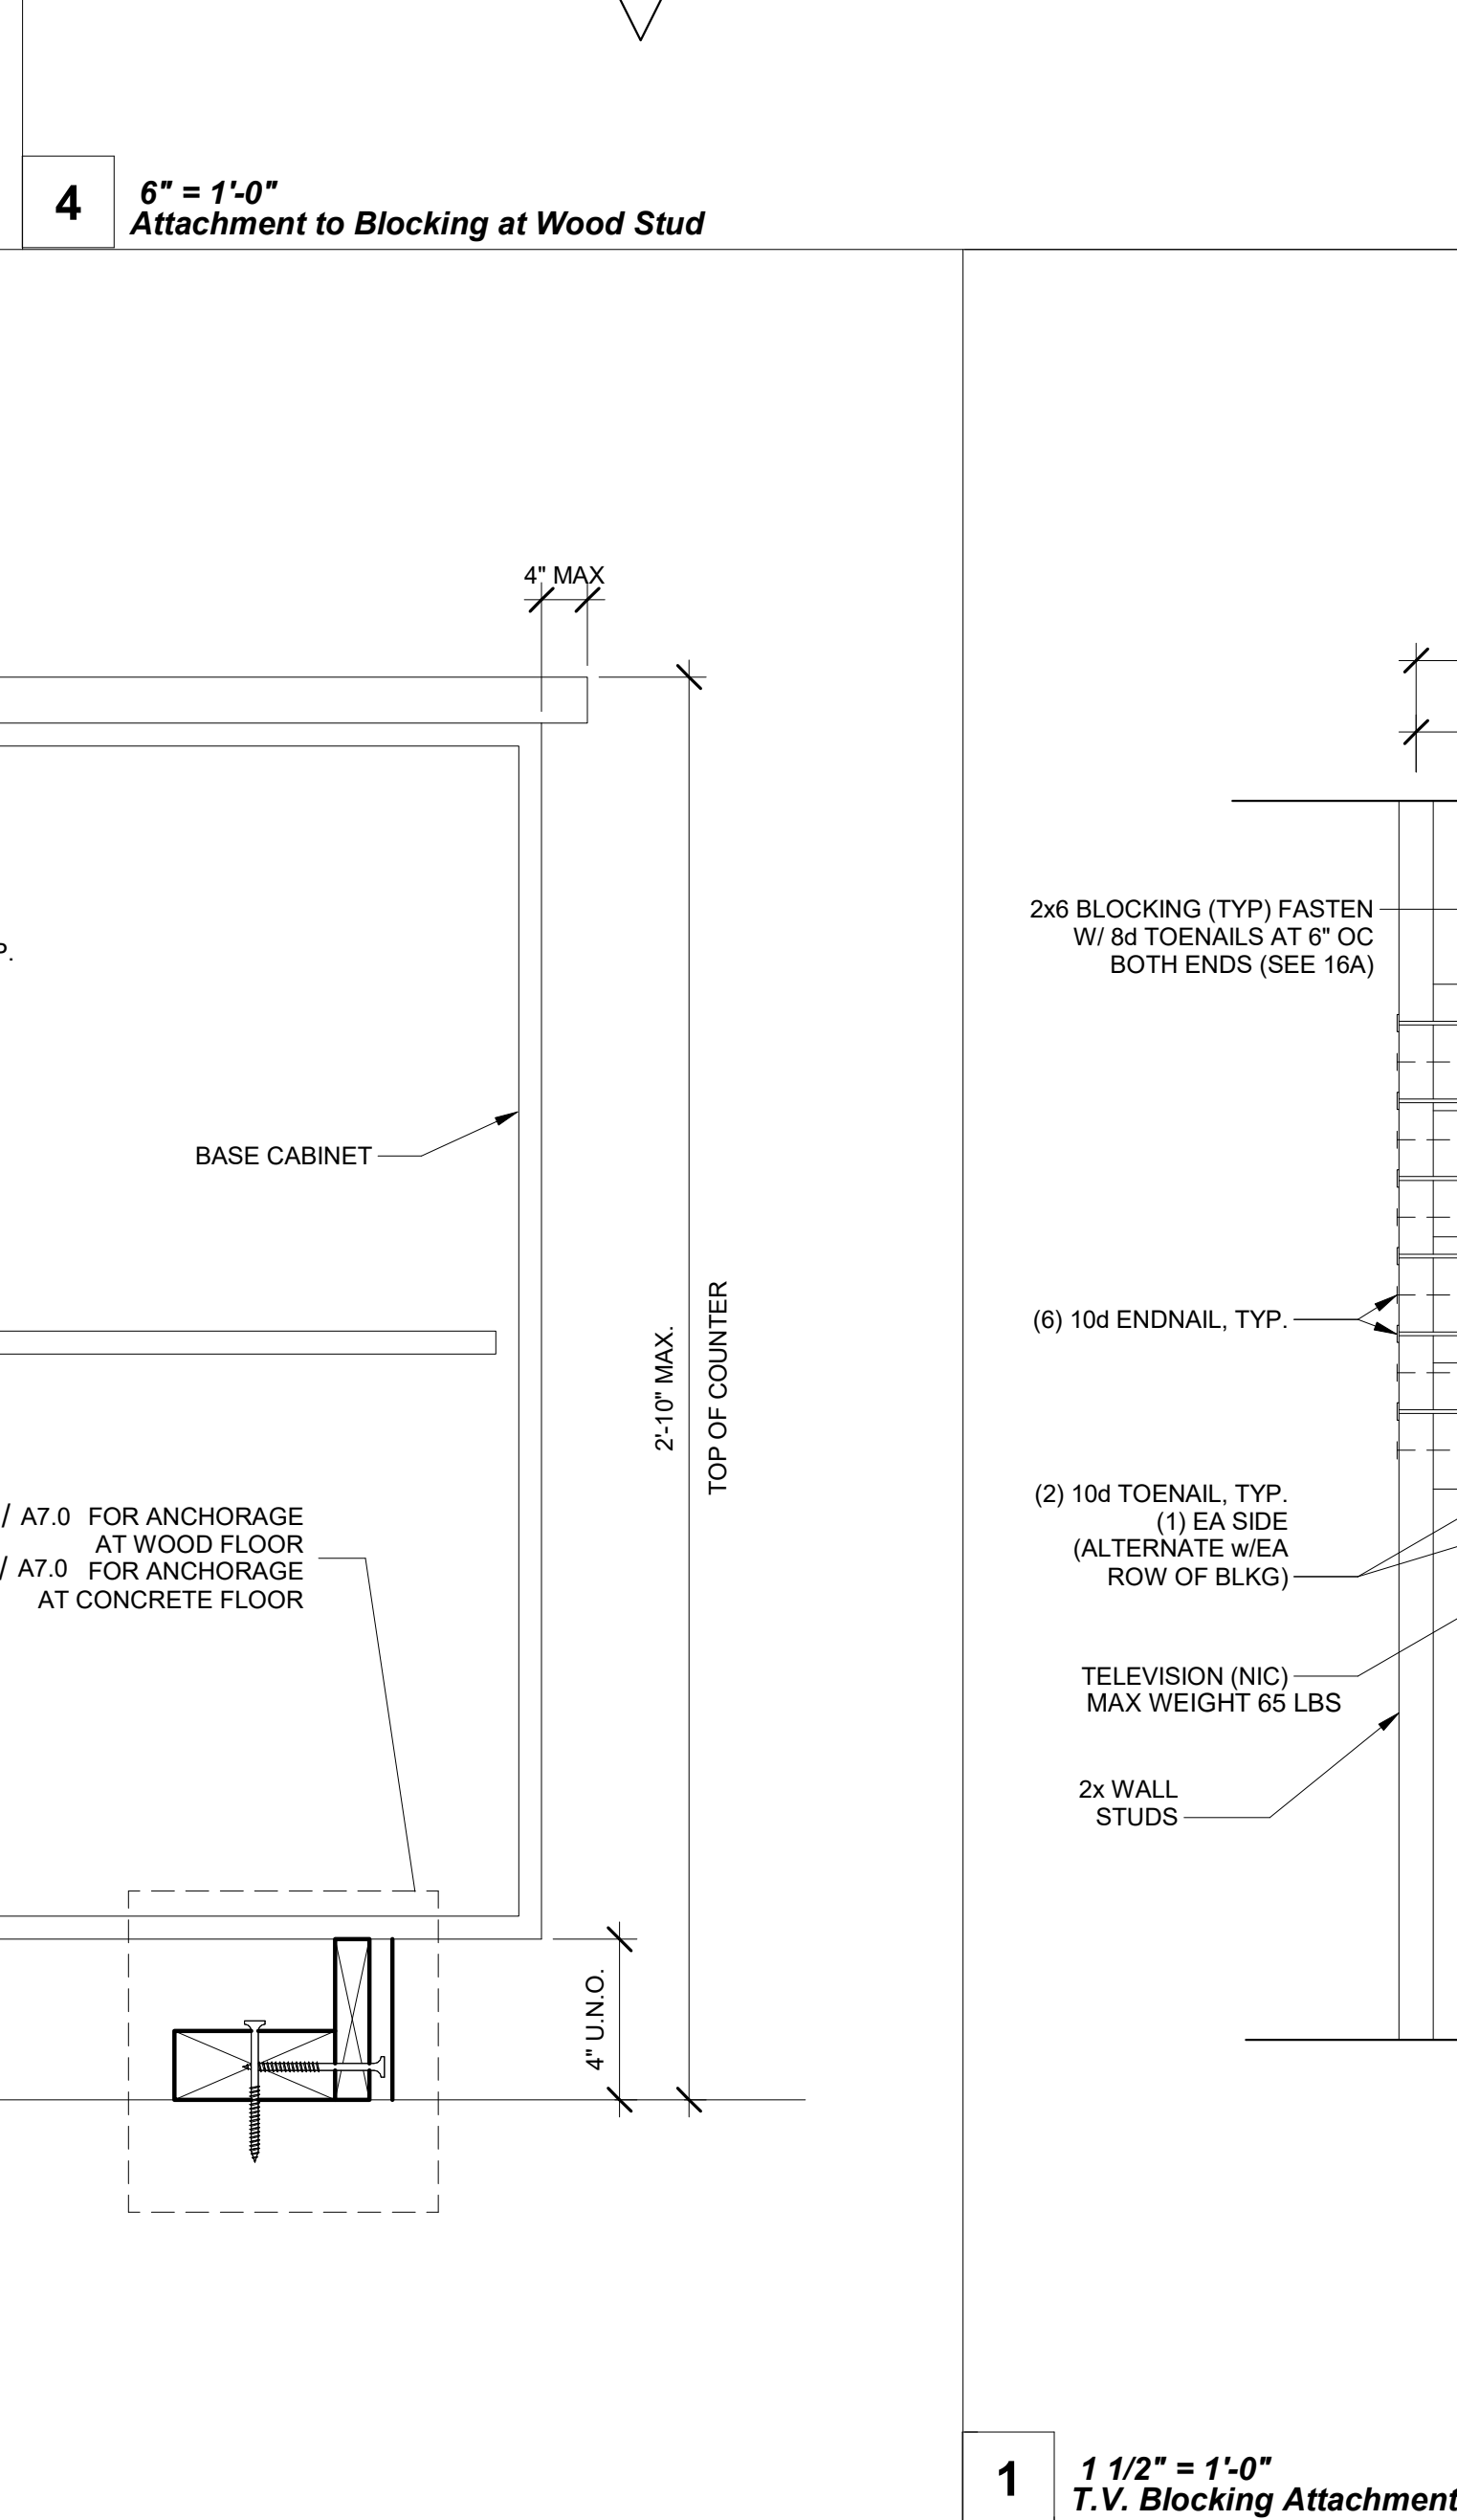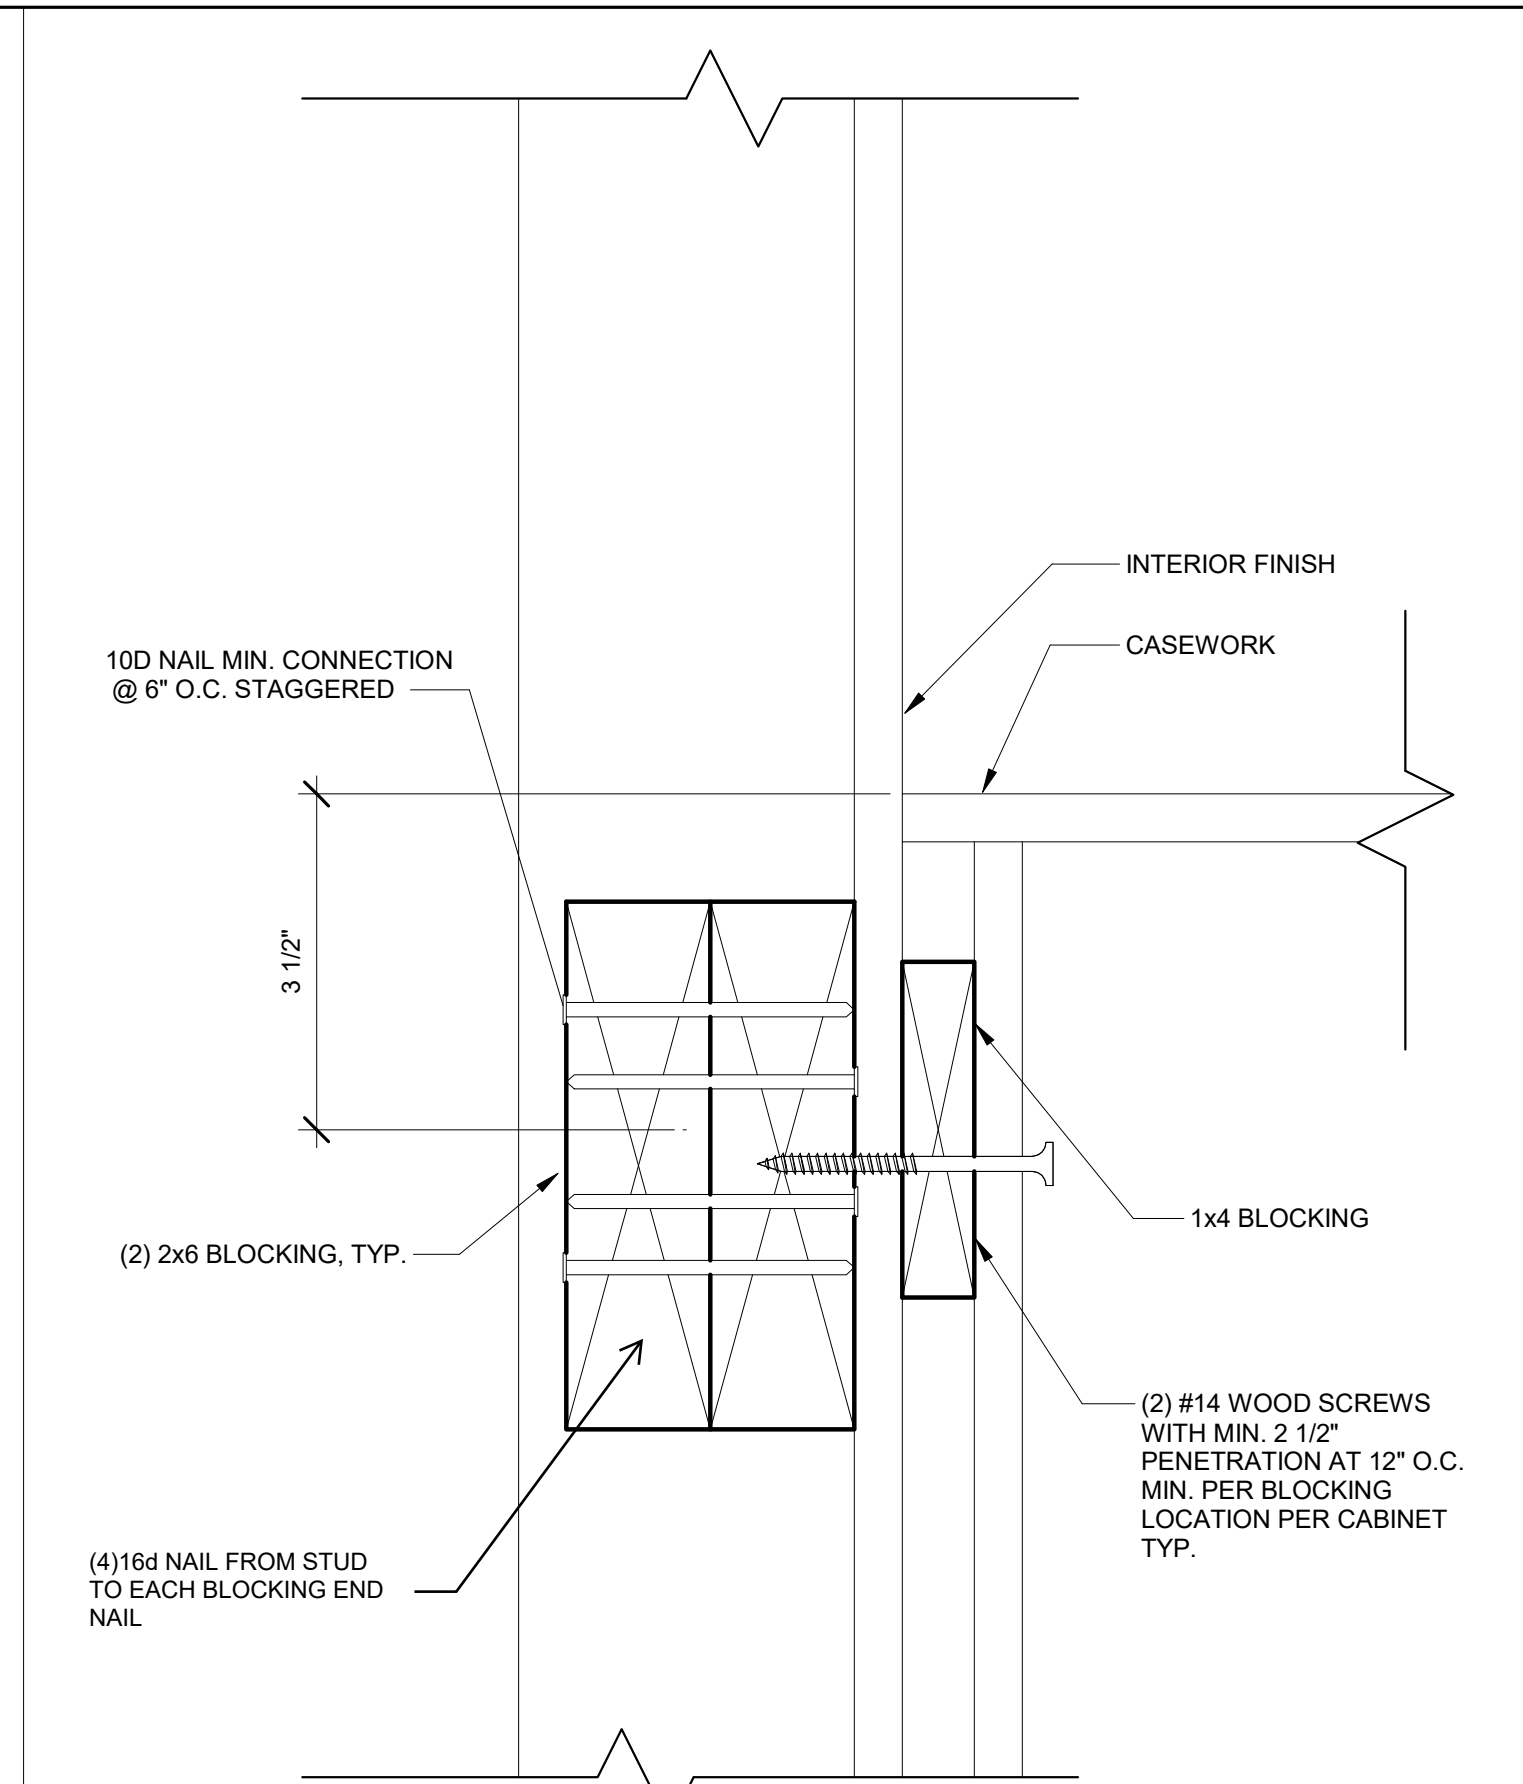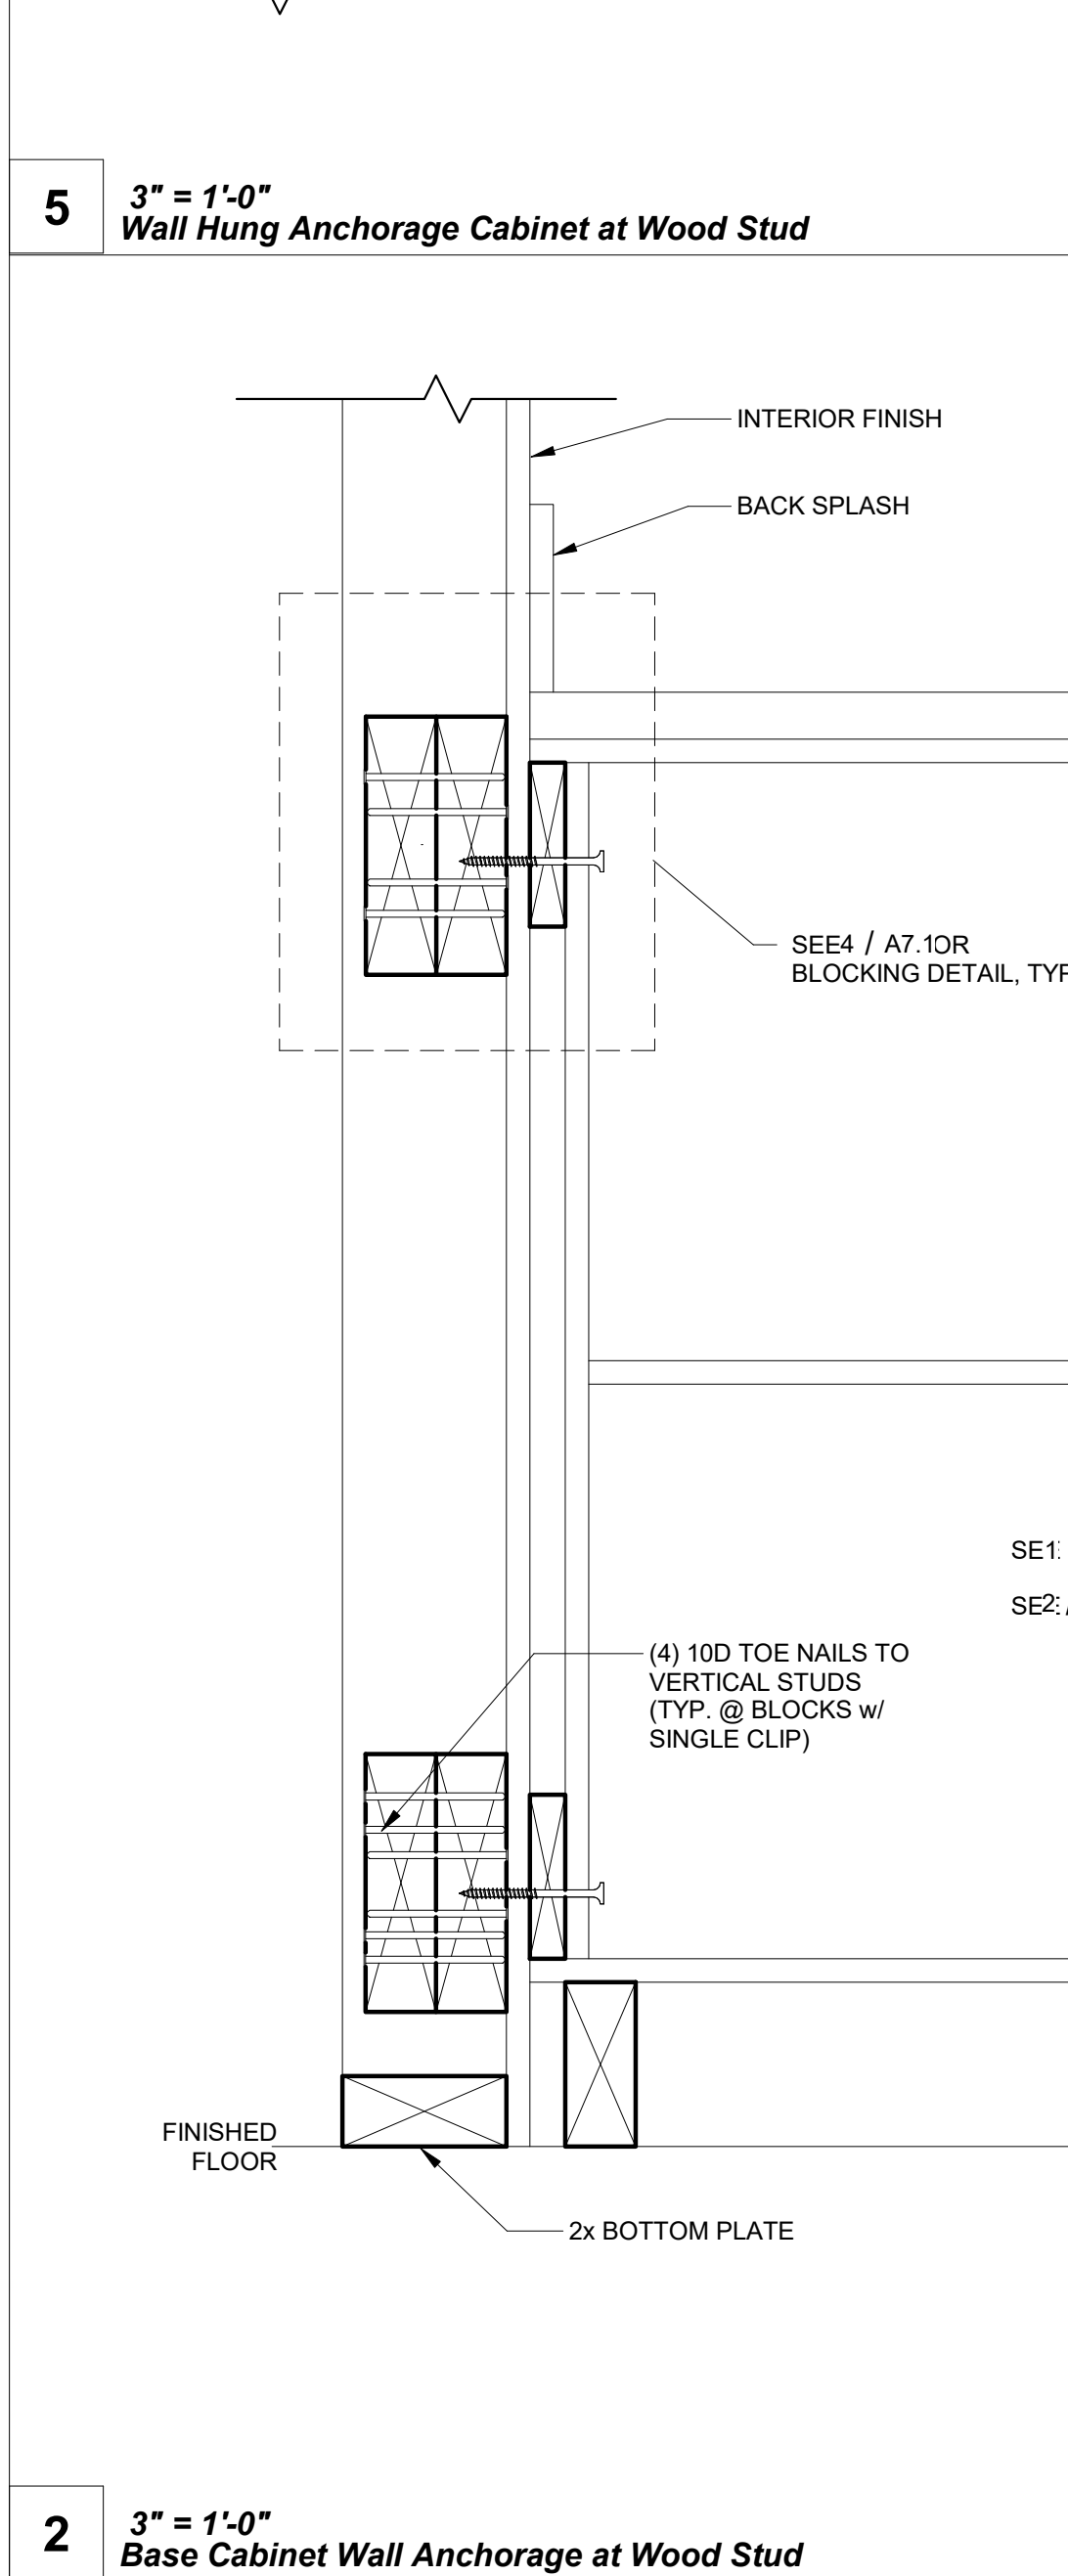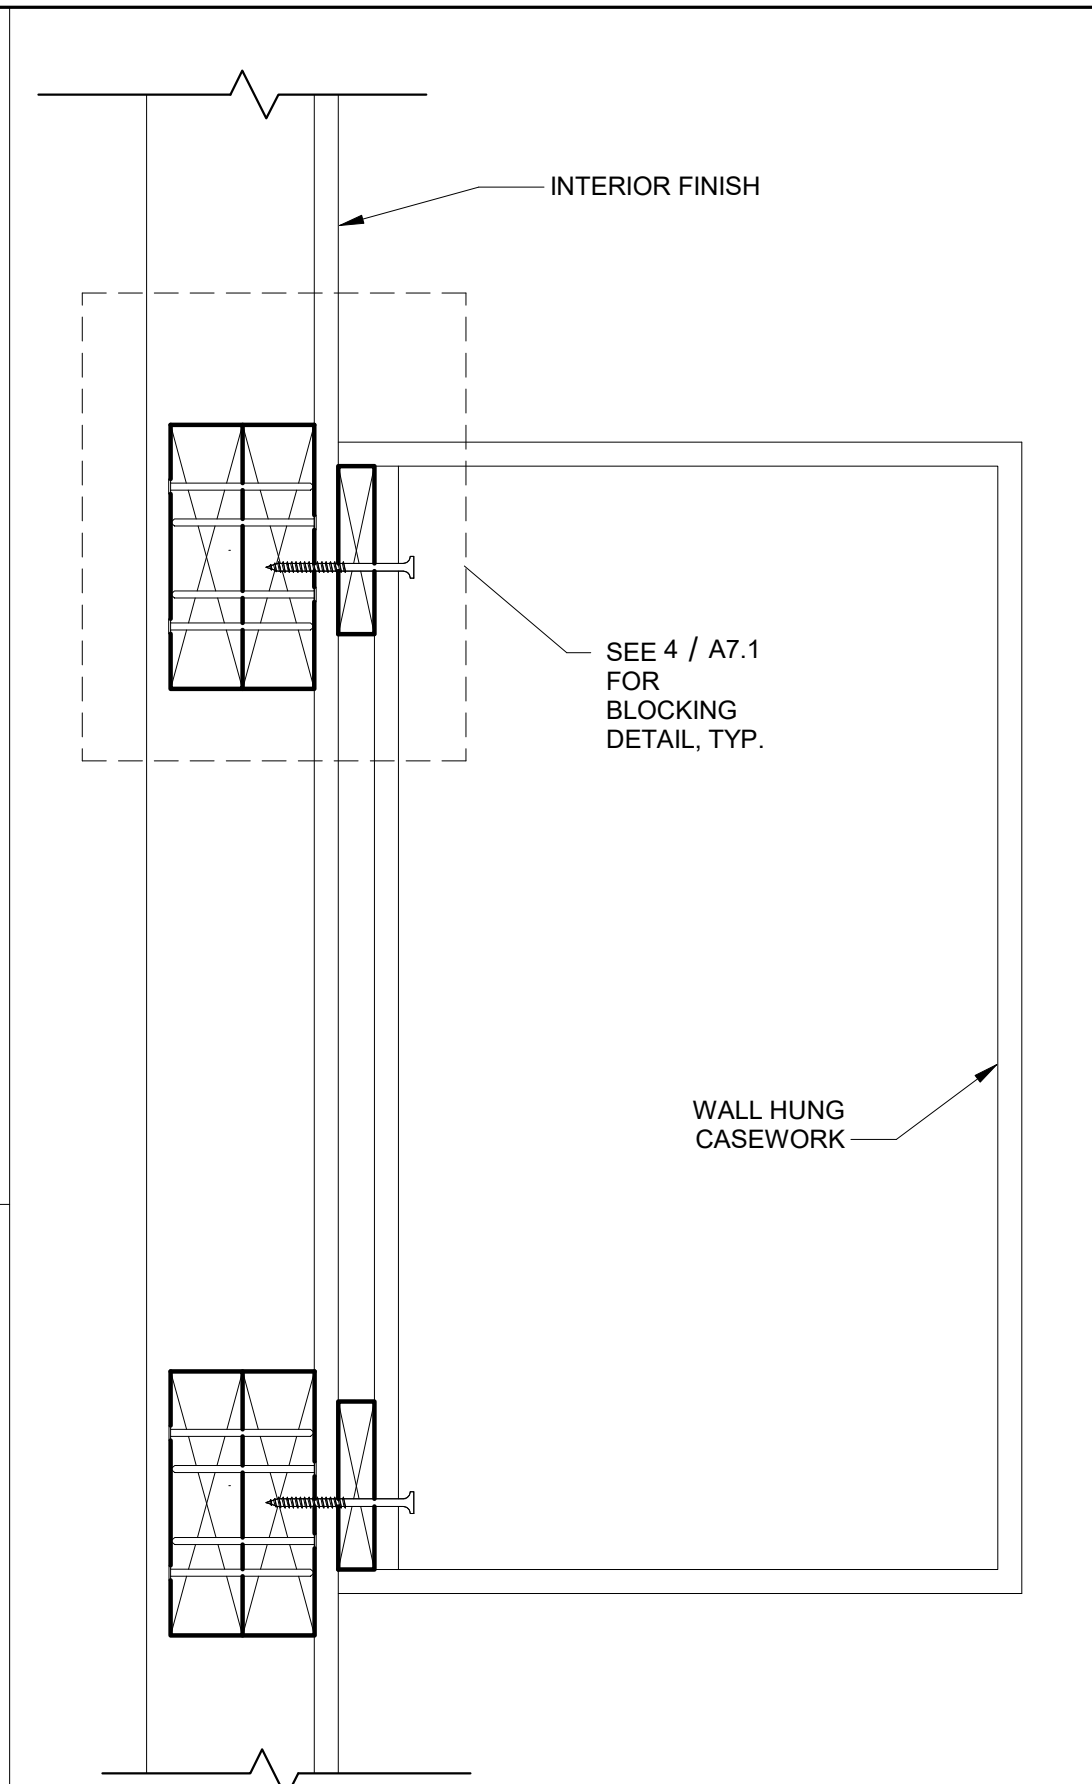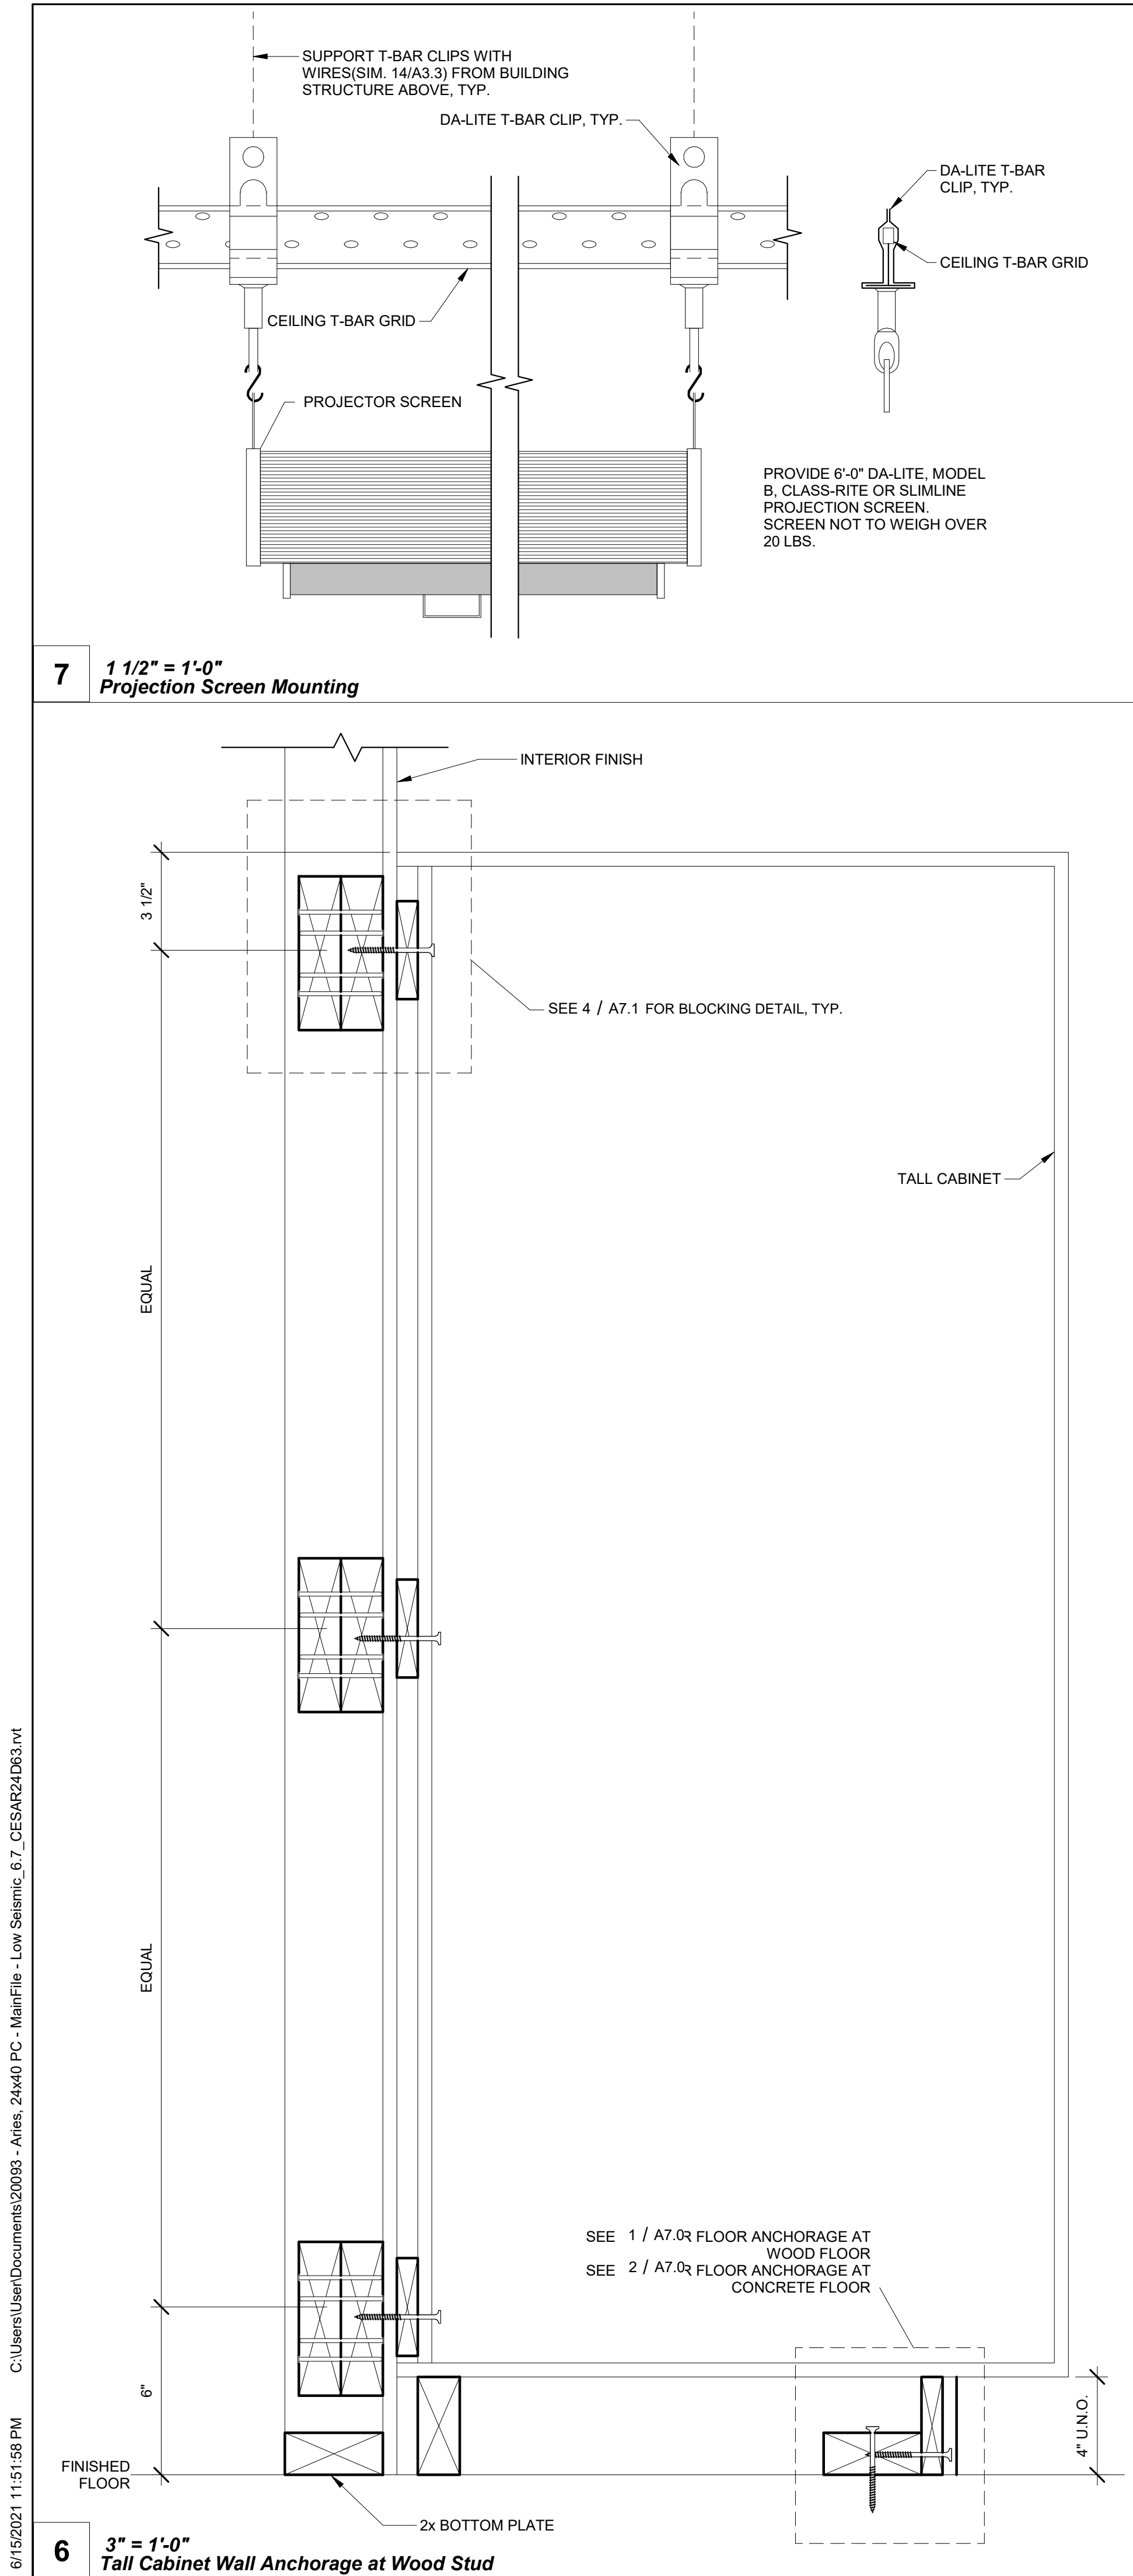

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-122690 INC:
REVIEWED FOR
SS [] PLS [] ACS []
DATE: 07/29/2024

R&S TAVARES ASSOCIATES
DESIGN & CONSULTING PROJECT MEET
11590 W BERNHARD COURT, SUITE 100
SAN DIEGO, CA 92127
WWW.RSTAVARES.COM

PROFESSIONAL STAMP
REGISTERED PROFESSIONAL ARCHITECT
MANNY D. FROST
P. 03380
03/31/24
STATE OF CALIFORNIA
02/16/24
RST#22088

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT
Class Leasing
1651 Juanita Street, San Jacinto, CA 92583
Voice (951) 943-1908 Fax (951) 943-5768

ORIGINAL PC STATE AGENCY APPROVAL

APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-123058 PC
REVIEWED FOR
SS [] PLS [] ACS [] CG []
DATE: 02/20/2024

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
ADDITIONAL
OPTION DETAILS








PROJECT NUMBER
22088

DRAWN BY
rMc/SC



CHECKED BY
RH/RT


DATE

SHEET NO.
A7.1
SHEET OF

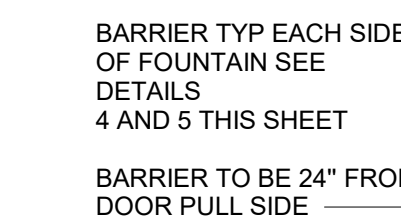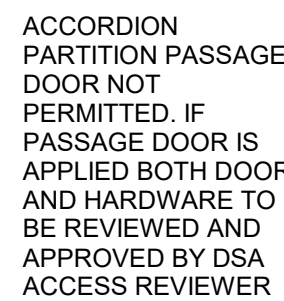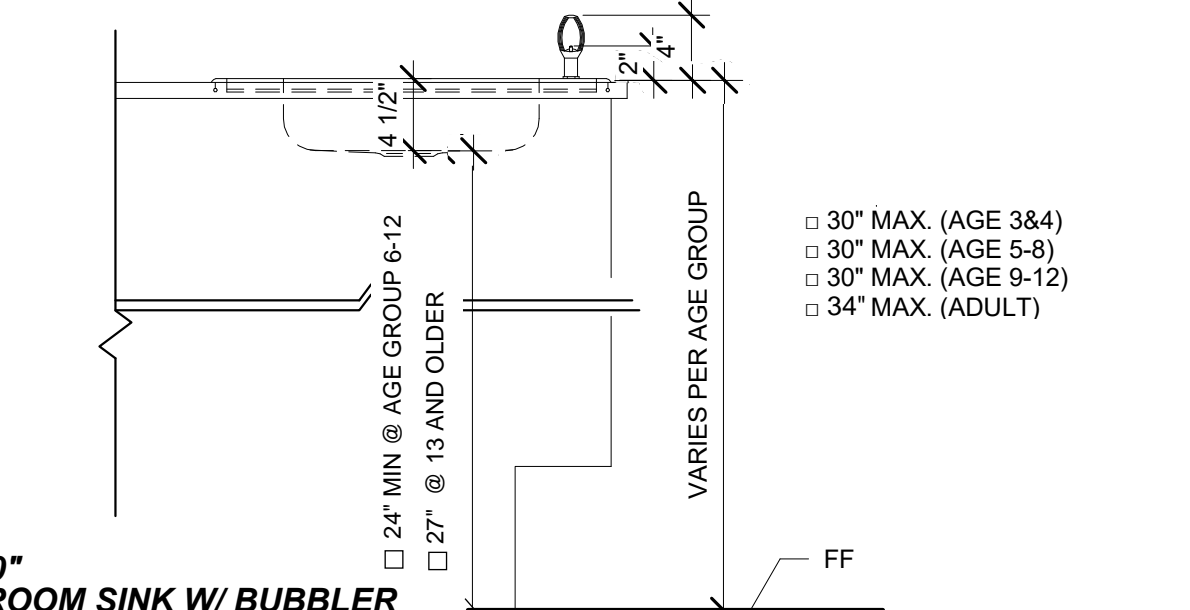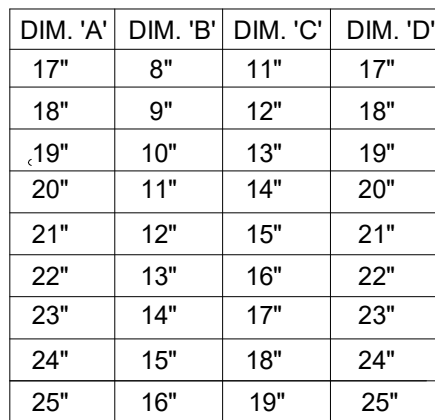


1. FINAL PRODUCT SELECTION IS OWNER RESPONSIBILITY.
2. MOUNTING REQUIREMENTS WILL VARY BY MANUFACTURER'S INSTALLATION INSTRUCTIONS
3. THE ELKAY SHEETS PROVIDED IN THIS SET ARE FOR EXAMPLE PURPOSES ONLY.
4. FINAL PRODUCT SELECTION MUST BE SUBMITTED ALONG WITH SITE SPECIFIC CONSTRUCTION APPLICATION FOR REVIEW
5. MOUNTING HARDWARE SHALL PROVIDE A MINIMUM OF 2" PENETRATION INTO WOOD FRAMING

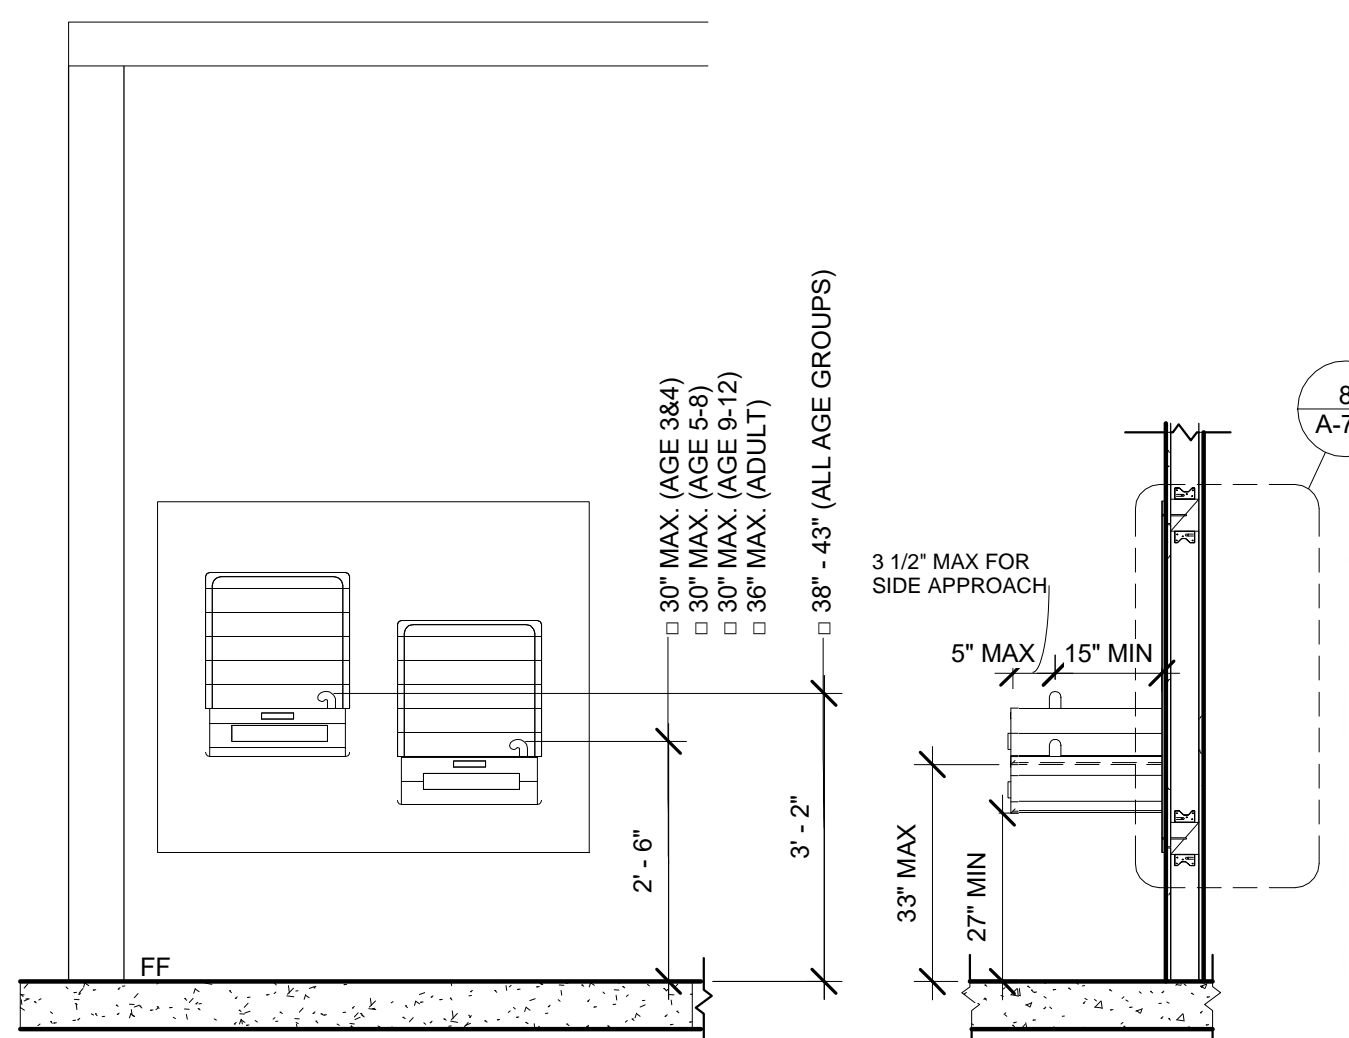

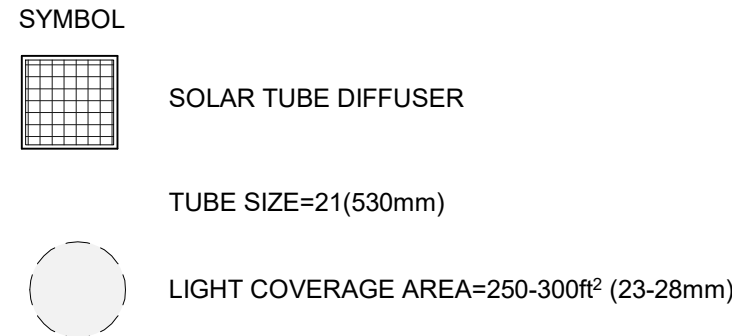


NOTE: PROVIDE A MINIMUM OF 72 SF SOLAR READY AREA PER MODULE. AREA TO BE A MINIMUM OF 5' IN ANY DIRECTION WITH A MINIMUM SPACE OF 80 SF PER BUILDING.

MULTI-LEVEL SWITCHING IS REQUIRED FOR AREAS GREATER THAN 100SF. SWITCHES WIRED SO THAT INTERIOR LIGHTING CAN BE TURNED FULLY ON, HALF OFF, OR COMPLETELY OFF. ALL MULTI-LEVEL SWITCHES ARE EQUIPPED WITH A SLIDE FOR CONTINUOUS DIMMING.

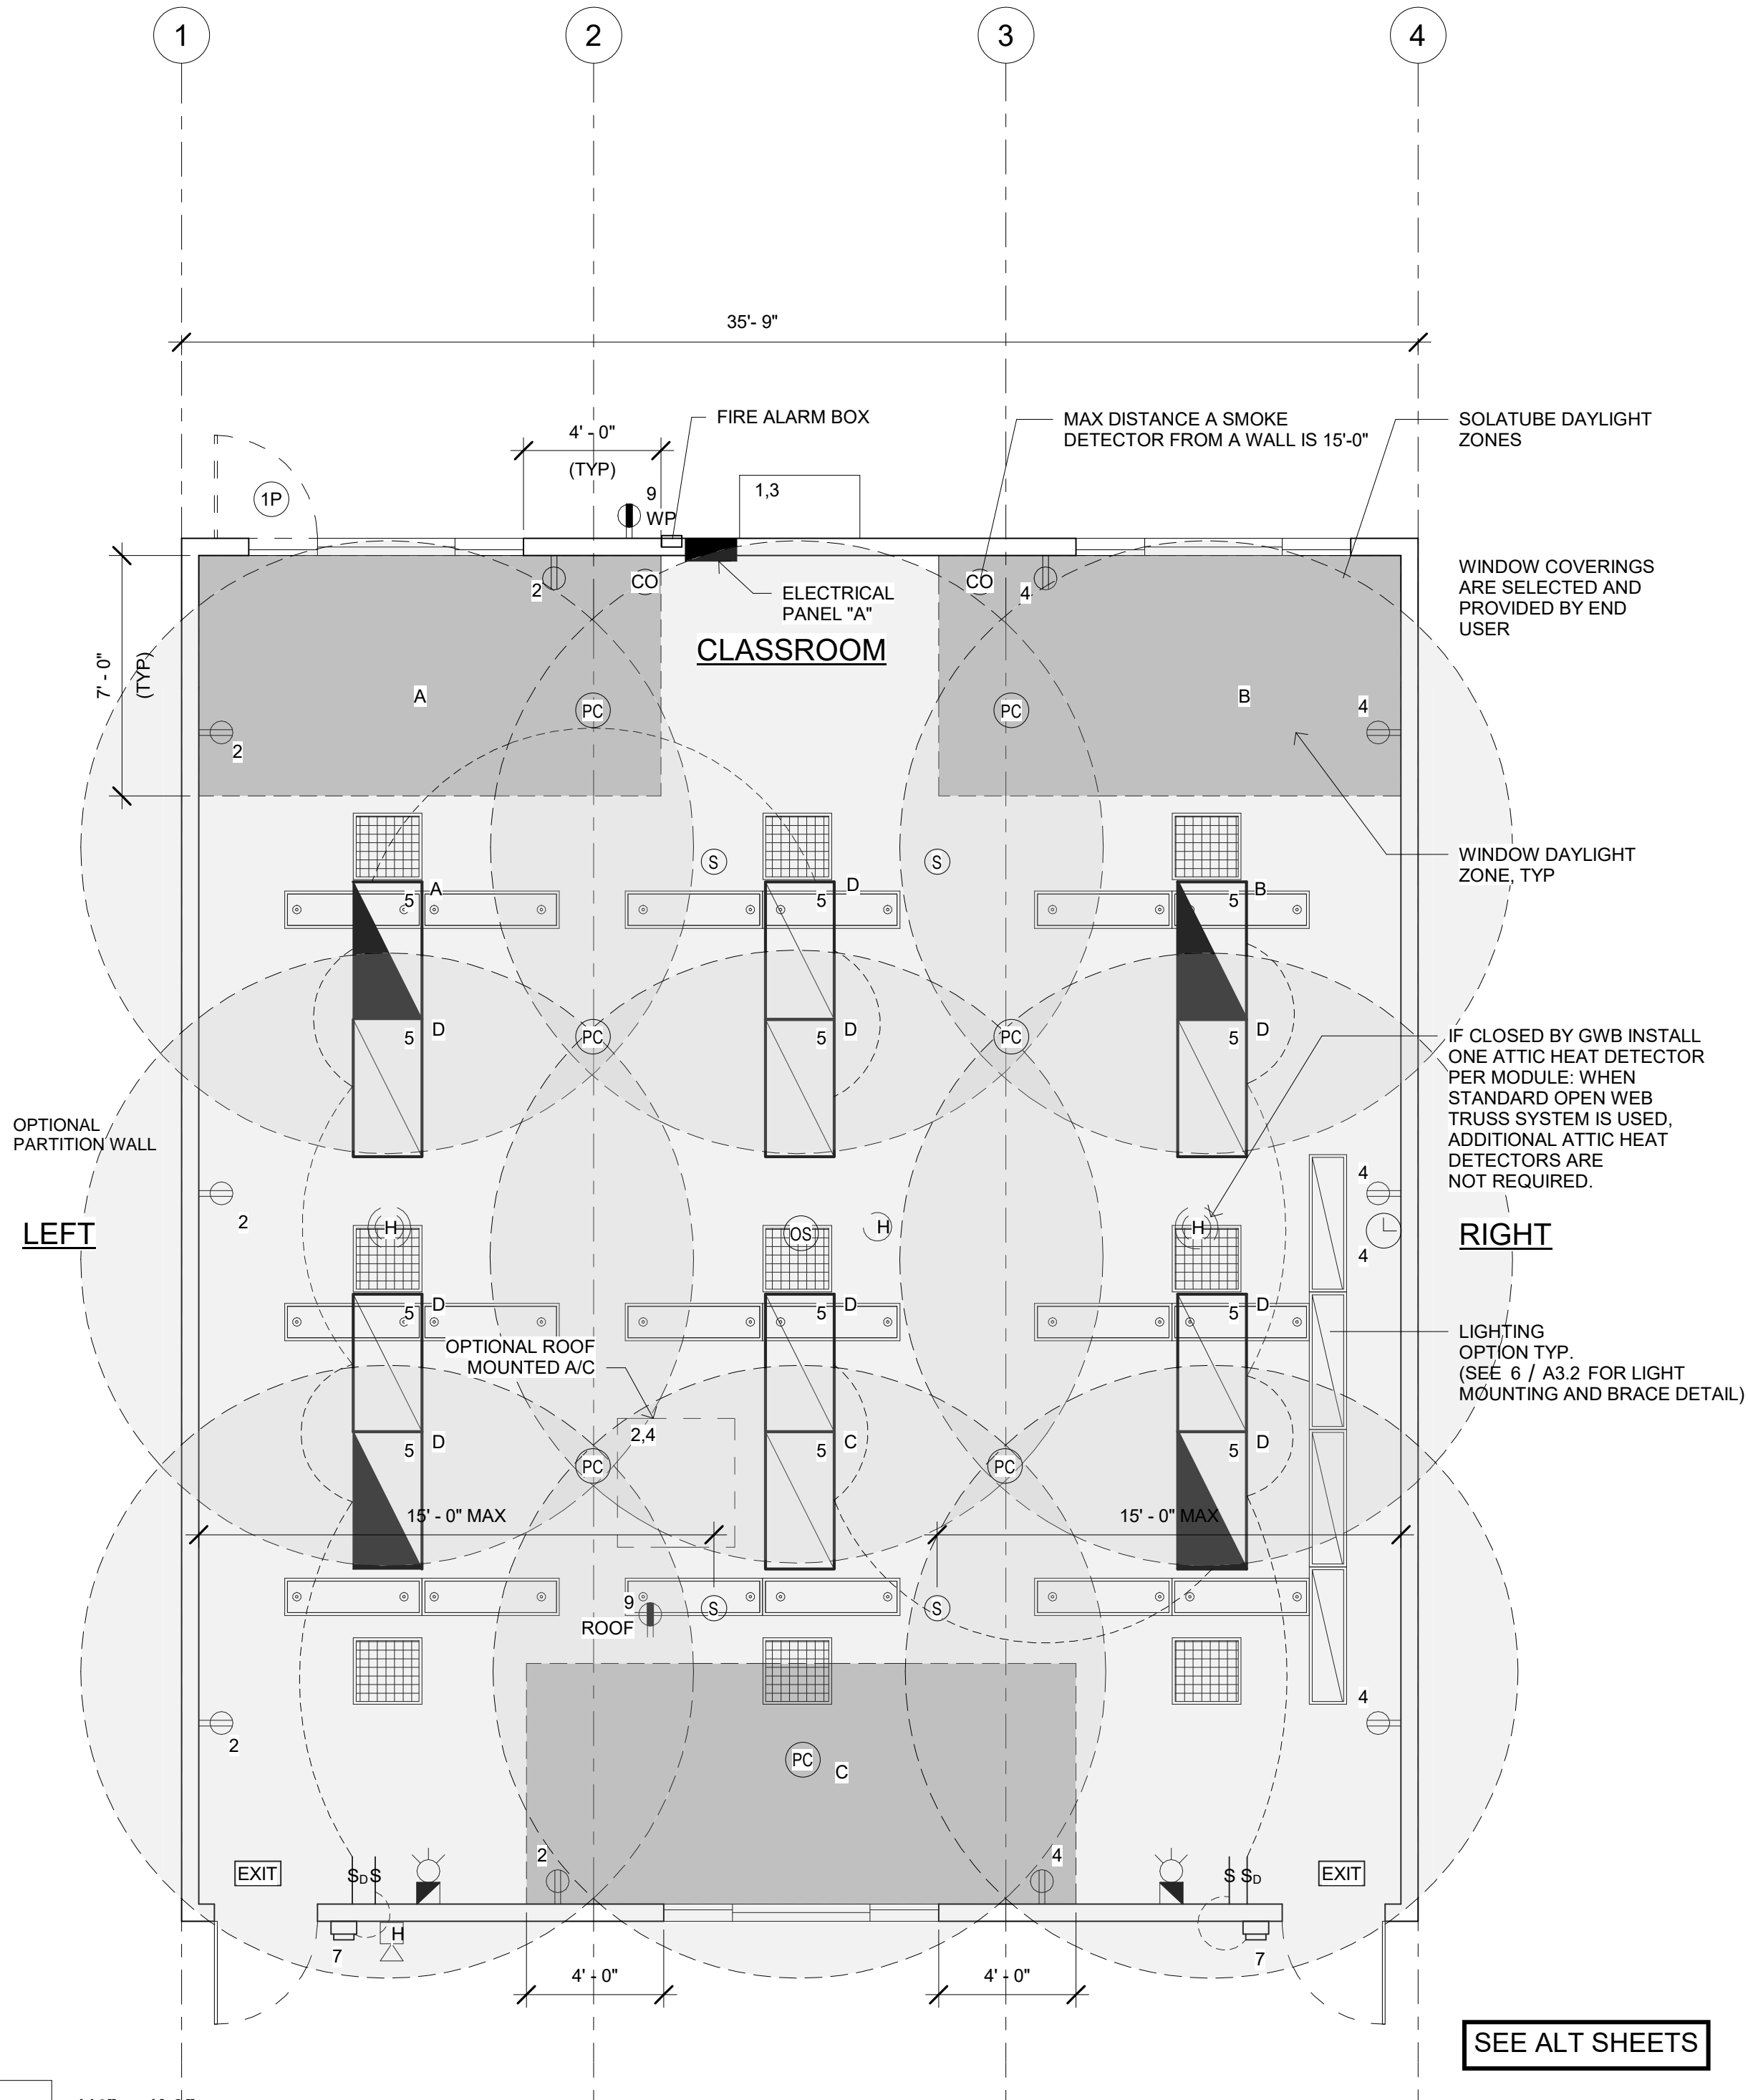


1 1/4" = 1'-0" ELECTRICAL PLAN

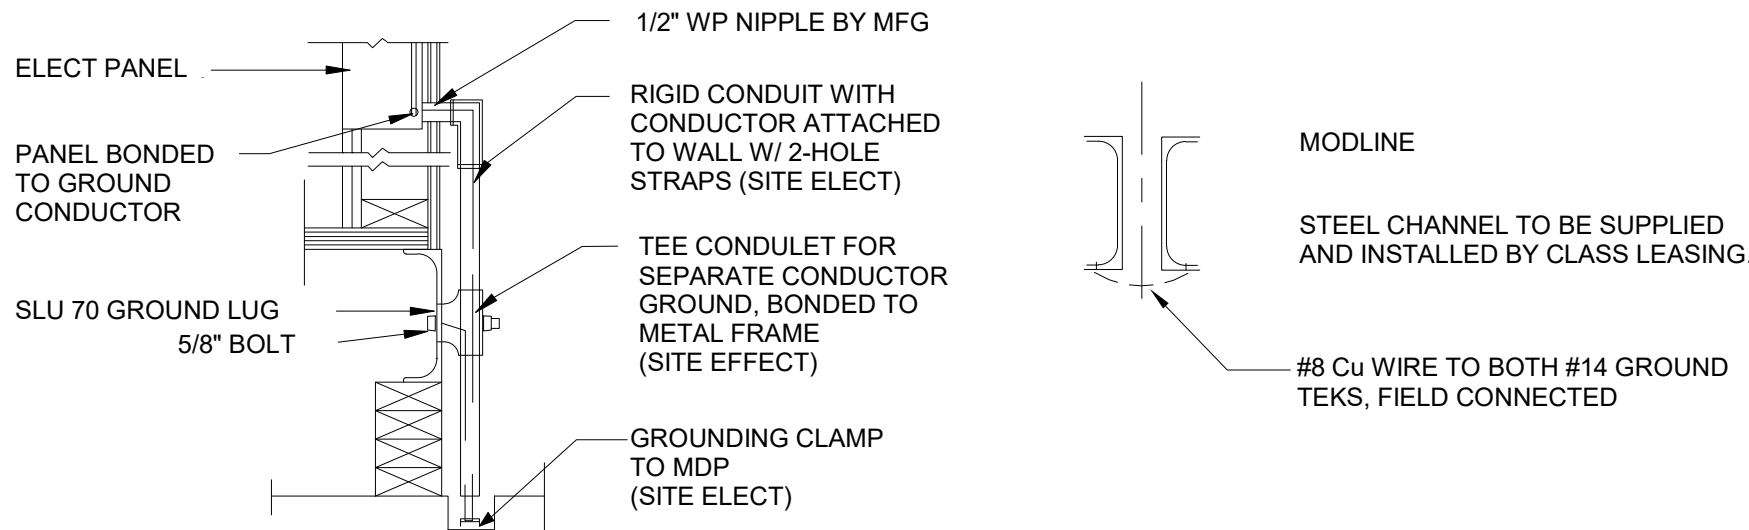


NOTES:


- BOND SEPARATE CONDUCTORS FROM GROUND ROD TO ELEC'L. PANEL & TO METAL BUILDING FRAME (CEC 250.52) IN ADDITION TO THE DETAIL SHOWN ABOVE. BOND THE ELECTRICAL GROUND TO METAL UNDERGROUND WATER PIPE IN DIRECT CONTACT WITH THE EARTH FOR 10 FT. OR MORE, IF AVAILABLE (CEC 250.52)
- CHECK RESISTANT TO GROUND ROD. IF RESISTANCE EXCEEDS 25 OHMS, INSTALL ADDITIONAL GROUND RODS WITH CONDUCTORS AS SHOWN SEPARATED AT LEAST 6'-0" UNTIL RESISTANCE IS REDUCED TO 25 OHMS OR LESS (CEC 250.56).
- ELEC. TRADE SHALL CHECK AREA FOR EXISTING CONDUITS, SEWER, GAS & WATER PIPING BEFORE DRIVING GROUND RODS.
- ALL MODULES OF STEEL FRAME BLDGS. SHALL BE ELECTRICALLY BONDED TOGETHER (BOLTING ONLY IS NOT ACCEPTABLE BONDING). BONDING SHALL INCLUDE METAL RAMP & STAIRS.
- SIZE OF CONDUCTORS SHALL COMPLY WITH CEC TABLE 250.66

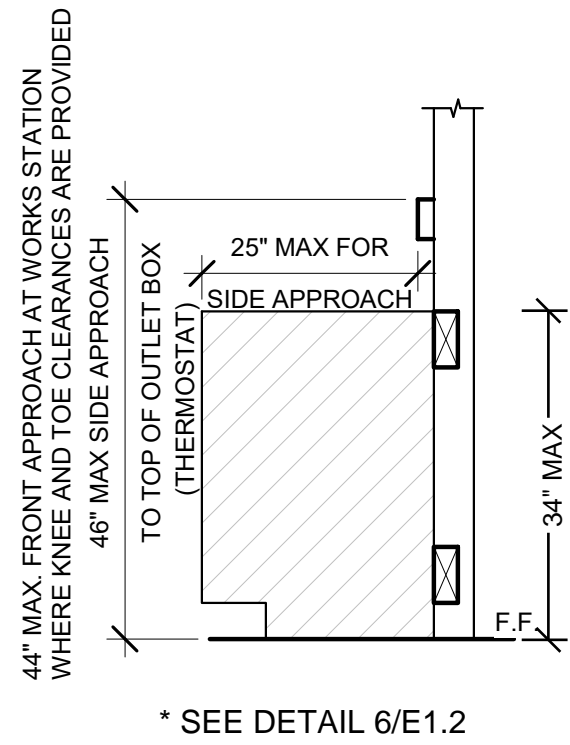

3 1" = 1'-0" ELEV. @ WORKSTATION

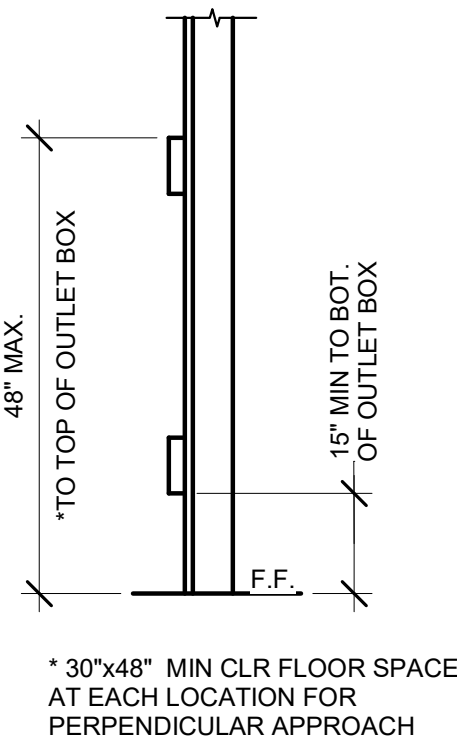

4 1" = 1'-0" MOUNTING ELEV.

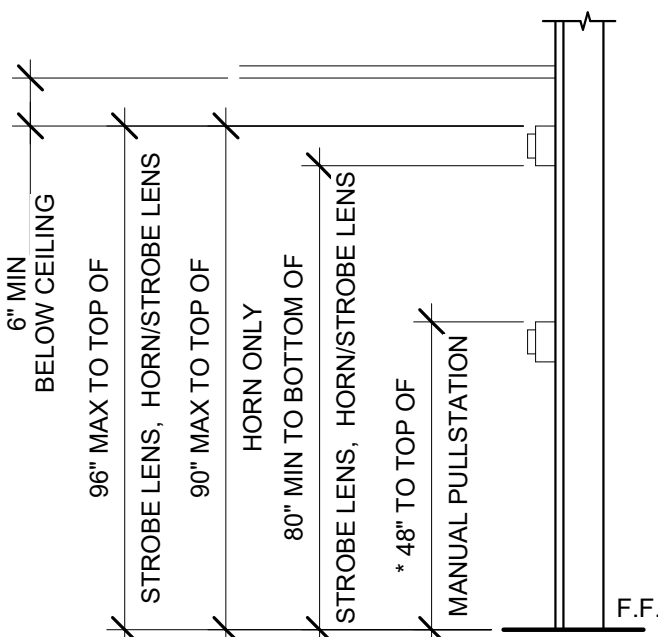

THE SWITCH OR SWITCHES INSTALLED IN EMERGENCY LIGHTING CIRCUITS SHALL BE SO ARRANGED THAT ONLY AUTHORIZED PERSONNEL WILL HAVE CONTROL OF EMERGENCY LIGHTING. (CEC art. 700.20)



5 1" = 1'-0" FIRE ALARM MOUNTING HEIGHTS

GENERAL GROUNDING NOTES

EACH BUILDING SHALL BE GROUNDED SEPARATELY WITH A 3/4" ROUND X 8 FEET COPPERCLAD STEEL GROUND ROD. WHERE ROCK BOTTOM IS FOUND, DRIVE ROD AT 45 DEGREES MAXIMUM FROM THE VERTICAL OR HAVE IT BURIED IN A TRENCH 30" DEEP MINIMUM.

TESTING FOR RESISTANCE TO GROUND, IF RESISTANCE EXCEEDS 25 OHMS INSTALL ADDITIONAL GROUND RODS SEPARATED AT LEAST 6 FEET, UNTIL RESISTANCE REDUCES TO 25 OHMS OR LESS. GROUND TEST MUST BE DONE IN THE PRESENCE OF THE PROJECT INSPECTOR AND ALL GROUNDING SHALL BE IN ACCORDANCE WITH CEC ARTICLE 250

Figure 308.2.2 Obstructed High Forward Reach

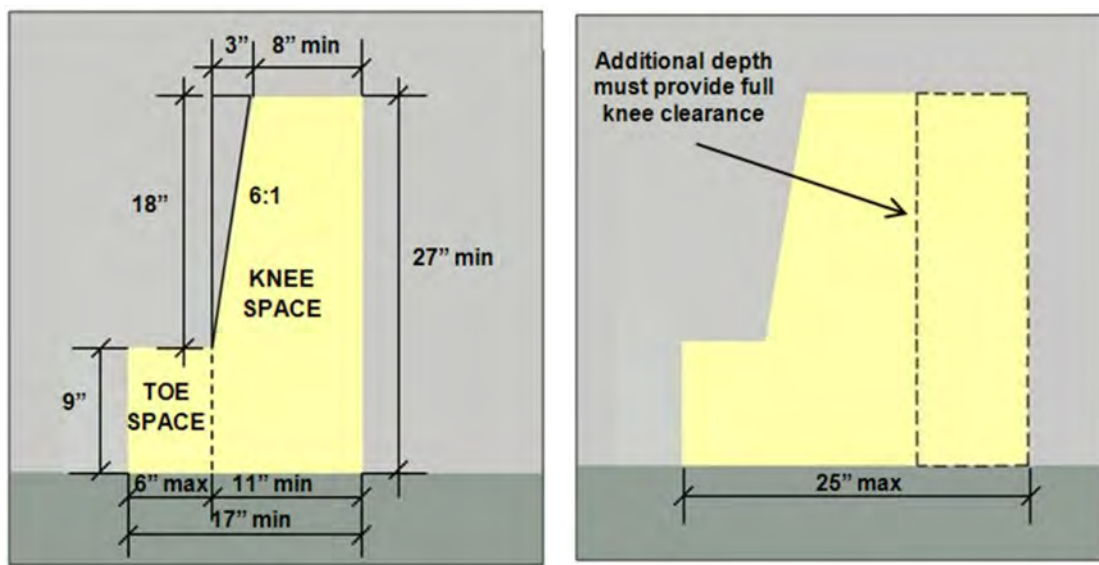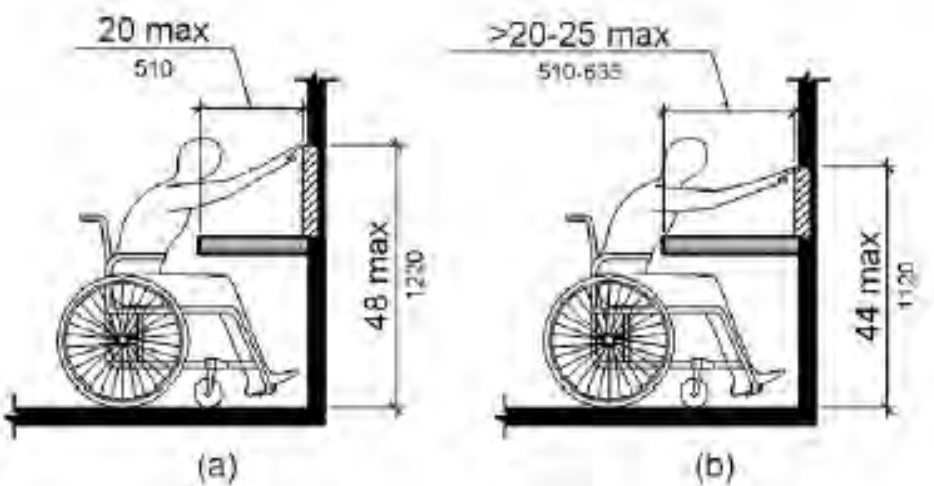

6 TOE SPACE CLEARANCE

MEP COMPONENT ANCHORAGE NOTE

ALL MECHANICAL, PLUMBING, AND ELECTRICAL COMPONENTS SHALL BE ANCHORED AND INSTALLED PER THE DETAILS ON THE DSA-APPROVED CONSTRUCTION DOCUMENTS. THE FOLLOWING COMPONENTS SHALL BE ANCHORED OR BRACED TO MEET THE FORCE AND DISPLACEMENT REQUIREMENTS PRESCRIBED IN THE 2022 CBC SECTIONS 1617A.1.18 THROUGH 1617A.1.26 AND ASCE 7-16 CHAPTERS 13, 26, AND 30:

- ALL PERMANENT EQUIPMENT AND COMPONENTS.
- TEMPORARY, MOVABLE OR MOBILE EQUIPMENT THAT IS PERMANENTLY ATTACHED (E.G., HARD WIRED) TO THE BUILDING UTILITY SERVICES SUCH AS ELECTRICITY, GAS OR WATER. "PERMANENTLY ATTACHED" SHALL INCLUDE ALL ELECTRICAL CONNECTIONS EXCEPT PLUGS FOR 110/220 VOLT RECEPTACLES HAVING A FLEXIBLE CABLE. TEMPORARY, MOVABLE OR MOBILE EQUIPMENT WHICH IS HEAVIER THAN 400 POUNDS OR HAS A CENTER OF MASS LOCATED 4 FEET OR MORE ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT IS REQUIRED TO BE RESTRAINED IN A MANNER APPROVED BY DSA.

THE FOLLOWING MECHANICAL AND ELECTRICAL COMPONENTS SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE BUT NEED NOT DEMONSTRATE DESIGN COMPLIANCE WITH THE REFERENCES NOTED ABOVE. THESE COMPONENTS SHALL HAVE FLEXIBLE CONNECTIONS PROVIDED BETWEEN THE COMPONENT AND ASSOCIATED DUCTWORK, PIPING, AND CONDUIT. FLEXIBLE CONNECTIONS MUST ALLOW MOVEMENT IN BOTH TRANSVERSE AND LONGITUDINAL DIRECTIONS:

- COMPONENTS WEIGHING LESS THAN 400 POUNDS AND HAVING A CENTER OF MASS LOCATED 4 FEET OR LESS ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT.
- COMPONENTS WEIGHING LESS THAN 20 POUNDS, OR IN THE CASE OF DISTRIBUTED SYSTEMS, LESS THAN 5 POUNDS PER FOOT, WHICH ARE SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

THE ANCHORAGE OF ALL MECHANICAL, ELECTRICAL AND PLUMBING COMPONENTS SHALL BE SUBJECT TO THE APPROVAL OF THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR STRUCTURAL ENGINEER DELEGATED RESPONSIBILITY AND ACCEPTANCE BY DSA. THE PROJECT INSPECTOR WILL VERIFY THAT ALL COMPONENTS AND EQUIPMENT HAVE BEEN ANCHORED IN ACCORDANCE WITH THE ABOVE REQUIREMENTS.

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM BRACING NOTE

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS SHALL BE BRACED TO COMPLY WITH THE FORCES AND DISPLACEMENTS PRESCRIBED IN ASCE 7-16 SECTION 13.3 AS DEFINED IN ASCE 7-16 SECTIONS 13.6.5, 13.6.6, 13.6.7, 13.6.8; AND 2022 CBC, SECTIONS 1617A.1.24, 1617A.1.25 AND 1617A.1.26.

THE METHOD OF SHOWING BRACING AND ATTACHMENTS TO THE STRUCTURE FOR THE IDENTIFIED DISTRIBUTION SYSTEM ARE AS NOTED BELOW. WHEN BRACING AND ATTACHMENTS ARE BASED ON A PREAPPROVED INSTALLATION GUIDE (E.G., HCAI OPM FOR 2013 CBC OR LATER), COPIES OF THE BRACING SYSTEM INSTALLATION GUIDE OR MANUAL SHALL BE AVAILABLE ON THE JOBSITE PRIOR TO THE START OF AND DURING THE HANGING AND BRACING OF THE DISTRIBUTION SYSTEMS. THE STRUCTURAL ENGINEER OF RECORD SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.

MECHANICAL PIPING (MP), MECHANICAL DUCTS (MD), PLUMBING PIPING (PP), ELECTRICAL DISTRIBUTION SYSTEMS (E):

MP ☐ MD ☐ PP ☐ E ☒ OPTION 1: DETAILED ON THE APPROVED DRAWINGS WITH PROJECT SPECIFIC NOTES AND DETAILS.

MP ☐ MD ☐ PP ☐ E ☐ OPTION 2: SHALL COMPLY WITH HCAI PREAPPROVAL (OPM #) #.

FIRE ALARM NOTES

PROVIDE SPACE ON ELECTRICAL PANEL FOR LOCK-ON BREAKER, IDENTIFIED WITH RED MARKING, FOR 120 VOLTS FIRE ALARM CIRCUIT, WITH BREAKER LABELED AS FIRE ALARM CIRCUIT, CEC 780.41 (B). BREAKER AND CIRCUIT PROVIDED AND INSTALLED ON SITE BY OTHERS.

SMOKE AND HEAT DETECTOR CONDUIT AND DEVICES TO BE PROVIDED AND INTERCONNECTED TO THE FIRE ALARM SYSTEMS ON SITE BY OTHERS

APPROVAL OF THIS PLAN DOES NOT CONSTITUTE APPROVAL OF THIS FIRE ALARM SYSTEM FOR ALL SITES, THE FIRE ALARM SYSTEM AND COMPONENTS MAYBE REQUIRED TO BE CHANGED DUE TO EXISTING CONDITIONS OR INCOMPATIBLE COMPONENTS.

CONDUIT FILL AND CONDUCTOR CAPACITY TABLE

(ALL CONDUCTORS SHALL BE TYPE THHN/THWN 75 DEG. C. COPPER)



WIRE SIZE	CAPACITY	WIRE TYPE	NO. OF CONDUCTOR PERMITTED			
			1/2" C	3/4" C	1" C	1 1/4" C
#12	20A	THHN	9	16	25	45
#10	30A	THHN	5	10	16	28
#8	45A	THHN	2	5	8	14
#6	65A	THHN	1	3	5	10
#4	85A	THHN	1	2	4	7

JUNCTION BOX SIZE TABLE

BOX	SIZE	CU. IN.	MAX NO. OF CONDUCTORS			
			#12	#10	#8	#6
4SS	1 1/4"x4" SQ	18.0	8	7	6	0
4S	1 1/2"x4" SQ	21.0	9	8	7	0
4SD	2 1/8"x4" SQ	30.3	13	12	10	6
4SX	2 7/8"x4" SQ	43.5	23	21	17	10
5SD	2 1/8"x4-11/16" SQ	42.0	18	16	14	6
5SX	3 7/8"x4-11/16" SQ	86.0	38	34	28	17
664	4"x6" SQ	144.0	64	57	48	28

* DEDUCT ONE CONDUCTOR FOR (1) OR MORE GROUNDING CONDUCTORS ENTERING THE BOX

PROJECT SPECIFIC STATE AGENCY APPROVAL

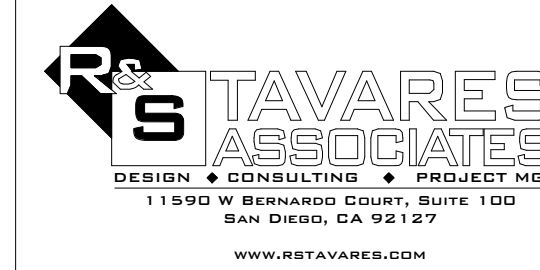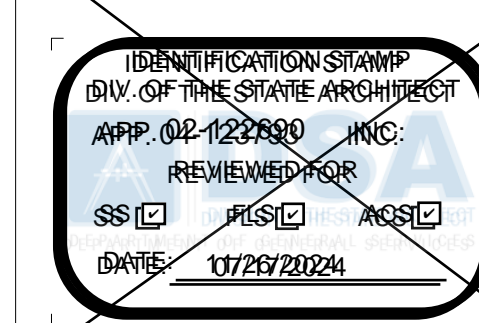

PROFESSIONAL STAMP




THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



ORIGINAL PC STATE AGENCY APPROVAL

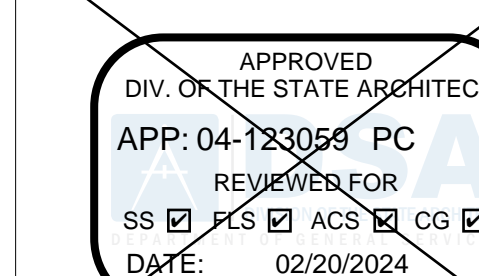

Revision Schedule

Description Date

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE

PC 2022 CBC: 24' x 40' EXPANDABLE TO 120' x 40'

SHEET TITLE

ELECTRICAL PLAN 36x40

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY

RH/RT

DATE

SHEET NO.

E1.2

SHEET OF

2 1" = 1'-0"
ELECTRICAL PANEL_WALL MOUNTED

PANEL A= 100A	120/208 VOLTS, 1 ϕ, 3 WIRE						MAIN LUGS ONLY			
	LOADCENTER RECESSED			10000 AIC			GRD & NEUTRAL BARS		AMP BUS	
	VOLTAMPS						VOLTAMPS			
DESCRIPTION	ϕ A	ϕ B	C/B	CKT	ϕ	CKT	C/B	ϕA	ϕ B	DESCRIPTION
AC WALL MOUNTED- 5 TON	7705		30	1	A	2	20	900		OUTLETS
		7705	30	3	B	4	20		1080	OUTLETS
GENERAL LIGHTING	1440		20	5	A	6	20	180		EXTERIOR GFI/WP
EXTERIOR LIGHTING		80	20	7	B	8	20		180	ROOF GFI/WP
DED SOLAR READY										
DED SOLAR READY										
SUBTOTAL	ϕ A 9145	ϕ B 7785						ϕ A 1080	ϕ B 1260	SUBTOTAL
TOTAL	10225	9045	10225/120 VOLTS=81.21 81.21+ 1.7= 82.91							

SEE ALT SHEETS

PANEL A= 100A	120/208 VOLTS, 1 ϕ, 3 WIRE						MAIN LUGS ONLY			
	LOADCENTER RECESSED			10000 AIC			GRD & NEUTRAL BARS		AMP BUS	
	VOLTAMPS						VOLTAMPS			
DESCRIPTION	ϕ A	ϕ B	C/B	CKT	ϕ	CKT	C/B	ϕA	ϕ B	DESCRIPTION
AC ROOF MOUNTED- 5 TON	8280		30	1	A	2	20	900		OUTLETS
		8280	30	3	B	4	20		1080	OUTLETS
GENERAL LIGHTING	1440		20	5	A	6	20	180		EXTERIOR GFI/WP
EXTERIOR LIGHTING		80	20	7	B	8	20		180	ROOF GFI/WP
DED SOLAR READY										
DED SOLAR READY										
SUBTOTAL	ϕ A 9720	ϕ B 8360						ϕ A 1080	ϕ B 1260	SUBTOTAL
TOTAL	10800	9620	10800/120 VOLTS= 90 90 + 1.15= 91.15							

3 1" = 1'-0"
ELECTRICAL PANEL_ROOF MOUNTED

LEGEND

- ELECTRICAL PANEL AT +60" AFF TO TOP OF ELECTRICAL PANEL WITH 1 1/2" DIA POWER STUB OUT
- ROOF MOUNTED HVAC UNIT-SEE MECHANICAL DWGS
- WALL MOUNTED HVAC UNIT, SEE MECHANICAL DWGS

100 CFM CEILING MOUNTED EXHAUST FAN.
INTERLOCKED WITH LIGHT SWITCH

4SD J-BOX FOR WATER HEATER LOCATE ABOVE CEILING
W/ COVER PLATE, HARD WIRE TO UNIT
4SD J-BOX IN ATTIC FOR ATTIC MOUNTED HEAT DETECTOR (DEVICE BY OTHERS). MAXIMUM 35'-0" FROM ANY POINT IN ATTIC BUT NOT MORE THAN 25'-0" FROM TWO PERPENDICULAR WALL AND 50'-0" BETWEEN THEM. PROVIDE A 6'-0" CONDUIT FROM EACH J-BOX TO HEAT DETECTOR LOCATION. CONDUIT & CONNECTION TO CEILING DEVICE & DEVICE BY OTHERS (ALARM NOTE #1)

4SD J-BOX IN ATTIC FOR CEILING MOUNTED SMOKE DETECTOR (DEVICE BY OTHERS). MAXIMUM 21'-0" FROM ANY POINT IN ROOM BUT NOT MORE THAN 15'-0" TO A PERPENDICULAR WALL AND 30'-0" BETWEEN THEM. PROVIDE A 6'-0" CONDUIT FROM EACH J-BOX TO SMOKE DETECTOR LOCATION. CONDUIT & CONNECTION TO CEILING DEVICE & DEVICE BY OTHERS (ALARM NOTE #1)

RECESSED 4SD J-BOX W/ COVER PLATE FOR FUTURE FIRE ALARM SYSTEM BY OTHERS. MOUNT AT +48" AFF U.O.N. TO CENTERLINE OF BOX AND PROVIDE 1" CO STUB TO ATTIC SPACE WITH PULLSTRING

4SD J-BOX FOR EXTERIOR FIRE ALARM HORN (DEVICE BY OTHERS). MOUNT AT +90" AFF TO TOP OF DEVICE WITH 3/4" CONDUIT STUBBED TO ATTIC WITH PULLSTRING

4SD J-BOX/SINGLE GANG MUD RING FOR FIRE ALARM STROBE (DEVICE BY OTHERS).
BOTTOM OF LENS 80" MIN TOP OF LENS 96" MAX AFF WITH 3/4"CONDUIT TO EXTERIOR FIRE ALARM HORN WITH PULLSTRING

4SD J-BOX/ SINGLE GANG MUD RING FOR FIRE ALARM PULL STATION (DEVICE BY OTHERS). MOUNT AT +48" AFF TO TOP OF CONTROL BOX WITH 3/4" CONDUIT TO FIRE ALARM STROBE WITH PULLSTRING

EXIT SIGN WITH BATTERY BACK UP. EXIT SIGN REQUIRED FOR CLASSROOMS WITH TWO OR MORE EXTERIOR DOORS. FLS 90" BACK UP. CLASSROOMS WITH ONE EXTERIOR DOOR-OPTIONAL.

CLOCK OUTLET AT +90" AFF TO CENTERLINE OF DEVICE
EXTERIOR LED LIGHT FIXTURE. 30w MAX WITH PHOTOCELL MOUNT AT +93" AFF

ROOF
GFI
WP

ROOF MOUNTED WEATHER PROOF GFI RECEPTACLE
GROUND FAULT CIRCUIT INTERRUPT RECEPTACLE WITHIN 6'-0" OF ALL SINKS

EXTERIOR WEATHER PROOF GFI RECEPTACLE AT +24" AFF FOR A/C SERVICES (MAX 25'-0" FROM UNITS)

DUPLEX (WALL MOUNTED) RECEPTACLE 15A-125V-3 WIRE. MOUNT AT +15" AFF U.O.N. TO BOTTOM OF OUTLET BOX

3-WAY LIGHT SWITCH. MOUNT AT+48" AFF TO TOP OF SWITCH BOX

LIGHT SWITCH. MOUNT AT+48" AFF TO TOP OF SWTICH BOX

SINGLE BUTTON DIMMER SWITCH. AT +48" AFF, TO TOP OF SWITCH BOX, WATTSTOPPER #LMDM-101 OR EQUAL

SINGLE SWITCH WALL OCCUPANCY SENSOR.
WATTSTOPPER PW-100 OR EQUAL. SENSOR TO BE MOUNTED AT +44" AFF AND USE FOR OPEN ROOM (OR RESTROOM) LESS THAN 100 SQ FT W/ (1) CIRCUIT.

ULTRASONIC CEILING OCCUPANCY SENSOR.
WATTSTOPPER W-500A OR EQUAL. SENSOR TO BE CONNECTED TO KEYED LIGHT SWITCHES FOR MANUAL OVERRIDE AND USE FOR RESTROOM W/ PARTITIONS.

CEILING MOUNTED PHOTOCELL, WATTSTOPPER #MLMS-500 OR EQUAL


CEILING MOUNTED OCCUPANCY SENSOR.
WATTSTOPPER #LMPC-100 OR EQUAL.

2x4 CEILING LIGHT WITH (3) LED PANELLIGHT, LAY-IN LIGHT FIXTURE WITH DIMMABLE BALLAST
DIMI LIGHTING-MODEL DM-P72448W-40K-ZZ
WATTAGE: 48W (48" LG) OR EQUAL

2x4 CEILING LIGHT WITH (3) LED PANELLIGHT, LAY-IN LIGHT FIXTURE WITH DIMMABLE BALLAST
DIMI LIGHTING-MODEL DM-P72448W-40K-ZZ
WATTAGE: 48W (48" LG) OR EQUAL
EACH LIGHT FIXTURE WHICH IS INDICATED AS BEING AN EMERGENCY LIGHT SHALL HAVE A BALLAST BATTERY PACK INSTALLED ON THE FIXTURE. THE BATTERY PACK SHALL PROVIDE POWER TO A SINGLE LAMP WITHIN THE FIXTURE FOR NO LESS THAN 90 MINUTES. ANY LIGHT FIXTURE Equipped WITH A BATTERY PACK SHALL BE WIRED IN SUCH A MANNER THAT THE BATTERY WILL BE ACTIVATED IMMEDIATELY UPON LOSS OF POWER TO THE FIXTURE. ADDITIONALLY THE BATTERY PACK SHALL BE OPERATED USING BATTERY POWER LIGHTING CONTROL SWITCHES AND SENSORS SHALL NOT BE ABLE TO SHUT THE FIXTURE OFF.

NOTE: SEE 4/A3.2 FOR PHOTOMETRIC DATA

PROJECT SPECIFIC STATE AGENCY APPROVAL

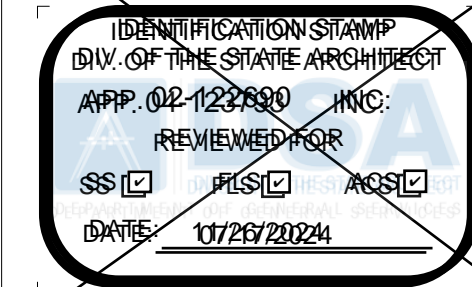

PROFESSIONAL STAMP




THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



ORIGINAL PC STATE AGENCY APPROVAL

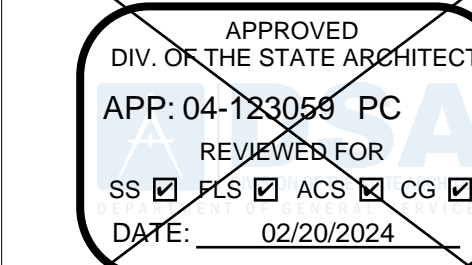

Revision Schedule

Description Date

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE

PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE

ELECTRICAL
SCHEDULE 36x40

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY

RH/RT

DATE

SHEET NO.

E1.3

SHEET OF

MEP COMPONENT ANCHORAGE NOTE

ALL MECHANICAL, PLUMBING, AND ELECTRICAL COMPONENTS SHALL BE ANCHORED AND INSTALLED PER THE DETAILS ON THE DSA-APPROVED CONSTRUCTION DOCUMENTS. THE FOLLOWING COMPONENTS SHALL BE ANCHORED OR BRACED TO MEET THE FORCE AND DISPLACEMENT REQUIREMENTS PRESCRIBED IN THE 2022 CBC SECTIONS 1617A.1.18 THROUGH 1617A.1.26 AND ASCE 7-16 CHAPTERS 13, 26, AND 30:

1. ALL PERMANENT EQUIPMENT AND COMPONENTS.
2. TEMPORARY, MOVABLE OR MOBILE EQUIPMENT THAT IS PERMANENTLY ATTACHED (OR HARD WIRED) TO THE BUILDING UTILITY SERVICES SUCH AS ELECTRICITY, GAS OR WATER, "PERMANENTLY ATTACHED" SHALL INCLUDE ALL FLEXIBLE CONNECTIONS EXCEPT PLUGS FOR 110/220 VOLT RECEPTACLES HAVING A FLEXIBLE CABLE.
3. EQUIPMENT WHICH IS HEAVIER THAN 400 POUNDS OR HAS A CENTER OF MASS LOCATED 4 FEET OR MORE ABOVE THE FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT IS REQUIRED TO BE RESTRAINED IN A MANNER APPROVED BY DSA.

THE FOLLOWING MECHANICAL AND ELECTRICAL COMPONENTS SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE BY MEANS THAT CAN DEMONSTRATE DESIGN COMPLIANCE WITH THE REFERENCES NOTED ABOVE. THESE COMPONENTS SHALL HAVE FLEXIBLE CONNECTIONS PROVIDED BETWEEN THE COMPONENT AND ASSOCIATED DUCTWORK, PIPING, AND CONDUIT. FLEXIBLE CONNECTIONS MUST ALLOW MOVEMENT IN BOTH TRANSVERSE AND LONGITUDINAL DIRECTIONS:

- A. COMPONENTS WEIGHING LESS THAN 400 POUNDS AND HAVING A CENTER OF MASS LOCATED 4 FEET OR LESS ABOVE THE COMPONENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT.
- B. COMPONENTS WEIGHING LESS THAN 20 POUNDS OR IN THE CASE OF DISTRIBUTED SYSTEMS, LESS THAN 5 POUNDS PER SQUARE FOOT, WHICH ARE SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

THE ANCHORAGE OF ALL MECHANICAL, ELECTRICAL AND PLUMBING COMPONENTS SHALL BE SUBJECT TO THE APPROVAL OF THE DESIGN ENGINEER. RESPONSIBILITY IN REGARD TO STRUCTURAL ENGINEER DELEGATED RESPONSIBILITY AND ACCEPTANCE BY DSA. THE DESIGN ENGINEER SHALL BE RESPONSIBLE FOR THE ANCHORAGE OF ALL EQUIPMENT HAVE BEEN ANCHORED IN ACCORDANCE WITH THE ABOVE REQUIREMENTS.

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM BRACING NOTE

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS SHALL BE DESIGNED TO COMPLY WITH THE FORCES AND DISPLACEMENTS PRESCRIBED IN ASCE 7-16 SECTION 13.3 AS DEFINED IN ASCE 7-16 SECTIONS 13.6.6, 13.6.6.1, 13.6.7, 13.6.8, AND 2022 CBC, SECTIONS 1617A.1.24, 1617A.1.25 AND 1617A.1.26.

THE METHOD OF SHOWING BRACING AND ATTACHMENTS TO THE STRUCTURE FOR THE DISTRIBUTED DISTRIBUTION SYSTEM ARE AS NOTED BELOW. WHEN BRACING AND ATTACHMENTS ARE BASED ON A "PREPARED" INSTALLATION GUIDE (E.G. HCAI OPM# 2013 CBC OR LATER), COPIES OF THE BRACING SYSTEM INSTALLATION GUIDE OR MANUAL SHALL BE ON FILE ON THE JOB PRIOR TO THE START OF AND DURING THE HANGING AND BRACING OF THE DISTRIBUTION SYSTEM. THE DESIGN ENGINEER OF RECORD SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.

MECHANICAL PIPING (MP), MECHANICAL DUCTS (MD), PLUMBING PIPING (PP), ELECTRICAL DISTRIBUTION SYSTEMS (E).

48" MAX.
TO TOP OF OUTLET BOX
(TERMINUS/JOINT)
F.F.

* 30"x48" MIN CLR FLOOR SPACE AT EACH LOCATION FOR PERPENDICULAR APPROACH

MPD MD PPPP OPTION 1: DETAILED ON THE APPROVED DRAWINGS WITH PROJECT SPECIFIC NOTES AND DETAILS
 MPD MD PPPP OPTION 2: SHALL COMPLY WITH HCAI PREAPPROVAL (OPM #) # _____

5 **1" = 1'-0"**
EQUIPMENT ANCHORAGE

9 **1" = 1'-0"**
MOUNTING ELEV.

SD-9419
HART AND COOLEY SUPPLY REG.
SEE SCHED THIS SHEET

ROOF CAP PER SCHEDULE (THIS SHEET)
ATTACH PER MFR.

MASTIC SET FLANGE
ALL 4-SIDES (CONT.)

SHTG AND
ROOFING

STRAP (2-SIDES) AND FSTNG
PER 17 / A3.3

FAN MOUNT w/
(2)#8 STSMS FSTNR
TO 2'-0" CROSSBAR

T-GRID CLG AND PANEL

FLEXIBLE DUCTING
PER PLAN

EXHAUST FAN

CROSS BAR SUPPORT (ADDITIONAL)
w/ #8 STSMS FST'ND

SEE ISOMETRIC DETAIL 17/A3.3 FOR STRAPS

SEE DETAIL 19/S3.1 FOR FST'NG

ROOF

44" MAX. FST'NG
WHERE K = 1/2" MIN.

* SEE DETAIL 2/M0.2

	<div style="border: 1px solid black; padding: 5px; display: inline-block;"> 10 </div> <div style="display: inline-block; vertical-align: middle;"> 1" = 1'-0" ELEV. @ WORKSTATION </div>
--	--

14 SEER		
SINGLE PACKAGE ROOF TOP HEAT PUMP SCHEDULE		
	STANDARD	OPTION #1
TAG	RM-1	
NOMINAL TONNAGE	3.0 TONS	4 TONS
MANUFACTURER	**CARRIER	**CARRIER
MODEL#	50VTC48	50VTC48
CFM	1200	1500
STATIC PRESSURE	0.15	0.4
MIN OSA	365	548
DRIVE	BELT	BELT
MCA	59	64
MOCP	68	74
VOLTAGE	208/230-1	208/230-1
WIRE SIZE (PWR/GRND)	#6/#10	#4/#8
DESIGN RETURN AIR (DB/WB)	80/67	80/67
SENSIBLE COOLING @ 95° F	30.500	35.260
TOTAL COOLING @ 95° F	35.600	49.600
HEATING CAP. BTUH @ 47° F	35.500	45.5000
HEATING CAP. BTUH @ 17° F	18.400	28.600
OPERATING WEIGHT	572#	560#
SEER	14.00	14.00
HSPF	8.1	8.0
COP @ 47° F	3.4	3.4
COP @ 17° F	2.3	2.4

1. HVAC UNIT SET BACK THERMOSTAT SHALL BE PROVIDED

2. MINIMUM OUTSIDE AIR 15 CFM PER OCCUPANT AND T

3. MODEL NUMBERS FOR HEAT PUMP UNITS WITH OPTIC STRIP IS NOT USED. THE MCA AND MOCP MUST BE V

SHOWN MAY NOT BE USED.

120.12(D)

THERMOSTAT SHALL BE PROGRAMED WITH EXPECTED OCCUPIED TIMES. AIR HANDLER FAN WILL BE PROGRAMED TO RUN DURING ALL OCCUPIED TIMES. PRE-OCCUPANCY PURGE SHALL BE PROGRAMED ONE HOUR PRIOR TO THE MODULAR BUILDING BEING NORMALLY OCCUPIED.

FOR ROOF MOUNTED HVAC UNITS A GASKET SHALL BE PLACED BETWEEN THE CURB AND THE HVAC UNIT. MASTIC SEALANT SHALL BE USED TO SEAL ALL SEAMS BETWEEN THE HVAC UNIT AND THE CURB. THE SUPPLY AND RETURN DUCTS SHALL BE ATTACHED TO THE CURB AND MASTIC SHALL BE USED TO SEAL THE DUCTS TO THE CURB. THE SUPPLY AND RETURN DUCTS SHALL BE THE SAME SIZE AND ALIGN WITH THE HVAC UNIT.

FLEXIBLE AIR DUCTS AND CONNECTORS SHALL BE NOT MORE THAN 5 FEET IN LENGTH AND SHALL NOT BE USED IN LIEU OF RIGID ELBOWS OR FITTINGS. FLEXIBLE AIR DUCTS SHALL BE PERMITTED TO BE USED AS AN ELBOW AT A TERMINAL DEVICE PER ENERGY CODE 120.4.

DUCT INSTALLATION AND PLENUMS SHALL MEET THE REQUIREMENTS OF ENERGY CODE SECTION 120.4 AND THE MANUFACTURERS INSTALLATION INSTRUCTIONS.

HORIZONTAL FLEX DUCT SHALL BE SUPPORTED AT A MAXIMUM 4 FT INTERVALS, WITH HANGING STRAPS A MINIMUM 1 1/2 IN. WIDE. DUCTS MUST BE PULLED TIGHT WITH A MAXIMUM SAG OF 1/2" PER FOOT OF HORIZONTAL RUN.

DUCT SHALL NOT BE KINKED OR CRUSHED.

BEND/RADIUS EQUAL TO THE DUCT DIAMETER OR GREATER.

HVAC SCHEDULE		
BUILDING SIZE	# OF HVAC	
	3 1/2 TON HVAC	4 TON HVAC
□ 24' x 40'	1	
✕ 36' x 40'		1
□ 48' x 40'	2	
□ 60' x 40'		2
□ 72' x 40'	3	
□ 84' x 40'		3
□ 96' x 40'	4	
□ 108' x 40'		4
□ 120' x 40'	5	

MERV 13 AND 2-INCH DEPTH PER ENERGY CODE 120.1(C)1. FILTERS REQ'D FOR ALL UNITS

THE UNIT SHALL UTILIZE DEMAND CONTROL VENTILATION
ONAL 5.0 AUXILIARY HEAT STRIPS, WHEN THE HEAT
RIFIED AND HEAT STRIPS LARGER THAN THE SIZES

SECTION 915
CARBON MONOXIDE DETECTION

915.2.3 Group E occupancies. Carbon monoxide
detection shall be installed in classrooms in Group E occu-
pancies. Carbon monoxide alarm signals shall be automati-
cally transmitted to an on-site location that is staffed by school
personnel.

915.3 Detection equipment. Carbon monoxide detection
required by Sections 915.1 through 915.2.3 shall be provided
by carbon monoxide alarms complying with Section 915.4 or
carbon monoxide detection systems complying with Section
915.5.

CFC 915.1 - Classrooms which contain a fuel-burning
appliance or a fuel-burning fireplace or are supplied by
a forced-air furnace shall be provided with a carbon
monoxide detection system. Provide a carbon monoxide
detection system

GENERAL NOTE:
UTILITIES THAT SPAN BETWEEN UNITS OR ACROSS SEISMIC SEPARATION
JOINTS MUST BE DESIGNED WITH A FLEXIBLE CONNECTION THAT CAN
ACCOMMODATE DIFFERENTIAL MOVEMENTS




DESIGN • CONSULTING • PROJECT MGT

11590 W BERNARDO COURT, SUITE 100
SAN DIEGO, CA 92127

WWW.RSTAVARES.COM

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEVISED SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©


CLient

 **Class
Leasing**

1651 Juanita Street, San Jacinto, CA 92583
(951) 943-1908 Fax (951) 943-5768

#	Description	Date
<p align="center">PRE-CHECK (PC) DOCUMENT</p> <p align="center">Code: 2022 CBC</p> <p align="center">A separate project application for construction is required</p> <p>PROJECT TITLE</p> <p align="center">PC 2022 CBC: 24' x 40' EXPANDABLE TO 120' x 40'</p>		

PROJECT NUMBER	22088
DRAWN BY	rMc/SC
CHECKED BY	RH/RT
DATE	
SHEET NO.	M0.1
SHEET	OF

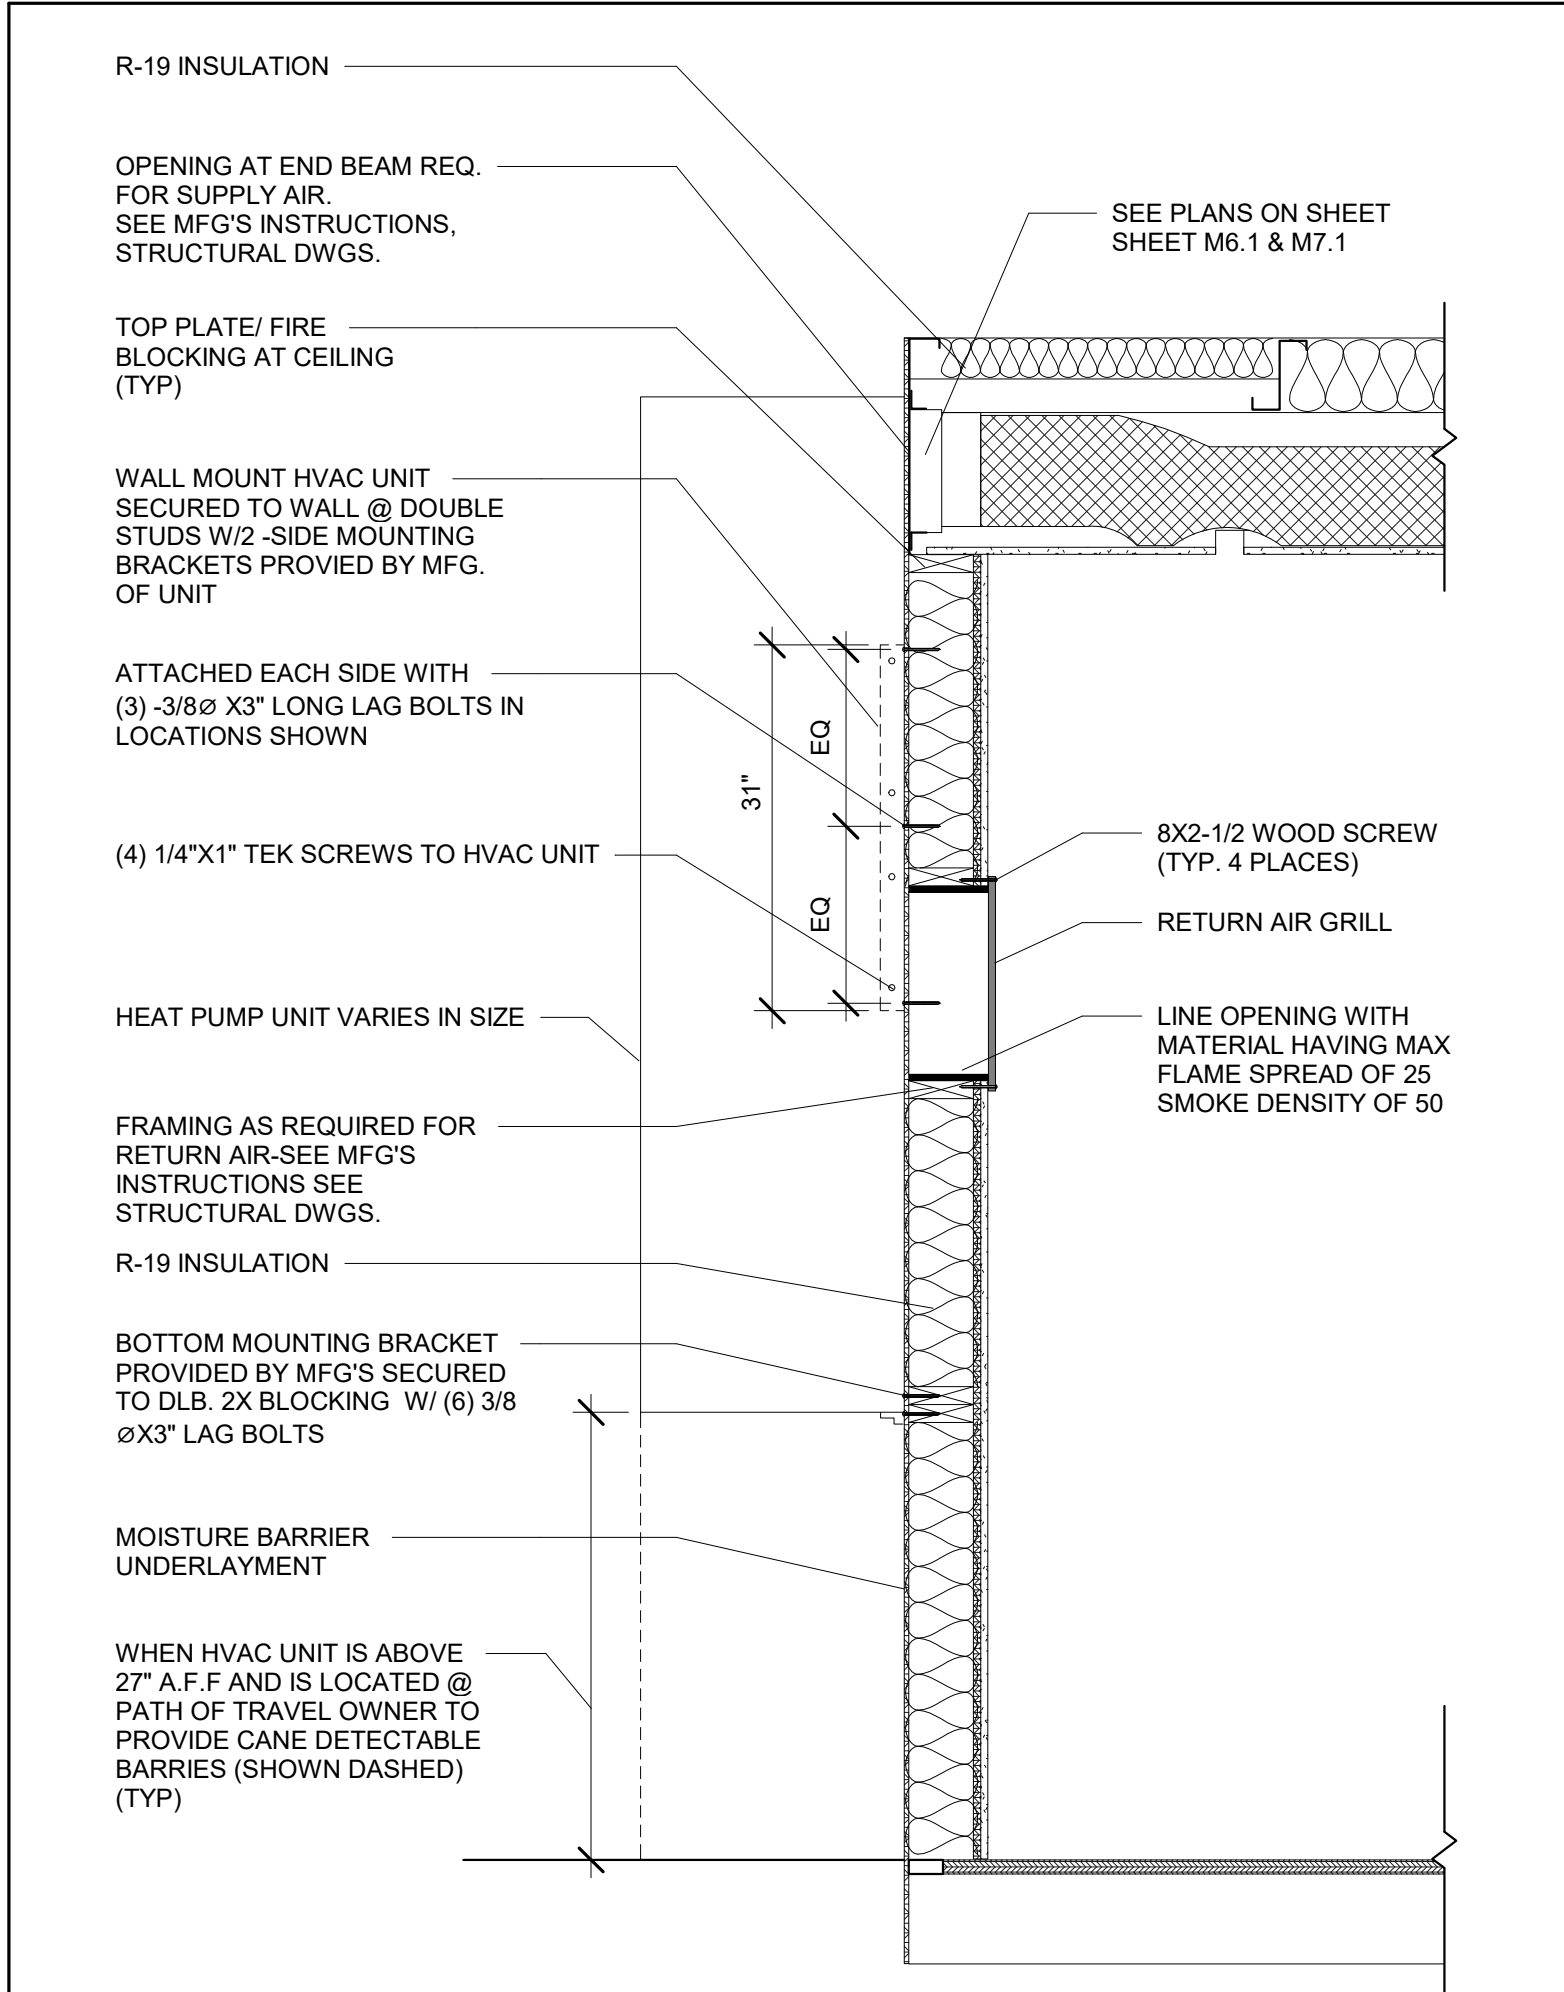

1 3/4" = 1'-0" HVAC @ WALL SECTION

SEQUENCE OF OPERATIONS

BARD W48HC-A

Sequence of Operation

Cooling
Circuit R-Y1 makes at thermostat pulling in compressor contactor, starting the compressor and outdoor motor. (See **NOTE** under **Condenser Fan Operation** concerning models equipped with low ambient control.) The G (indoor motor) circuit is automatically completed by the thermostat on any call for cooling operation or can be energized by manual fan switch on subbase for constant air circulation. On a call for 2nd stage heating, circuit R-W2 makes at the thermostat pulling in heat reactor for the strip heat and blower operation. On a call for third stage heat, R-W3 makes bringing on second heat contactor, if so equipped.

Heating
A 24V solenoid coil on reversing valve controls heating cycle operation. Two thermostat options, one allowing "Auto" changeover from cycle to cycle and the other constantly energizing solenoid coil during heating season—thus eliminating pressure equalization noise except during defrost, are to be used.

On "Auto" option, a circuit is completed from R-B/W1 and R-Y1 on each heating "on" cycle, energizing reversing valve solenoid and pulling in compressor contactor, starting compressor and outdoor motor. R-G also make starting indoor blower motor. Heat pump heating cycle now in operation.

The second option has no "Auto" changeover position, but instead energizes the reversing valve solenoid constantly whenever the system switch on subbase is placed in "Heat" position, the "B" terminal being constantly energized from R. A thermostat demand for heat completes R-Y1 circuit, pulling in compressor contactor starting compressor and outdoor motor. R-G also make starting indoor blower motor.

On a call for 2nd stage heating, circuit R-W2 makes at the thermostat pulling in the heat reactor for the strip heat and blower operation. On a call for third stage heat, R-B/W1 breaks, dropping out heat pump, and R-W3 makes, bringing on second heat reactor, if so equipped.

Balanced Climate™ Mode

Balanced Climate™ is a great comfort feature that can easily be applied under any normal circumstances. If the Bard air conditioning system is being set up in a typical environment where 72°F is the lowest cooling setpoint, remove the Y1/Y2 jumper and install a 2-stage cooling thermostat. This will increase the humidity removal up to 35% and provide a much more comfortable environment. This mode will also increase the supply temperature when in heating mode. When Balanced Climate mode is activated, it is employed in both heating and cooling modes.


NOTE: Units with mechanical dehumidification require an additional connection to be made when enabling Balanced Climate. Refer to dehumidification supplemental instructions for this step.

If the application is likely to require air conditioning operation below 60°F outdoor conditions, a low ambient control (LAC) kit must be installed. The LAC kit is equipped with an outdoor temperature switch that disables Balanced Climate mode when the outdoor temperature drops below 50°F. This prevents potential evaporator coil freeze up issues. The LAC kit also comes with an evaporator freeze protection thermostat that cuts out the compressor if the evaporator begins to freeze up.

If the unit is being installed with any ventilation package, a Bard LAC kit must be installed. Failure to install energizes the reversing valve solenoid constantly whenever the system switch on subbase is placed in "Heat" position, the "B" terminal being constantly energized from R. A thermostat demand for heat completes R-Y1 circuit, pulling in compressor contactor starting compressor and outdoor motor. R-G also make starting indoor blower motor.

Balanced Climate can readily be applied to duct-free (supply and return air grille) applications. It may also be applied to ducted applications with limited static of 0.20" ESP (total including both supply and return statics). Consult Bard Application Engineering for details prior to implementation.

CAUTION: Balanced Climate is not a replacement for a dehumidification (hot gas reheat) unit for extreme applications, but rather an enhancement feature for limited climates and applications.

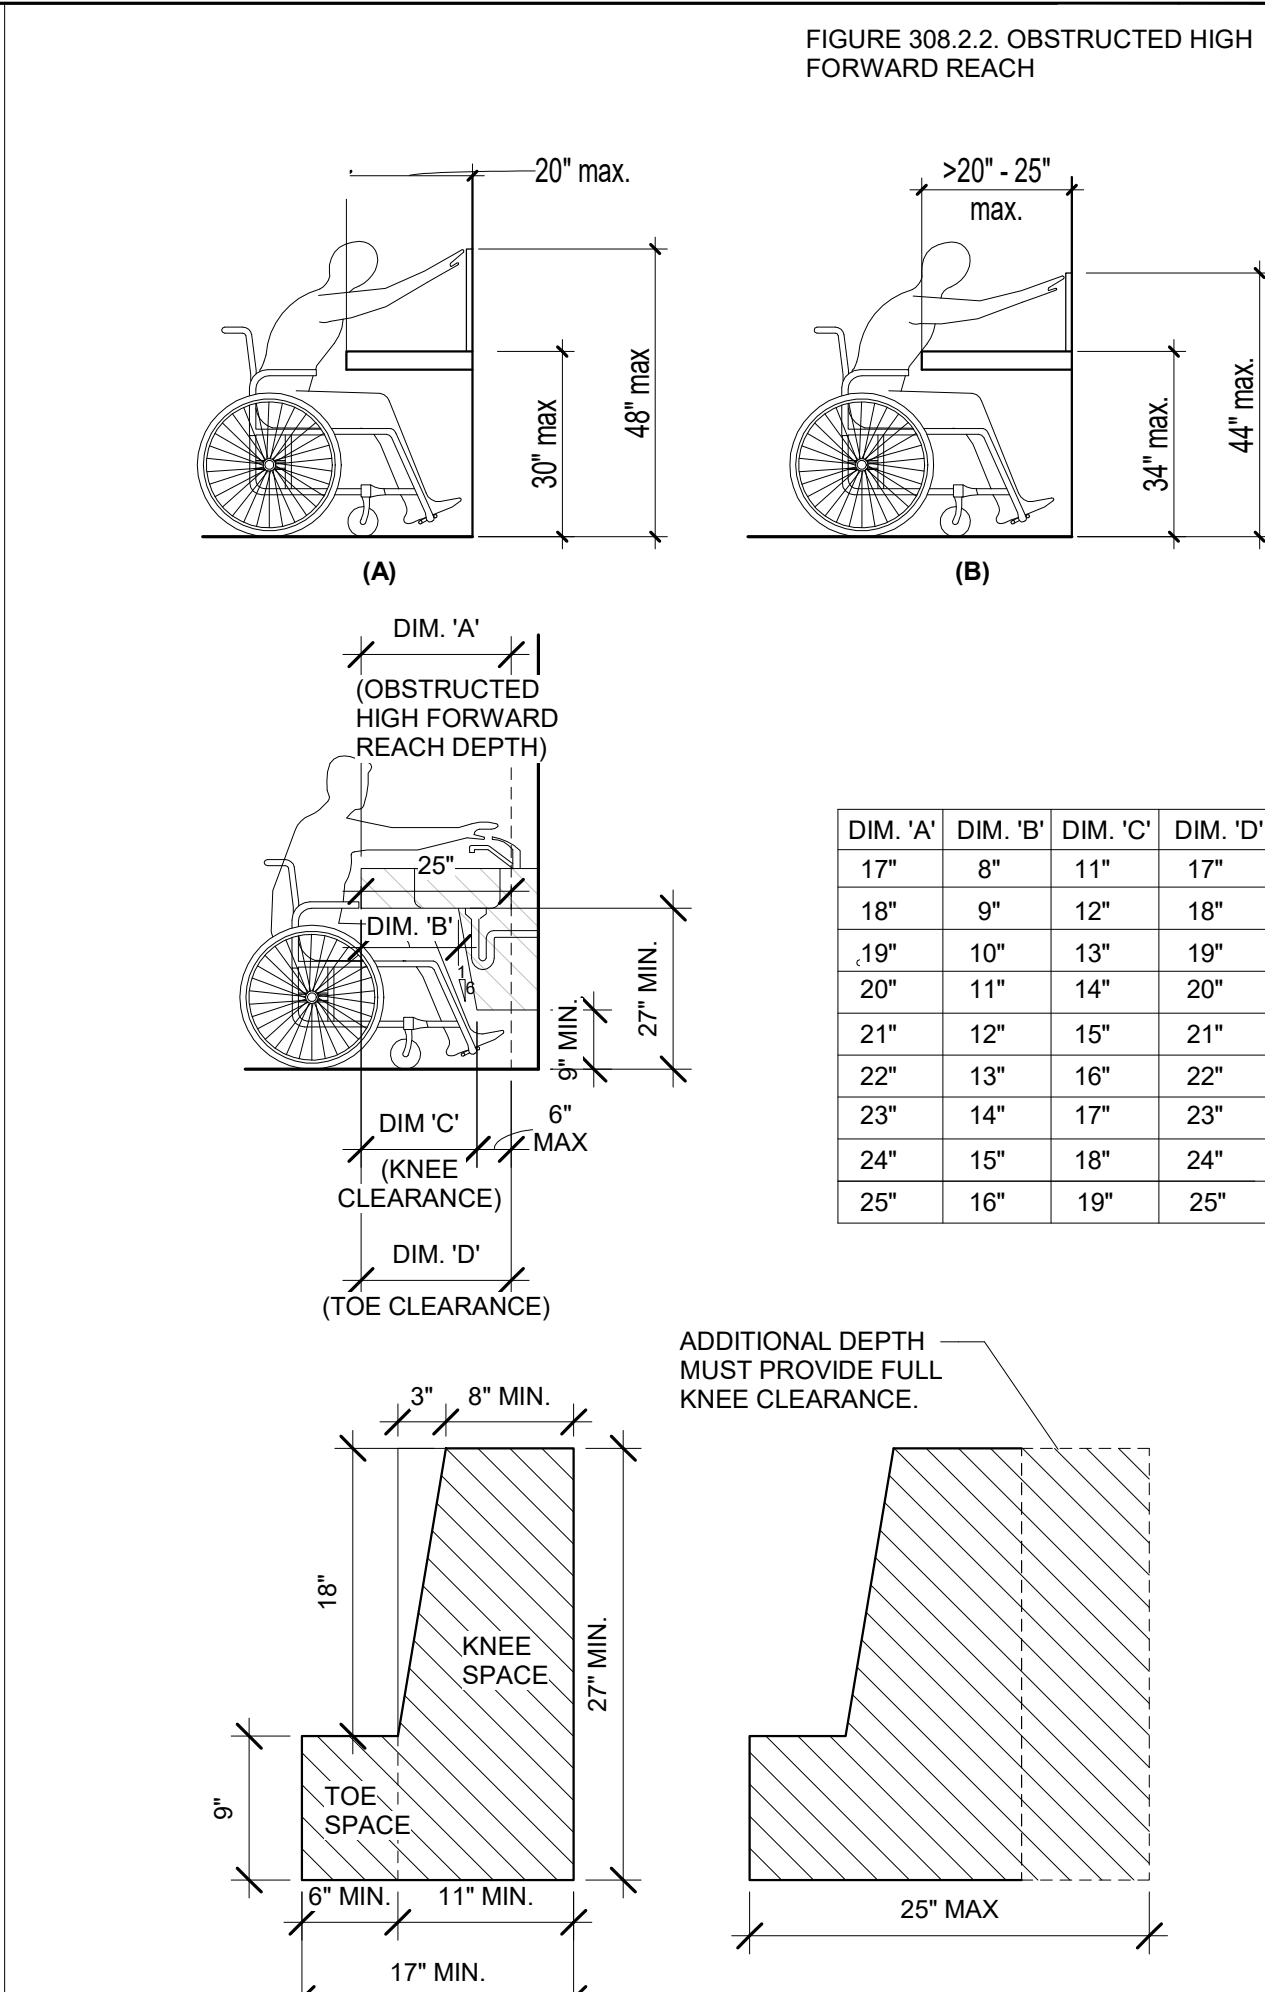

2 TOE SPACE CLEARANCE

120.1(D)
THERMOSTAT SHALL BE PROGRAMED WITH EXPECTED OCCUPIED TIMES AIR HANDLER FAN WILL BE PROGRAMED TO RUN DURING ALL OCCUPIED TIMES PRE-OCCUPANCY PURGE SHALL BE PROGRAMED ONE HOUR PRIOR TO THE MODULAR BUILDING BEING NORMALLY OCCUPIED.

FOR ROOF MOUNTED HVAC UNITS A GASKET SHALL BE PLACED BETWEEN THE CURB AND THE HVAC UNIT. MASTIC SEALANT SHALL BE USED TO SEAL ALL SEAMS BETWEEN THE HVAC UNIT AND THE CURB. THE SUPPLY AND RETURN DUCTS SHALL BE ATTACHED TO THE CURB AND MASTIC SHALL BE USED TO SEAL THE DUCTS TO THE CURB. THE SUPPLY AND RETURN DUCTS SHALL BE THE SAME SIZE AND ALIGN WITH THE HVAC UNIT.

FLEXIBLE AIR DUCTS AND CONNECTORS SHALL BE NOT MORE THAN 5 FEET IN LENGTH AND SHALL NOT BE USED IN LIEU OF RIGID ELBOWS OR FITTINGS. FLEXIBLE AIR DUCTS SHALL BE PERMITTED TO BE USED AS AN ELBOW AT A TERMINAL DEVICE PER ENERGY CODE 120.4.

DUCT INSTALLATION AND PLENUMS SHALL MEET THE REQUIREMENTS OF ENERGY CODE SECTION 120.4 AND THE MANUFACTURERS INSTALLATION INSTRUCTIONS. HORIZONTAL FLEX DUCT SHALL BE SUPPORTED AT A MAXIMUM 4 FT INTERVALS, WITH HANGING STRAPS A MINIMUM 1 1/2 IN. WIDE. DUCTS MUST BE PULLED TIGHT WITH A MAXIMUM SAG OF 1/2" PER FOOT OF HORIZONTAL RUN. DUCT SHALL NOT BE KINKED OR CRUSHED. BEND/RADIUS EQUAL TO THE DUCT DIAMETER OR GREATER.

UPON SITE PLACEMENT OR SITE CONSTRUCTION, THE OPERATION AND MAINTENANCE DOCUMENTATION FOR ALL MECHANICAL AND LIGHTING SYSTEMS AND CONTROLS SHALL BE PROVIDED BY THE MODULAR BUILDING MANUFACTURER, OR THE GENERAL CONTRACTOR FOR THE PERMANENT MODULAR RELOCATABLE BUILDING AND DELIVERED TO THE OWNER.

AT THE TIME OF ROUGH INSTALLATION, DURING IN THE FACTORY OR ON THE CONSTRUCTION SITE, DURING SHIPMENT (IF APPLICABLE) AND UNTIL FINAL STARTUP OF THE HEATING COOLING AND VENTILATING EQUIPMENT, ALL DUCT AND OTHER RELATED DISTRIBUTION COMPONENT OPENINGS SHALL BE PROCTED TO REDUCE THE AMOUNT OF DUST, WATER AND DEBRIS WHICH MAY ENTER THE SYSTEM

1 1/4" = 1'-0" MECHANICAL NOTES

LIST OF MECHANICAL EQUIPMENT				
Any substitutions of equipment made to the approved PC must be equal or better than the equipment listed below.				
Modular size and equipment type	4.0 TON WM HVAC	5.0 TON WM HVAC	3 TON WM HVAC	Responsible for programing/commissioning (builder or HVAC contractor)
HVAC Equipment Make and Model	BARD W48HC-A	BARD W60H1	BARD W36 HB	NA
BTUH Heating Cooling	41,500 45,500	51,000 55,500	38,500 40,000	NA
Indoor/Blower Fan BHP/HP CFM @ at 7 inch WC	1/3-825-2 2.5 24"-2900	1/3-825-2 4.1 24"-3700	1/3-825-2 2.5 24"-2900	NA
Strip Heating Maximum allowed or Not Allowed if not modeled	PER TITLE 24	PER TITLE 24	PER TITLE 24	NA
Minimum allowed SEER, EER, HSPF and/or COP, and Phase	14, 11, 3,40, 3	14, 11, 3,30, 3	14, 11, 3,40, 3	NA
Thermostat Make and Model Setback – § 110.2(c) Heat Pumps – § 110.2(b)	BARD #8403-061 C48H1	BARD #8403-061 C60H1	BARD #8403-061 C42H1	(Responsible Person) Required Acceptance Test NRCA-MCH-03-A
Shut-off and Reset Make and Model Occupancy Sensor or 4 hr override – § 120.2(e)	STANDARD BUILT-IN	STANDARD BUILT-IN	STANDARD BUILT-IN	(Responsible Person) Required Acceptance Test NRCA-MCH-03-A
Economizer Equipment Make and Model – § 140.4(e)	ECON-NC5	ECON-NC5	ECON-NC5	(Responsible Person) Required Acceptance Test NRCA-MCH-02-A and 05-A
Economizer Controls Make and Model – § 140.4(e)	ECON-WD5	ECON-WD5	ECON-WD5	(Responsible Person) Required Acceptance Test NRCA-MCH-02-A and 05-A
Economizer Fault Detection Software Make and Model – § 120.2(i)	ECON-DB5	ECON-DB5	ECON-DB5	(Responsible Person) Required Acceptance Test NRCA-MCH-12-A or 13-A
Outside Air In CFM – § 120.1(c)3	PER TITLE 24	PER TITLE 24	PER TITLE 24	(Responsible Person) Required Acceptance Test NRCA-MCH-02-A
Ventilation Kit If economizer is not installed specify Make and Model.	N/A	N/A	N/A	(Responsible Person) Required Acceptance Test NRCA-MCH-02-A
Demand Control Ventilation Co2 Sensor with ppm display Make and Model – §120.1(d)4	PER BARD SPECIFICATIONS	PER BARD SPECIFICATIONS	PER BARD SPECIFICATIONS	(Responsible Person) Required Acceptance Test NRCA-MCH-06-A
Minimum Designed Outside Air in CFM – § 120.1(c)3	PER TITLE 24	PER TITLE 24	PER TITLE 24	(Responsible Person) Required Acceptance Test NRCA-MCH-02-A
Demand Shed Thermostat Make Model If DDC to the zone § 120.2(h)				(Responsible Person) Required Acceptance Test NRCA-MCH-11-A

NOTE: SEE M0.1 AND CUT SHEETS FOR ADDITIONAL EQUIPMENT OPTIONS

C:\Users\User\Documents\2003- Arnes, 24x40 PC - MainFile - Low Seismic 6.7_CESAR24.D63.rvt

6/5/2021 11:53:14 PM

BARD C60HC1 & C42HC1

Sequence of Operation

Cooling Stage 1 – Circuit R-Y makes at thermostat pulling in compressor contactor, starting the compressor and outdoor motor. The G (indoor motor) circuit is automatically completed on any call for cooling operation or can be energized by manual fan switch on subbase for constant air circulation.

Cooling Stage 2 – Circuit R-Y1 makes at the thermostat, energizing the 2nd stage solenoid in the compressor. Default position is not energized. Compressor will run at low capacity until this solenoid is energized.

Heating Stage 1 – A 24V solenoid coil on reversing valve controls heating cycle operation. Two thermostat options, one allowing "Auto" changeover from cycle to cycle and the other constantly energizing solenoid coil during heating season and thus eliminating pressure equalization noise except during defrost, are to be used. On "Auto" option, a circuit is completed from R-B and R-Y on each heating "on" cycle, energizing reversing valve solenoid and pulling in compressor contactor starting compressor and outdoor motor. R-G also make, starting indoor blower motor. Heat pump heating cycle now in operation. The second option has no "Auto" changeover position, but instead energizes the reversing valve solenoid constantly whenever the system switch on subbase is placed in "Heat" position, the "B" terminal being constantly energized from R. A thermostat demand for Stage 1 heat completes R-Y circuit, pulling in compressor contactor and starting compressor and outdoor motor. R-G also make, starting indoor blower motor.

Heating Stage 2 – Circuit R-Y2 makes at the thermostat, energizing the 2nd stage solenoid in the compressor.

Pressure Service Ports

High and low pressure service ports are installed on all units so that the system operating pressures can be observed. Pressure tables 6A and 6B cover all models. It is imperative to match the correct pressure table to the unit by model number.

This unit employs high-flow Coremax valves instead of the typical Shrader type valves.

WARNING! Do Not use a Schrader valve core removal tool with these valves. Use of such a tool could result in eye injuries or refrigerant burns!

To change a Coremax valve without first removing the refrigerant, a special tool is required which can be obtained at www.fastestinc.com/en/SCA07H. See the replacement parts manual for replacement core part numbers.

CARRIER 50VTC48L

OPERATION

Sequence of Operation—When free cooling is not available, the compressor will be controlled by the thermostat. When free cooling is available, the outdoor-air damper is modulated by the Economizer control to provide a 50° to 55°F (10° to 12.8°C) supply-air temperature into the zone. As the supply-air temperature fluctuates above 55° (12.8°C) or below 50°F (10°C), the dampers will be modulated (open or close) to bring the supply-air temperature back within the set points. For Economizer operation, there must be a thermostat call for the fan (G). This will move the damper to its minimum position during the occupied mode.

NOTE: The DCV Max potentiometer must be closed (CCW) when not using CO2 sensor.

Above 50°F (10°C) supply-air temperature, the dampers will modulate from 100% open to the minimum open position. From 50°F to 45°F (10° to 7.2°C) supply-air temperature, the dampers will maintain at the minimum open position. Below 45°F (7.2°C), the dampers will be completely shut. As the supply-air temperature rises, the dampers will come back open to the minimum open position once the supply-air temperature rises to 48°F (8.9°C). If power exhaust is installed, as the outdoor-air damper opens and closes, the power exhaust fans will be energized and deenergized. If field-installed accessory CO2 sensors are connected to the Economizer control, a demand controlled ventilation strategy will begin to operate. As the CO2 level in the zone increases above the CO2 set point, the minimum position of the damper will be increased proportionally. As the CO2 level decreases because of the increase in fresh air, the outdoor-air damper will be proportionally closed. Damper position will follow the higher demand condition from DCV mode or free cooling mode. Damper movement from full closed to full open (or vice versa) will take between 1 1/2 and 2 1/2 minutes. If free cooling can be used as determined from the appropriate changeover command (dry bulb, enthalpy curve, or differential enthalpy), a call for cooling (Y1 closes at the thermostat) will cause the control to modulate the dampers open to maintain the supply air temperature set point at 50° to 55°F (10° to 12.8°C). As the supply air temperature drops below the set point range of 50° to 55°F (10° to 12.8°C), the control will modulate the outdoor-air dampers closed to maintain the proper supply-air temperature.

TABLE 140.4-E AIR ECONOMIZER HIGH LIMIT SHUT OFF CONTROL REQUIREMENTS

Device Type ^a	Climate Zones	Required High Limit (Economizer Off When):	
		Equation ^b	Description
Fixed Dry Bulb	1, 3, 5, 11-16	T _{OA} > 75°F	Outdoor air temperature exceeds 75°F
	2, 4, 10	T _{OA} > 73°F	Outdoor air temperature exceeds 73°F
	6, 8, 9	T _{OA} > 71°F	Outdoor air temperature exceeds 71°F
Differential Dry Bulb	7	T _{OA} > 69°F	Outdoor air temperature exceeds 69°F
	1, 3, 5, 11-16	T _{OA} > T _{RA} ^c	Outdoor air temperature exceeds return air temperature
	2, 4, 10	T _{OA} > T _{RA} -2°F	Outdoor air temperature exceeds return air temperature minus 2°F
Fixed Enthalpy ^c + Fixed Drybulb	6, 8, 9	T _{OA} > T _{RA} -4°F	Outdoor air temperature exceeds return air temperature minus 4°F
	7	T _{OA} > T _{RA} -6°F	Outdoor air temperature exceeds return air temperature minus 6°F
	All	h _{OA} > 28 Btu/lb ^c or T _{OA} > 75°F	Outdoor air enthalpy exceeds 28 Btu/lb of dry air ^c or Outdoor air temperature exceeds 75°F

^a Only the high limit control devices listed are allowed to be used and at the setpoints listed. Others such as Dew Point, Fixed Enthalpy, Electronic Enthalpy, and Differential Enthalpy Controls, may not be used in any Climate Zone for compliance with Section 140.4(e)1 unless approval for use is provided by the Energy Commission Executive Director.

^b Devices with selectable (rather than adjustable) setpoints shall be capable of being set to within 2°F and 2 Btu/lb of the setpoint listed.

^c At altitudes substantially different than sea level, the Fixed Enthalpy limit value shall be set to the enthalpy value at 75°F and 50% relative humidity. As an example, at approximately 6,000 foot elevation, the fixed enthalpy limit is approximately 30.7 Btu/lb.

ALL ECONOMIZERS MUST BE PROGRAMMED IN THE FIELD BY THE HVAC CONTRACTOR TO THE TEMPERATURE IN TABLE 140.4-E

PC DESIGN REVIEW INFORMATION Title 24, Part 6, Energy Code DSA Application #: 04-121369 Calculation Date/Time of Energy Report: 2023-07-26 XX Model Name and Option: 24x40 PC (Wood Frame Walls) Total Floor Area: 960 ft ² HVAC System Type: Wall Mounted A/C						
Climate Zone 14 (Palmdale)						
Aisimuth (Front Orientation)	Standard Design	Proposed Design	Margin	Margin %	Worst Case	
30°	TOW-E	366.40	297.14	69.26	18.9028%	
	TOW-T	366.40	297.14	69.26	18.9028%	
	SOURCE	36.24	30.65	5.59	15.4249%	
75°	TOW-E	358.22	295.30	62.92	17.6705%	**
	TOW-T	358.22	295.30	62.92	17.6705%	**
	SOURCE	35.43	30.56	5.07	14.2296%	**
120°	TOW-E	363.42	296.43	67.04	18.4444%	
	TOW-T	363.42	296.43	67.04	18.4444%	
	SOURCE	36.01	30.64	5.37	14.9125%	
165°	TOW-E	366.46	297.42	69.04	18.8397%	
	TOW-T	366.46	297.42	69.04	18.8397%	
	SOURCE	36.22	30.64	5.58	15.4050%	
210°	TOW-E	366.40	297.14	69.26	18.9028%	
	TOW-T	366.40	297.14	69.26	18.9028%	
	SOURCE	36.24	30.65	5.59	15.4249%	
255°	TOW-E	358.22	295.30	62.92	17.6705%	**
	TOW-T	358.22	295.30	62.92	17.6705%	**
	SOURCE	35.43	30.56	5.07	14.2296%	**
300°	TOW-E	363.42	296.43	67.04	18.4444%	
	TOW-T	363.42	296.43	67.04	18.4444%	
	SOURCE	36.01	30.64	5.37	14.9125%	
345°	TOW-E	366.46	297.42	69.04	18.8397%	
	TOW-T	366.46	297.42	69.04	18.8397%	
	SOURCE	36.23	30.64	5.58	15.4050%	
Climate Zone 15 (Palm Springs)						
Aisimuth (Front Orientation)	Standard Design	Proposed Design	Margin	Margin %	Worst Case	
30°	TOW-E	378.51	303.65	74.86	19.7775%	
	TOW-T	378.51	303.65	74.86	19.7775%	
	SOURCE	33.26	26.66	6.60	19.8837%	
75°	TOW-E	369.92	301.77	68.15	18.4250%	**
	TOW-T	369.92	301.77	68.15	18.4250%	**
	SOURCE	32.57	26.55	6.02	18.4833%	**
120°	TOW-E	370.43	302.74	67.69	18.2734%	
	TOW-T	370.43	302.74	67.69	18.2734%	
	SOURCE	32.71	26.64	6.07	18.5706%	
165°	TOW-E	378.42	303.43	74.99	19.8160%	
	TOW-T	378.42	303.43	74.99	19.8160%	
	SOURCE	34.83	27.69	7.14	20.5015%	
210°	TOW-E	378.51	303.65	74.86	19.7775%	
	TOW-T	378.51	303.65	74.86	19.7775%	
	SOURCE	33.26	26.66	6.60	19.8837%	
255°	TOW-E	369.92	301.77	68.15	18.4250%	**
	TOW-T	369.92	301.77	68.15	18.4250%	**
	SOURCE	32.57	26.55	6.02	18.4833%	**
300°	TOW-E	370.43	302.74	67.69	18.2734%	
	TOW-T	370.43	302.74	67.69	18.2734%	
	SOURCE	32.71	26.64	6.07	18.5706%	
345°	TOW-E	378.42	303.43	74.99	19.8160%	
	TOW-T	378.42	303.43	74.99	19.8160%	
	SOURCE	34.83	27.69	7.14	20.5015%	
Climate Zone 16 (Blue Canyon)						
Aisimuth (Front Orientation)	Standard Design	Proposed Design	Margin	Margin %	Worst Case	
30°	TOW-E	307.24	278.52	28.72	9.3477%	**
	TOW-T	307.24	278.52	28.72	9.3477%	**
	SOURCE	54.83	41.05	13.78	25.1221%	**
75°	TOW-E	341.77	272.69	69.08	20.2124%	
	TOW-T	341.77	272.69	69.08	20.2124%	
	SOURCE	65.39	40.97	24.42	37.3452%	
120°	TOW-E	307.35	273.40	33.95	11.0460%	
	TOW-T	307.35	273.40	33.95	11.0460%	
	SOURCE	54.88	41.01	13.87	25.2733%	
165°	TOW-E	309.02	273.26	35.76	11.5721%	
	TOW-T	309.02	273.26	35.76	11.5721%	
	SOURCE	54.91	41.02	13.89	25.2959%	
210°	TOW-E	307.24	273.52	33.72	10.9751%	
	TOW-T	307.24	273.52	33.72	10.9751%	
	SOURCE	54.83	41.01	13.82	25.1221%	
255°	TOW-E	341.77	272.69	69.08	20.2124%	
	TOW-T	341.77	272.69	69.08	20.2124%	
	SOURCE	65.39	40.97	24.42	37.3452%	
300°	TOW-E	307.35	273.40	33.95	11.0460%	
	TOW-T	307.35	273.40	33.95	11.0460%	
	SOURCE	54.88	41.01	13.87	25.2733%	
345°	TOW-E	309.02	273.26	35.76	11.5721%	
	TOW-T	309.02	273.26	35.76	11.5721%	
	SOURCE	54.91	41.02	13.89	25.2959%	
Notes:						
Reference: Energy Code, Appendix NAK, Table NAK-3						
* Is the event that there are identical percentages, select one.						
**This table is not currently generated by the energy software.						
Least Compliance Margin Generation						

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD							NRCC-PRF-E	
Nonresidential Performance Compliance Method							(Page 2 of 17)	
B. PROJECT SUMMARY								
Table B shows which building components are included in the performance calculation. If indicated as not included, the project must show compliance prescriptively if within the permit application.								
Building Components Complying via Performance					Building Components Complying Prescriptively			
Envelope (See Table G)	Nonres	Performance	Solar Thermal Water Heating (See Table I3)	<input type="checkbox"/>	Performance	The following building components are ONLY eligible for prescriptive compliance and should be documented on the NRCC form listed if within the scope of the permit application (i.e. compliance will not be shown on the NRCC-PRF-E).		
	MultiFam	Not included		<input checked="" type="checkbox"/>	Not Included			
Mechanical (See Table H)	Nonres	Performance	Covered Process: Commercial Kitchens (See Table J)	<input type="checkbox"/>	Performance	Indoor Lighting (Unconditioned) 140.6 & 170.2(e)	NRCC-LTI-E is required	
	MultiFam	Not included		<input checked="" type="checkbox"/>	Not Included	Outdoor Lighting 140.7 & 170.2(e)	NRCC-LTO-E is required	
Domestic Hot Water (See Table I)	Nonres	Not Included	Covered Process: Laboratory Exhaust (see Table J)	<input type="checkbox"/>	Performance	Sign Lighting 140.8 & 170.2(e)	NRCC-LTI-E is required	
	MultiFam	Not included		<input checked="" type="checkbox"/>	Not Included	Building Components Complying with Mandatory Measures		
Lighting (Indoor Conditioned, see Table K)	Nonres	Performance	Photovoltaics (see Table F)	<input type="checkbox"/>	Performance	Electrical power systems, commissioning, solar ready, elevator and escalator requirements are mandatory and should be documented on the NRCC form listed if applicable (i.e. compliance will not be shown on the NRCC-PRF-E).		
	MultiFam	Not Included		<input checked="" type="checkbox"/>	Not Included	Electrical Power Distribution 110.11	NRCC-ELC-E is required	
				<input type="checkbox"/>	Performance	Commissioning 120.8	NRCC-CXB-E is required	
			Battery (see Table F)	<input checked="" type="checkbox"/>	Not included	Solar and Battery 110.10	NRCC-SAB-E is required	

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD				NRCC-PRF-E
Nonresidential Performance Compliance Method				(Page 6 of 17)
C4. SOURCE ENERGY COMPLIANCE RESULTS FOR PERFORMANCE COMPONENTS (Annual SOURCE Energy Use, kWhu/R ² /yr)				
COMPLIES ²				
Energy Component	Standard Design (SOURCE)	Proposed Design (SOURCE)	Compliance Margin (SOURCE) ¹	
Space Heating	3.73	6.14	-2.41	
Space Cooling	3.47	3.65	-0.18	
Indoor Fans	14.94	8.15	6.79	
Heat Rejection	0	0	0	
Pumps & Misc.	0	0	0	
Domestic Hot Water	5.99	5.99	0	
Indoor Lighting	2.57	1.71	0.86	
Flexibility	---	---	---	
EFFICIENCY COMPLIANCE TOTAL	30.7	25.64	5.06 (16.5%)	
Photovoltaics	---	---	---	
Batteries	---	---	---	
TOTAL COMPLIANCE	30.7	25.64	5.06 (16.5%)	

¹ Notes: This number in parenthesis following the Compliance Margin in column 4, represents the Percent Better than Standard.

1. COMPLIANCE SUMMARY		COMPLIES ⁵	
	Time Dependent Valuation (TDV)		Source Energy Use
	Efficiency ¹ (kBtu/ft ² - yr)	Total ² (kBtu/ft ² - yr)	Total ² (kBtu/ft ² - yr)
Standard Design	358.72	358.72	30.7
Proposed Design	295.31	295.31	25.64
Compliance Margins	63.41	63.41	5.06
	Pass	Pass	Pass

¹Efficiency measures include improvements like a better building envelope and more efficient equipment
²Compliance Totals include efficiency, photovoltaics and batteries
⁵Building complies when efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD				NRCC-PRF-E
Nonresidential Performance Compliance Method				(Page 5 of 17)
3. TDV ENERGY RESULTS FOR NON-REGULATED COMPONENTS ¹				
Non-Regulated Energy Component	Standard Design (TDV)	Proposed Design (TDV)	Compliance Margin (TDV) ¹	
Receptacle	67.93	67.93	---	
Process	---	---	---	
Other Ltg	---	---	---	
Process Motors	---	---	---	
TOTAL (TOTAL COMPLIANCE + NON-REGULATED COMPONENTS)	426.65	363.24	63.41 (14.9%)	

A Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD				NRCC-PRF-E
Nonresidential Performance Compliance Method				(Page 4 of 17)
C2. TDV ENERGY COMPLIANCE RESULTS FOR PERFORMANCE COMPONENTS (Annual TDV Energy Use, kWh/tu/t ² - yr)				
COMPLIES ²				
Energy Component	Standard Design (TDV)	Proposed Design (TDV)	Compliance Margin (TDV) ¹	
Space Heating	25.61	42	-16.39	
Space Cooling	93.22	95.25	-2.03	
Indoor Fans	152.65	81.72	70.93	
Heat Rejection	0	0	0	
Pumps & Misc.	0	0	0	
Domestic Hot Water	54.63	54.6	0.03	
Indoor Lighting	32.61	21.74	10.87	
Flexibility	---	---	---	
EFFICIENCY COMPLIANCE TOTAL	358.72	295.31	63.41 (17.7%)	
Photovoltaics	---	---	---	
Batteries	---	---	---	
TOTAL COMPLIANCE	358.72	295.31	63.41 (17.7%)	

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

PROJECT NUMBER	
22088	
DRAWN BY	
rMc/SC	
CHECKED BY	
RH/RT	
DATE	
06/15/2021	
SHEET NO.	
M2.9	
SHEET	OF

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 9 of 17)

C8. ENERGY USE INTENSITY (EUI)				
	Standard Design (kBtu/ft ² / yr)	Proposed Design (kBtu/ft ² / yr)	Margin (kBtu/ft ² / yr)	Margin Percentage
GROSS EUI ¹	49.76	41.58	8.18	16.44
NET EUI ¹	49.76	41.58	8.18	16.44

¹ Notes: Gross EUI is Energy Use Total (not including PV)/Total Building Area. Net EUI is Energy Use Total (including PV)/Total Building Area.

D1. EXCEPTIONAL CONDITIONS
• The project uses the Simplified Geometry Performance Modeling Approach which is not capable of modeling daylighting controls and assumes the prescriptive Secondary Daylit Control requirements are met. PRESCRIPTIVE COMPLIANCE documentation (form NRCC-LTI-02-E) for the requirements of section 140.6(d) Automatic Daylighting Controls in Secondary Daylit Zones is required.
• The building does not include service water heating. Verify that service water heating is not required and is not included in the design.
• Project is claiming Exception 2 to Section 140.10(a): No PV system is required where the required PV system size is less than 4 kWdc.

G1. ENVELOPE GENERAL INFORMATION (conditioned spaces only)			
01	02	03	04
Opaque Surfaces & Orientation	Total Gross Surface Area (ft ²)	Total Penetration Area (ft ²)	Window to Wall Ratio (%)
North-Facing ¹	240	32	13.33
East-Facing ²	400	0	0
South-Facing ³	240	32	13.33
West-Facing ⁴	400	0	0
Total	1280	64	5
Roof	960	14	1.46

Notes
¹North-Facing is oriented to within 45 degrees of true north, including 45 00'00" east of north (NE), but excluding 45 00'00" west of north (NW).
²East-Facing is oriented to within 45 degrees of true east, including 45 00'00" south of east (SE), but excluding 45 00'00" north of east (NE).
³South-Facing is oriented to within 45 degrees of true south, including 45 00'00" west of south (SW), but excluding 45 00'00" east of south (SE).
⁴West-Facing is oriented to within 45 degrees of true west, including 45 00'00" north of west (NW), but excluding 45 00'00" south of west (SW).

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 12 of 17)

H3. NONRESIDENTIAL / COMMON USE AREA FAN SYSTEMS SUMMARY												
01	02	03	04	05	06	07	08	09	10	11	12	13
Name or Item Tag	Qty	Design OA CFM	CFM	Power	Power Units	Control	Fan Type	CFM	Power	Power Units	Control	Status ¹
AC-1	1	364.8	1,100	0.5	BHP	Constant Vol	N/A	N/A	N/A	N/A	N/A	N

¹ Status: N - New, A - Altered, E - Existing

H8. SYSTEM SPECIAL FEATURES			
01	02	03	04
System Name	Equipment Type	Interlocks per 140.4(n) ¹	Other Special Features and Controls
AC-1	Single Package VHP Air System	No	Zone(s) With CO2 Sensor Vent. Control Fixed DB

Notes: This table includes controls related to the performance path only. For projects using the prescriptive path, mandatory and prescriptive controls requirements are documented on the NRCC-MCH-E.

¹ Yes = Interlocks are provided, No = Interlocks are not provided, NA means no operable openings.

H9. NONRESIDENTIAL / COMMON USE AREA & HOTEL/MOTEL VENTILATION						
01	02	03	04	05	06	07
Zone Name	Ventilation Function	# of People	Supply OA CFM	Exhaust CFM	Conditioned Area (sf)	DCV or Occupant Sensor Controls, or Both
1-First Floor	Education - Classrooms (ages 9-18)	24	364.8	0	960	DCV

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 15 of 17)

L. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION	
Selections made by Documentation Author indicate which Certificates of Installation must be submitted for the features to be recognized for compliance. These documents must be retained and provided to the building inspector during construction and can be found online	
Building Component	Form/Title
Envelope	NRCH-ENV-01-E - Must be submitted for all buildings
Envelope	NRCH-ENV-E - Envelope (for all buildings)
Mechanical	NRCH-MCH-01-E - Must be submitted for all buildings
Mechanical	NRCH-MCH-E - For all buildings with Mechanical Systems
Indoor Lighting	NRCH-LTI-01-E - Must be submitted for all buildings
Indoor Lighting	NRCH-LTI-E - Indoor Lighting (for all buildings)

M. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE	
Selections made by Documentation Author indicate which Certificates of Acceptance must be submitted for the features to be recognized for compliance. These documents must be provided to the building inspector during construction and must be completed through an Acceptance Test Technician Certification Provider (ATTCP).	
Building Component	Form/Title
Envelope	NRCA-ENV-02-F - NRFC label verification for fenestration
Indoor Lighting	NRCA-LTI-02-A - Occupancy Sensors and Automatic Time Switch Controls.
Mechanical	NRCA-MCH-02-A - Outdoor Air must be submitted for all newly installed HVAC units. Note: MCH-02-A can be performed in conjunction with MCH-07-A Supply Fan VFD Acceptance (if applicable) since testing activities overlap
Mechanical	NRCA-MCH-05-A - Air Economizer Controls
Mechanical	NRCA-MCH-06-A Demand Control Ventilation Systems must be submitted for all systems required to employ demand controlled ventilation (refer to) can vary outside ventilation flow rates based on maintaining interior carbon dioxide (CO2) concentration setpoints.

N. DECLARATION OF REQUIRED CERTIFICATES OF VERIFICATION	
Selections made by Documentation Author indicate which Certificates of Verification must be submitted for the features to be recognized for compliance. These documents must be retained and provided to the building inspector during construction and can be found online	
There are no Certificates of Verification applicable to this project	

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 10 of 17)

G4. NONRESIDENTIAL AIR BARRIER	
01	02
Building Story Name	Air Barrier
Com-Floor 1	No air barrier

G5. OPAQUE SURFACE ASSEMBLY SUMMARY										
01	02	03	04	05	06		07	08	09	10
Surface Name	Construction Type	Area (ft²)	Framing Type	Cavity R-Value	Continuous R-Value		Units	Value	Description of Assembly Layers	Status¹
					Interior	Exterior				
R-19 Wood Framed Wall7	Exterior Wall	1,280	Wood	19	N/A	N/A	U-factor	0.0605	Wood siding - 1/2 in. Vapor permeable felt - 1/8 in. Composite-1 Gypsum Board - 1/2 in. Softwood - 1.5 in.	N
R-19 Metal Floor Crawlspace14	Exterior Floor	960	Metal	19	N/A	N/A	U-factor	0.0588	Vented Crawl Space Composite-2 Plywood - 1/2 in. Carpet - 3/4 in.	N
Standing Seam R-38 Metal16	Roof	960	N/A	36	N/A	N/A	U-factor	0.06	Metal Standing Seam - 1/16 in. Composite-3	N

¹ Status: N - New, A - Altered, E - Existing

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 13 of 17)

H11. ZONAL SYSTEM AND TERMINAL UNIT SUMMARY											
01	02	03	04	05	06	07	08	09	10	11	12
System ID	System Type	Qty	Rated Capacity (kBtu/h)	Airflow (cfm)	Fan						VSD
1-First Floor-Trm	Uncontrolled	1	N/A	N/A	1,100	N/A	0	N/A	N/A	N/A	<input type="checkbox"/>

K1. INDOOR CONDITIONED LIGHTING GENERAL INFO					
01	02	03	04	05	06
Occupancy Type ¹	Conditioned Floor Area ² (ft ²)	Installed Lighting Power (Watts)	Lighting Control Credits (Watts)	Additional (Custom) Allowance	
Classroom, Lecture, or Training/Vocational	960	384	0	0	0
Building Totals:	960	384	0	0	0

¹ See Table 140.6-C
² See NRCC-LTI-E for unconditioned spaces
³ Lighting information for existing spaces modeled is not included in this table

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 16 of 17)

Documentation Author's Declaration Statement	
1. I certify that this Certificate of Compliance documentation is accurate and complete.	
Documentation Author Name: LAL B. SAHGAJ	Documentation Author Signature:
Company: LSA CONSULTING ENGINEERS	Signature Date:
Address: 83, WINDSWEEP WAY	CEA/HERS Certification Identification (if applicable): M26885
City/State/Zip: MISSION VIEJO, CA 92692	Phone: (949) 830-4746

Responsible Person's Declaration statement	
I certify the following under penalty of perjury, under the laws of the State of California:	
1. The information provided on this Certificate of Compliance is true and correct.	
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).	
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.	
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.	
5. I understand that a registered copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections, and I will take the necessary steps to accomplish this requirement.	
6. I understand that a registered copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy, and I will take the necessary steps to accomplish these requirements.	

Responsible Designer Name:	Responsible Designer Signature:
Company: R & S TAVARES ASSOCIATES	Date Signed:
Address: 11590 W. Bernardo Court, Suite 100	License #: M26885
City/State/Zip: San Diego, Ca. 92127	Title:
Phone:	Scope:
Responsible Designer Name:	Responsible Designer Signature:
Company: R & S TAVARES ASSOCIATES	Date Signed:
Address: 11590 W. Bernardo Court, Suite 100	License #: M26885
City/State/Zip: San Diego, Ca. 92127	Title:
Phone:	Scope:

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 17 of 17)

Responsible Designer Name: Lal Sahgal	Responsible Designer Signature:
Company: LSA Consulting Engineers	Date Signed:
Address: 83, Windswept Way	License #: M26885
City/State/Zip: Mission Viejo, Ca. 92692	Title:
Phone:	Scope:

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 11 of 17)

G7A. FENESTRATION ASSEMBLY SUMMARY (NONRESIDENTIAL)								
01	02	03	04	05	06	07	08	09
Fenestration Assembly Name	Fenestration Type/Frame Type / Frame Type	Certification Method ¹	Assembly Method	Area (ft ²)	Overall U-factor	Overall SHGC	Overall VT	Status ²
Sierra Pacific Windows	Vertical fenestration Operable window	NFRF	Manufactured	64	0.35	0.24	0.5	N
Sola tube	N/A Skylight Fixed window N/A	NFRF	Manufactured	14	0.39	0.37	0.65	N

¹ Notes: Newly installed fenestration shall have a certified NFRF Label Certificate or use the CEC default tables found in Table 110.6-A and Table 110.6-B. Center of Glass (COG) values are for the glass-only, determined by the manufacturer, and are shown for ease of verification. Site-built fenestration values are calculated per Nonresidential Appendix N46 and are used in the analysis.
² Status: N - New, A - Altered, E - Existing

H1. DRY SYSTEM EQUIPMENT (FURNACES, AIR HANDLING UNITS, HEAT PUMPS, VRF, ECONOMIZERS ETC.)											
01	02	03	04	05	06	07	08	09	10	11	12
Equipment Name	Equipment Type	Qty	Total Heating Output (kBtu/h)	Supp Heat Output (kBtu/h)	Efficiency Unit	Efficiency	Total Cooling Output (kBtu/h)	Efficiency Unit	Efficiency	Economizer Type (if present)	Status ¹
AC-1	Single Package VHP Air System	1	34.37	13.65	COP	3.3	34.56	EER	11	Fixed DB	N

¹ Status: N - New, A - Altered, E - Existing

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 14 of 17)


K2. INDOOR CONDITIONED LIGHTING SCHEDULE					
Luminaire Schedule (includes all permanent installed lighting in conditioned space, and portable lighting over 0.3 w/ft ² in offices)					
01	02	03	04	05	06
Name or Item Tag	Complete Luminaire Description (i.e. 3-lamp fluorescent troffer, F32T8, one dimmable electronic ballast)	Watts per luminaire	How is Wattage determined	Total Number of Luminaires	Installed Watts
L-1	2x4 LED Panel	48	According to	8	384

¹ If lighting power densities were used in the compliance model Building Departments will need to check prescriptive forms for Luminaire Schedule details.


K3. INDOOR CONDITIONED LIGHTING CONTROL CREDITS								
Lighting Control Credits Schedule (includes all lighting controls installed in conditioned space for compliance credit per 140.6(a)2 and Table 140.6-A)								
01	02	03	04	05	06	07	08	09
Area Description	Primary Function Area (must meet requirements of Table 140.6-A and 170.2-1)	Type of Lighting Control	Power Adjustment Factor (PAF)	Luminaire Item Tag	Watts per Luminaire	# of Luminaires	Lighting Controlled (Watts)	Control Credit (Watts)
S-1-First Floor	Classroom, Lecture, or Training/Vocational	N/A	N/A	L-1	48	8	384	0
Lighting Control Credits (Conditioned) Total (Watts)							0	

K4. INDOOR CONDITIONED LIGHTING MANDATORY LIGHTING CONTROL		
Building Level Controls		
01	02	
Mandatory Demand Response 110.12(c)	Shut-Off Controls 130.1(c) & 160.5(b)4C	
Required	Required	
See NRCC-LTI-E for mandatory controls		

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:52:04
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0144

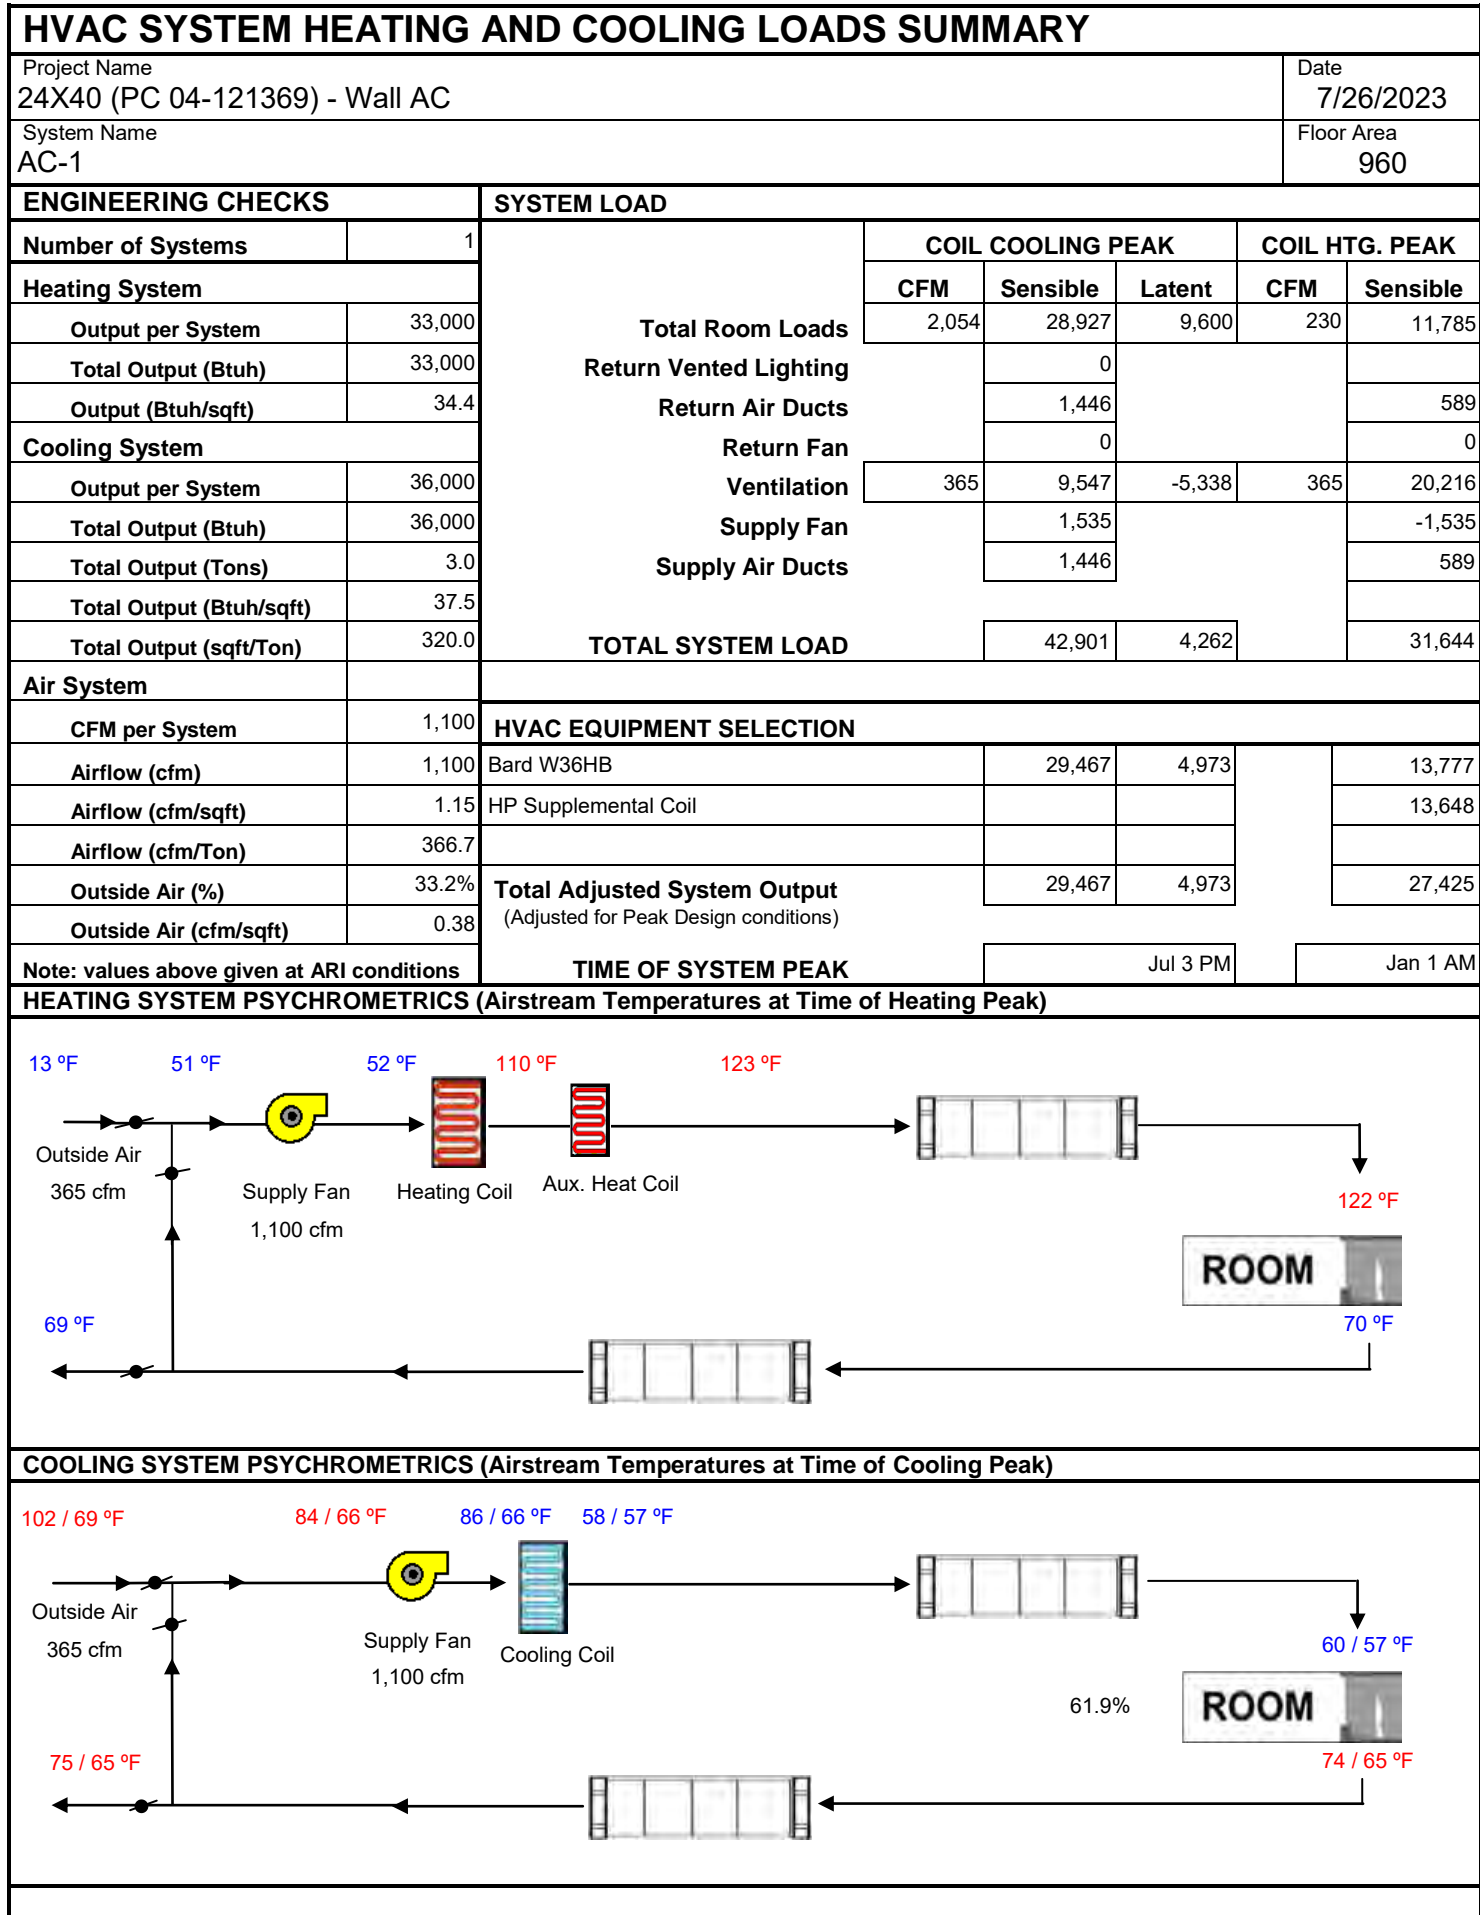

PROJECT SPECIFIC STATE AGENCY APPROVAL

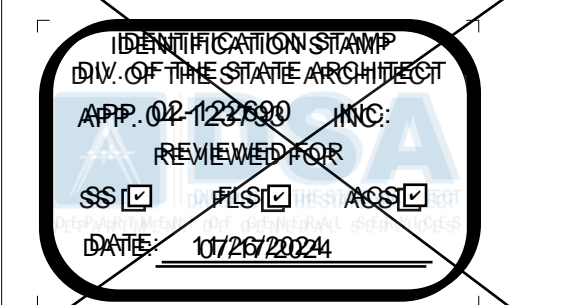

C:\Users\User\Documents\22088-Aries_24x40 PC - MainFile - Low Seismic_detached (2022)_CESAR24063.rvt

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 9 of 17)

C8. ENERGY USE INTENSITY (EUI)				
	Standard Design (kBtu/ft ² / yr)	Proposed Design (kBtu/ft ² / yr)	Margin (kBtu/ft ² / yr)	Margin Percentage
GROSS EUI ¹	51.89	43.01	8.88	17.11
NET EUI ¹	51.89	43.01	8.88	17.11

¹ Notes: Gross EUI is Energy Use Total (not including PV)/Total Building Area. Net EUI is Energy Use Total (including PV)/Total Building Area.

D1. EXCEPTIONAL CONDITIONS
• The project uses the Simplified Geometry Performance Modeling Approach which is not capable of modeling daylighting controls and assumes the prescriptive Secondary Daylit Control requirements are met. PRESCRIPTIVE COMPLIANCE documentation (form NRCC-LTI-02-E) for the requirements of section 140.6(d) Automatic Daylighting Controls in Secondary Daylit Zones is required.
• The building does not include service water heating. Verify that service water heating is not required and is not included in the design.
• Project is claiming Exception 2 to Section 140.10(a): No PV system is required where the required PV system size is less than 4 kWdc.

G1. ENVELOPE GENERAL INFORMATION (conditioned spaces only)			
01	02	03	04
Opaque Surfaces & Orientation	Total Gross Surface Area (ft ²)	Total Fenestration Area (ft ²)	Window to Wall Ratio (%)
North-Facing ¹	240	32	13.33
East-Facing ²	400	0	0
South-Facing ³	240	32	13.33
West-Facing ⁴	400	0	0
Total	1280	64	5
Roof	960	14	1.46

Notes:
¹North-Facing is oriented to within 45 degrees of true north, including 45 00'00" east of north (NE), but excluding 45 00'00" west of north (NW).
²East-Facing is oriented to within 45 degrees of true east, including 45 00'00" south of east (SE), but excluding 45 00'00" north of east (NE).
³South-Facing is oriented to within 45 degrees of true south, including 45 00'00" west of south (SW), but excluding 45 00'00" east of south (SE).
⁴West-Facing is oriented to within 45 degrees of true west, including 45 00'00" north of west (NW), but excluding 45 00'00" south of west (SW).

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:57:22
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0145

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 12 of 17)

H3. NONRESIDENTIAL / COMMON USE AREA FAN SYSTEMS SUMMARY												
01	02	03	04	05	06	07	08	09	10	11	12	13
Name or Item Tag	Qty	Design OA CFM	CFM	Power	Power Units	Control	Fan Type	CFM	Power	Power Units	Control	Status ¹
AC-1	1	364.8	1,100	0.5	BHP	Constant Vol	N/A	N/A	N/A	N/A	N/A	N

¹ Status: N - New, A - Altered, E - Existing

H8. SYSTEM SPECIAL FEATURES			
01	02	03	04
System Name	Equipment Type	Interlocks per 140.4(n) ¹	Other Special Features and Controls
AC-1	Single Package VHP Air System	No	Zone(s) With CO2 Sensor Vent. Control Fixed DB

Notes: This table includes controls related to the performance path only. For projects using the prescriptive path, mandatory and prescriptive controls requirements are documented on the NRCC-MCH-E.

¹ Yes = Interlocks are provided, No = Interlocks are not provided, NA means no operable openings.

H9. NONRESIDENTIAL / COMMON USE AREA & HOTEL/MOTEL VENTILATION						
01	02	03	04	05	06	07
Zone Name	Ventilation Function	# of People	Supply OA CFM	Exhaust CFM	Conditioned Area (sf)	DCV or Occupant Sensor Controls, or Both
1-First Floor	Education - Classrooms (ages 9-18)	24	364.8	0	960	DCV

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:57:22
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0145

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 15 of 17)

L. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION	
Selections made by Documentation Author indicate which Certificates of Installation must be submitted for the features to be recognized for compliance. These documents must be retained and provided to the building inspector during construction and can be found online	
Building Component	Form/Title
Envelope	NRCH-ENV-01-E - Must be submitted for all buildings
Envelope	NRCH-ENV-E - Envelope (for all buildings)
Mechanical	NRCH-MCH-01-E - Must be submitted for all buildings
Mechanical	NRCH-MCH-E - For all buildings with Mechanical Systems
Indoor Lighting	NRCH-LTI-01-E - Must be submitted for all buildings
Indoor Lighting	NRCH-LTI-E - Indoor Lighting (for all buildings)

M. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE	
Selections made by Documentation Author indicate which Certificates of Acceptance must be submitted for the features to be recognized for compliance. These documents must be provided to the building inspector during construction and must be completed through an Acceptance Test Technician Certification Provider (ATTCP).	
Building Component	Form/Title
Envelope	NRCA-ENV-02-F - NRFC label verification for fenestration
Indoor Lighting	NRCA-LTI-Q2-A - Occupancy Sensors and Automatic Time Switch Controls.
Mechanical	NRCA-MCH-02-A - Outdoor Air must be submitted for all newly installed HVAC units. Note: MCH-02-A can be performed in conjunction with MCH-07-A Supply Fan VFD Acceptance (if applicable) since testing activities overlap
Mechanical	NRCA-MCH-05-A - Air Economizer Controls
Mechanical	NRCA-MCH-06-A Demand Control Ventilation Systems must be submitted for all systems required to employ demand controlled ventilation [refer to] can vary outside ventilation flow rates based on maintaining interior carbon dioxide (CO2) concentration setpoints.

N. DECLARATION OF REQUIRED CERTIFICATES OF VERIFICATION	
Selections made by Documentation Author indicate which Certificates of Verification must be submitted for the features to be recognized for compliance. These documents must be retained and provided to the building inspector during construction and can be found online	
There are no Certificates of Verification applicable to this project	

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:57:22
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0145

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 10 of 17)

G4. NONRESIDENTIAL AIR BARRIER	
01	02
Building Story Name	Air Barrier
Com-Floor 1	No air barrier

G5. OPAQUE SURFACE ASSEMBLY SUMMARY									
01	02	03	04	05	06	07	08	09	10
Surface Name	Construction Type	Area (ft ²)	Framing Type	Cavity R-Value	Continuous R-Value	Units	Value	Description of Assembly Layers	Status ¹
R-19 Wood Framed Wall7	Exterior Wall	1,280	Wood	19	N/A	N/A	U-factor	Wood siding - 1/2 in. Vapor permeable felt - 1/8 in. Composite-1 gypsum Board - 1/2 in. Softwood - 1.5 in.	N
R-19 Metal Floor Crawlsps34	Exterior Floor	960	Metal	19	N/A	N/A	U-factor	Vented Crawl Space Composite-2 Plywood - 1/2 in. Carpet - 3/4 in.	N
Standing Seam R-38 Metal16	Roof	960	N/A	36	N/A	N/A	U-factor	Metal Standing Seam - 1/16 in. Composite-3	N

¹ Status: N - New, A - Altered, E - Existing

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:57:22
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0145

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 13 of 17)

H11. ZONAL SYSTEM AND TERMINAL UNIT SUMMARY											
01	02	03	04	05	06	07	08	09	10	11	12
System ID	System Type	Qty	Rated Capacity (kBtu/h)	Airflow (cfm)	Fan	Heating	Cooling	Design	Min.	Min. Ratio	VSD
1-First Floor-Trm	Uncontrolled	1	N/A	N/A	1,100	N/A	0	N/A	N/A	N/A	

K1. INDOOR CONDITIONED LIGHTING GENERAL INFO					
01	02	03	04	05	06
Occupancy Type ¹	Conditioned Floor Area ² (ft ²)	Installed Lighting Power (Watts)	Lighting Control Credits (Watts)	Additional (Custom) Allowance	
Classroom, Lecture, or Training Vocational	960	384	0	Area Category Footnotes (Watts)	Area Category Footnotes (Watts)
Building Totals:	960	384	0	0	0

¹See Table 140.6-C
²See NRCC-LTI-E for unconditioned spaces
³Lighting information for existing spaces modeled is not included in this table

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:57:22
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0145

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 16 of 17)

Documentation Author's Declaration Statement	
1. I certify that this Certificate of Compliance documentation is accurate and complete.	
Documentation Author Name: LAL B. SAHGAJ	Documentation Author Signature:
Company: LSA CONSULTING ENGINEERS	Signature Date:
Address: 83, WINDSWEEP WAY	CEA/HERS Certification Identification (if applicable): M26885
City/State/Zip: MISSION VIEJO, CA 92692	Phone: (949) 830-4746

Responsible Person's Declaration statement	
I certify the following under penalty of perjury, under the laws of the State of California:	
1. The information provided on this Certificate of Compliance is true and correct.	
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)	
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.	
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.	
5. I understand that a registered copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections, and I will take the necessary steps to accomplish this requirement.	
6. I understand that a registered copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy, and I will take the necessary steps to accomplish these requirements.	

Responsible Designer Name:	Responsible Designer Signature:
Company: R & S Tavares Associates	Date Signed:
Address: 11590 W. Bernardo Court, Suite 100	License #: M26885
City/State/Zip: San Diego, Ca. 92127	Title:
Phone:	Scope:
Responsible Designer Name:	Responsible Designer Signature:
Company: R & S Tavares Associates	Date Signed:
Address: 11590 W. Bernardo Court, Suite 100	License #: M26885
City/State/Zip: San Diego, Ca. 92127	Title:
Phone:	Scope:

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:57:22
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0145

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 17 of 17)

Responsible Designer Name: Lal Sahgal	Responsible Designer Signature:
Company: LSA Consulting Engineers	Date Signed:
Address: 83, Windswept Way	License #: M26885
City/State/Zip: Mission Viejo, Ca. 92692	Title:
Phone:	Scope:

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:57:22
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0145

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 11 of 17)

G7A. FENESTRATION ASSEMBLY SUMMARY (NONRESIDENTIAL)								
01	02	03	04	05	06	07	08	09
Fenestration Assembly Name	Fenestration Type/Product Type / Frame Type	Certification Method ¹	Assembly Method	Area (ft ²)	Overall U-factor	Overall SHGC	Overall VT	Status ²
Sierra Pacific Windows	Vertical fenestration Operable window	NFRF	Manufactured	64	0.35	0.24	0.5	N
Sola tube	N/A Skylight Fixed window N/A	NFRF	Manufactured	14	0.39	0.37	0.65	N

¹ Notes: Newly installed fenestration shall have a certified NFRF Label Certificate or use the CEC default tables found in Table 110.6-A and Table 110.6-B. Center of Glass (COG) values are for the glass-only, determined by the manufacturer, and are shown for ease of verification. Site-built fenestration values are calculated per Nonresidential Appendix N46 and are used in the analysis.
² Status: N - New, A - Altered, E - Existing

H1. DRY SYSTEM EQUIPMENT (FURNACES, AIR HANDLING UNITS, HEAT PUMPS, VRF, ECONOMIZERS ETC.)											
01	02	03	04	05	06	07	08	09	10	11	12
Equipment Name	Equipment Type	Qty	Total Heating Output (kBtu/h)	Supp Heat Output (kBtu/h)	Efficiency Unit	Efficiency	Total Cooling Output (kBtu/h)	Efficiency Unit	Efficiency	Economizer Type (if present)	Status ¹
AC-1	Single Package VHP Air System	1	34.37	13.65	COP	3.3	34.56	EER	11	Fixed DB	N

¹ Status: N - New, A - Altered, E - Existing

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:57:22
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0145

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 14 of 17)


K2. INDOOR CONDITIONED LIGHTING SCHEDULE					
Luminaire Schedule (includes all permanent installed lighting in conditioned space, and portable lighting over 0.3 w/ft ² in offices)					
01	02	03	04	05	06
Name or Item Tag	Complete Luminaire Description (i.e. 3-lamp fluorescent troffer, F32T8, one dimmable electronic ballast)	Watts per luminaire	How is Wattage determined	Total Number of Luminaires	Installed Watts
L-1	2x4 LED Panel	48	According to	8	384

¹If lighting power densities were used in the compliance model Building Departments will need to check prescriptive forms for Luminaire Schedule details.


K3. INDOOR CONDITIONED LIGHTING CONTROL CREDITS								
Lighting Control Credits Schedule (includes all lighting controls installed in conditioned space for compliance credit per 140.6(a)(2) and Table 140.6-A)								
01	02	03	04	05	06	07	08	09
Area Description	Primary Function Area (must meet requirements of Table 140.6-A and 170.2-1)	Type of Lighting Control	Power Adjustment Factor (PAF)	Luminaire Item Tag	Watts per Luminaire	# of Luminaires	Lighting Controlled (Watts)	Control Credit (Watts)
S-1-First Floor	Classroom, Lecture, or Training Vocational	N/A	N/A	L-1	48	8	384	0
Lighting Control Credits (Conditioned) Total (Watts)							0	

K4. INDOOR CONDITIONED LIGHTING MANDATORY LIGHTING CONTROL	
Building Level Controls	
01	02
Mandatory Demand Response 110.12(c)	Shut-Off Controls 130.1(c) & 160.5(b)(4)C
Required	Required
See NRCC-LTI-E for mandatory controls	

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-25 10:57:22
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0145

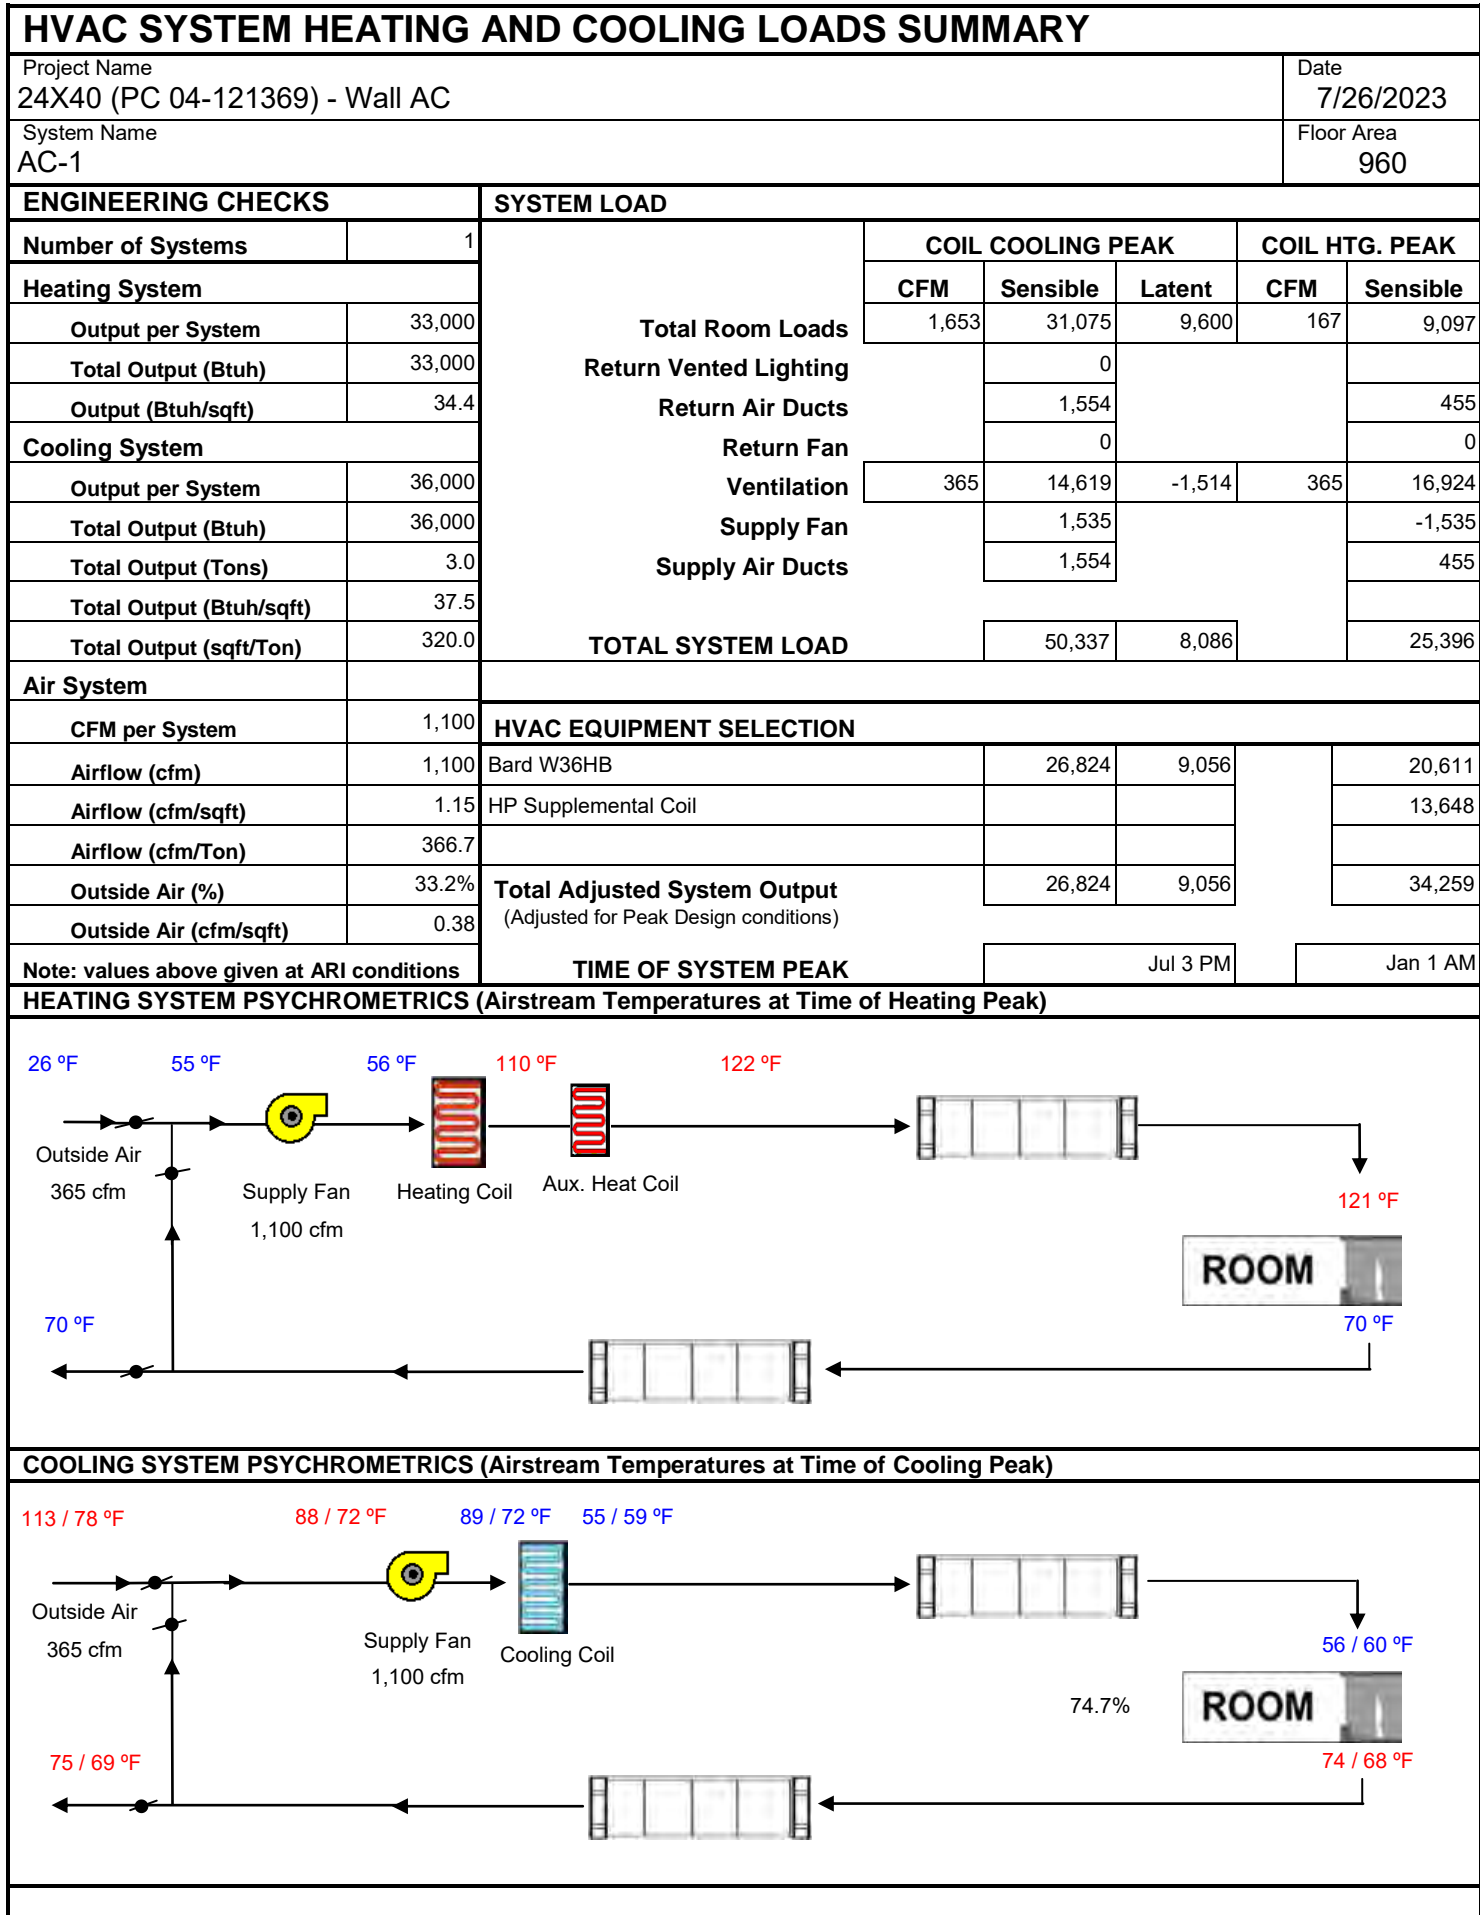

PROJECT SPECIFIC STATE AGENCY APPROVAL

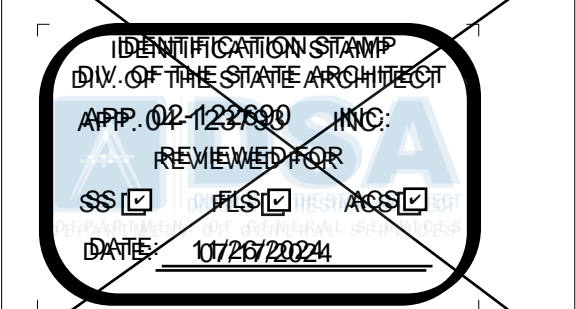

PROFESSIONAL STAMP



CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 9 of 17)

	Standard Design (kBtu/ft ² / yr)	Proposed Design (kBtu/ft ² / yr)	Margin (kBtu/ft ² / yr)	Margin Percentage
GROSS EUI ¹	67.5	49	18.5	27.41
NET EUI ¹	67.5	49	18.5	27.41

¹ Notes: Gross EUI is Energy Use Total (not including PV)/Total Building Area. Net EUI is Energy Use Total (including PV)/Total Building Area.

D1. EXCEPTIONAL CONDITIONS
• The project uses the Simplified Geometry Performance Modeling Approach which is not capable of modeling daylighting controls and assumes the prescriptive Secondary Daylit Control requirements are met. PRESCRIPTIVE COMPLIANCE documentation (form NRCC-LTI-02-E) for the requirements of section 140.6(d) Automatic Daylighting Controls in Secondary Daylit Zones is required.
• The building does not include service water heating. Verify that service water heating is not required and is not included in the design.
• Project is claiming Exception 2 to Section 140.10(a): No PV system is required where the required PV system size is less than 4 kWdc.

01	02	03	04
Opaque Surfaces & Orientation	Total Gross Surface Area (ft ²)	Total Fenestration Area (ft ²)	Window to Wall Ratio (%)
North-Facing ¹	400	0	0
East-Facing ²	240	32	13.33
South-Facing ³	400	0	0
West-Facing ⁴	240	32	13.33
Total	1280	64	5
Roof	960	14	1.46

Notes
¹North-Facing is oriented to within 45 degrees of true north, including 45 00°00" east of north (NE), but excluding 45 00°00" west of north (NW).
²East-Facing is oriented to within 45 degrees of true east, including 45 00°00" south of east (SE), but excluding 45 00°00" north of east (NE).
³South-Facing is oriented to within 45 degrees of true south, including 45 00°00" west of south (SW), but excluding 45 00°00" east of south (SE).
⁴West-Facing is oriented to within 45 degrees of true west, including 45 00°00" north of west (NW), but excluding 45 00°00" south of west (SW).

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-26 13:02:48
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0170

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 12 of 17)

01	02	03	04	05	06	07	08	09	10	11	12	13
Name or Item Tag	Qty	Design OA CFM	CFM	Power	Power Units	Control	Fan Type	CFM	Power	Power Units	Control	Status ¹
AC-1	1	364.8	1,100	0.5	BHP	Constant Vol	N/A	N/A	N/A	N/A	N/A	N

¹ Status: N - New, A - Altered, E - Existing

H8. SYSTEM SPECIAL FEATURES			
01	02	03	04
System Name	Equipment Type	Interlocks per 140.4(n) ¹	Other Special Features and Controls
AC-1	Single Package VHP Air System	No	Zone(s) With CO2 Sensor Vent. Control Fixed DB

Notes: This table includes controls related to the performance path only. For projects using the prescriptive path, mandatory and prescriptive controls requirements are documented on the NRCC-MCH-E.

¹ Yes = Interlocks are provided, No = Interlocks are not provided, NA means no operable openings.

01	02	03	04	05	06	07
Zone Name	Ventilation Function	# of People	Supply OA CFM	Exhaust CFM	Conditioned Area (sf)	DCV or Occupant Sensor Controls, or Both
1-First Floor	Education - Classrooms (ages 9-18)	24	364.8	0	960	DCV

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-26 13:02:48
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0170

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 15 of 17)

L. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION	
Selections made by Documentation Author indicate which Certificates of Installation must be submitted for the features to be recognized for compliance. These documents must be retained and provided to the building inspector during construction and can be found online	
Building Component	Form/Title
Envelope	NRCH-ENV-01-E - Must be submitted for all buildings
Envelope	NRCH-ENV-E - Envelope (for all buildings)
Mechanical	NRCH-MCH-01-E - Must be submitted for all buildings
Mechanical	NRCH-MCH-E - For all buildings with Mechanical Systems
Indoor Lighting	NRCH-LTI-01-E - Must be submitted for all buildings
Indoor Lighting	NRCH-LTI-E - Indoor Lighting (for all buildings)

M. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE	
Selections made by Documentation Author indicate which Certificates of Acceptance must be submitted for the features to be recognized for compliance. These documents must be provided to the building inspector during construction and must be completed through an Acceptance Test Technician Certification Provider (ATTCP).	
Building Component	Form/Title
Envelope	NRCA-ENV-02-F - NRFC label verification for fenestration
Indoor Lighting	NRCA-LTI-02-A - Occupancy Sensors and Automatic Time Switch Controls.
Mechanical	NRCA-MCH-02-A - Outdoor Air must be submitted for all newly installed HVAC units. Note: MCH-02-A can be performed in conjunction with MCH-07-A Supply Fan VFD Acceptance (if applicable) since testing activities overlap
Mechanical	NRCA-MCH-05-A - Air Economizer Controls
Mechanical	NRCA-MCH-06-A Demand Control Ventilation Systems must be submitted for all systems required to employ demand controlled ventilation [refer to] can vary outside ventilation flow rates based on maintaining interior carbon dioxide (CO2) concentration setpoints.

N. DECLARATION OF REQUIRED CERTIFICATES OF VERIFICATION	
Selections made by Documentation Author indicate which Certificates of Verification must be submitted for the features to be recognized for compliance. These documents must be retained and provided to the building inspector during construction and can be found online	
There are no Certificates of Verification applicable to this project	

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-26 13:02:48
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0170

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 10 of 17)

G4. NONRESIDENTIAL AIR BARRIER	
01	02
Building Story Name	Air Barrier
Com-Floor 1	No air barrier

01	02	03	04	05	06	07	08	09	10
Surface Name	Construction Type	Area (ft ²)	Framing Type	Cavity R-Value	Continuous R-Value	Units	Value	Description of Assembly Layers	Status ¹
R-19 Wood Framed Wall7	Exterior Wall	1,280	Wood	19	N/A	N/A	U-factor	Wood siding - 1/2 in. Vapor permeable felt - 1/8 in. Composite-1 Gypsum Board - 1/2 in. Softwood - 1.5 in.	N
R-19 Metal Floor Crawlspace3	Exterior Floor	960	Metal	19	N/A	N/A	U-factor	Vented Crawl Space Composite-2 Plywood - 1/2 in. Carpet - 3/4 in.	N
Standing Seam R-38 Metal16	Roof	960	N/A	36	N/A	N/A	U-factor	Metal Standing Seam - 1/16 in. Composite-3	N

¹ Status: N - New, A - Altered, E - Existing

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-26 13:02:48
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0170

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 13 of 17)

H11. ZONAL SYSTEM AND TERMINAL UNIT SUMMARY											
01	02	03	04	05	06	07	08	09	10	11	12
System ID	System Type	Qty	Rated Capacity (kBtu/h)		Airflow (cfm)		Fan			VSD	
			Heating	Cooling	Design	Min.	Min. Ratio	Power	Power Units		Cycles
1-First Floor-Trm	Uncontrolled	1	N/A	N/A	1,100	N/A	0	N/A	N/A	N/A	<input type="checkbox"/>

K1. INDOOR CONDITIONED LIGHTING GENERAL INFO					
01	02	03	04	05	06
Occupancy Type ¹	Conditioned Floor Area ² (ft ²)	Installed Lighting Power (Watts)	Lighting Control Credits (Watts)	Additional (Custom) Allowance	
				Area Category Footnotes (Watts)	Area Category Footnotes (Watts)
Classroom, Lecture, or Training Vocational	960	384	0	0	0
Building Totals:	960	384	0	0	0

¹See Table 140.6-C

²See NRCC-LTI-E for unconditioned spaces

³Lighting information for existing spaces modeled is not included in this table

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-26 13:02:48
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0170

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 16 of 17)

Documentation Author's Declaration Statement	
I, I certify that this Certificate of Compliance documentation is accurate and complete.	
Documentation Author Name: LAL B. SAHGAJ	Documentation Author Signature:
Company: LSA CONSULTING ENGINEERS	Signature Date:
Address: 83, WINDSWEEP WAY	CEA/HERS Certification Identification (if applicable): M26885
City/State/Zip: MISSION VIEJO, CA 92692	Phone: (949) 830-4746

Responsible Person's Declaration statement	
I certify the following under penalty of perjury, under the laws of the State of California:	
1. The information provided on this Certificate of Compliance is true and correct.	
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)	
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.	
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.	
5. I understand that a registered copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections, and I will take the necessary steps to accomplish this requirement.	
6. I understand that a registered copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy, and I will take the necessary steps to accomplish these requirements.	

Responsible Designer Name:	Responsible Designer Signature:
Company: R & S Tavares Associates	Date Signed:
Address: 11590 W. Bernardo Court, Suite 100	License #: M26885
City/State/Zip: San Diego, Ca. 92127	Title:
Phone:	Scope:
Responsible Designer Name:	Responsible Designer Signature:
Company: R & S Tavares Associates	Date Signed:
Address: 11590 W. Bernardo Court, Suite 100	License #: M26885
City/State/Zip: San Diego, Ca. 92127	Title:
Phone:	Scope:

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-26 13:02:48
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0170

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 17 of 17)

Responsible Designer Name: Lal Sahgal	Responsible Designer Signature:
Company: LSA Consulting Engineers	Date Signed:
Address: 83, Windswept Way	License #: M26885
City/State/Zip: Mission Viejo, Ca. 92692	Title:
Phone:	Scope:

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-26 13:02:48
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0170

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 11 of 17)

G7A. FENESTRATION ASSEMBLY SUMMARY (NONRESIDENTIAL)								
01	02	03	04	05	06	07	08	09
Fenestration Assembly Name	Fenestration Type/ Product Type / Frame Type	Certification Method ¹	Assembly Method	Area (ft²)	Overall U-factor	Overall SHGC	Overall VT	Status ²
Sierra Pacific Windows	Vertical fenestration Operable window N/A	NFRC	Manufactured	64	0.35	0.24	0.5	N
Sola tube	Skylight Fixed window N/A	NFRC	Manufactured	14	0.39	0.37	0.65	N

¹ Notes: Newly installed fenestration shall have a certified NFRC Label Certificate or use the CEC default tables found in Table 110.6-A and Table 110.6-B. Center of Glass (COG) values are for the glass-only, determined by the manufacturer, and are shown for ease of verification. Site-built fenestration values are calculated per Nonresidential Appendix NA6 and are used in the analysis.

² Status: N - New, A - Altered, E - Existing

H1. DRY SYSTEM EQUIPMENT (FURNACES, AIR HANDLING UNITS, HEAT PUMPS, VRF, ECONOMIZERS ETC.)																	
01	02	03	04				05		06		07		08	09	10	11	12
Equipment Name	Equipment Type	Qty	Heating				Cooling		Economizer Type (if present)	Status ¹							
			Total Heating Output (kBtu/h)	Supp Heat Output (kBtu/h)	Efficiency Unit	Efficiency	Total Cooling Output (kBtu/h)	Efficiency Unit			Efficiency						
AC-1	Single Package VHP Air System	1	34.37	13.65	COP	3.3	34.56	EER	11	Fixed DB	N						

¹ Status: N - New, A - Altered, E - Existing

¹ Status: N - New, A - Altered, E - Existing

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-26 13:02:48
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0170

CERTIFICATE OF COMPLIANCE - NONRESIDENTIAL PERFORMANCE COMPLIANCE METHOD	NRCC-PRF-E
Nonresidential Performance Compliance Method	(Page 14 of 17)


K2. INDOOR CONDITIONED LIGHTING SCHEDULE					
Luminaire Schedule (includes all permanent installed lighting in conditioned space, and portable lighting over 0.3 w/ft ² in offices)					
01	02	03	04	05	06
Name or Item Tag	Complete Luminaire Description (i.e. 3 lamp fluorescent troffer, F32T8, one dimmable electronic ballast)	Installed Watts (Conditioned)			Installed Watts
		Watts per luminaire	How is Wattage determined	Total Number of Luminaires	
L-1	2x4 LED Panel	48	According to	8	384
*If lighting power densities were used in the compliance model Building Departments will need to check prescriptive forms for Luminaire Schedule details.					

¹If lighting power densities were used in the compliance model Building Departments will need to check prescriptive forms for Luminaire Schedule details.


K3. INDOOR CONDITIONED LIGHTING CONTROL CREDITS								
Lighting Control Credits Schedule (Includes all lighting controls installed in conditioned space for compliance credit per 140.6(a)2 and Table 140.6-A)								
01	02	03	04	05	06	07	08	09
Area Description	Primary Function Area (must meet requirements of Table 140.6-A and 170.2-1)	Type of Lighting Control	Power Adjustment Factor (PAF)	Luminaire Item Tag	Watts per Luminaire	# of Luminaires	Lighting Controlled (Watts)	Control Credit (Watts)
S-1-First Floor	Classroom, Lecture, or Training Vocational	N/A	N/A	L-1	48	8	384	0
Lighting Control Credits (Conditioned) Total (Watts)							0	

K4. INDOOR CONDITIONED LIGHTING MANDATORY LIGHTING CONTROL	
Building Level Controls	
01	02
Mandatory Demand Response 110.12(c)	Shut-Off Controls 130.1(c) & 160.5(b)4C
Required	Required
See NRCC-LTI-E for mandatory controls	

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Report Generated: 2023-07-26 13:02:48
Schema Version: rev 20220601 Compliance ID: EnergyPro-4958-0723-0170

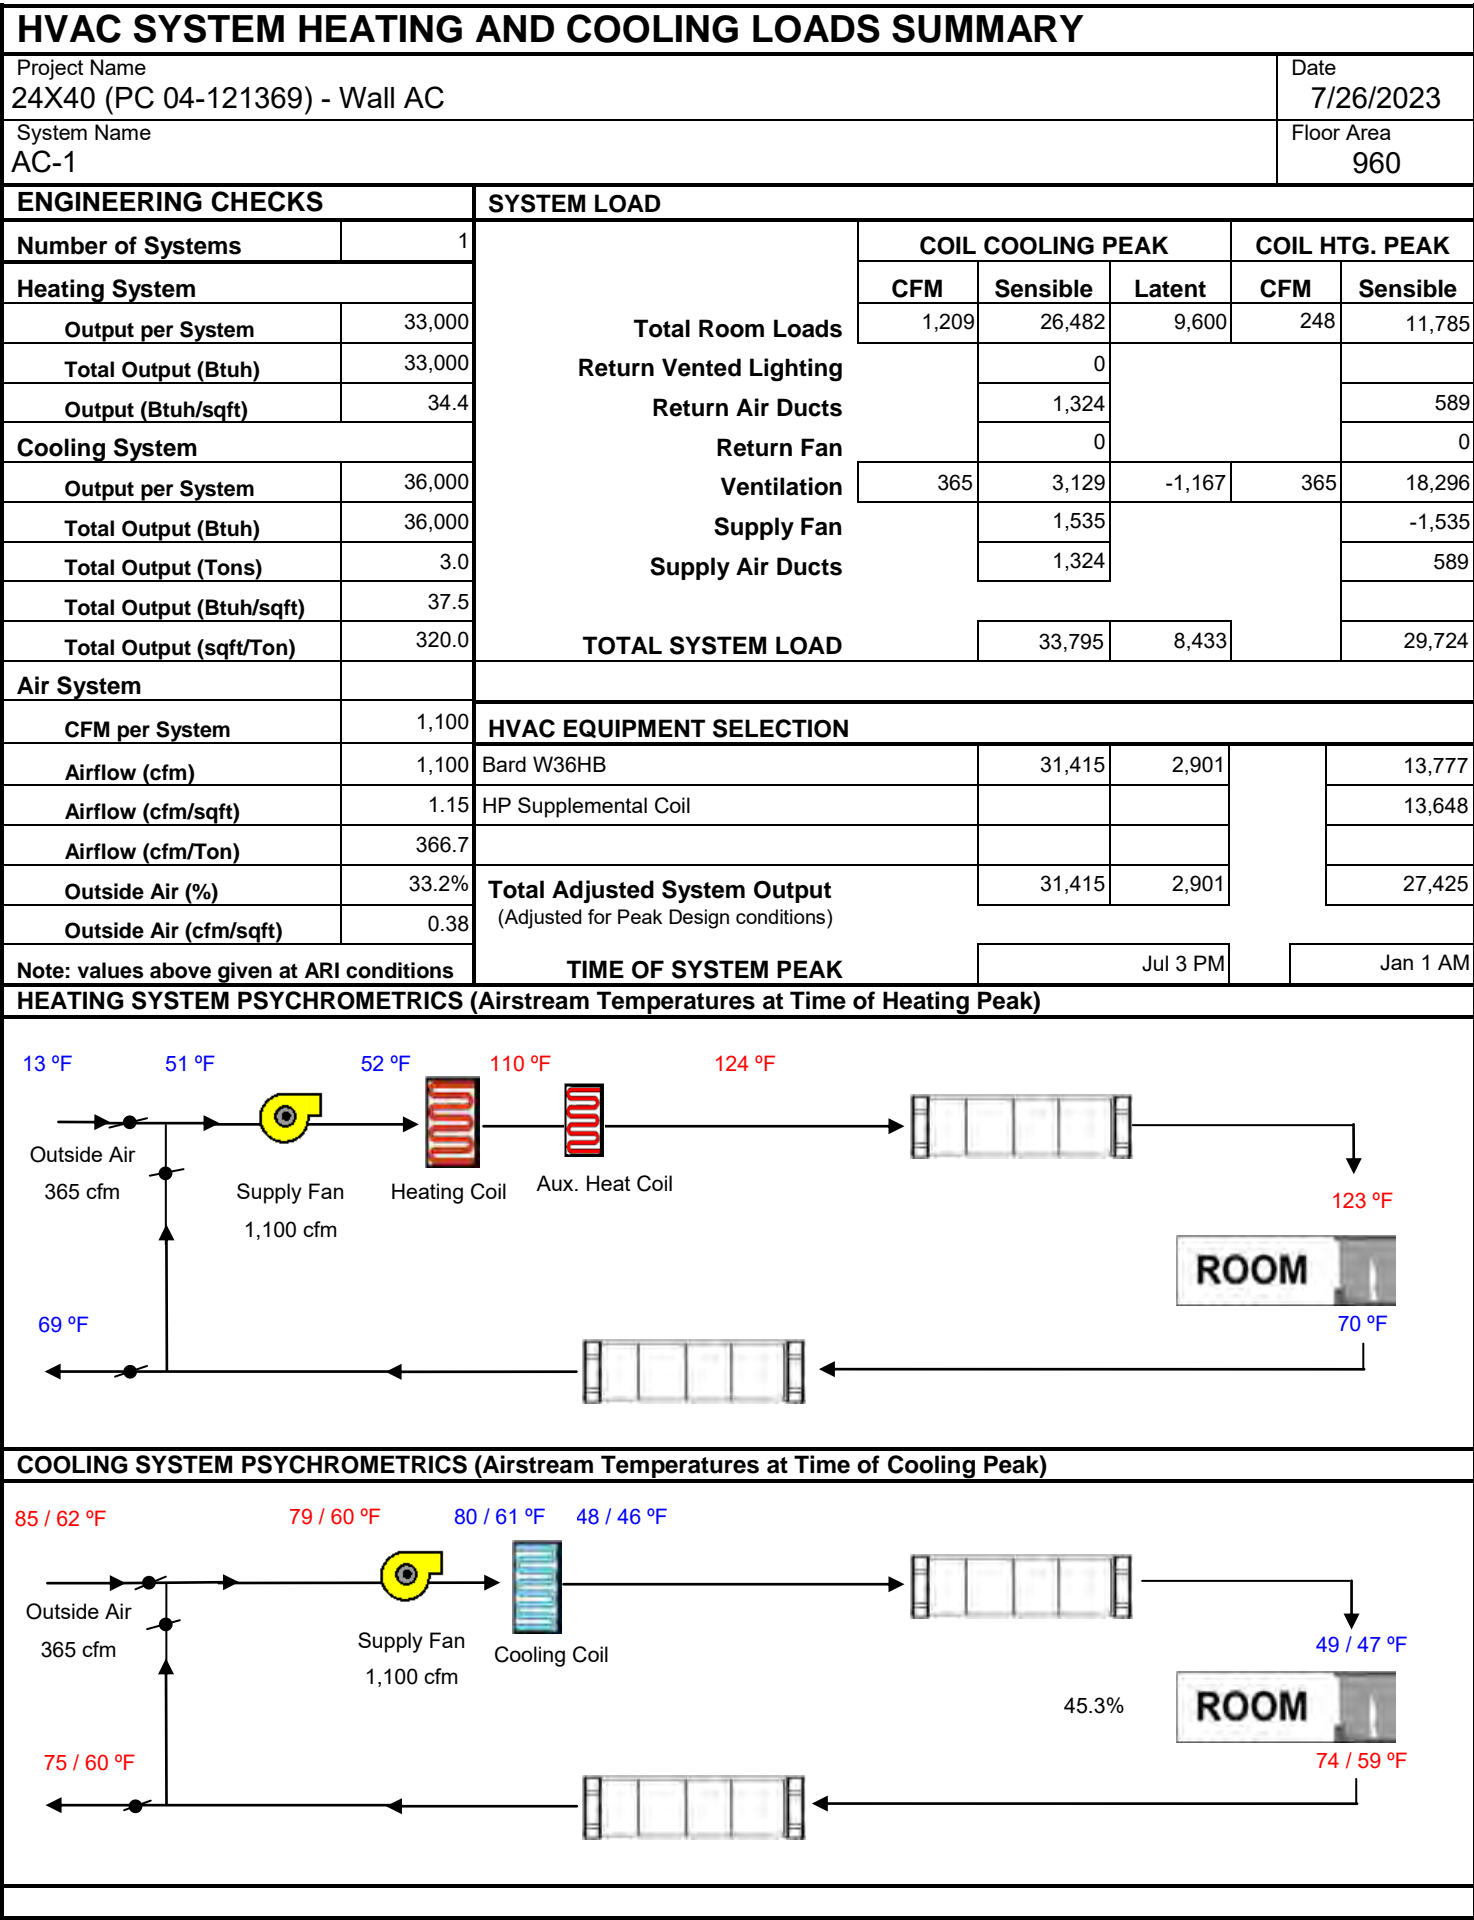

PROJECT SPECIFIC STATE AGENCY APPROVAL

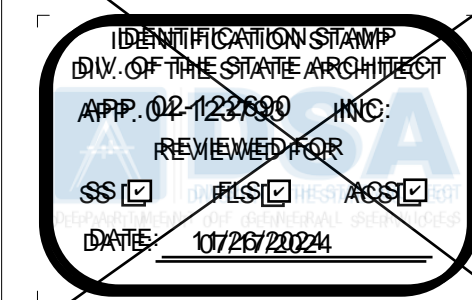

PROFESSIONAL STAMP




02/16/24

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



ORIGINAL PC STATE AGENCY APPROVAL

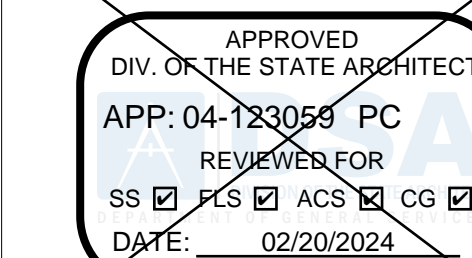

Revision Schedule

Description Date

PRE-CHECK (PC) DOCUMENT

CODE: 2019 CBC

A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
24'x40' T24 CZ 16
(WALL AC)

PROJECT NUMBER

22088

DRAWN BY

Author

CHECKED BY

Checker

DATE

06/15/2021

SHEET NO.

M2.14

SHEET OF

ENVELOPE MANDATORY MEASURES: NONRESIDENTIAL

ENV-MM

Project Name

120X40 (PC 04-116504) - Wall AC

Date

6/23/2018

DESCRIPTION

Building Envelope Measures:

§110.8(a):

Installed insulating material shall have been certified by the manufacturer to comply with the California Quality Standards for insulating material, Title 20 Chapter 4, Article 3.

§110.8(c):

All Insulating Materials shall be installed in compliance with the flame spread rating and smoke density requirements of Sections 2602 and 707 of Title 24, Part 2.

§110.8(g):

Heated slab floors shall be insulated according to the requirements in Table 110.8-A.

§110.7(a):

All Exterior Joints and openings in the building that are observable sources of air leakage shall be caulked, gasketed, weatherstripped or otherwise sealed.

§110.6(a):

Manufactured fenestration products and exterior doors shall have air infiltration rates not exceeding 0.3 cfm/ft.² of window area, 0.3 cfm/ft.² of door area for residential doors, 0.3 cfm/ft.² of door area for nonresidential single doors (swinging and sliding), and 1.0 cfm/ft.² for nonresidential double doors (swinging).

§110.6(a):

Fenestration U-factor shall be rated in accordance with NFRC 100, or the applicable default U-factor.

§110.6(a):

Fenestration SHGC shall be rated in accordance with NFRC 200, or NFRC 100 for site-built fenestration, or the applicable default SHGC.

§110.6(b):

Site Constructed Doors, Windows and Skylights shall be caulked between the unit and the building, and shall be weatherstripped (except for unframed glass doors and fire doors).

§120.7(a):

The opaque portions of the roof/ceiling that separates conditioned spaces from unconditioned spaces or ambient air shall meet the applicable U-Factor requirements as follows:
Metal Buildings- The weighted average U-factor of the roof assembly shall not exceed 0.098.
Wood Framed and Others- The weighted average U-factor of the roof assembly shall not exceed 0.075.
The opaque portions of walls that separate conditioned spaces from unconditioned spaces or ambient air shall meet the applicable U-Factor as follows:
Metal Building- The weighted average U-factor of the wall assembly shall not exceed 0.113.
Metal Framed- The weighted average U-factor of the wall assembly shall not exceed 0.151.
Light Mass Walls- A 6 inch or greater Hollow Core Concrete Masonry Unit shall have a U-factor not to exceed 0.440.
Heavy Mass Walls- An 8 inch or greater Hollow Core Concrete Masonry Unit shall have a U-factor not to exceed 0.690.
Wood Framed and Others- The weighted average U-factor of the wall assembly shall not exceed 0.110.
Spandrel Panels and Opaque Curtain Wall- The weighted average U-factor of the spandrel panels and opaque curtain wall assembly shall not exceed 0.280.
Demising Walls- The opaque portions of framed demising walls shall meet the requirements of Item A or B below:
A. Wood framed walls shall be insulated to meet a U-factor not greater than 0.099.
B. Metal Framed walls shall be insulated to meet a U-factor not greater than 0.151.

§120.7(b):

The opaque portions of floors and soffits that separate conditioned spaces from unconditioned spaces or ambient air shall meet the applicable U-Factor requirements as follows:

§120.7(c):

Raised Mass Floors- Shall have a minimum of 3 inches of lightweight concrete over a metal deck or the weighted average U-factor of the floor assembly shall not exceed 0.349.
Other Floors- The weighted average U-factor of the floor assembly shall not exceed 0.071.

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-PLB-E

This document is used to demonstrate compliance for nonresidential occupancies with requirements in 110.1, 110.3, 120.3, and 140.5, and with requirements in 141.0 for additions and alterations, for domestic water heating scopes using the prescriptive path. For high-rise residential and hotel/motel occupancies compliance is demonstrated with requirements in 110.1, 110.3, 160.4 and 170.2(d), and with requirements 180.1 for additions and 180.2 for alterations.

Project Name:

24X40 (PC 04-121369) - Wall AC

Report Page:

(Page 1 of 6)

Project Address:

Climate Zone 14

Date Prepared:

9/7/2023

A. GENERAL INFORMATION

01

Project Location (city)

Palmdale

02

Climate Zone

14

03

Occupancy Types Within Project (select all that apply):

☐ Classroom

B. PROJECT SCOPE

This table includes domestic water heating systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive paths outlined in 140.1/170.2(d) and 141.0(a)/180.1, or 141.0(b)(2)/180.2 for additions or alterations. Solar water heating systems are documented on the NRCC-SAB compliance document. Combined hydronic water heating systems are documented on the NRCC-MCH compliance document.

01

My project consists of (check all that apply):

☒ New system (DHW system being installed for the first time)

☐ System Alteration (equipment, distribution or controls)

02

System Type^{1,2}

Individual System (serving nonresidential spaces)

03

System Components

☒ Equipment

☒ Distribution

☒ Controls

04

Compliance Results

COMPLIES

¹ Dwelling units refers to hotel/motel guest rooms and units in a multifamily residential occupancy.
² DHW systems serving 2 or more dwelling units are considered "Central Systems" for multifamily occupancies

C. COMPLIANCE RESULTS

This table C will indicate if the project data into the compliance document is compliant with water heating requirements. If this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D or the table indicated as not compliant for guidance.

01

Domestic Hot Water Equipment

Table F

Yes

02

Distribution Systems

Table G

Yes

03

Controls

Table H

Yes

04

Compliance Results

COMPLIES

D. EXCEPTIONAL CONDITIONS

This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance

Generated Date/Time:

Documentation Software: EnergyPro

Report Version: 2022.0.000

Report Generated: 2023-09-07 12:06:05

Compliance ID: EnergyPro-4958-0923-0242

Report Generated: 2023-09-07 12:06:05

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-PLB-E

This document is used to demonstrate compliance for nonresidential occupancies with requirements in 110.1, 110.3, 120.3, and 140.5, and with requirements in 141.0 for additions and alterations, for domestic water heating scopes using the prescriptive path. For high-rise residential and hotel/motel occupancies compliance is demonstrated with requirements in 110.1, 110.3, 160.4 and 170.2(d), and with requirements 180.1 for additions and 180.2 for alterations.

Project Name:

24X40 (PC 04-121369) - Wall AC

Report Page:

(Page 2 of 6)

Date Prepared:

9/7/2023

E. ADDITIONAL REMARKS

This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

F. DOMESTIC HOT WATER EQUIPMENT

This table is used to demonstrate compliance with mandatory equipment requirements in 110.1 and 110.3. Compliance with prescriptive requirements in 140.5(c)/170.2(d) must also be demonstrated and with 141.0/180.1/180.2 for addition and alteration scopes.

Equipment Schedule: Water Heating Efficiency and Standby Loss

03

04

05

06

System Name

A O Smith DEL-10

Exception to 140.5(c)/170.2(d)

☐

Gas Service Water Heating System >= 1MMBtu/h¹

Capacity-weighted Average Efficiency %

07

08

09

10

11

12

13

14

15

Name or Item Tag

Equipment Type

Volume (gal)

Rated Input Capacity (Btu/h)

Max GPM/ First Hour Rating (FHR)

Rated Efficiency

Minimum Efficiency Required

Efficiency Unit

Designed Standby Loss

Maximum Standby Loss

A O Smith DEL-10

Consumer Rated Electric Storage

10

5,120

FHR >= 75

0.95

0.93

UEF

¹FOOTNOTE: In systems >= 1MMBtu/h with multiple units, gas water heaters with input capacity > 100,000 Btu/h may meet 90% E_t requirements via an input capacity-weighted average.

Water Heating Equipment All Occupancies

Yes

No

Not Applicable

Requirement

18

☐

☐

☒

Unfired storage tank insulation shall have Internal + External >= R-16 OR External >= R-3.5. Label required per 110.3(c)

19

☐

☐

☒

New state buildings 60% of energy for service water heating from site solar energy or recovered energy per 110.3(c)(5)

20

☐

☐

☒

Insulation valves for instantaneous water heater with input rating < 6.8 MBtu/h or 2.101 has been specified per 110.3(c)(6)

21

☐

☐

☒

School buildings < 25,000 ft² and < 4 stories must install a heat pump water heating system per 140.5(a). Water heating systems serving an individual bathroom space may be an instantaneous electric water heater.

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance

Generated Date/Time:

Documentation Software: EnergyPro

Report Version: 2022.0.000

Report Generated: 2023-09-07 12:06:05

Compliance ID: EnergyPro-4958-0923-0242

Report Generated: 2023-09-07 12:06:05

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-PLB-E

This document is used to demonstrate compliance for nonresidential occupancies with requirements in 110.1, 110.3, 120.3, and 140.5, and with requirements in 141.0 for additions and alterations, for domestic water heating scopes using the prescriptive path. For high-rise residential and hotel/motel occupancies compliance is demonstrated with requirements in 110.1, 110.3, 160.4 and 170.2(d), and with requirements 180.1 for additions and 180.2 for alterations.

Project Name:

24X40 (PC 04-121369) - Wall AC

Report Page:

(Page 4 of 6)

Date Prepared:

9/7/2023

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-PLB-E

This document is used to demonstrate compliance for nonresidential occupancies with requirements in 110.1, 110.3, 120.3, and 140.5, and with requirements in 141.0 for additions and alterations, for domestic water heating scopes using the prescriptive path. For high-rise residential and hotel/motel occupancies compliance is demonstrated with requirements in 110.1, 110.3, 160.4 and 170.2(d), and with requirements 180.1 for additions and 180.2 for alterations.

Project Name:

24X40 (PC 04-121369) - Wall AC

Report Page:

(Page 5 of 6)

Date Prepared:

9/7/2023

H. DOMESTIC HOT WATER CONTROLS

This table is used to demonstrate compliance with control requirements in 110.3 for all occupancies. For multifamily residential and hotel/motel occupancies, compliance is also demonstrated with requirements in 160.4(e)/170.2(d).

Yes

No

Not Applicable

Requirement

01

☒

☐

☐

Construction documents require manufacturer certification that service water heating systems are equipped with automatic temperature controls capable of adjusting temperature settings per 110.3(a).

02

☐

☐

☒

Systems with capacity > 167,000 BTU/h equipped with outlet temperature controls per 110.3(c)1 unless covered by California Plumbing Code 613.0.

03

☐

☐

☒

Controls for circulating pumps or electrical heat trace systems are capable of automatically turning off the system per 613.0(c)2 unless systems serve healthcare facility.

04

☐

☐

☒

For recirculation systems serving multiple dwelling units, design includes automatic pump controls per 170.2(d) or 180.1(b)3 for additions.

05

☐

☐

☒

For recirculation systems serving individual dwelling units, design includes manual on/off controls as specified in Reference Appendix R44.4.5 per 170.2(d).

06

☐

☐

☒

Combustion air positive shut-off shall be provided per 160.4(3) on all newly installed commercial boilers as follows:
• Boilers with input capacity >= 2.5 MMBtu/h, in which the boiler is designed to operate with a nonpositive vent static pressure.
• Boilers where one stack serves two or more boilers with a total combined input capacity per stack of 2.5 MMBtu/h.
Boiler combustion air fans with motor >= 10 hp shall meet one of the following
• The fan motor shall be driven by a variable speed drive OR
• The fan motor shall include controls that limit the fan motor demand to <=30% of the total design wattage at 50% of the design air volume.

07

☐

☐

☒

The fan motor shall be driven by a variable speed drive OR
• The fan motor shall include controls that limit the fan motor demand to <=30% of the total design wattage at 50% of the design air volume.

08

☐

☐

☒

Newly installed boilers with an input capacity (q_{ig}/7.5MMBtu/h and a steady state full-load combustion efficiency < 90% shall maintain excess (black-gas) oxygen concentrations <= 5% by volume on a dry basis over firing rates of 20-100%. Combustion air volume shall be controlled with respect to firing rate or flue gas oxygen concentration. Use of a common gas and combustion air control linkage or jack shaft is prohibited.

TABLE 120.3-A / 160.4-A PIPE INSULATION THICKNESS					
Fluid Temperature Range (°F)	Conductivity Range (Btu-in. per hour per ft. per °F)	Insulation Mean Rating Temp (°F)	Nominal Pipe Diameter (in)		
			< 1	1 to < 1.5	1.5 to < 4
			Minimum Insulation Required		
105-140	0.22 - 0.28	100	1.0 in or R-7.7	1.5 in or R-12.5	1.5 in or R-11
			2.0 in or R-16		

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-PLB-E

This document is used to demonstrate compliance for nonresidential occupancies with requirements in 110.1, 110.3, 120.3, and 140.5, and with requirements in 141.0 for additions and alterations, for domestic water heating scopes using the prescriptive path. For high-rise residential and hotel/motel occupancies compliance is demonstrated with requirements in 110.1, 110.3, 160.4 and 170.2(d), and with requirements 180.1 for additions and 180.2 for alterations.

Project Name:

24X40 (PC 04-121369) - Wall AC

Report Page:

(Page 5 of 6)

Date Prepared:

9/7/2023

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-PLB-E

This document is used to demonstrate compliance for nonresidential occupancies with requirements in 110.1, 110.3, 120.3, and 140.5, and with requirements in 141.0 for additions and alterations, for domestic water heating scopes using the prescriptive path. For high-rise residential and hotel/motel occupancies compliance is demonstrated with requirements in 110.1, 110.3, 160.4 and 170.2(d), and with requirements 180.1 for additions and 180.2 for alterations.

Project Name:

24X40 (PC 04-121369) - Wall AC

Report Page:

(Page 5 of 6)

Date Prepared:

9/7/2023

I. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION

Selections have been made based on information provided in this document. If any selection has been changed by permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and can be found online.

Form/Title

NRCC-PLB-E - Must be submitted for all buildings

J. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

There are no forms required for this project.

K. DECLARATION OF REQUIRED CERTIFICATES OF VERIFICATION

There are no forms required for this project.

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance

Generated Date/Time:

Documentation Software: EnergyPro

Report Version: 2022.0.000

Report Generated: 2023-09-07 12:06:05

Compliance ID: EnergyPro-4958-0923-0242

Report Generated: 2023-09-07 12:06:05

STATE OF CALIFORNIA

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-PLB-E

This document is used to demonstrate compliance for nonresidential occupancies with requirements in 110.1, 110.3, 120.3, and 140.5, and with requirements in 141.0 for additions and alterations, for domestic water heating scopes using the prescriptive path. For high-rise residential and hotel/motel occupancies compliance is demonstrated with requirements in 110.1, 110.3, 160.4 and 170.2(d), and with requirements 180.1 for additions and 180.2 for alterations.

Project Name:

24X40 (PC 04-121369) - Wall AC

Report Page:

(Page 6 of 6)

Date Prepared:

9/7/2023

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name:

Al B. SANGAL

Signature Date:

9/7/2023

Address:

83, WINDSWEEP WAY

City/State/Zip:

MISSION VIEJO CA 92692

Phone:

(949) 830-4746

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

1. The information provided in this Certificate of Compliance is true and correct.

2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).

3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.

4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.

5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name:

Lal Sahgal

Signature Date:

2023-09-07

Address:

83, Windswept Way

City/State/Zip:

Mission Viejo Ca. 92692

Phone:

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance

Generated Date/Time:

Documentation Software: EnergyPro

Report Version: 2022.0.000

Report Generated: 2023-09-07 12:06:05

Compliance ID: EnergyPro-4958-0923-0242

Report Generated: 2023-09-07 12:06:05

Mandatory Measures: The following notes (items) represent the Mandatory Measures for all buildings.

Heat pumps with supplementary electric resistance heaters shall have controls:

- That prevent supplementary heater operation when the heating load can be met by the heat pump alone; and
- In which the cut-on temperature for compression heating is higher than the cut-on temperature for supplementary heating, and the cut-off temperature for compression heating is higher than the cut-off temperature for supplementary heating.

The minimum rate of outdoor air required per Section 120.1 (b) 2 shall be supplied to each space at all time the space is usually occupied.

The Lesser of the minimum rate of outdoor air required by Sec. 120.1 (b) 2, or three complete air changes shall be supplied to the entire building during the one-hour period immediately before the building is normally occupied.

Hotel/Motel Guest Room Thermostats shall have numeric temperature set points in degrees F, and set point stops accessible only to authorized personnel, to restrict over-heating and over-cooling.

All air distribution system ducts and plenums, including, but not limited to, building cavities, mechanical closets, air-handler boxes and support platforms used as ducts or plenums, shall be installed, sealed and insulated to meet the requirements of chapter 6 of the 2001 CMC. Supply-air and return-air ducts conveying heated or cooled air shall be insulated to a minimum installed level of R-8, unless ducts are in conditioned space.

The thermostatic controls for HVAC systems shall meet the following requirements as applicable:

- Each space conditioning zone shall be controlled by an individual thermostatic control that responds to temperature within the zone and meets the applicable requirements of Subsection (b).
- Each Thermostatic control required by Subsection (a) shall be capable of being set locally or remotely by adjustment or selection of sensors to control:
 - Comfort heating down to 55°F or lower.
 - Comfort Cooling up to 85°F or higher.
 - Both heating and cooling, the thermostatic controls shall be capable of providing a temperature range or dead band of at least 5°F within which the supply of heating and cooling energy to the zone is shut off or reduced to a minimum.

- Outdoor air supply and exhaust equipment shall be installed with dampers that automatically close upon fan shutdown.
- Demand Control Ventilation Devices (CO2 sensors) shall be installed in accordance with Sec. 120.1 (c) 4.
- Each space-conditioning system shall be installed with controls that comply with Items 1 and 2 below:
 - Are capable of automatically shutting off the system during periods of non-use and shall have:
 - An automatic time switch control device complying with Sec. 119(c), with an accessible manual override that allows operation of the system for up to 4 hours; or
 - An occupancy sensor; or
 - A four-hour timer that can be manually operated.
 - EXCEPTION: Mechanical systems serving retail stores and associated malls, restaurants, grocery stores, churches, and theaters equipped with 7-day programmable timers.
- Automatically restart and temporarily operate the system as required to maintain:
 - A setback heating thermostat set point, if the system provides mechanical heating; and
 - EXCEPTION: Area with the design winter outdoor temperature of greater than 32°F.
 - A setup cooling thermostat set point, if the system provides mechanical cooling.

EXCEPTION: Area with the design summer outdoor temperature of less than 100°F.
EXCEPTION: Systems serving hotel/motel guest rooms, if they have a readily accessible manual shut-off switch.

The piping for all space conditioning and service water heating systems shall be insulated in accordance with TABLE 123-A.

Service water heating systems and equipment shall meet the applicable requirements of the Appliance Efficiency Regulations as required by Sec. 110.1.

Service hot water systems with circulating pumps or with electrical heat trace systems shall be capable of automatically turning off the system.

Lavatories in public restrooms shall have controls that limit the water supply temperature to 110°F.

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

Revision Schedule		
#	Description	Date

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
ENVELOPE AND
NOTES

PROJECT NUMBER
22088

DRAWN BY
rMc/CG

CHECKED BY
RH/RT


DATE

SHEET NO.
M3.3


SHEET OF

NOTES:


- 1) MASTIC SEALANT SHALL BE USED TO SEAL ALL SEAMS BETWEEN THE PLENUM AND ROOF BEAM.
- 2) THE SUPPLY DUCTS SHALL BE ATTACHED TO THE PLENUM COLLARS AND MASTIC SHALL BE USED TO SEAL THE DUCTS TO THE COLLARS.

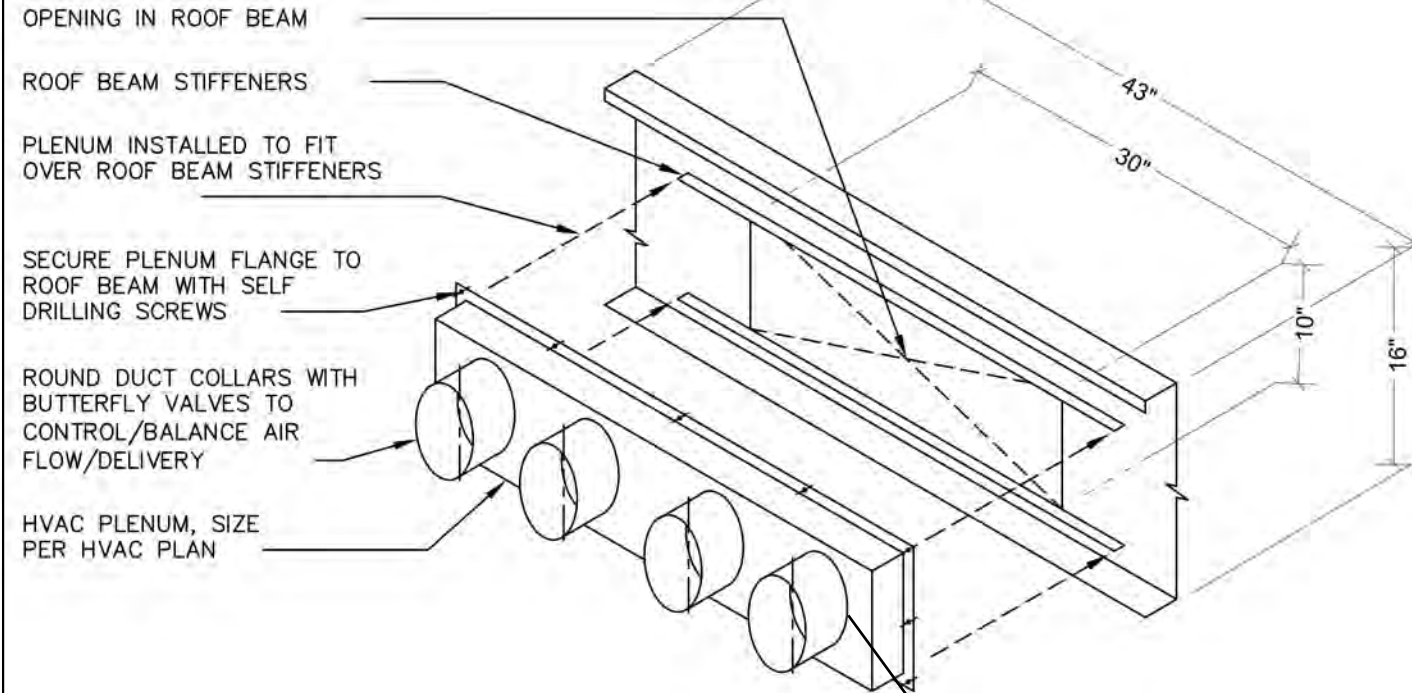

6 NTS
WALL MT. HVAC PLENUM

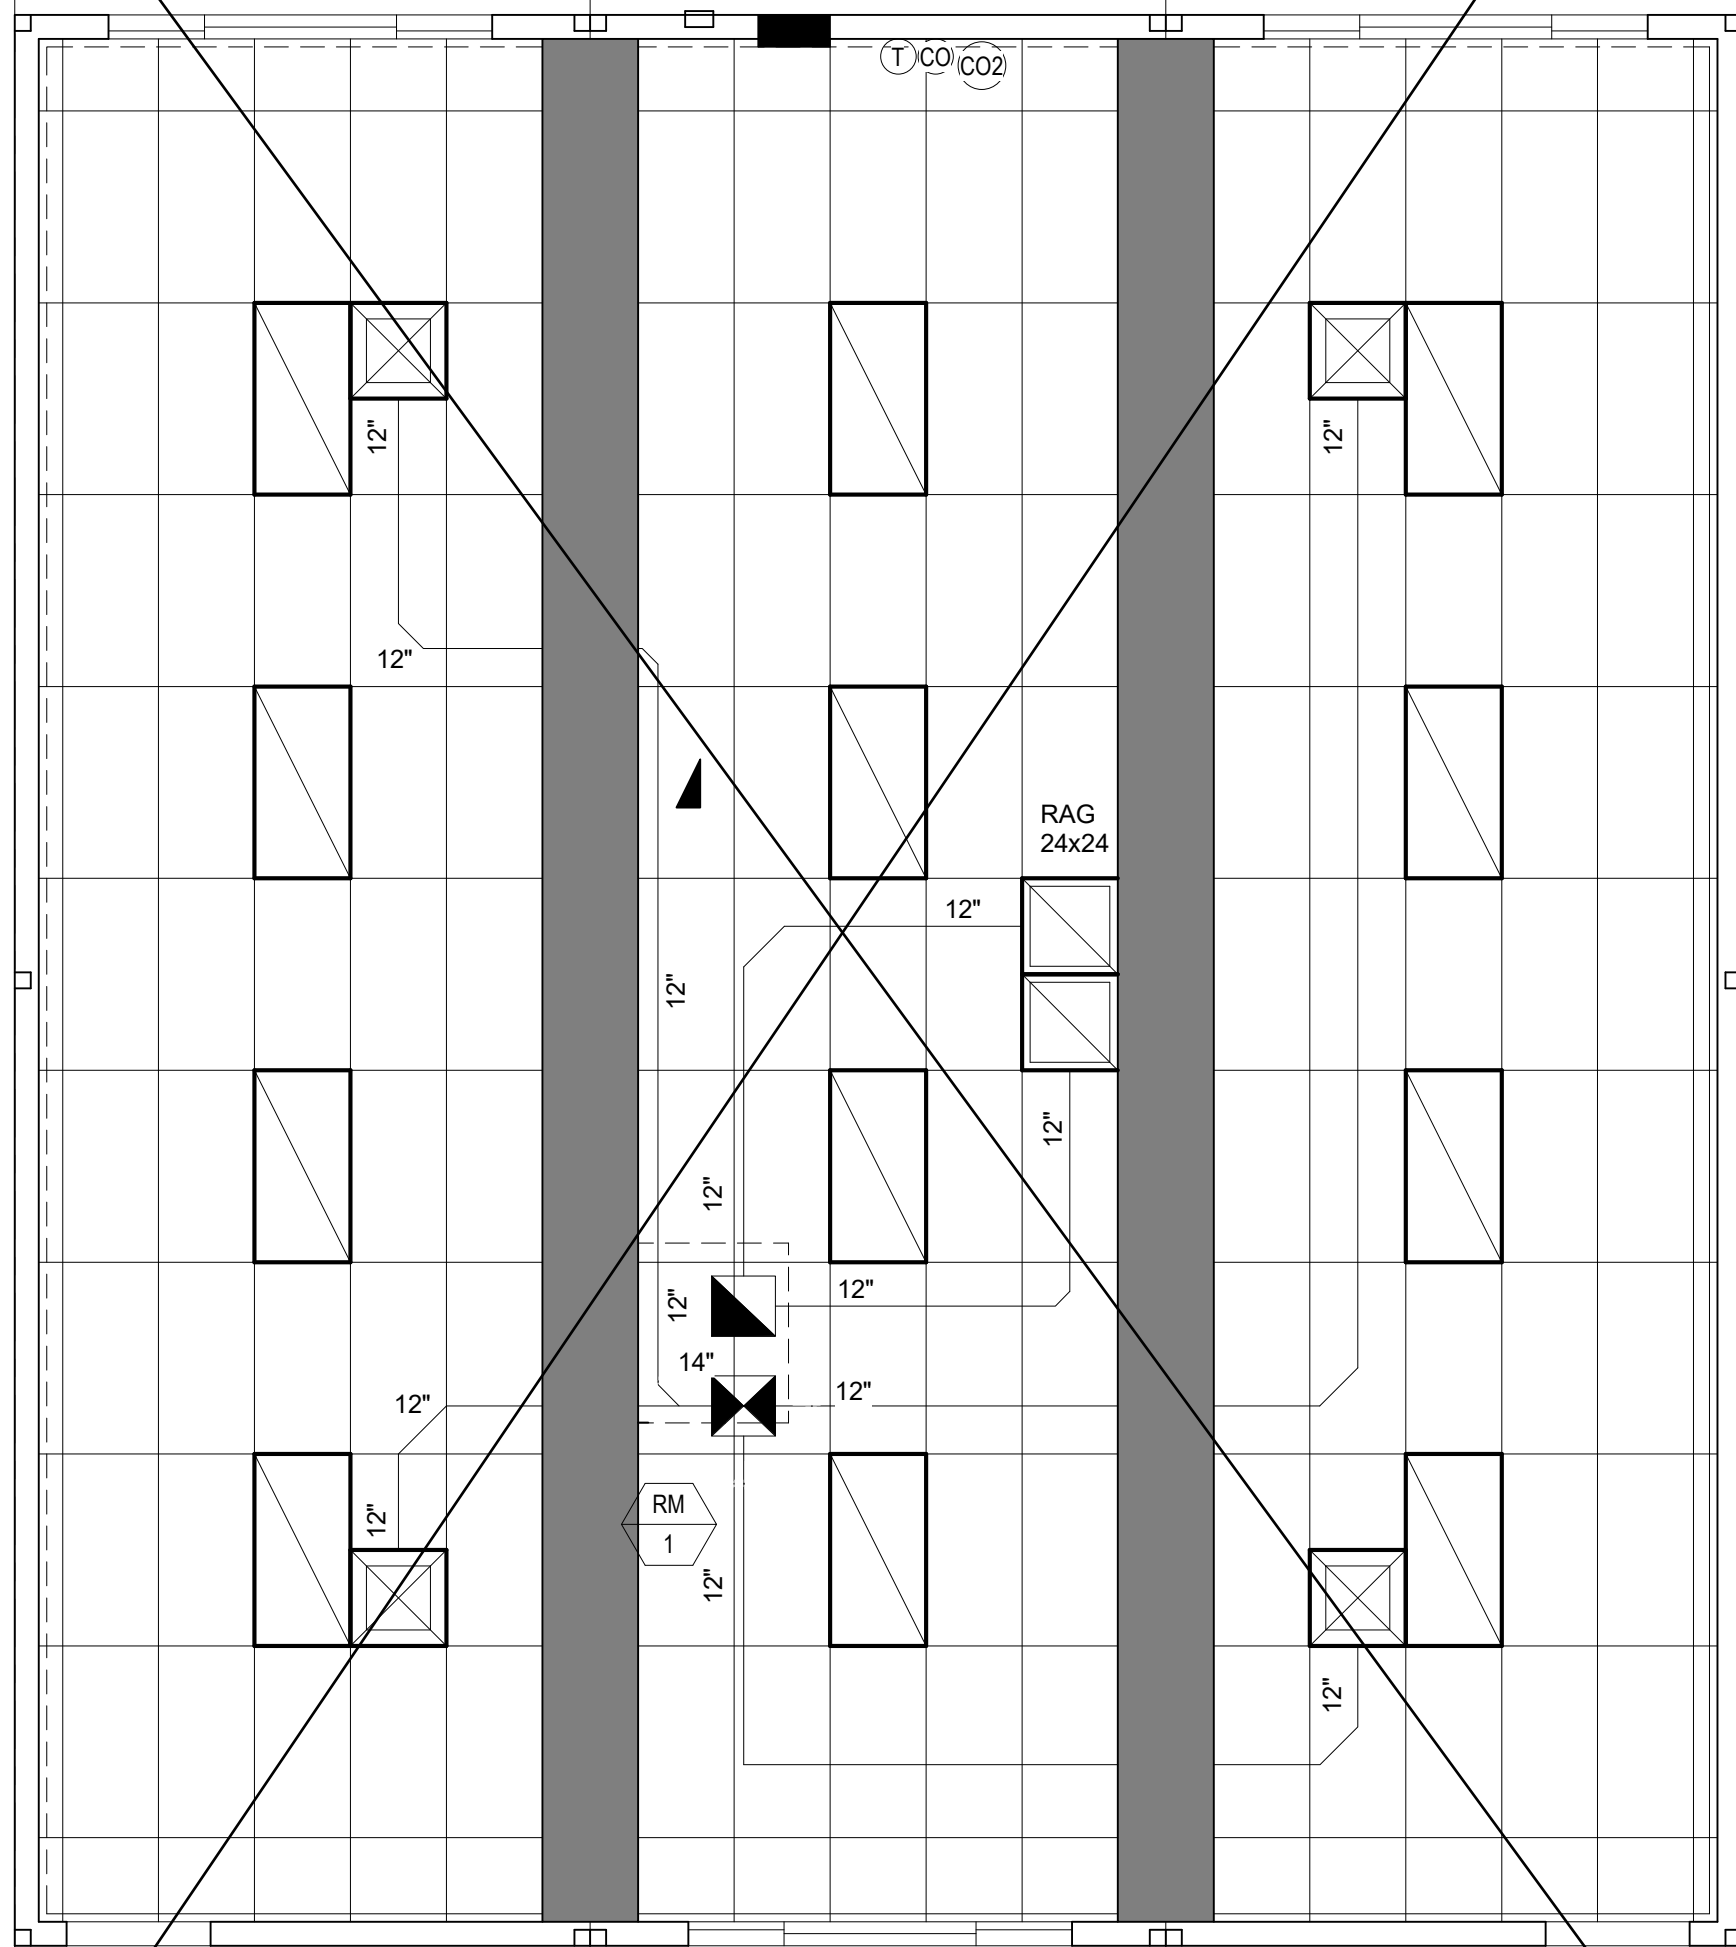



OPT. ROOF MOUNTED

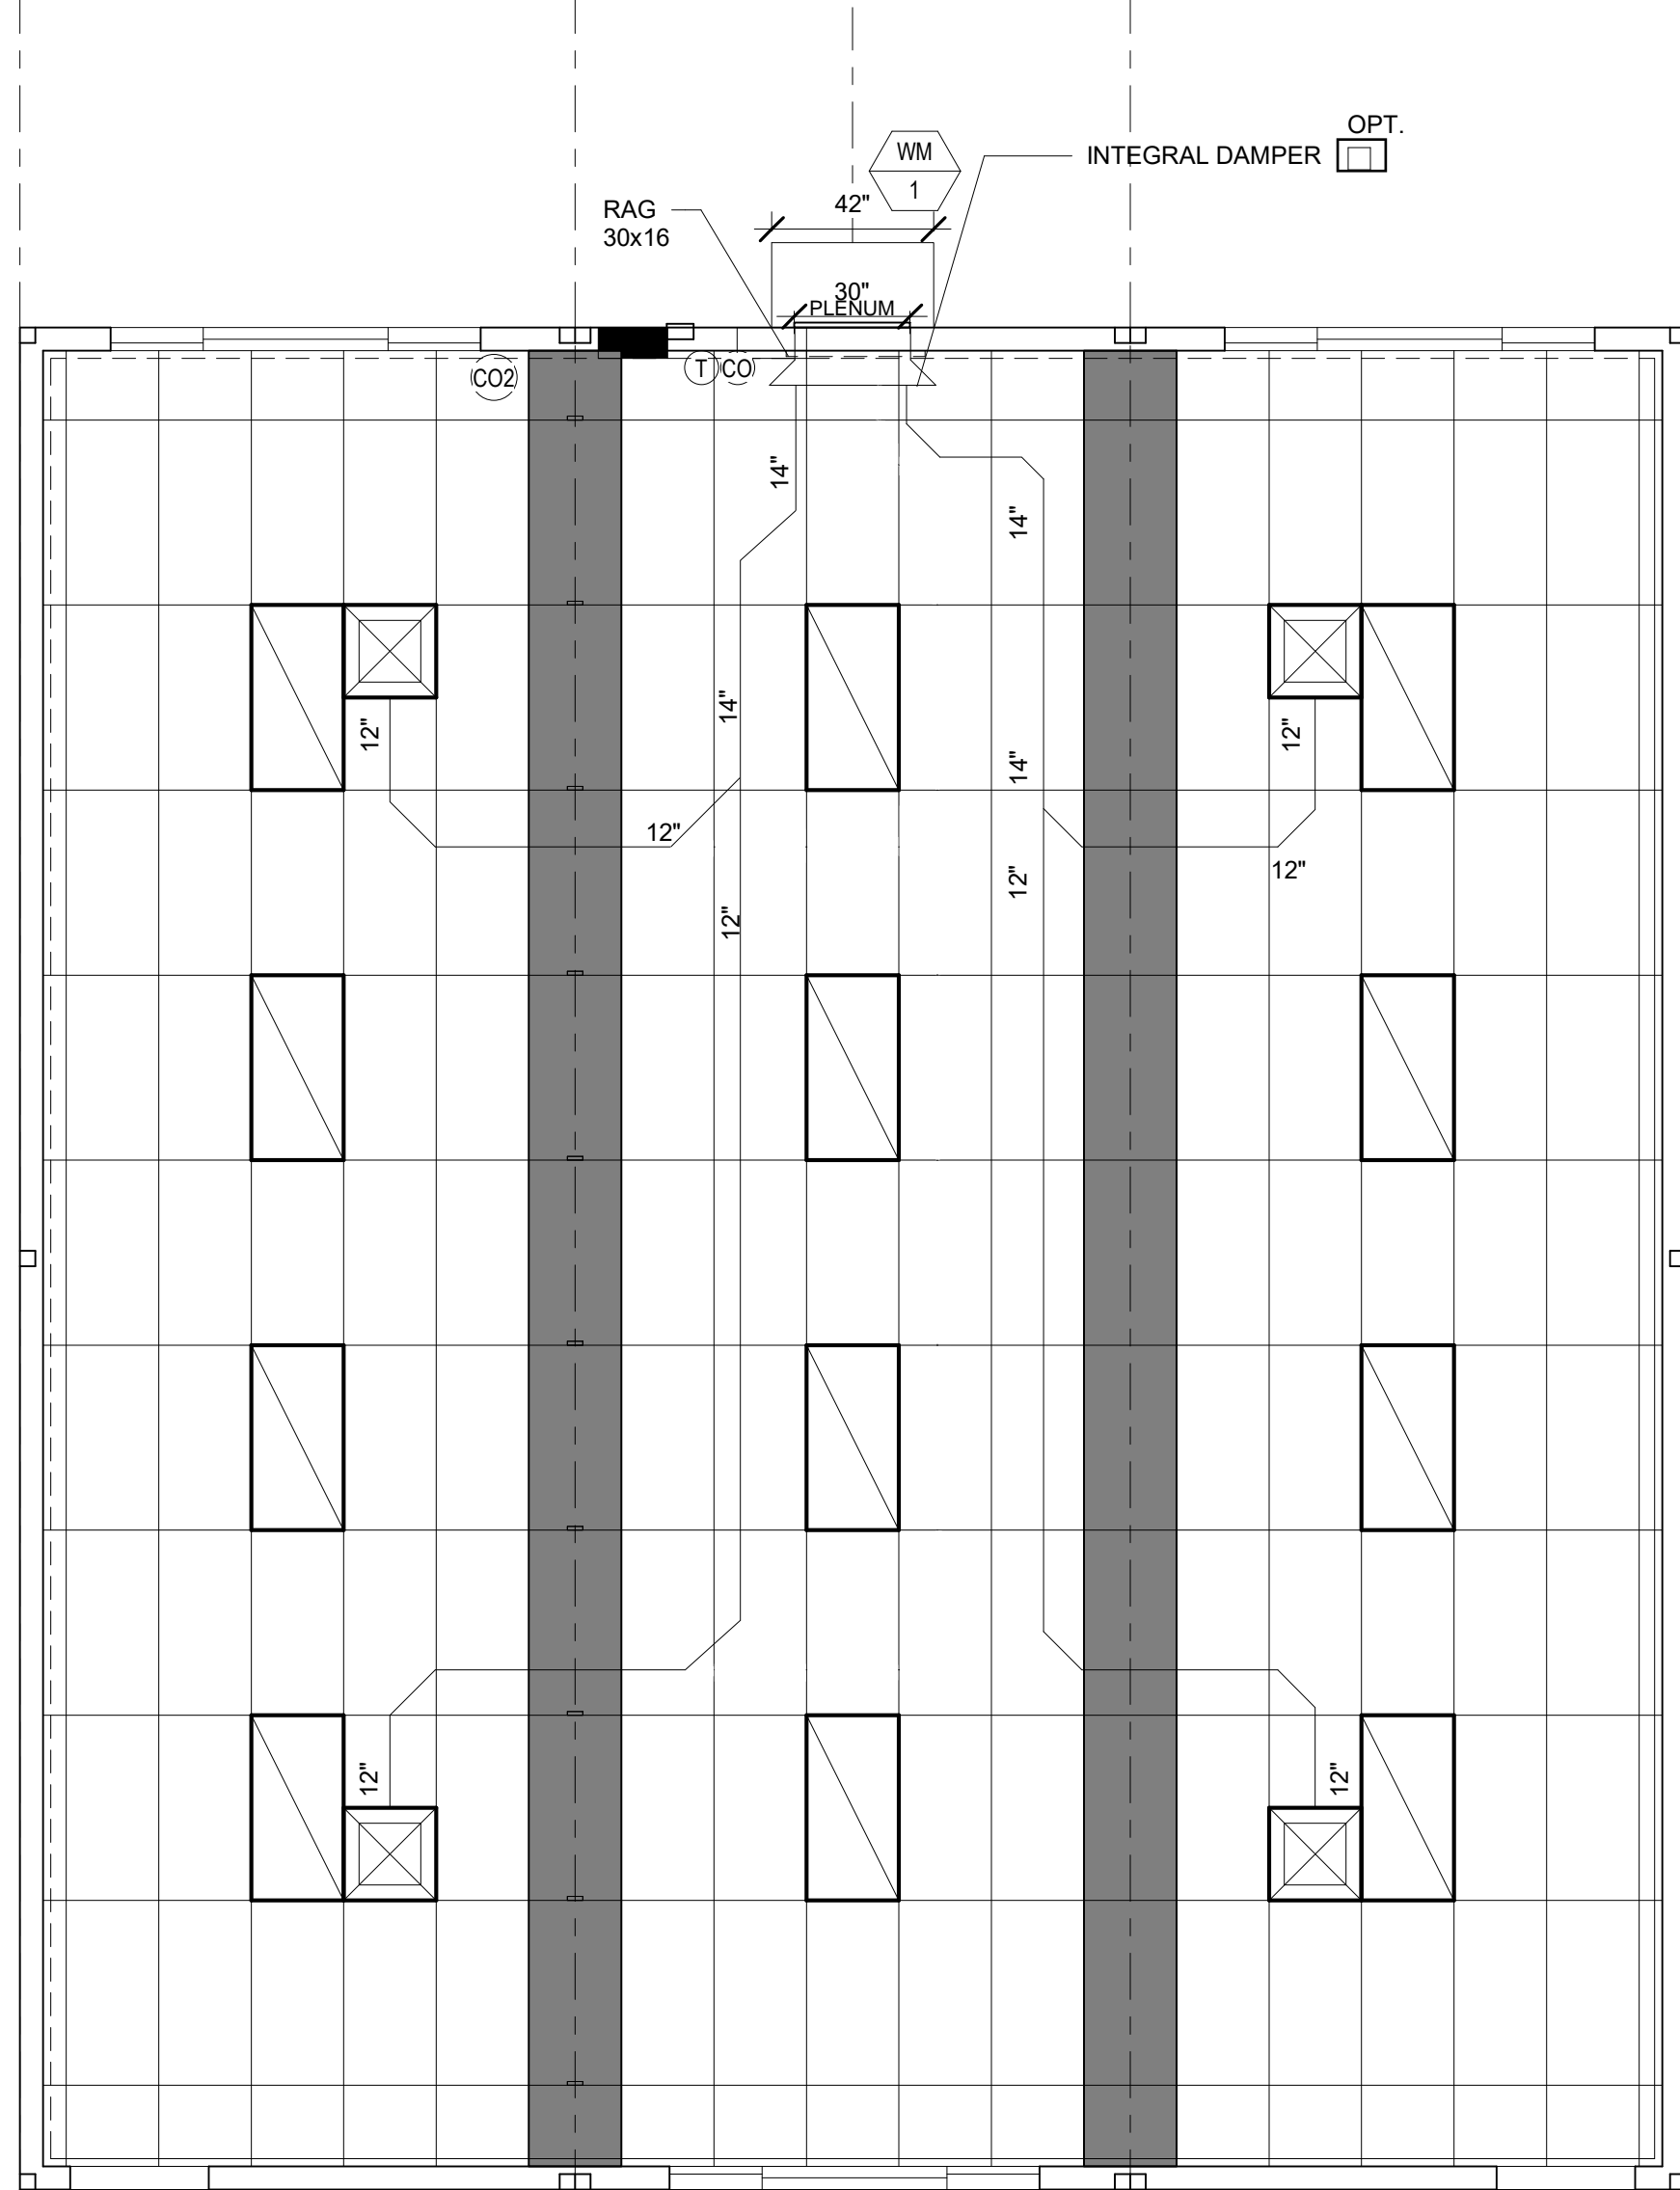

OPT. WALL MOUNTED

SEE ALT SHEETS


PROJECT SPECIFIC STATE AGENCY APPROVAL

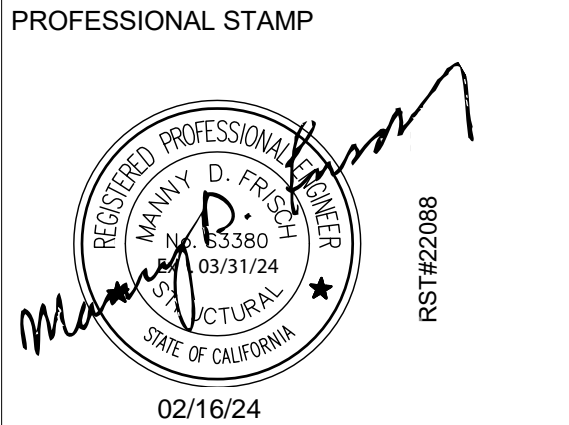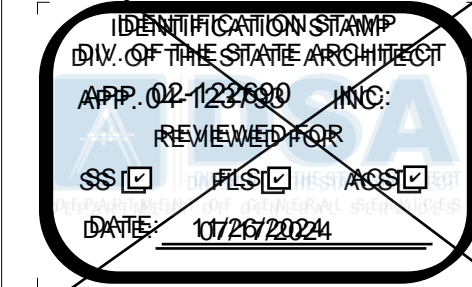

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©



ORIGINAL PC STATE AGENCY APPROVAL

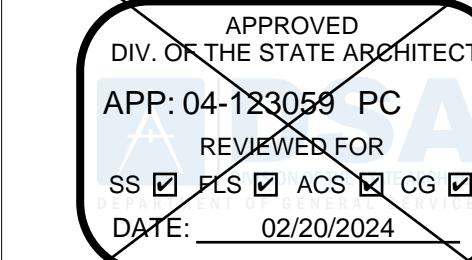

Revision Schedule		
#	Description	Date

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC: 24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
MECHANICAL
CEILING PLAN
36x40

PROJECT NUMBER

22088

DRAWN BY
rMc/SC

CHECKED BY
RH/RT

DATE

SHEET NO.

M6.1


SHEET OF



GENERAL NOTE:
UTILITIES THAT SPAN BETWEEN UNITS OR ACROSS SEISMIC SEPARATION
JOINTS MUST BE DESIGNED WITH A FLEXIBLE CONNECTION THAT CAN
ACCOMMODATE DIFFERENTIAL MOVEMENTS

Revision Schedule		
#	Description	Date

PROJECT NUMBER	
22088	
DRAWN BY	rMc/SC
CHECKED BY	RH/RT
DATE	
SHEET NO.	
P1.0	
SHEET	OF

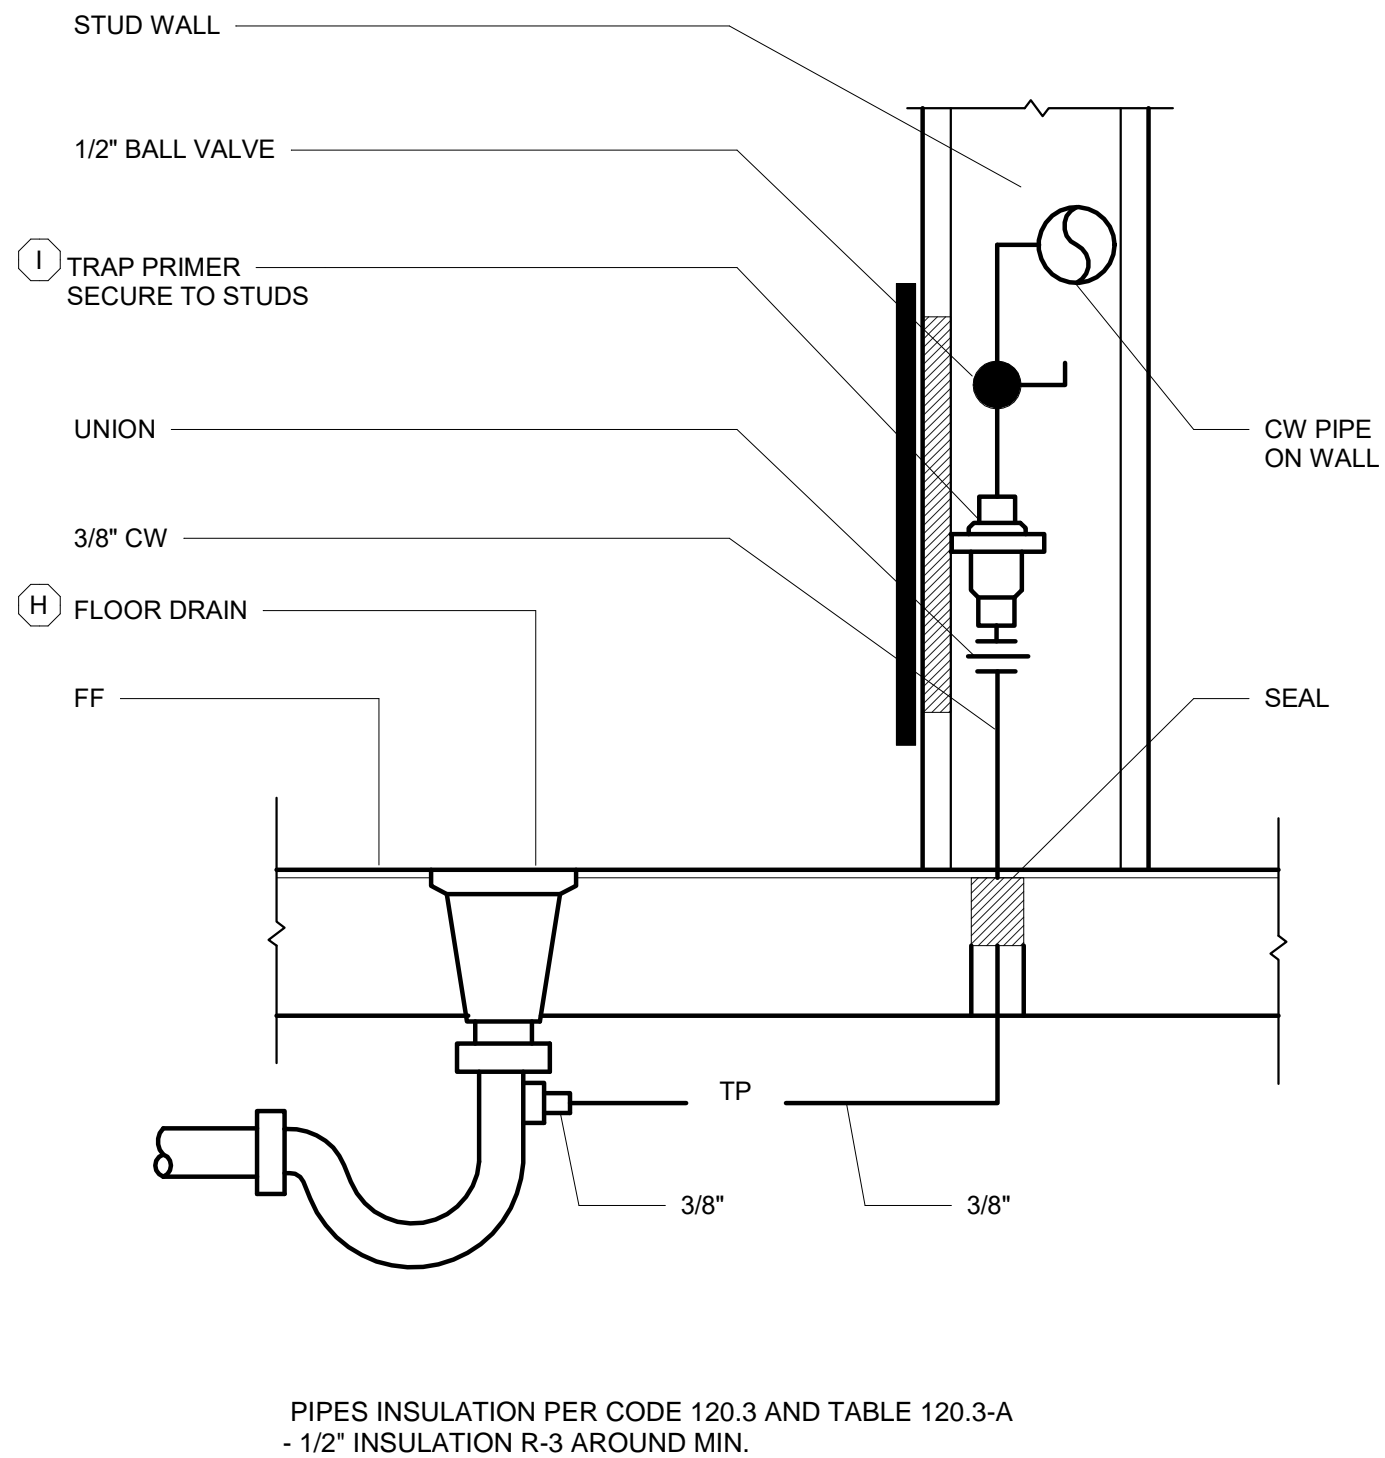

6/16/2021 7:45:10 AM C:\Users\User\Documents\RST#20132 - Class Leasing, PC 24x40 to 120x40 HS_detached_CESAR24D63.rvt



- | FOOTING SCHEDULE (CONCRETE FLOOR) | | | | |
|-----------------------------------|--------------------------------|--------------------------------|-------------------------|-----------------------------|
| DESIGN FLOOR
LIVE LOAD | SIDEWALL
FOOTING | ENDWALL
FOOTING | INTERIOR PAD
FOOTING | PAD FOOTING
@ SEPARATION |
| □ 50 + 15 PSF | 12" WIDE
(2) #5
CONT T&B | 14" WIDE (3)
#5 CONT
T&B | 3' - 2" SQ
(3) #5 EW | 4' - 0" SQ
(4) #5 EW |
| □ 100 PSF | 12" WIDE
(2) #5
CONT T&B | 16" WIDE
(3) #5
CONT T&B | 3' - 6" SQ
(3) #5 EW | 4' - 6" SQ
(4) #5 EW |
| □ 150 PSF | 14" WIDE
(2) #5
CONT T&B | 16" WIDE (3)
#5 CONT
T&B | 4' - 2" SQ
(4) #5 EW | 4' - 10" SQ
(5) #5 EW |

FOOTING SCHEDULE (CONCRETE FLOOR)				
DESIGN FLOOR LIVE LOAD	SIDEWALL FOOTING	ENDWALL FOOTING	INTERIOR PAD FOOTING	PAD FOOTING @ SEPARATION
<input type="checkbox"/> 50 + 15 PSF	12" WIDE (2) #5 CONT T&B	14" WIDE (3) #5 CONT T&B	3' - 2" SQ (3) #5 EW	4' - 0" SQ (4) #5 EW
<input type="checkbox"/> 100 PSF	12" WIDE (2) #5 CONT T&B	16" WIDE (3) #5 CONT T&B	3' - 6" SQ (4) #5 EW	4' - 6" SQ (4) #5 EW
<input type="checkbox"/> 150 PSF	14" WIDE (2) #5 CONT T&B	16" WIDE (3) #5 CONT T&B	4' - 2" SQ (4) #5 EW	4' - 10" SQ (5) #5 EW

WELD PLATE SCHEDULE				
		L64x3/8, 14" LONG		16x3/8 SQ PL
		≤ 100 PSF	150 PSF	≤ 150 PSF
EACH SIDEWALL		3	4	-
EACH MODLINE		-	2	2
EACH END- WALL	24x40	5	7	
	36x40	6	7/10	
	48x40	7	10/13	
	60x40	9	12	
	72x40	10	14	
	84x40	12	17	
	96x40	13	19	
	108x40	15	21	
	120x40	16	23	



R&S TAVARES ASSOCIATES

DESIGN ♦ CONSULTING ♦ PROJECT MGT

11590 W BERNARDO COURT, SUITE 100
SAN DIEGO, CA 92127

WWW.RSTAVARES.COM

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

ORIGINAL PC STATE AGENCY APPROVAL

APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-123058 PC
REVIEWED FOR
SS ☒ FLS ☒ ACS ☒ CG ☒
DATE: 02/20/2024

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

SHEET TITLE

CONCRETE
FOUNDATION
PLAN


DRAWN BY	rMc/SC
----------	--------

DATE
SHEET NO.


F2.10

C:\Users\User\Documents\RS#20132 - Class Leasing, PC 24x40 to 120x40 HS, detached, CESAR24D33.rvt


6/16/2021 7:45:12 AM

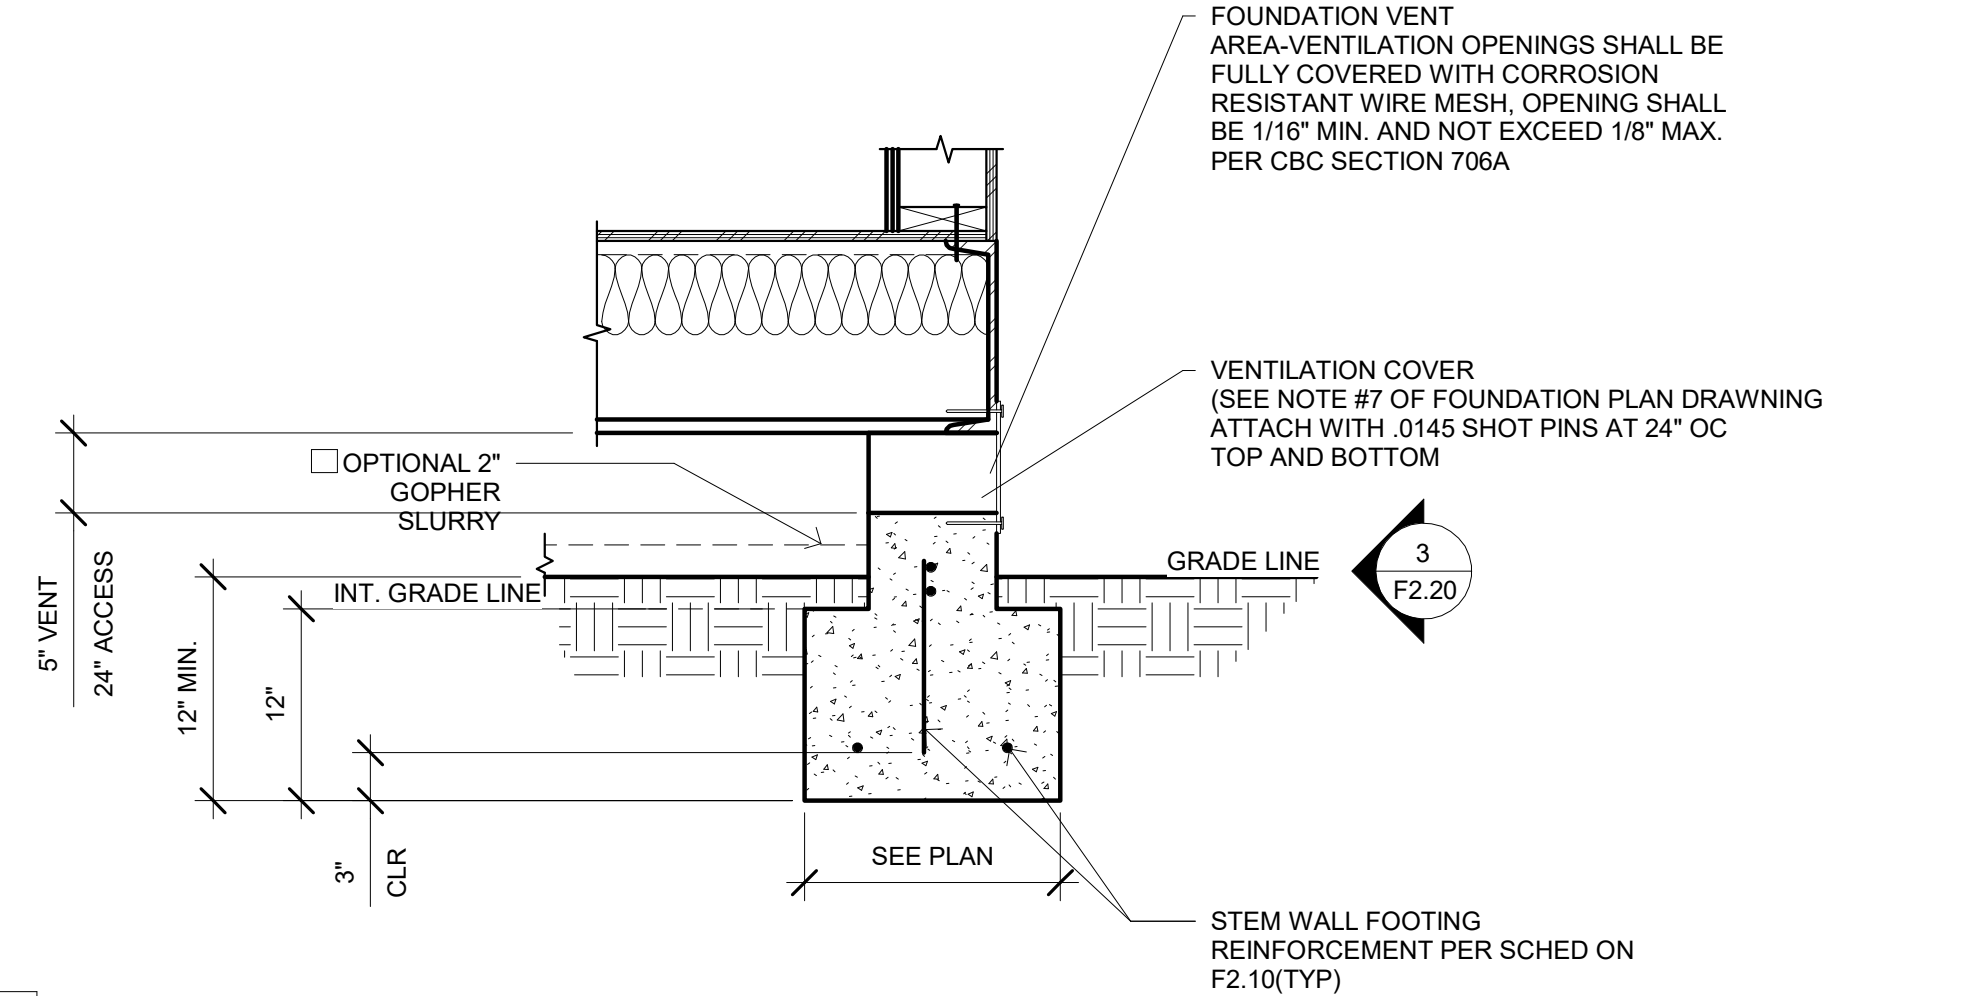


7 1" = 1'-0" VENT/ACCESS SECTION, ABOVE GRADE

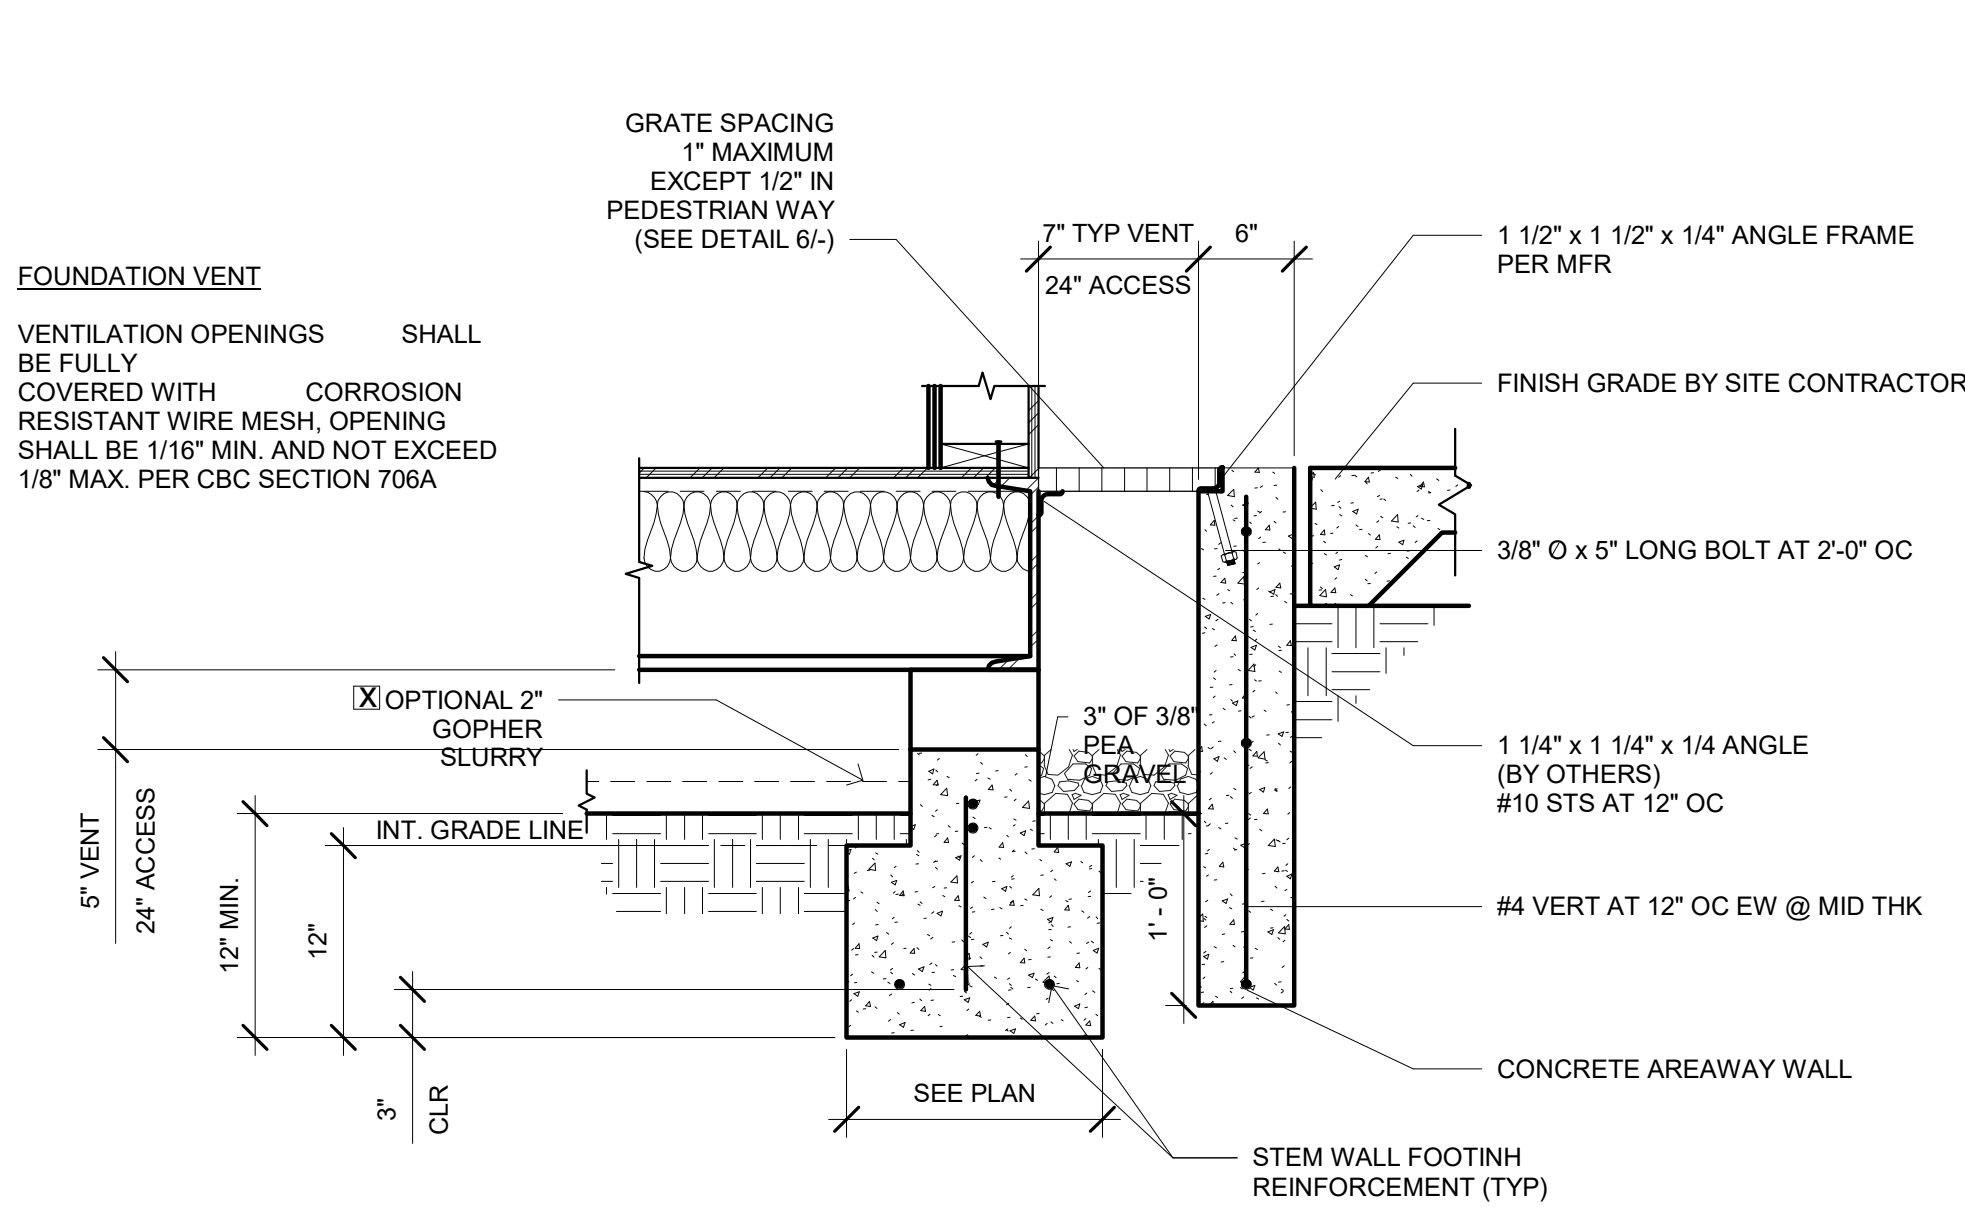


8 1" = 1'-0" VENT/ACCESS SECTION, BELOW GRADE

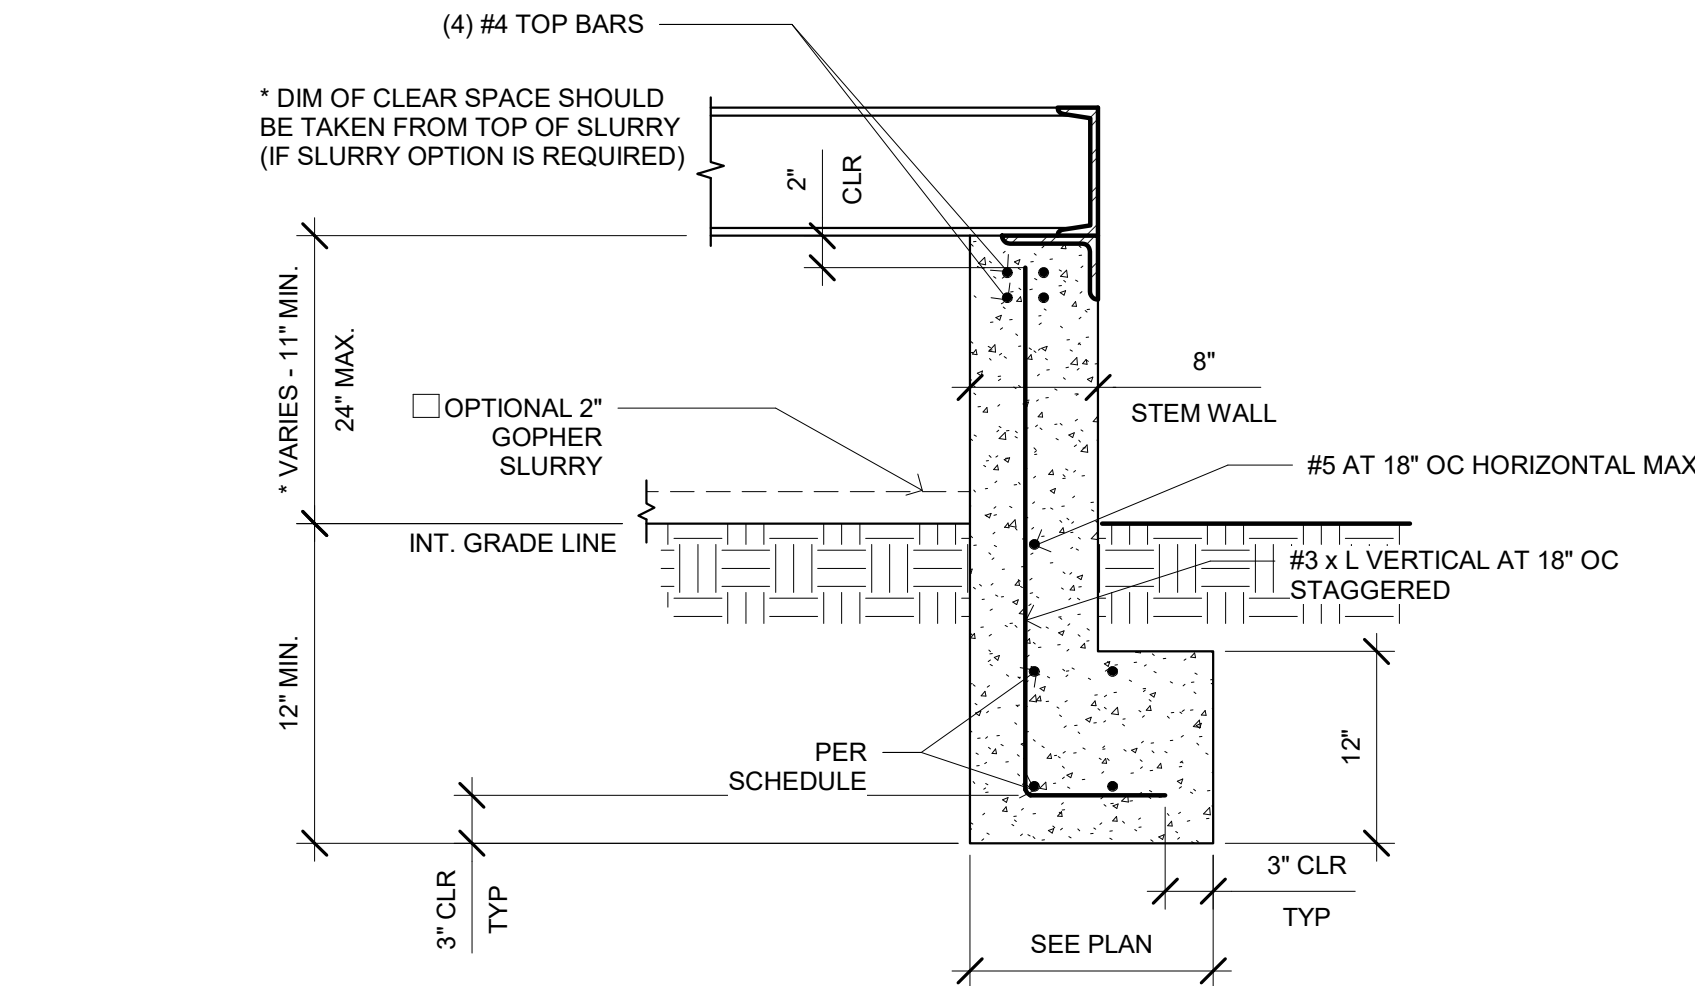


4 1" = 1'-0" SIDE WALL FOOTING, ABOVE GRADE

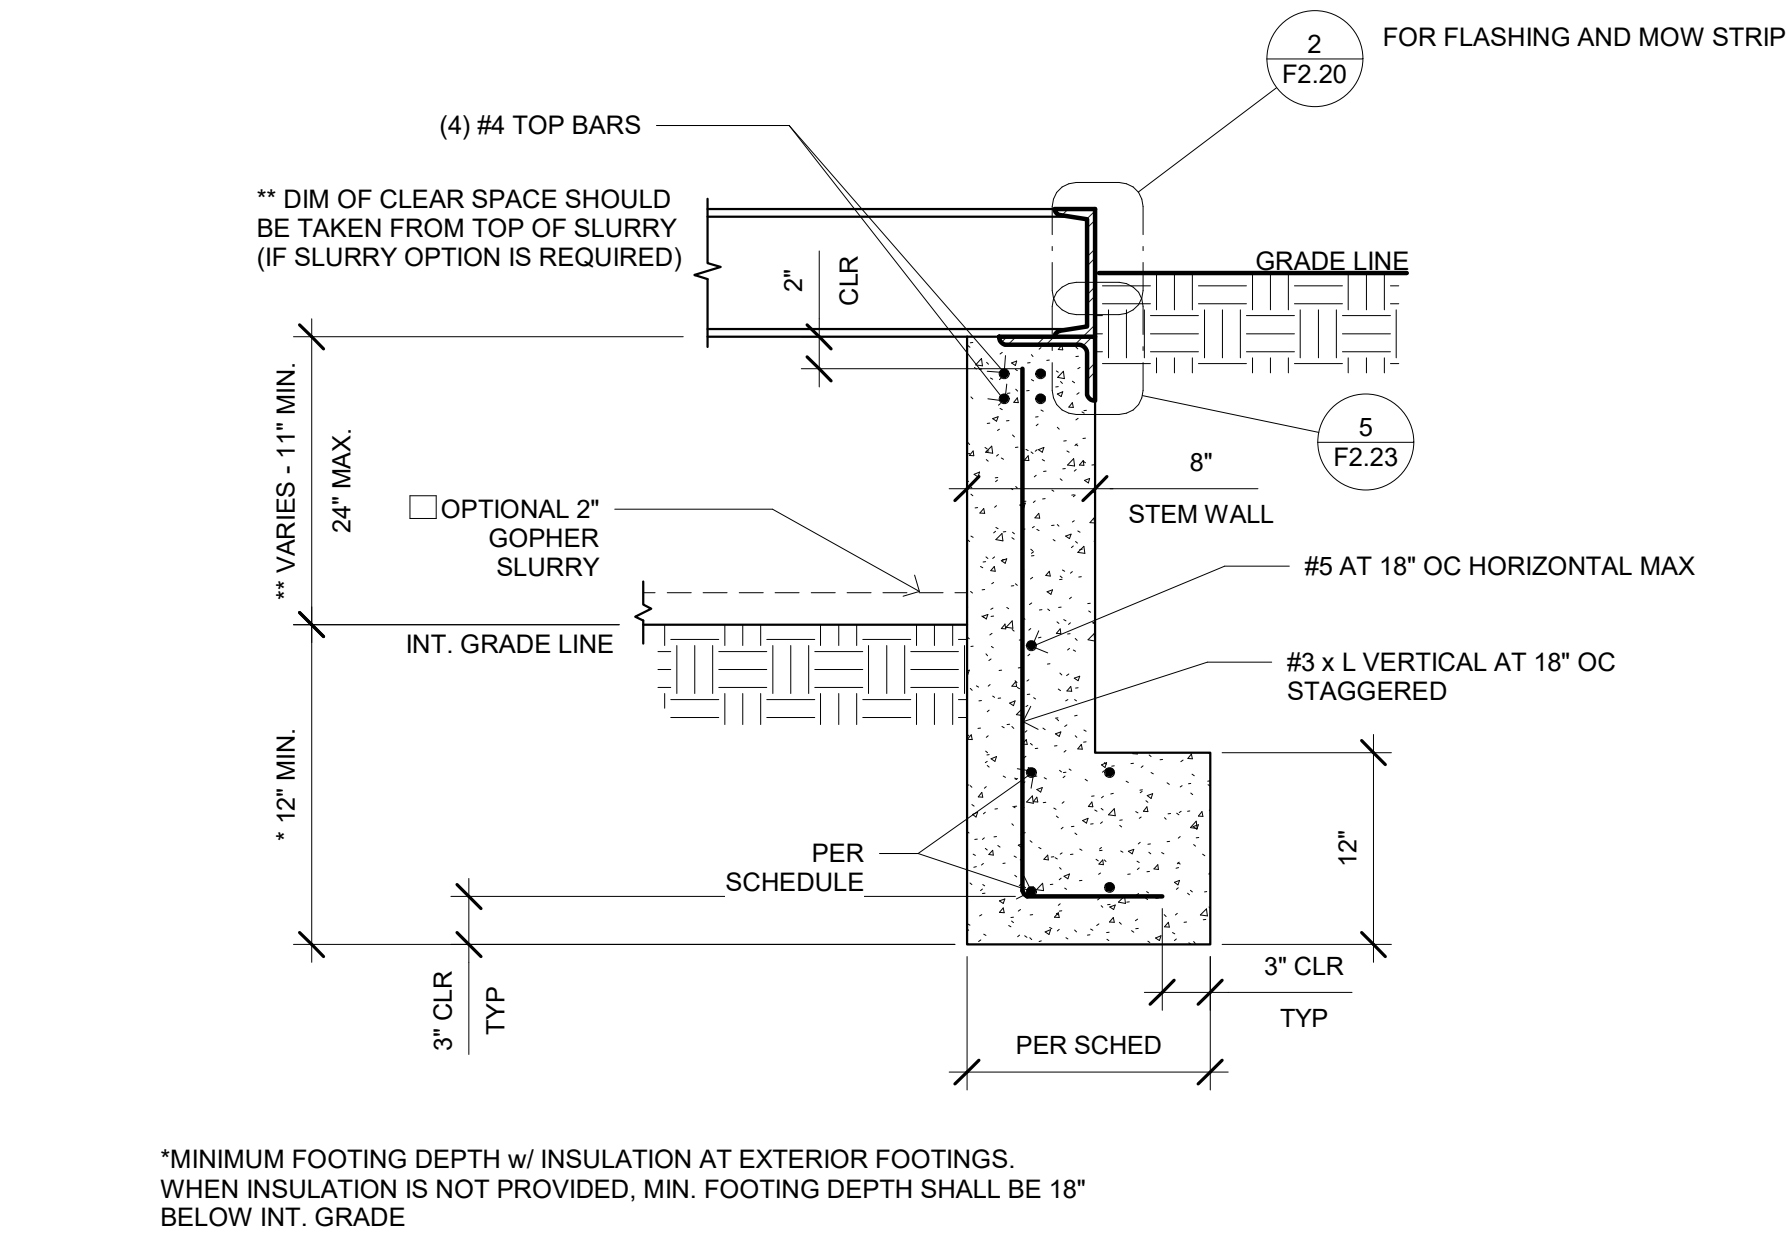


5 1" = 1'-0" SIDE WALL FOOTING, BELOW GRADE

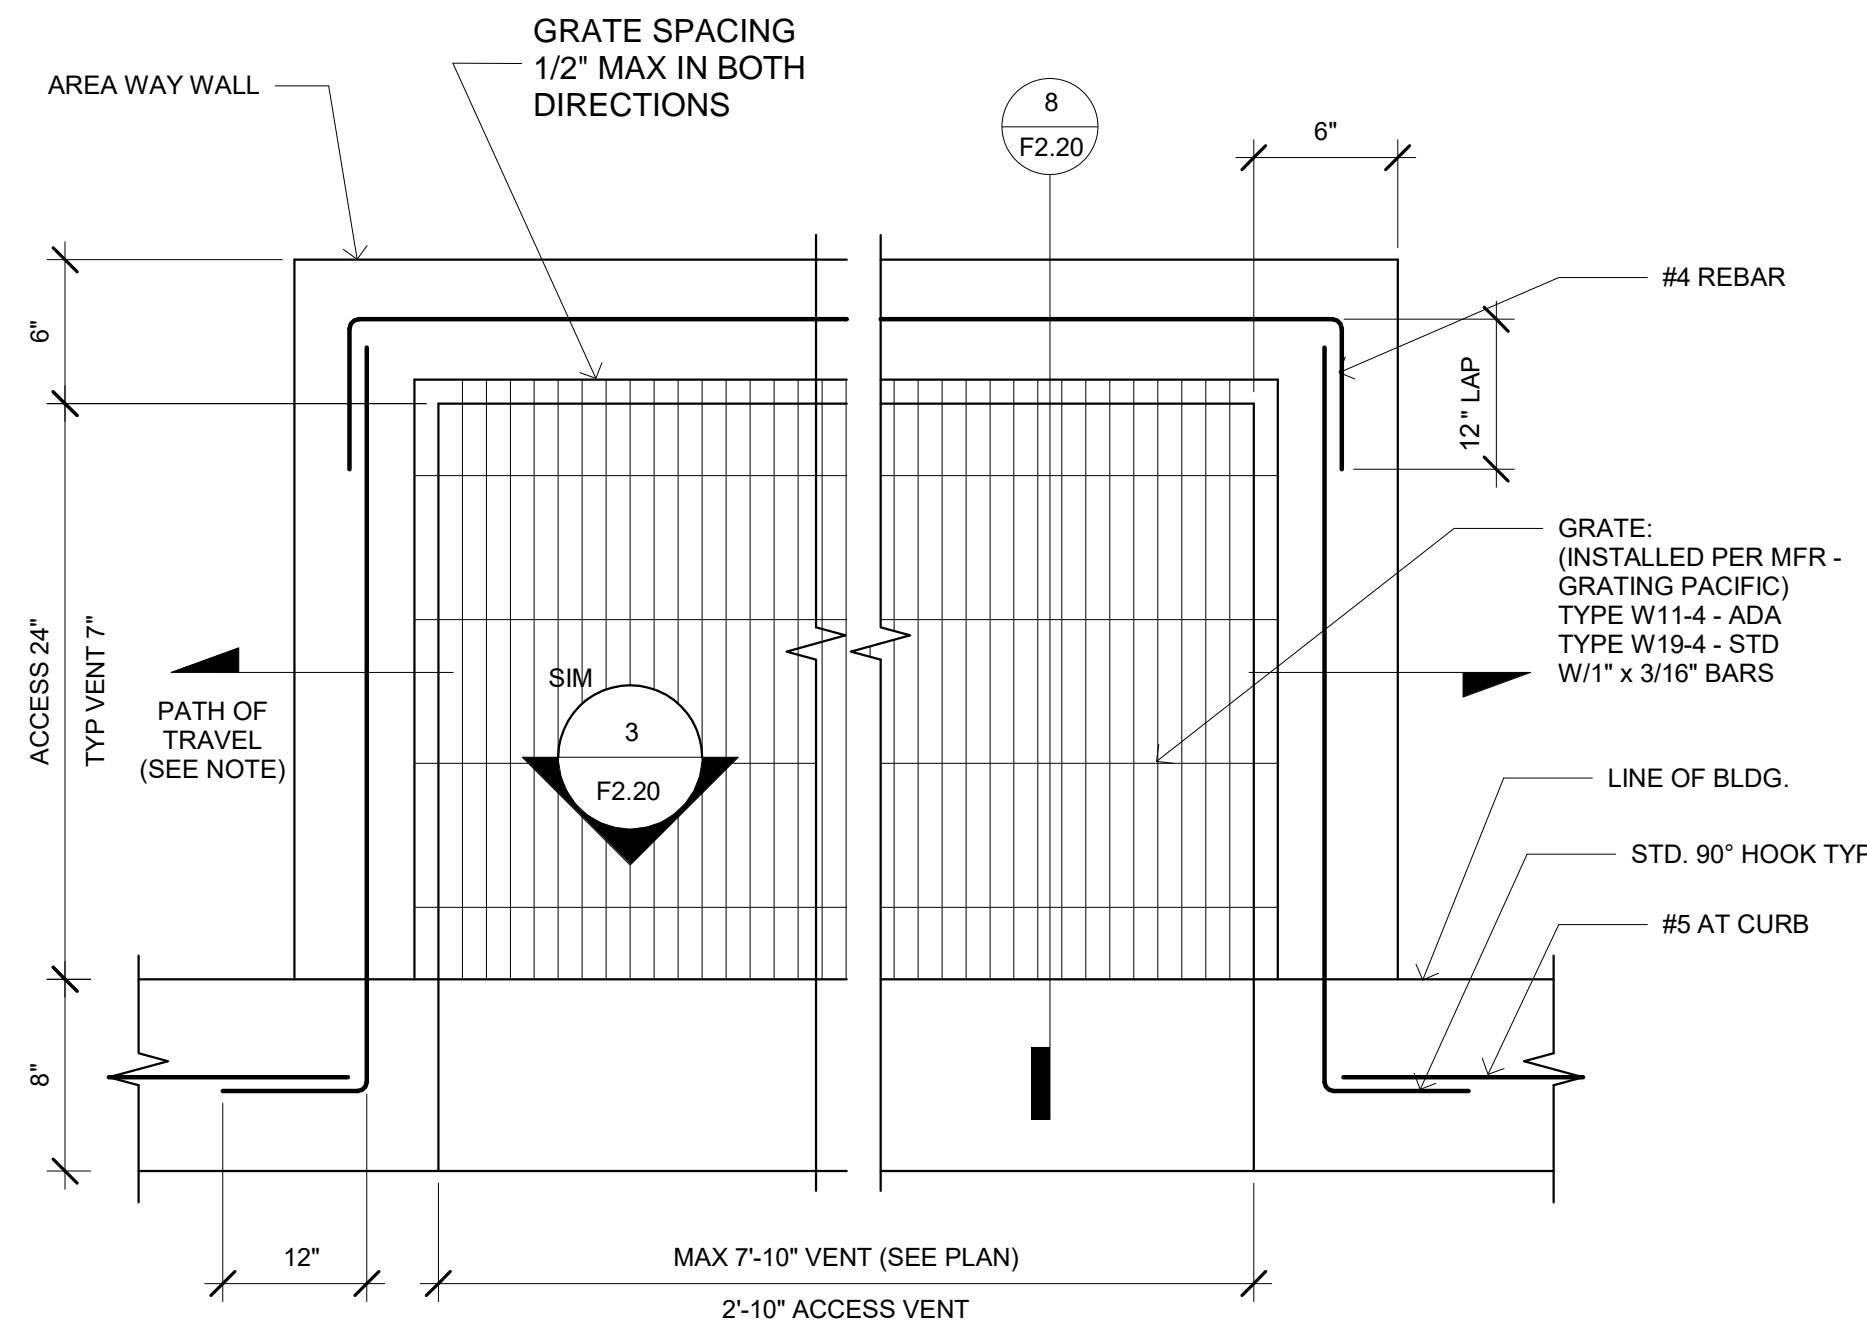


6 1 1/2" = 1'-0" ACCESS VENT FOR BELOW GRADE FOUNDATION

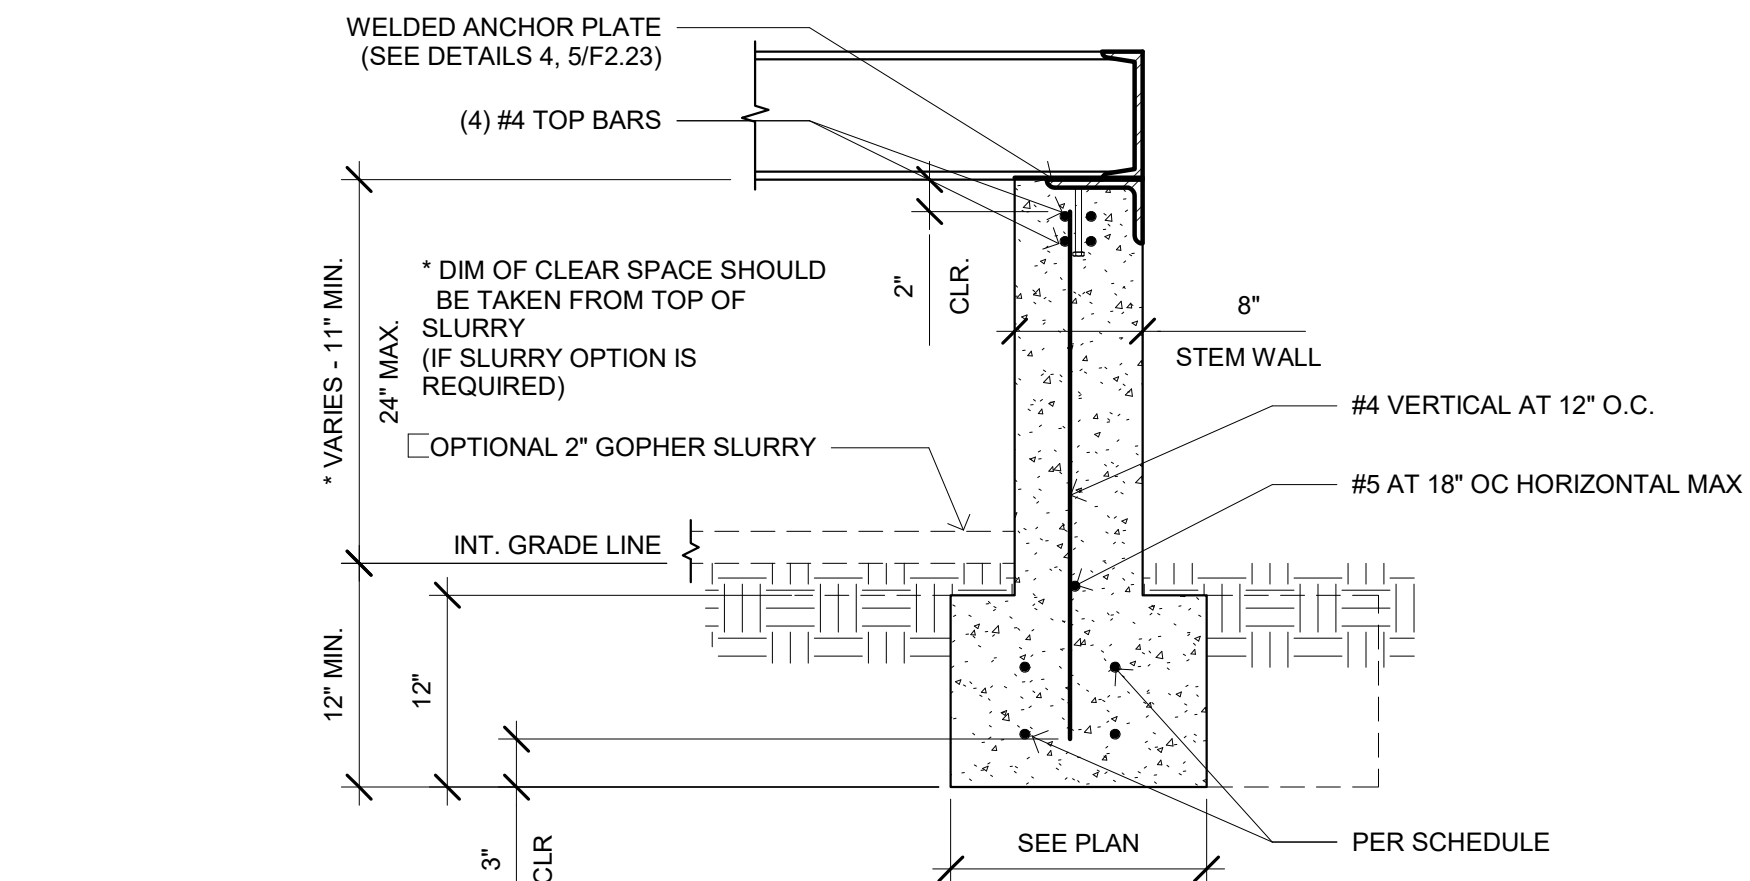

1 1" = 1'-0" END WALL FOOTING, ABOVE GRADE

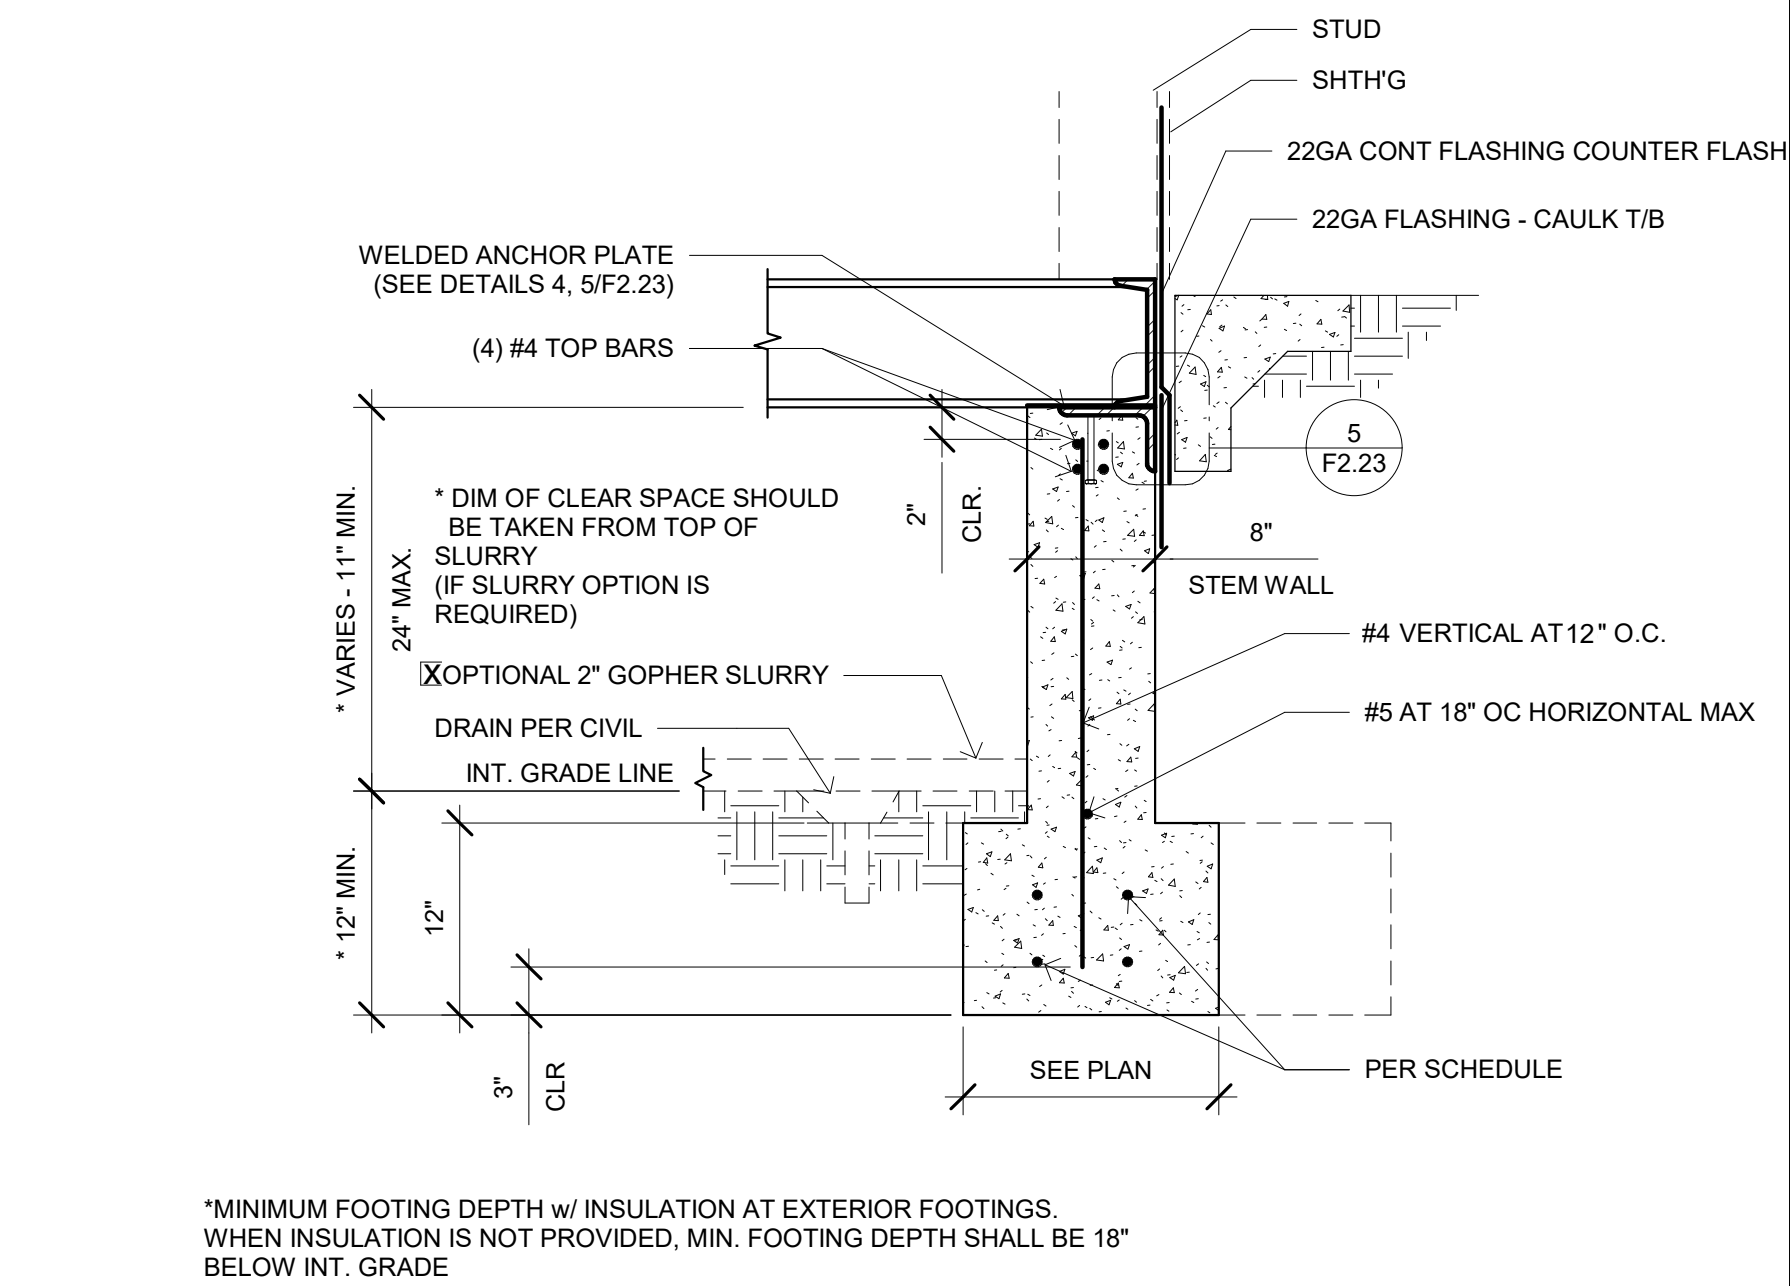

2 1" = 1'-0" END WALL FOOTING, BELOW GRADE

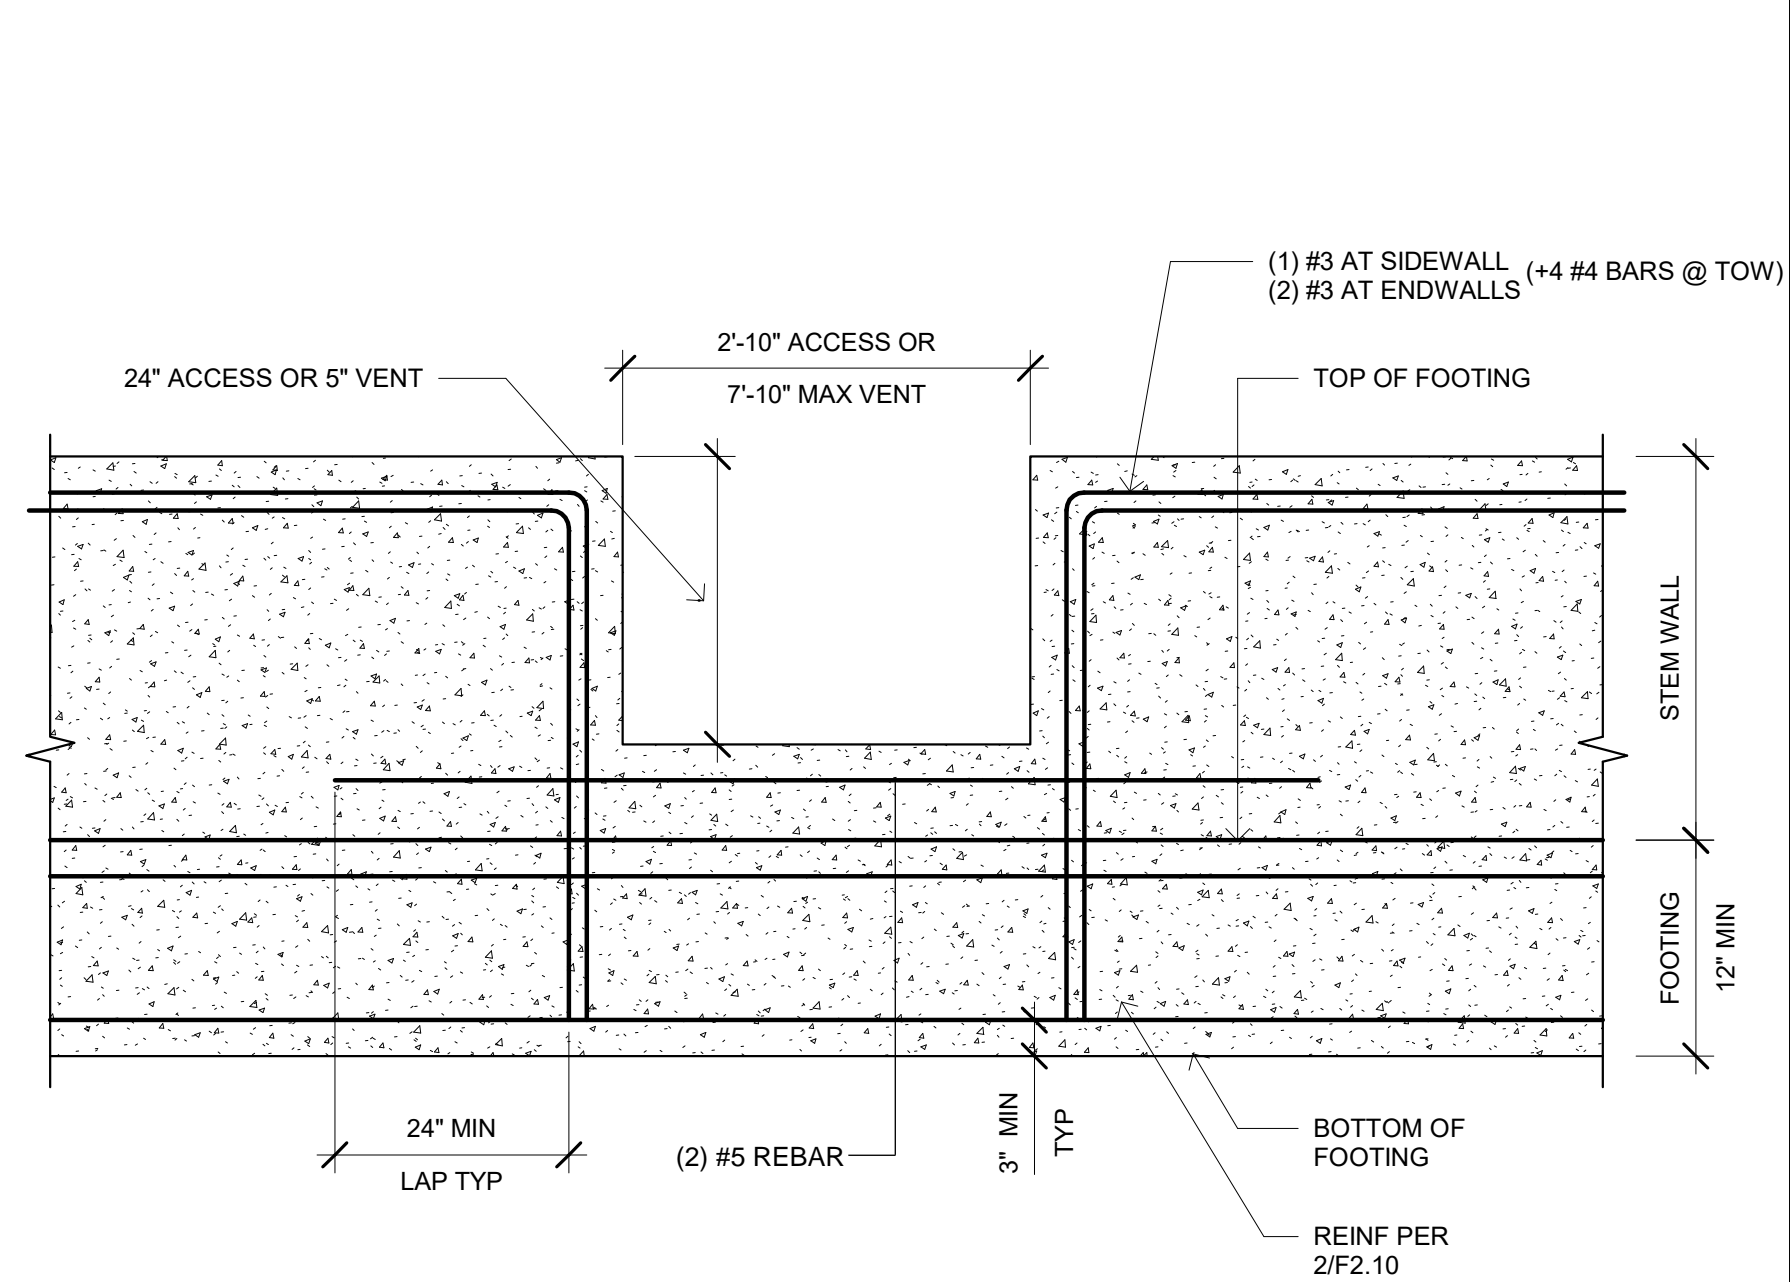

3 3/4" = 1'-0" VENT OPENING

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-122890 INC:
REVIEWED FOR
SS ☐ PLS ☐ ACS ☐
DATE: 07/29/2024

R&S TAVARES ASSOCIATES
DESIGN & CONSULTING PROJECT MEET
11590 W BERNARDO COURT, SUITE 100
SAN DIEGO, CA 92127
WWW.RSTAVARES.COM

PROFESSIONAL STAMP

REGISTERED PROFESSIONAL ARCHITECT
MANNY D. FROST
63380
03/31/24
PRACTURING
STATE OF CALIFORNIA
02/16/24
RST#22088

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT

Class Leasing
1651 Juanita Street, San Jacinto, CA 92583
Voice (951) 943-1908 Fax (951) 943-5768

ORIGINAL PC STATE AGENCY APPROVAL

APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-123058 PC
REVIEWED FOR
SS ☒ PLS ☒ ACS ☒ CG ☒
DATE: 02/20/2024

Revision Schedule		
#	Description	Date

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC:24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
CONCRETE
FOUNDATION
DETAILS

PROJECT NUMBER
22088


DRAWN BY
rMc/SC

CHECKED BY
JA/RT


DATE

SHEET NO.
F2.20


SHEET OF

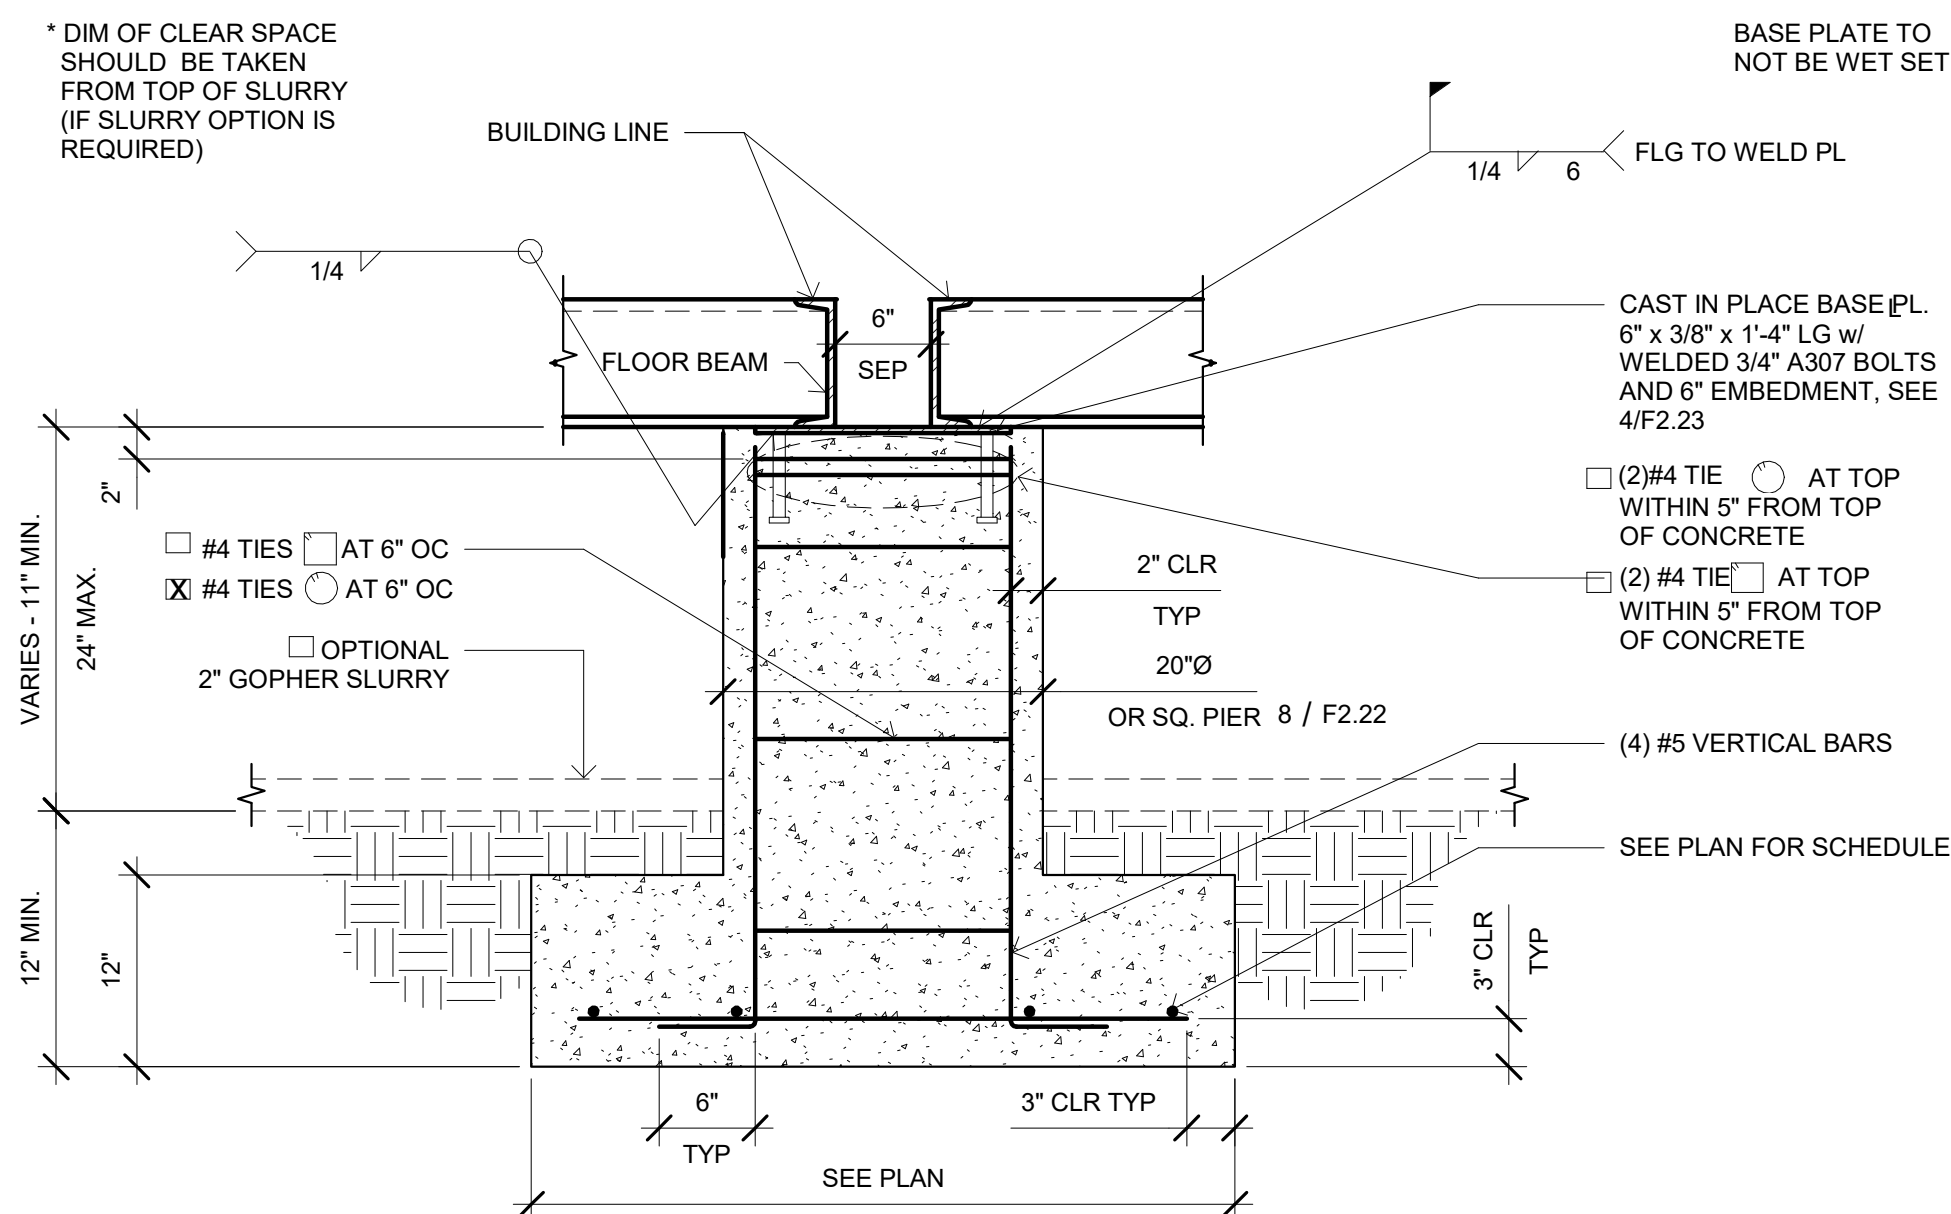


7 **1" = 1'-0"**
INTERIOR PAD FOOTING (AT SEPARATION)

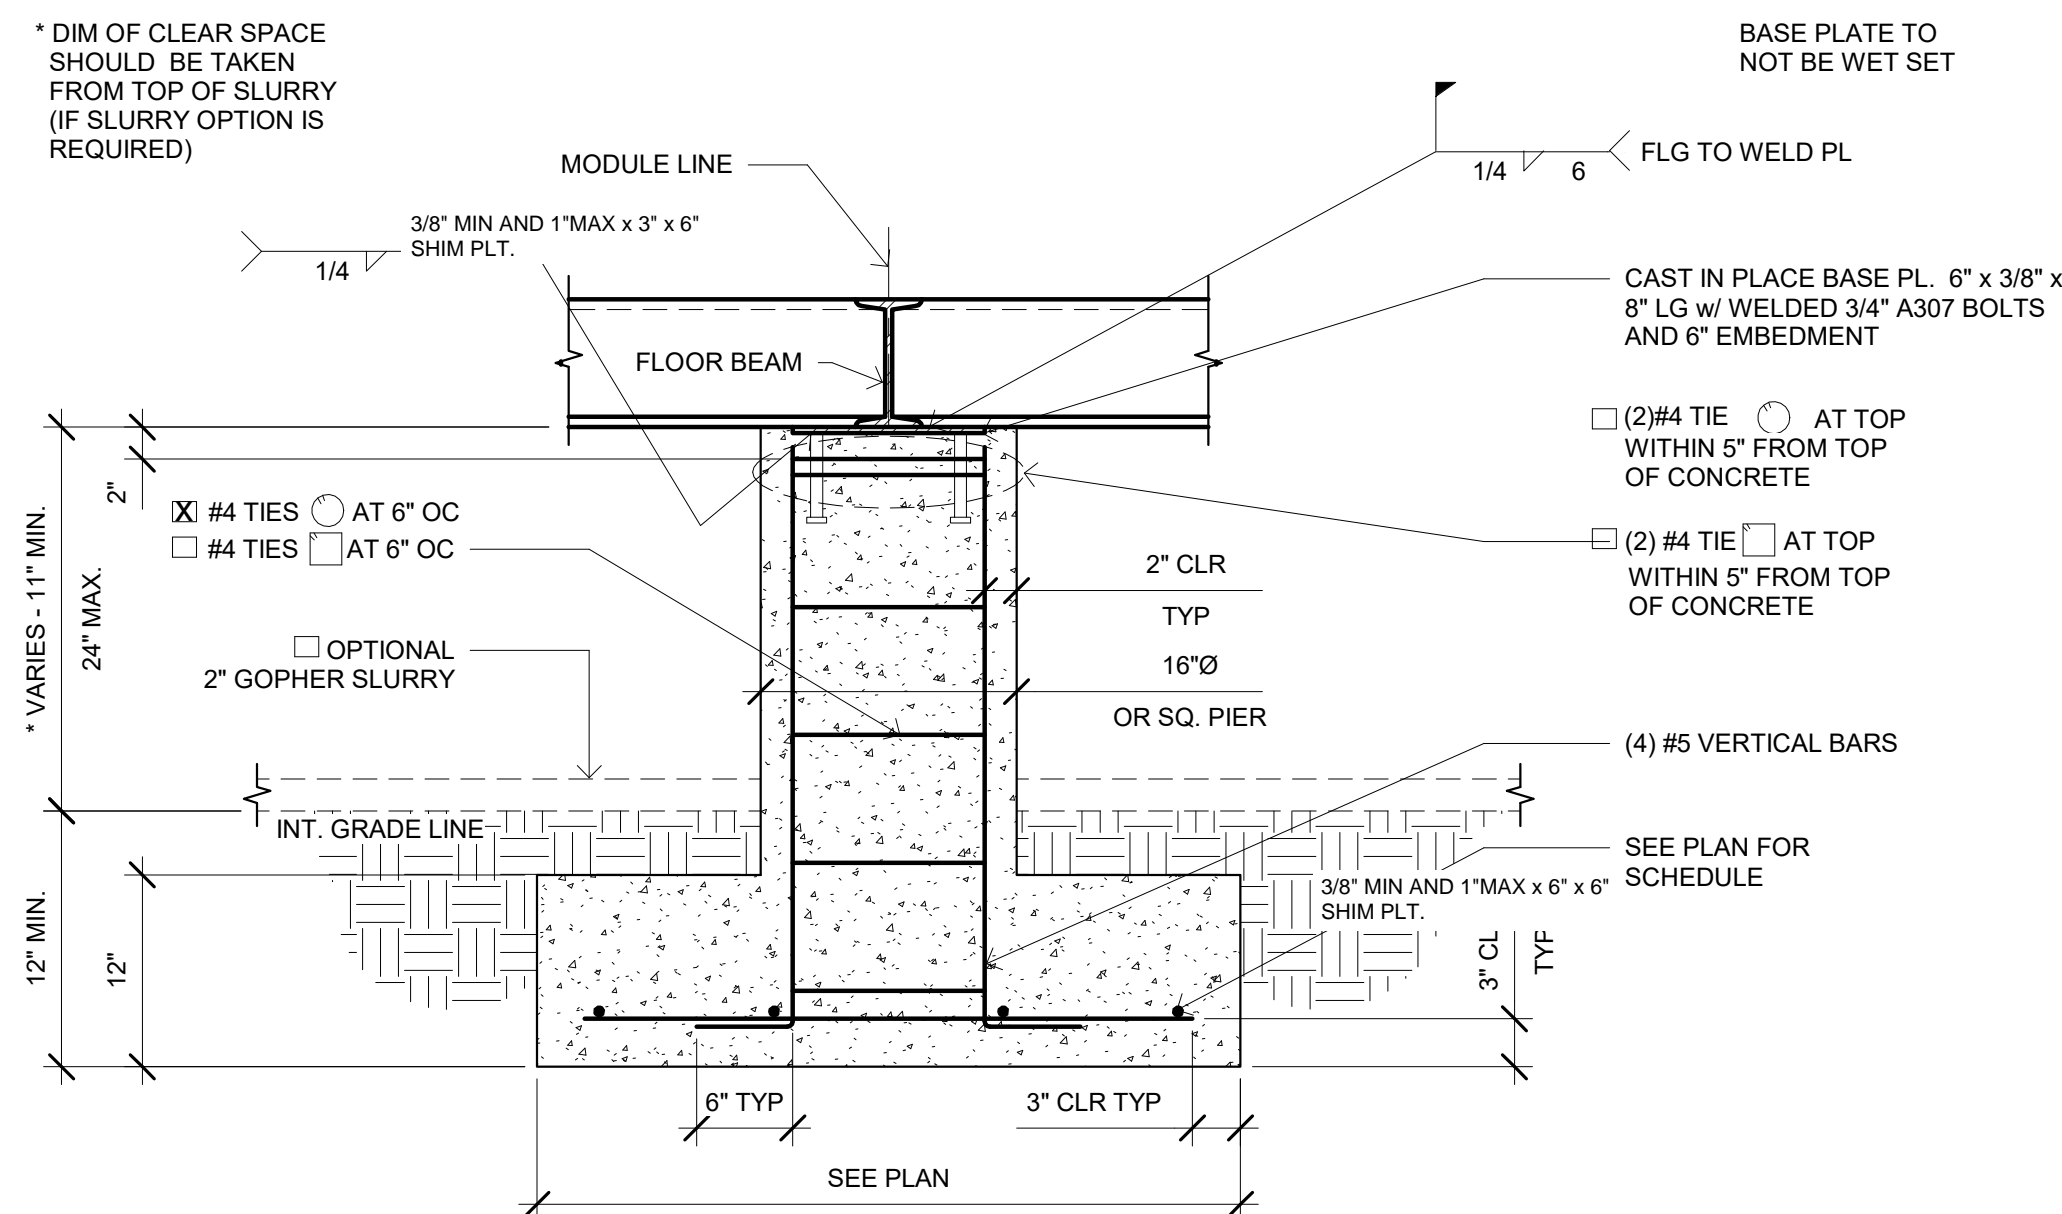


4 $1'' = 1'-0''$
INTERIOR PAD FOOTING (ATTACHMENT AT PLATE)

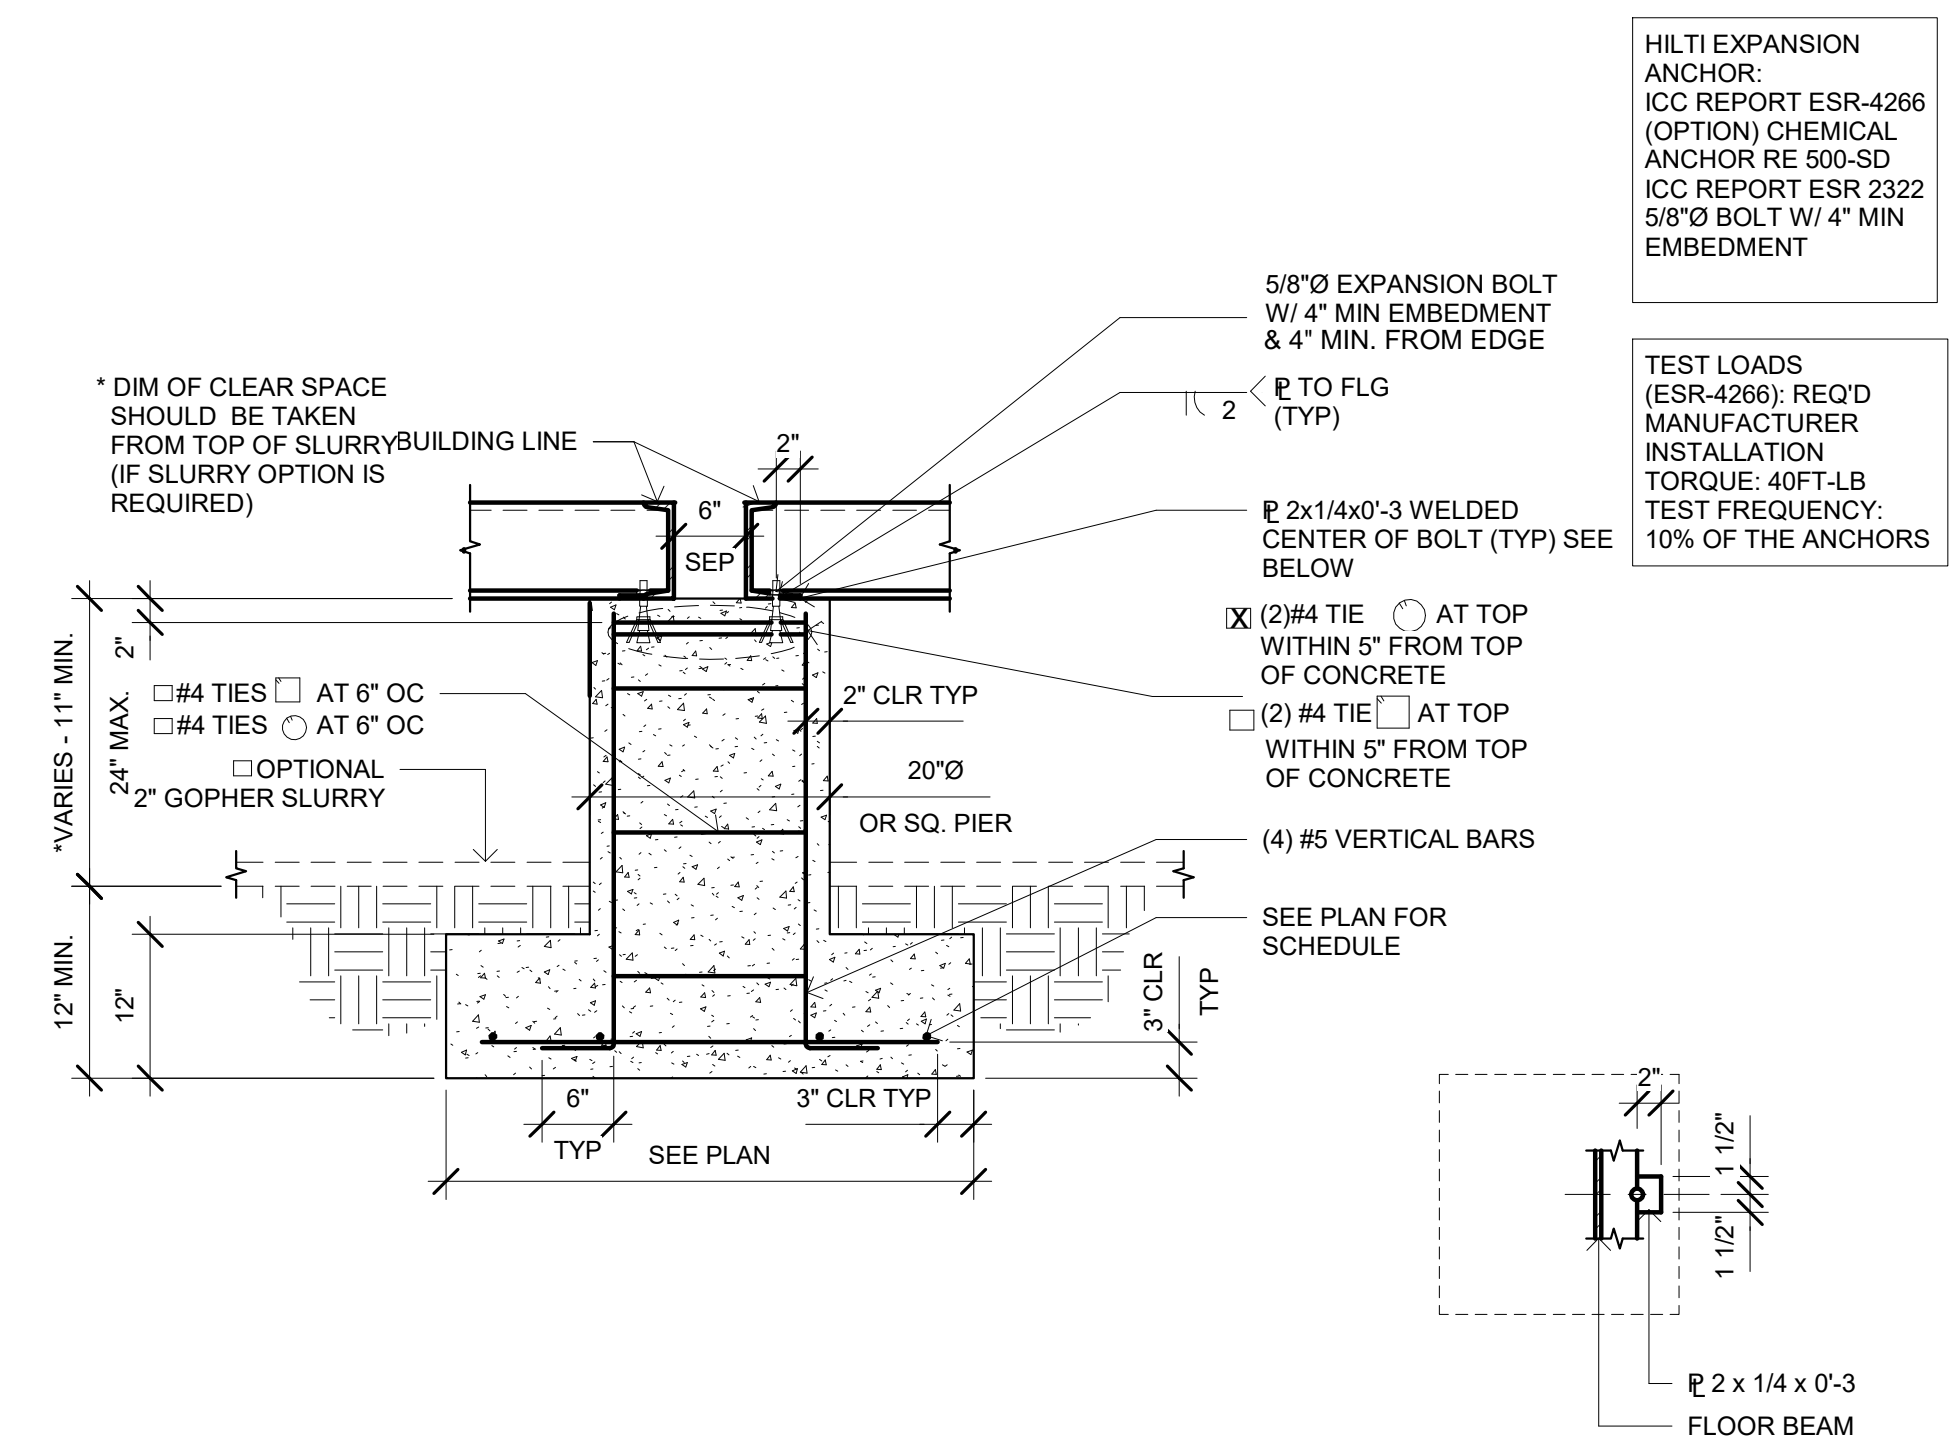


3 $\frac{3}{4}" = 1'-0"$
OPT. INTERIOR PAD FOOTING (AT SEPARATION)

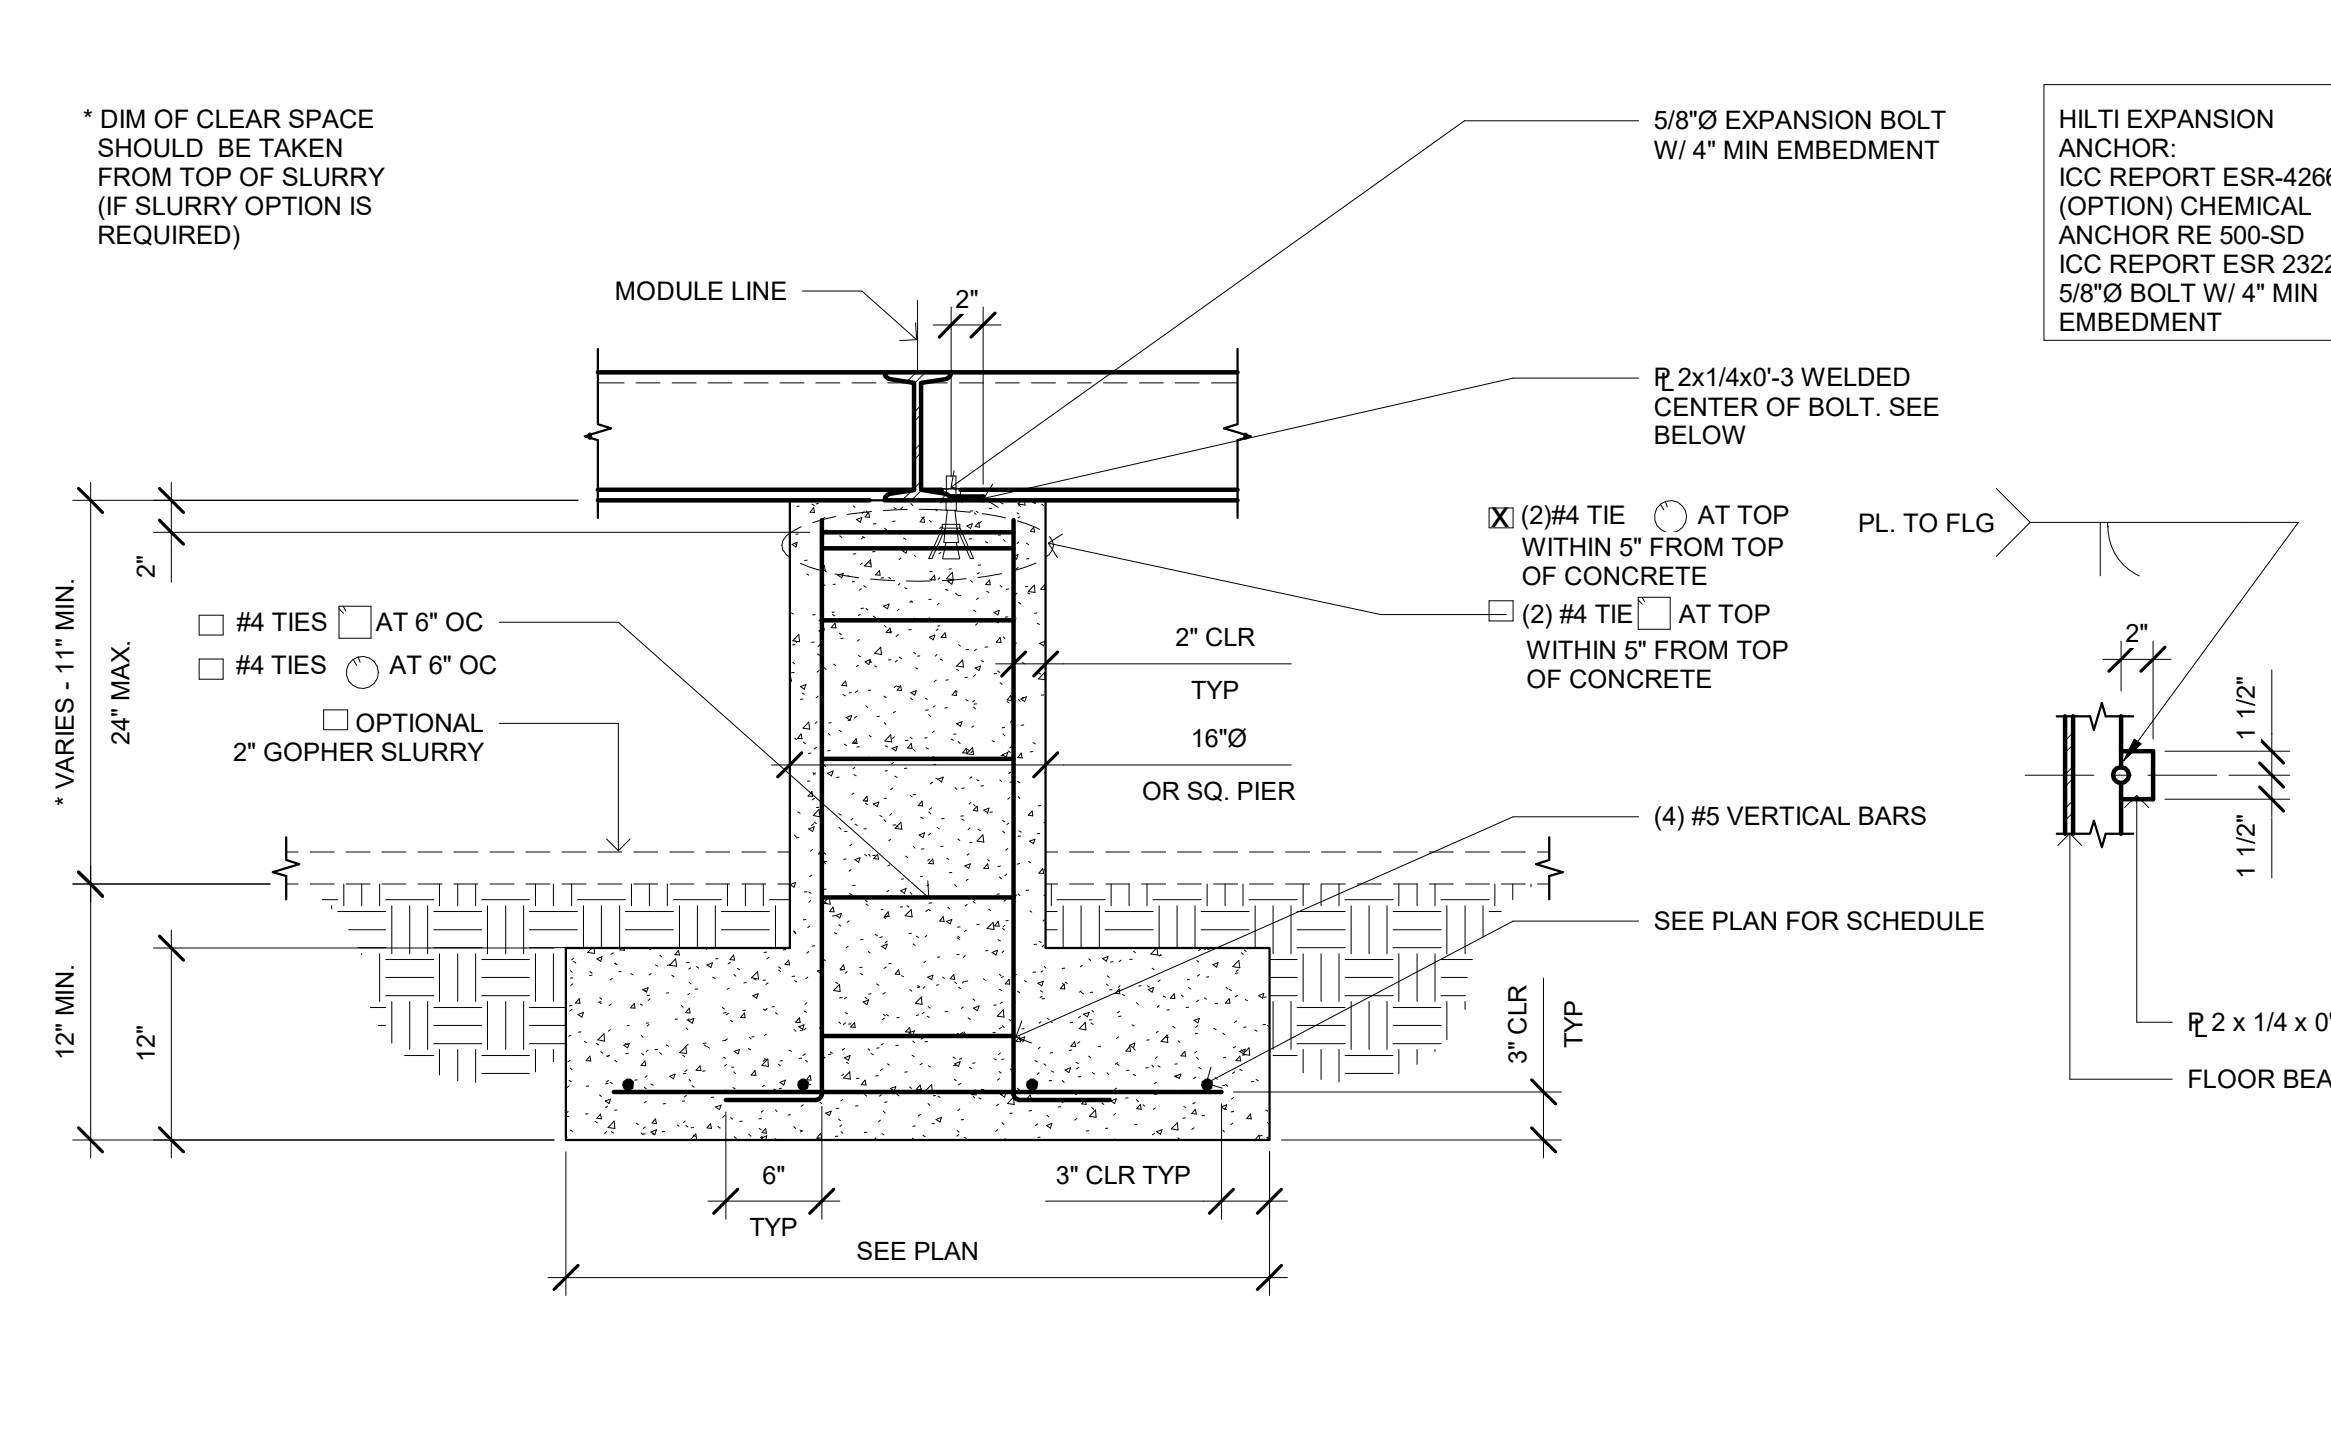


5 $1'' = 1'-0''$
OPT. INTERIOR PAD FOOTING (ATTACHMENT AT PLATE)

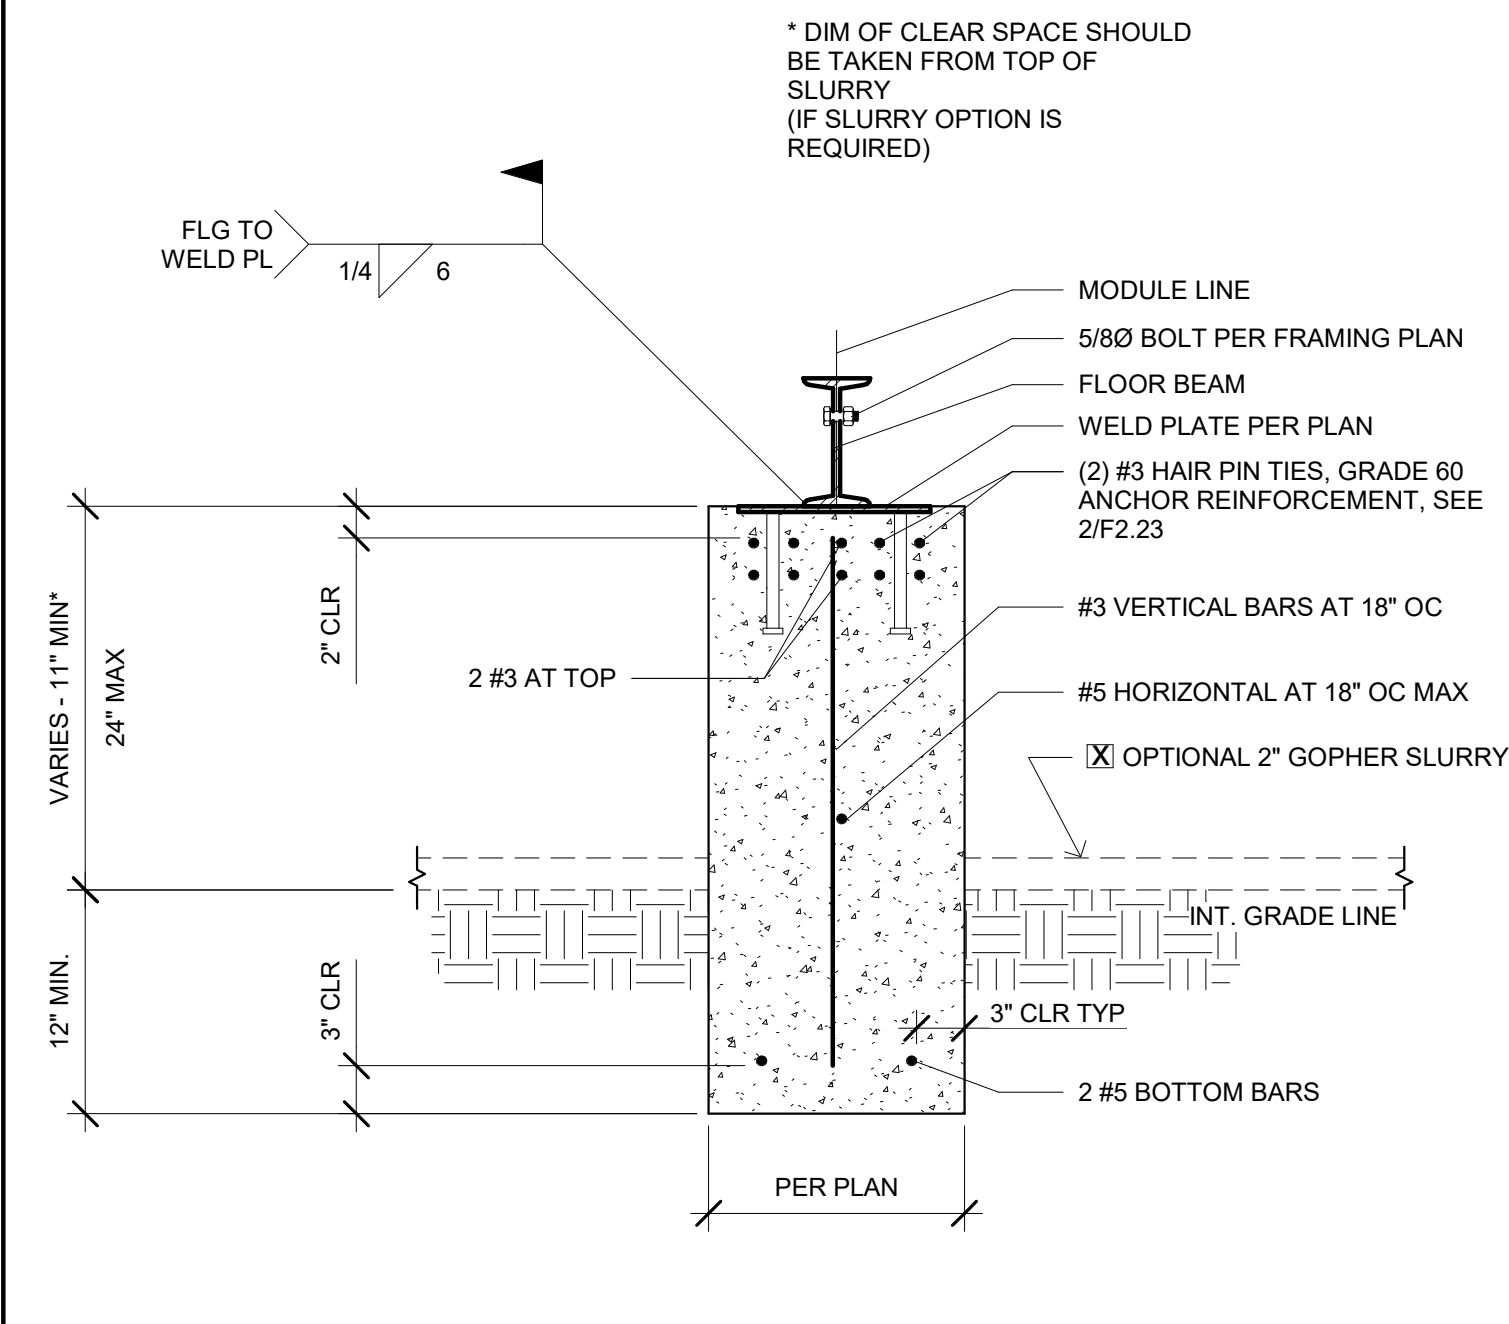


1 **1" = 1'-0"**
INTERIOR RETURN FOOTING

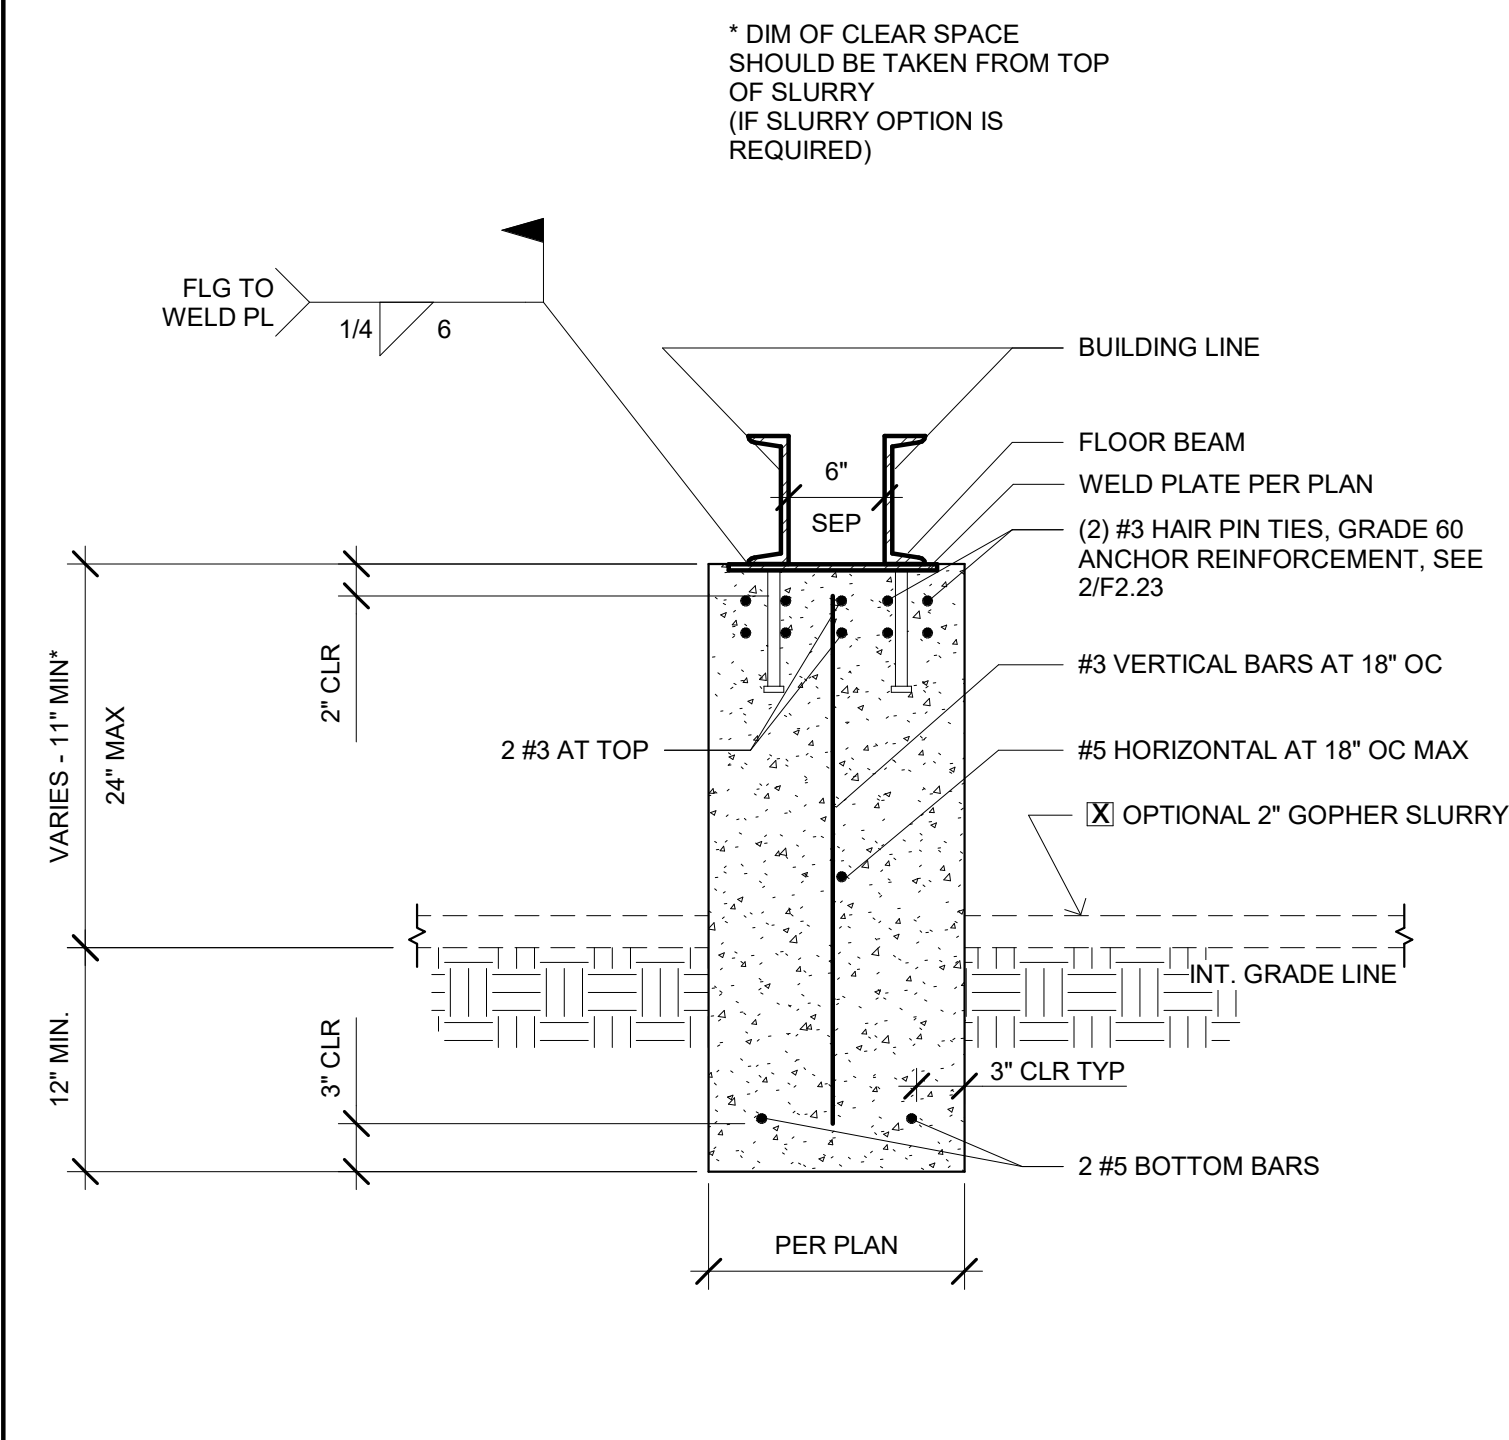



2 $1'' = 1'-0''$
INTERIOR RETURN FOOTING AT SEPARATION

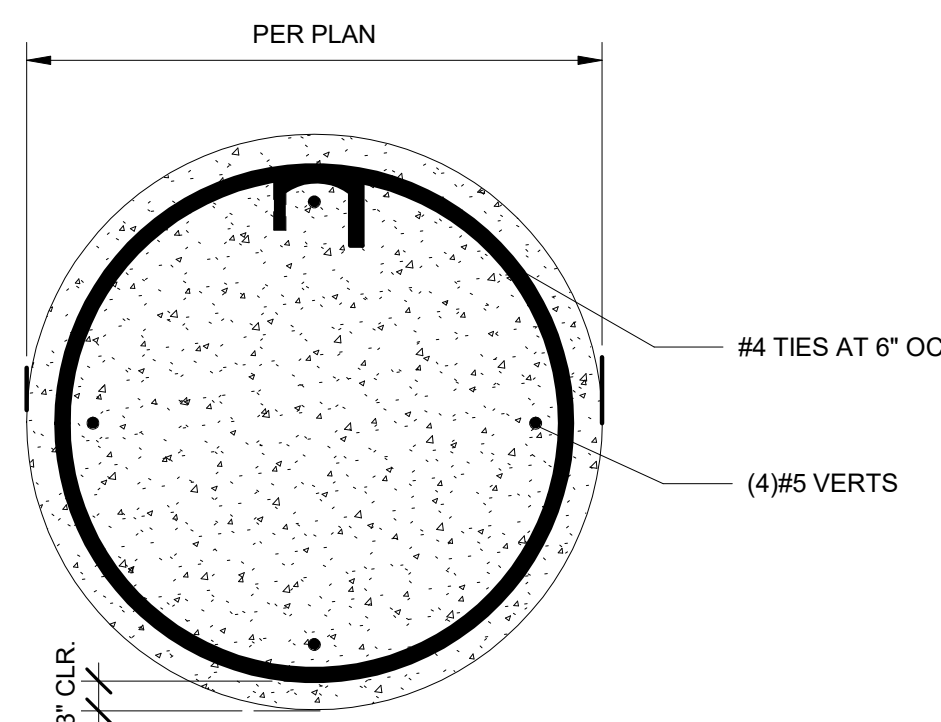

8 $1\frac{1}{2}" = 1'-0"$
TYP. CIRCULAR FTG.

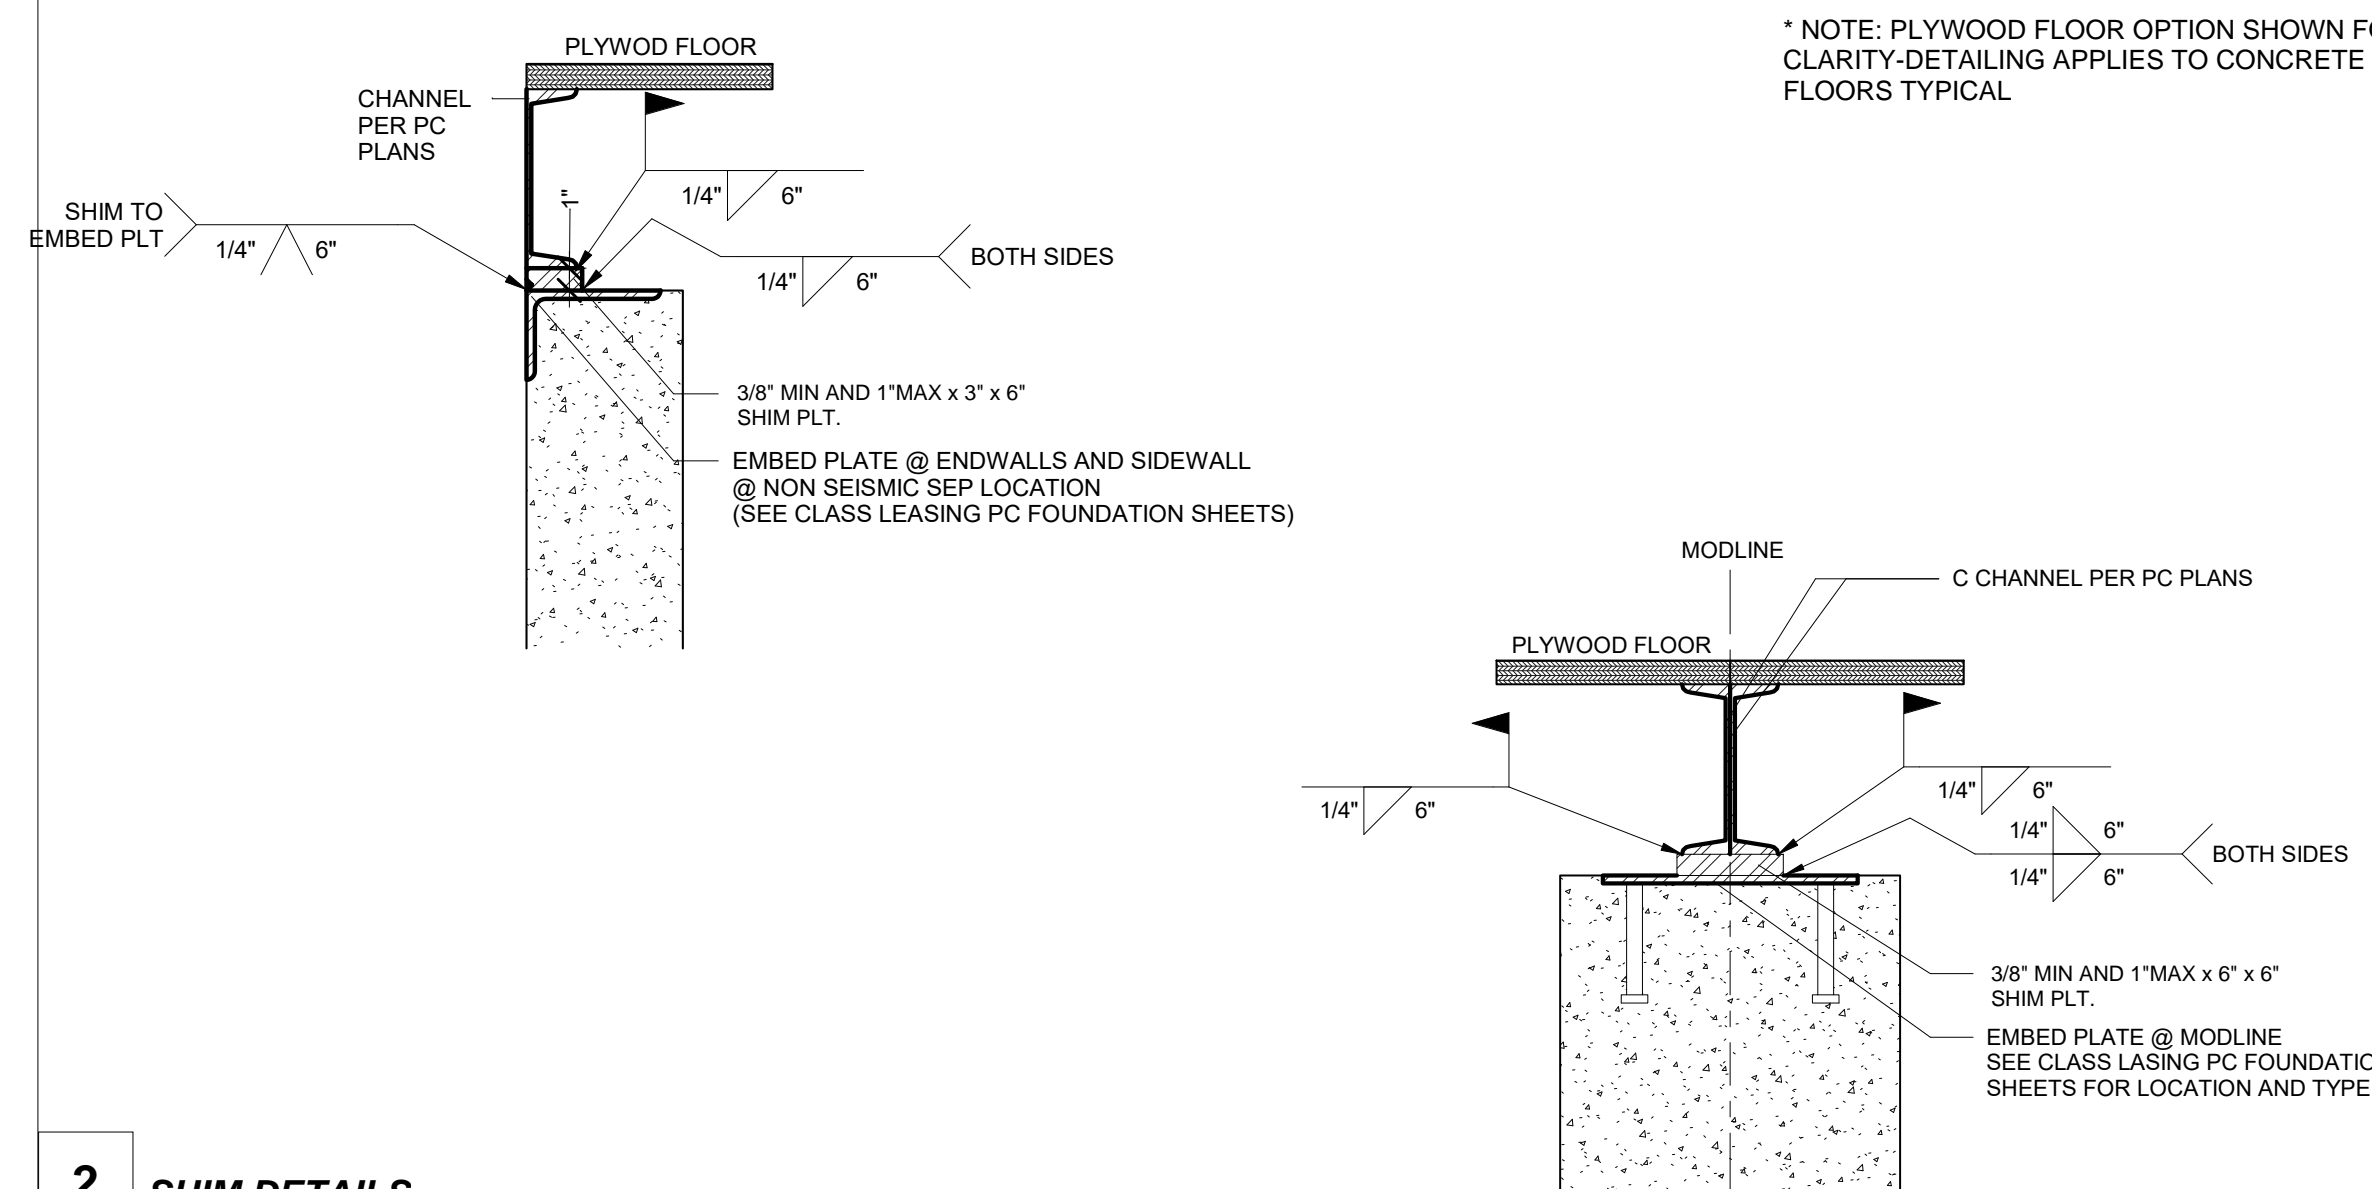

2 SHIM DETAILS

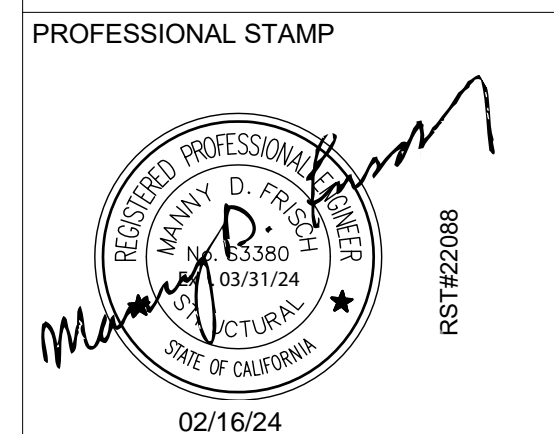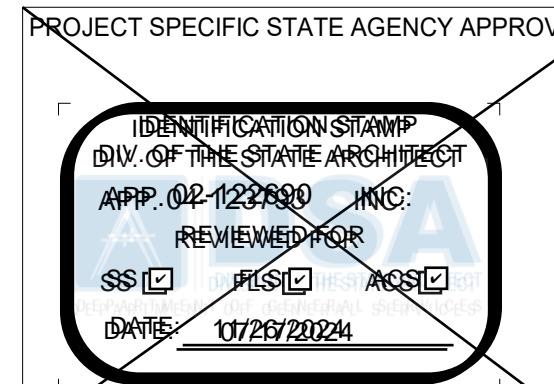


THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEVISED SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



☒ ORIGINAL PC STATE AGENCY APPROVAL

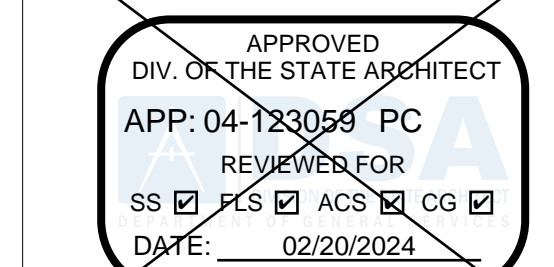

Revision Schedule		
#	Description	Date

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required.

PROJECT TITLE
PC 2022 CBC:24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE

CONCRETE
FOUNDATION
DETAILS

PROJECT NUMBER


DRAWN BY rMc/SC

CHECKED BY JA/RT







DATE _____

SHEET NO.	
-----------	--

SHEET OF



"FOUNDATION CONCRETE MAY BE PLACED DIRECTLY INTO NEAT EXCAVATIONS PROVIDED THE FOUNDATION TRENCH WALLS ARE STABLE AS DETERMINED BY THE ARCHITECT (STRUCTURAL ENGINEER). SUBJECT TO THE APPROVAL OF THE DIVISION OF THE STATE ARCHITECT. IN SUCH CASE THE MINIMUM FORMWORK SHOWN ON THE DRAWINGS IS MANDATORY TO INSURE CLEAN EXCAVATIONS IMMEDIATELY PRIOR TO AND DURING THE PLACING OF CONCRETE."

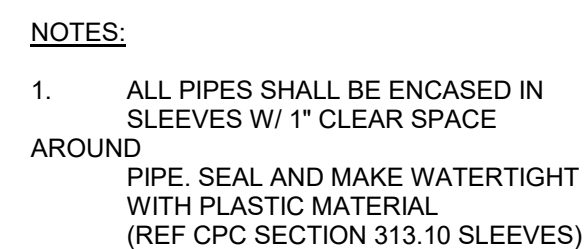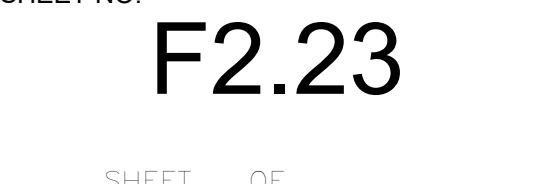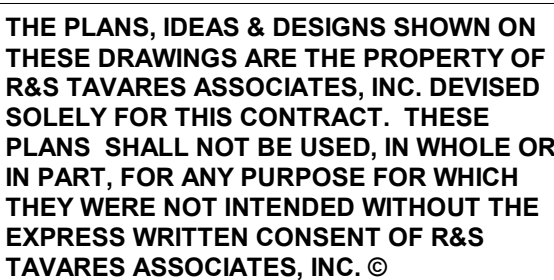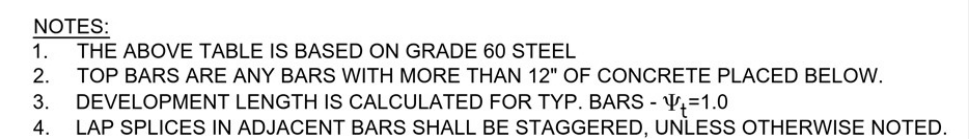(a) MEASURED ON INSIDE OF BAR(b) MEASURED ON INSIDE OF BAF

STRUCTURAL STEEL:

- A.

ALL WORK, UNLESS MODIFIED BY THE CONTRACT DOCUMENTS, SHALL BE PERFORMED IN ACCORDANCE WITH CURRENT AISC SPECIFICATIONS AND STANDARDS.
- B.

STEEL SHAPES SHALL CONFORM TO THE FOLLOWING STANDARD:

a.

STRUCTURAL HSS COLUMNS:

ASTM A500 GRADE B

b.

STRUCTURAL W-SHAPES:

ASTM A992 GRADE 50

c.

TUBE STEEL:

ASTM A500 GRADE A

d.

ALL OTHER:

ASTM A36
- C.

FABRICATION, ERECTION, AND SHOP PAINTING SHALL BE IN ACCORDANCE WITH THE PROVISIONS OF THE AISC CODE OF STANDARD PRACTICE FOR STEEL BUILDING AND BRIDGES.
- D.

HOLES IN STRUCTURAL STEEL SHALL NOT BE PERMITTED, UNLESS SPECIFIED IN THE STRUCTURAL DRAWINGS

CONCRETE

- A.

ALL CONCRETE WORK, UNLESS MODIFIED BY CONTRACT DOCUMENTS, SHALL BE PERFORMED IN ACCORDANCE WITH CHAPTER 19A, CBC 2022 AND ACI 318-19.
- B.

TESTS AND INSPECTION SHALL BE PERFORMED BY A TESTING LABORATRY CONTRACTED BY THE DISTRICT.
- C.

MIX DESIGN SHALL BE SUBMITTED FOR QUALIFICATION AND PROVIDE A 28-DAY COMPRESSIVE STRENGTH P.C. OF 3500 PSI, COMPOSED OF NORMAL WEIGHT TYPE I PORTLAND CEMENT IN CONFORMANCE WITH ASTM C150.
- D.

FORMWORK SHALL RESULT IN FINAL STRUCTURE THAT CONFORMS TO SHAPES, LINES, AND DIMENSIONS AS REQUIRED BY THE CONTRACT DOCUMENTS.
- E.

LOCATIONS OF VENTS AND OPENINGS FOR MECHANICAL AND ELECTRICAL USE SHALL BE VERIFIED BY ARCHITECT.
- F.

EMBEDMENT OF MATERIALS NOT HARMFULL TO CONCRETE AND WITHIN LIMITATIONS OF SECTION 20.6, ACI-318-19 SHALL BE PERMITTED. REFER TO OTHER DISCIPLINES FOR LOCATION OF CONDUIT, PIPES, FITTINGS, SLEEVES, ETC.
- G.

CONTINUOUS BATCH PLANT INSPECTION WAIVED PER CBC 1705A3.3. WHEN CONTINUOUS BATCH PLANT INSPECTION IS WAIVED, THE FOLLOWING PERIODIC INSPECTION SHALL BE REQUIRED:(INSPECTIONS PROVIDED BY DISTRICT)
1.

QUALIFIED TECHNICIAN OF THE TESTING LABORATORY SHALL CHECK THE FIRST BATCH AT THE START OF THE DAY.
2.

LICENSED WEIGHMASTER TO POSITIVELY IDENTIFY MATERIALS AS TO QUANTIFY AND CERTIFY TO EACH LOAD BY A BATCH TICKET.
3.

BATCH TICKETS, INCLUDING MATERIAL QUANTITIES AND WEIGHTS SHALL ACCOMPANY THE LOAD, SHALL BE TRANSMITTED TO THE INSPECTOR OF RECORD BY A TRUCK DRIVER WITH THE LOAD IDENTIFIED THEREON, THE LOAD SHALL NOT BE PLACED WITHOUT A BATCH TICKET IDENTIFYING THE MIX. THE INSPECTOR WILL KEEP A DAILY RECORD OF PLACEMENTS, IDENTIFYING EACH TRUCK, ITS LOAD, AND TIME OF RECEIPT, AND APPROXIMATE LOCATION OF DEPOSIT IN THE STRUCTURE AND WILL TRANSMIT A COPY OF THE DAILY RECORD TO THE ENFORCEMENT AGENCY.
- H.

ANCHOR BOLTS, AND REINFORCING STEEL SHALL BE SECURELY TIED BEFORE CONCRETE IS POURED.

CONCRETE MIX

IN ADDITION TO THOSE REQUIREMENTS DICTATED BY THE PC DESIGN, THE CONCRETE MIX USED IN THE FOUNDATION ELEMENTS SHALL COMPLY WITH THE DURABILITY REQUIREMENTS OF AMERICAN CONCRETE INSTITUTE (ACI) 318 SECTION 19.3. THE PC DRAWINGS SHALL ACCOUNT FOR THE DEPENDENCY OF THESE DURABILITY REQUIREMEMNTS ON SITE-SPECIFIC CHARACTERISTICS.

A. WHEN THE PC DRAWINGS DO NOT REQUIRE A SITE-SPECIFIC GEOTECHNICAL REPORT THAT QUANTIFIES SULFATE CONTENT IN THE SOIL, THE PC DRAWINGS SHALL REQUIRE A CONCRETE MIX SHALL COMPLYING WITH ONE OF THE FOLLOWING PER ACI 318 TABLE 19.3.2.1. SEE THIS SHEET A.1 & A.2 FOR OPTIONS

B. MAXIMUM WATER/CEMENT RATION OF 0.45; MINIMUM COMPRESSIVE STRENGTH OF 4,500 POUNDS PER SQUARE INCH (PSI); TYPE V CEMENT PLUS POZZOLAN OR SLAG CEMENT COMPLYING WITH FOOTNOTE 7; AND PROHIBITION OF ADMIXTURES CONTAINING CALCIUM CHLORIDE

C. MAXIMUM WATER/CEMENT RATIO OF 0.40; MINIMUM COMPRESSIVE STRENGTH OF 5,000 PSI; TYPE V CEMENT COMPLYING WITH FOOTNOTE 8; AND PROHIBITION OF ADMIXTURES CONTAING CALCIUM CHLORIDE.

D. WHEN THE PC DRAWINGS REQUIRE A SITE-SPECIFIC GEOTECHNICAL REPORT THAT QUANTIFIES SULFATE CONTENT IN THE SOIL, THE PC DRAWINGS SHALL CLEARLY STATE THE EXPOSURE CLASS FOR EACH CATAGORY (I.E., F, S, W, AND C) OR COMBINATION THEREOF. THE PC DESIGN IS APPROVED FOR THE MAXIMUM WATER/CEMENT RATIO, MINIMUM COMPRESSIVE STRENGTH, CEMENTITIOUS MATERIAL REQUIREMENTS, AND ADMIXTURE LIMITATIONS SHALL BE STATED ON THE PC DRAWINGS FOR EACH APPROVED CASE.

E. BOTH APPROACHES GIVEN SECTIONS 5.5.1 AND 5.5.2 ABOVE CAN BE INCLUDED ON THE PC DRAWINGS AS ALTERNATE OPTIONS IN ACCORDANCE WITH SECTION 1.4 ABOVE

F. CONCRETE EXPOSE TO THAW AND FREEZE CYCLES SHALL BE AIR ENTRAINED PER ACI 318 SECTION 19.3.3.1

STEEL REINFORCEMENT

- A.

DEFORMED BARS SHALL CONFORM TO ASTM A615.
- B.

f_y = 60,000 PSI, FOR ALL BARS EXEPT FOR #3 BARS, f_y = 40,000 PSI.
- C.

PROVIDE A MINIMUM CONCRETE COVER FOR REINFORCEMENT EMBEDDED IN:

a.

CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH = 3"

b.

CONCRETE EXPOSED TO EARTH OR WEATHER FOR #5 BARS OR SMALLER = 1.5"
- D.

SPLICE LENGTHS SHALL BE A MINIMUM OF 48" FOR #5 BARS, AND 30" FOR #4 BARS UNLESS OTHERWISE SPECIFIED IN DRAWINGS.

BOLTS

- A.

ALL BOLTS AND ANCHOR BOLTS SHALL CONFORM TO ASTM A-307
- B.

BOLTS EXPOSED TO THE ELEMENTS SHALL BE GALVANIZED BY THE HOT-DIP OR MECHANICAL PROCESS

WELDING

- A.

ALL WELDING SAHLL BE IN COMFORMANCE TO:

a.

AWS D1.1, EXCEPT AS MODIFIED IN SECTION J2, AISC-360 FOR STEEL

b.

AWS D1.3 FOR LIGHT GAUGE STEEL

c.

AWS D1.4 FOR REINFORCING STEEL
- B.

ELECTRODE CLASSIFICATION:

a.

E70XX FOR STEEL AND CONCRETE STEEL REINFORCEMENT

b.

E60XX FOR LIGHT GAUGE STEEL
- C.

WELDS SHALL BE CAPABLE OF PRODUCING THE FOLLOWING V-NOTCH TOUGHNESS AS DETERMINED BY APPROPRIATE AWS A5 CLASSIFICATION TEST METHOD OR MANUFACTURER CERTIFICATION:

a.

LATERAL FORCE RESISTING SYSTEM (LFRS) = 20 FT-LB AT 0 DEGREE F

b.

COMPLETE JOINT PENETRATION GROOVE WELD = 20 FT-LB AT 40 DEGREE F
- D.

SHOP AND FIELD WELDING SHALL BE PERFORMED BY AWS CERTIFIED WELDERS.
- E.

INSPECTION:

a.

PERIODIC INSPECTION OF FILLET WELDS LESS THAN OR EQUAL TO 5/16", FLOOR AND ROOF DECK WELDS.

b.

CONTINUOUS INSPECTION FOR OTHER WELDS.
- F.

NONDESTRUCTIVE TESTING (NDT):

a.

ULTRASONIC TESTING SHALL BE PERFORMED ON 100 PERCENT OF CJP GROOVE WELDS IN MATERIALS 5/16" OR THICK OR GREATER. ULTRASONIC TESTING NOT REQUIRED FOR MATERIALS LESS THAN 5/16" THICK. TESTING FREQUENCY MAY BE REDUCED TO 25%, PROVIDED PROVISIONS SET FORTH IN SECTION N5.5e, AISC-360 IS MET.

b.

MAGNETIC PARTICLE TESTING SHALL BE PERFORMED ON 25 PERCENT OF ALL BEAM-TO-COLUMN CJP GROOVE WELDS. TESTING FREQUENCY MAY BE REDUCED TO 10%, PROVIDED PROVISIONS SET FORTH IN J6.2g, AISC-341 IS MET.

FOUNDATIONS

GEOTECHNICAL INVESTIGATION SHALL BE CONDUCTED IN ACCORDANCE WITH SECTION 1803A.1 THROUGH 1803A.8 BY GEOTECHNICAL ENGINEER CONTRACTED BY THE DISTRICT. ALLOWABLE FOUNDATION AND LATERAL SOIL PRESSURE VALUES MAY BE DETERMINED FROM TABLE 1806A.2, WHERE GEOTECHNICAL REPORTS IS NOT REQUIRED PER SECT 1803A.2. A MAXIMUM ALLOWABLE SOIL PRESSURE OF 1000 PSF AND 1500 PSF SHALLBE PERMITTED FOR TEMPORARY V AND PERMANENT CONCRETE FOUNDATIONS RESPECTIVELY IN ACCORDANCE WITH SECTION 4.6, IR 16-1

A PREVIOUS REPORT FOR A SPECIFIC SITE MAY BE RESUBMITTED. THE ALLOWABLE FOUNDATIONA AND LATERAL SOIL PRESSURE VALUES ARE ALLOWED A 33% INCREASE FOR SHORT TERM WIND AND SEIMIC LOADS.

THE DISTRICT SHALL BE RESPONSIBLE FOR EXCAVATION, BACKFILL, SETTING ELEVATIONS, CRANING AND RIGGING. PROVIDE SHIMS TO LEVEL BUILDING WITHIN 1/2" TOLERANCE.

COLD-FORMED STEEL:

- A.

ALL WORK SHALL, UNLESS MODIFIED BY THE CONTRACT DOCUMENTS, SHALL BE PERFORMED IN ACCORDANCE WITH CURRENT AISI SPECIFICATIONS AND STANDARDS.
- B.

MATERIAL SPECIFICATION:

a.

ASTM A-1011/A, GRADE 33 FOR MATERIALS THICKNESS 0.120 OR LESS UNLESS OTHERWISE NOTI

b.

ASTM A-1003, GRADE 33 TYPE H FOR LIGHT GUAGE STUDS AND TRACKS

c.

SHAPES SHALL BE DIMENSIONED TO SSMA SPECIFICATIONS.
- C.

SCREWS EXPOSED TO THE ELEMENTS SHALL BE GALVANIZED

STEEL DECK

MINIMUM THICKNESS PERMITTED FOR FLOOR STEEL DECKS IS 20GA. PER DSA IR 16-1, 1.2.1, MINIMUM THICKNESS OF NON-STRUCTURAL STEEL ROOF DECKING IS 26GA. STANDING SEAM ROOF PANELS ARE GRADE 40 SHEET STEEL WITH ALUMINUM ZINC COATING CONFORMING TO ASTM A792 AND A255.

CHANGES

CHANGES AFFECTING STRUCTURAL PORTION OF THE APPROVED PC SHALL NEED DSA APPROVAL AND SHALL BE CLASSIFIED AS CCD CATEGORY A.

WOOD

ALL FRAMING LUMBER SHALL BE GRADE MARKED BY AN APPROVED GRADING AGENCY

SHEATHING:

EACH SHEET SHALL BE GRADE MARKED BY THE AMERICAN PLYWOOD ASSOCIATION IN ACCORDANCE WITH THE PROCEDURES AND QUALIFICATIONS SET FORTH BY PS 1-19.

1.

SUB FLOOR: 1 1/8" T&G UNBLOCKED PLYWOOD, SHALL PROVIDE A SMOOTH AND UNIFORM SURFACE
2.

CAPABLE OF ACCEPTING CARPET FINISH
3.

PLYWOOD ROOF DECK OPTION: APA RATED 3/4" T&G OSB OR EQUIVALENT RATED SHEATHING
- EXTERIOR WALL SIDING:
- I.

STANDARD: 5/8" DURATEMP OR 5/8" SMART PANEL
- II.

OPTION: 5/8" MOD
- III.

OPTION: 1/2" OSB OR CDX PLYWOOD FOR PLASTER/STUCCO FINISH
- IV.

OPTION: 1/2" OSB OR CDX PLYWOOD FOR HARDIE BOARD (LAP SIDING) FINISH
4.

EXTERIOR WALL SIDING ATTACHMENT:
- FASTENERS USED FOR THE ATTACHMENT OF EXTERIOR WALL COVERINGS SHALL BE HOT-DIPPED GALVANIZED, MECHANICALLY DEPOSITED ZINC-COATED, STAINLESS, SILICON BRONZE OR COPPER PER CBC SECTION 2304.10.1.1
- FASTEN TO WOOD FRAMING WITH 8D BOX NAILS @ 6" E.N., 12" F.N.
- FASTEN TO LIGHT GAGE METAL FRAMING WITH #8 WAFER HEAD STSMS @ 6" E.N., 12" F.N.
- FASTEN TO STRUCTURAL STEEL WITH #12 STSMS OR 0.145 DIAM SHOT PINS @ 12" O.C.

TREATED WOOD:

ALL WOOD LOCATED WITHIN 6" OF EXPOSED EARTH SHALL BE "PRESERVATIVE TREATED" OR SHALL BE "NATURALLY DURABLE" MATERIAL IN ACCORDANCE WITH CBC SECTION 2304.12.1.2.

1.

ALL ROUGH LUMBER SHALL BE DF #2 OR BETTER.
2.

ALL POWER DRIVEN FASTENERS SHALL BE HILTI FASTENERS ICC# ESR-1663, AND RAMSET POWER DRIVEN FASTENERS (ICC # ESR-1799), OR SIMPSON POWER DRIVEN FASTENERS ICC #ESR-2138, OR OTHER EQUIVALENT PRODUCTS WITH ICC REPORTS AND APPROVED BY DSA.
3.

FASTENERS, INCLUDING NUTS AND WASHERS, IN CONTACT WITH PRESERVATIVE-TREATED WOOD SHALL BE OF HOT-DIPPED ZINC-COATED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER PER CBC 2304.10.1.1

ROOF DIAPHRAGM:

3/4" T&G RATED SHEATHING UNBLOCKED DIAPHRAGM, EXPOSURE 1, 48/24 SPAN RATING
FASTEN AT METAL SUPPORTS W/ #10 x 1 1/4" SELF-TAPPING PHILLIPS FLAT-HEAD ZINC COATED TEKs SCREWS @ 6" BN/CON. EDGE, 6" EN, AND 12" O.C. FN. PROVIDE A MINIMUM OF 3/8" EDGE DISTANCE FOR FASTENERS TO PLYWOOD EDGE PER CBC SECTION 2306.2

NOTE: ALL PANEL EDGES SHALL BE ATTACHED TO FRAMING MEMBERS OR BLOCKING, WHERE USED AS BLOCKING, FLAT STRAPPING SHALL BE A MINIMUM THICKNESS OF 33MILS WITH A MINIMUM WIDTH OF 1.5 INCHS AND SHALL BE EITHER INSTALLED BELOW SHEATHING. FOR OTHER THAN STEEL SHEATHING, THE SCREWS SHALL BE INSTALLED THROUGH THE SHEATHING TO THE BLOCKING.

FLOOR DIAPHRAGM:

1 1/8" PLYWOOD UNBLOCKED DIAPHRAGM - STURD-FLOOR T&G RATED SHEATHING, EXTERIOR, 48" oc SPAN RATING
FASTEN AT METAL SUPPORTS W/ #10 - 24 x 2" SELF-TAPPING PHILLIPS FLAT-HEAD ZINC COATED TEKs @ 6" O.C. BN/CON. EDGE, 6" O.C. EN, 12" FN. PROVIDE A MINIMUM OF 3/8" EDGE DISTANCE FOR FASTENERS TO PLYWOOD EDGE PER CBC SECTION 2306.2

NOTE: ALL PANEL EDGES SHALL BE ATTACHED TO FRAMING MEMBERS OR BLOCKING, WHERE USED AS BLOCKING, FLAT STRAPPING SHALL BE A MINIMUM THICKNESS OF 33MILS WITH A MINIMUM WIDTH OF 1.5 INCHS AND SHALL BE EITHER INSTALLED BELOW SHEATHING. FOR OTHER THAN STEEL SHEATHING, THE SCREWS SHALL BE INSTALLED THROUGH THE SHEATHING TO THE BLOCKING.

CONCRETE FLOOR DATA: LIGHTWEIGHT CONCRETE FLOOR
STRENGTH: 3500 PSI
TYPE: I OR II
DESINTY: 110 PCF - MAX

DIMENSION LUMBER ATTACHMENT TO STEEL FRAMING:

2 x STUDS AT CORNER STEEL COLUMNS (NAILING STUD)
USE: #10 - 24 x 2 1/2" LG. SELF-DRILLING SELF-TAPPING PHILLIPS FLAT-HEAD WITH WASHER ZINC COATED TEK SCREWS AT 24" OC.

NAILING NOTES:

1.

ALL NAILS SHALL BE COMMON UNLESS OTHERWISE NOTED
2.

MACHINE APPLIED 16d FASTENERS SHALL HAVE AN EMBEDMENT OF NOT LESS THAN 1 1/2" INTO THE SECOND MEMBER, AND SHALL NOT BE LESS THAN 3" IN OVERALL LENGTH.
3.

NAILS SHALL BE ACCEPTABLE FOR HAND NAILING, PROVIDED THE REQUIREMENT EMBEDMENT IS MAINTAINED

CONNECTIONS AND FASTENERS:

ALL CONNECTIONS AND FASTENERS IN DRAWINGS CAN BE SUBSTITUTED BY AN EQUIVALENT PRODUCT PROVIDING REPORTS ARE SUBMITTED TO AND APPROVED BY DSA.

CONNECTIONS LAG SCREWS:

LAG SCREWS SHALL BE INSTALLED WITH WASHER AND TURNED BY WRENCH, OVER-TORQUING SHALL BE AVOIDED. PRE-DRILLED CLEARANCE AND LEAD HOLE SHALL BE REQUIRED AS DESCRIBED BELOW:

- a)

THE CLEARANCE HOLE FOR THE UNTHREADED PORTION OR THE SHANK SHALL HAVE SAME DEPTH AND DIAMETER.
- b)

THE LEAD HOLE FOR THE THREADED PORTION OF THE SHANK SHALL HAVE SAME DEPTH AND 65% TO 85% OF SHANK DIAMETER FOR LUMBER WITH SPECIFIC GRAVITY OF, G > 0.6
60% TO 75% OF SHANK DIAMETER FOR LUMBER WITH SPECIFIC GRAVITY OF, 0.5 < G ≤ 0.6
40% TO 70% OF SHANK DIAMETER FOR LUMBER WITH SPECIFIC GRAVITY OF, G ≤ 0.5

LEAD OR CLEARANCE HOLES SHALL NOT BE REQUIRED FOR 3/8" DIAMETER OR SMALLER LAG SCREWS.


NAILING SCHEDULE: (ALL NAILS SHALL BE COMMON OR BOX NAILS, GALVANIZED WHERE EXPOSED) PER CBC TABLE 2304.10.2			
CONNECTION	COMMON FASTENERS		BOX NAIL FASTENERS
	QTY	SIZE	SPACING O.C.
1. JOIST TO SILL OR GIRDER	3- 8d		3- 10d
2. BRIDGING TO JOIST	2- 8d		2- 10d
3. EA. JOIST	2- 8d		2- 10d
4. TO EA. JOIST	3- 8d		3- 10d
5. 2" SUBFLOOR TO JOIST	2- 16d		N/A
6. TO EA. JOIST	16d	@ 16"	16d @ 12"
7. TOP P.L.T. TO STUD	2- 16d		3- 10d
8. STUD TO SOLE P.L.T.	4- 8d		4- 10d
9. DOUBLE STUDS	16d @ 24"		10d @ 16"
10. DOUBLE TOP P.L.T.	3- 16d	@ 16"	10d @ 12"
11. RAFTERS TO TOP P.L.T.	3- 8d	@ 16"	3- 10d
12. R/W JOIST TO TOP P.L.T.	8d	@ 6"	10d @ 6"
13. INTERSECTIONS	2- 16d		3- 10d
14. CONT. HDR. 2 PIECES	16d	@ 16"	3- 10d
15. CLG. JOIST TO P.L.T.	3- 8d		3- 10d
16. CONT. HDR. TO STUD	4- 8d		4- 10d
17. PARTITIONS	3- 16d		4- 10d
18. RAFTERS	3- 16d		SEE TABLE 2308.7.3.1
19. RAFTER TO P.L.T.	3- 8d		3- 16d
20. P.L.T.	2- 8d		2- 10d
21. 1X8 SHTG. TO EA. BRG.	3- 8d		3- 10d
22. BRG.	3- 8d		3- 10d
23. BUILT-UP CORNER STUDS	16d @ 24"		3- 10d
24. BUILT-UP GIRDERS & BEAMS	20d @ 32"		10d @ 24"
25. 2" PLANKS	2- 20d		N/A
26. COLLAR TIE TO RAFTER	3- 10d		N/A
27. JACK RAFTER TO HIP	3- 10d		4- 16d
28. ROOF RAFTER TO 2X RIDGE	2- 16d		3- 10d
29. JOIST TO BAND JOIST	3- 16d		4- 10d
30. 4X BLOCKING TO STUDS	1- A36		N/A
OR	4- 8d		4- 10d

A) NAILS SPACED AT 8 INCHES AT INTERMEDIATE SUPPORTS WHERE SPANS ARE 48 INCHES OR MORE. FOR NAILING OF WOOD STRUCTURAL PANEL AND PARTIOLERING DIAPHRAGMS AND SHEAR WALLS, REFER TO SECTION 2305 NAILS FOR WALL SHEATHING ARE PERMITTED TO BE COMMON, BOX OR CASKIN.
B) SPACING SHALL BE 6 INCHES ON CENTER ON THE EDGES AND 12 INCHES ON CENTER AT INTERMEDIATE SUPPORTS FOR NONSTRUCTURAL APPLICATIONS.
C) WHERE A RAFTER IS FASTENED TO AN ADJACENT PARALLEL CEILING JOIST IN ACCORDANCE WITH THIS SCHEDULE AND THE CEILING JOIST IS FASTENED TO THE TOP PLATE IN ACCORDANCE WITH THIS SCHEDULE, THE NUMBER OF TOENAILS IN THE RAFTER SHALL BE PERMITTED TO BE REDUCED BY ONE NAIL.
D) RRSR-01 IS A ROOF SHEATHING RING SHANK NAIL MEETING THE SPECIFICATIONS IN ASTM F1667

DECIMAL AND GAUGE CHARTS		
FRACTION	DECIMAL	
1/32	0.03125	
1/16	0.0625	
3/32	0.09375	
1/8	0.125	
5/32	0.15625	
3/16	0.1875	
7/32	0.21875	
1/4	0.25	
9/32	0.28125	
5/16	0.3125	
11/32	0.34375	
3/8	0.375	
13/32	0.40625	
7/16	0.4375	
15/32	0.46875	
1/2	0.5	
17/32	0.53125	
9/16	0.5625	
19/32	0.59375	
5/8	0.625	
21/32	0.65625	
11/16	0.6875	
23/32	0.71875	
3/4	0.75	
25/32	0.78125	
13/16	0.8125	
27/32	0.84375	
7/8	0.875	
29/32	0.90625	
15/16	0.9375	
31/32	0.96875	
1	1	

PENNY	GAUGE	DEC.
60d, 40d	4	0.2242
30d	5	0.2092
20d	6	0.1943
	7	0.1793
16d	8	0.1644
12d, 10d	9	0.1495
8d	10	0.1345
6d	11	0.1196

PROJECT SPECIFIC STATE AGENCY APPROVAL

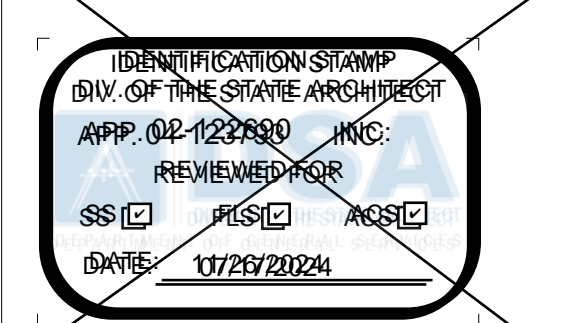

PROFESSIONAL STAMP




THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



ORIGINAL PC STATE AGENCY APPROVAL

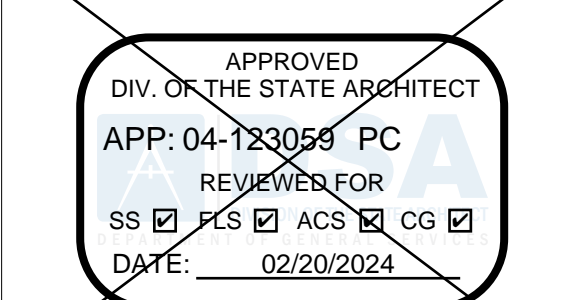

Revision Schedule

#	Description	Date
PRE-CHECK (PC) DOCUMENT		
Code: 2022 CBC		
A separate project application for construction is required		

PROJECT TITLE
PC 2022 CBC: 24' x 60'
EXPANDABLE TO
72' x 60'

SHEET TITLE
STRUCTURAL GEN
NOTES

PROJECT NUMBER
22088

DRAWN BY
rMc/SM

CHECKED BY
JA/RT

DATE

SHEET NO.

S0.1


SHEET OF

\\192.168.10.2\Clients\2022\22073 - Class Leasing, PC 24x40 to 120x40 HS, Eklorado Cty OE - 160# Snow Load, MainFile_detached.rvt

6/2/2022 9:46:43 AM

1 1/4" = 1'-0"
WD Shth'g Flr Framing Plan (50+15 PSF) CROSS-STRAP OPT.

MONO SLOPE X - S5.0 1
DUAL SLOPE S5.1 1

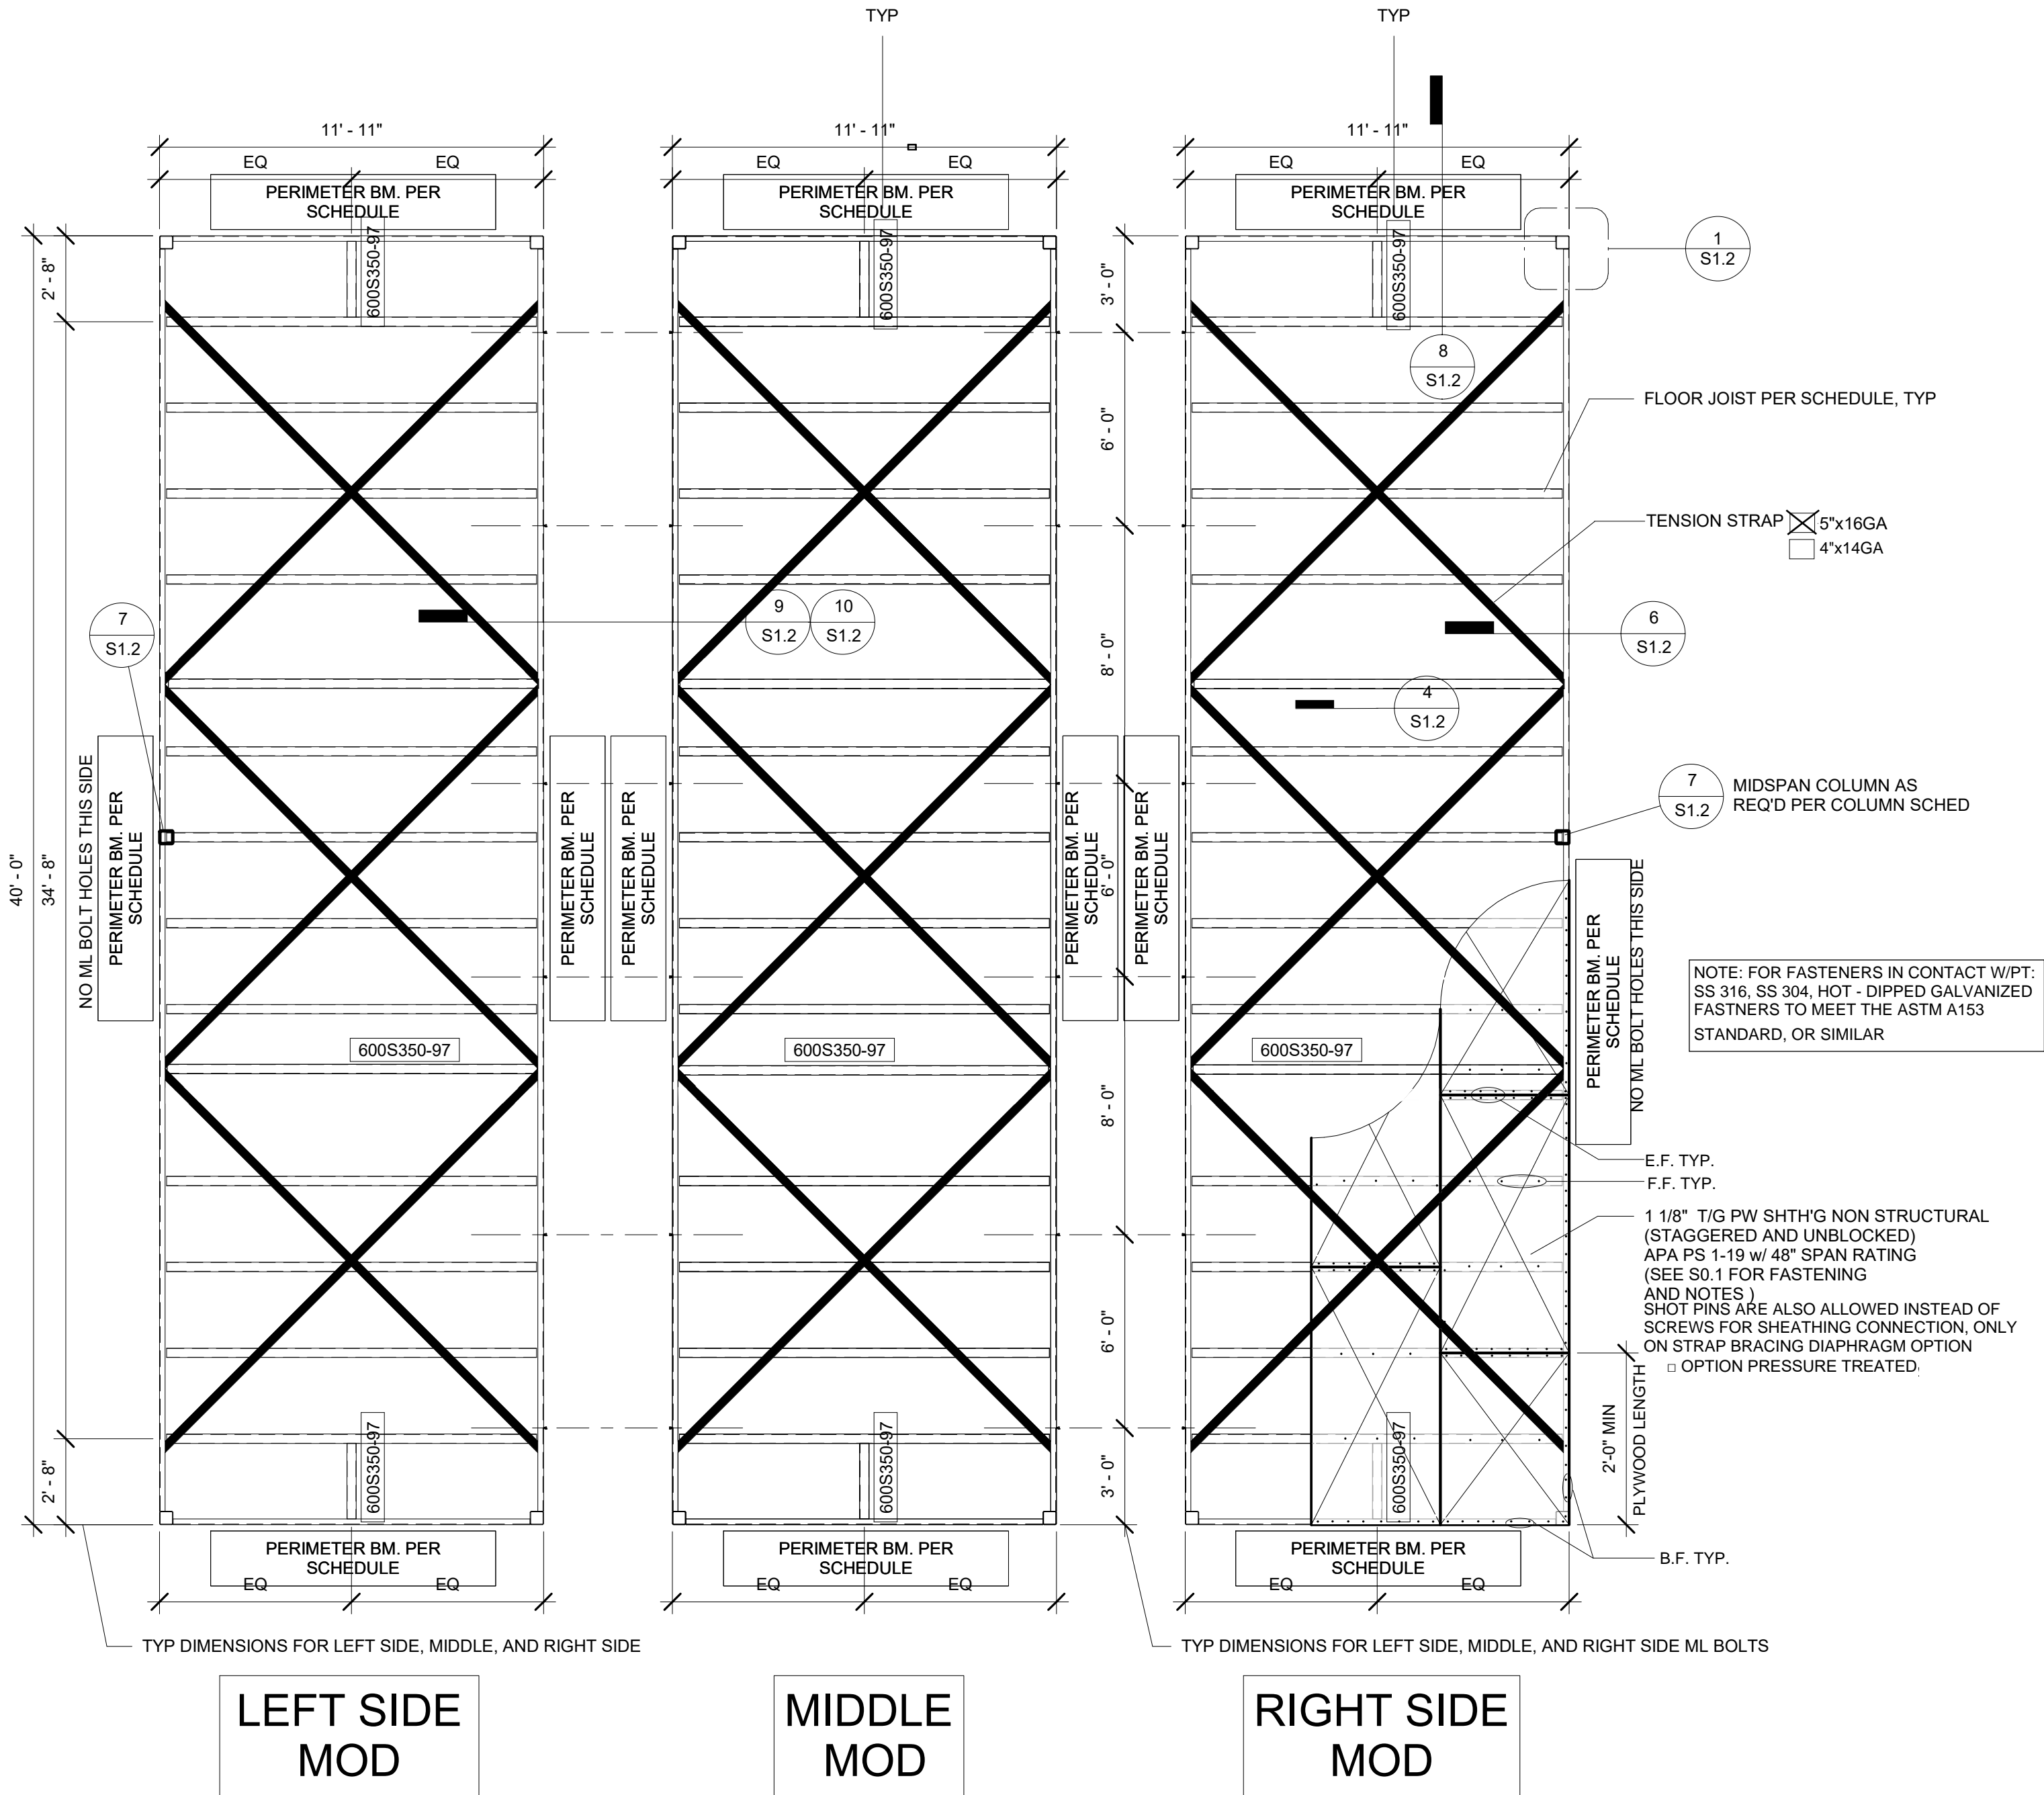

Floor Joist Schedule		
FLL	JOIST	SPACING
50+15 PSF ¹	600S350-97	32" O.C.
100 PSF ¹	600S350-97	24" O.C.
150 PSF ²	600S350-97	16" O.C.


FOOTNOTES:
1. APPLICABLE FOR OCCUPANCY E
2. APPLICABLE FOR OCCUPANCY E & B

Perimeter Floor Beam Schedule			
HT	No Plaster Walls	Plaster Walls	w/ Parapet, 18" max
9'	C10x15.3	C10x15.3	C10x15.3
10'	C10x15.3	C10x15.3	C10x15.3


NOTE: SPLICE AT FLOOR BEAM PERMITTED PER 3/S1.2

Column Schedule			
HT	No Plaster Walls	Plaster Walls	w/ Parapet, 18" max
9'	5x5x1/4	5x5x1/4	6x6X1/4
10'	6x6x1/4	6x6x1/4	6x6X1/4


NOTE: ALL PANEL EDGES SHLL BE ATTACHED TO FRAMING MEMBERS OR BLOCKING. WHERE USED AS BLOCKING, FLAT STRAPPING SHALL BE A MINIMUM THICKNESS OF 33MILS WITH A MINIMUM WIDTH OF 1.5 INCHES AND SHALL BE INSTALLED BELOW SHEATHING. FOR OTHER THAN STEEL SHEATHING, THE SCREWS SHALL BE INSTALLED THROUGH THE SHEATHING TO THE BLOCKING.

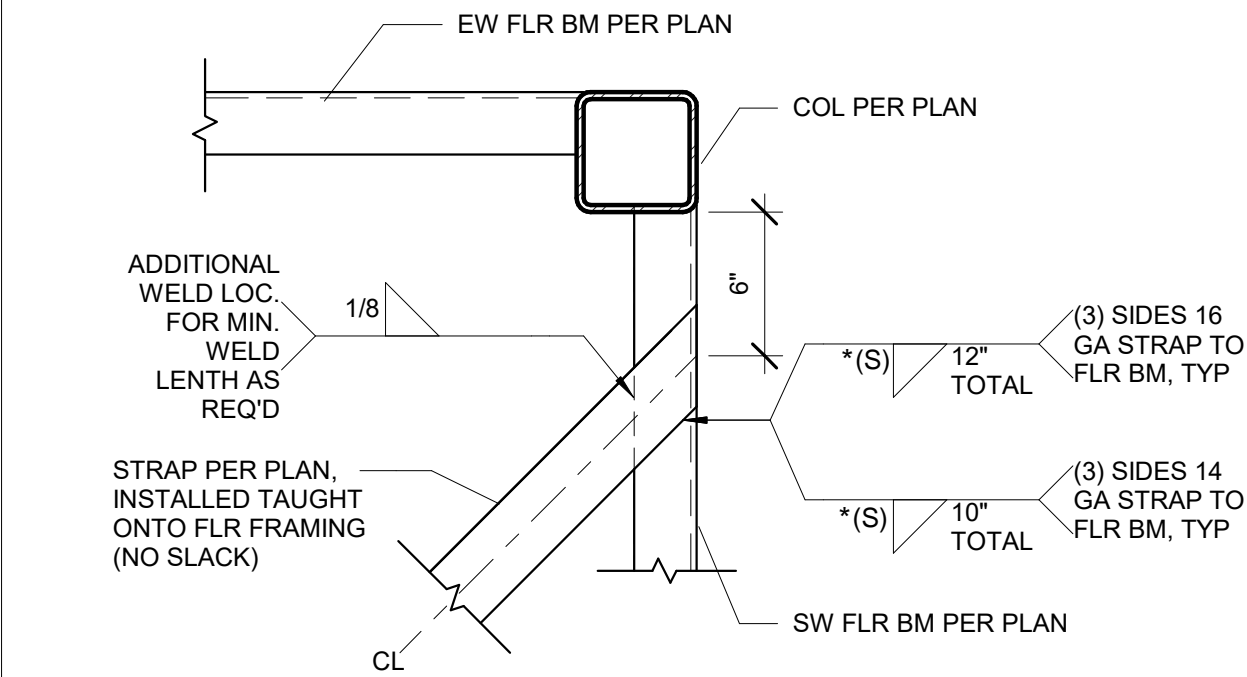


2 1 1/2" = 1'-0"
FLOOR BRACING STRAP @ ENDWALL

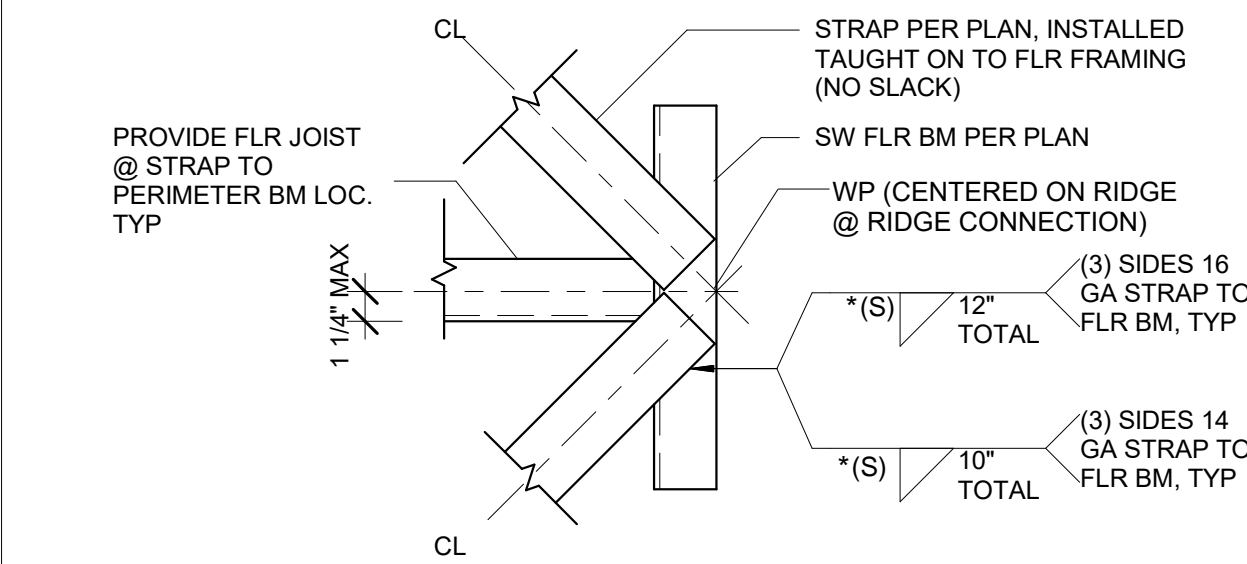



3 1 1/2" = 1'-0"
FLOOR STRAP BRACING @ SIDEWALL

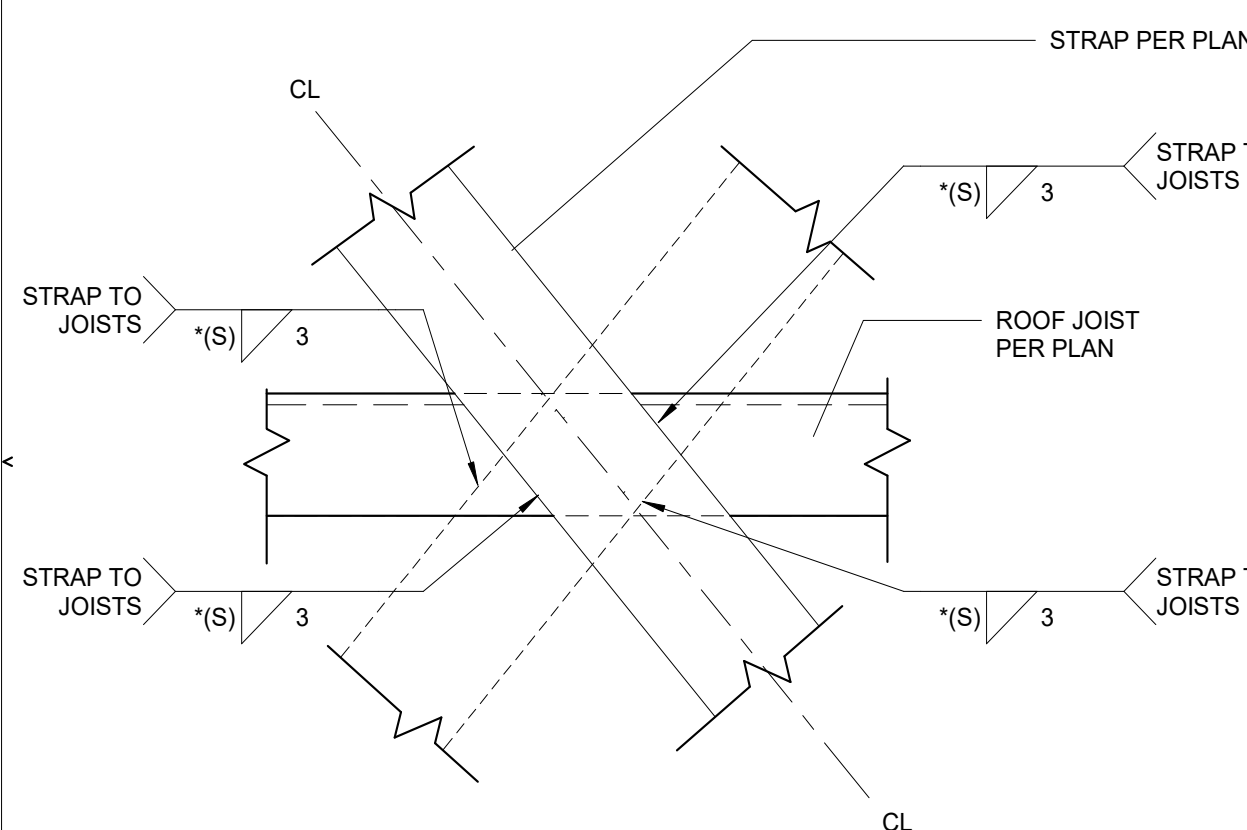


4 3" = 1'-0"
STRAP TO JOIST CONNECTION

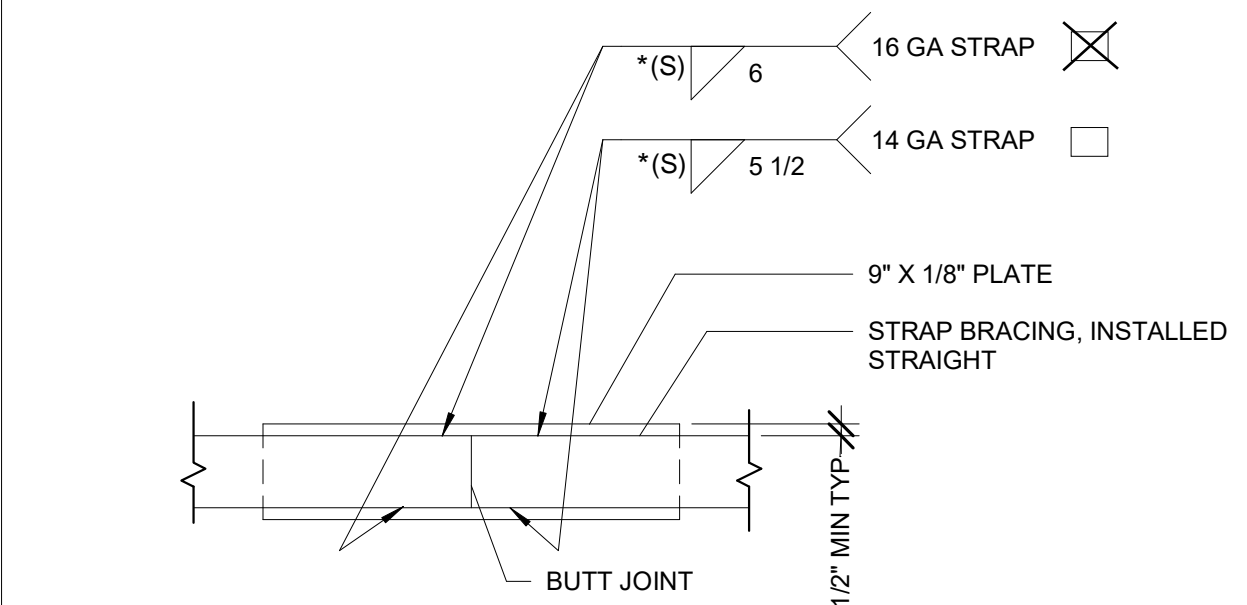

5 1 1/2" = 1'-0"
STRAP SPLICE DETAIL

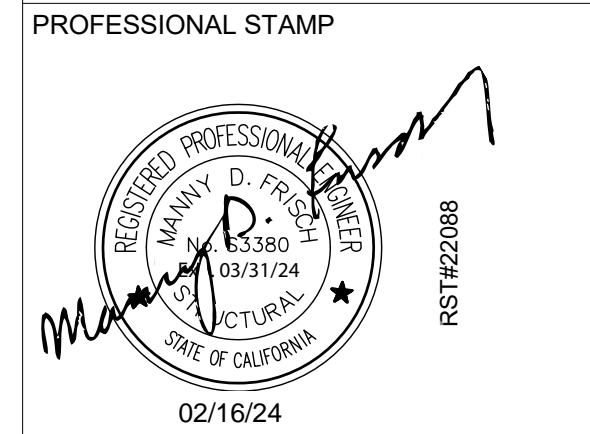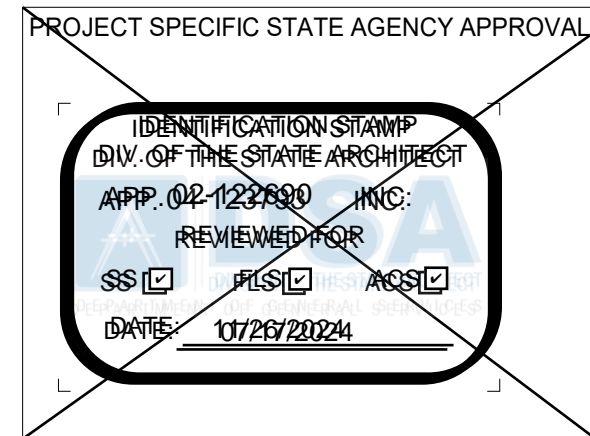

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PARTS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

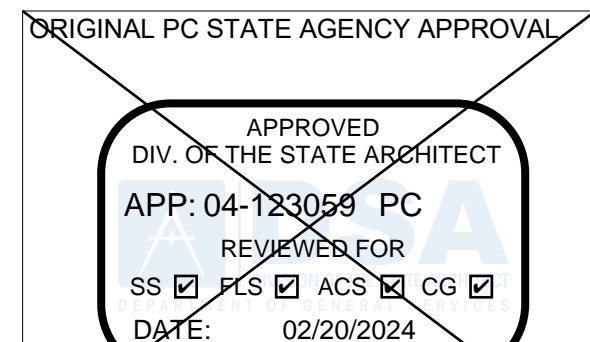

REVISIONS

Description BY

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC:24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
WD STH'G FLR
FRAMING PLAN
CROSS-STRAP OPT.
50 + 15 PSF
100 PSF
150 PSF

PROJECT NUMBER
22073

DRAWN BY
Author

CHECKED BY
Checker


DATE
06/07/2021


SHEET NO.
S1.0.4

SHEET OF SHEETS

C:\Users\User\Documents\RS#20132 - Class Leasing, PC 24x40 to 120x40 HS, detached_CESAR24D63.rvt

6/6/2021 1:52:34 AM


BH-36 METAL DECK PROPERTIES & PROFILE							
PLAN DESIGNATION	DECK TYPE	MINIMUM EFFECTIVE PROPERTIES				DECK PROFILE	
		S_x^+ IN ² /FT	S_y^+ IN ² /FT	I_x^+ IN ⁴ /FT	I_y^+ IN ⁴ /FT		
1-1/2"-18GA ASB BH-36 CALV DECK (36" WIDE)		0.311	0.329	0.287	0.313	<p>○ = (4) 3/8" EFFECTIVE FUSION WELDS¹ ALTERNATE: (6) #12 BOLTS (11) 1/4" - FOR ATTACHMENT @ PARALLEL SUPPORTS</p> <p>¹3/8" EFFECTIVE FUSION WELD = 1/3" VISUAL FUSION WELD</p>	

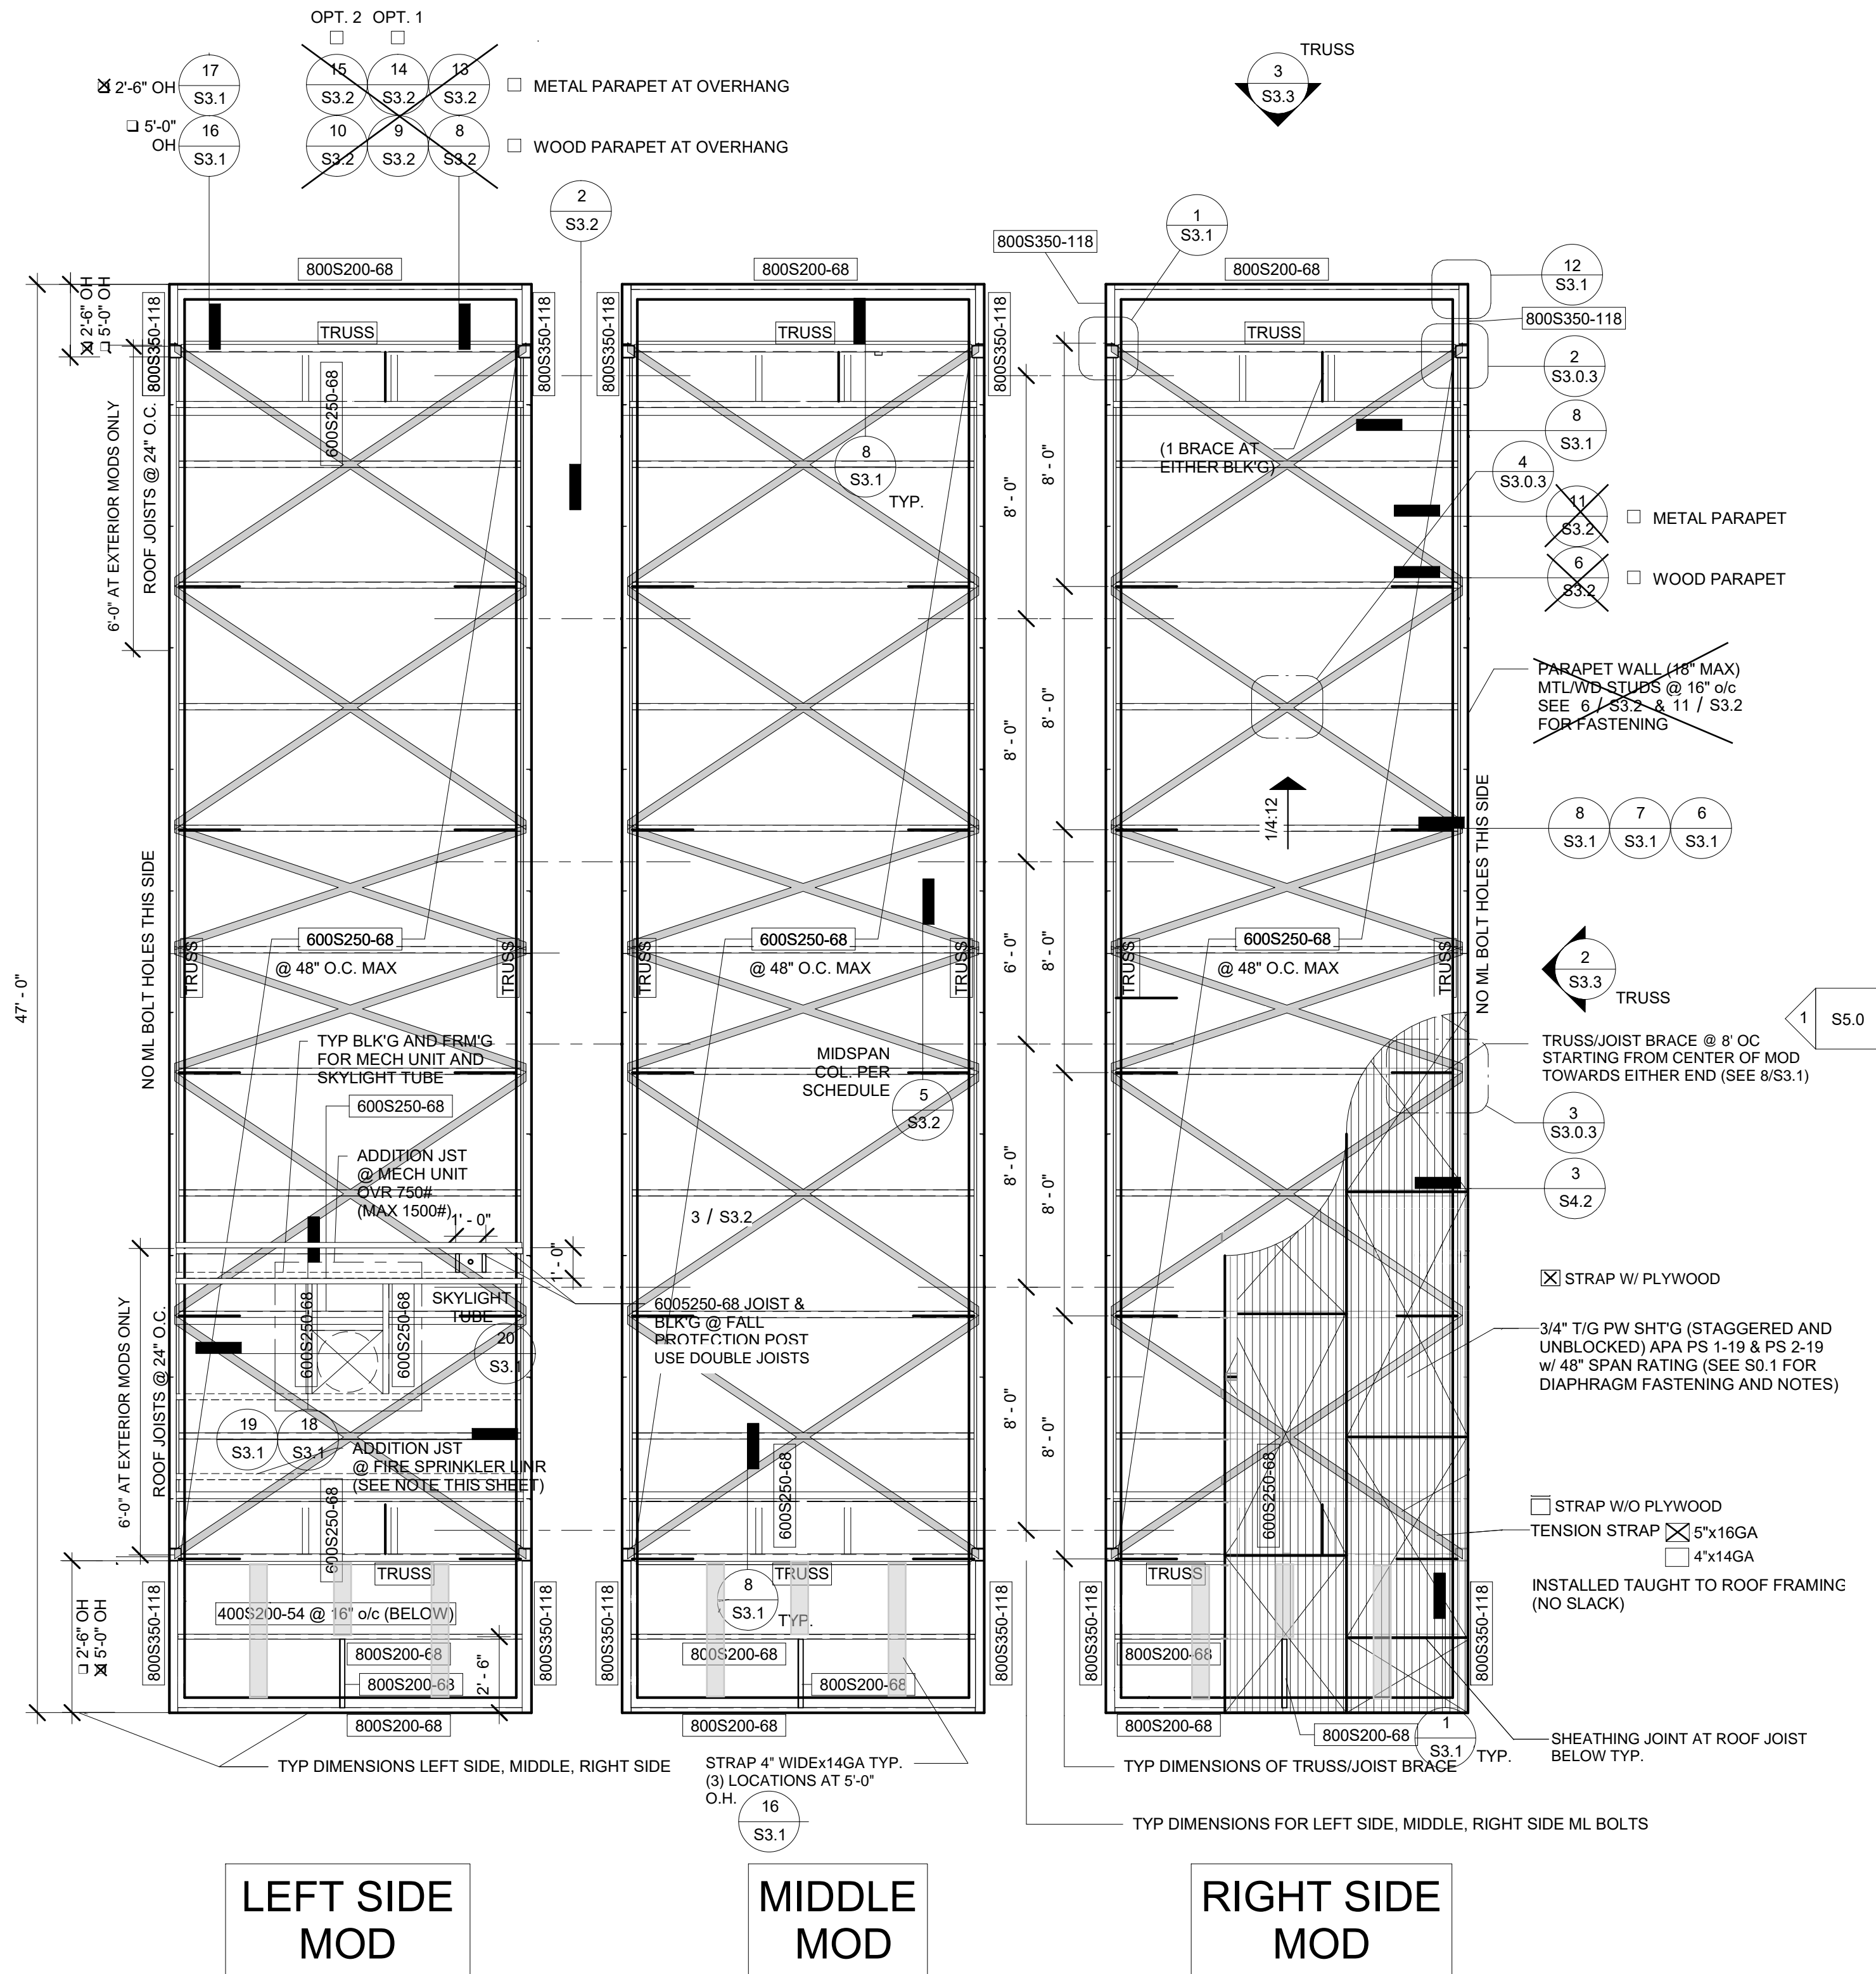


NOTES:
FIRE SPRINKLER
ADDITIONAL ROOF JOIST FOR FIRE SPRINKLER LINE AS REQ'D
LOCATION OF FIRE SPRINKLER AND ADDITIONAL JOIST TO BE DETERMINED

PV REQUIREMENTS:
1.7 REQUIRED PHOTOVOLTAIC (PV) SYSTEMS
WHEN A PV SYSTEM IS REQUIRED BY THE CALIFORNIA ENERGY CODE FOR A PC BUILDING CONFIGURATION, THE PV SYSTEM DESIGN SHALL BE IN ACCORDANCE WITH IR 16-8: SOLAR PHOTOVOLTAIC AND THERMAL SYSTEMS REVIEW AND APPROVAL REQUIREMENTS. THE PC DESIGN SHALL SHOW THAT THE STRUCTURE CAN SUPPORT THE REQUIRED SYSTEM LOADS WHEN THE BUILDING IS SUPPORTING THE PV SYSTEM. IF THE PV SYSTEM IS REQUIRED IT WILL BE SUBMITTED WITH THE SITE SPECIFIC APPLICATION.
8.3 REQUIRED PHOTOVOLTAIC (PV) SYSTEMS ENERGY REVIEW
WHEN A PV SYSTEM IS REQUIRED PER THE CALIFORNIA ENERGY CODE FOR A PC CONFIGURATION, THE SYSTEM POWER REQUIREMENTS SHALL BE CLEARLY DELINEATED ON THE PC PLANS IN THE DESIGN INFORMATION SECTION FOR THE PC. SEE SECTION 1.7 ABOVE FOR DESIGN AND SUBMITTAL REQUIREMENTS OF THE PV SYSTEM.


2 1 1/2" = 1'-0"
ROOF BRACING STRAP @ ENDWALL

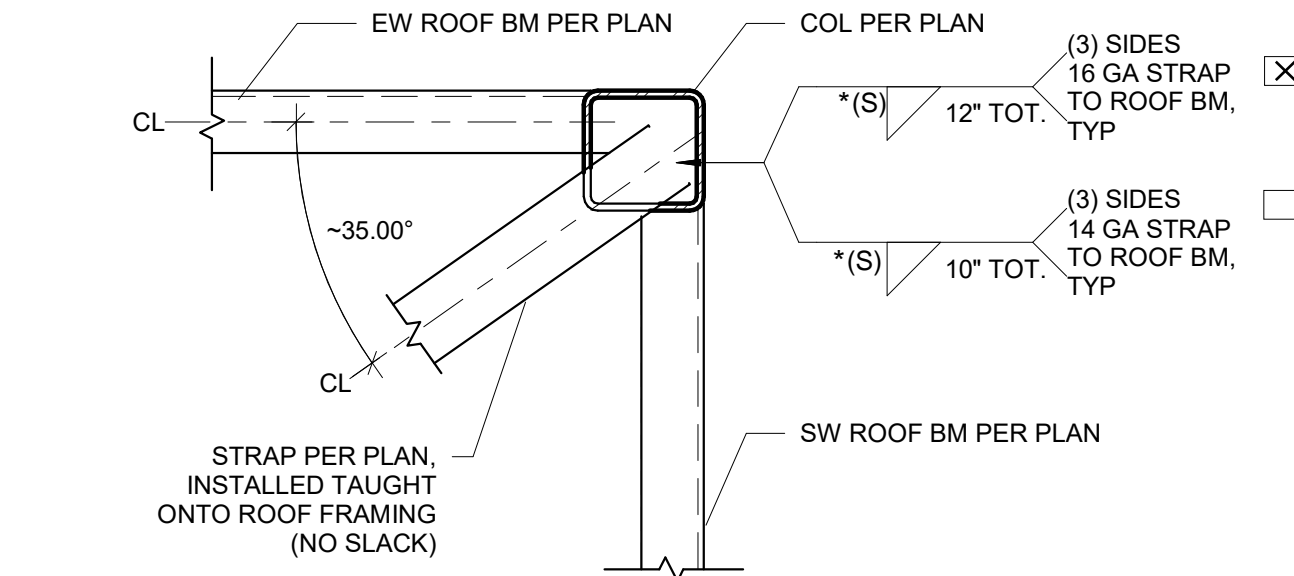


3 1 1/2" = 1'-0"
ROOF STRAP BRACING @ SIDEWALL

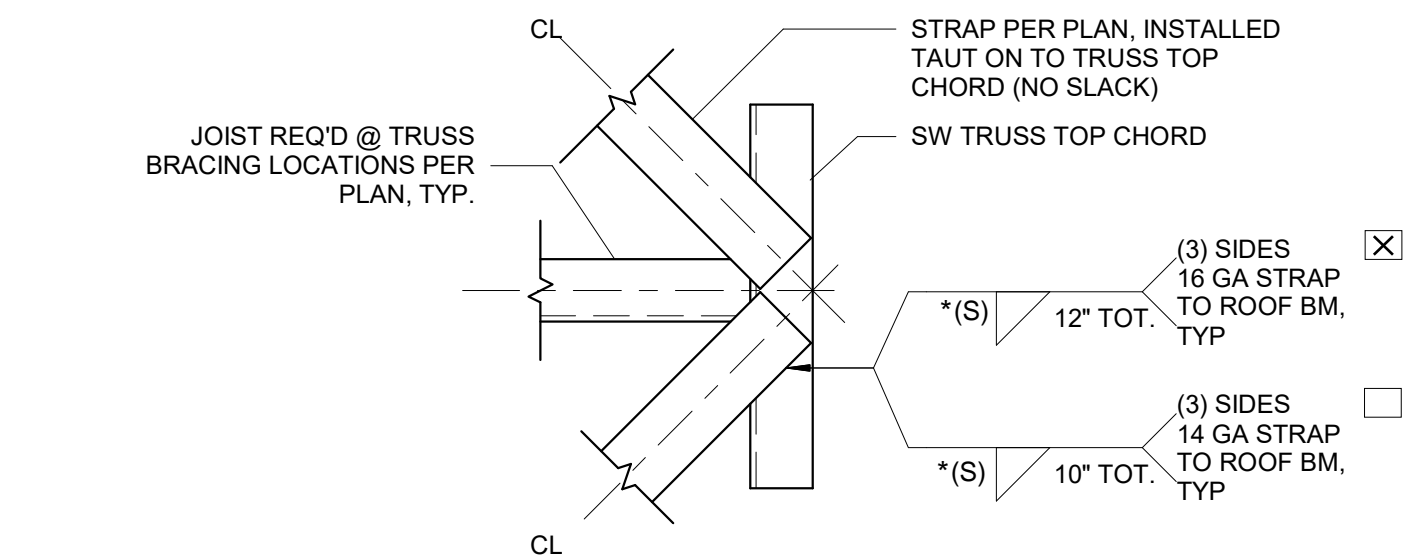

4 3" = 1'-0"
STRAP TO JOIST CONNECTION (ROOF)

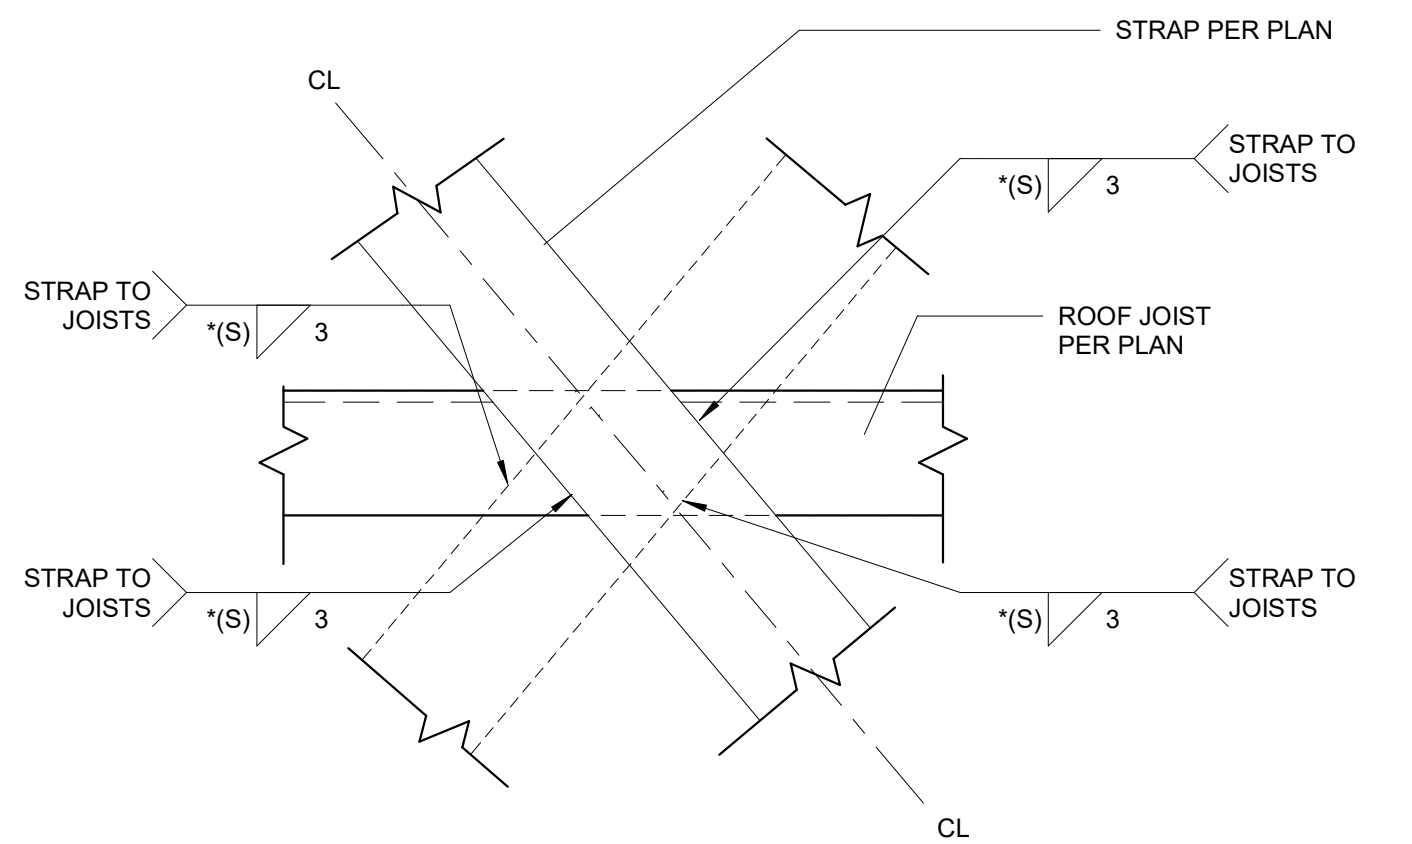

5 1 1/2" = 1'-0"
STRAP SPLICE DETAIL (ROOF)

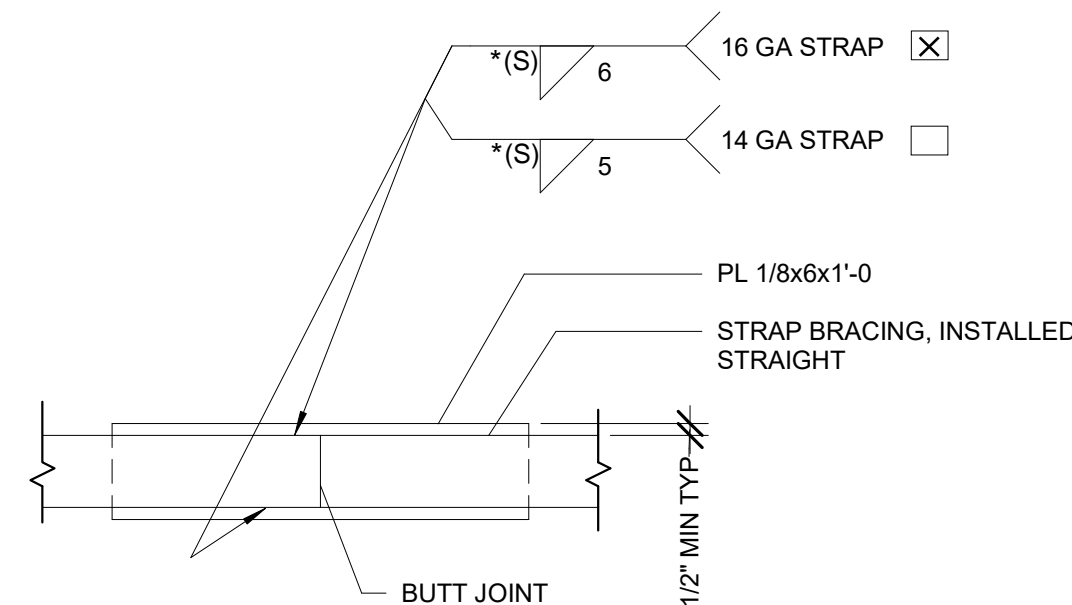

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-12-2020 INC.
REVIEWED FOR
SS [X] PLS [X] ACS [X]
DATE: 10/25/2024

R&S TAVARES ASSOCIATES
DESIGN & CONSULTING PROJECT MEET
11590 W BERNARDO COURT, SUITE 100
SAN DIEGO, CA 92127
WWW.RSTAVARES.COM

PROFESSIONAL STAMP

REGISTERED PROFESSIONAL ARCHITECT
MANNY D. FRIEDMAN
63380
03/31/24
PCTURIA
STATE OF CALIFORNIA
02/16/24
RST#22088

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT

Class Leasing
1651 Juanita Street, San Jacinto, CA 92583
Voice (951) 943-1908 Fax (951) 943-5768

ORIGINAL PC STATE AGENCY APPROVAL

APPROVED
DIV. OF THE STATE ARCHITECT
APP. 04-12-2024 PC
REVIEWED FOR
SS [X] PLS [X] ACS [X] CG [X]
DATE: 02/20/2024

Revision Schedule
Description Date

PRE-CHECK (PC) ALTERNATE DOCUMENT
CODE: 2019 CBC
A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC:24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE
MONO SLOPE
ROOF FRM'G PLAN
CROSS-STRAP
OPT.













PROJECT NUMBER
22088

DRAWN BY
MJM

CHECKED BY
RH/rMc

DATE
06/07/2021

SHEET NO.
S3.0.3
SHEET OF

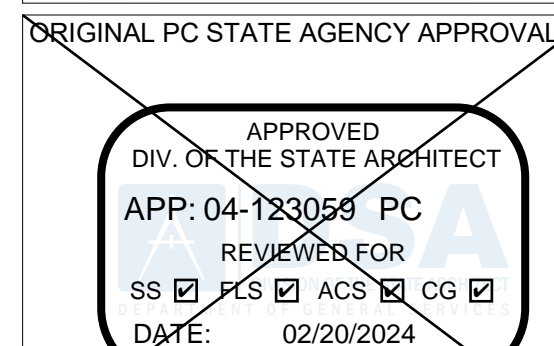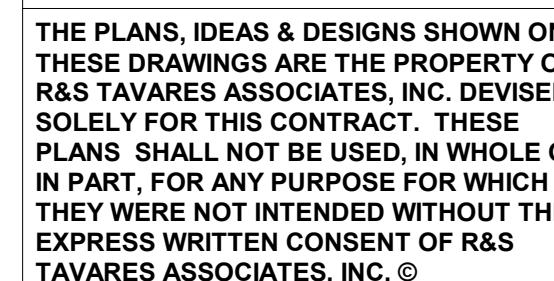

Revision Schedule		
#	Description	Date

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required.

PROJECT TITLE
PC 2022 CBC:24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE

STRUCTURAL
DETAILS
(ROOF)

PROJECT NUMBER	00000
----------------	-------

DRAWN BY
rMc/SC

CHECKED BY JA/RT

DATE _____

SHEET NO. 001




S3.1

SHEET OF

9/22/2022 11:10:42 AM
LA/2022/22088 - Class Leasing, 24x40 to 120x40 High Seismic 2022 PC/REV/22088- 2022.09 updated S3.3 with truss cross-section detail and call outs- source 20093.rvt





TABLE A-SECTION CENTROID	
SECTION	CENTROID C
L4X3 (LLV)	1 1/4"
L4X3 (LLH)	3/4"
L2X2X3/16	9/16"
L1.5X1.5X3/16	7/16"

NOTE: SEE DETAIL 8 / S3.3

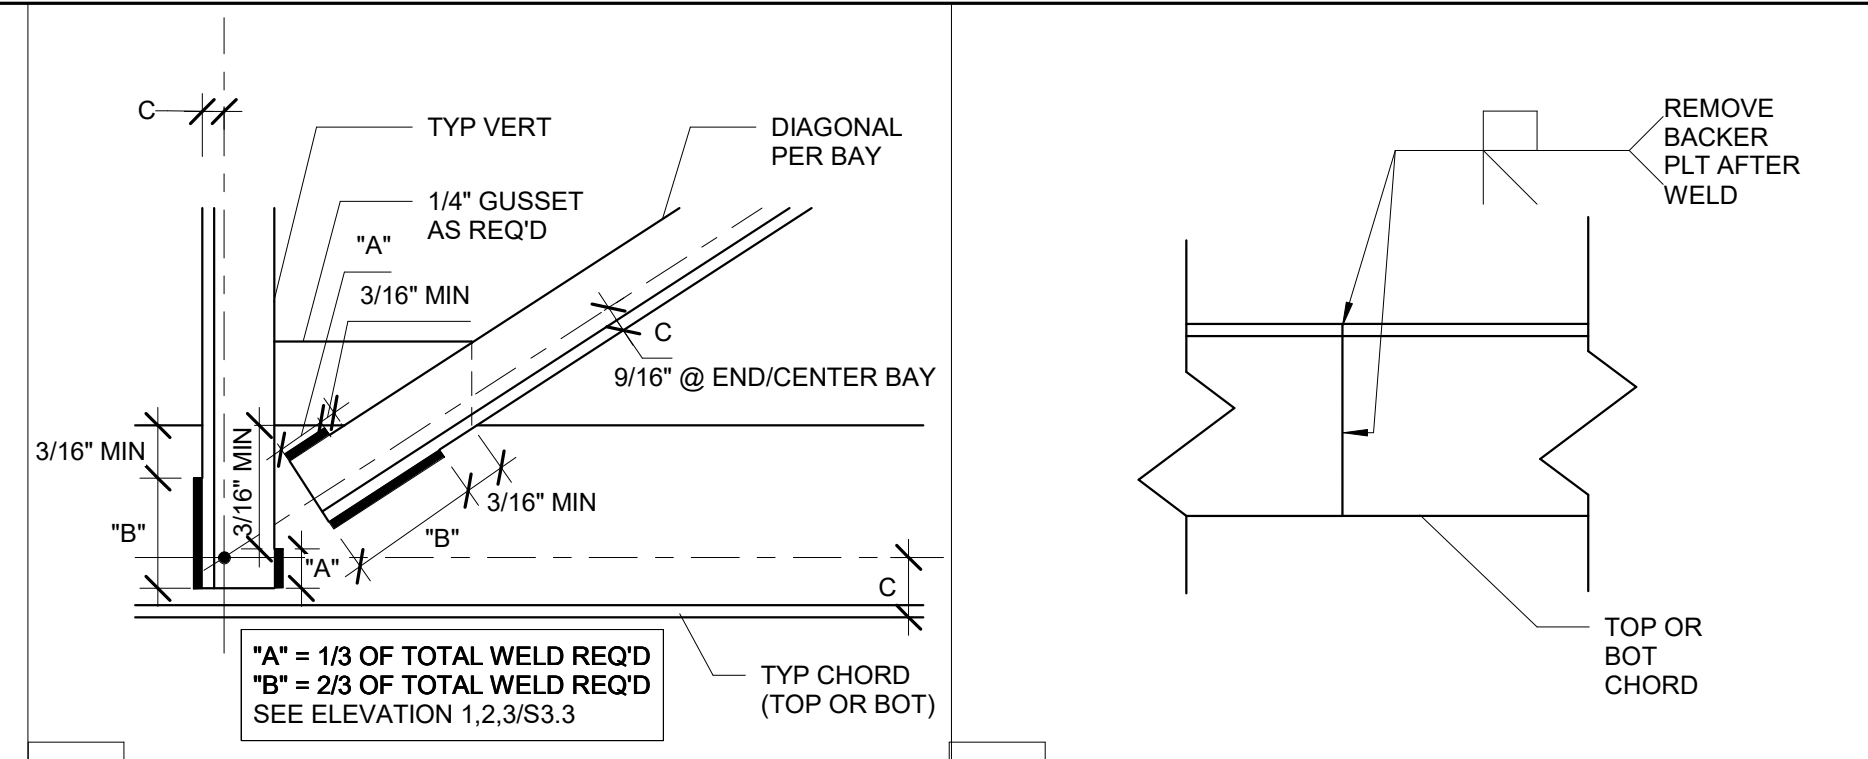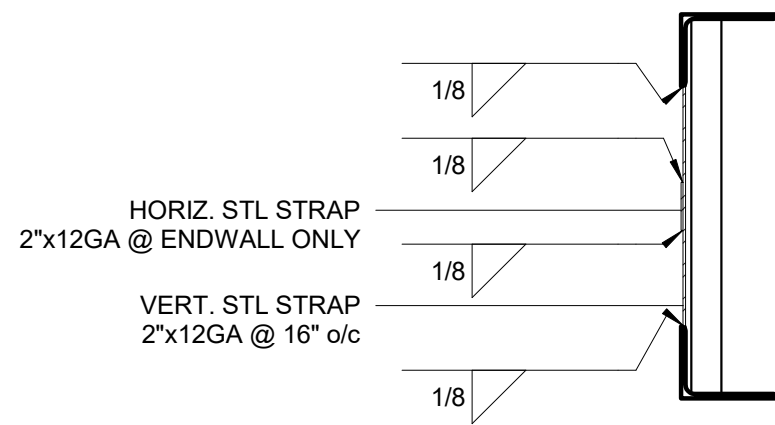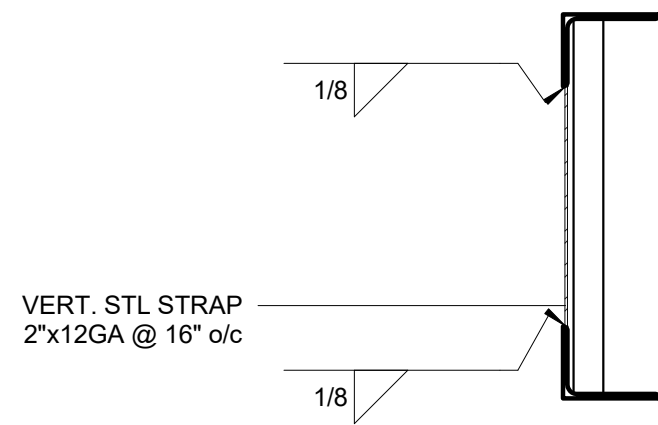


8 3" = 1'-0" Typ Fillet Weld Lengths

9 3" = 1'-0" Typ Truss Chord Splice

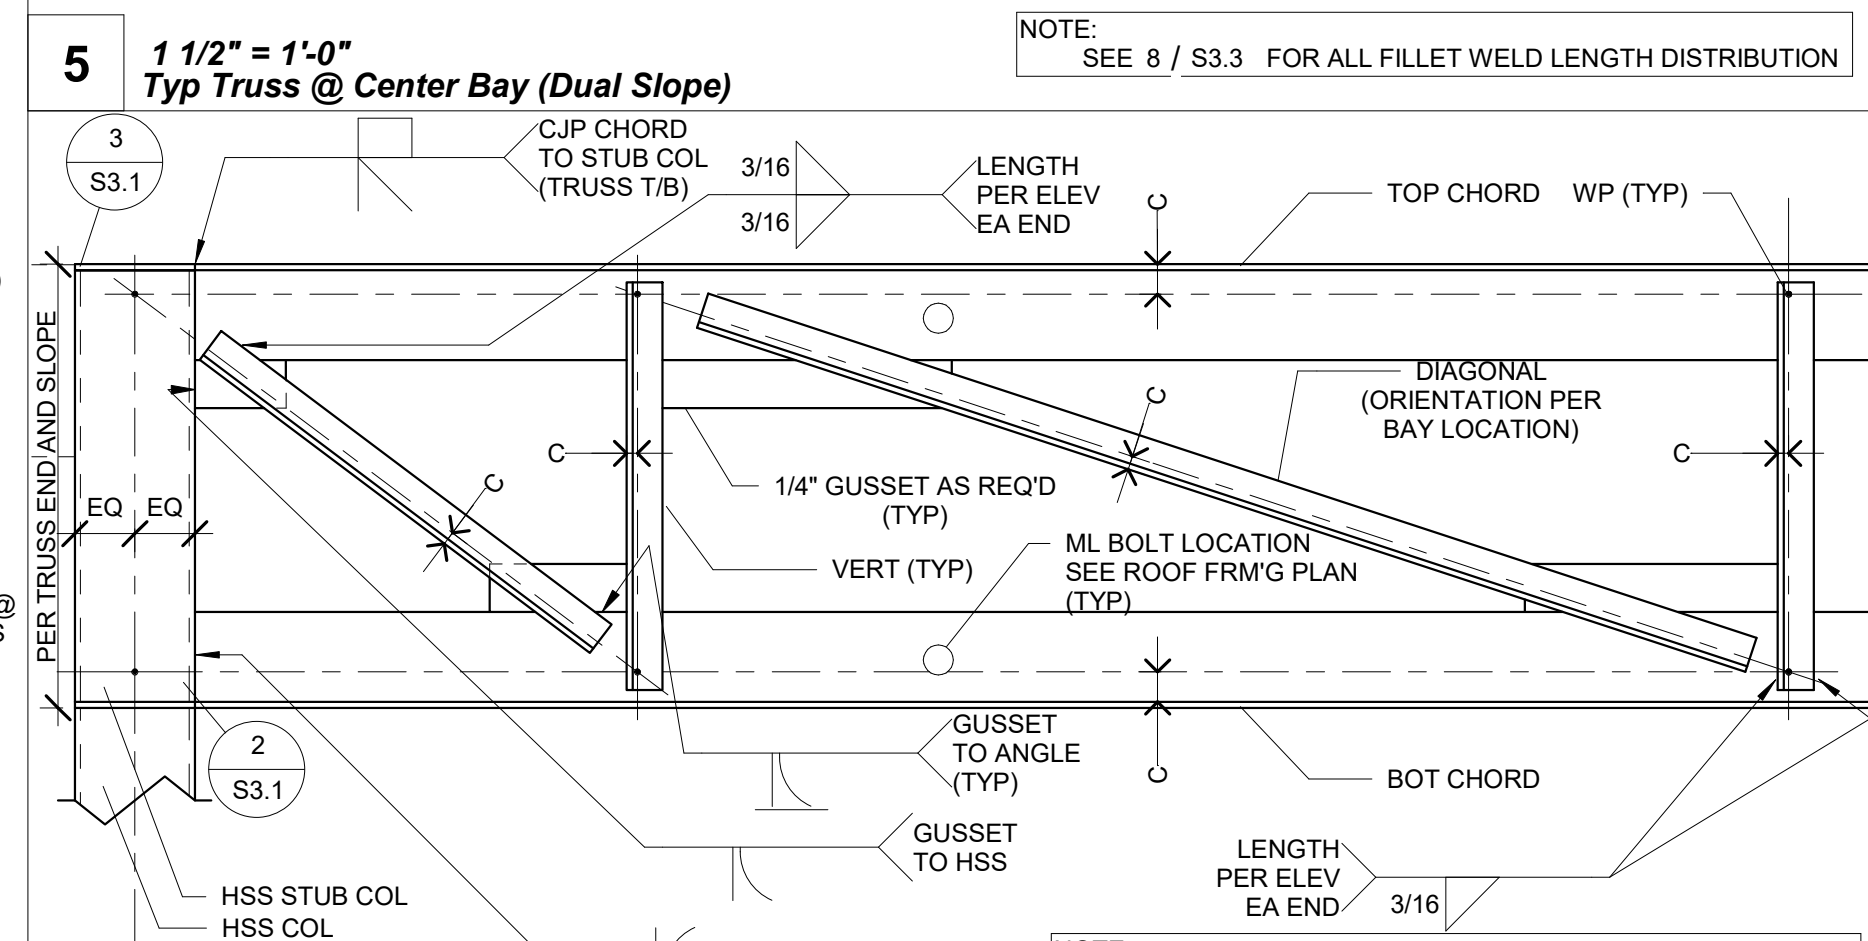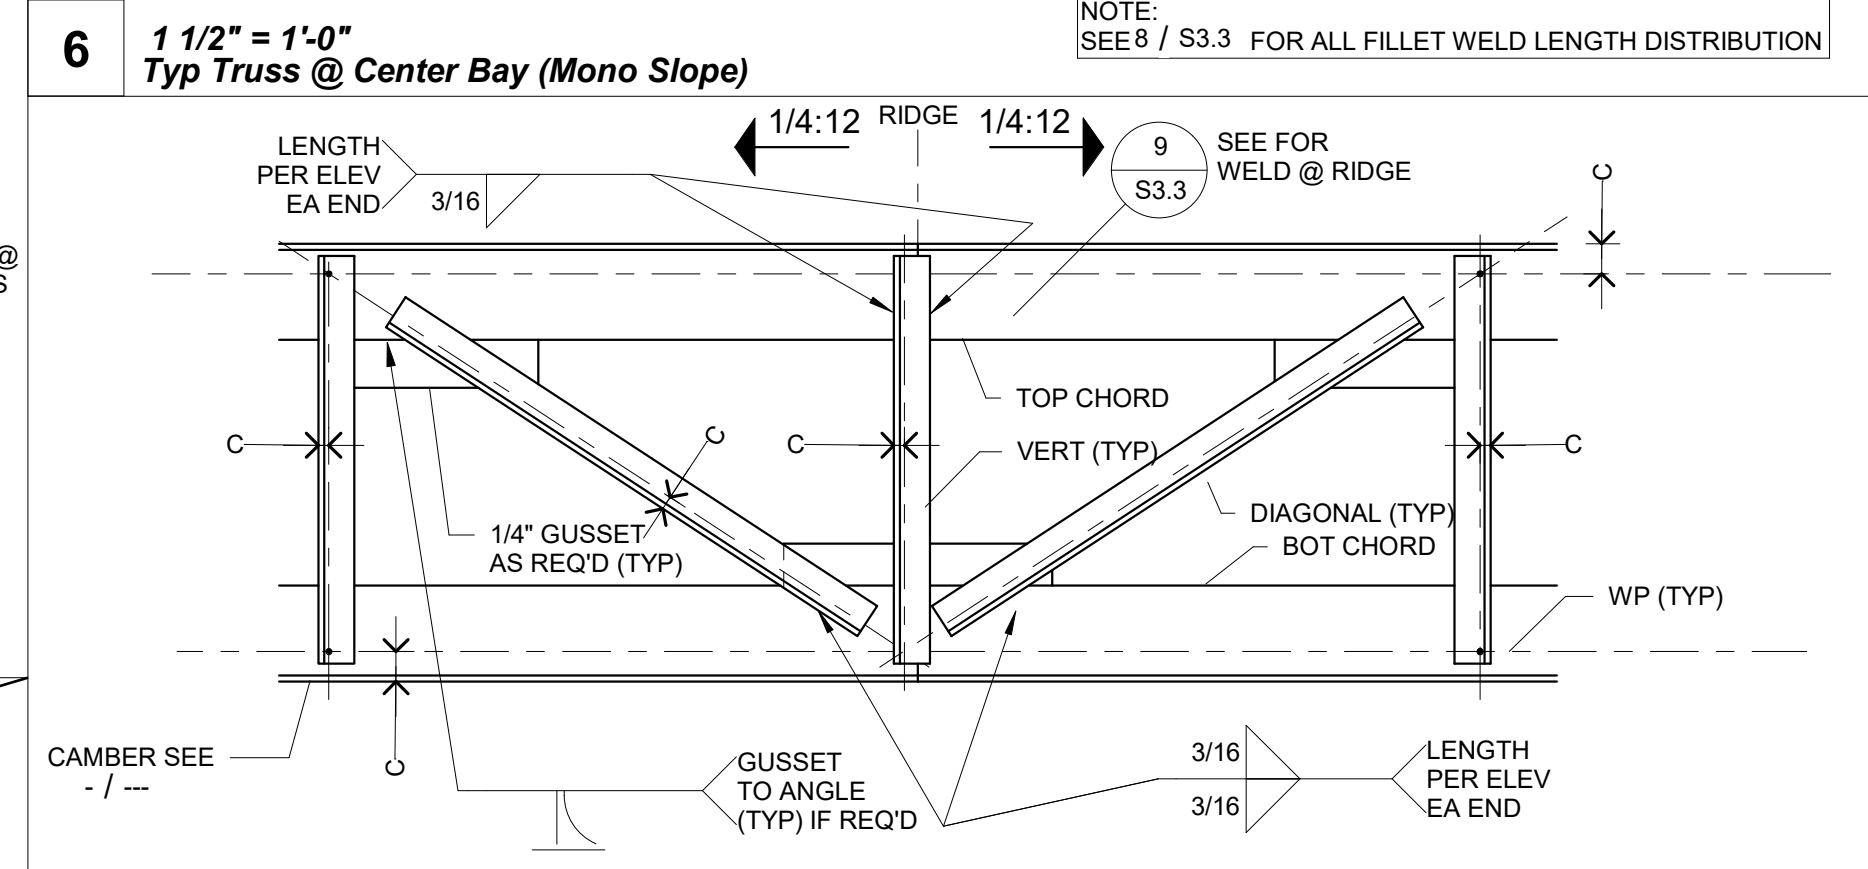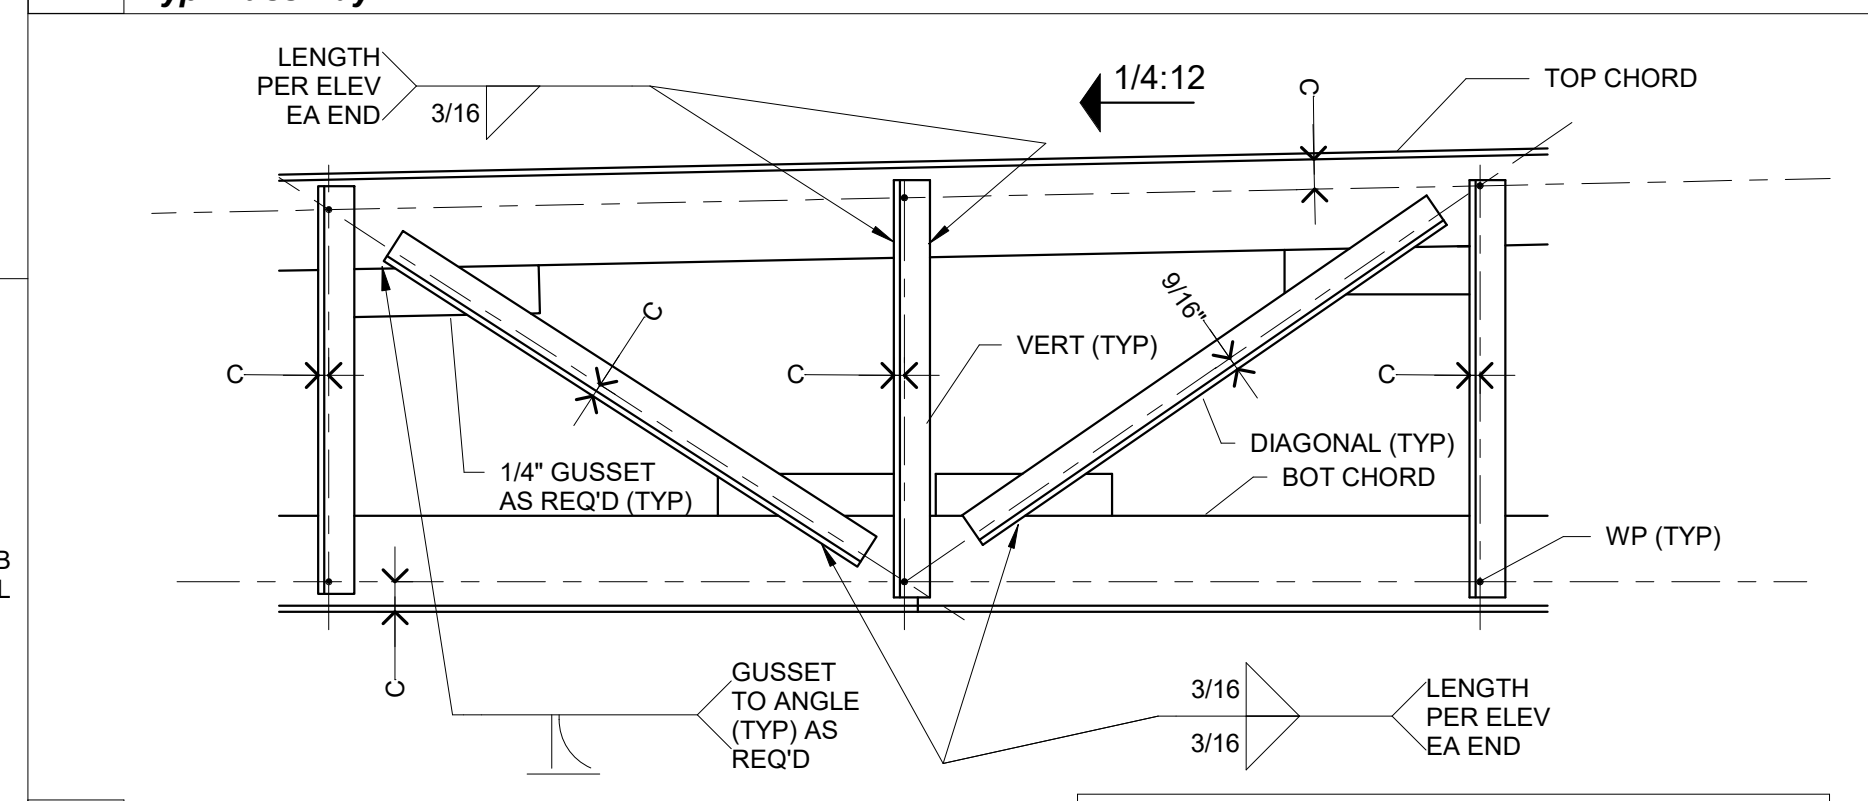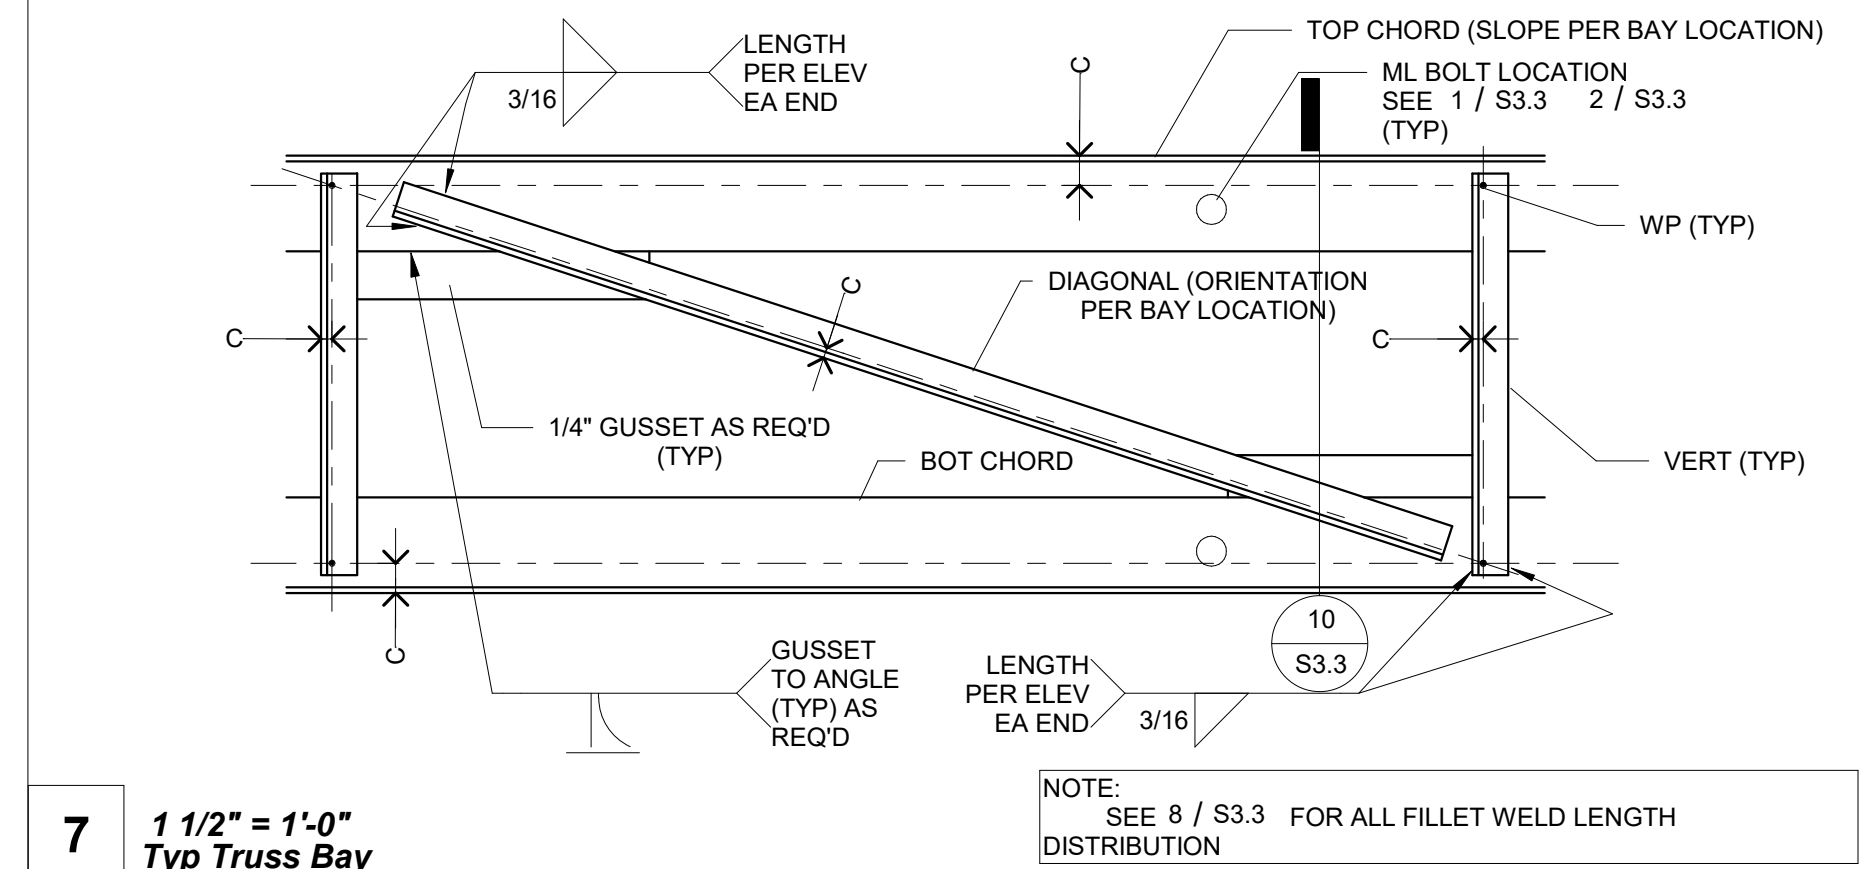


4 1 1/2" = 1'-0" Typ End Bay to Stub Conn


12 1/2" = 1'-0" TABLE A - SECTION CENTROID

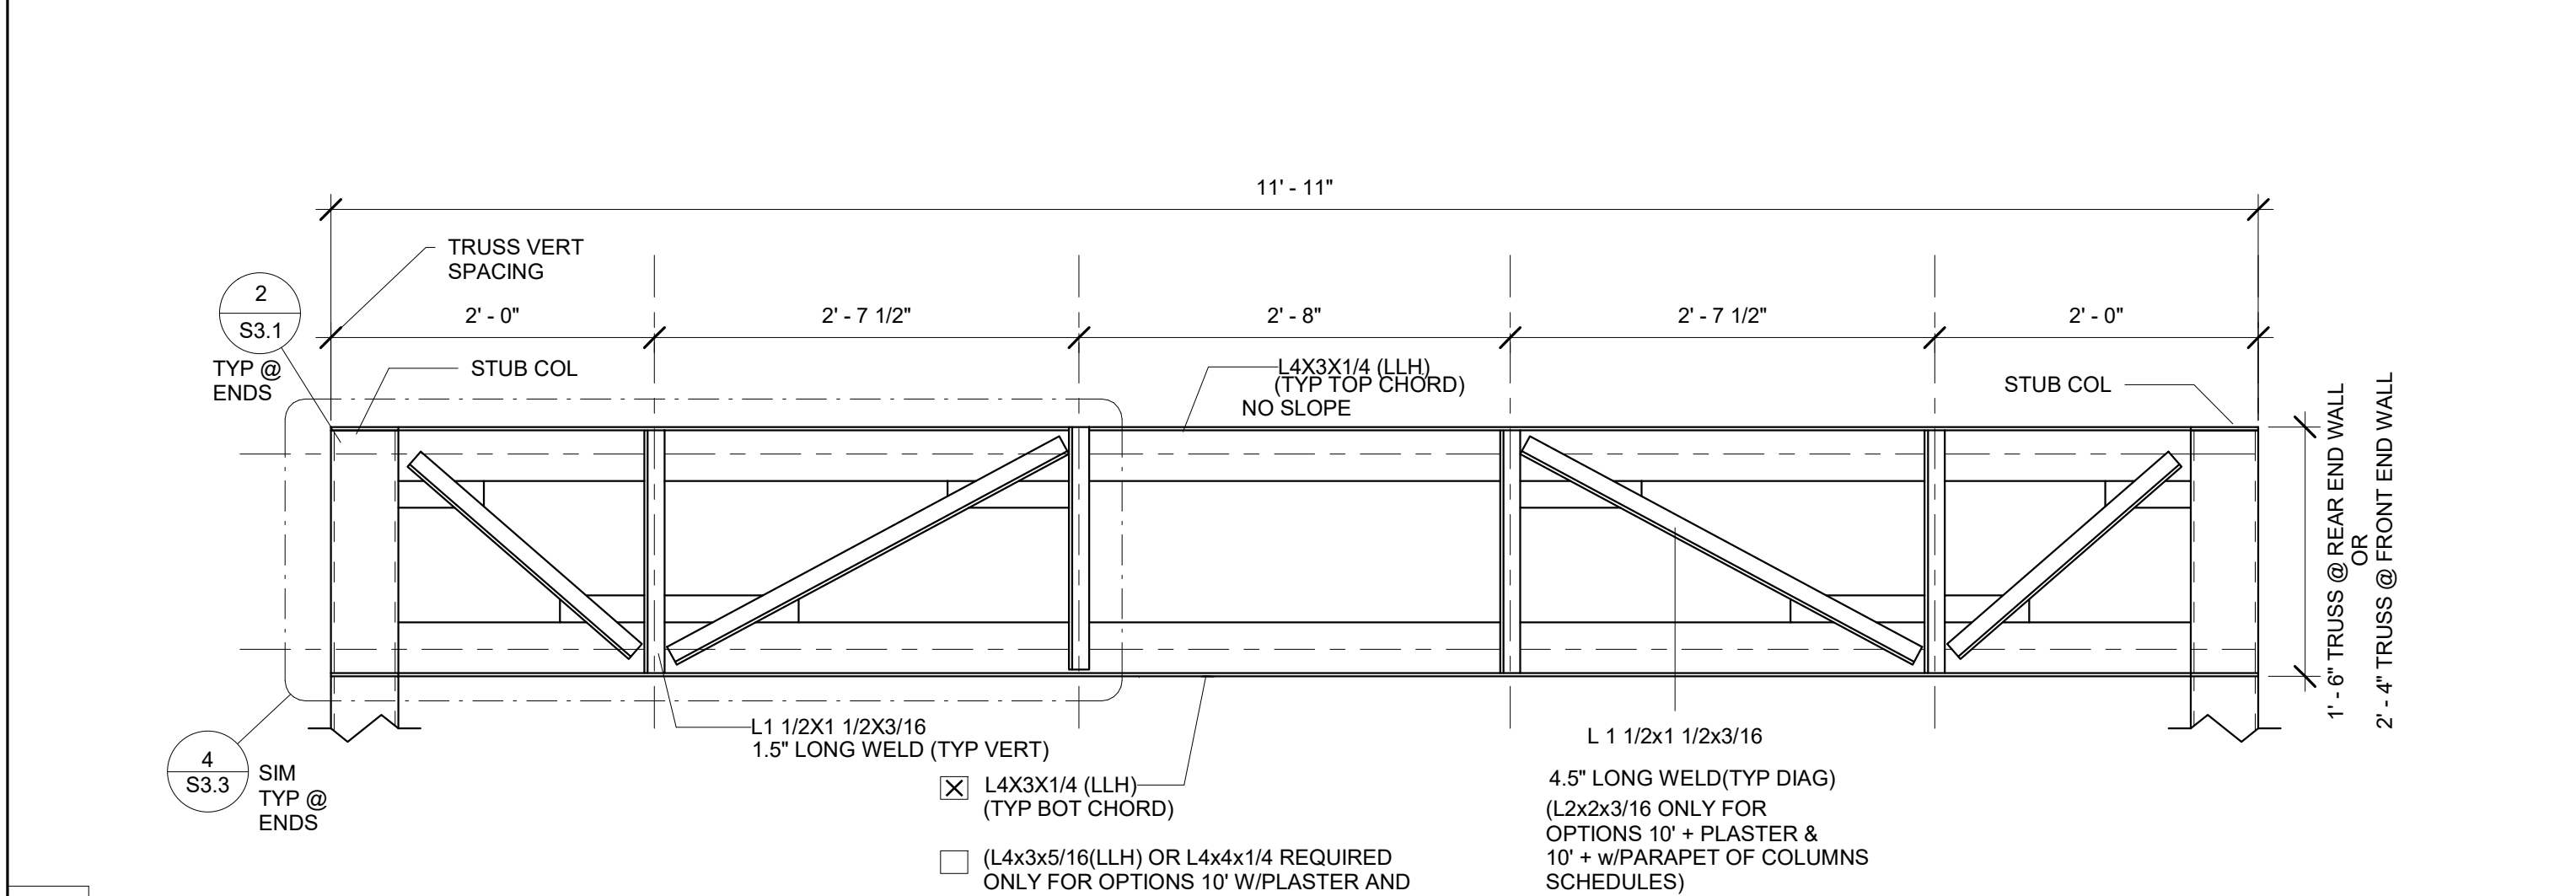


3 1" = 1'-0" End Wall Truss

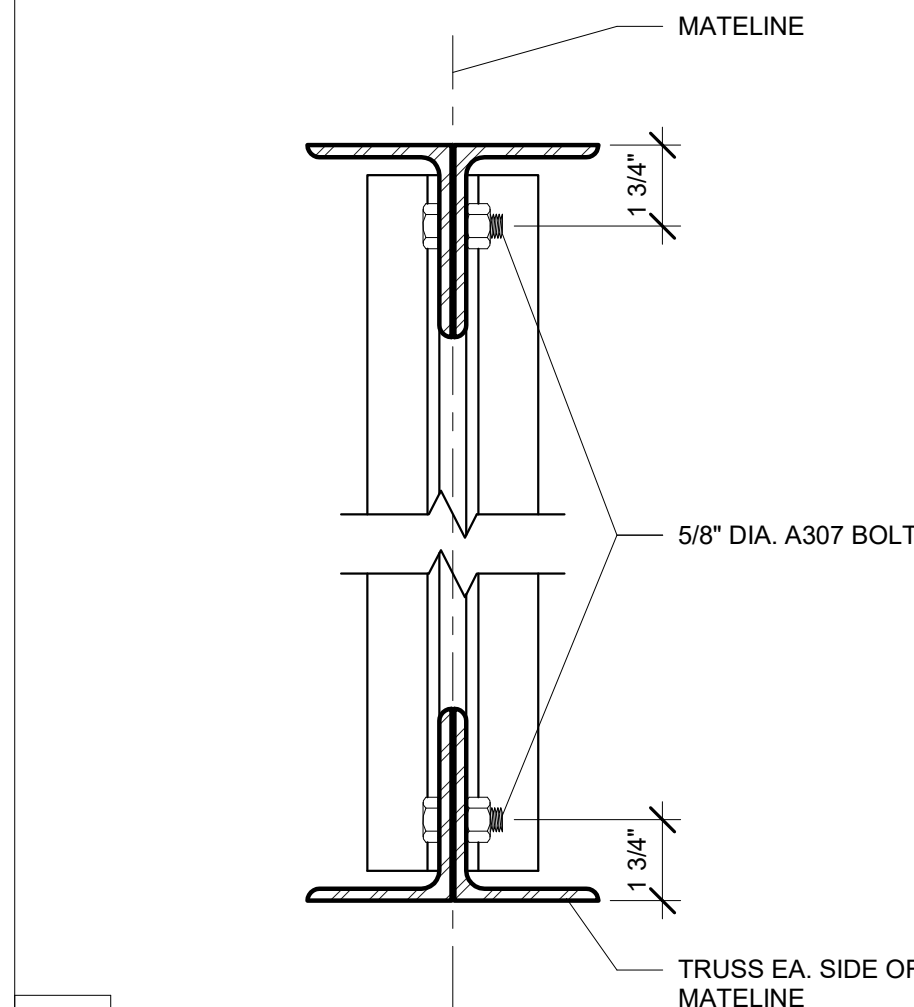




10 3" = 1'-0" TRUSS CONN. @ MATELINE

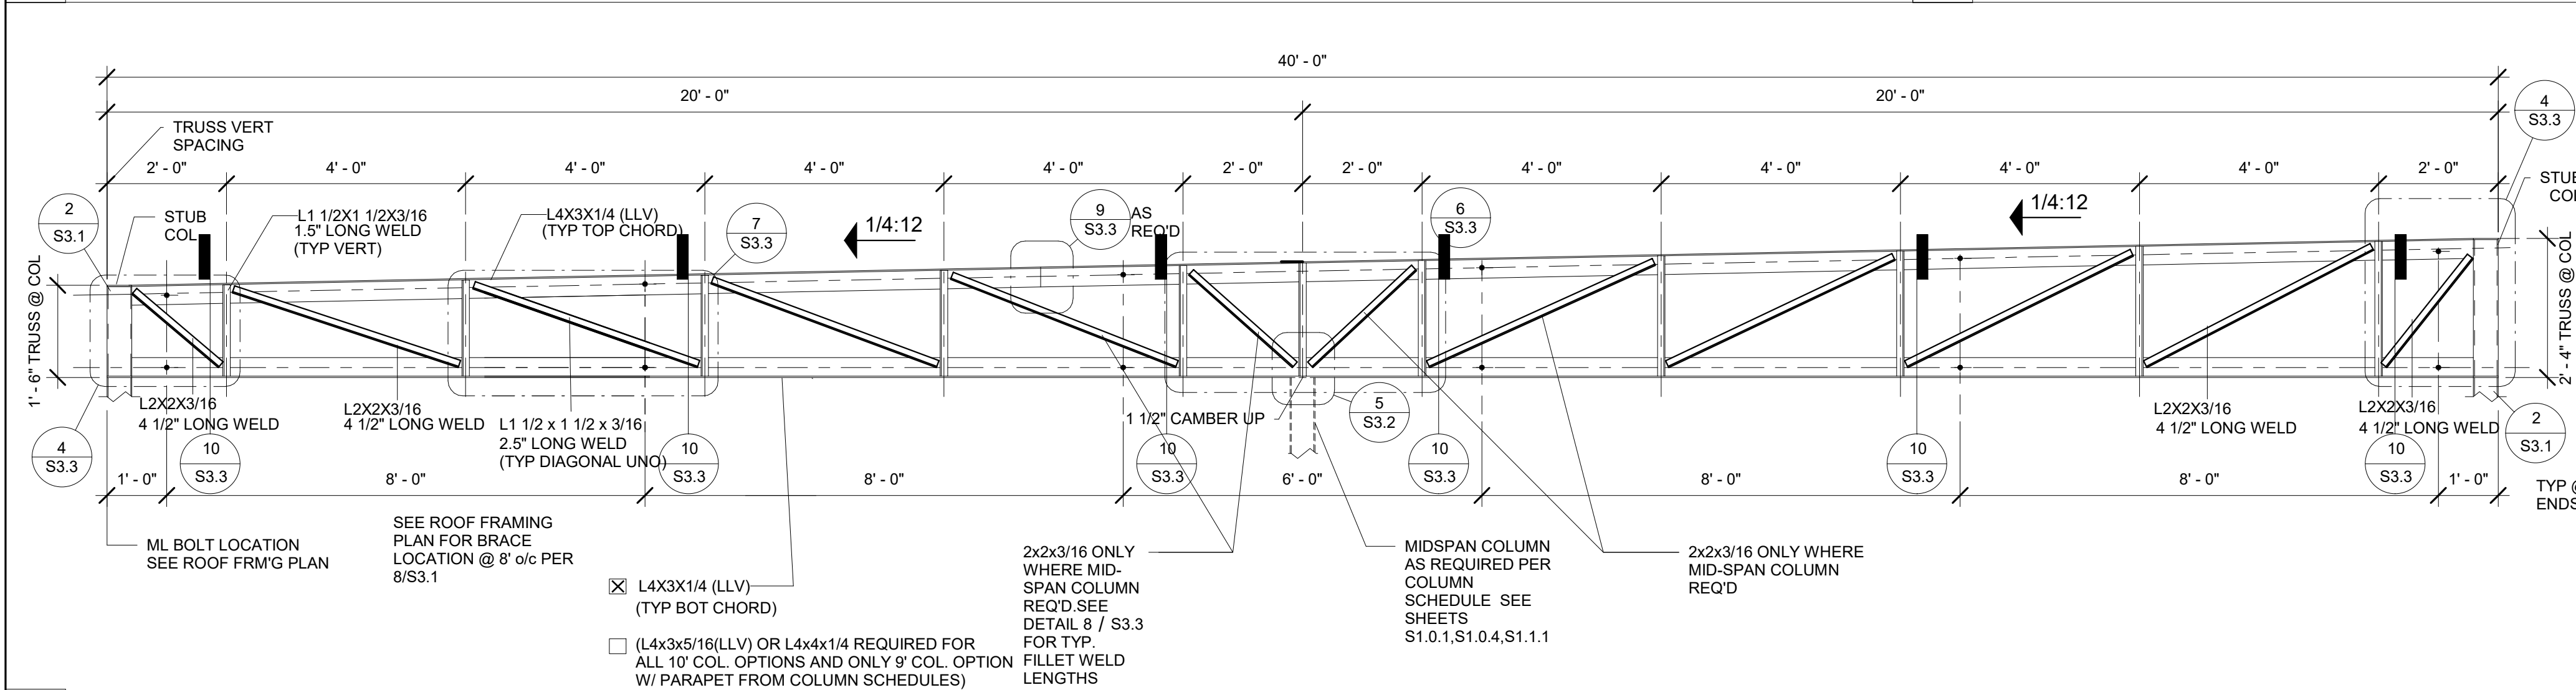



2 1/2" = 1'-0" Mono Truss

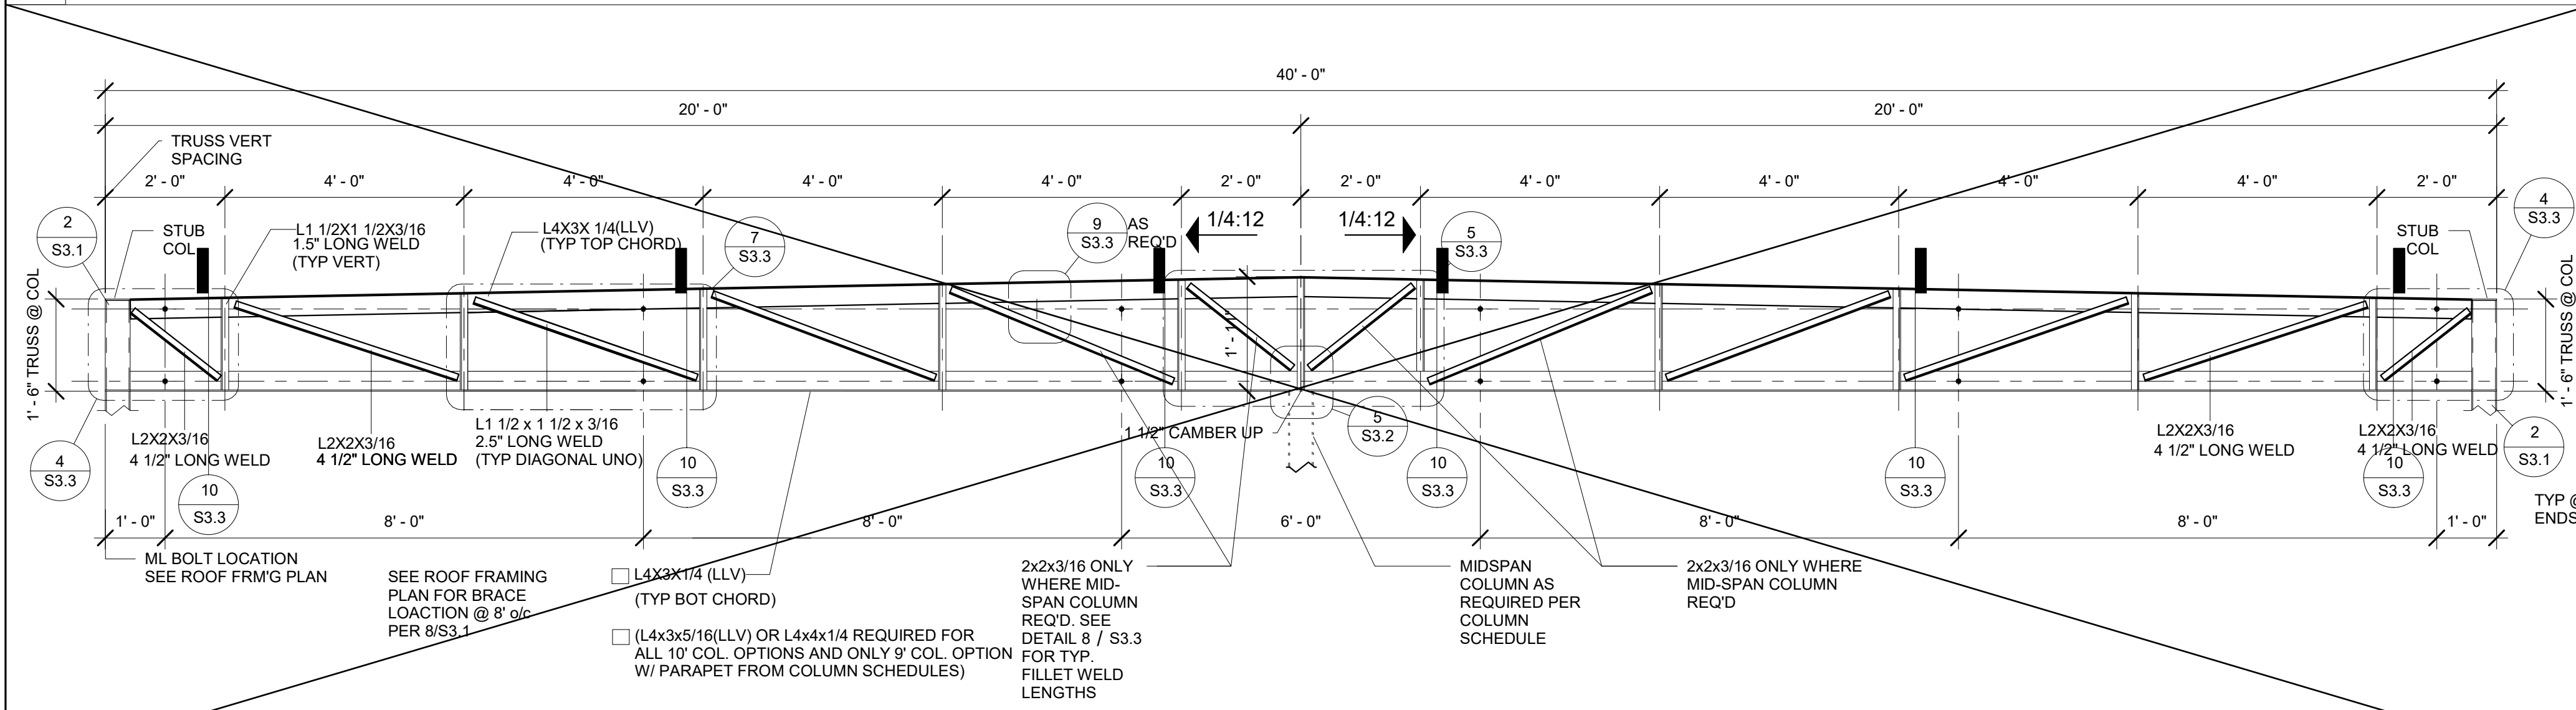

1 1/2" = 1'-0" Dual Truss

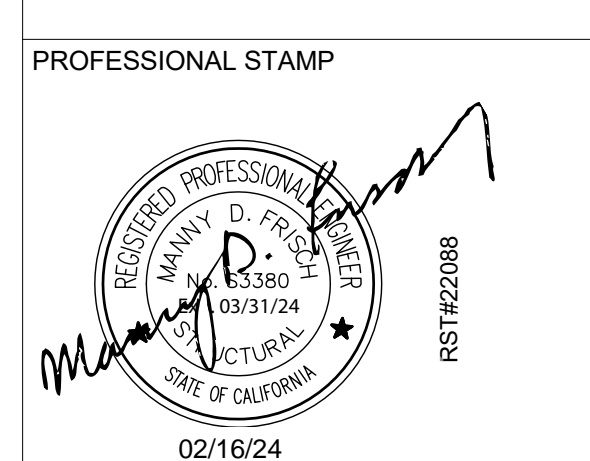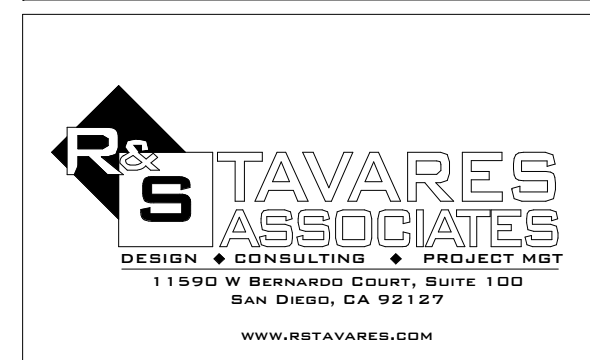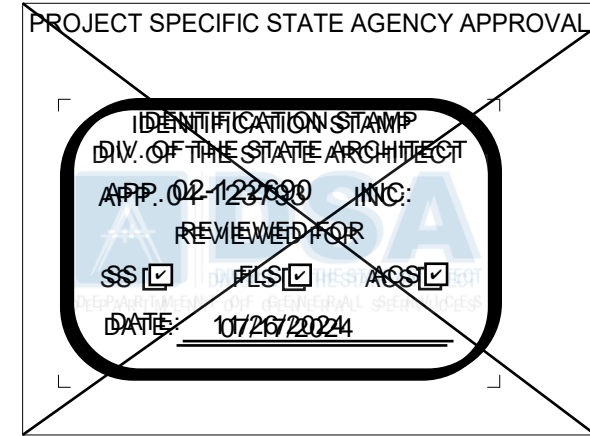

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

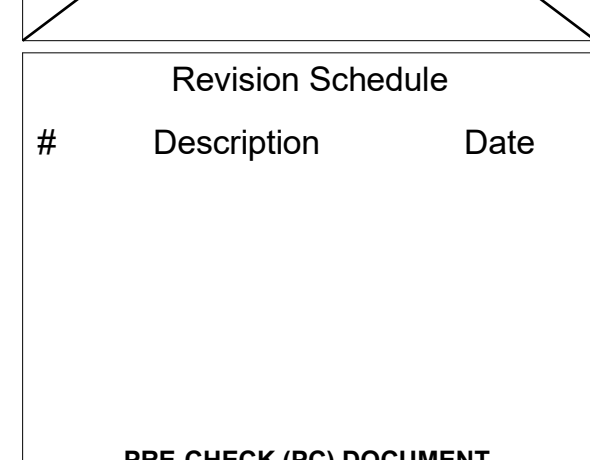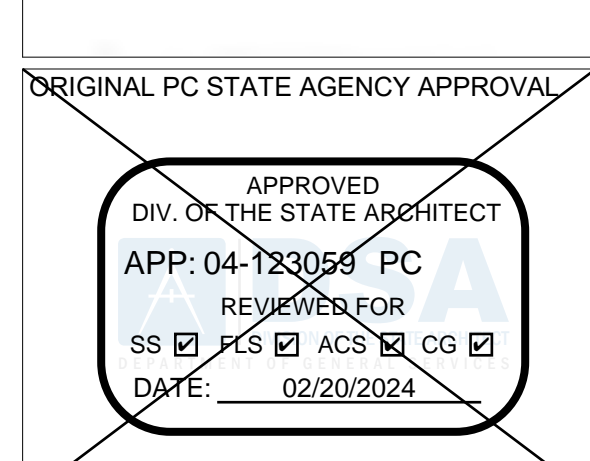

Revision Schedule

#	Description	Date
1	PRE-CHECK (PC) DOCUMENT	02/20/2024
2	CODE: 2022 CBC	02/20/2024
3	A separate project application for construction is required	02/20/2024
4	PROJECT TITLE	02/20/2024
5	PC 2022 CBC: 24' x 40' EXPANDABLE TO 120' x 40'	02/20/2024

SHEET TITLE

ROOF PERIMETER TRUSS

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY

RH/RT










DATE

SHEET NO.


S3.3

SHEET OF

6/6/2021 1:52:57 AM C:\Users\User\Documents\RS#20132 - Class Leasing, PC 24x40 to 120x40 HS, detached, CESAR24D33.rvt

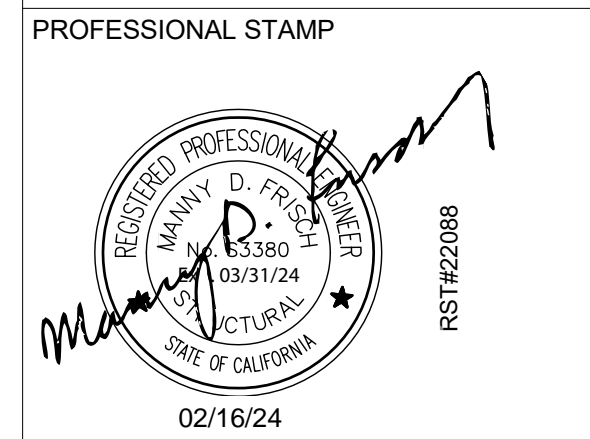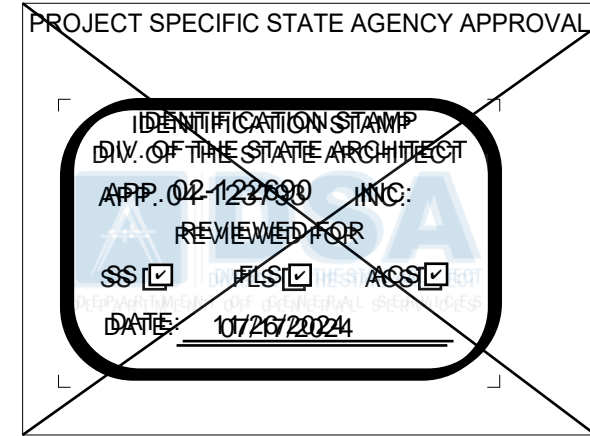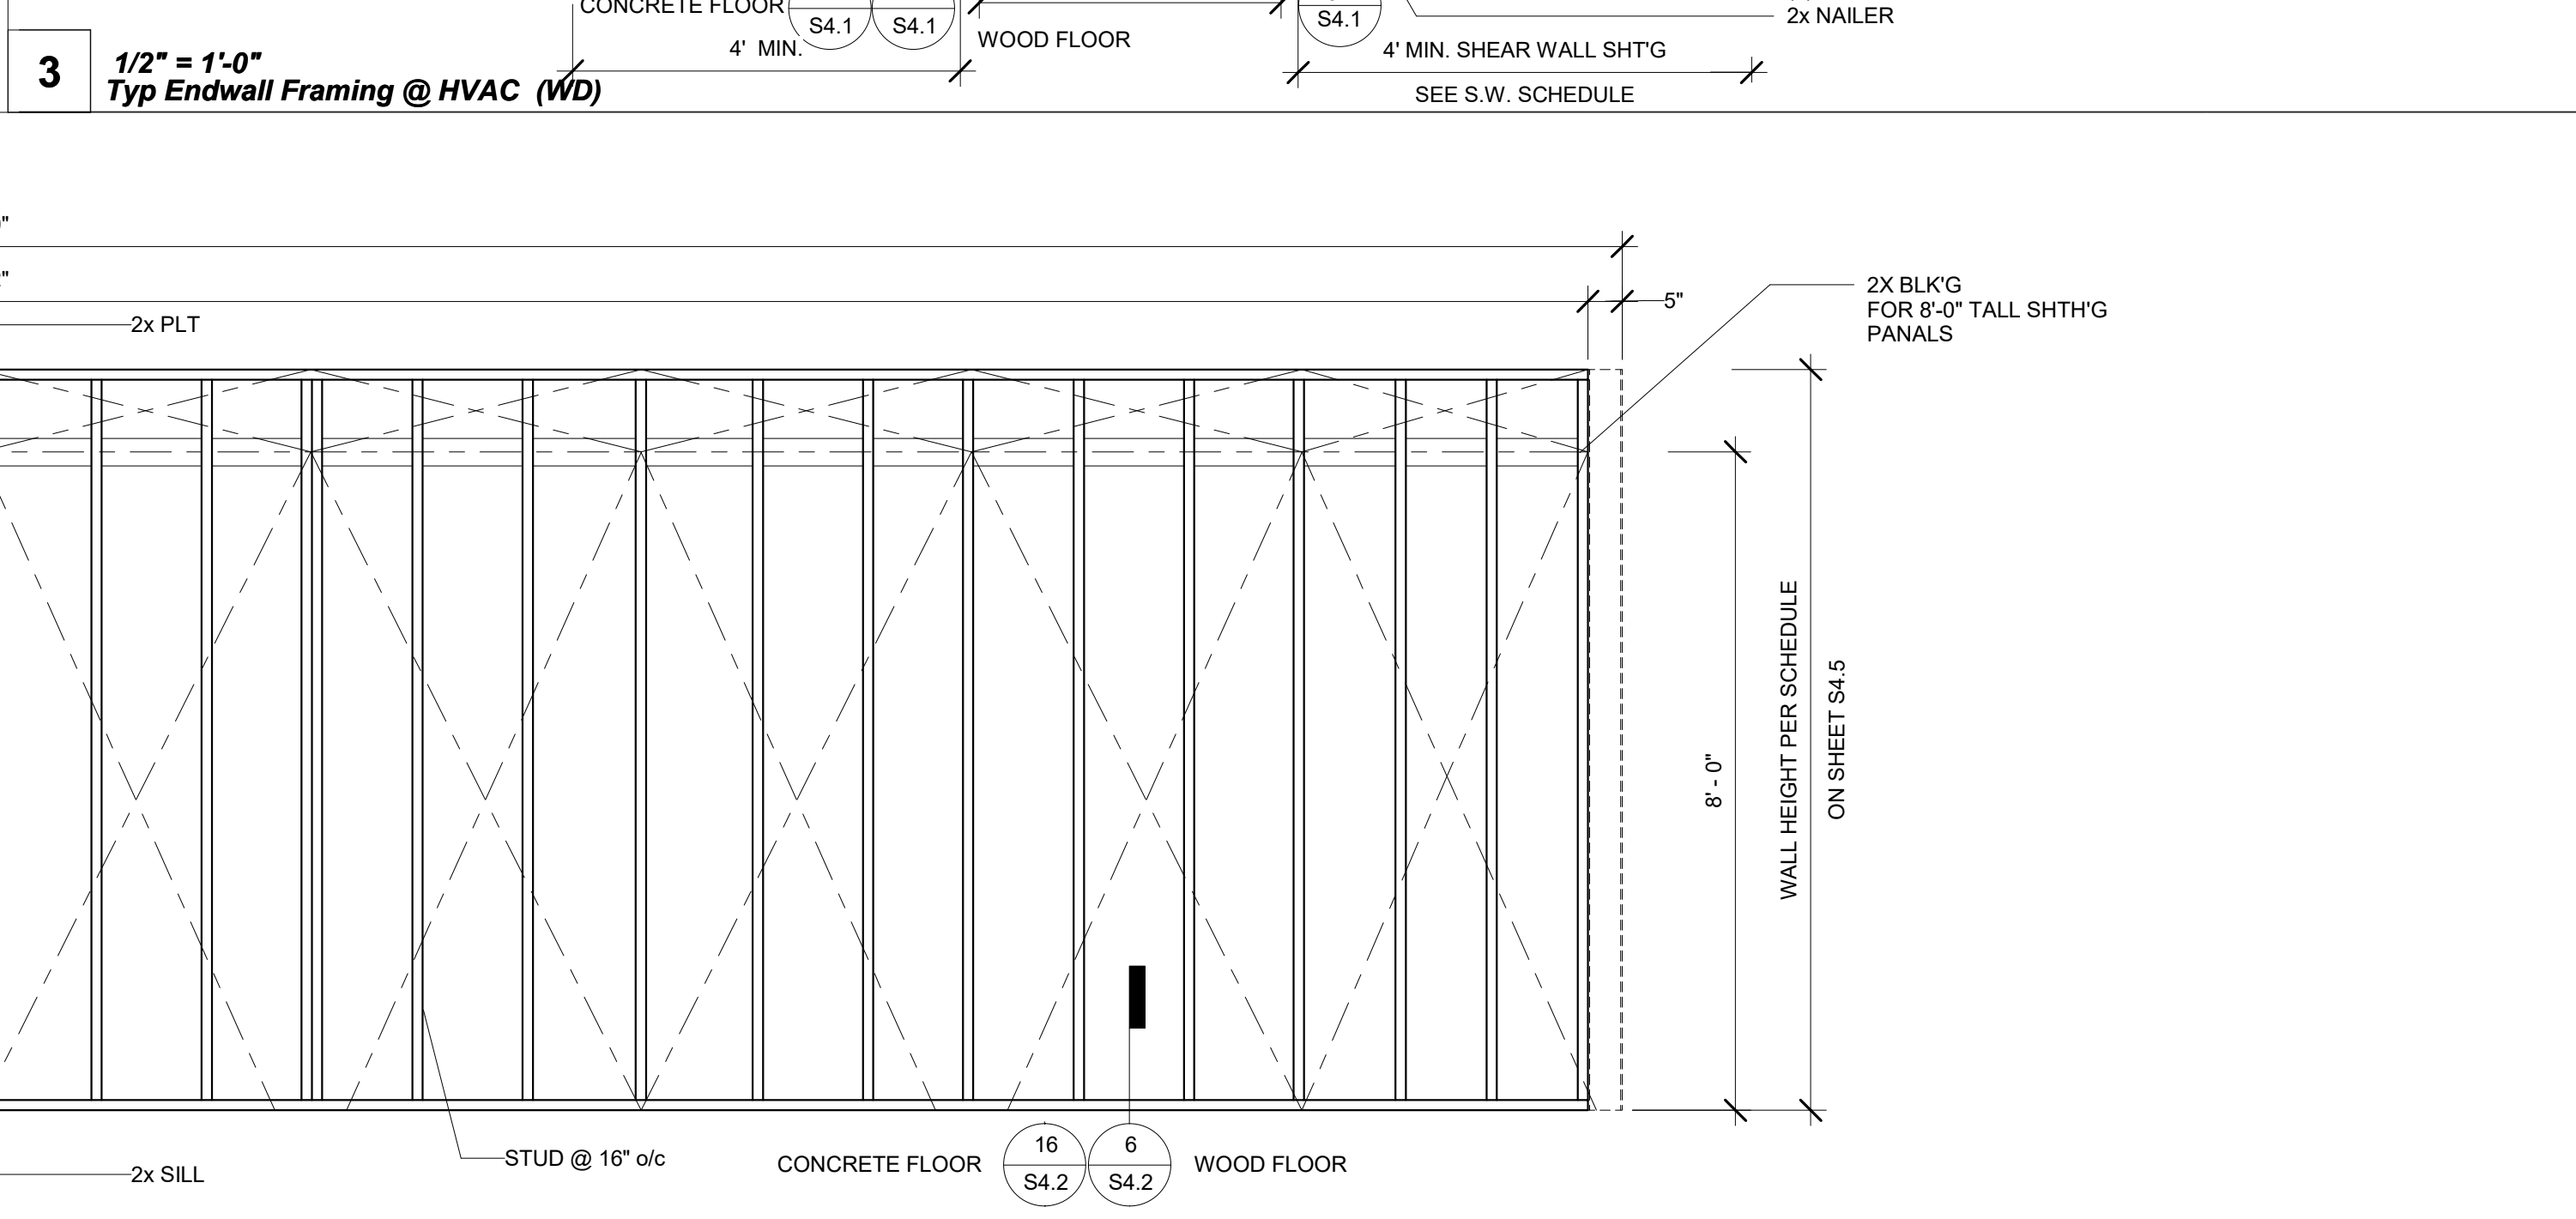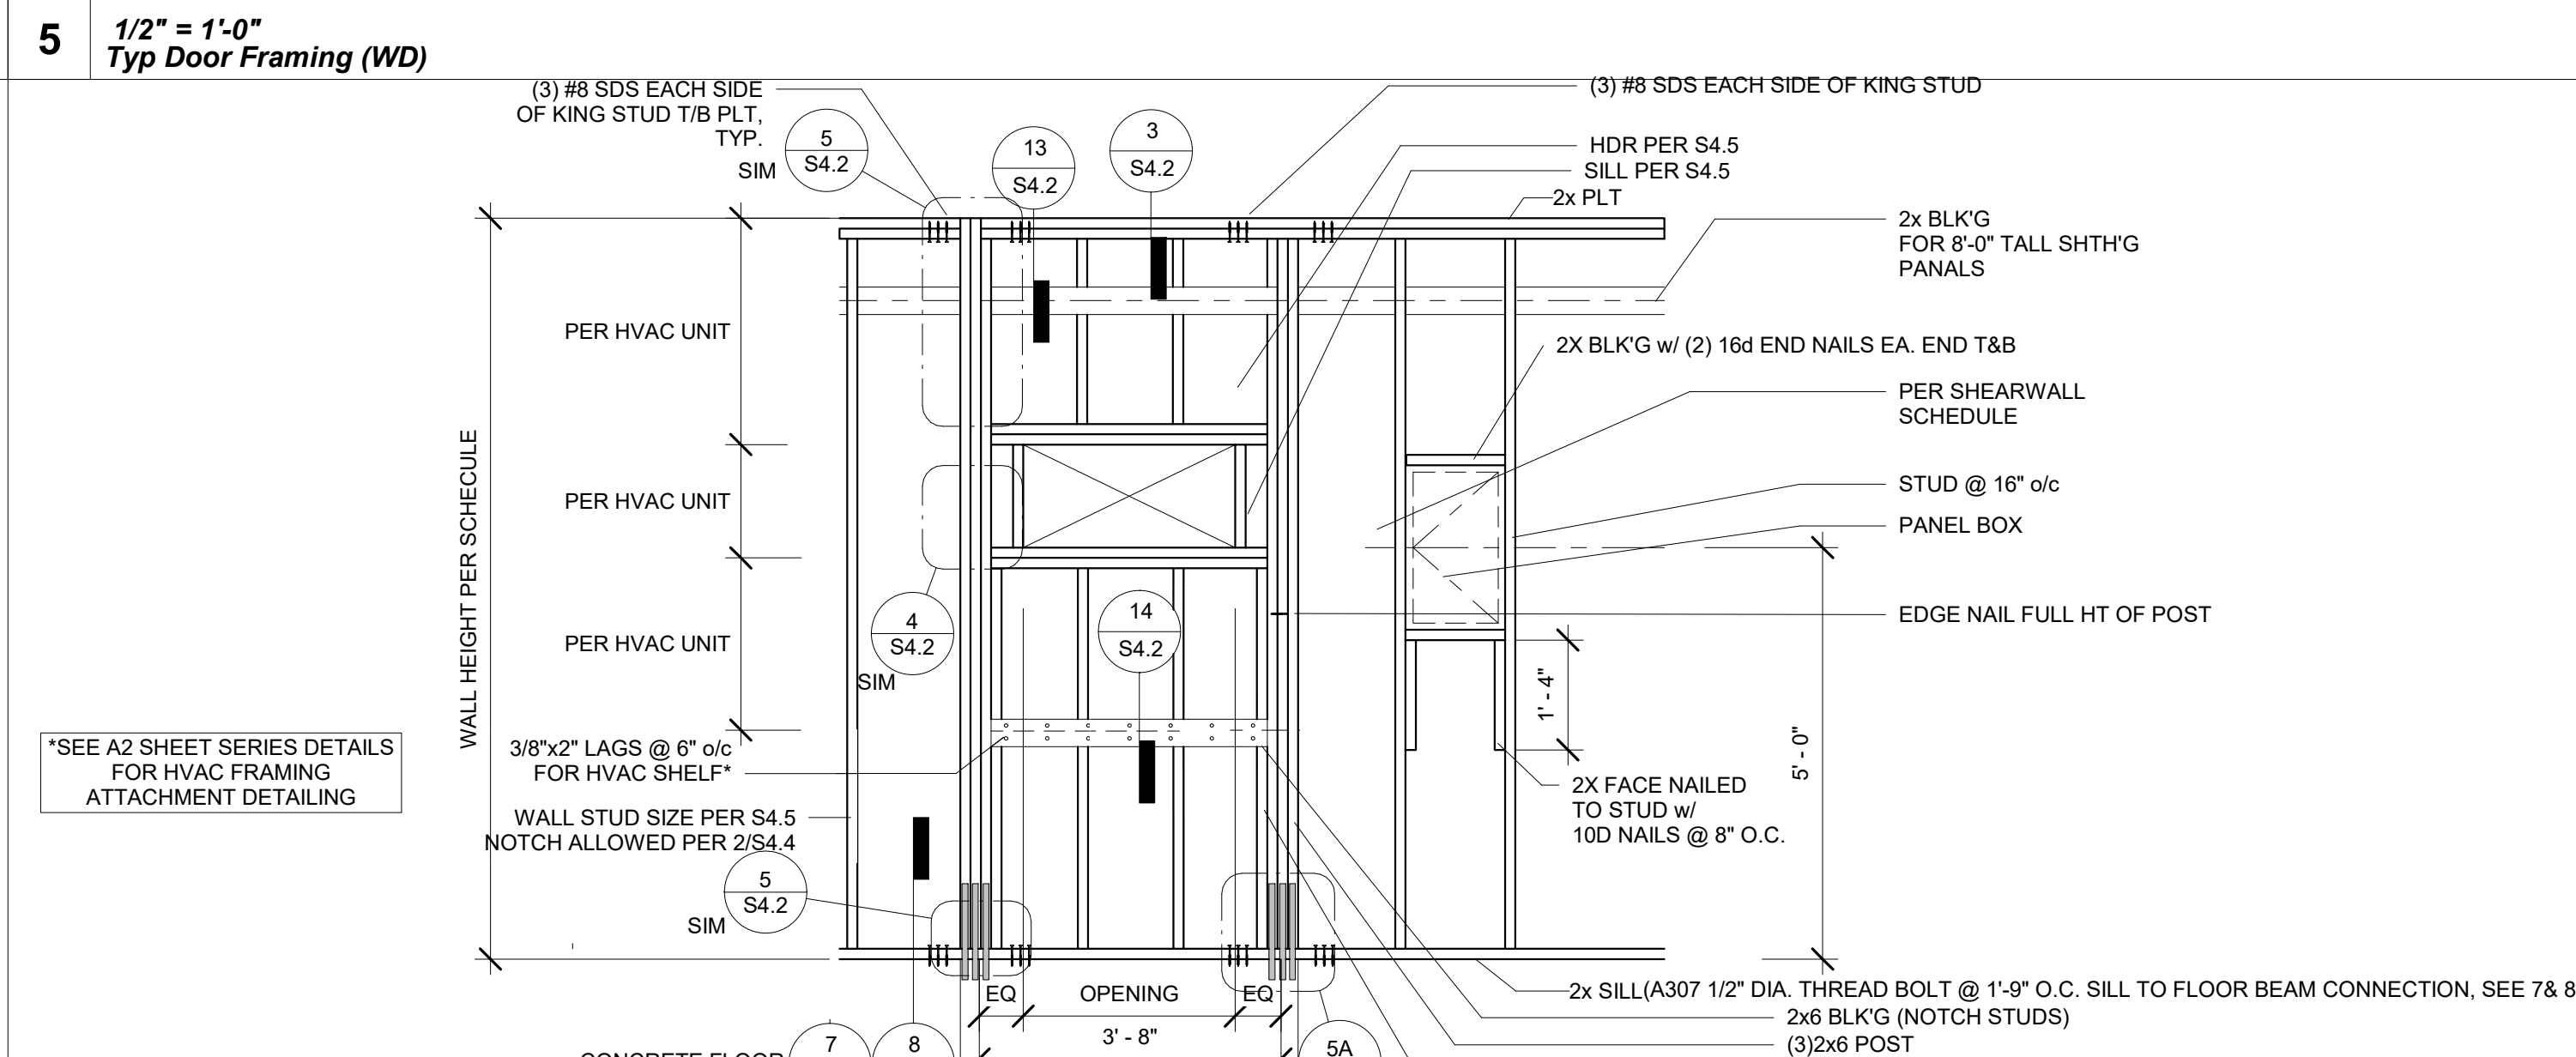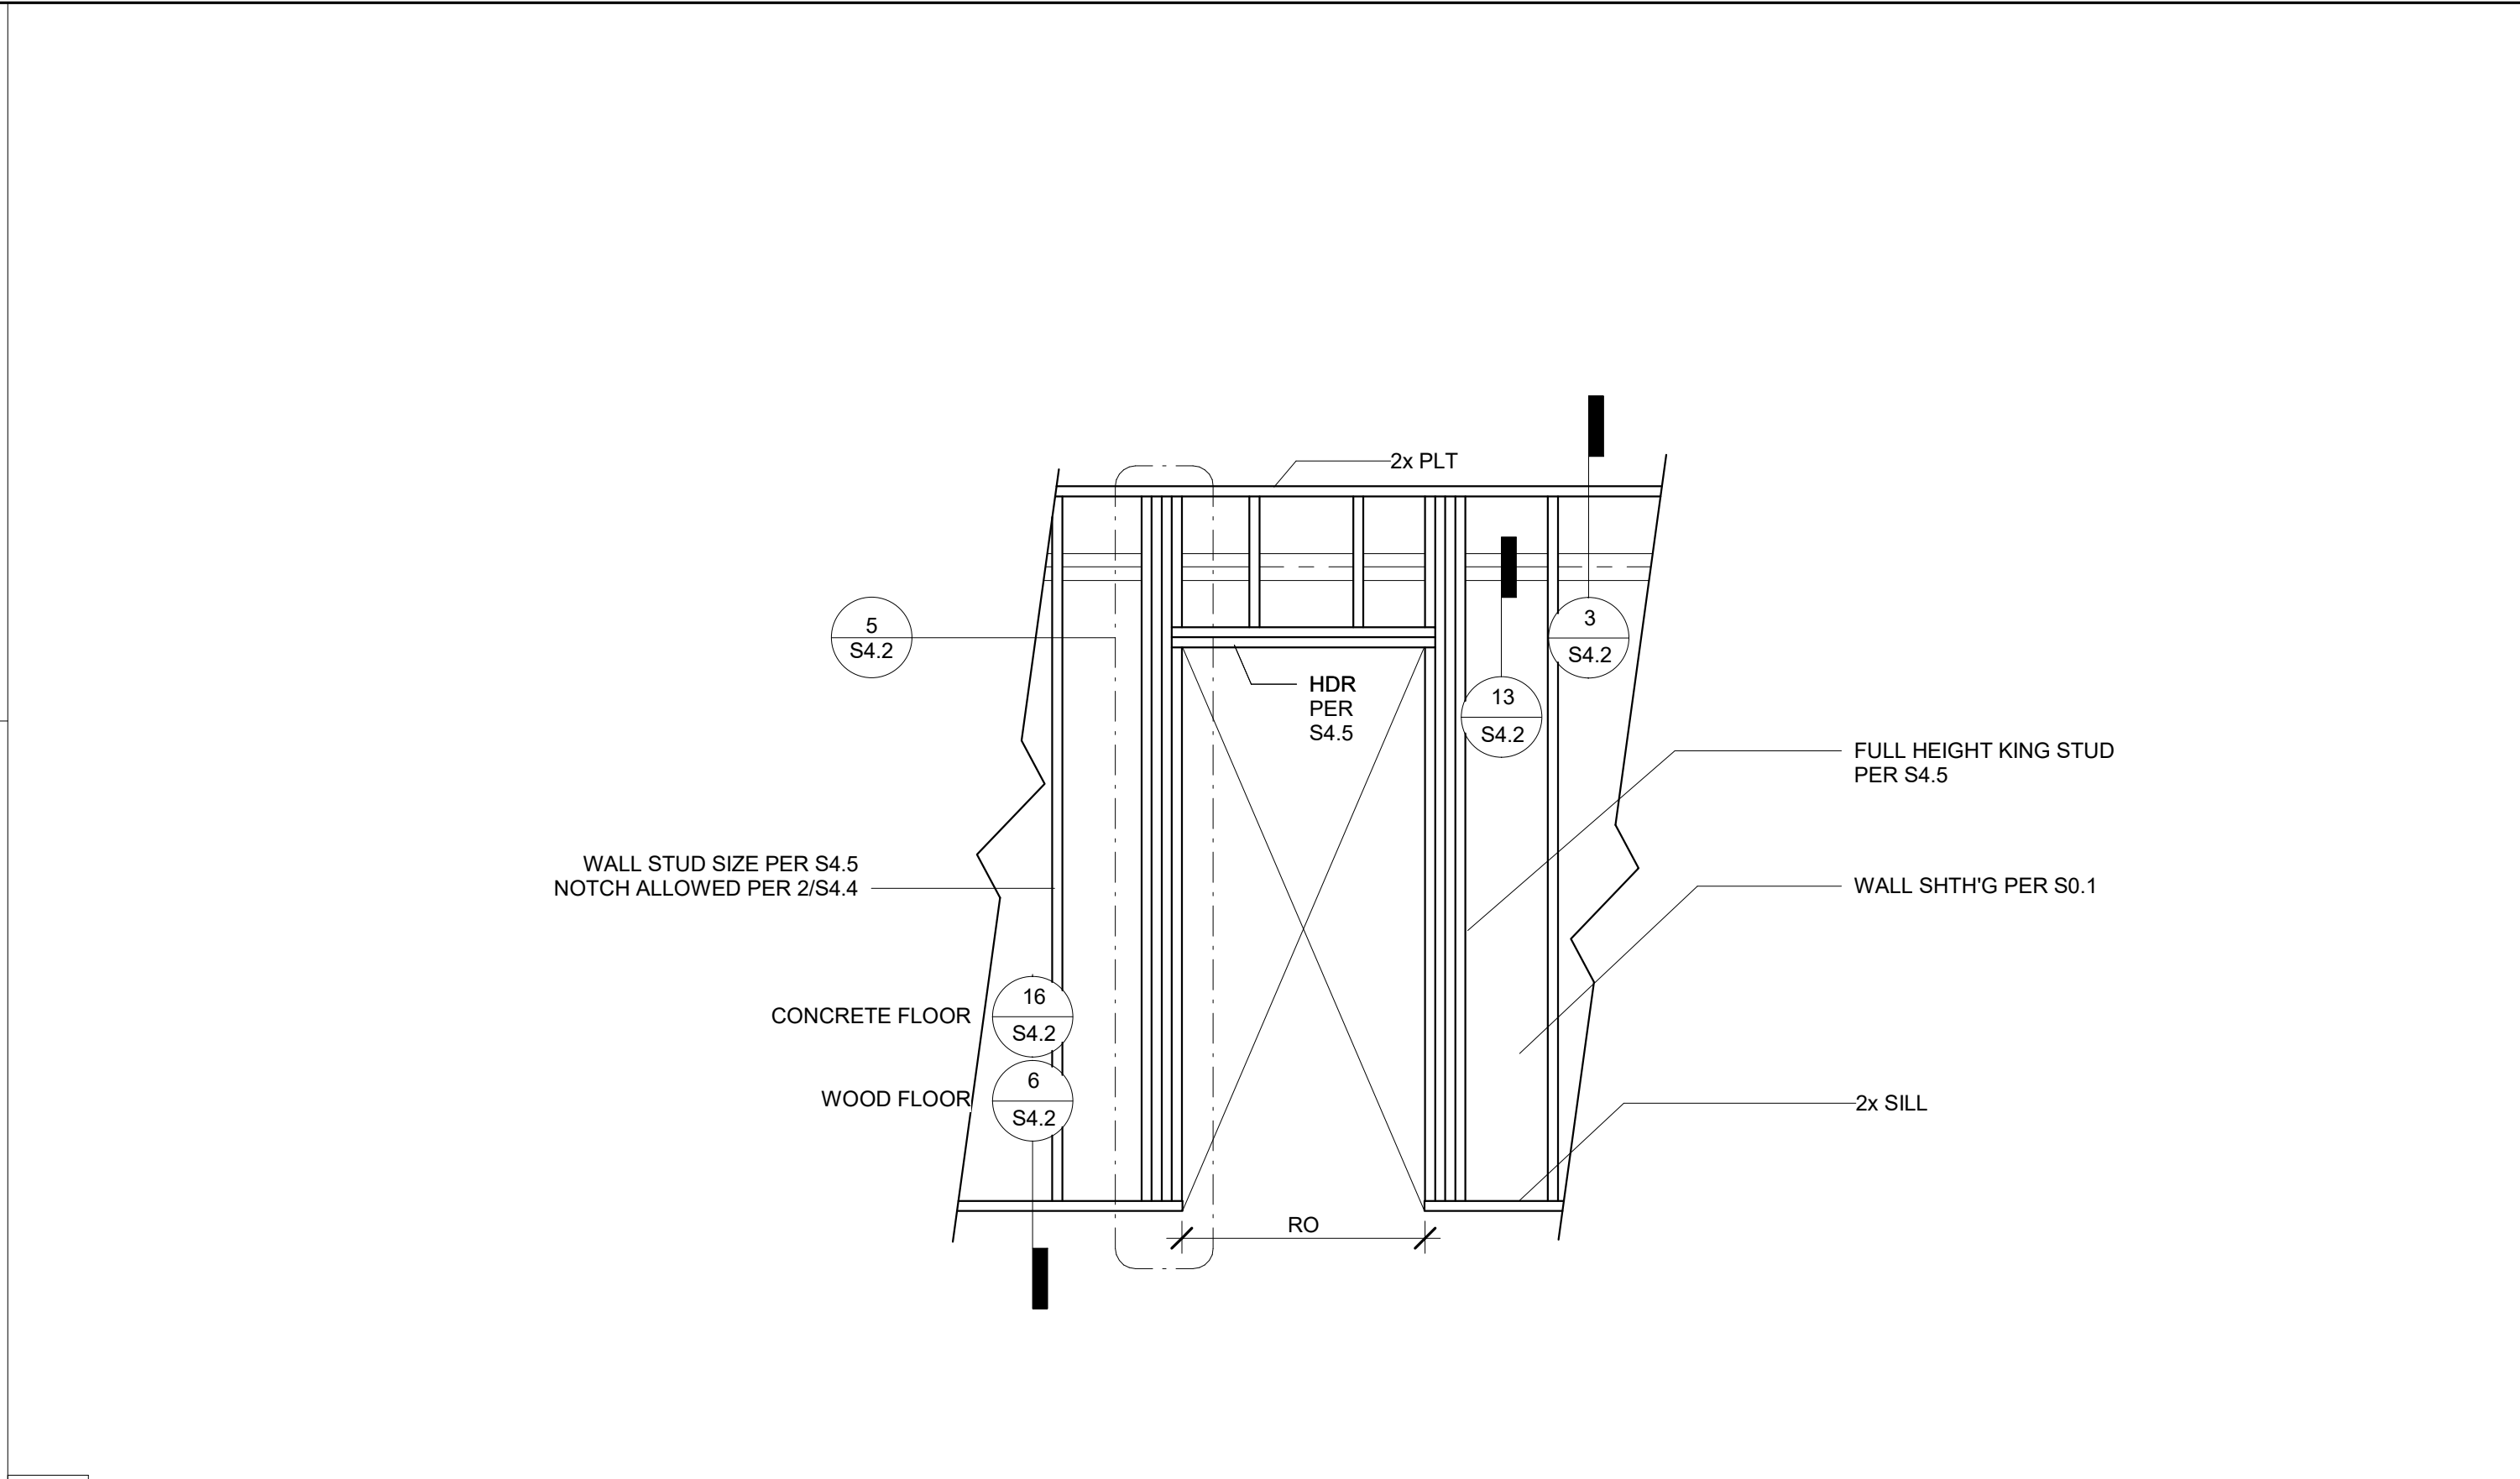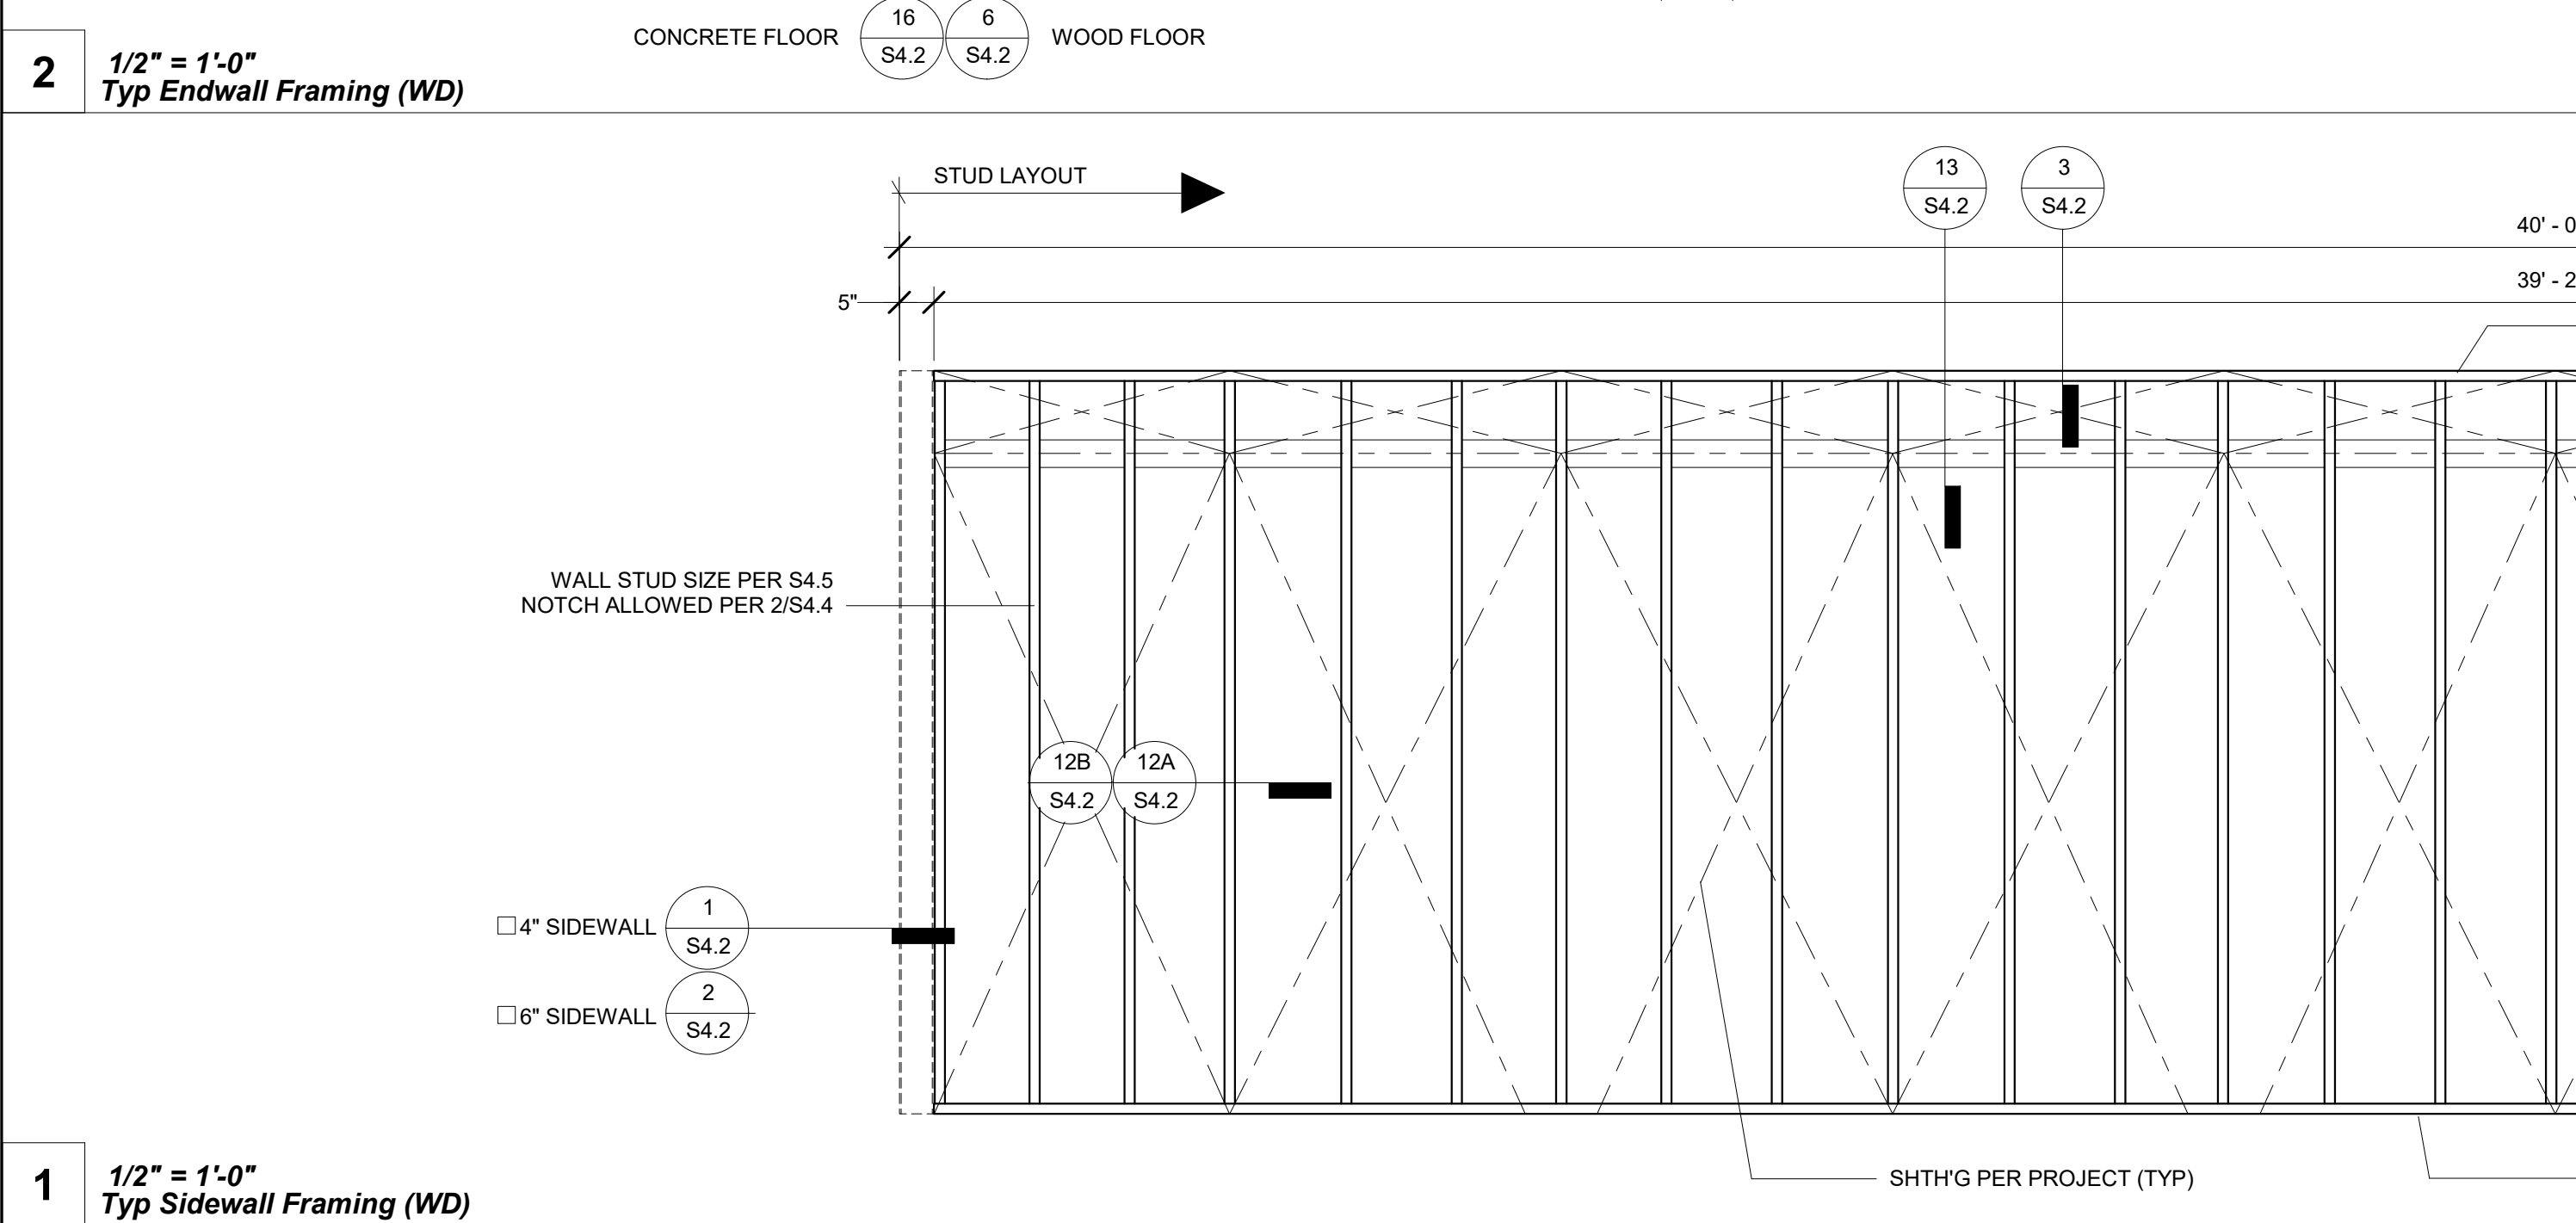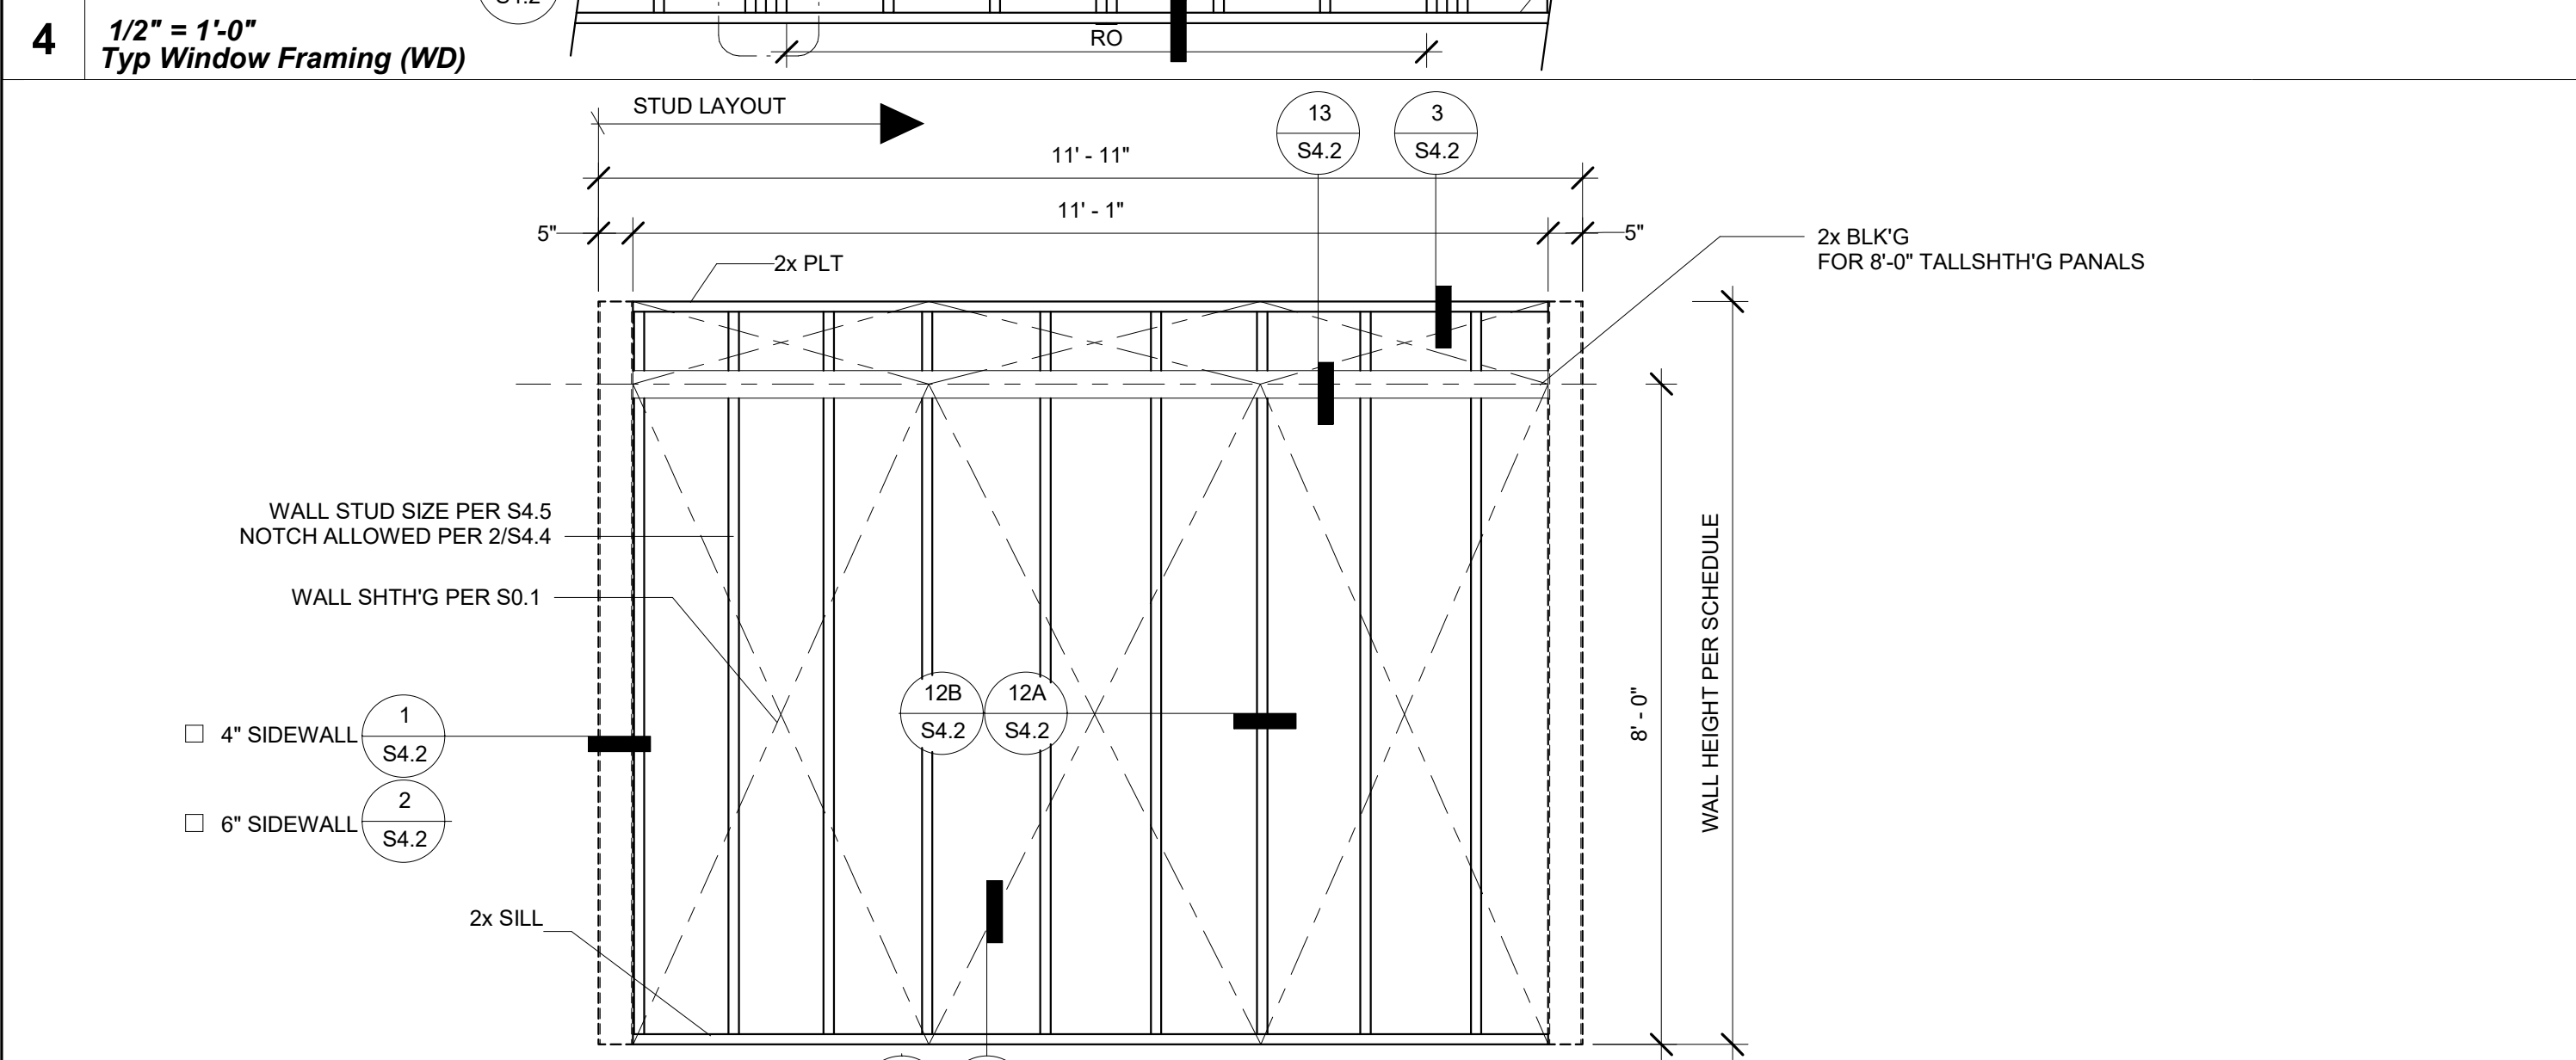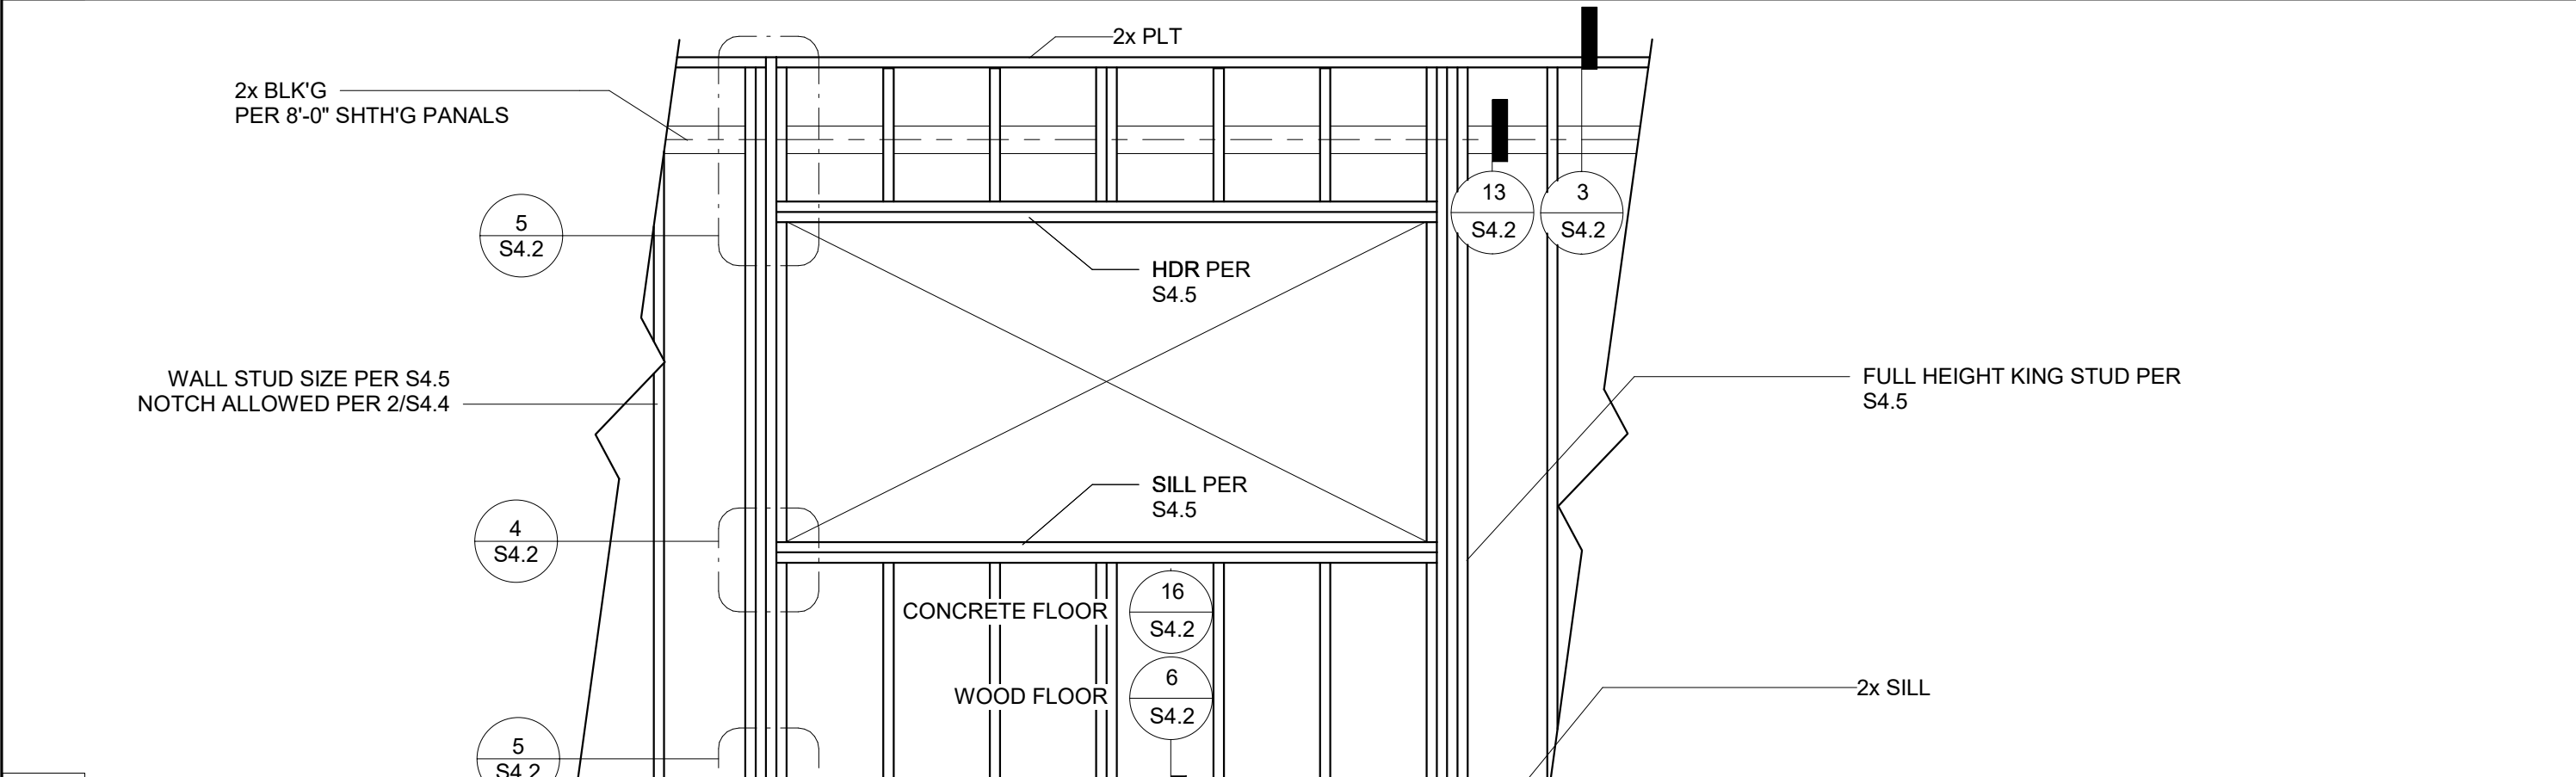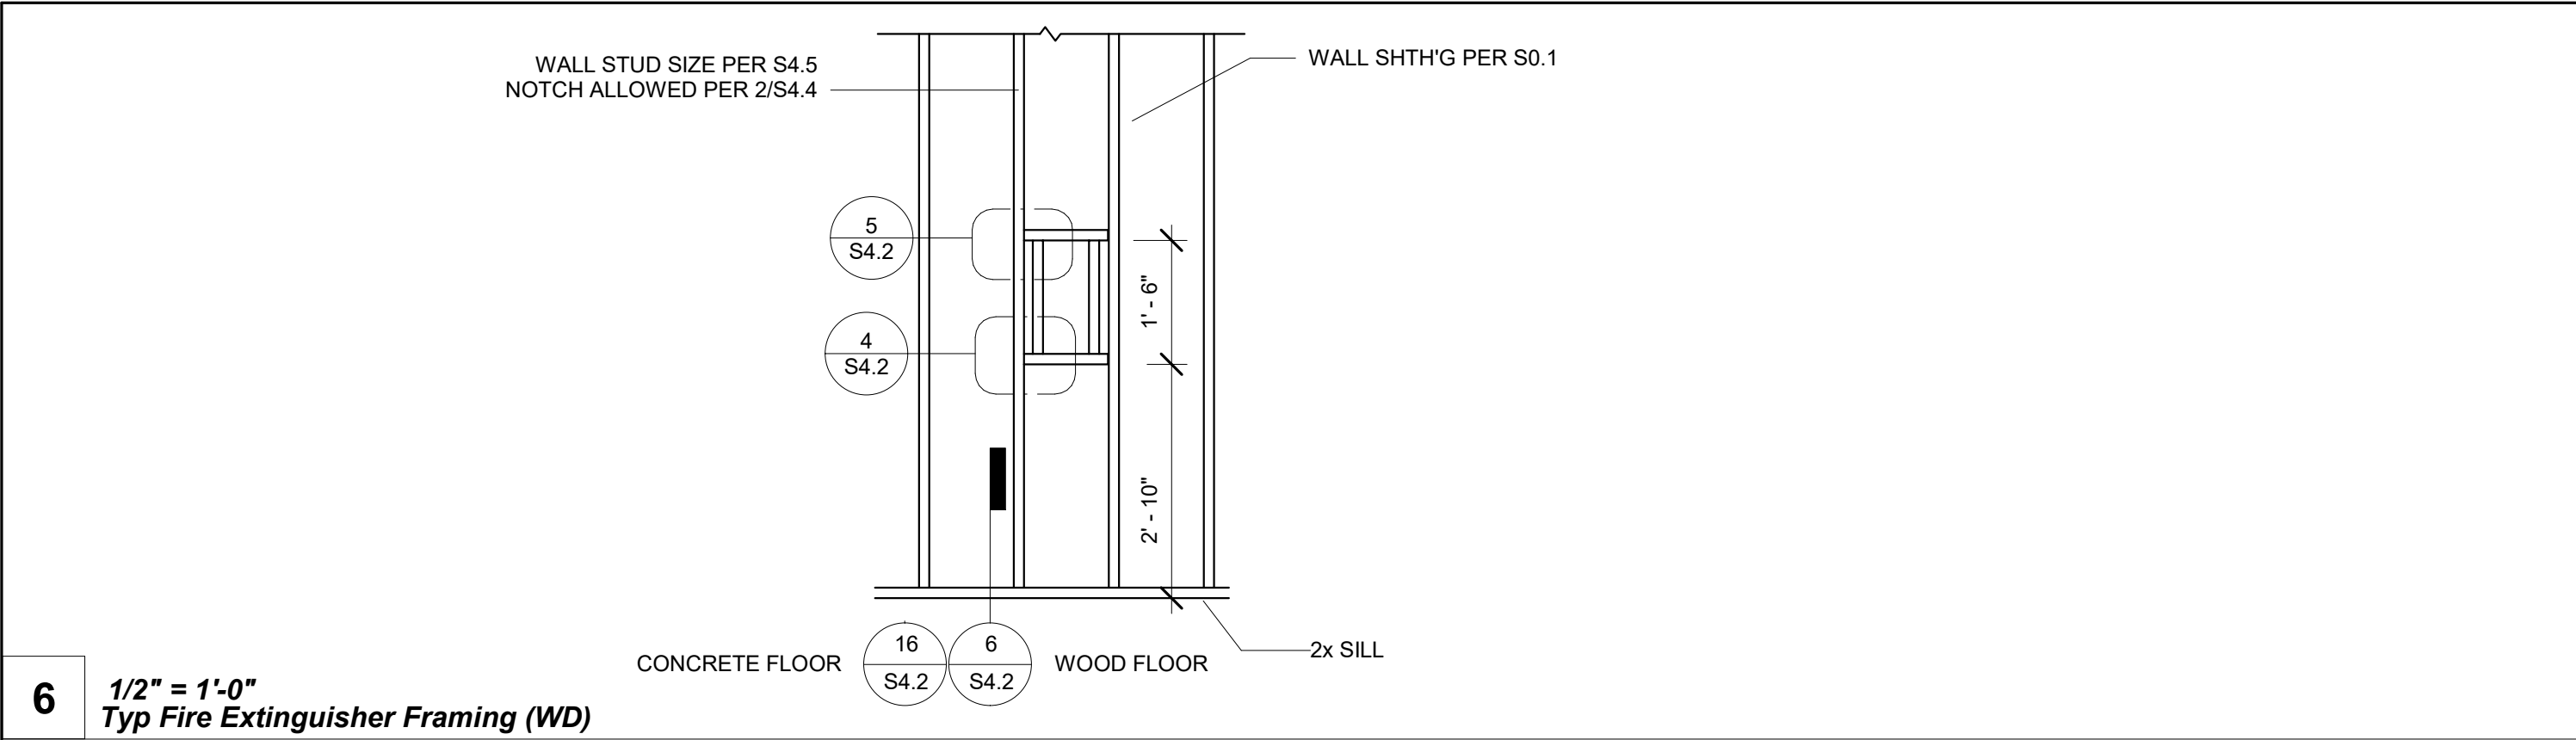

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

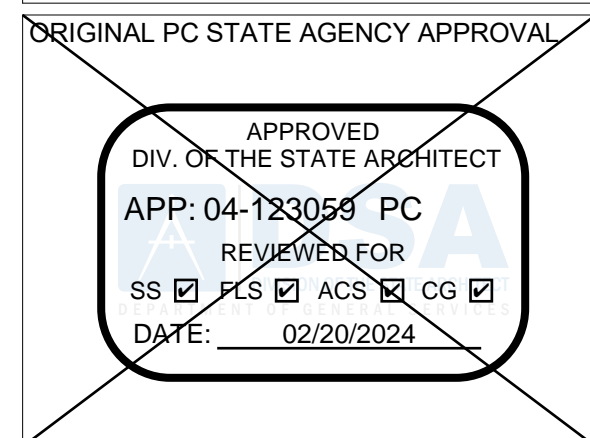

Revision Schedule		
#	Description	Date


PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC:24' x 40' EXPANDABLE TO 120' x 40'


SHEET TITLE
WD WALL FRAMING ELEVATIONS

PROJECT NUMBER
22088
DRAWN BY
rMc/SC
CHECKED BY
JA/RT
DATE
SHEET NO.
S4.1
SHEET OF


6/6/2021 1:53:00 AM C:\Users\User\Documents\RS#20132 - Class Leasing, PC 24x40 to 120x40 HS, detached_CESAR24D63.nt

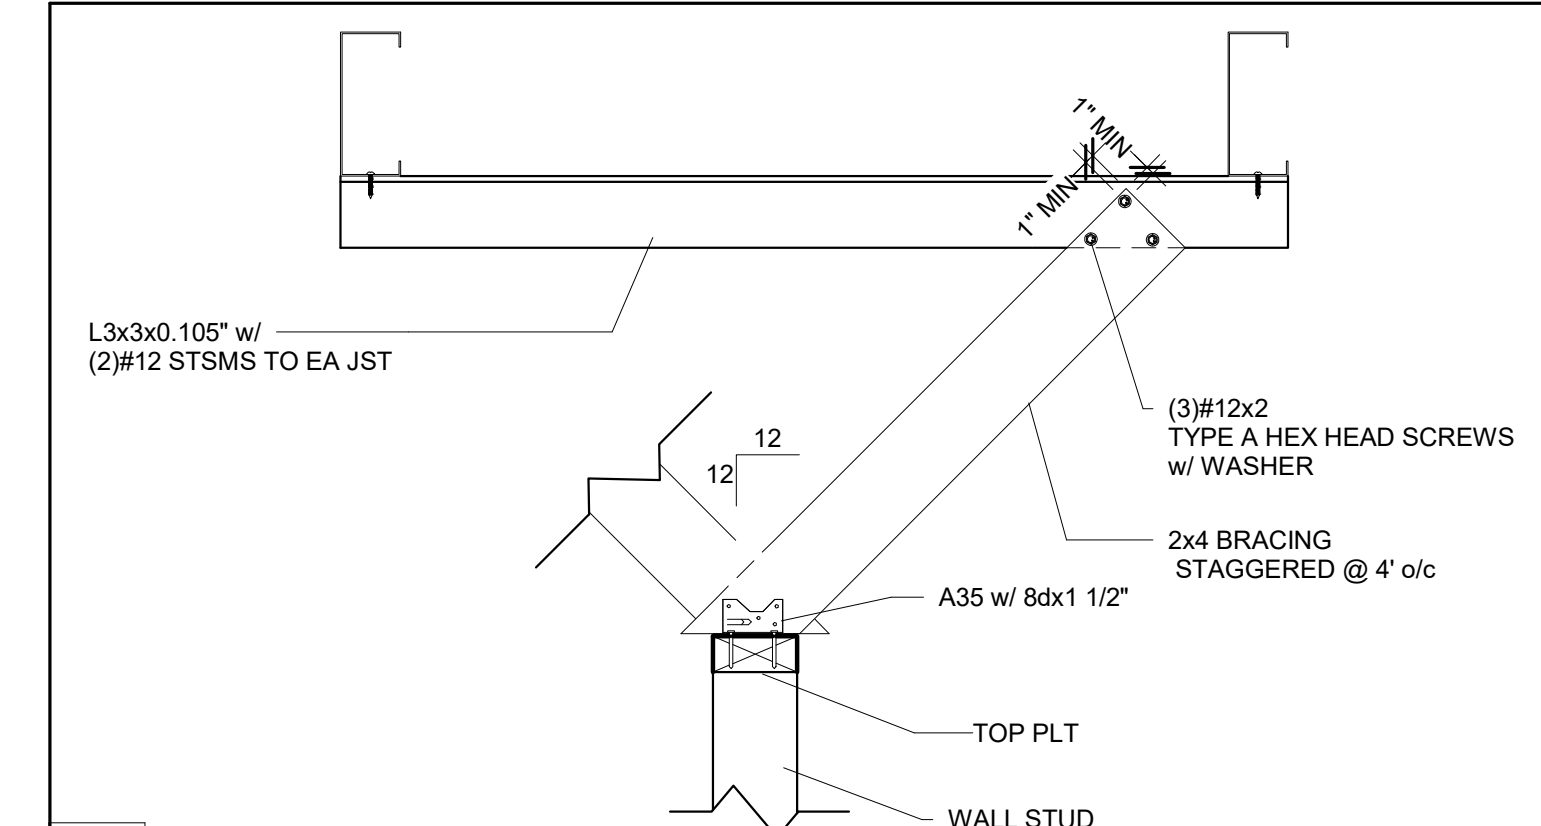


20 1 1/2" = 1'-0"
Sections - Interior Partition w/ Brace to Blk'g (WD)

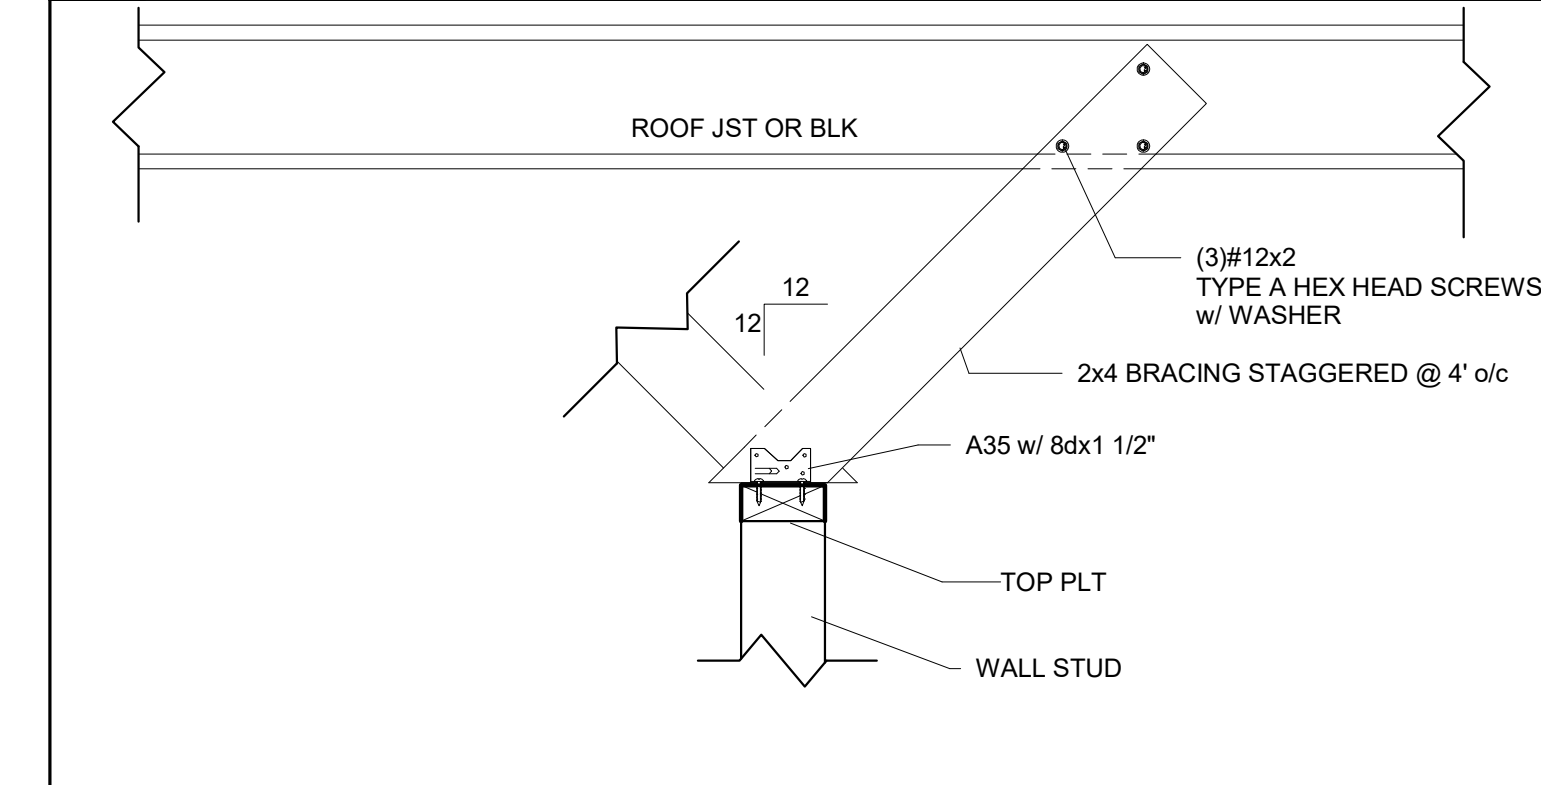


19 1 1/2" = 1'-0"
Sections - Interior Partition w/ Brace (WD)

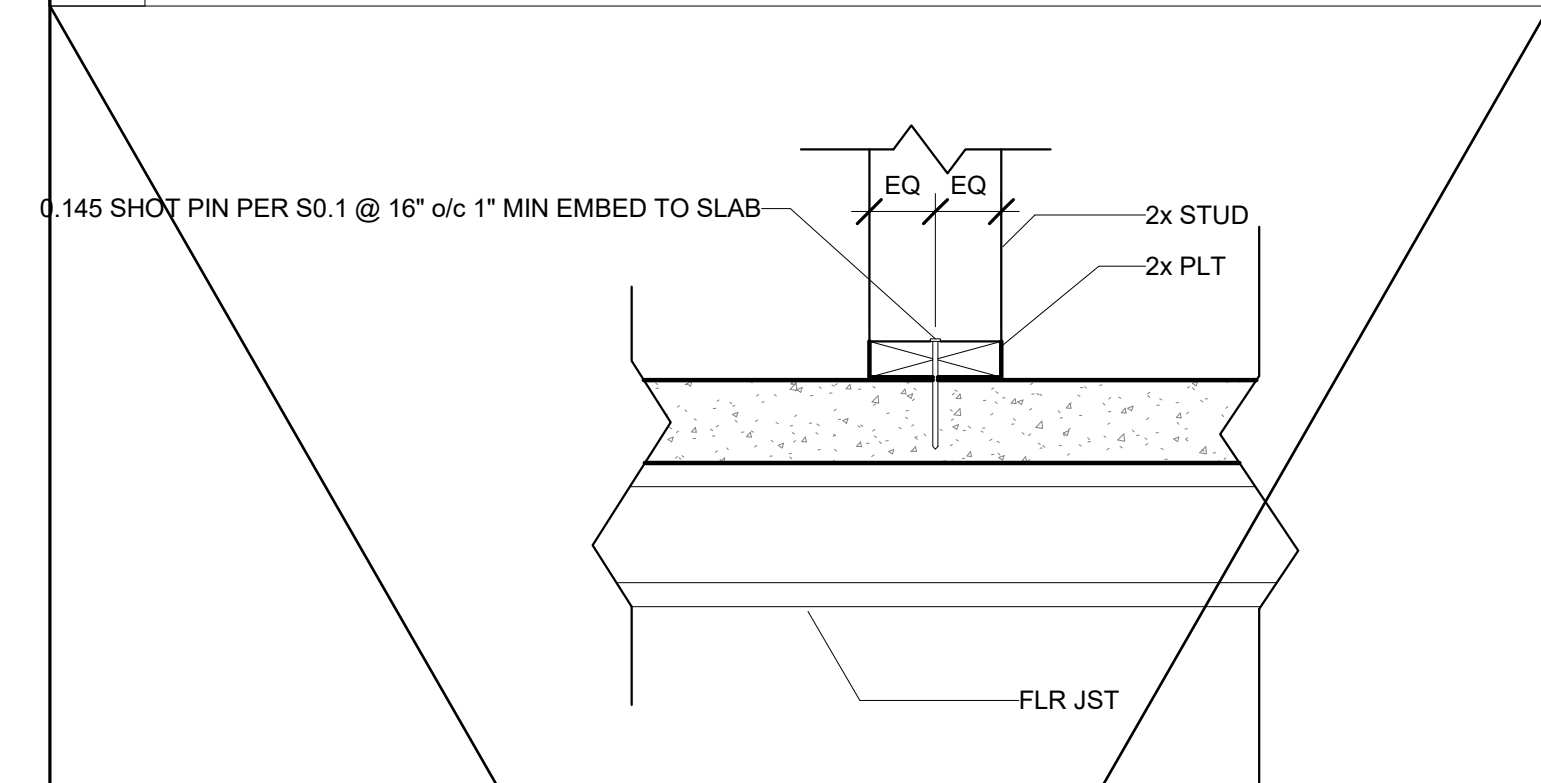


18 1 1/2" = 1'-0"
Typ Partition Sill Connection (CONC)

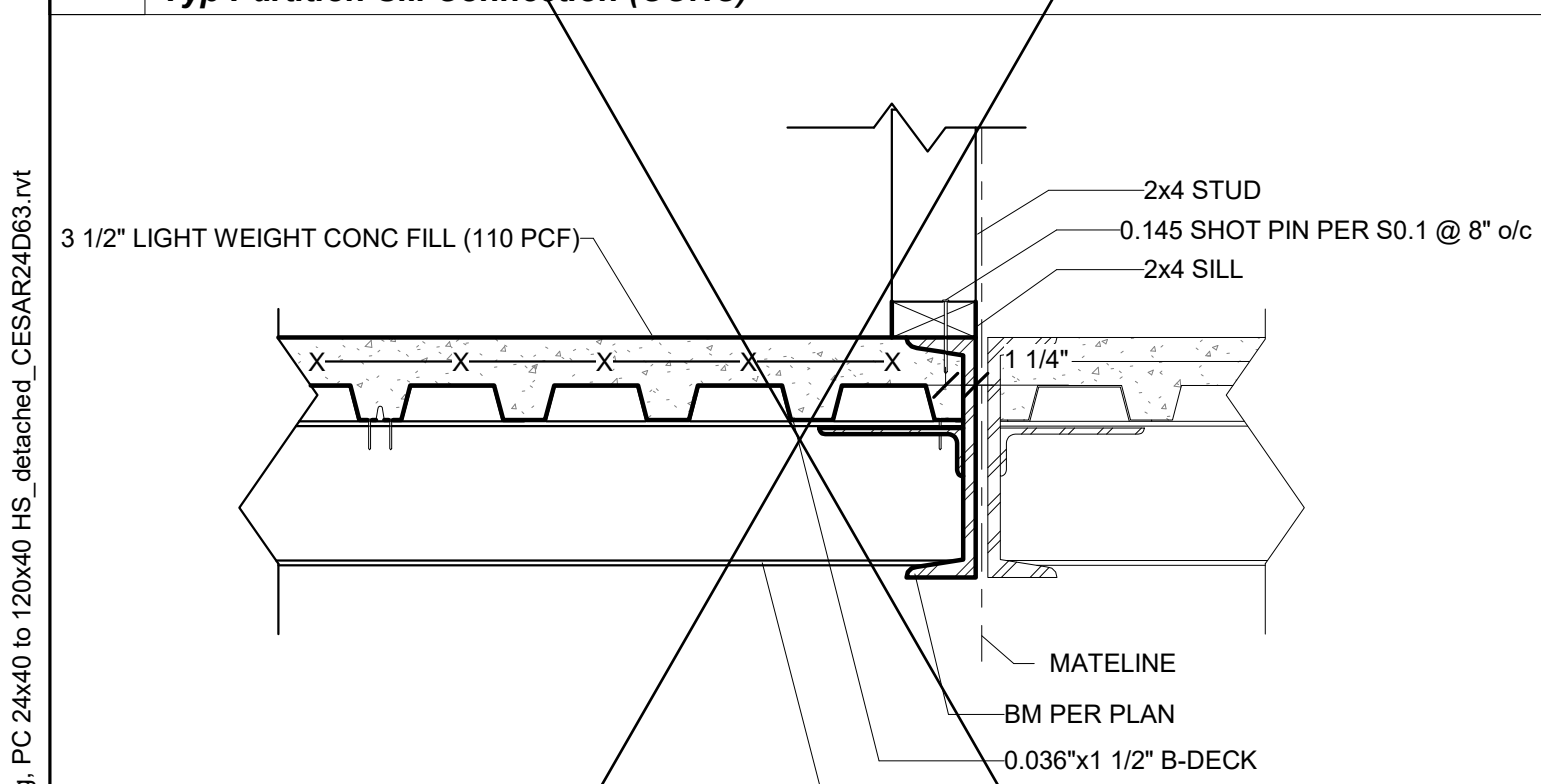


17 1 1/2" = 1'-0"
Wall Sill Plt Connection @ Interior Sidewall (CONC)

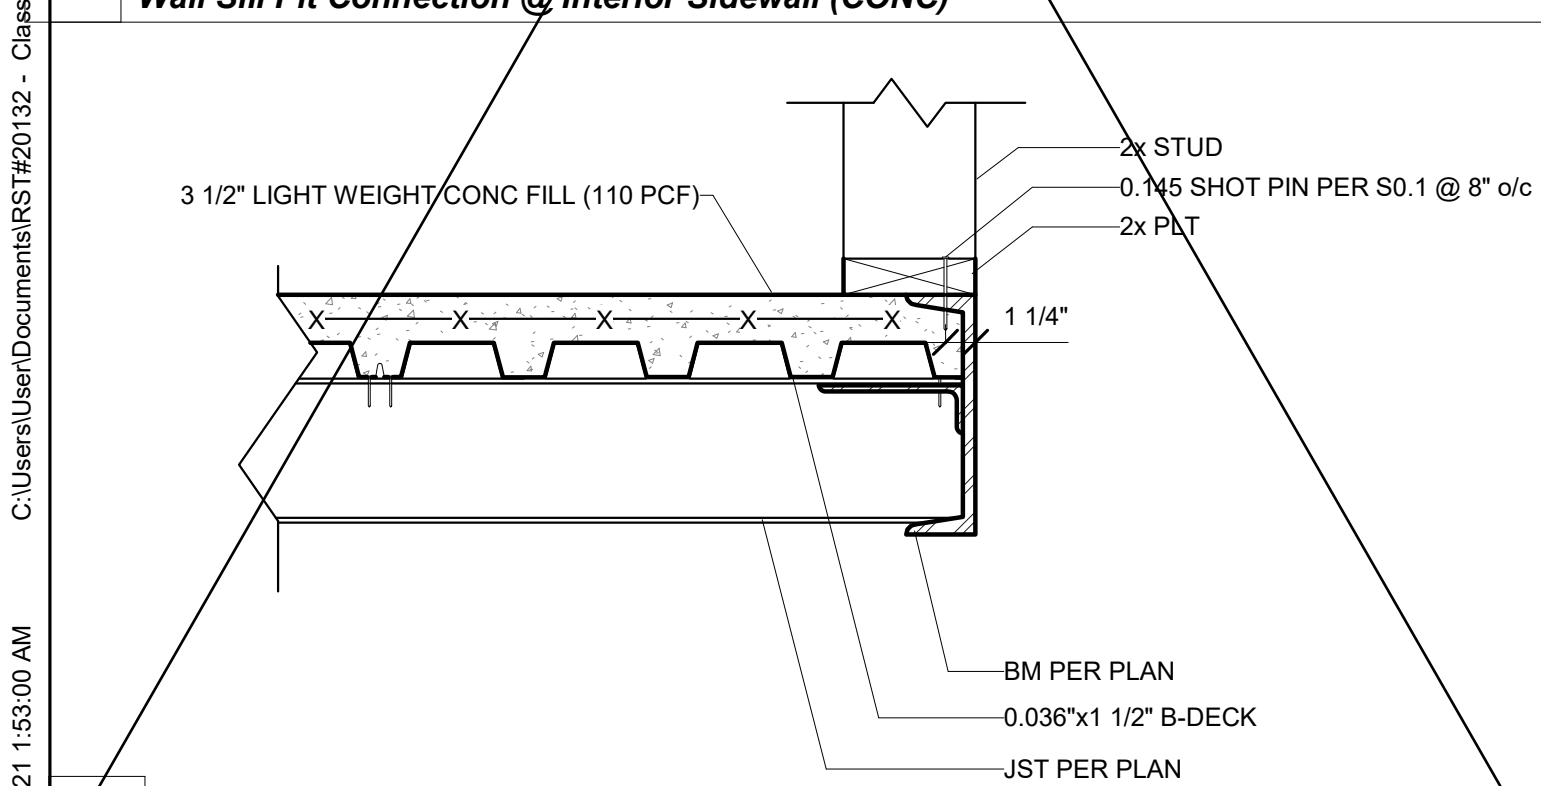


16 1 1/2" = 1'-0"
Wall Sill Plt Connection @ Exterior Rim (CONC)

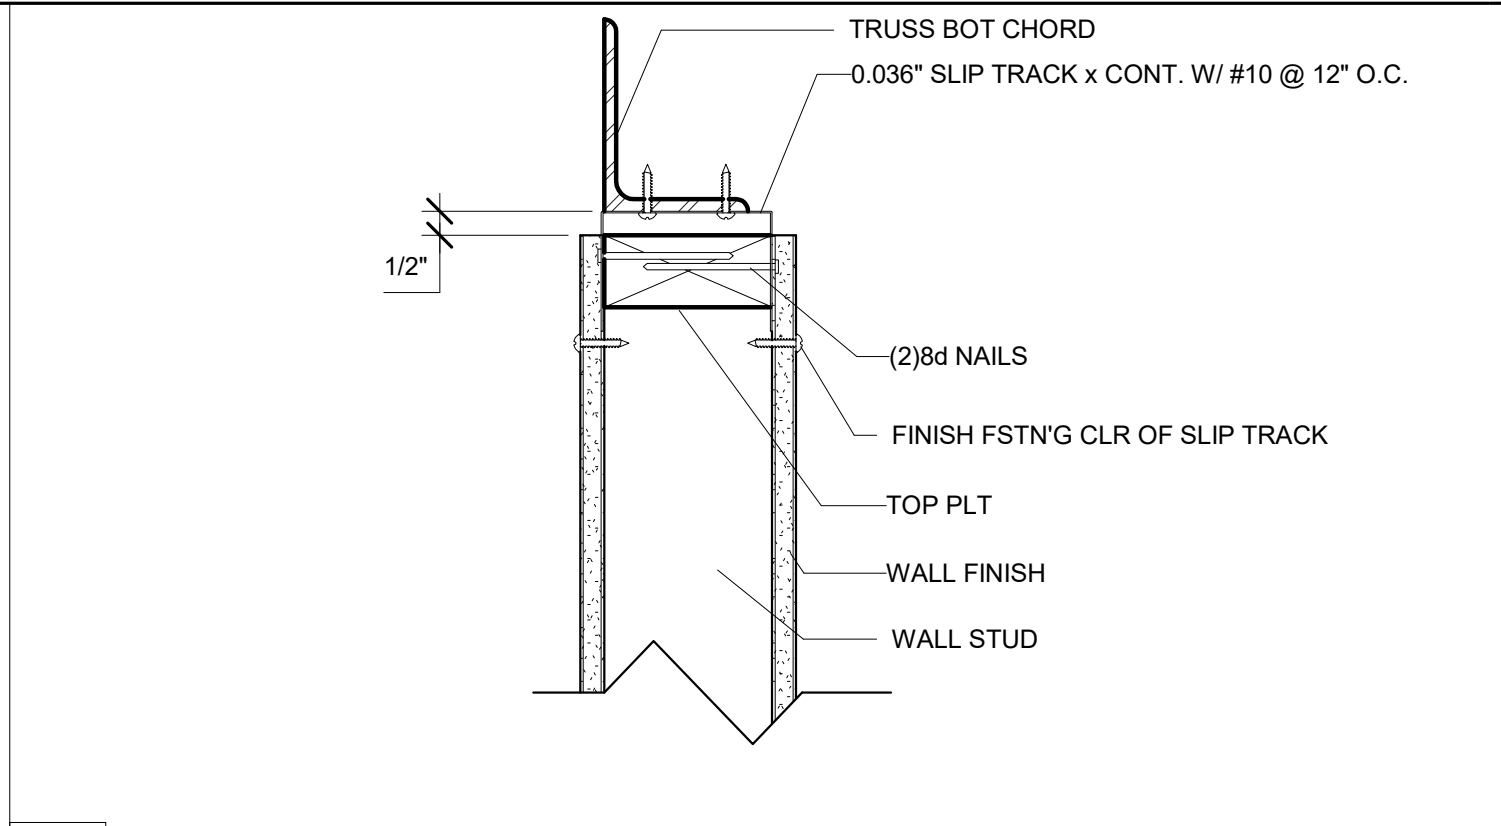


15 3" = 1'-0"
Section - Interior Wall Top Plate @ Truss (ML)

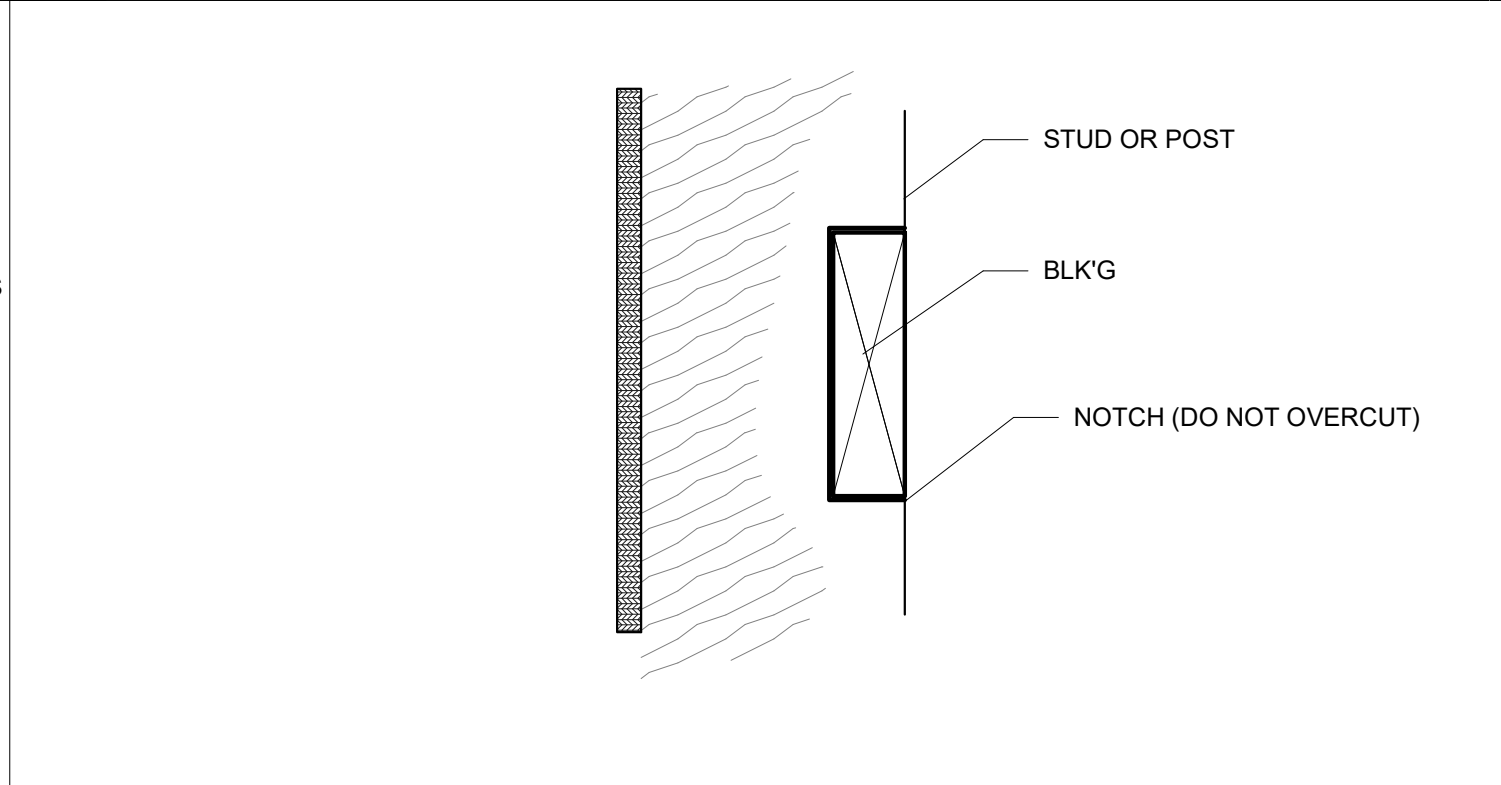


14 3" = 1'-0"
Notch Stud @ Blk'g

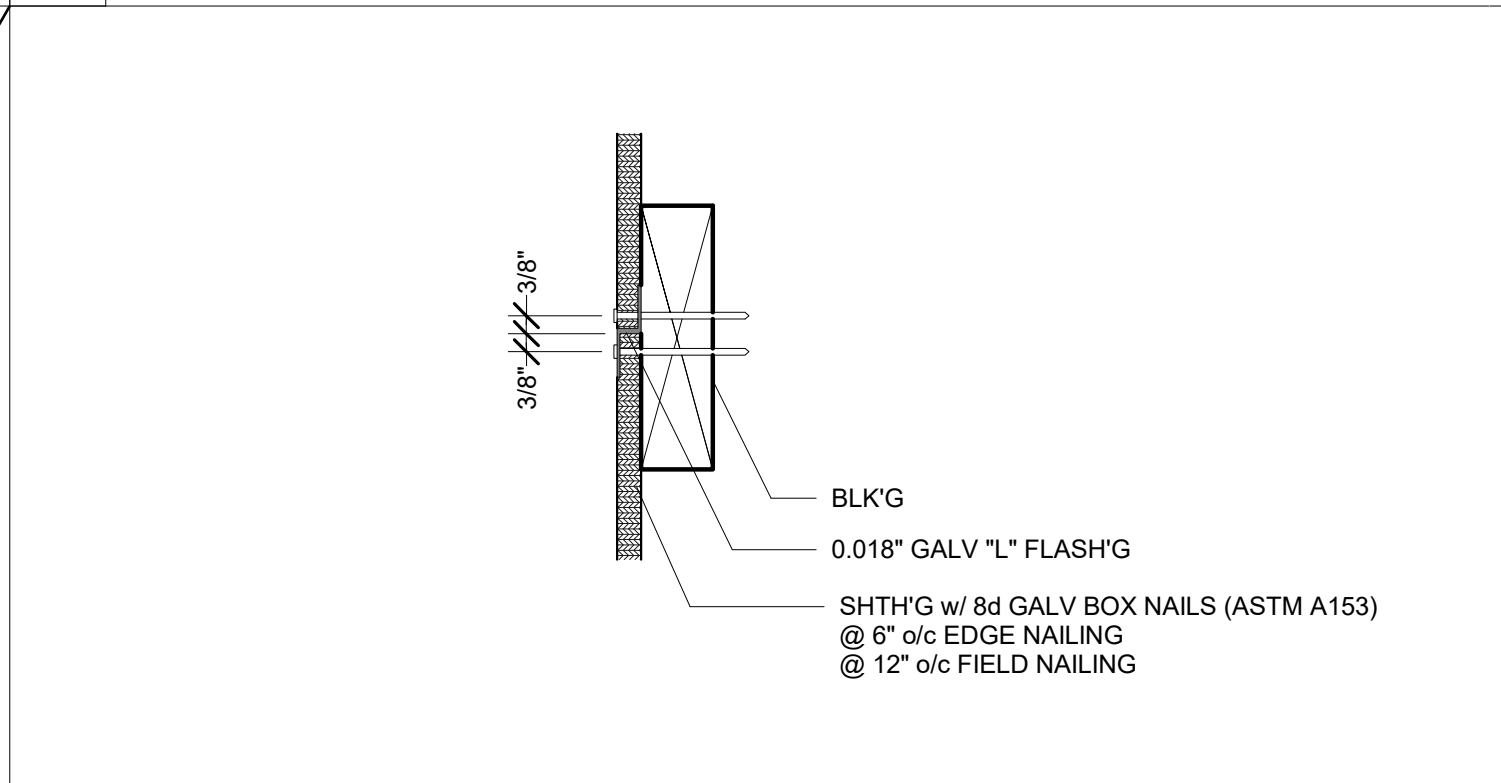


13 3" = 1'-0"
Shth'g @ Blk'g

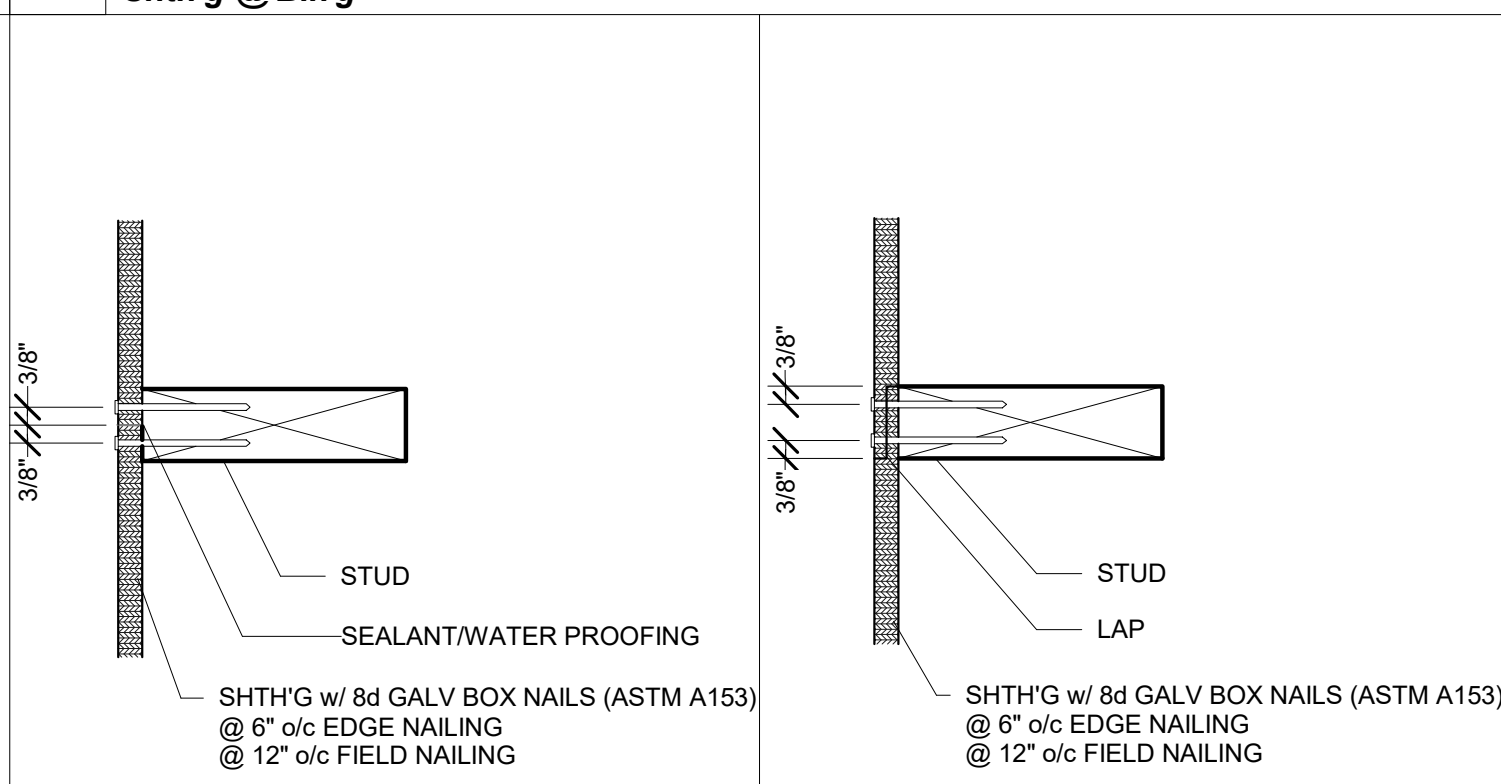


12A 3" = 1'-0"
Shth'g @ Butt Jnt

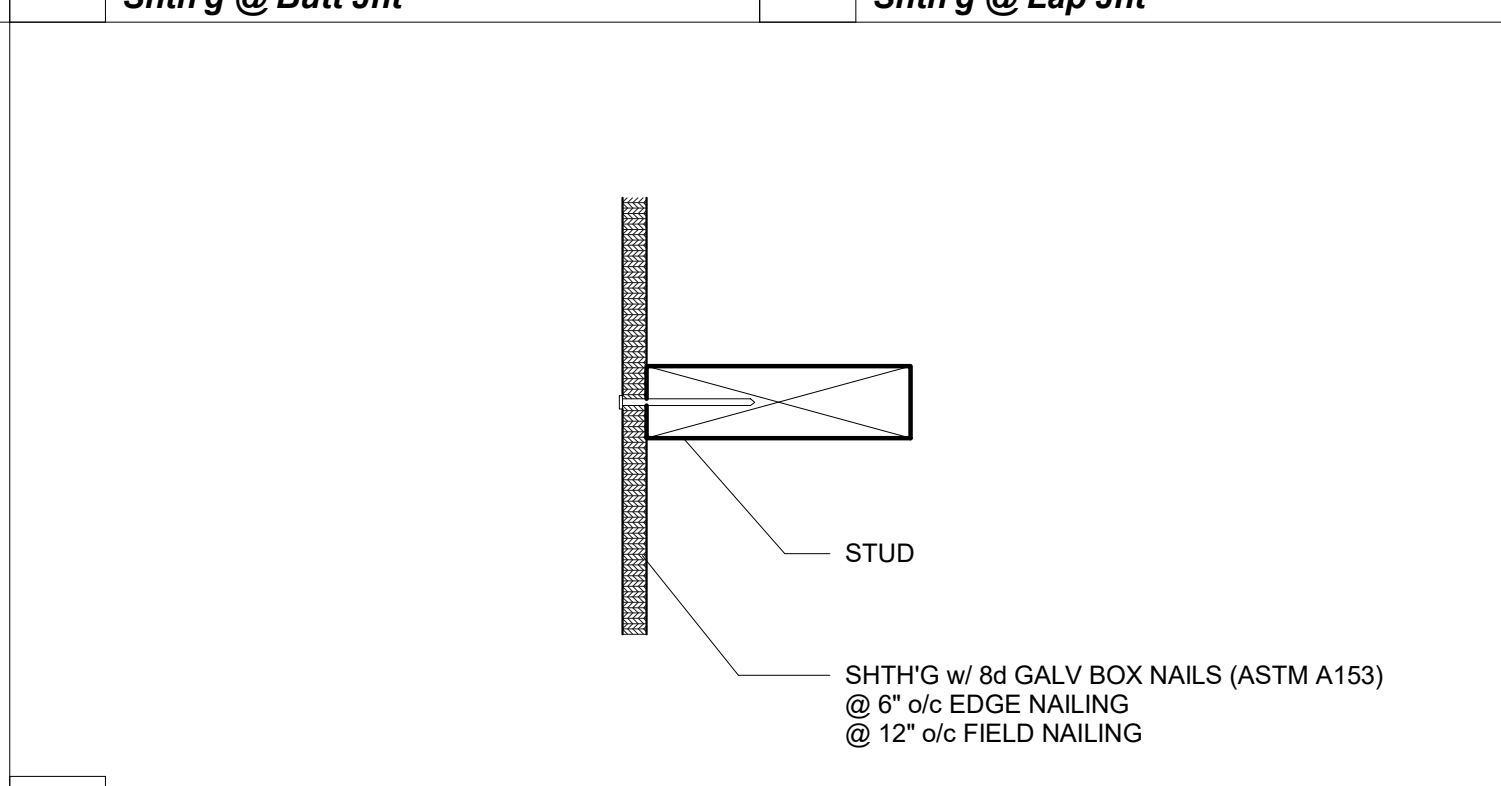


11 3" = 1'-0"
Shth'g @ Stud Conn

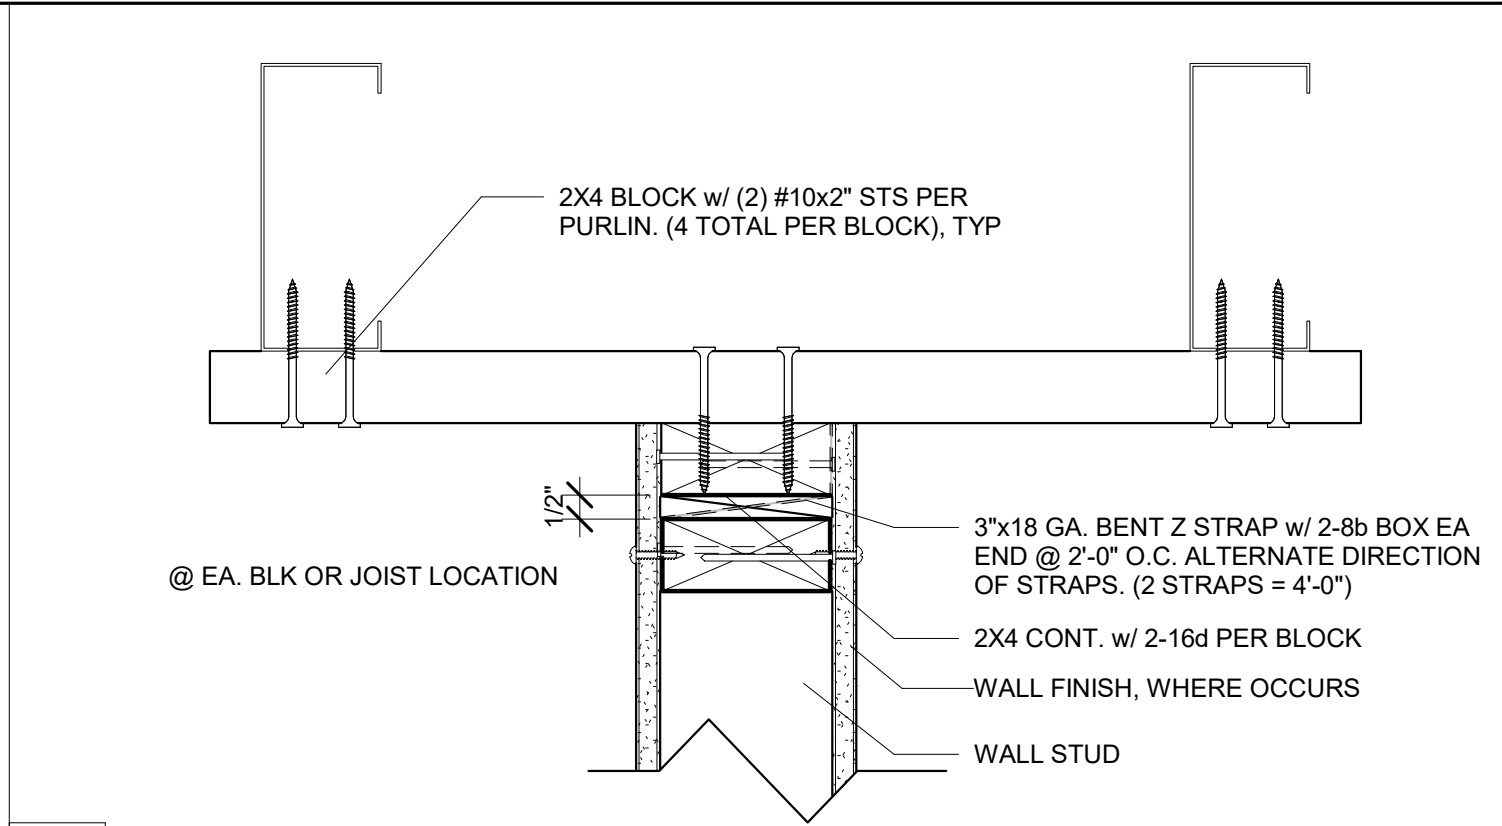


10 3" = 1'-0"
Sections - Interior Partition @ Blk'g (WD)

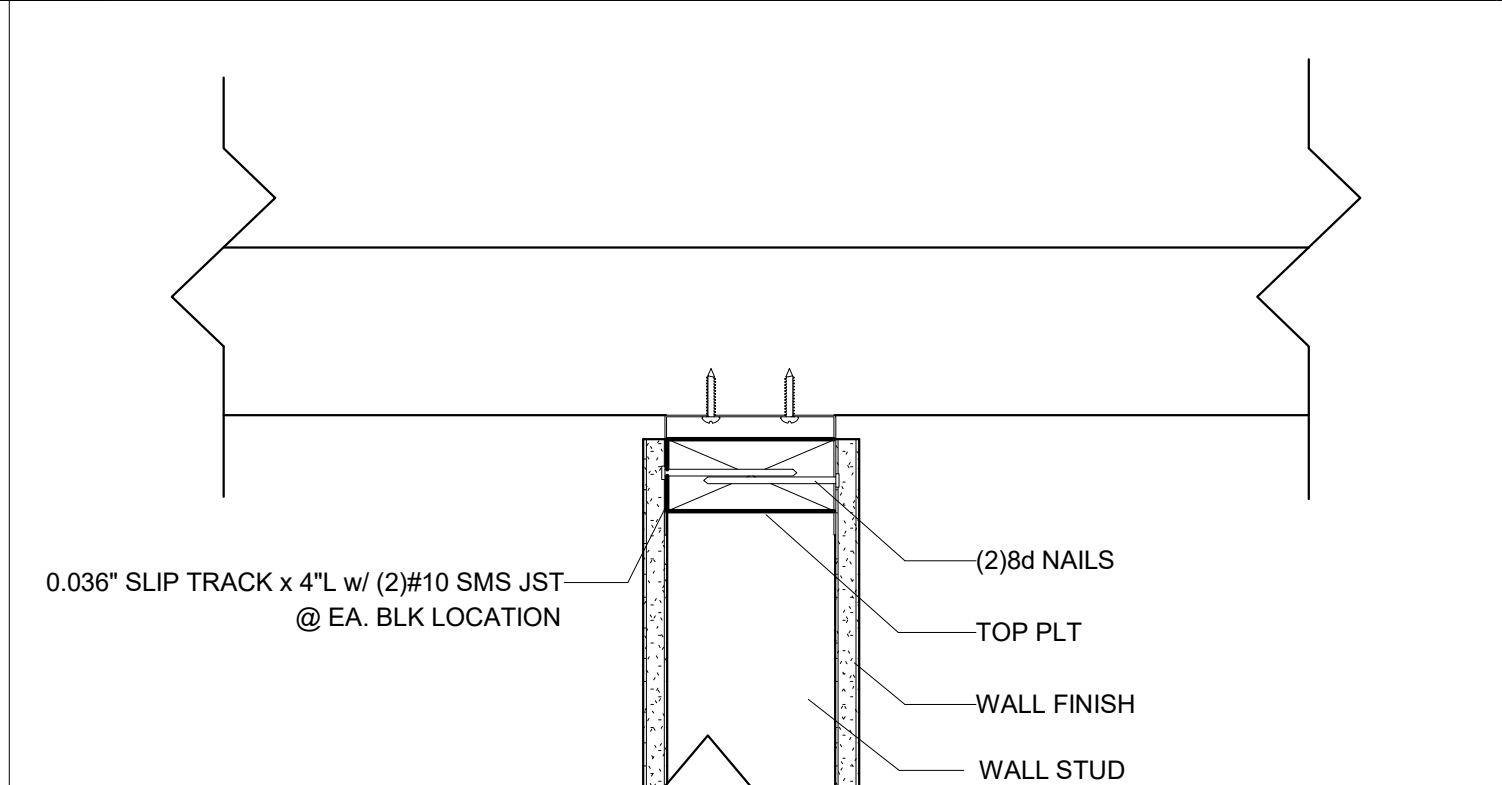


9 3" = 1'-0"
Sections - Interior Partition @ Jst (WD)

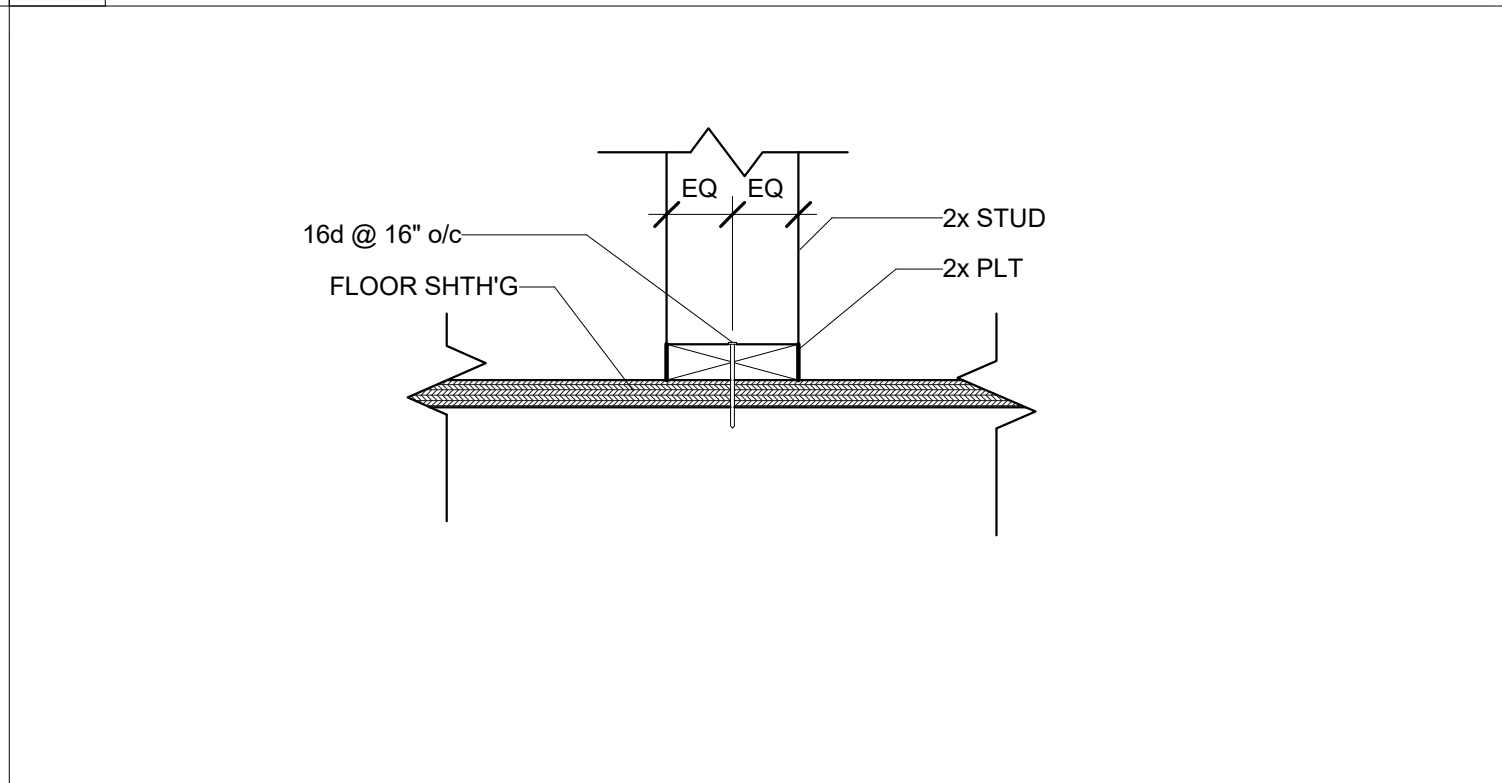


8 1 1/2" = 1'-0"
Typ Partition Sill Connection (WD)

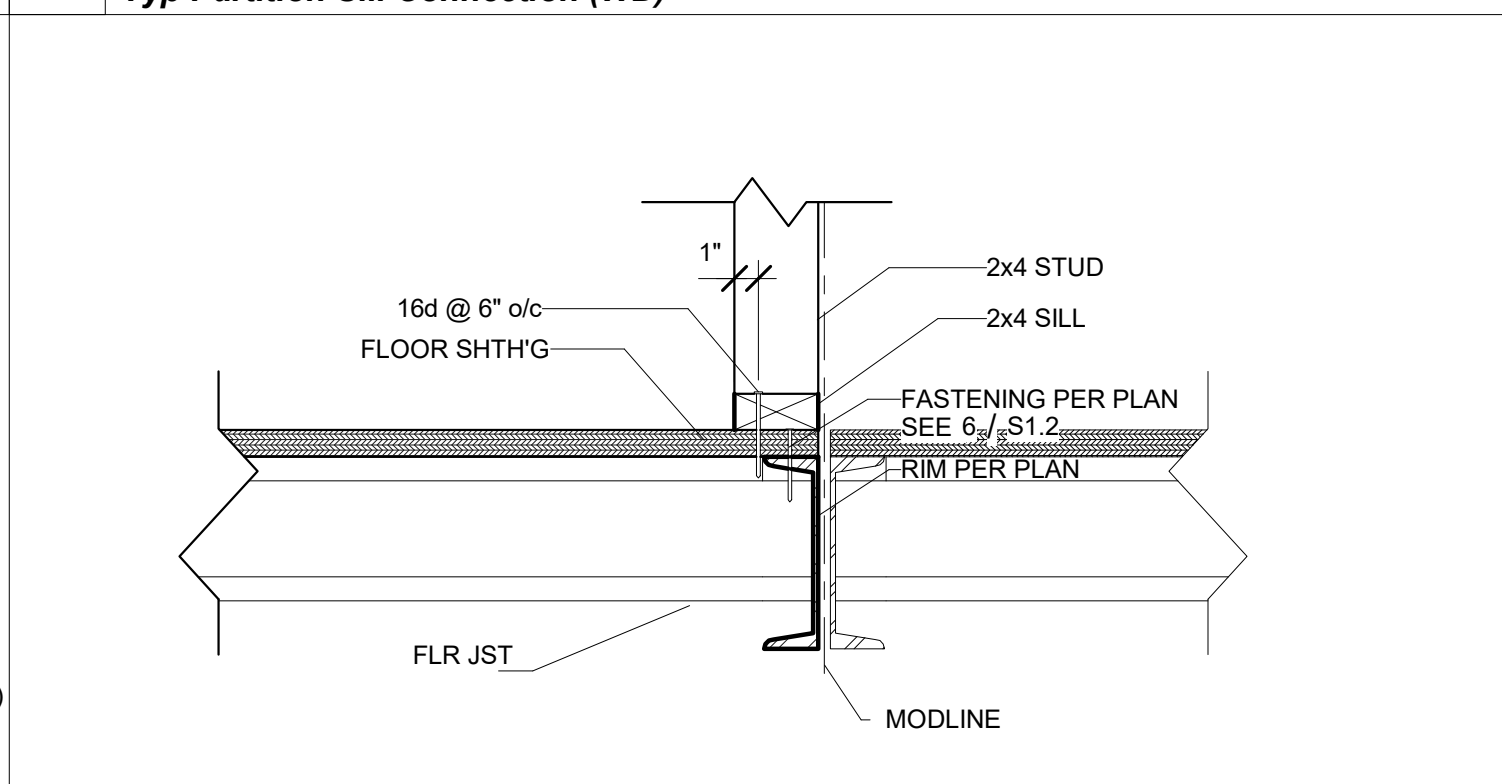


7 1 1/2" = 1'-0"
2x4 Wall Sill Connection @ Interior Sidewalls (WD)

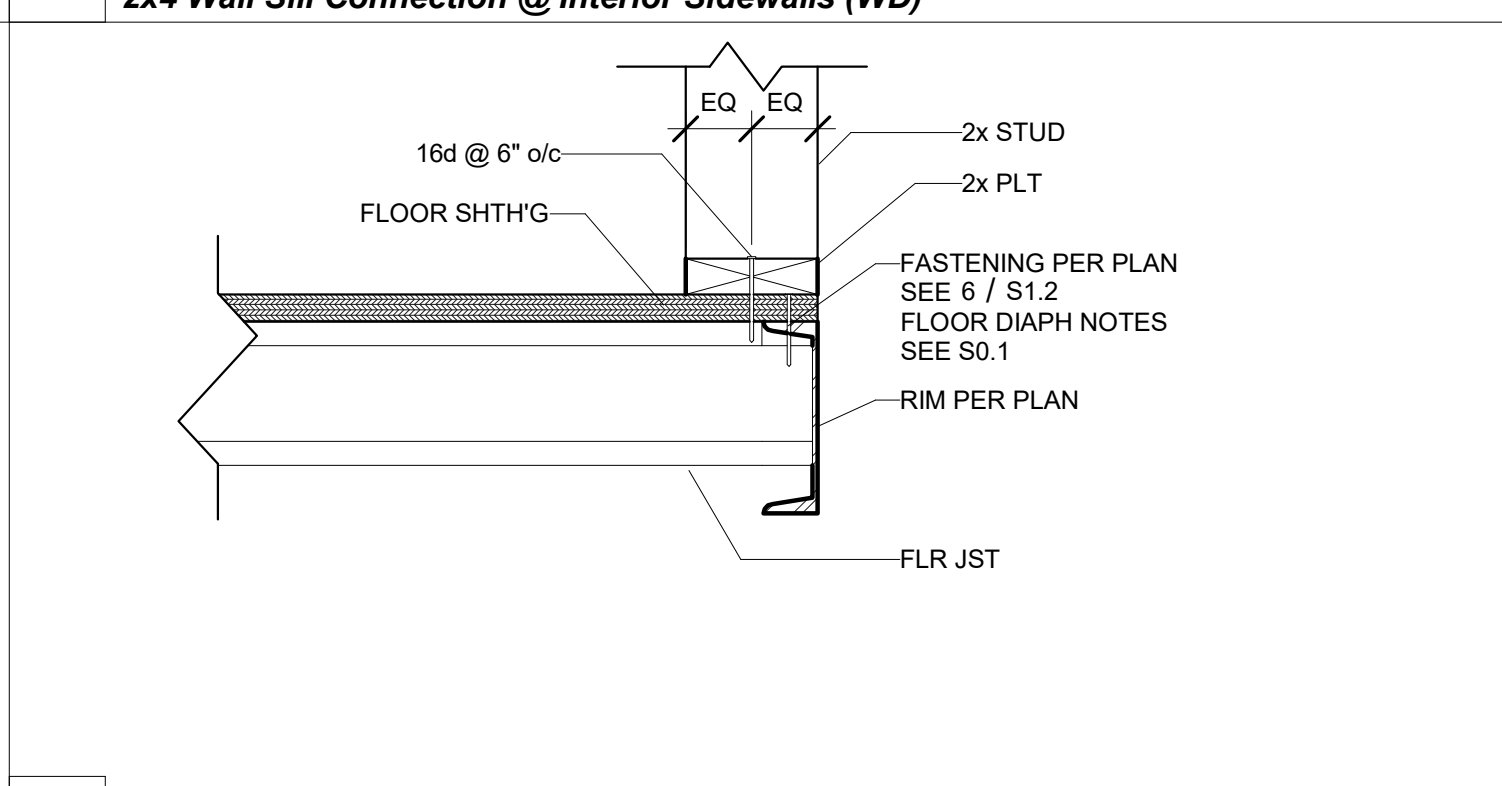


6 1 1/2" = 1'-0"
Wall Sill Connection @ Exterior Rim (WD)

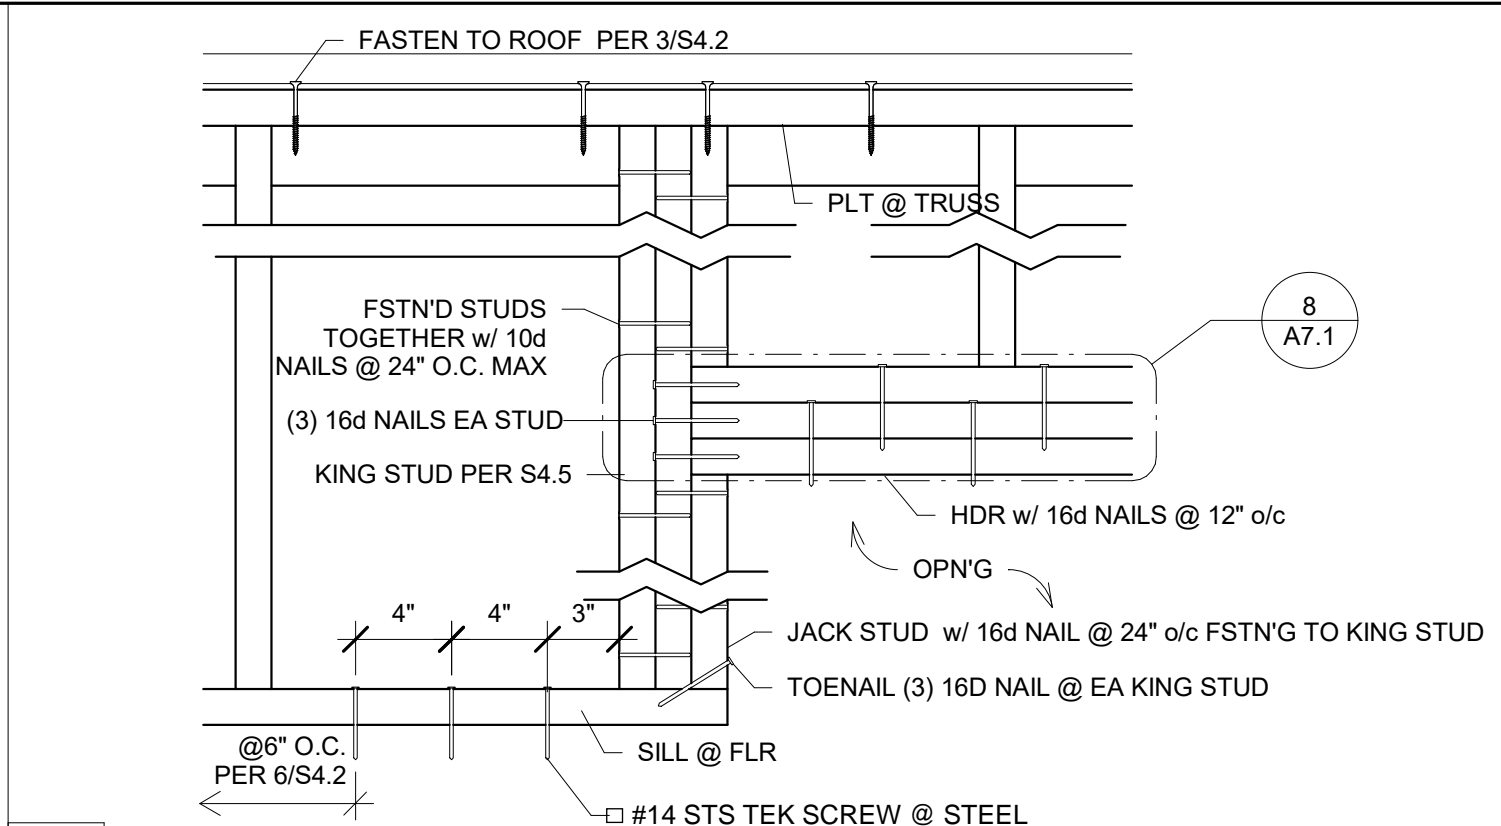


5 1 1/2" = 1'-0"
Elevation - Window/Door Hdr and Sill

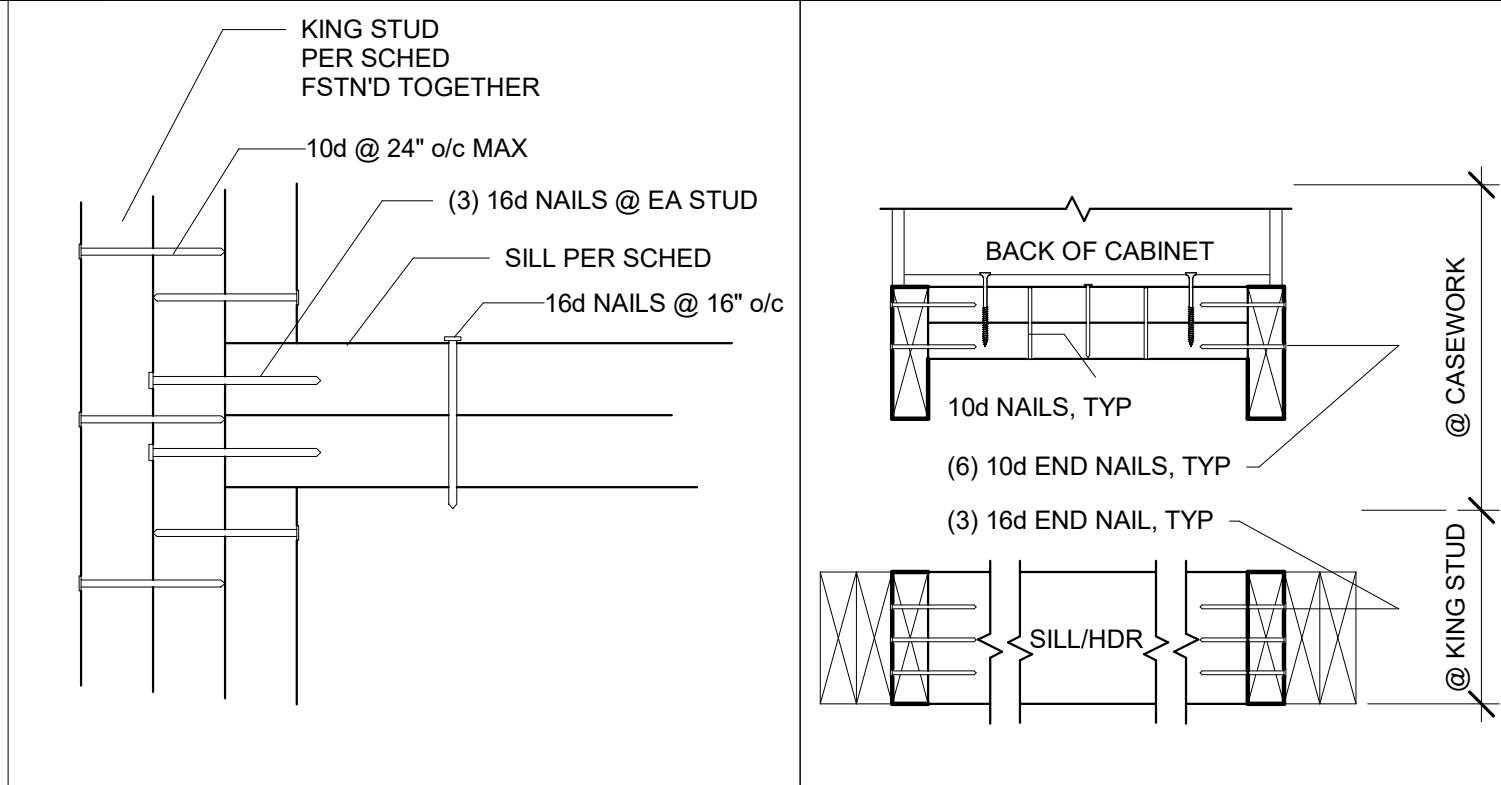


4 3" = 1'-0"
Elevation - Ext Wall Sill @ Window

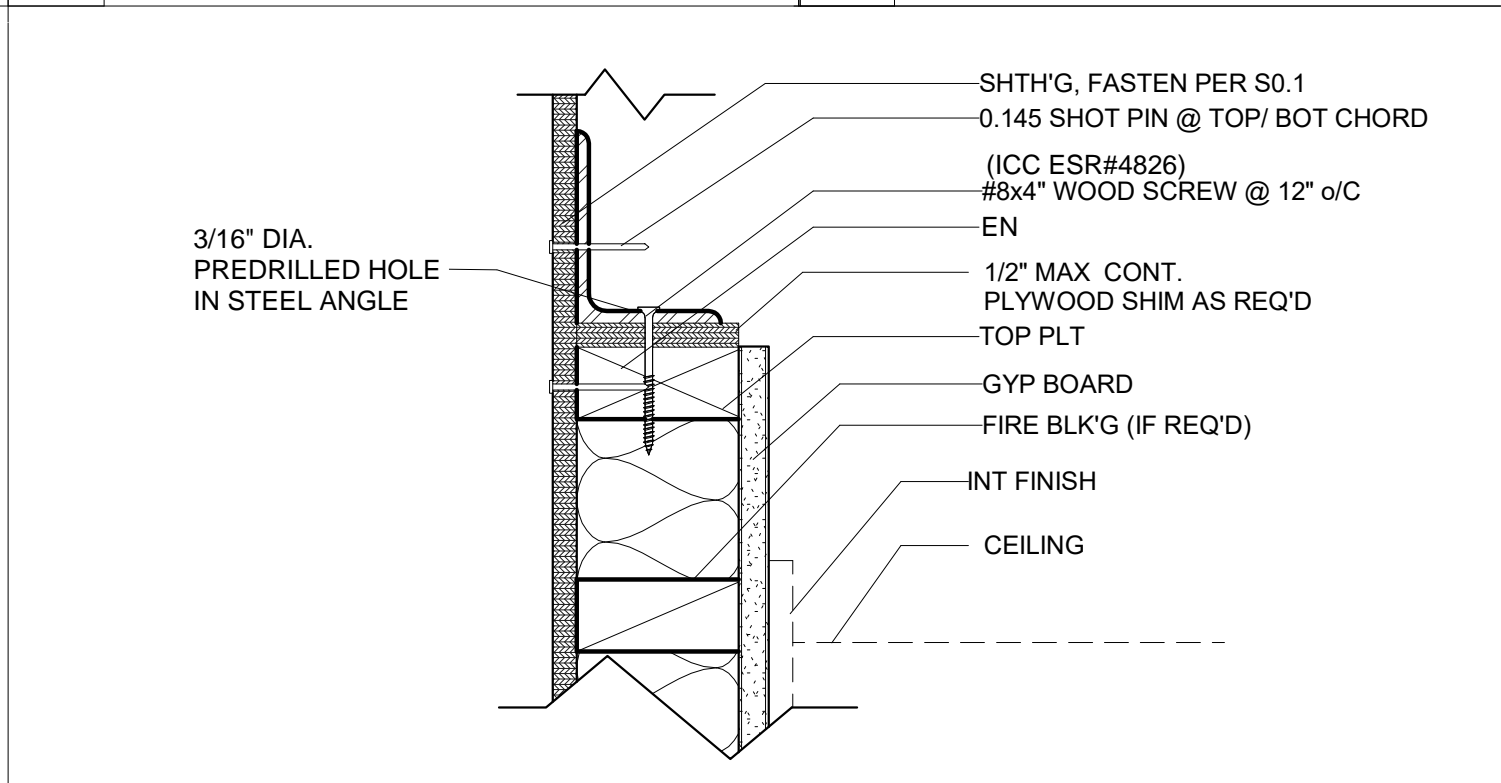

12 1 1/2" = 1'-0"
CASEWORK END NAIL PLAN

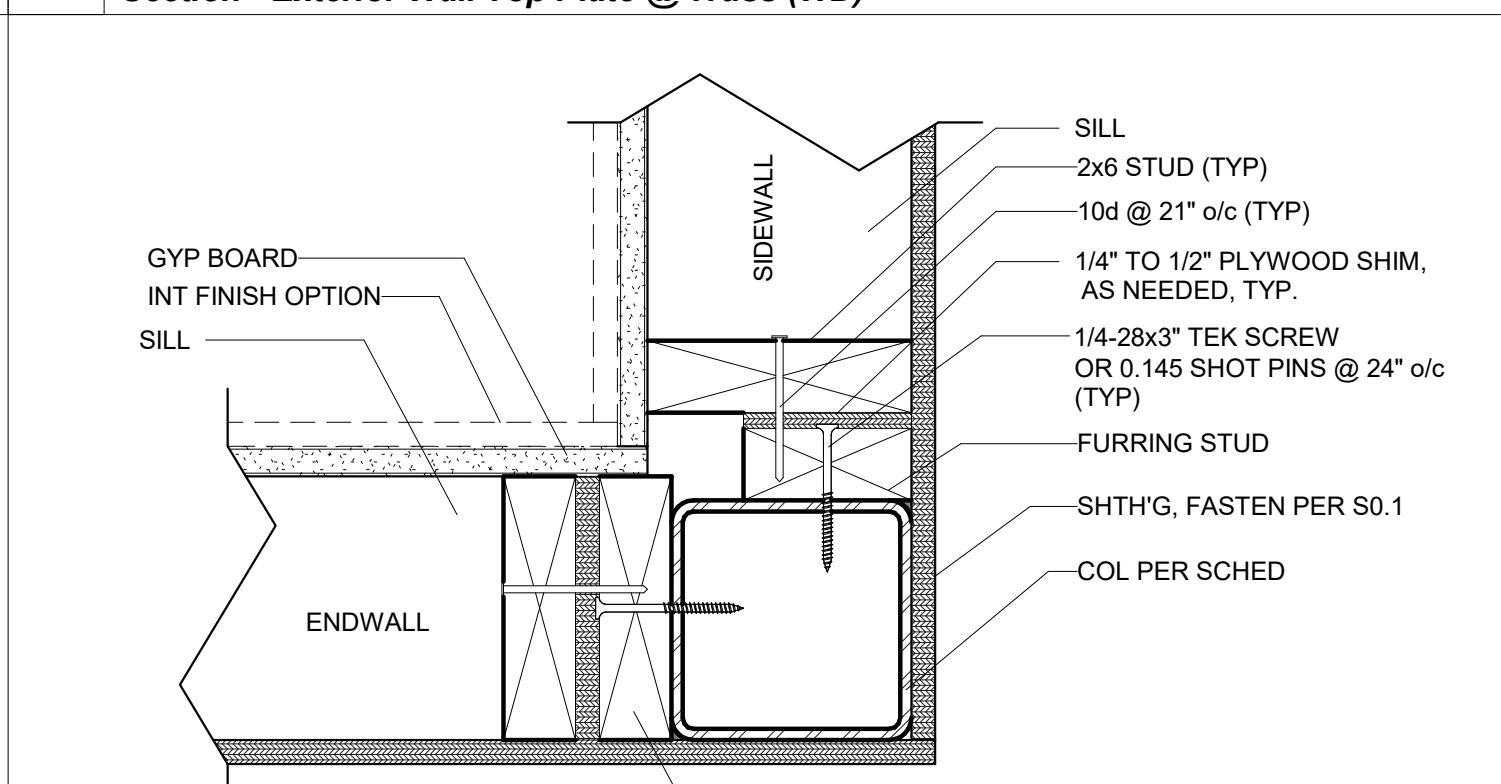



3 3" = 1'-0"
Section - Exterior Wall Top Plate @ Truss (WD)

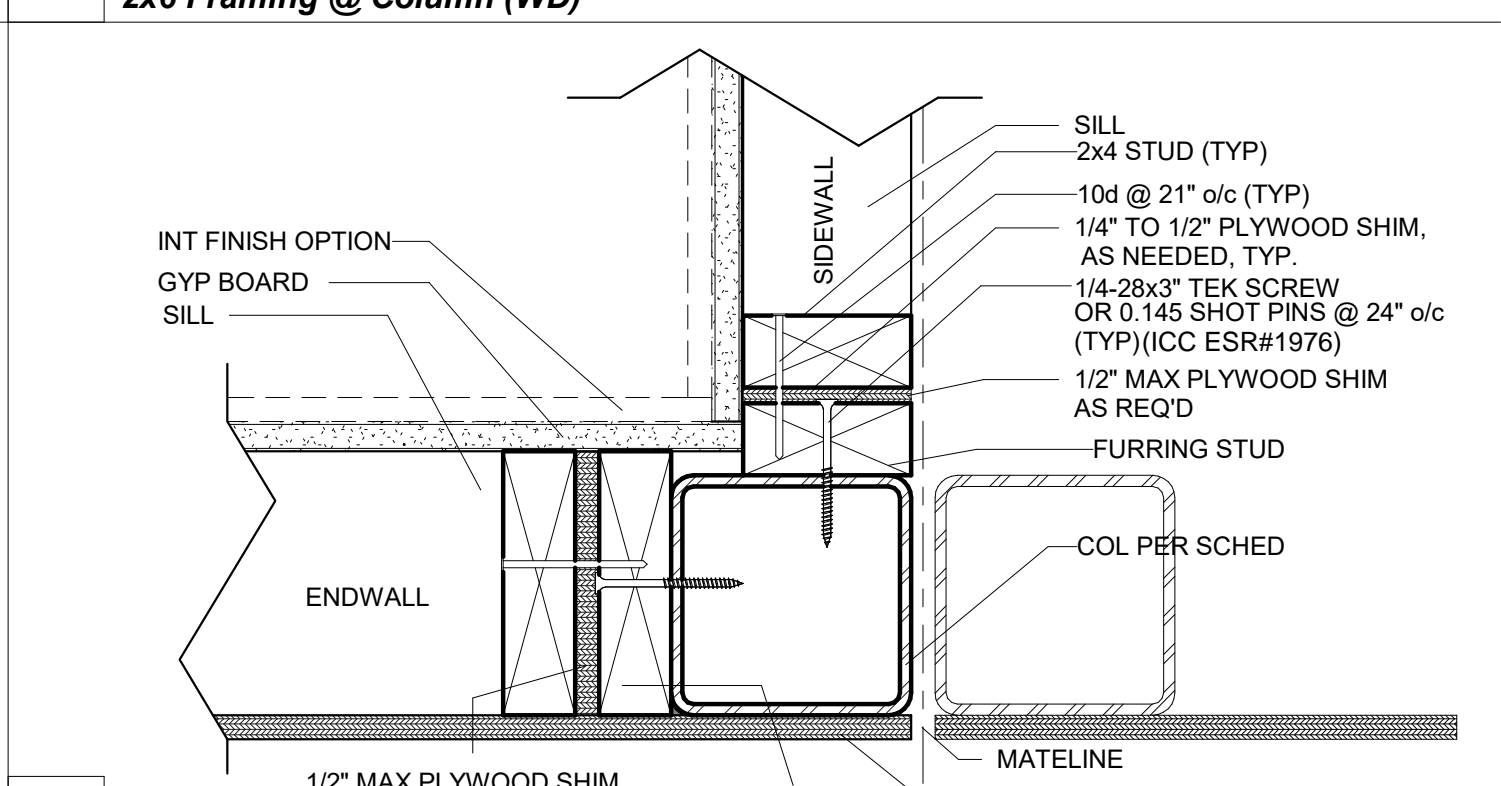


2 3" = 1'-0"
2x6 Framing @ Column (WD)



1 3" = 1'-0"
Interior Sidewall Framing @ Column (WD)

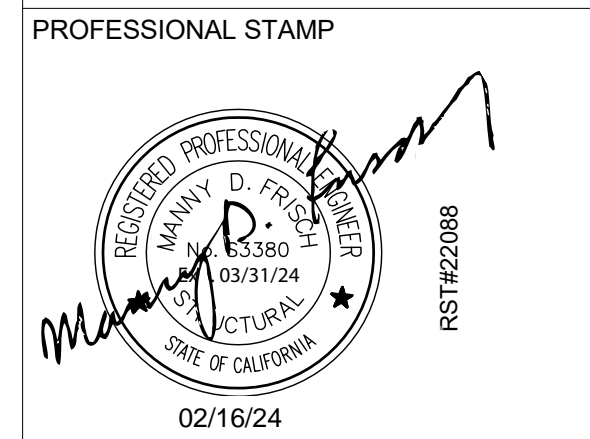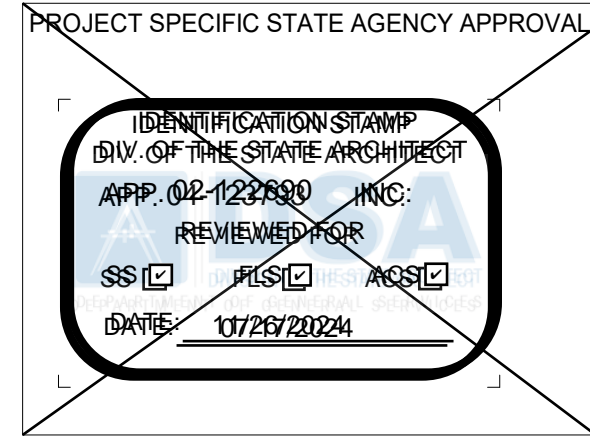

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

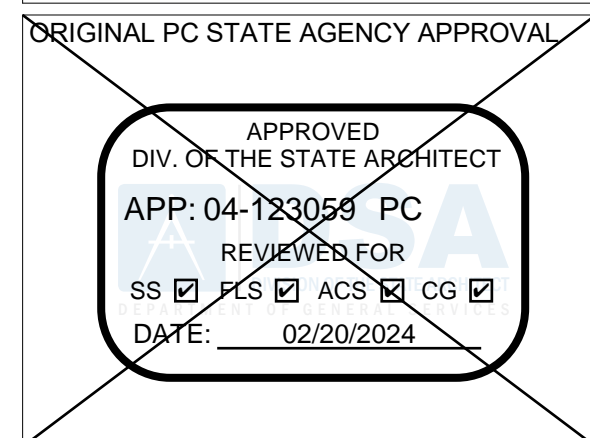

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required

PROJECT TITLE
PC 2022 CBC:24' x 40' EXPANDABLE TO 120' x 40'

SHEET TITLE
WALL DETAILS (WOOD FRAMING)

PROJECT NUMBER
22088





DRAWN BY
rMc/SC

CHECKED BY
JA/RT

DATE

SHEET NO.
S4.2

SHEET OF

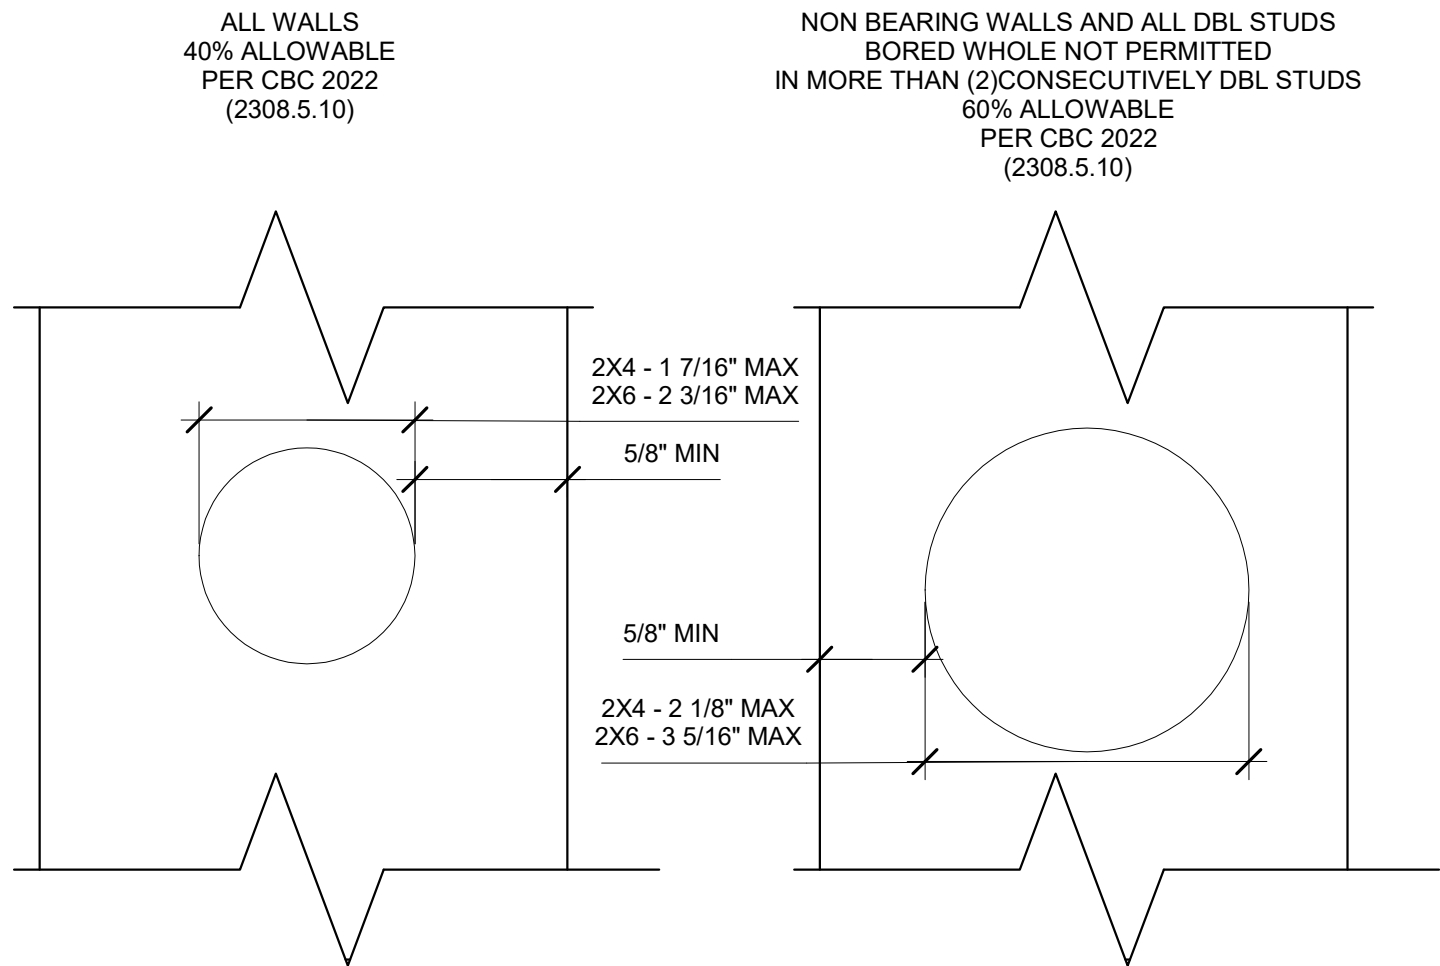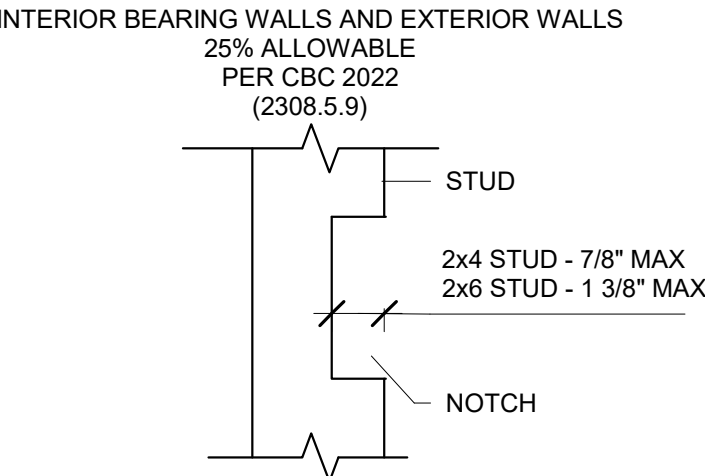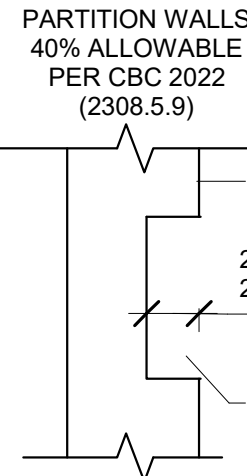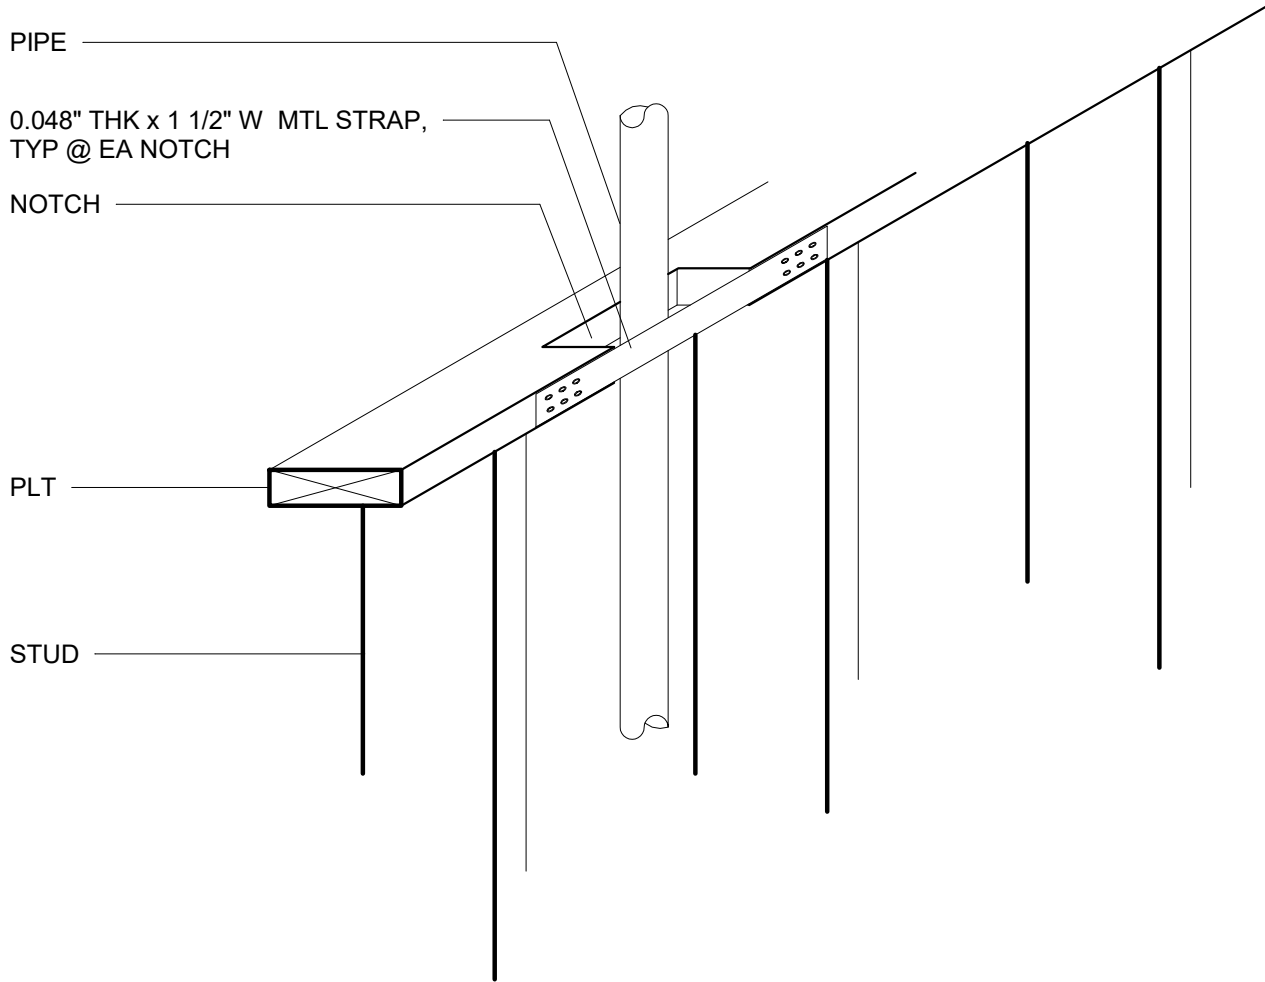

2 1 1/2" = 1'-0"
Plt Notch

1 6" = 1'-0"
Stud Penetration

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP

DIV. OF THE STATE ARCHITECT

APP: 02-122690 INC:

REVIEWED FOR

SS ☐ PLS ☐ ACS ☐

DATE: 07/29/2024

R&S TAVARES ASSOCIATES

DESIGN • CONSULTING • PROJECT MGT

11590 W BERNARDO COURT, SUITE 100

SAN DIEGO, CA 92127

WWW.RSTAVARES.COM

PROFESSIONAL STAMP

REGISTERED PROFESSIONAL ARCHITECT

MANNY D. FRIEDL

63380

03/31/24

STATE OF CALIFORNIA

02/16/24

RST#22088

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT

CL Class Leasing

1651 Juanita Street, San Jacinto, CA 92583

Voice (951) 943-1908 Fax (951) 943-5768

ORIGINAL PC STATE AGENCY APPROVAL

APPROVED

DIV. OF THE STATE ARCHITECT

APP: 04-123058 PC

REVIEWED FOR

SS ☒ PLS ☒ ACS ☒ CG ☒

DATE: 02/20/2024

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE

PC 2022 CBC:24' x 40' EXPANDABLE TO 120' x 40'

SHEET TITLE

TYP FRAMING

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY

JA/RT

DATE

SHEET NO.

S4.4

SHEET OF

2x4 Interior Wall Opening Schedule										
COL HEIGHT	OPN'G SIZE	HDR			SILL			FULL HEIGHT KING STUD		
		Lumber	Number	Type	Lumber	Number	Type	Lumber	Number	Type
9FT	3070	HF / SYP	1	#2	-	-	-	HF	2	#2
		DF / SYP	1	#2	-	-	-	DF	2	#2
	4070	HF / SYP	1	#2	-	-	-	HF	2	#2
		DF / SYP	1	#2	-	-	-	DF	2	#2
	6040	HF / SYP	2	#2	DF	2	#2	HF	2	#2
		DF / SYP	2	#2	DF	2	#2	DF	2	#2
10FT	3070	HF / SYP	1	#2	-	-	-	HF	2	#2
		DF / SYP	1	#2	-	-	-	DF	2	#2
	4070	HF / SYP	1	#2	-	-	-	HF	2	#2
		DF / SYP	1	#2	-	-	-	DF	2	#2
	6040	HF / SYP	2	#2	HF	2	#2	HF	2	#2
		DF / SYP	2	#2	DF	2	#2	DF	2	#2
10FT	8040	HF / SYP	3	#2	HF	3	#2	HF	2	#2
		DF / SYP	3	#2	DF	3	#2	DF	2	#2
	3070	HF / SYP	1	#2	-	-	-	HF	2	#2
		DF / SYP	1	#2	-	-	-	DF	2	#2
	4070	HF / SYP	1	#2	-	-	-	HF	2	#2
		DF / SYP	1	#2	-	-	-	DF	2	#2
10FT	6040	HF / SYP	2	#2	HF	2	#2	HF	2	#2
		DF / SYP	2	#2	DF	2	#2	DF	2	#2
	8040	HF / SYP	3	#2	HF	3	#2	HF	2	#2
		DF / SYP	3	#2	DF	3	#2	DF	2	#2
	3070	HF / SYP	1	#2	-	-	-	HF	2	#2
		DF / SYP	1	#2	-	-	-	DF	2	#2

2x4 Interior Wall Framing Schedule								
COL HEIGHT	Typical Location				4ft From Building Corner			
	Lumber	Number	Type	Spacing	Lumber	Number	Type	Spacing
9	HF	1	#2	16" O.C.	-	-	-	-
	DF	1	#2	16" O.C.	-	-	-	-
10	HF	1	#2	16" O.C.	-	-	-	-
	DF	1	#2	16" O.C.	-	-	-	-

2x6 Exterior Wall Opening Schedule (SHTH'G FINISH)										
COL HEIGHT	OPN'G SIZE	HDR			SILL			FULL HEIGHT KING STUD		
		Lumber	Number	Type	Lumber	Number	Type	Lumber	Number	Type
9FT	3070	HF / SYP	1	#2	HF	1	#2	HF	1	#2
		DF / SYP	1	#2	DF	1	#2	DF	1	#2
	4070	HF / SYP	1	#2	HF	1	#2	HF	1	#2
		DF / SYP	1	#2	DF	1	#2	DF	1	#2
	6040	HF / SYP	1	#2	HF	1	#2	HF	1	#2
		DF / SYP	1	#2	DF	1	#2	DF	1	#2
10FT	3070	HF / SYP	1	#2	HF	1	#2	HF	1	#2
		DF / SYP	1	#2	DF	1	#2	DF	1	#2
	4070	HF / SYP	1	#2	HF	1	#2	HF	1	#2
		DF / SYP	1	#2	DF	1	#2	DF	1	#2
	6040	HF / SYP	1	#2	HF	1	#2	HF	2	#2
		DF / SYP	1	#2	DF	1	#2	DF	2	#2
10FT	8040	HF / SYP	1	#2	HF	1	#2	HF	2	#2
		DF / SYP	1	#2	DF	1	#2	DF	2	#2
	3070	HF / SYP	1	#2	HF	1	#2	HF	1	#2
		DF / SYP	1	#2	DF	1	#2	DF	1	#2
	4070	HF / SYP	1	#2	HF	1	#2	HF	1	#2
		DF / SYP	1	#2	DF	1	#2	DF	1	#2
10FT	6040	HF / SYP	1	#2	HF	1	#2	HF	2	#2
		DF / SYP	1	#2	DF	1	#2	DF	2	#2
	8040	HF / SYP	1	#2	HF	1	#2	HF	2	#2
		DF / SYP	1	#2	DF	1	#2	DF	2	#2
	3070	HF / SYP	1	#2	HF	1	#2	HF	1	#2
		DF / SYP	1	#2	DF	1	#2	DF	1	#2

2x6 Exterior Wall Framing Schedule (SHTH'G FINISH)								
COL HEIGHT	Typical Location				4ft From Building Corner			
	Lumber	Number	Type	Spacing	Lumber	Number	Type	Spacing
9	HF	1	#2	16" O.C.	HF	1	#2	16" O.C.
	DF	1	#2	16" O.C.	DF	1	#2	16" O.C.
10	HF	1	#2	16" O.C.	HF	1	#2	16" O.C.
	DF	1	#2	16" O.C.	DF	1	#2	16" O.C.

2x6 Exterior Wall Opening Schedule (PLASTER FINISH)										
COL HEIGHT	OPN'G SIZE	HDR			SILL			FULL HEIGHT KING STUD		
		Lumber	Number	Type	Lumber	Number	Type	Lumber	Number	Type
9FT	3070	HF	1	#2	HF	1	#2	HF	1	#2
		DF	1	#2	DF	1	#2	DF	1	#2
	4070	HF	1	#2	HF	1	#2	HF	1	#2
		DF	1	#2	DF	1	#2	DF	1	#2
	6040	HF	1	#2	HF	1	#2	HF	2	#2
		DF	1	#2	DF	1	#2	DF	1	#2
10FT	3070	HF	1	#2	HF	1	#2	HF	2	#2
		DF	1	#2	DF	1	#2	DF	1	#2
	4070	HF	1	#2	HF	1	#2	HF	2	#2
		DF	1	#2	DF	1	#2	DF	1	#2
	6040	HF	1	#2	HF	1	#2	HF	2	#2
		DF	1	#2	DF	1	#2	DF	2	#2
10FT	8040	HF	2	#2	HF	1	#2	HF	3	#2
		DF	1	#2	DF	1	#2	DF	2	#2
	3070	HF	1	#2	HF	1	#2	HF	2	#2
		DF	1	#2	DF	1	#2	DF	1	#2
	4070	HF	1	#2	HF	1	#2	HF	2	#2
		DF	1	#2	DF	1	#2	DF	1	#2
10FT	6040	HF	1	#2	HF	1	#2	HF	2	#2
		DF	1	#2	DF	1	#2	DF	2	#2
	8040	HF	2	#2	HF	1	#2	HF	3	#2
		DF	1	#2	DF	1	#2	DF	2	#2
	3070	HF	1	#2	HF	1	#2	HF	2	#2
		DF	1	#2	DF	1	#2	DF	2	#2

2x6 Exterior Wall Framing Schedule (PLASTER FINISH)								
COL HEIGHT	Typical Location				4ft From Building Corner			
	Lumber	Number	Type	Spacing	Lumber	Number	Type	Spacing
9	HF	1	#2	16" O.C.	HF	1	#2	16" O.C.
	DF	1	#2	16" O.C.	DF	1	#2	16" O.C.
10	HF	1	#2	16" O.C.	HF	1	#2	16" O.C.
	DF	1	#2	16" O.C.	DF	1	#2	16" O.C.

NOTE: SEE DETAIL 1 ON SHEETS A2.1- A2.6

PROJECT SPECIFIC STATE AGENCY APPROVAL

IDENTIFICATION STAMP

DIV. OF THE STATE ARCHITECT

APP: 02-122690 INC:

REVIEWED FOR

SS ☐ PLS ☐ ACS ☐ CG ☐

DATE: 07/29/2024

R&S TAVARES ASSOCIATES

DESIGN & CONSULTING PROJECT MEET

11590 W BERNARDO COURT, SUITE 100

SAN DIEGO, CA 92127

WWW.RSTAVARES.COM

PROFESSIONAL STAMP

REGISTERED PROFESSIONAL ARCHITECT

MANNY D. FROST

03380

03/31/24

STATE OF CALIFORNIA

RST#A2208

02/16/24

THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT

Class Leasing

1651 Juanita Street, San Jacinto, CA 92583

Voice (951) 943-1908 Fax (951) 943-5788

ORIGINAL PC STATE AGENCY APPROVAL

APPROVED

DIV. OF THE STATE ARCHITECT

APP: 04-123058 PC

REVIEWED FOR

SS ☒ PLS ☒ ACS ☒ CG ☒

DATE: 02/20/2024

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE

PC 2022 CBC:24' x 40'

EXPANDABLE TO

120' x 40'

SHEET TITLE

FRAMING SCHEDULES

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY

JA/RT

DATE

SHEET NO.


S4.5

SHEET OF


C:\Users\User\Documents\RS#20132 - Class Leasing, PC 24x40 to 120x40 HS, detached, CESAR24D83.rvt

6/6/2021 1:53:08 AM


1 1" = 1'-0"
Structural Section (MONO)

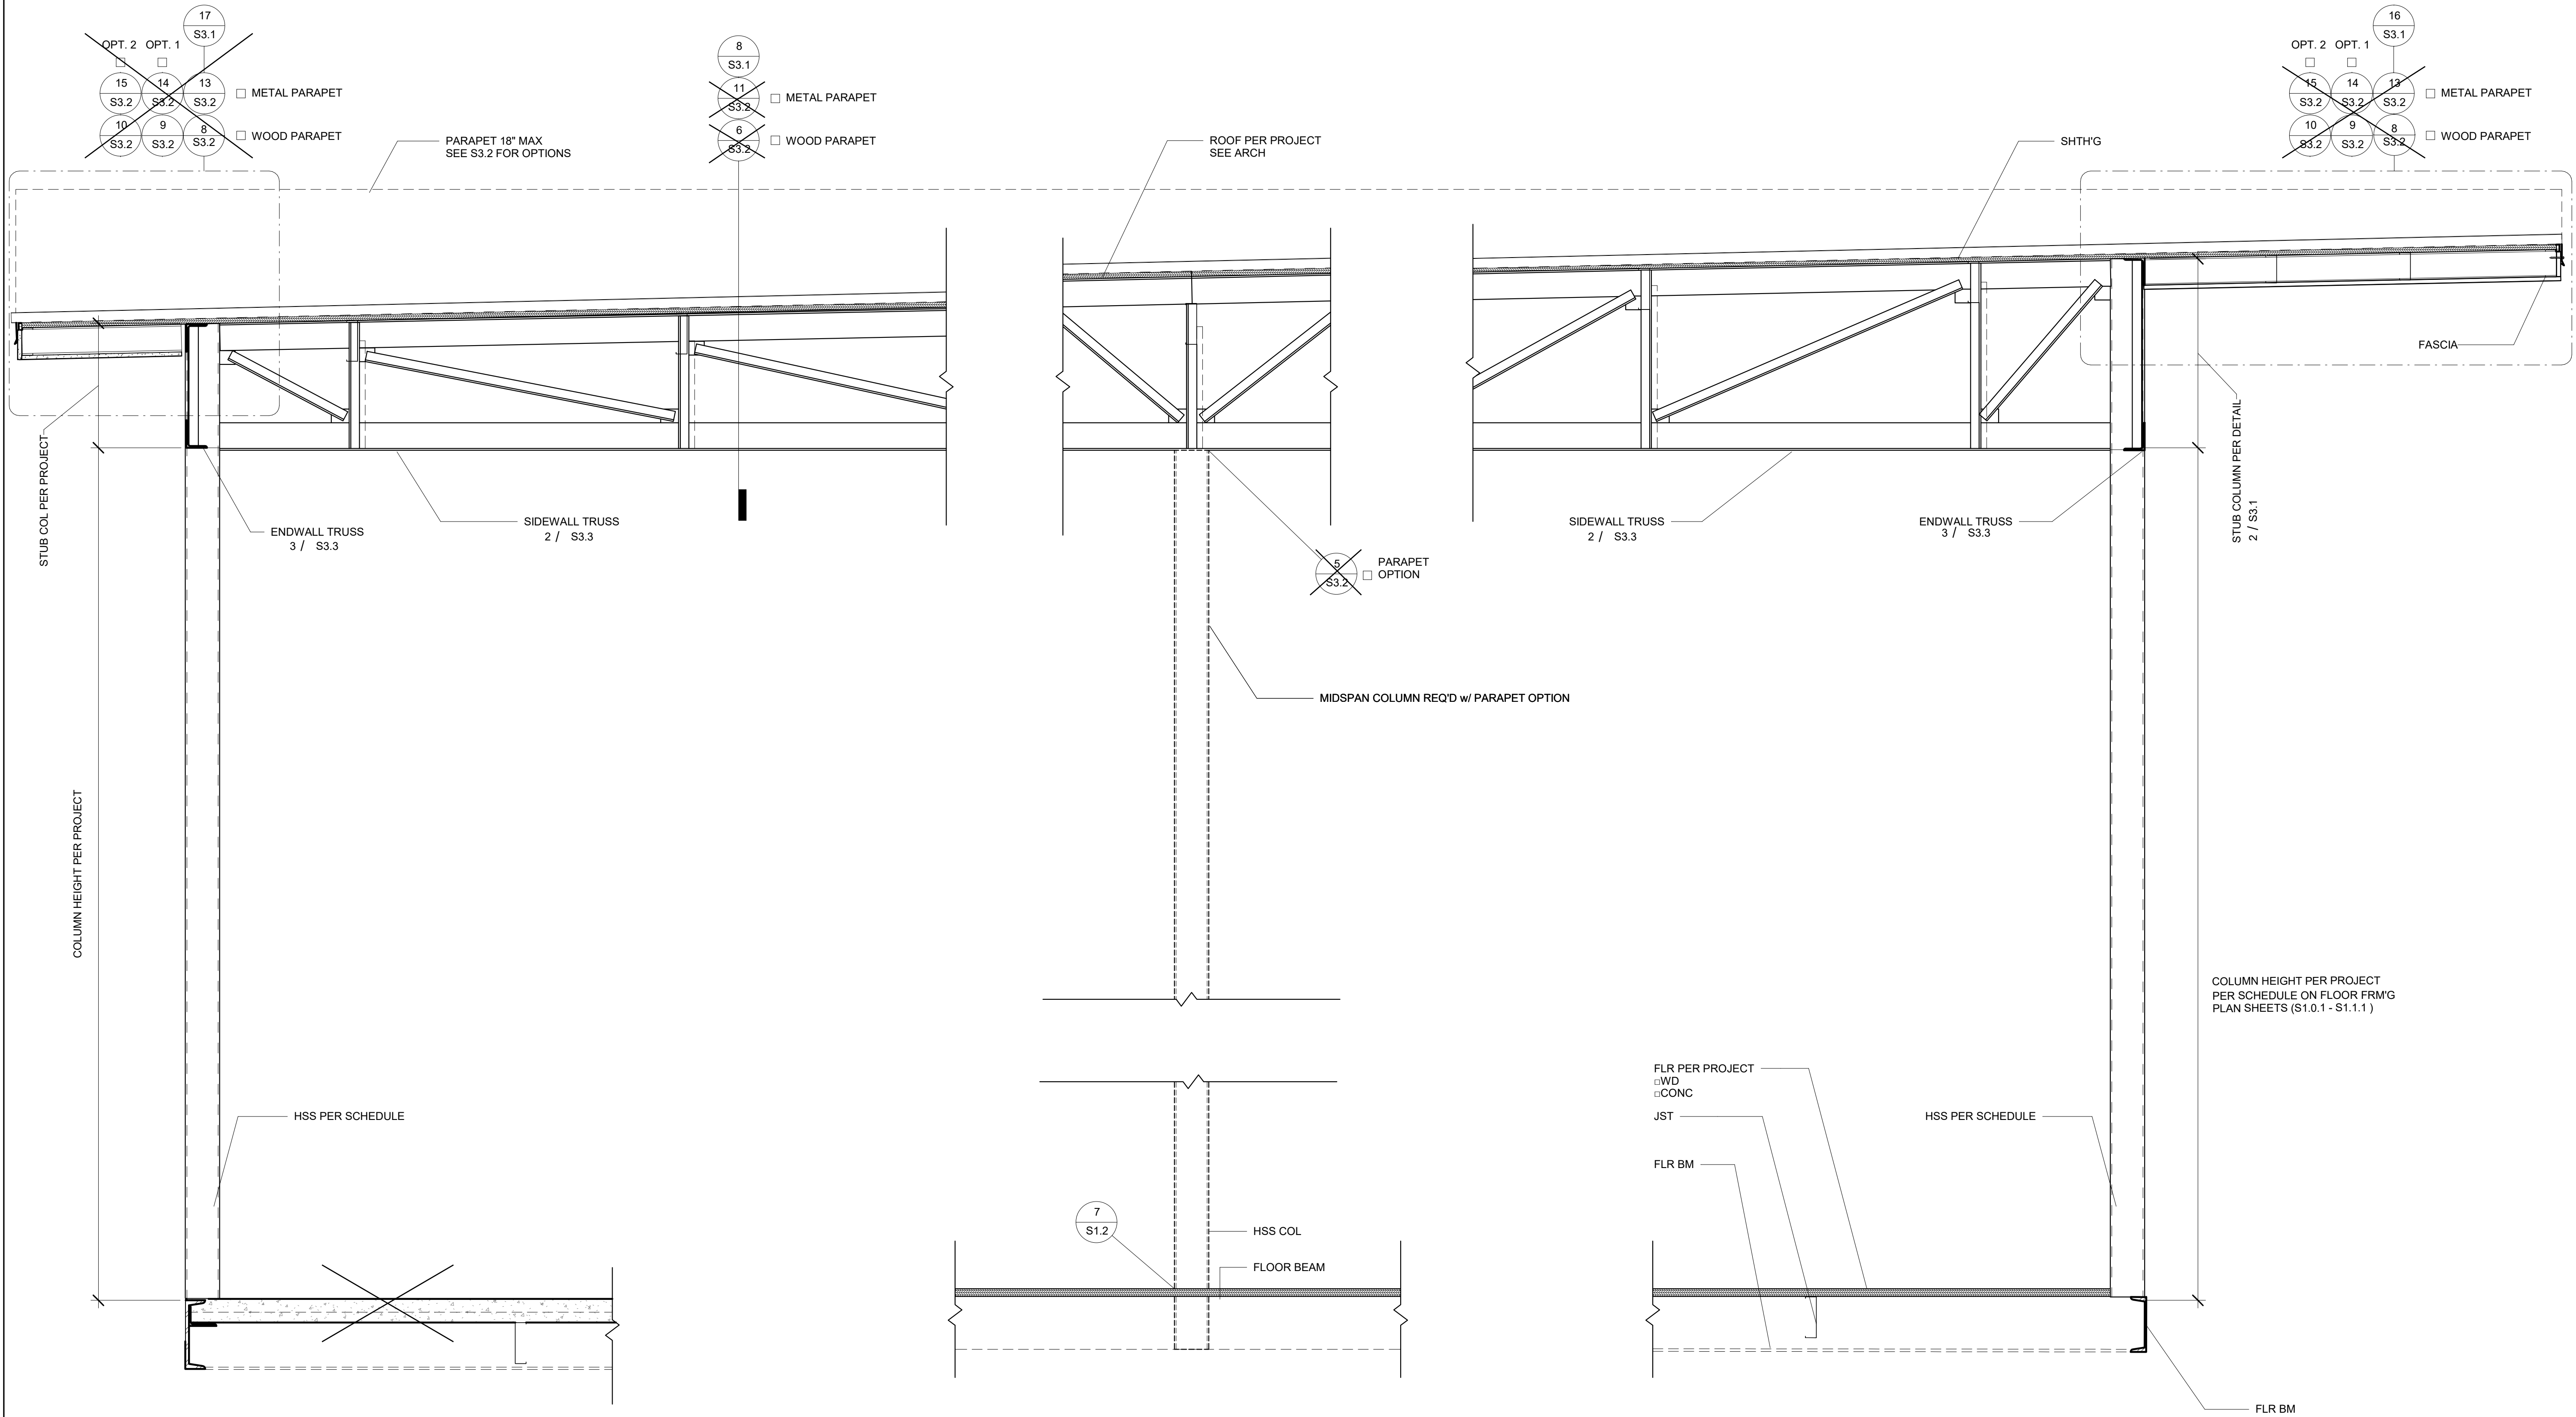

PROJECT SPECIFIC STATE AGENCY APPROVAL

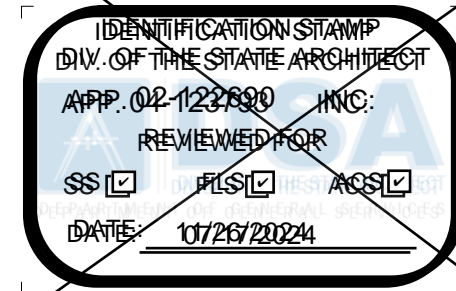

PROFESSIONAL STAMP

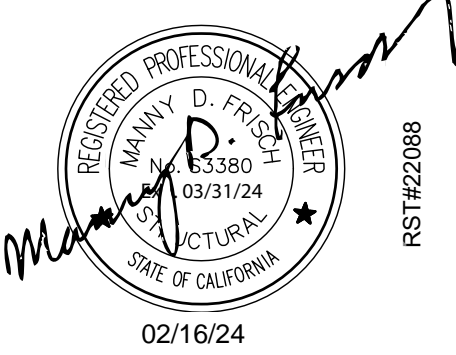


THE PLANS, IDEAS & DESIGNS SHOWN ON THESE DRAWINGS ARE THE PROPERTY OF R&S TAVARES ASSOCIATES, INC. DEvised SOLELY FOR THIS CONTRACT. THESE PLANS SHALL NOT BE USED, IN WHOLE OR IN PART, FOR ANY PURPOSE FOR WHICH THEY WERE NOT INTENDED WITHOUT THE EXPRESS WRITTEN CONSENT OF R&S TAVARES ASSOCIATES, INC. ©

CLIENT



ORIGINAL PC STATE AGENCY APPROVAL

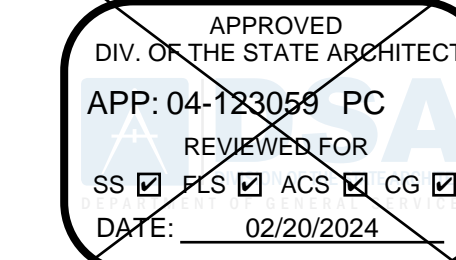

Revision Schedule

#	Description	Date
---	-------------	------

PRE-CHECK (PC) DOCUMENT

Code: 2022 CBC

A separate project application for construction is required

PROJECT TITLE

PC 2022 CBC:24' x 40'
EXPANDABLE TO
120' x 40'

SHEET TITLE

LONG. SECTION -
(MONO)

PROJECT NUMBER

22088

DRAWN BY

rMc/SC

CHECKED BY


JA/RT

DATE

SHEET NO.

S5.0

SHEET OF

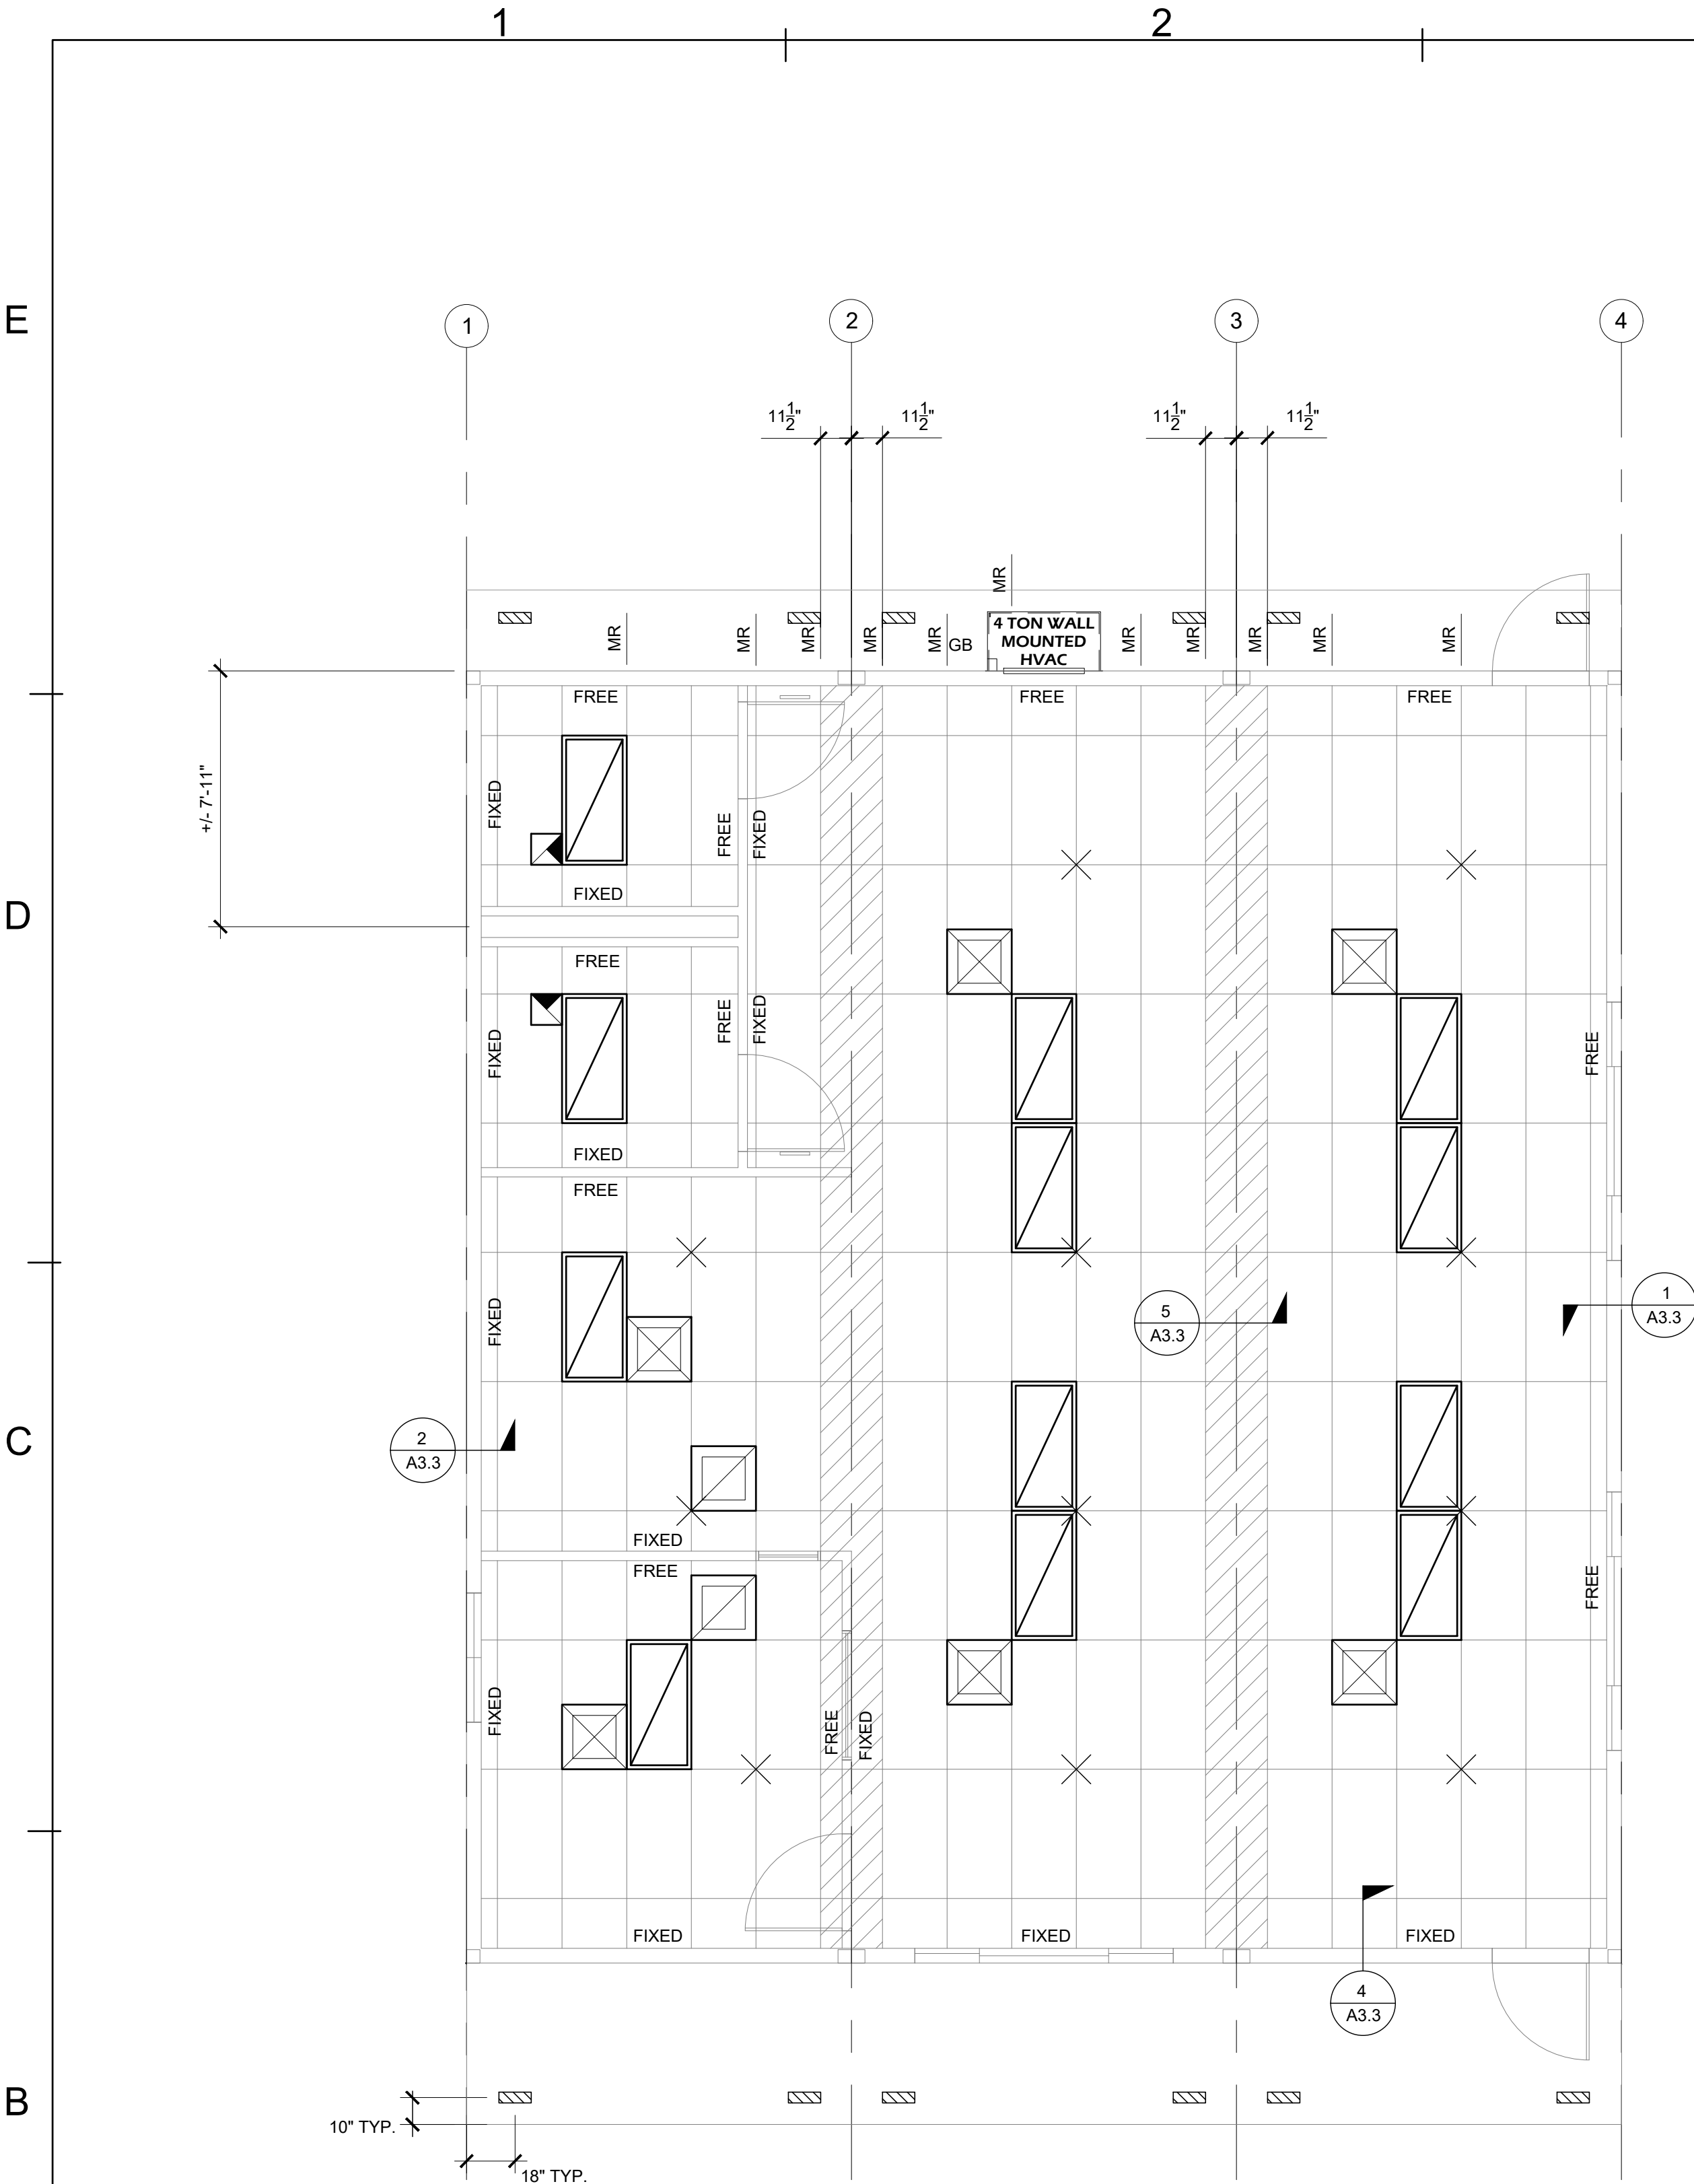

RCP LEGEND			
	8'-6" T-GRID CLG		RECESSED LIGHT FIXTURE 2'x4'
	MR MAIN RUNNERS		SINGLE OCC. 1 LIGHT FIXTURE = 32 SYSTEM WATTS (3)32 SYSTEM WATTS X .80 = 25.6 25.6 / 68 S.F. ROOM = 38 LUMINAIRE WATTS/SF
	4'x12" SOFTFIT VENTS		SPLAY WIRE / STRUT TIE


REF.: DSA A# - }

REFLECTED CEILING PLAN

SCALE: 1/4" = 1'-0"

2

REF.: DSA A# - }

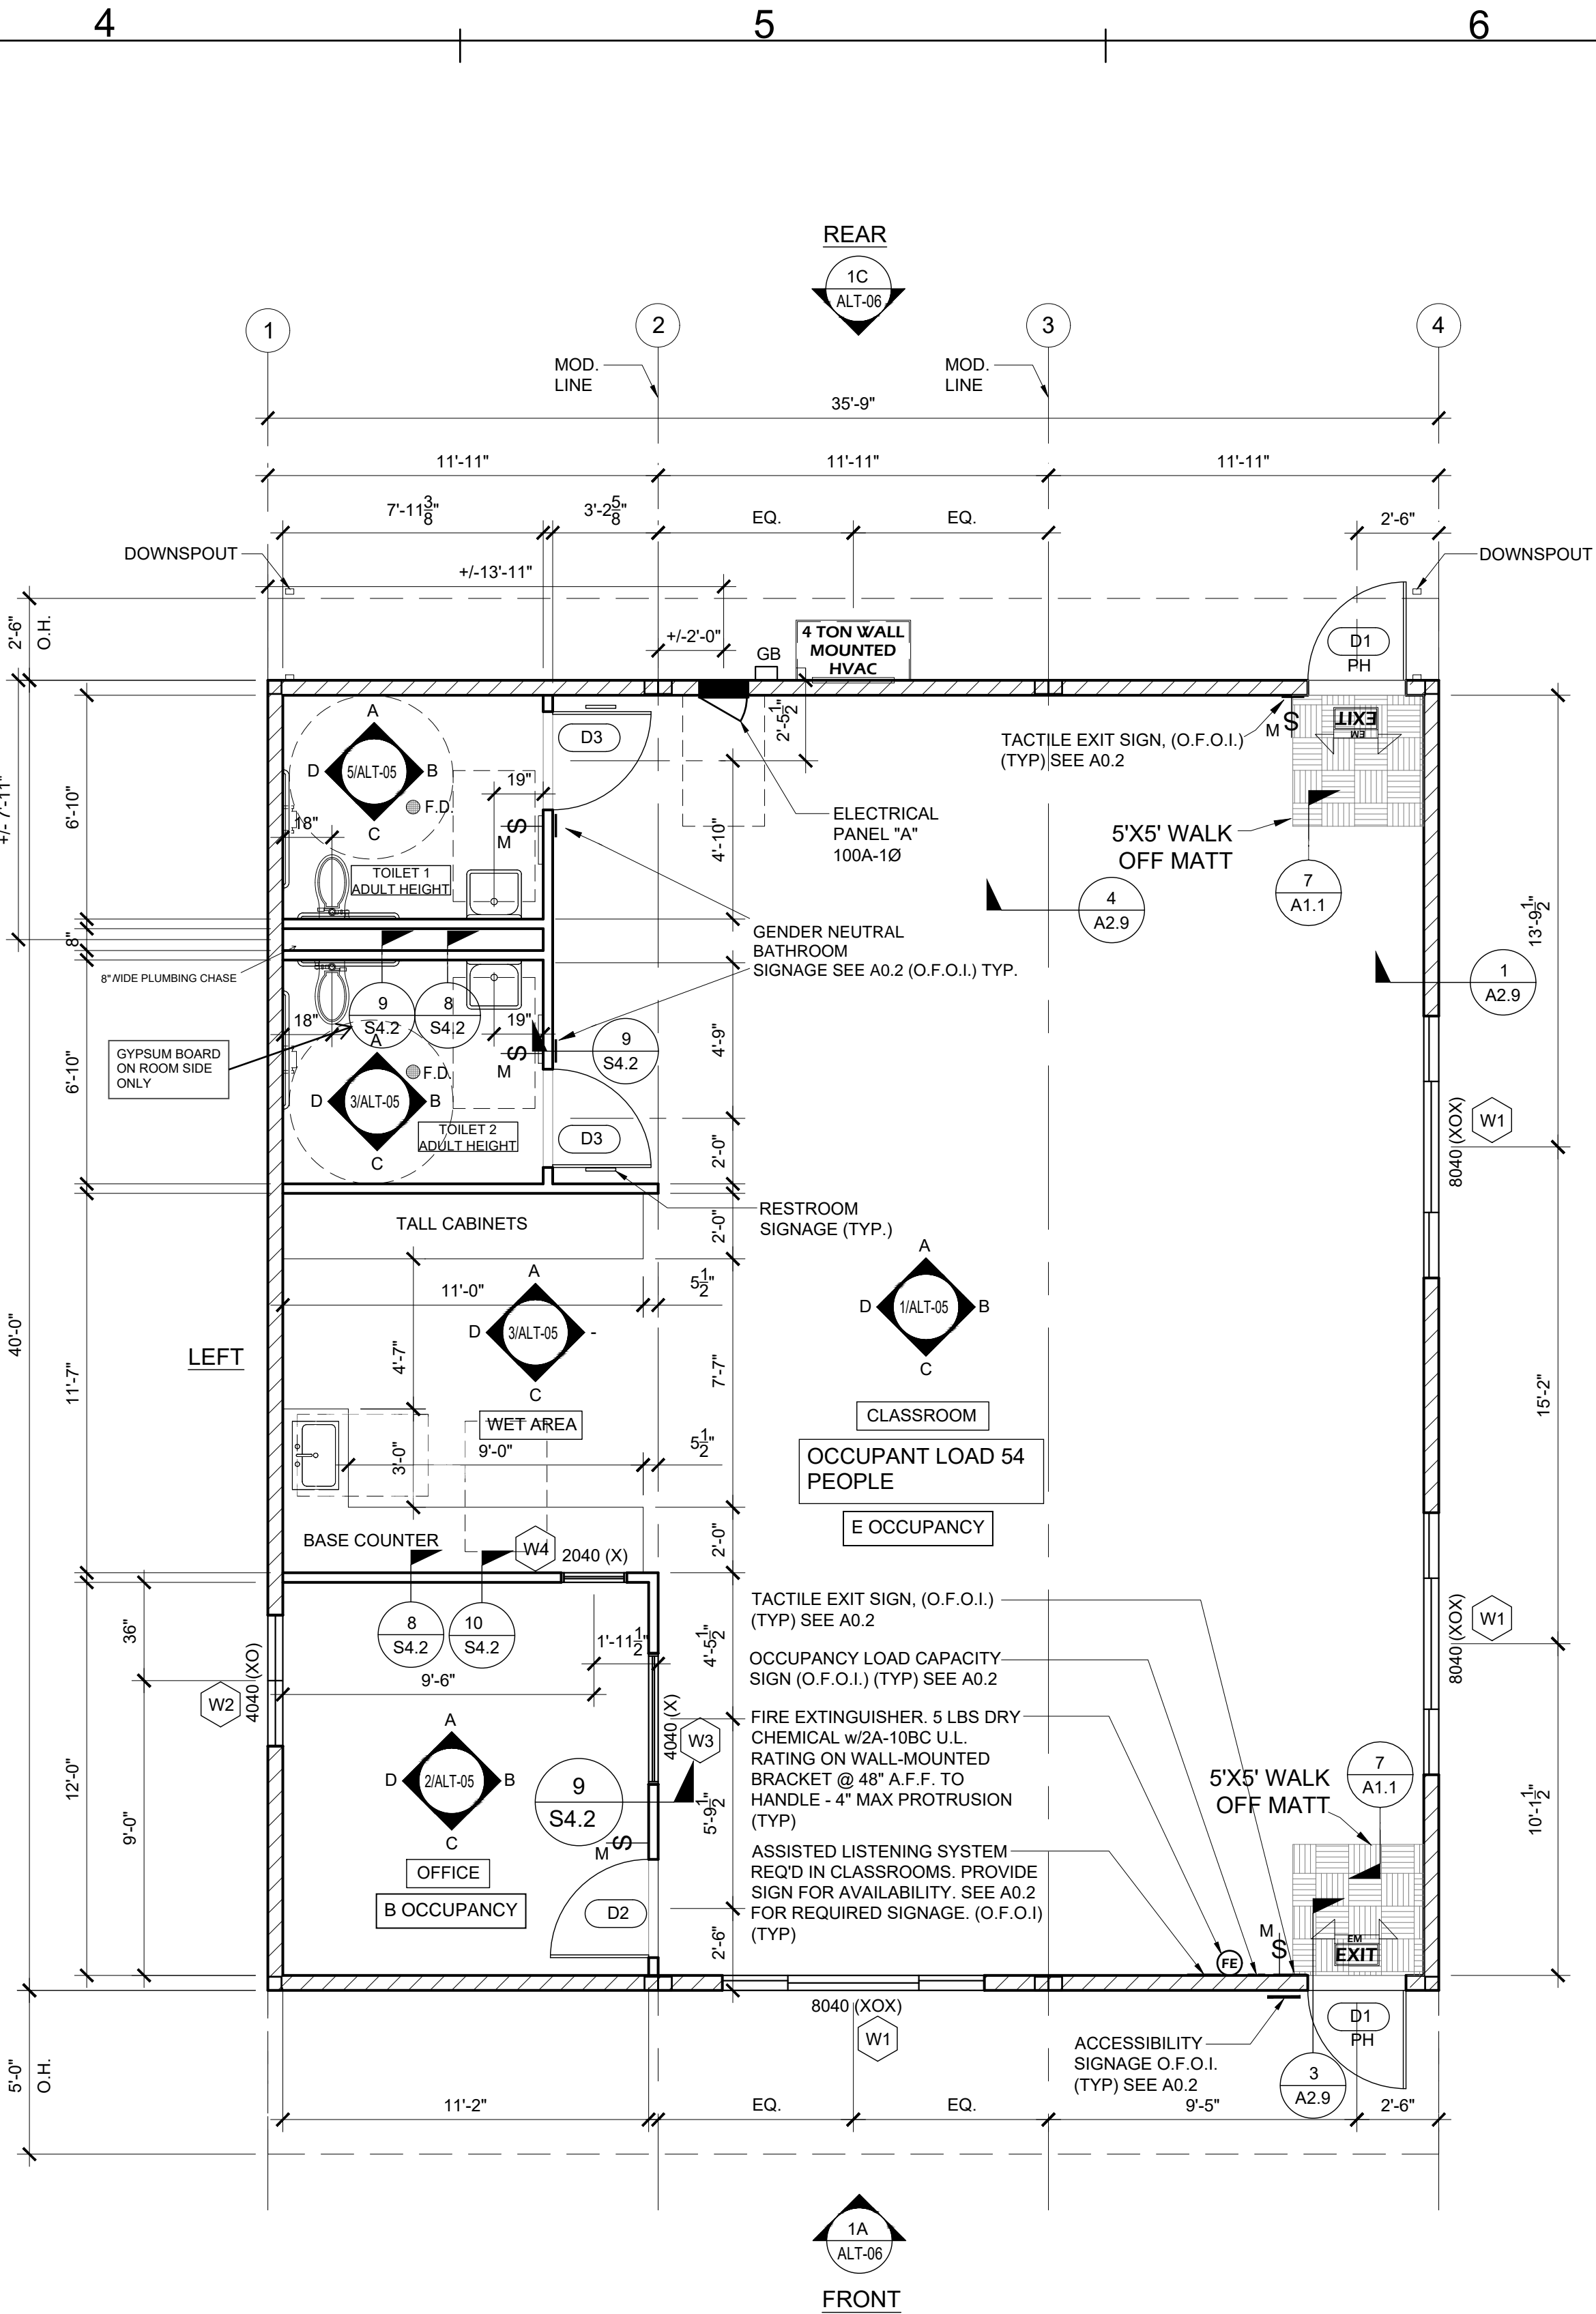


WALL LEGEND	
	2X6 EXTERIOR WALL SEE ALT-D1 FOR INSULATION INFO
	2X4 INTERIOR WALL SEE ALT-D1 FOR INSULATION INFO
DETAIL LEGEND	
	WINDOW REFERENCE - SEE ALT-D1
	DOOR REFERENCE - SEE ALT-D1

NOTES

- DIMENSIONS SHOWN ARE TO FACE OF STUD TYPICAL U.N.O.)
- ML - MODLINE
- FOS - FACE OF STEEL



ENGINEER

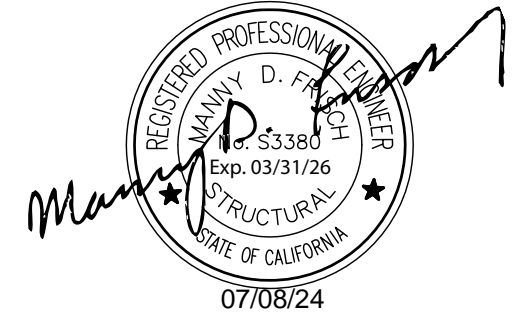

AOR

STOCKTON USD
36x40 CLASSROOM BUILDING

SHEET TITLE:
FLOOR PLAN & REFLECTED
CEILING PLAN

DATE: 06-27-24


DRAWN BY: -

SCALE: AS SHOWN

JOB: -

SHEET NO:


ALT-01

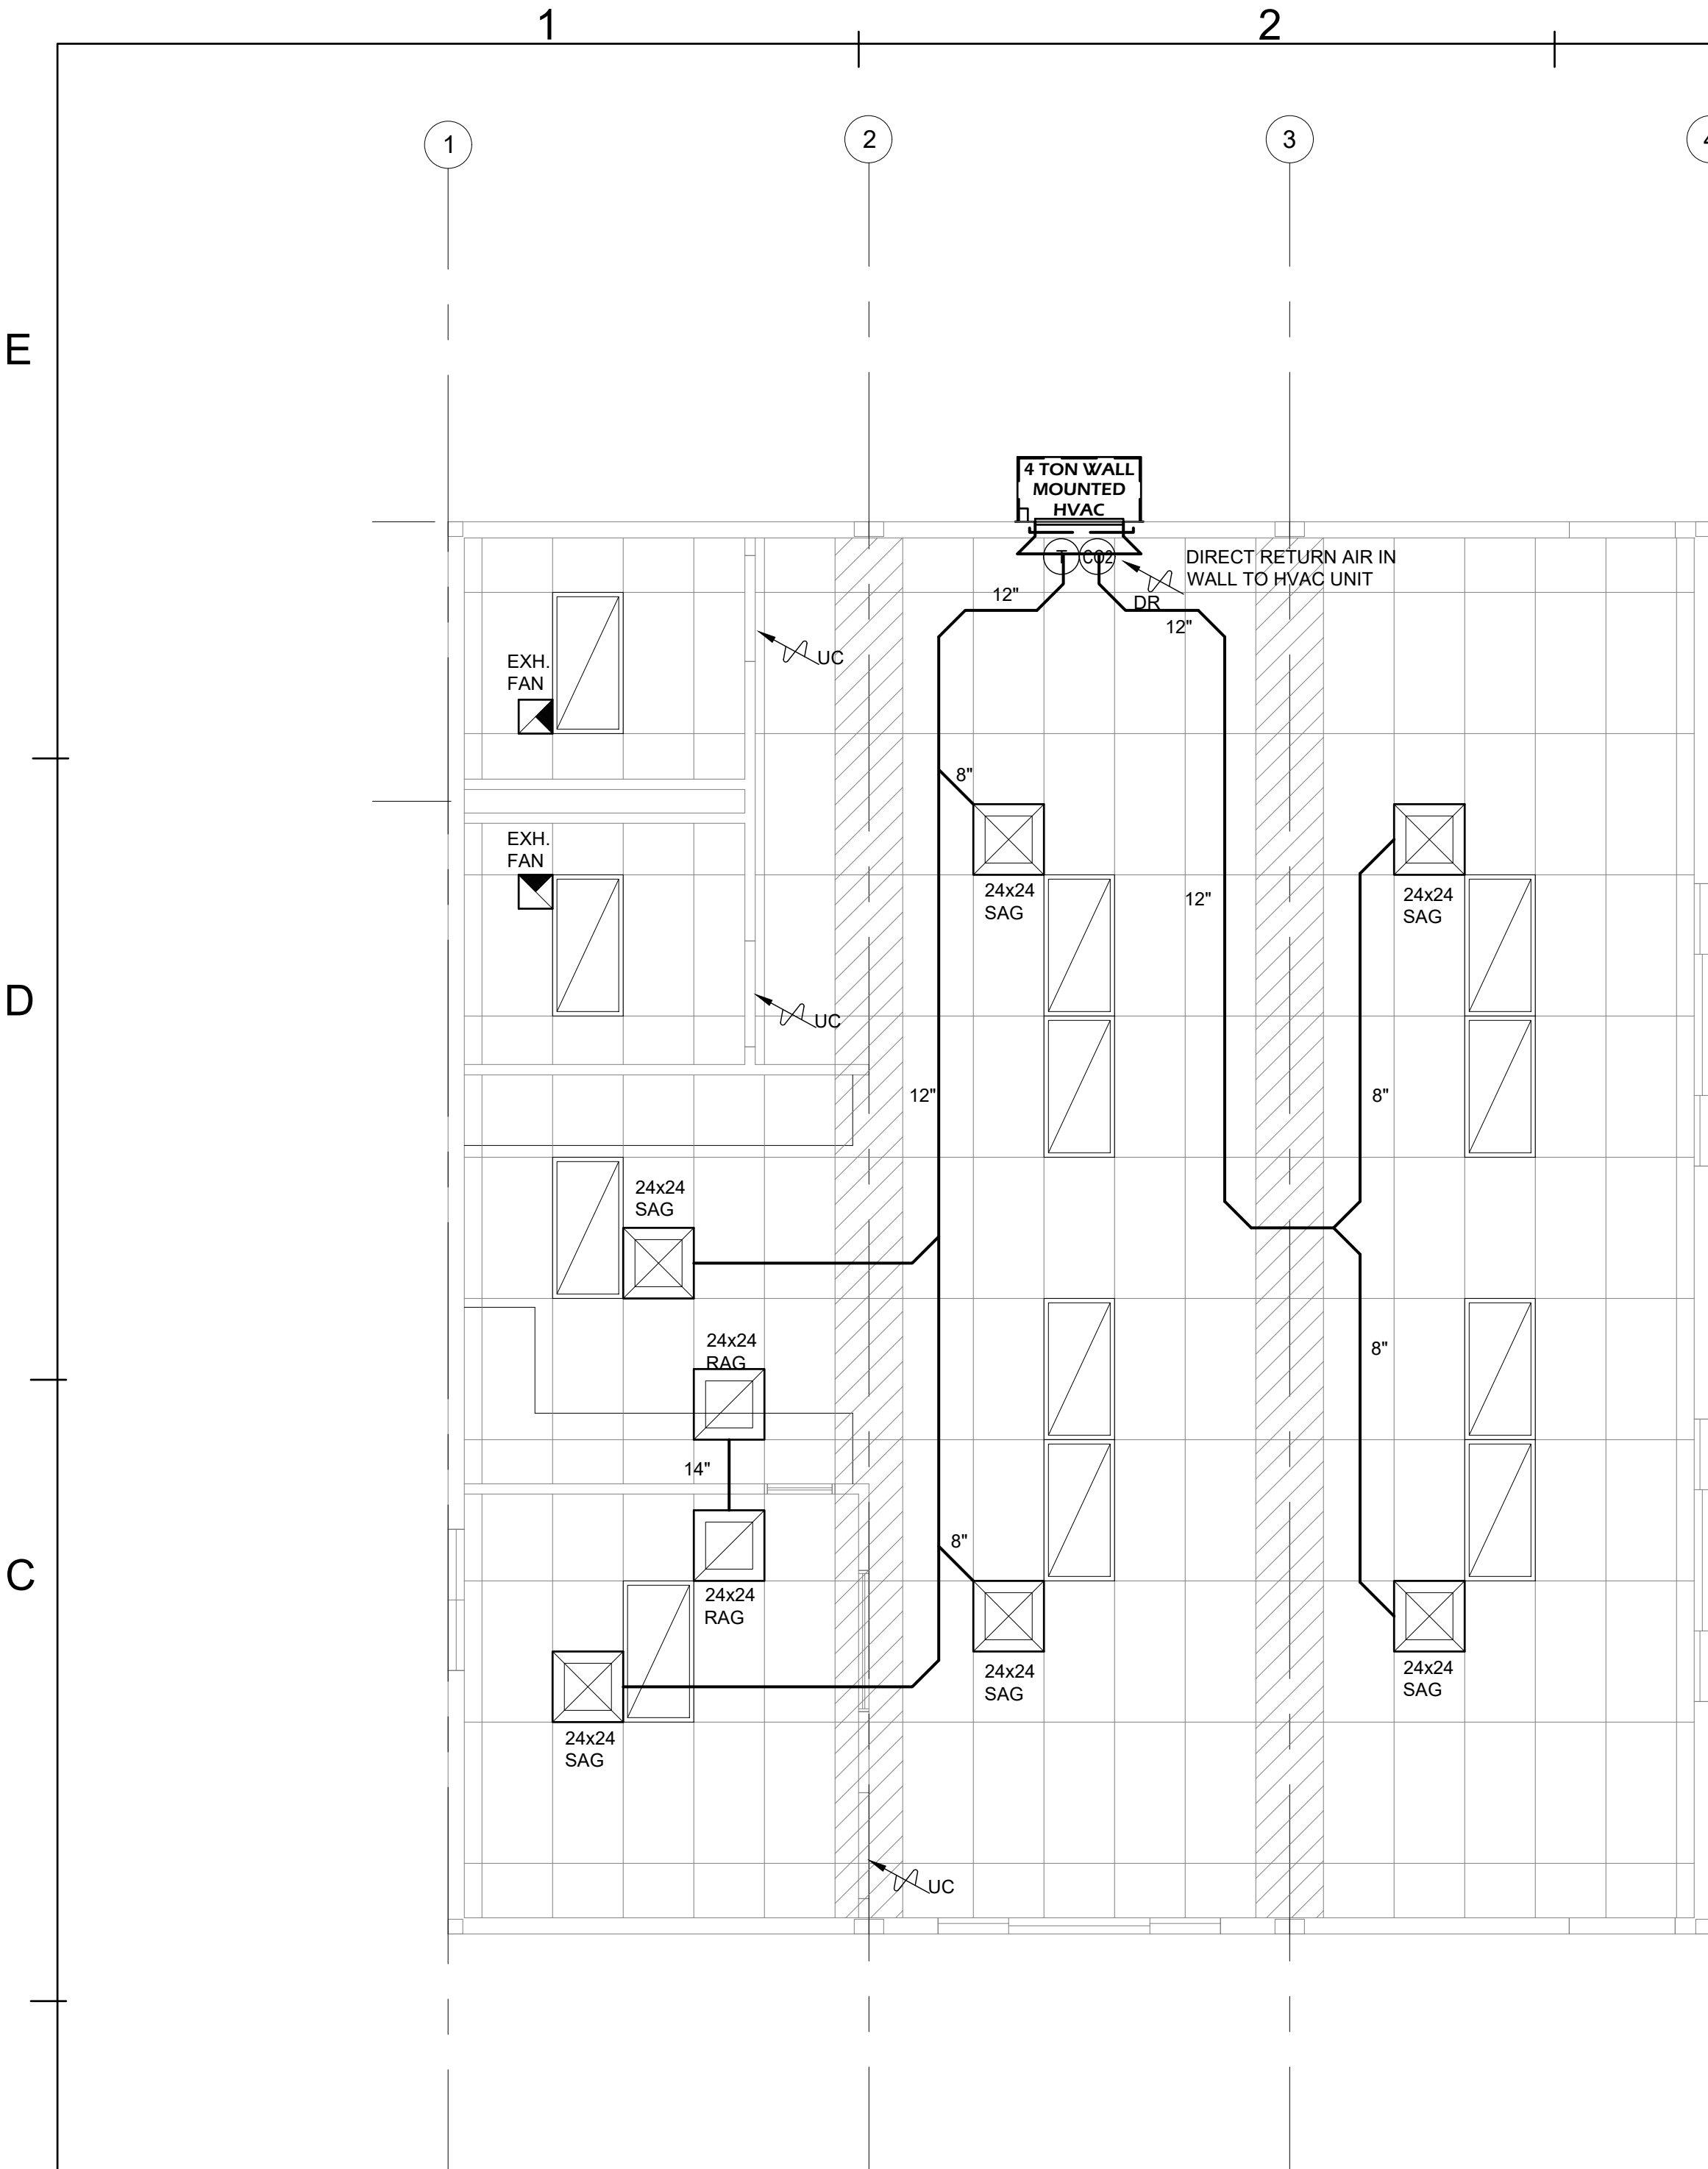

MECHANICAL LEGEND	
	SUPPLY DUCT
12"	NUMBER INDICATES DUCT SIZE
	SUPPLY REGISTER WITH INTEGRAL DAMPER
	RETURN AIR GRILLE
	EXHAUST FAN
	THERMOSTAT
	CARBON DIOXIDE
	DIRECT RETURN AIR GRILL
	UNDERCUT DOOR

MECHANICAL PLAN

SCALE: 1/4" = 1'-0"

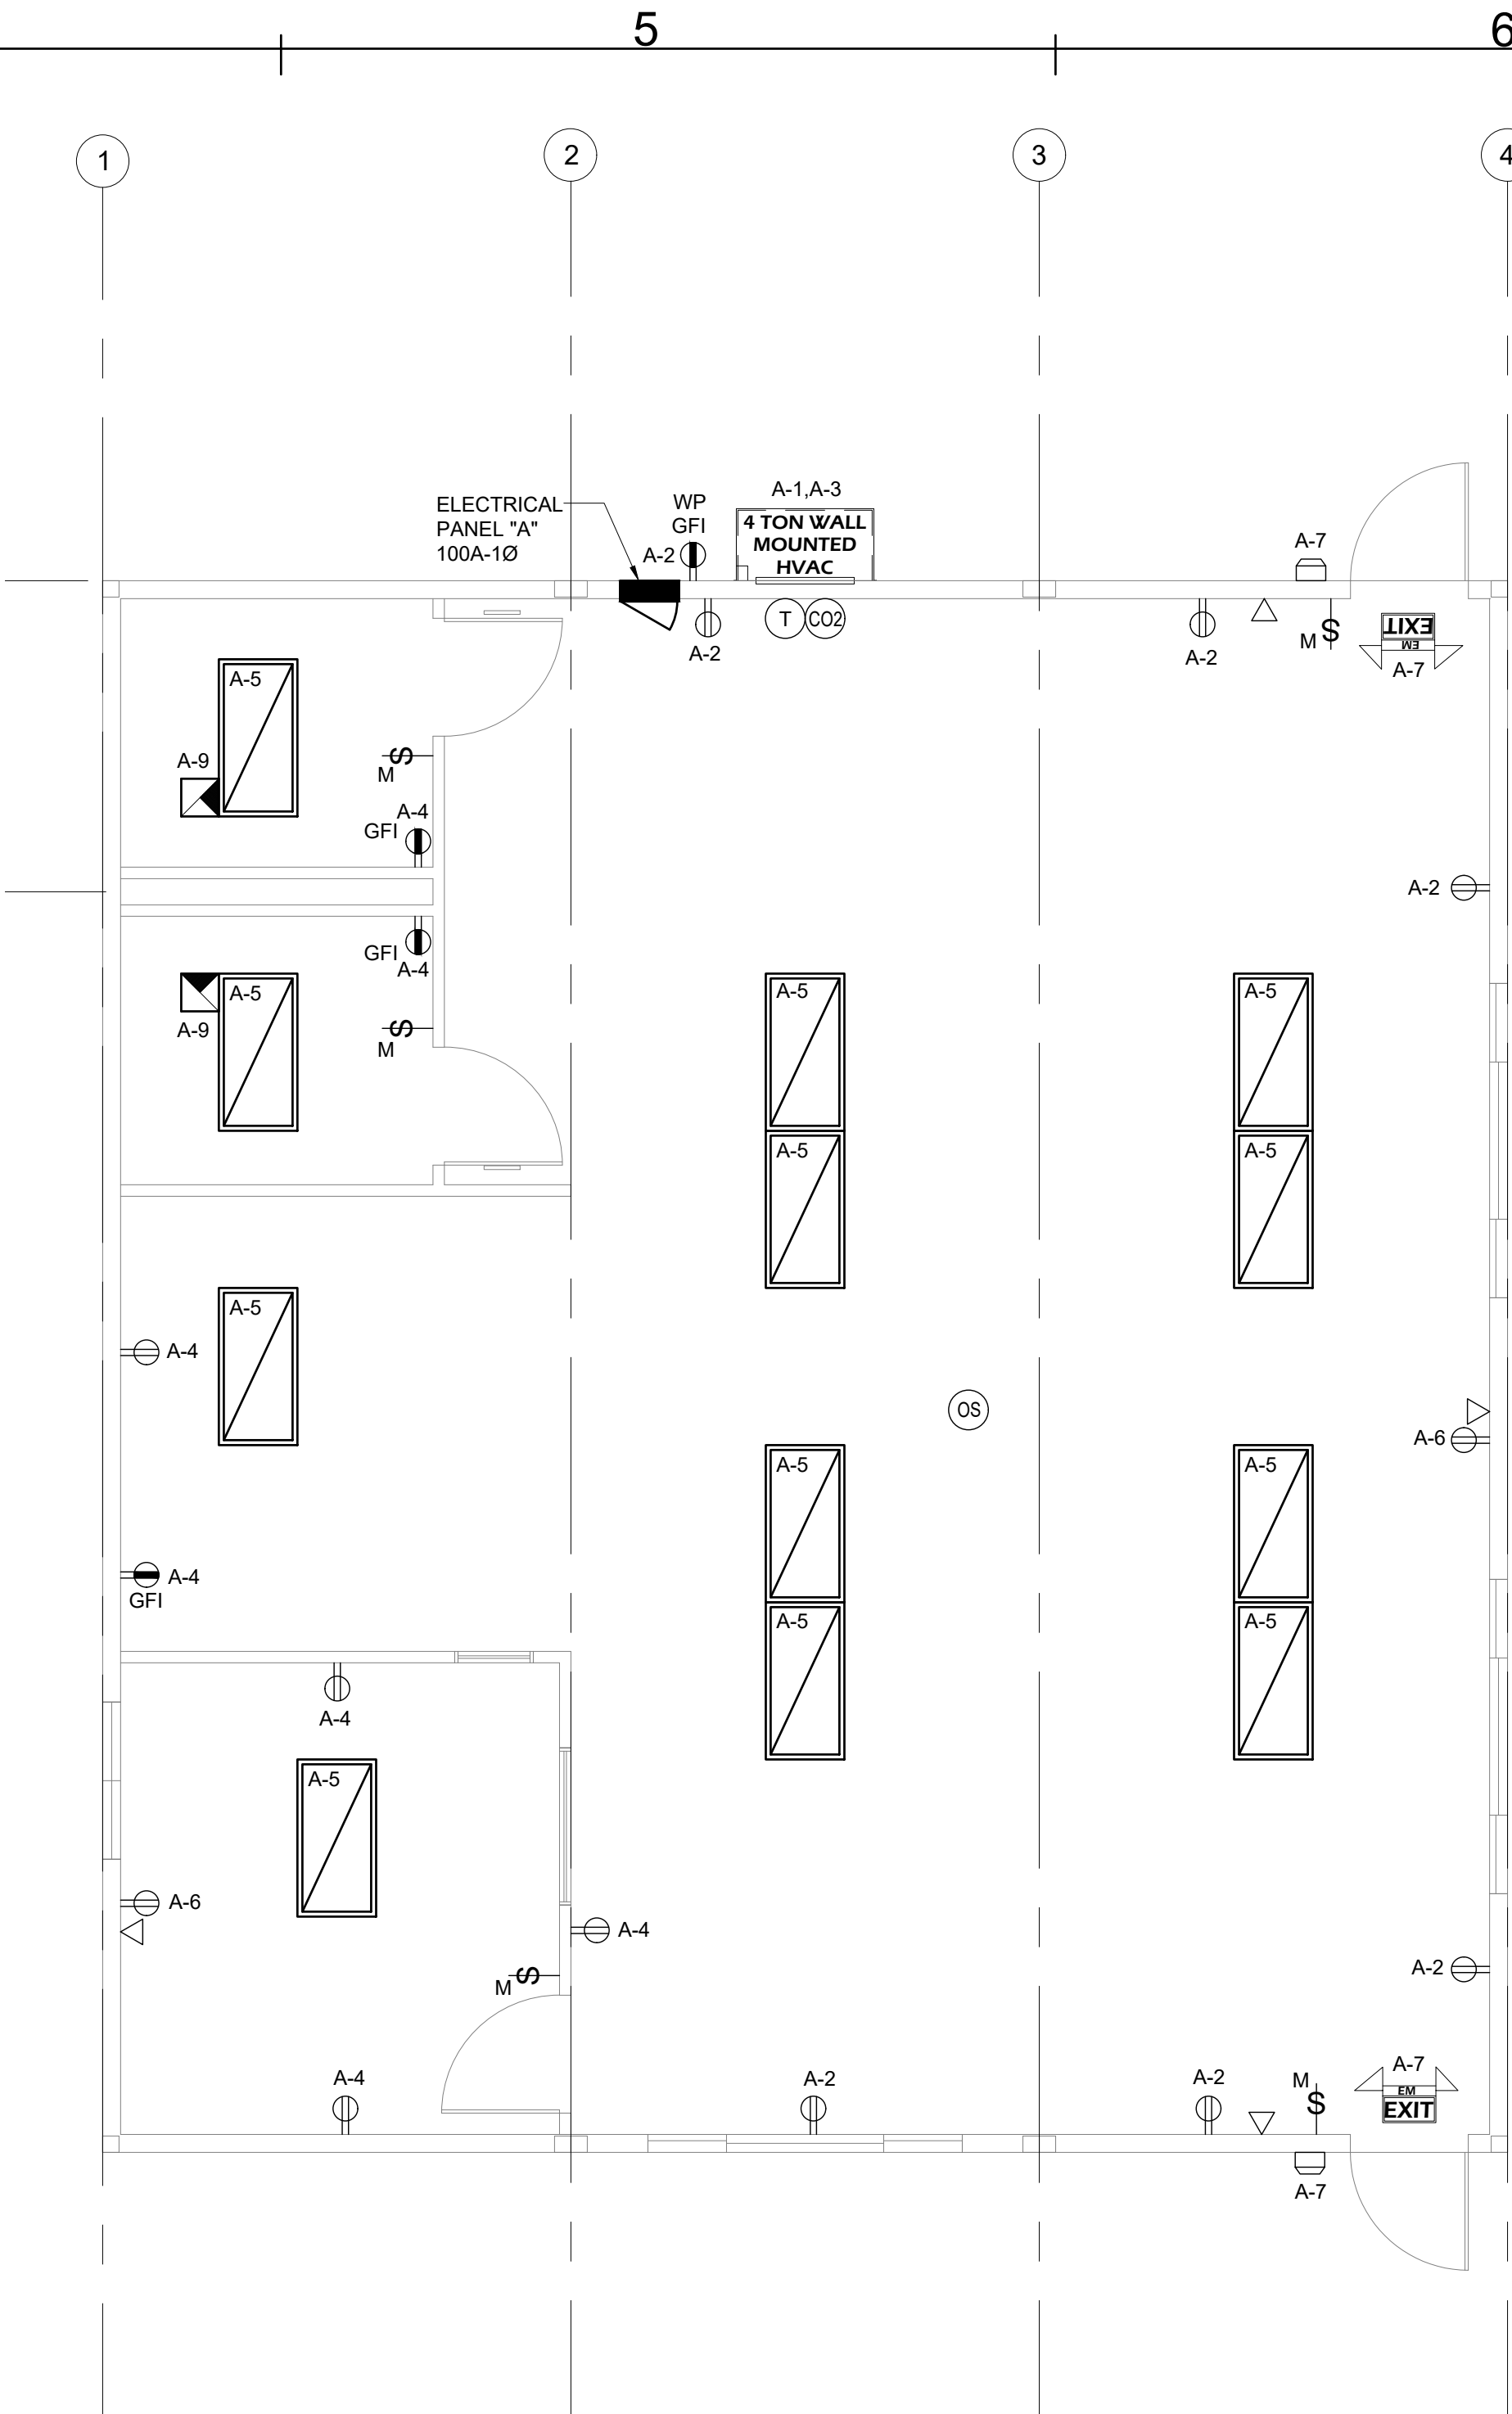

PANEL: A S/N:	PHASE:		VOLTS:		BUSS:		MAIN:		LOCATION:		FEED:		MOUNTING:				
	SINGLE		120/240		100 AMP		100A		INTERIOR		BACK		RECESSED				
OBJECT DESCRIPTION	WATT/NO. PER OF LCL	WATTS		BRK/POLE		WIRE SIZE	NO CT	LEG A/B	NO CT	WIRE SIZE	POLE/BRK	WATTS		NO OF LCL	PER WATT	OBJECT DESCRIPTION	
4 TON A/C	5428 1	x	5428	60	2	#6	1	X	2	#12	1	20	1280	7	180	RECEPT DUPLEX/GFWP	
4 TON A/C	5428 1	x	5428	60	2	#6	1	X	3	#12	1	20	1280	7	180	RECEPT DUPLEX/GFWP	
INT. LIGHTS	48 12	x	576	20	1	#12	5	X	6	#12	1	20	1000	2	300	RECEPTS DATA	
EXT. EXTERIOR LIGHTS	60 4	x	240	20	1	#12	7	X	8	#12	1	20	0			OWNER INSTALLS	
EXHAUST FANS	144 2	x	288	20	1	#12	9	X	10	#12	1	20	0			OWNER INSTALLS	
SPACE							11	X	12	#12	1	20		40	1	40	FIRE ALARM
LEG TOTALS			6282			5888						2380	1300	LEG TOTALS			
LCL=2990+15520=18510																	
TOTAL WATTS=18510																	
LEG BALANCE = 10.2%																	
TOTAL AMPS: 77.13																	

ELECTRICAL LEGEND	
	2x4 CEILING LED LIGHT FIXTURE WITH ELECTRONIC BALLAST
	ELECTRICAL PANEL AT +60" AFF TO TOP OF PANEL WITH 1-1/2" DIA POWER STUB OUT
	MOTION LIGHT SWITCH. MOUNT AT +48" AFF TO TOP OF DEVICE (11B-308.1.1)
	EXIT SIGN WITH BATTERY BACK UP AND BUG EYE EMERGENCY LIGHT. EXIT SIGN REQUIRED FOR TWO OR MORE EXTERIOR DOORS
	DUPLEX (WALL MOUNTED) RECEPTACLE 15A - 125V - 3 WIRE. MOUNT AT +18" AFF U.O.N. TO CENTERLINE OF DEVICE
	DUPLEX GFI (WALL MOUNTED) RECEPTACLE 20A - 125V - 3 WIRE. MOUNT AT +18" AFF U.O.N. TO CENTERLINE OF DEVICE (OUTLETS @ 44" AFF TO TOP OF BOX ROTATED 90 DEGREES)
	EXTERIOR LIGHT FIXTURE. MOUNT AT +80" AFF WITH 90 MIN BATTERY BACK UP
	CEILING MOUNTED OCCUPANCY SENSOR WATTSTOPPER #LMPC-100 OR EQUAL
	4SD TWO-GANG RING J-BOX FOR FUTURE DATA - 3/4" CO STUB INTO ATTIC WITH PULLSTRING

ELECTRICAL PLAN

SCALE: 1/4" = 1'-0"

IDENTIFICATION STAMP
PROJECT: 02-15200000
APP. 02-15200000
SIGNED FOR: ACS
DATE: 11/06/2024

REVISIONS	BY
1	
2	
3	
4	
5	
6	
7	
8	



ENGINEER

REGISTERED PROFESSIONAL
MANUEL D. FLORES
Exp. 03/31/26
STRUCTURAL
DATE OF CALIFORNIA
07/08/24

AOR

STOCKTON USD
36x40 CLASSROOM BUILDING

SHEET TITLE:
ELECTRICAL PLAN &
MECHANICAL PLAN

DATE:
06-27-24


DRAWN BY:
-

SCALE:
AS SHOWN

JOB:
-

SHEET NO:

ALT-02

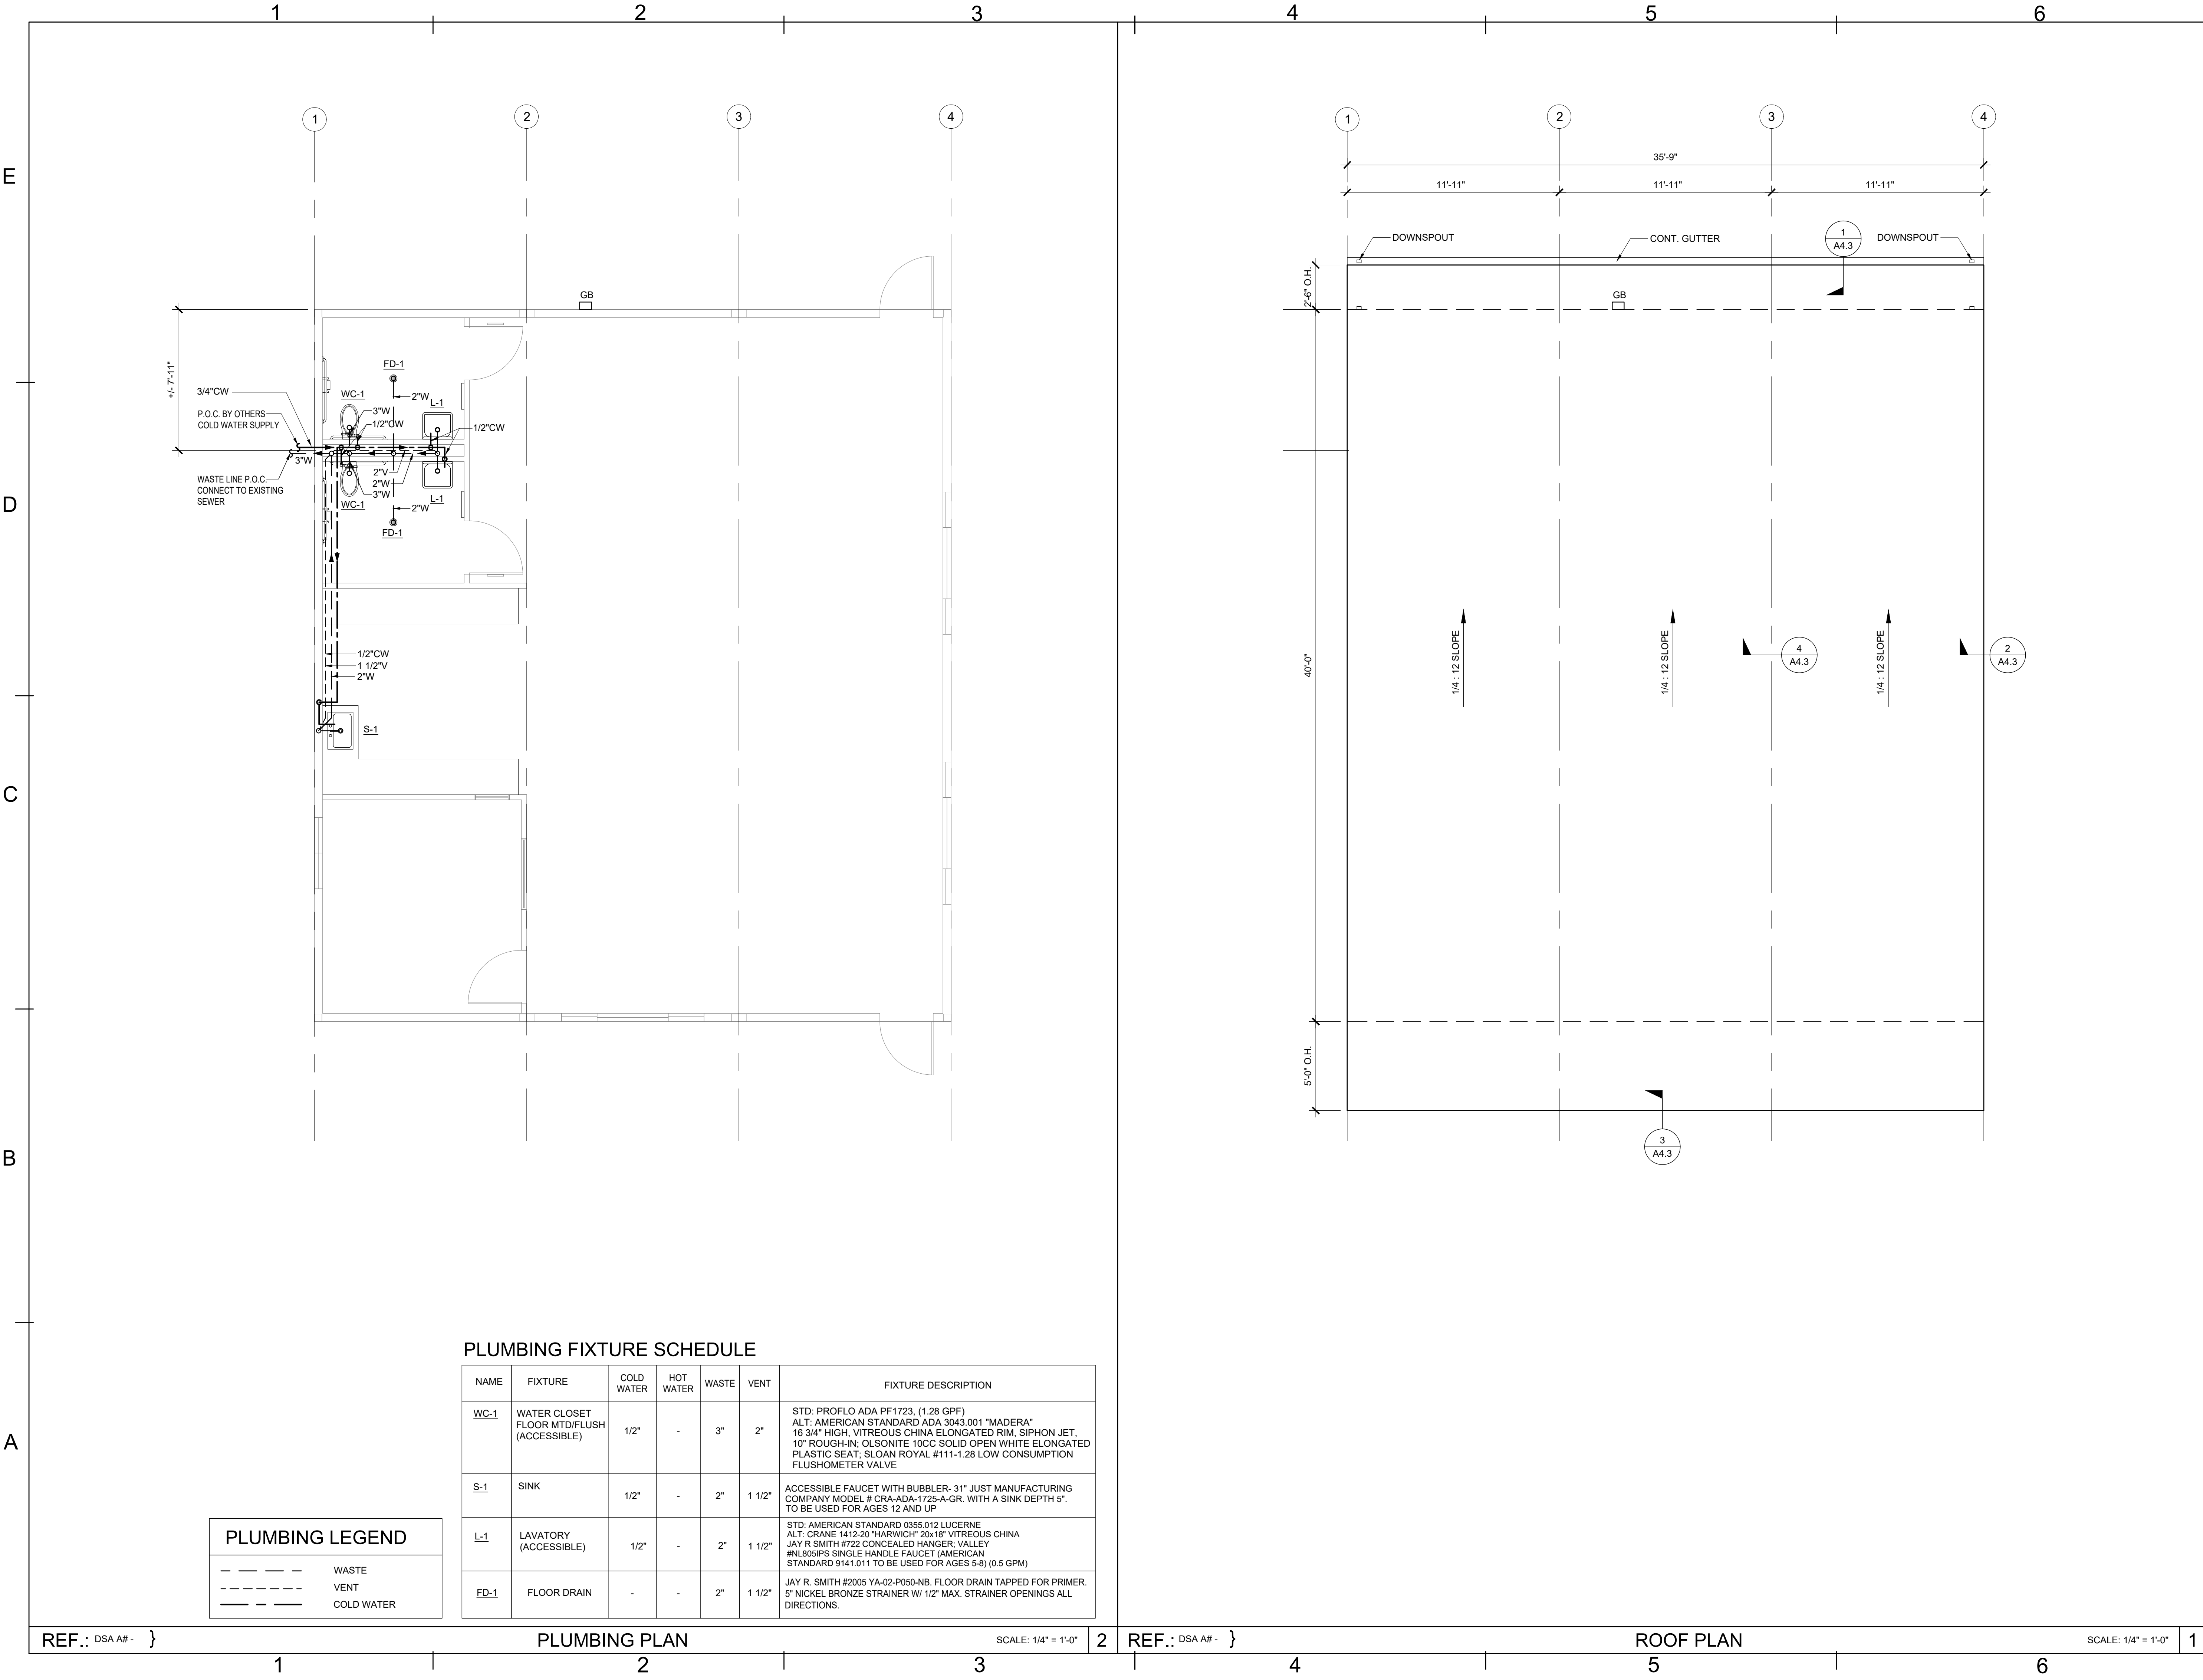

IDENTIFICATION STAMP
PROJECT NO. 92583-5003
APP. 02-15-2024
DESIGNED FOR: ACS
REVIEWED FOR: ACS
DATE: 11/06/2024

REVISIONS	BY
1	
2	
3	
4	
5	
6	
7	
8	

1651 S. Juanita St. San Jacinto, CA 92583-5003
VOICE (951)943-1908 FAX (951)943-5768

ENGINEER

AOR

STOCKTON USD
36x40 CLASSROOM BUILDING

SHEET TITLE:
ROOF PLAN & PLUMBING PLAN


DATE:
06-27-24

DRAWN BY:
-

SCALE:
AS SHOWN

JOB:
-

SHEET NO:
ALT-03

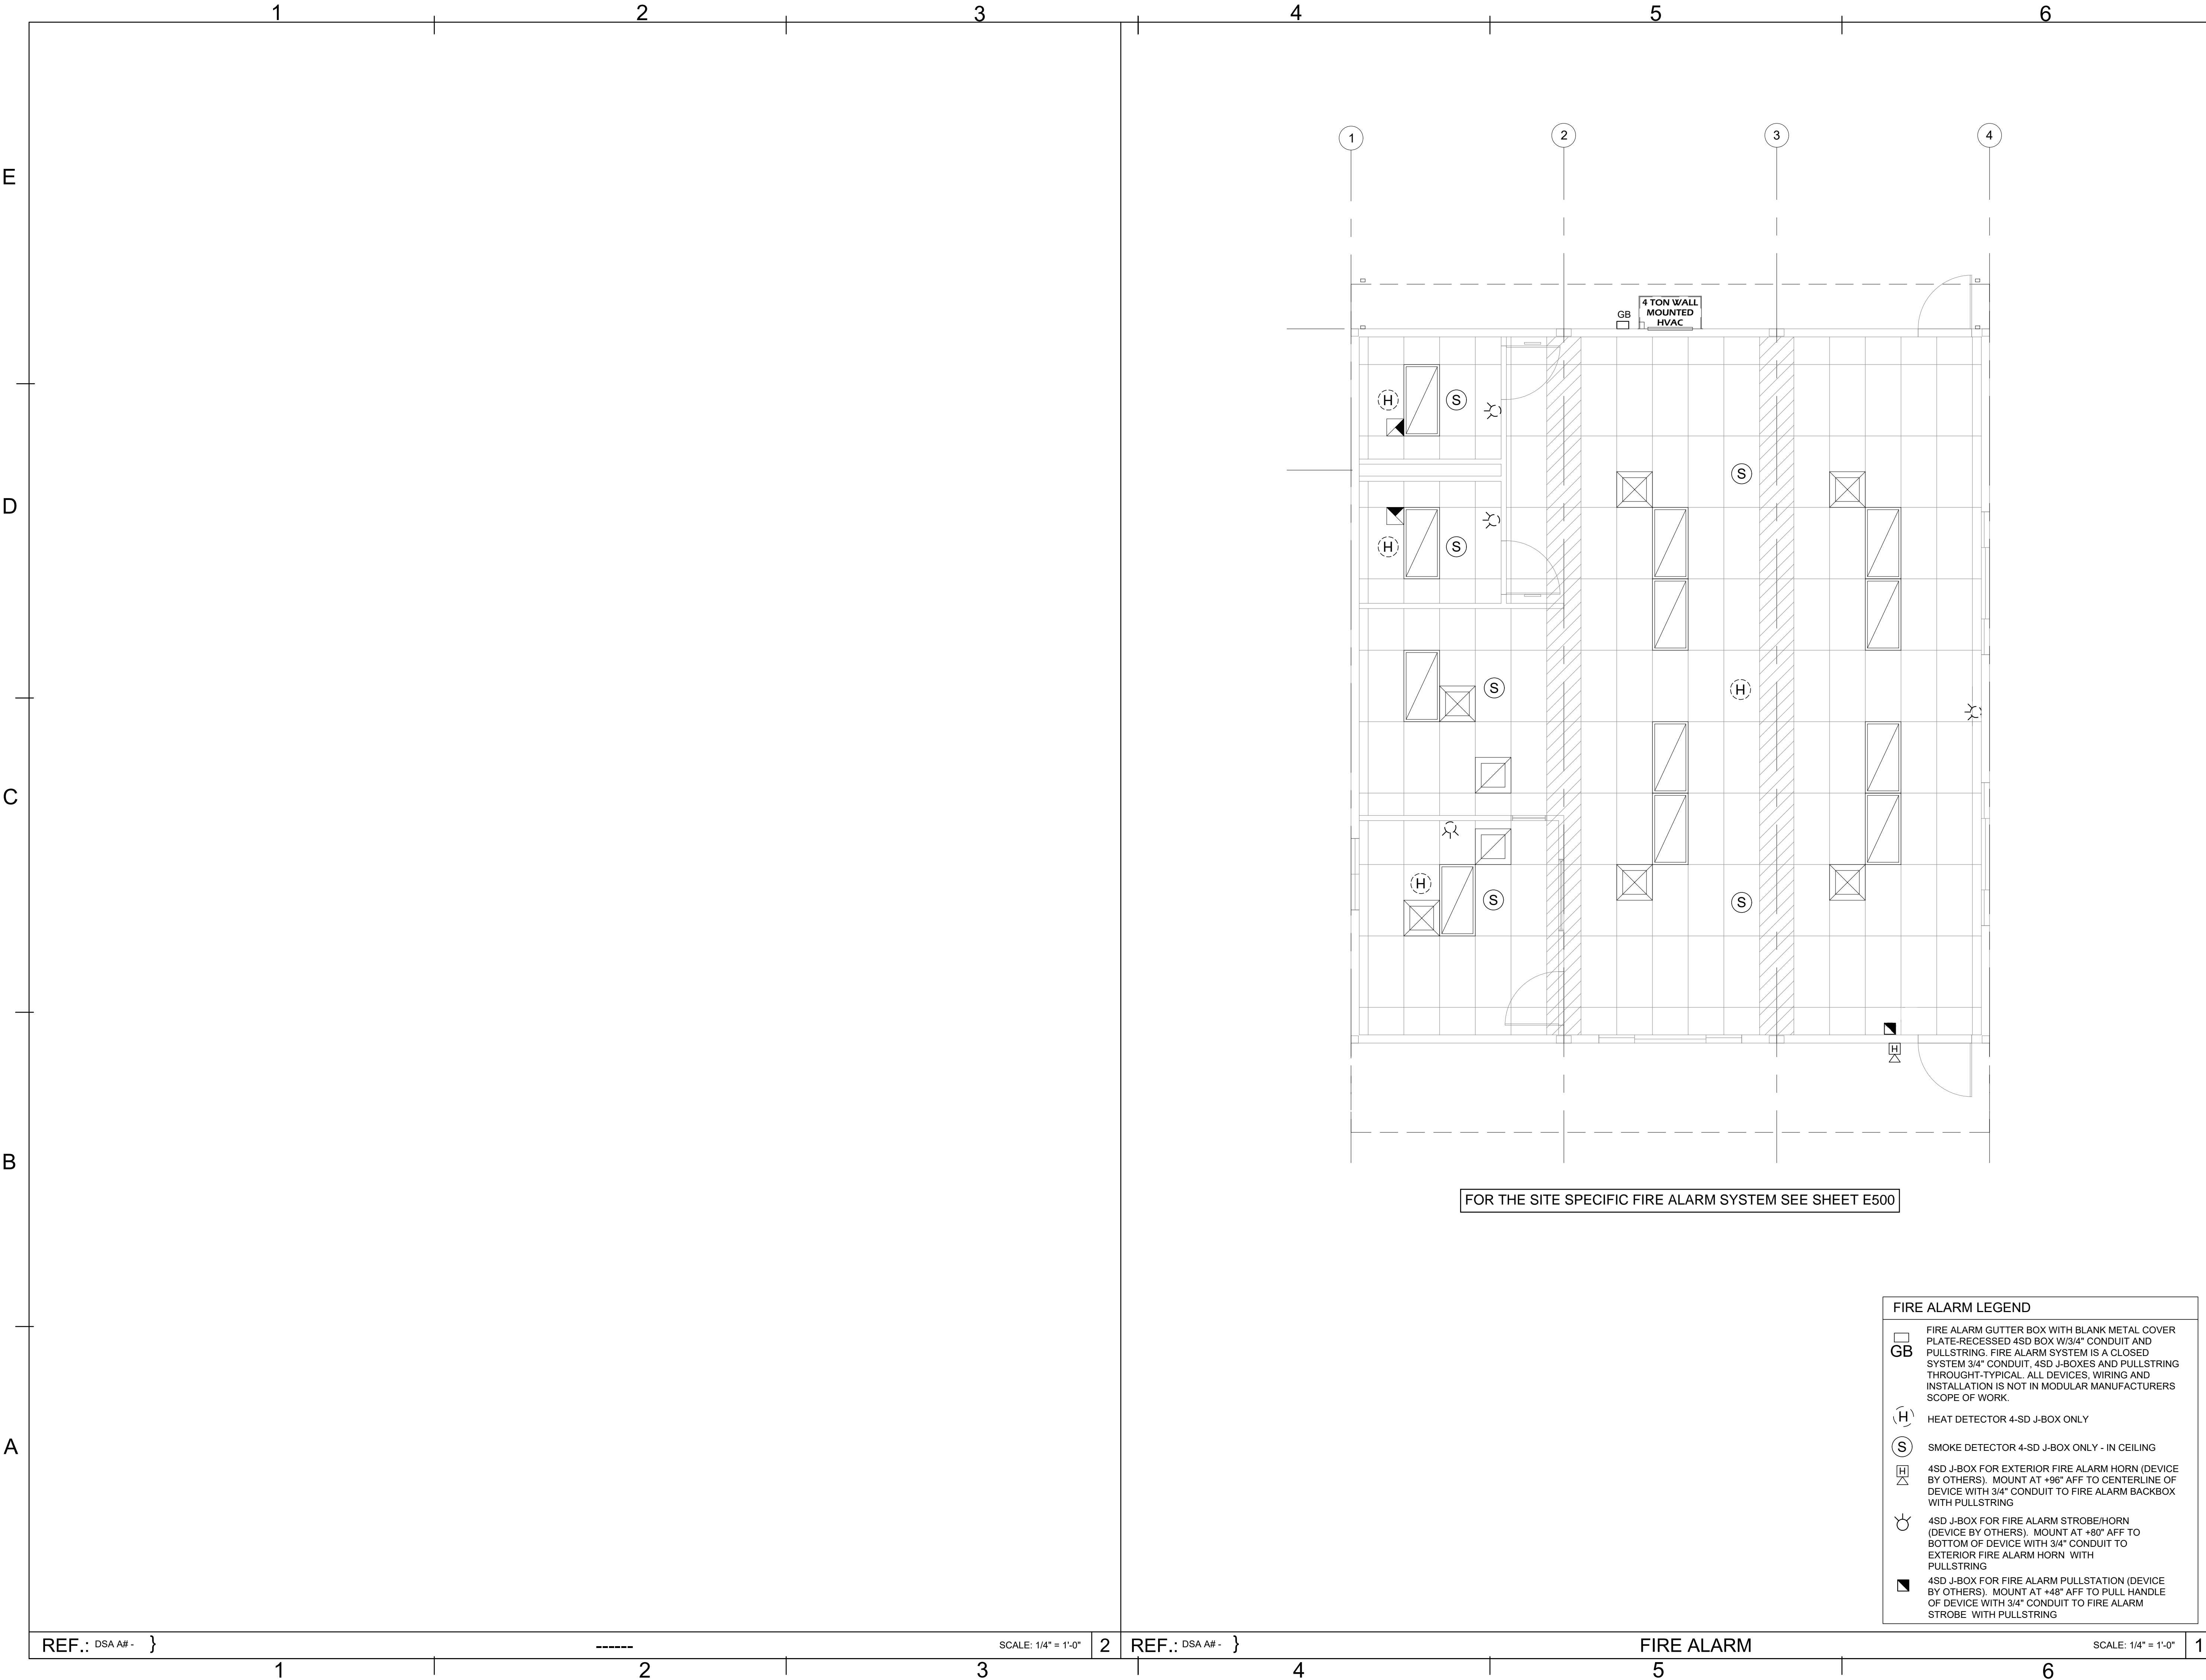

IDENTIFICATION STAMP
PROJECT NO. 92583-5003
APP. 02-15-2024 FOR: STOCKTON USD
DESIGNED BY: ACS
CHECKED BY: ACS
DATE: 11/06/2024

REVISIONS	BY
1	
2	
3	
4	
5	
6	
7	
8	

Class

Leasing

1651 S. Juanita St. San Jacinto, CA 92583-5003
VOICE (951)943-1908 FAX (951)943-5768

ENGINEER

REGISTERED PROFESSIONAL
MARTIN D. FRIEDMAN
No. 53388
Exp. 03/31/26
STRUCTURAL
STATE OF CALIFORNIA
07/08/24

AOR

STOCKTON USD
36x40 CLASSROOM BUILDING

SHEET TITLE:
FIRE ALARM

DATE:
06-27-24

DRAWN BY:
-

SCALE:
AS SHOWN

JOB:
-

SHEET NO:
ALT-04

FIRE ALARM LEGEND

GB

FIRE ALARM GUTTER BOX WITH BLANK METAL COVER PLATE-RECESSED 4SD BOX W/3/4" CONDUIT AND PULLSTRING. FIRE ALARM SYSTEM IS A CLOSED SYSTEM 3/4" CONDUIT, 4SD J-BOXES AND PULLSTRING THROUGH-TYPICAL. ALL DEVICES, WIRING AND INSTALLATION IS NOT IN MODULAR MANUFACTURERS SCOPE OF WORK.

H

HEAT DETECTOR 4-SD J-BOX ONLY

S

SMOKE DETECTOR 4-SD J-BOX ONLY - IN CEILING

H

4SD J-BOX FOR EXTERIOR FIRE ALARM HORN (DEVICE BY OTHERS). MOUNT AT +96" AFF TO CENTERLINE OF DEVICE WITH 3/4" CONDUIT TO FIRE ALARM BACKBOX WITH PULLSTRING

H

4SD J-BOX FOR FIRE ALARM STROBE/HORN (DEVICE BY OTHERS). MOUNT AT +80" AFF TO BOTTOM OF DEVICE WITH 3/4" CONDUIT TO EXTERIOR FIRE ALARM HORN WITH PULLSTRING

P

4SD J-BOX FOR FIRE ALARM PULLSTATION (DEVICE BY OTHERS). MOUNT AT +48" AFF TO PULL HANDLE OF DEVICE WITH 3/4" CONDUIT TO FIRE ALARM STROBE WITH PULLSTRING

Table 10.2.4.2.1(a) Protection Areas and Maximum Spacing of Standard Pendent and Upright Spray Sprinklers for Light Hazard

Construction Type	System Type	Maximum Protection Area		Maximum Spacing	
		ft ²	m ²	ft	m
Combustible obstructed with exposed members 3 ft (910 mm)	All	168	16	15	4.6

GENERAL NOTES

C-16 Contractor License may design and install fire sprinkler systems within the parameters of their license. Such system may not be installed by another individual or company not professionally associated with the licensed design build contractor. All design and installation shall be in accordance with NFPA 13, 2022 Edition and local authority.

Design Area is designed for Light Hazard Occupancy @ 0.10 gpm/sq. ft. over the hydraulically most remote 1500sq. ft., reduced to 900 sq ft for use of Quick Response Fire Sprinklers and ceiling height at 8'-6" (including 100 gpm outside hose stream allowance.). Upright fire sprinklers spaced at 168 Sq ft max. Below ceiling sprinklers are @ maximum 180 Sq ft.

All pipe 1"-1/2" to be Sch 40 Bull Moose and 175 lb. WWP cast iron fittings (ANSI-B16.9).

All pipe 2" and larger to be Sch 10 Bull Moose with grooved coupling, and style #750 reducing coupling.

Propriety and central station monitoring to be provided by others.

All wiring to be provided by others.

Install earthquake bracing as shown per NFPA 13 using 1" schedule 40 piping to support all earthquake braces.


The length of an unsupported arm over to a sprinkler shall not exceed 12".

All new systems including yard shall be hydraulically tested at not less than 200 psi (13.8 bars) pressure for two hours, or at 50 psi (3.4 bars) in excess of the maximum pressure, when maximum pressure is in excess of 150 psi.

Install surge protection at end of all branch lines.

Lateral Bracing not required where Hangers are less than 6".


All Interior Walls to be Full Height.

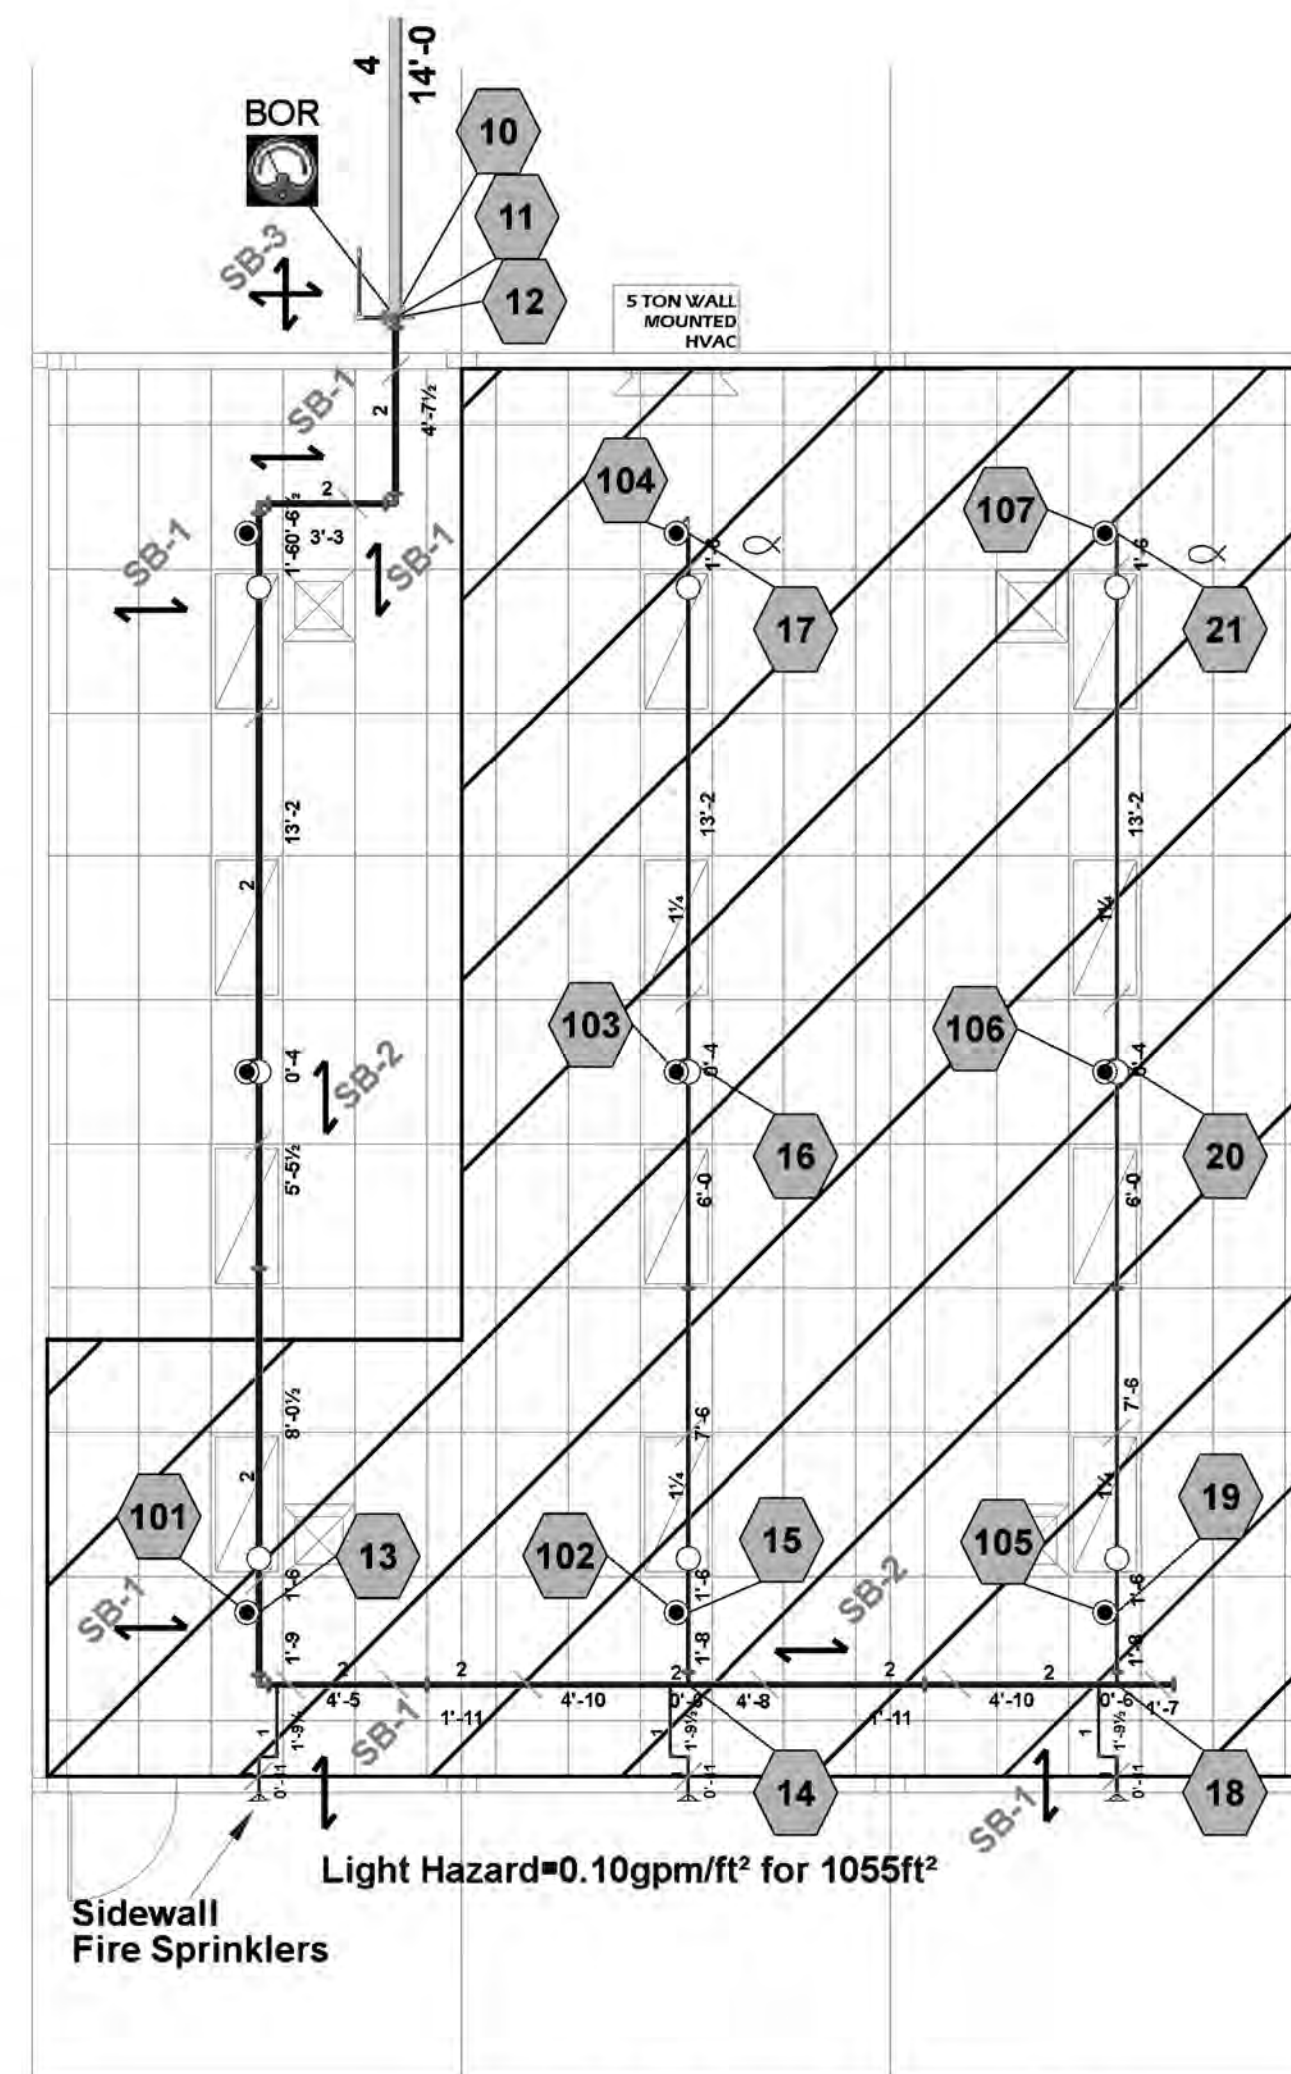

RCP 3/16" = 1'

1,440 Square Feet protected by Riser
Occupancy Group E
Construction Type V-B


2022 NFPA 13 8.16.4.1 : The Designer shall indicate on the plans a; piping subject to freezing (where water temperature cannot be maintained above 40 degrees Fahrenheit) and provide approved protection.
2022 NFPA 13 Sec 10.10.2.1.1 ; Underground mains and lead-in connections to system risers shall be completely flushed before connection is made to overhead sprinkler piping. Where underground piping is flushed and not immediately connected to the overhead piping, the riser shall be capped or otherwise protected to prevent debris, dirt, or animals from entering into the underground piping (Witnessed by the Project Inspector).
2022 NFPA 13 Figure 10.10.1" A copy of completed and signed "Contractors Materials & Test Certificate for Underground Piping" shall be included ion the submittal.
2022 NFPA Section 10.10.2.2.1 All piping and attached appurtenances subjected to system working pressure shall be hydrostatically tested at 200 PSI, or 50 PSI in excess of the system working pressure, whichever is greater, and shall maintain that pressure without loss for 2 hours. (Witnessed by the Project Inspector).
2022 NFPA Section 6.2.9: Provide spare sprinkler head cabinet, sprinkler wrench, and no fewer than 6 spare sprinkler heads matching the types and temperature rating in each protected area for systems less than 300 sprinklers. (12 spare heads for systems 300 to 1,000 sprinklers).
2022 CBC/CFC & 2022 NFPA 13 903.4.2: The Inspectors Test pipe size shall be no less than 1", with a smooth bore, corrosion-resistant orifice, providing the equivalent flow of the smallest orifice of the sprinkler types installed within the system. The discharge shall be to the exterior of the building.
2022 NFPA 25.5.3.3.6 The Sprinkler flow switch shall be tested to confirm that when the Inspectors Test Valve is activated an alarm will sound no more than 90 seconds after initial flow (Witnessed by the Project Inspector).
2022 CBC/CFC & 2022 NFPA 13 904.4.3: Connections to protected premises and supervising station fire alarm systems shall be tested to verify proper identification and transmission of alarms from automatic fire extinguishing systems (Witnessed by the Project Inspector).
2022 NFPA 13 Section 8.17.2.4.7: Signage shall be provided as required, including "Riser Room Identification".
2022 CBC/CFC Section 903.4.1" The main fire alarm panel valve monitoring and water flow alarm and trouble Signals shall be distinctly different and shall be automatically transmitted to an approved central station monitoring company.
2022 NFPA 13 Section 25.5 A permanent hydraulic calculations design data placard shall be attached to each Riser.
2022 NFPA 13 Section 6.8.2 and 2022 CBC 903.4.2: Flow switch shall be connected to a 10 inch outside alarm bell or other audible alarm device at each Riser. Approved identification signs shall be provided on the outside alarm bell "SPRINKLER FIRE ALARM - WHEN ALARM SOUNDS CALL 911/ FIRE DEPARTMENT".
Title 19 Article 906(a) A label of the self adhesive type shall be placed in the fire department connection or on the riser for fire sprinkler system and shall include the date of installation and/or date service was performed and the license number of person performing service work.
2022 NFPA 13 Figure 25.1" Sprinkler contractor shall complete and sign Contractors Material & Test Certificate for Aboveground Piping. This form shall be given to the Project Inspector who will forward to DSA for filling in project records.

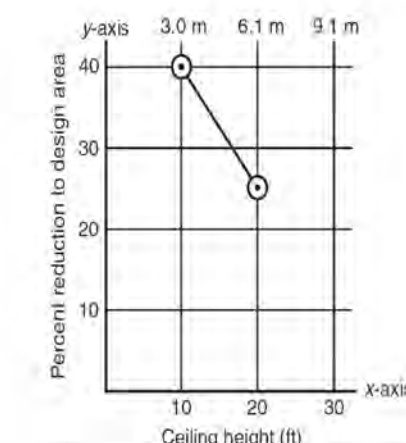

Note: $y = \frac{20}{3}x - 65$ for U.S. Customary Units
Note: $y = \frac{20}{3}x - 65$ for SI Units
For ceiling height ≥ 10 ft and ≤ 20 ft, $y = \frac{20}{3}x - 65$
For ceiling height > 20 ft, $y = 40$
For SI units, 1 ft = 0.31 m

FIGURE 11.2.3.2.1 Design Area Reduction for Quick-Response Sprinklers.
Quick Response Fire Sprinkler Area Reduction

HYDRAULIC SYSTEM	
This building is protected by a hydraulically designed automatic sprinkler system.	
System Installed By: So Cal Fire Protection Inc	
Location: REMOTE AREA 1	
Sprinkler Information	
NUMBER OF SPRINKLERS FLOWING	7
MANUFACTURER	VIKING
MODEL	VK 3021
	155 PENDANT
	1/2" ORIFICE
	QUICK RESPONSE
	K-FACTOR 5.6
Basis of Design	
STANDARD	NFPA 2022 EDITION
HAZARD GROUP	LIGHT HAZARD
DENSITY	0.10 GPM SQ. FT.
DESIGNED AREA OF DISCHARGE	1055 SQ. FT.
System Demand	
DESIGN DISCHARGE	132.51
DESIGN PRESSURE AT THE BASE OF RISER	31.57
DESIGN FLOW RATE	232.51
DESIGN PRESSURE AT THE BASE OF RISER	88.77
HOSE STREAM ALLOWANCE	0 GPM INSIDE
	100 GPM OUTSIDE
	100 GPM TOTAL
MINIMUM DISCHARGE FLOW AND PRESSURE FROM REMOTE SPRINKLER	18.0 GPM @ 10.33
COVERAGE PER SPRINKLER HEAD	180 Sq Ft

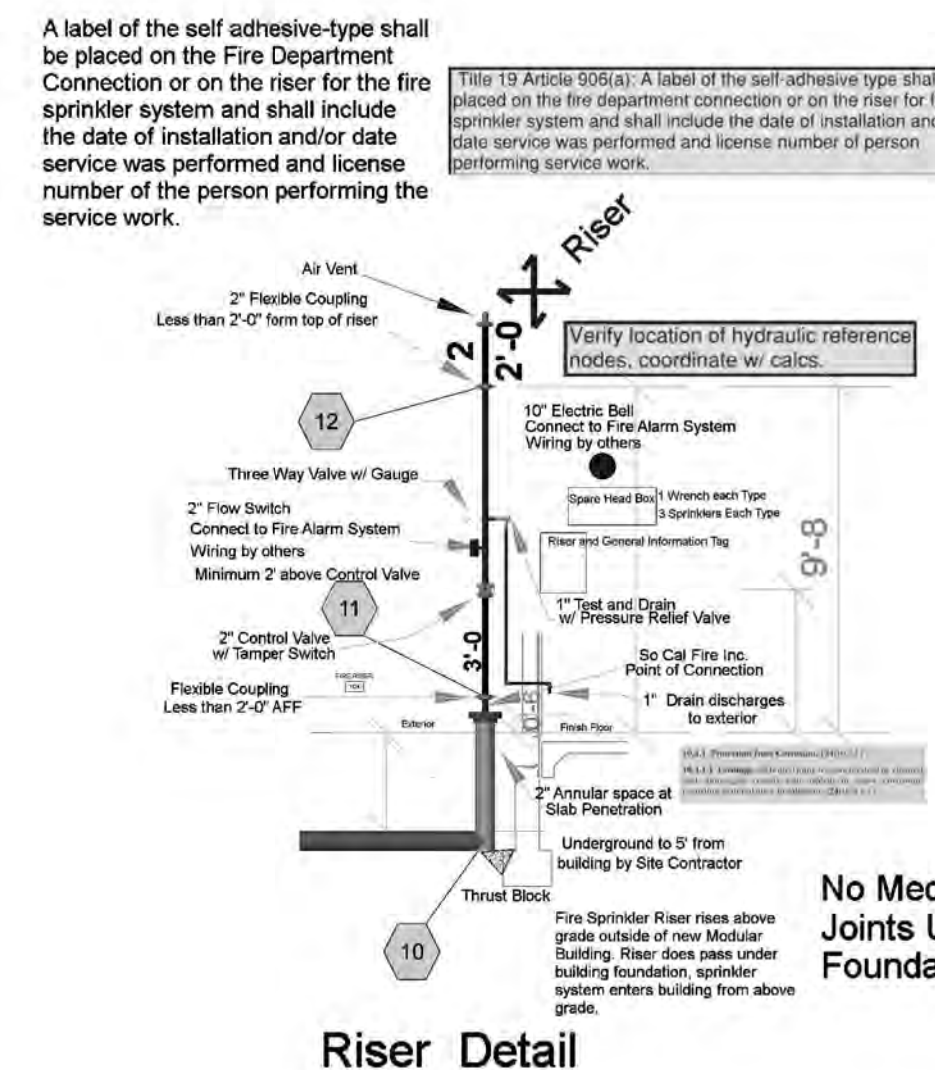

The end sprinkler on each line shall be restrained against excessive vertical and lateral movement. Provide hanger note, detail, symbol and indicate on the piping plans each location of where such a restraint is required

Ductwork shall not obstruct the function and spray pattern of the existing fire sprinkler system. Contractor shall maintain clearance requirements as defined in 2022 NFPA 13.

Per NFPA 13, 6.2.6.1.1 – Provide corrosion resistant sprinklers in areas exposed to exterior atmosphere. FS-11

Flexible couplings shall be installed as follows:
a. At the top and bottom of all risers.
b. Above and below the floor in multistory building.
c. On both sides of concrete or masonry wall.
d. On one side of building expansion joint.

SPRINKLER COMPONENTS


- Ring Hanger attached to Tolco #58 W/ 3/8" ATR
- Lateral Seismic Brace
- Longitudinal Seismic Brace
- 4 Way Riser Seismic Brace
- Branch Line Restraint

Detail

- 2 FP-2
- 5 FP-2
- 6 FP-2
- 1 FP-2
- 4 FP-2

Sprinkler Legend

Symbol	Manufacturer	SIN	MODEL	Quantity	K-Factor	Type	Size	Response	Finish	Temperature	Note
●	Viking	VK3021	Microfast	9	5.6	Pendant	1/2"	Quick Response	White	155	
○	Viking	VK3001	Microfast	9	5.6	Upright	1/2"	Quick Response	Brass	200	
+	Viking	VK305	Microfast	3	5.6	Sidewall	1/2"	Quick Response	White	200	
				21							

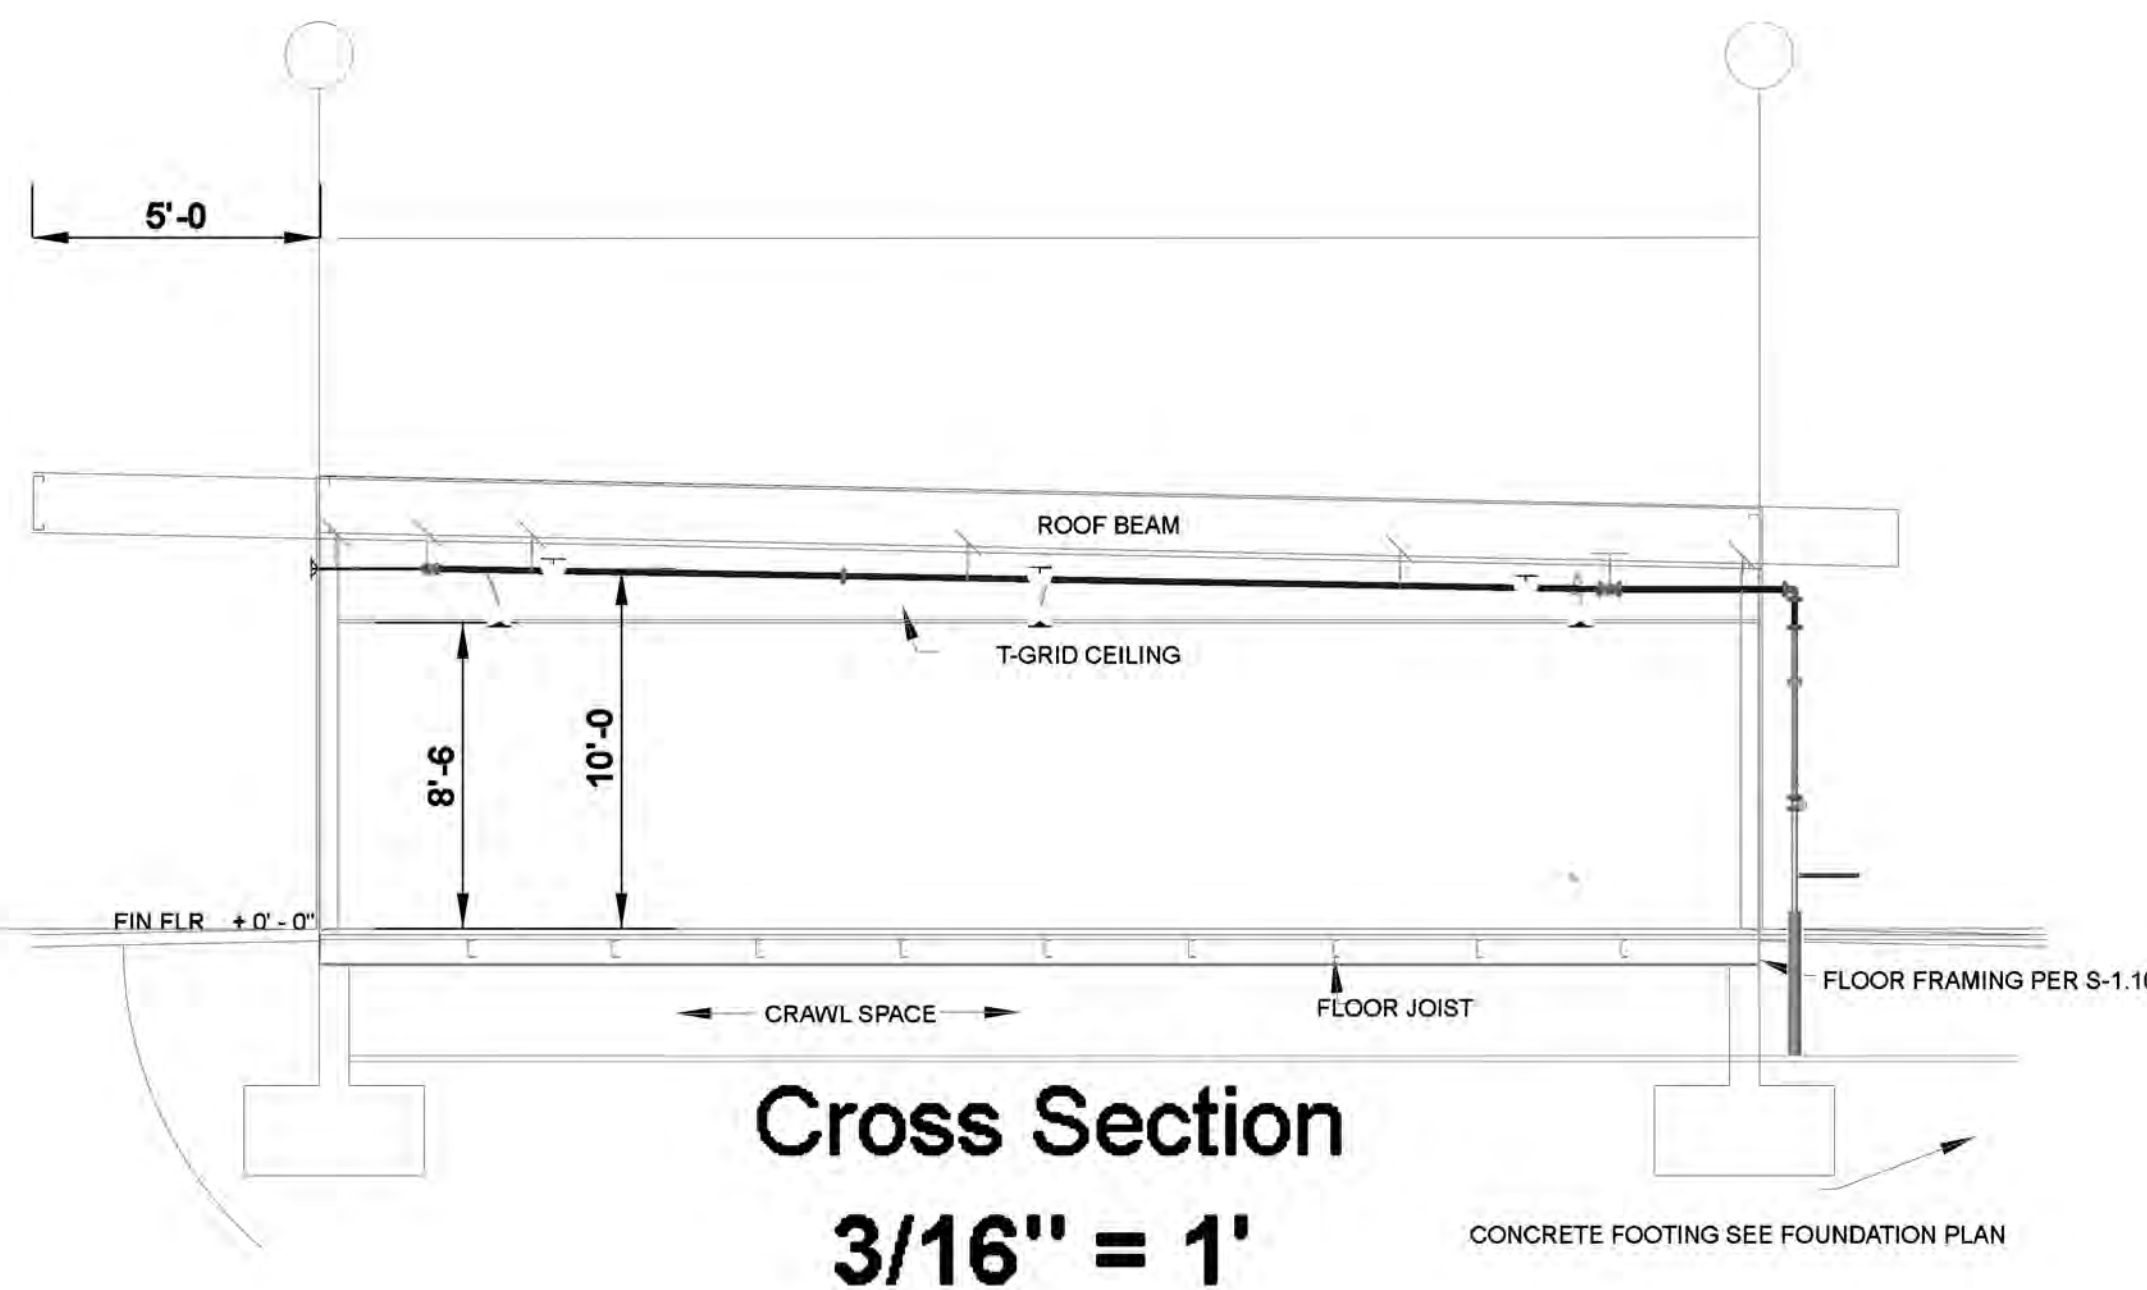

TOLBrace™ Seismic Bracing Calculations

VER. 3.0

Contractor: ABC Civil & Fire Protection Inc.

Address: 14192 Bick Ave.

Santa Ana CA 92705

Phone: 714-368-8208

License: 88865

Project Address: Peyton ES

2505 Gold Brook Drive

Stockton, CA 95212

Job #

Calculations based on 2012 MRF-A Preamble #12

Brace Information

Maximum Brace Length	7' 0" (2.134 m)
Design of Brace	1"
Type of Brace	50:40
Angle of Brace	60° Min
Least Rad. of Gyration	0.42" (11 mm)
L/R Value	200
Max Horizontal Load	1004 lbs (729 kg)

TOLCO™ Component Selection

TOLCO™ Component	Listed Load	Adjusted Load
------------------	-------------	---------------

1010 10mp	1500 lbs (680 kg)	1259 lbs (569 kg)
7500 3" Unbraced Lateral	1600 lbs (726 kg)	1386 lbs (629 kg)

* Calculation Based on Concentric Loading

* See Parameter Information
* Please Note: These calculations are for TOLCO™ components only. Use of any other components voids these calculations and the listing of the assembly.

Seismic Brace Assembly Detail

Fastener Information

Orientation to Connecting Surface	NFPA Type I
Fastener	
Type	3/8in. Unfinished Steel Bolt
Diameter	3/8in
Length	N/A
Maximum Load	1278 lbs (580 kg)
Paying Factor	N/A

Brace Identification on Plans

Brace Type	Lateral [X]	Vertical [Y]	A/R [Z]
------------	-------------	--------------	---------

Sprinkler System Load Calculation (Fpw = CpWp)

Diameter	Type	Length	Total Length	Weight Per Unit Length	Total Weight
2" (50 mm)	50:40	12.8 (3.7 m)	12.8 (3.7 m)	4.22 (0.20 kg)	53.9 (24 kg)
1.5" (38 mm)	50:40	39.1 (10.1 m)	39.1 (10.1 m)	2.93 (0.14 kg)	97.9 (44 kg)
1.25" (32 mm)	50:40	39.1 (10.1 m)	39.1 (10.1 m)	2.50 (0.10 kg)	97.9 (44 kg)

Gross Weight	150.7 (68 kg)
Wind [15%]	18.2 (8 kg)
Total [15%]	168.9 (76 kg)
Max Weight per ft (0.52 ft) of application	300 (137 kg)

Mean Size	Type Sph.	Spacing (ft)
12"	405	12

Use of TOLCO™ is subject to terms and conditions per the end user agreement

TOLCO™ Version B

TOLBRACE™ Seismic Calculations	
Project: ES	Job #: _____
25253 Gold Brook Drive	
Brace Identification	Lateral Brace 1
Brace Type (Per NFPA13)	NFPA Type 1
Braced Pipe (Rt)	2" Sch40 Steel Pipe
Spacing of Braces	12'-0" (3.66 m)
Orientation of Brace	Lateral
Bracing Material	1" Sch40
Maximum Brace Length	7'-0" (2.13 m)
Stiffness/Ratio used for Load Calculation	200
True Angle of Brace for Calculation	60°
Type of Fastener	3/16" Unfinished Steel Bolt
Length of Fastener	N/A
Summary of Pipe within Zone of Influence	
0" Dia. 10 Steel Pipe (0.0 m)	13.8 (4.2 m)
2" Dia. 40 Steel Pipe (5.1 m)	1.0 (0.3 m)
1" Dia. 40 Steel Pipe (3.0 m)	2.4 (0.7 m)

6-Factor Used 0.41	
Allowance for Heads and Fittings	15%
Conclusions	
Total Actual Load of Pipe in Zone of Influence	74 lbs (34 kg)
Material Capacity	1604 lbs (729 kg)
Fatiguer Capacity	1278 lbs (580 kg)
Fig 1001 Clamp	1299 lbs (589 kg)
Fig500 - 30" Universal Swivel	1386 lbs (629 kg)
Structural Member	2-Purvis
Calculations prepared by T.E. Mai	
* The Association of the District Member is for informational purposes only. * All items within this report are the sole property, right, and product of it is placed in the public domain.	

PD

Hanger Detail

Side Beam Bracket
Tolco Fig. 58

(2) 1/4" Tec Screws

3/8" All Thread Rod

Swivel Ring
Tolco Fig. 200R

Z Purlin

0'-3 Minimum

Pipe 1" to 4" Dia.

Symbol= /

Branch Line Restraint

2 - #14 x 1" Tek Screws

Slide Beam Bracket
(See Fig. 58)

2 - #14 x 1" Tek Screws

Z-Purite

4" Frame with 1-1/2" Z-Purite anchor pipe

Ring Hanger and 3/8" All Thread Rod

Symbol =

Lateral Sway
650 lb. Max. H

Longitudinal Sway Brace Detail 650 lb. Max. Horizontal Load AT Z PURLIN ATTACHMENT

Z Purlin
 1/2 x 1 1/2 Machine (Hex) Bolt
 Attach within 2" of top of C Channel
 (Tolco Fig. 980) Universal Swivel
 Sway Brace Attachment

45-55°

1" Pipe, Schedule 40
 6'-0" Max Length
 Load Capacity 1310 lbs.
 1" Pipe Max 7'

(Tolco Fig. 980) Universal Swivel
 Sway Brace Attachment
 Load Capacity 2760 lbs.

(Tolco Fig. 4L) Pipe Clamp
 Load Capacity 440 lbs.

Symbol= →

Sway Brace Tag			
Brace Type Longitudinal	Brace Pipe Size 1"	Fastener Type Machine (Hex) Bolt	Fastener Orientation NFPA Type "1"
Brace Angle 60-90	Attached To Steel	Fastener Size 1/2 x 1 1/2	Maximum Fastener Load 2260lb
Code: NFPA #13 - 2016 Table: 9.3.5.11.8			Manufacturer: Tolco Inc

**SCHOOLHOUSE
MANUFACTURING**

ARCHITEC STAMP:

ENGINEER STAMP:CONSULTANT:

CONSULTANT:

 **So Cal Fire Inc**

**14102 Holt Avenue
North Tustin, CA 92705
714 368 0230
C-16 # 898658**

CONSULTANT STAMP:

Seal of the State of California, Department of Fire Protection. The seal is circular with the text "DEPARTMENT OF FIRE PROTECTION" and "STATE OF CALIFORNIA" around the perimeter. In the center, it says "THOMAS E. MAU" and "Classification". Handwritten signatures and text are present: "C-16" and "Sub 6" are written in the center, "898658" is written below the center, and "Mau" is written to the right of the seal. There is also a handwritten signature across the seal.

PROJECT NAME: _____

**Peyton E S
2525 Gold Brook Drive
Stockton, CA 95212**

ISSUE DATES: DESCRIPTION: DATE:
FSP 7-29-2024

DRAWN BY: **J. E. Mau**
CHECKED BY:

SHEET TITLE:
Details

SHEET NUMBER:

FP-2

Hydraulic Plan



North Star
Engineering Group, Inc.
CIVIL ENGINEERING • SURVEYING • PLANNING
620 12th Street Modesto, CA 95354
(209) 524-3525 Phone (209) 524-3526 Fax

SCHOOLHOUSE
MANUFACTURING
ARCHITECT STAMP:

ENGINEER STAMP:

CONSULTANT:
So Cal Fire Inc.

14102 Holt Avenue
North Tustin, CA 92705
714 368 0230
C-16 # 898658

CONSULTANT STAMP:



PROJECT NAME:


Peyton E S
2525 Gold Brook Drive
Stockton, CA 95212

ISSUE DATES: DESCRIPTION: DATE:
FSP 7-29-2024

DRAWN BY: **J. E. May**
CHECKED BY:

SHEET TITLE:
Hydraulic Plan
SHEET NUMBER:

FP-3

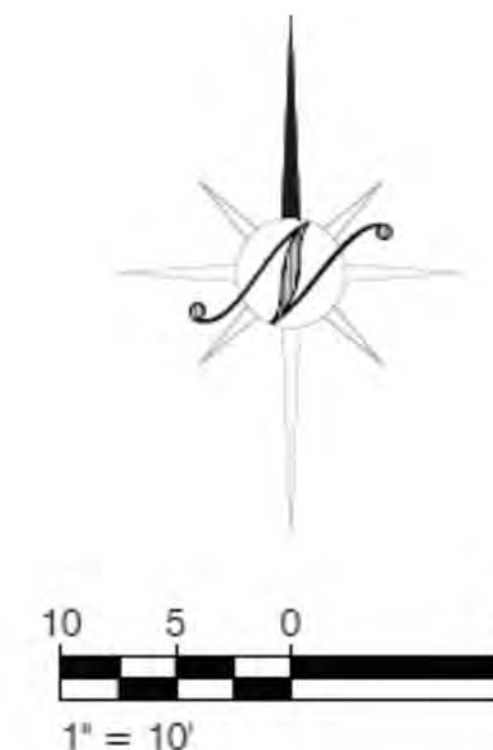


Hydraulic Node

KEY NOTES

- SEE TOPOGRAPHIC AND DEMOLITION SHEET C2.1 FOR ADDITIONAL REMOVAL, REPLACEMENT AND PROTECTION NOTES.
- CONTRACTOR SHALL "USE EXTREME CAUTION" THROUGHOUT THE COURSE OF CONSTRUCTION AS TO AVOID EXISTING UNDERGROUND LINES AND STRUCTURES THAT MAY CONFLICT WITH PROPOSED IMPROVEMENTS.
- CONTRACTOR SHALL EXCAVATE EXISTING SEWER PIPE TO VERIFY THE HORIZONTAL AND VERTICAL ALIGNMENT PRIOR TO THE INSTALLATION OF THE SEWER SYSTEM. CONTRACTOR SHALL INFORM THE ENGINEER IF THE ALIGNMENTS ARE DIFFERENT THAN SHOWN. CONTRACTOR SHALL CONNECT TO EXISTING SEWER SYSTEM PER CITY OF STOCKTON STANDARDS AND SPECIFICATIONS.
- "USE EXTREME CAUTION" TO AVOID UNDERGROUND UTILITIES WHEN INSTALLING FOOTINGS FOR WALLS, FENCES OR ARCHITECTURAL AMENITIES AT ALL UTILITY WALL/FENCE/AMENITY CROSSINGS.
- CONTRACTOR SHALL INSTALL DRINKING FOUNTAIN PER ARCHITECTURAL PLANS AND SPECIFICATIONS.
- CONTRACTOR SHALL INSTALL SEWER CLEANOUT PER DETAIL 7 ON SHEET C1.4.
- PROPOSED DOMESTIC WATER WITH SHUT OFF VALVE TO BE STUBBED 5 FEET FROM THE FACE OF THE BUILDING. CONTRACTOR SHALL VERIFY THE LOCATIONS OF THE UTILITY CONNECTIONS WITH THE PLUMBING PLANS PRIOR TO CONSTRUCTION OF PROPOSED STUBS.
- CONTRACTOR SHALL INSTALL SEWER CLEANOUT PER DETAIL 7 ON SHEET C1.4 WITH APPROPRIATE FITTINGS AND REDUCER. CONTRACTOR SHALL VERIFY THE LOCATIONS OF THE UTILITY CONNECTIONS WITH THE PLUMBING PLANS PRIOR TO CONSTRUCTION OF PROPOSED STUBS AND STUB 5 FEET FROM THE FACE OF THE BUILDING.
- CONTRACTOR SHALL CONNECT TO EXISTING DOMESTIC WATER LINE PER CITY OF STOCKTON STANDARDS AND SPECIFICATIONS. CONTRACTOR SHALL EXCAVATE EXISTING WATER LINE TO VERIFY THE HORIZONTAL AND VERTICAL ALIGNMENT PRIOR TO THE INSTALLATION OF THE PROPOSED WATER PIPE. CONTRACTOR SHALL INFORM THE ENGINEER IF THE ALIGNMENTS ARE DIFFERENT THAN SHOWN.
- CONTRACTOR SHALL CONNECT TO EXISTING FIRE WATER LINE PER CITY OF STOCKTON STANDARDS AND SPECIFICATIONS. CONTRACTOR SHALL EXCAVATE EXISTING WATER LINE TO VERIFY THE HORIZONTAL AND VERTICAL ALIGNMENT PRIOR TO THE INSTALLATION OF THE PROPOSED WATER PIPE. CONTRACTOR SHALL INFORM THE ENGINEER IF THE ALIGNMENTS ARE DIFFERENT THAN SHOWN.
- CONTRACTOR SHALL INSTALL WATER PIPES WITH SUFFICIENT ENOUGH DEPTH TO MAINTAIN 1' MINIMUM VERTICAL CLEARANCE FROM OUTSIDE DIAMETER OF PIPES AND COMPLY WITH THE MOST CURRENT STATE HEALTH CODE AND THE CALIFORNIA BUILDING AND PLUMBING CODE STANDARDS. CONTRACTOR SHALL DEEPEN WATER PIPES AS NECESSARY AND USE EXTREME CAUTION WHEN PLACING THRUST BLOCKS AS TO AVOID CONFLICTS WITH OTHER UTILITY PIPES. CONTRACTOR SHALL INSTALL REDUCERS AS REQUIRED. WATER VALVES SHALL BE INSTALLED ON 4" WATER PIPES OR LARGER AND BALL VALVES/CORP STOPS SHOULD BE INSTALLED ON 3" WATER PIPES OR SMALLER. THRUST BLOCKS SHALL BE INSTALLED AT FIRE HYDRANTS, BLOW-OFFS, TEES, CAPS, BENDS, ENDS, AND CHANGES IN SIZE AND/OR DIRECTION. WATER SEPARATION SHALL BE CONSTRUCTED IN ACCORDANCE WITH SECTION 720.0 AND TABLE 7-7 OF THE CALIFORNIA PLUMBING CODE. SEE CITY OF STOCKTON STANDARD DETAIL W-12 FOR THRUST BLOCK DETAILS AND SPECIFICATIONS.
- PROPOSED FIRE SPRINKLER WATER WITH SHUT OFF VALVE TO BE STUBBED 5 FEET FROM THE FACE OF THE BUILDING. CONTRACTOR SHALL VERIFY THE LOCATIONS OF THE UTILITY CONNECTIONS WITH THE PLUMBING PLANS PRIOR TO CONSTRUCTION OF PROPOSED STUBS.
- CONTRACTOR SHALL INSTALL 4" DOUBLE CHECK DETECTOR ASSEMBLY WITH OS&Y VALVES, TAMPER SWITCH, AND ASSOCIATED CONDUITS PER DETAIL 8 ON SHEET C1.4. "USE EXTREME CAUTION" WHEN INSTALLING DEVICES TO AVOID EXISTING UNDERGROUND UTILITIES THAT MAY EXIST. CONTRACTOR TO FIELD VERIFY PRIOR TO CONSTRUCTION.
- CONTRACTOR SHALL INSTALL FIRE HYDRANT ASSEMBLY PER CITY OF STOCKTON STANDARD DETAIL W-13. MAINTAINING A 3 FEET MINIMUM CLEARANCE SPACE. "USE EXTREME CAUTION" WHEN INSTALLING FOOTINGS TO AVOID UNDERGROUND UTILITIES.
- CONTRACTOR SHALL INSTALL RECTANGULAR CATCH BASIN PER DETAIL 9 ON SHEET C1.4.
- CONTRACTOR SHALL EXCAVATE EXISTING STORM DRAINAGE STUB TO VERIFY THE HORIZONTAL AND VERTICAL ALIGNMENT PRIOR TO THE INSTALLATION OF THE STORM DRAINAGE SYSTEM. CONTRACTOR SHALL INFORM THE ENGINEER IF THE ALIGNMENTS ARE DIFFERENT THAN SHOWN. CONTRACTOR SHALL CONNECT TO EXISTING STORM DRAINAGE SYSTEM PER CITY OF STOCKTON STANDARDS AND SPECIFICATIONS.
- CONTRACTOR SHALL INSTALL BOLLARDS PER ARCHITECTURAL PLANS AND SPECIFICATIONS.

COPYRIGHT © 2024 NORTHSTAR ENGINEERING GROUP, INC.

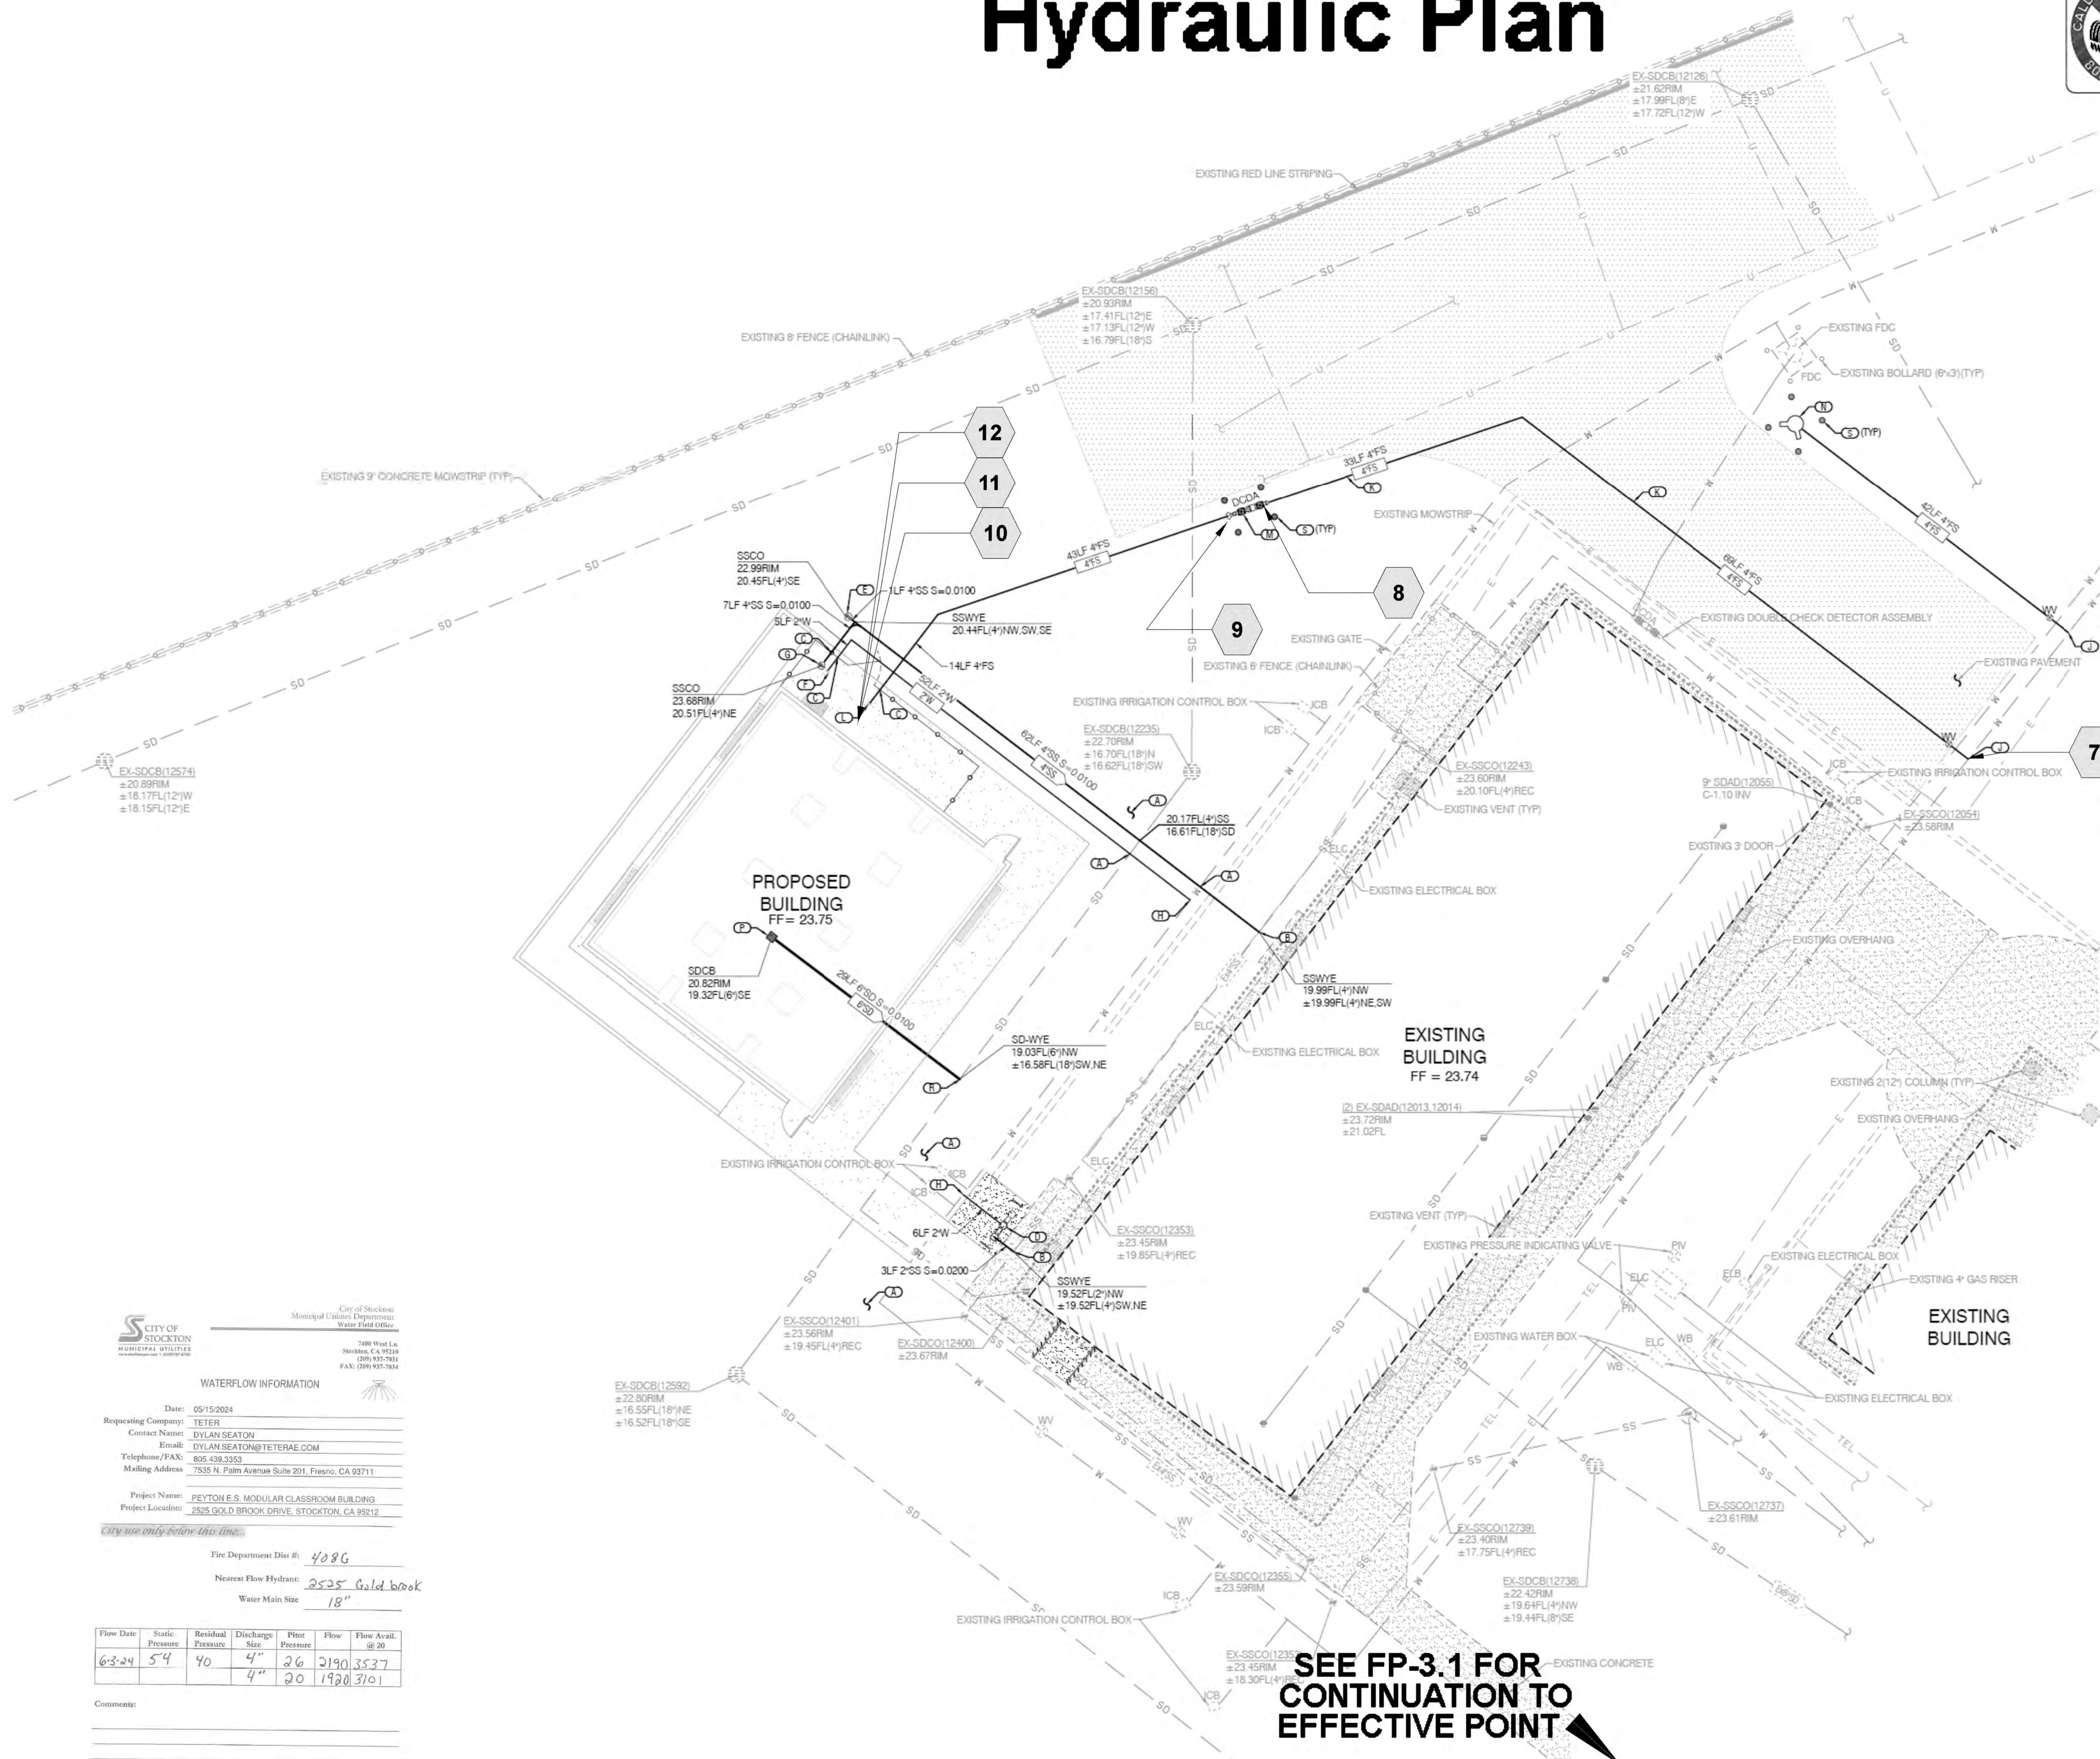

City of Stockton
Municipal Utilities Department
Water Field Office
2400 West L.A.
Stockton, CA 95219
(209) 937-7881
FAX: (209) 937-7884

WATERFLOW INFORMATION

Date: 05/15/2024
Requesting Company: TETRA
Contact Name: DYLAN SEATON
Email: DYLAN.SEATON@TETRAE.COM
Telephone/FAX: 805-439-3353
Mailing Address: 7535 N. Palm Avenue Suite 201, Fresno, CA 93711

Project Name: PEYTON E.S. MODULAR CLASSROOM BUILDING
Project Location: 2525 GOLD BROOK DRIVE, STOCKTON, CA 95212

City use only below this line:

Fire Department Dist #: 4086


Nearest Flow Hydrant: 2525 Gold Brook

Water Main Size: 18"

Flow Date	Static Pressure	Residual Pressure	Discharge Size	Pipe Pressure	Flow Rate	Flow Avail. @ 20'
6-3-24	54	40	4"	26	2190	3537
			4"	20	1920	3101

Comments:


**SEE FP-3.1 FOR
CONTINUATION TO
EFFECTIVE POINT**

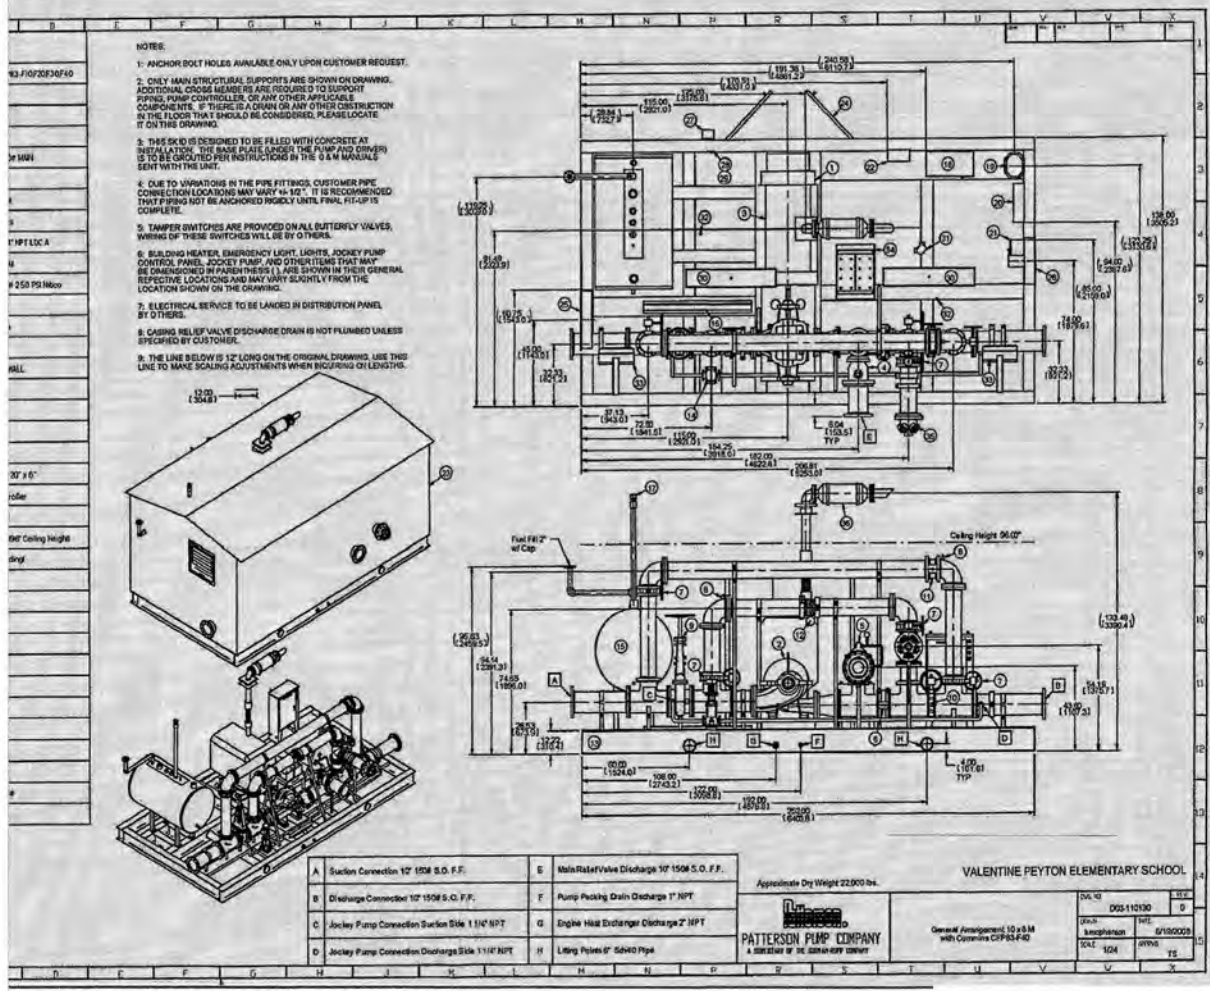

FIRE PUMP SCHEDULE	
1	10" WATER LINE FROM PUBLIC
2	10" WATER LINE FROM BOOSTER PUMP
3	10" WATER LINE FROM BOOSTER PUMP
4	10" WATER LINE FROM BOOSTER PUMP
5	10" WATER LINE FROM BOOSTER PUMP
6	10" WATER LINE FROM BOOSTER PUMP
7	10" WATER LINE FROM BOOSTER PUMP
8	10" WATER LINE FROM BOOSTER PUMP
9	10" WATER LINE FROM BOOSTER PUMP
10	10" WATER LINE FROM BOOSTER PUMP
11	10" WATER LINE FROM BOOSTER PUMP
12	10" WATER LINE FROM BOOSTER PUMP

Hydraulic Plan

Node 1 to Node 2	27'-3"	Ductile Iron Class 52
Node 2 to Node 3	260'-7.5"	PVC C900
Node 3 to Node 4	12'-0"	PVC C900
Node 4 to Node 5	488'-7"	PVC C900
Node 5 to Node 6	Pump	PVC C900
Node 6 to Node 7	335'-2.5"	PVC C900
Node 7 to Node 8	101'-7.5"	PVC C900
Node 8 to Node 9	12'-0"	PVC C900
Node 9 to Node 10	52'-9"	PVC C900
Node 10 to Node 11	4'-0"	Ductile Iron Class 52
Node 11 to Node 12	8'-4.5"	Sch 10 Black Steel

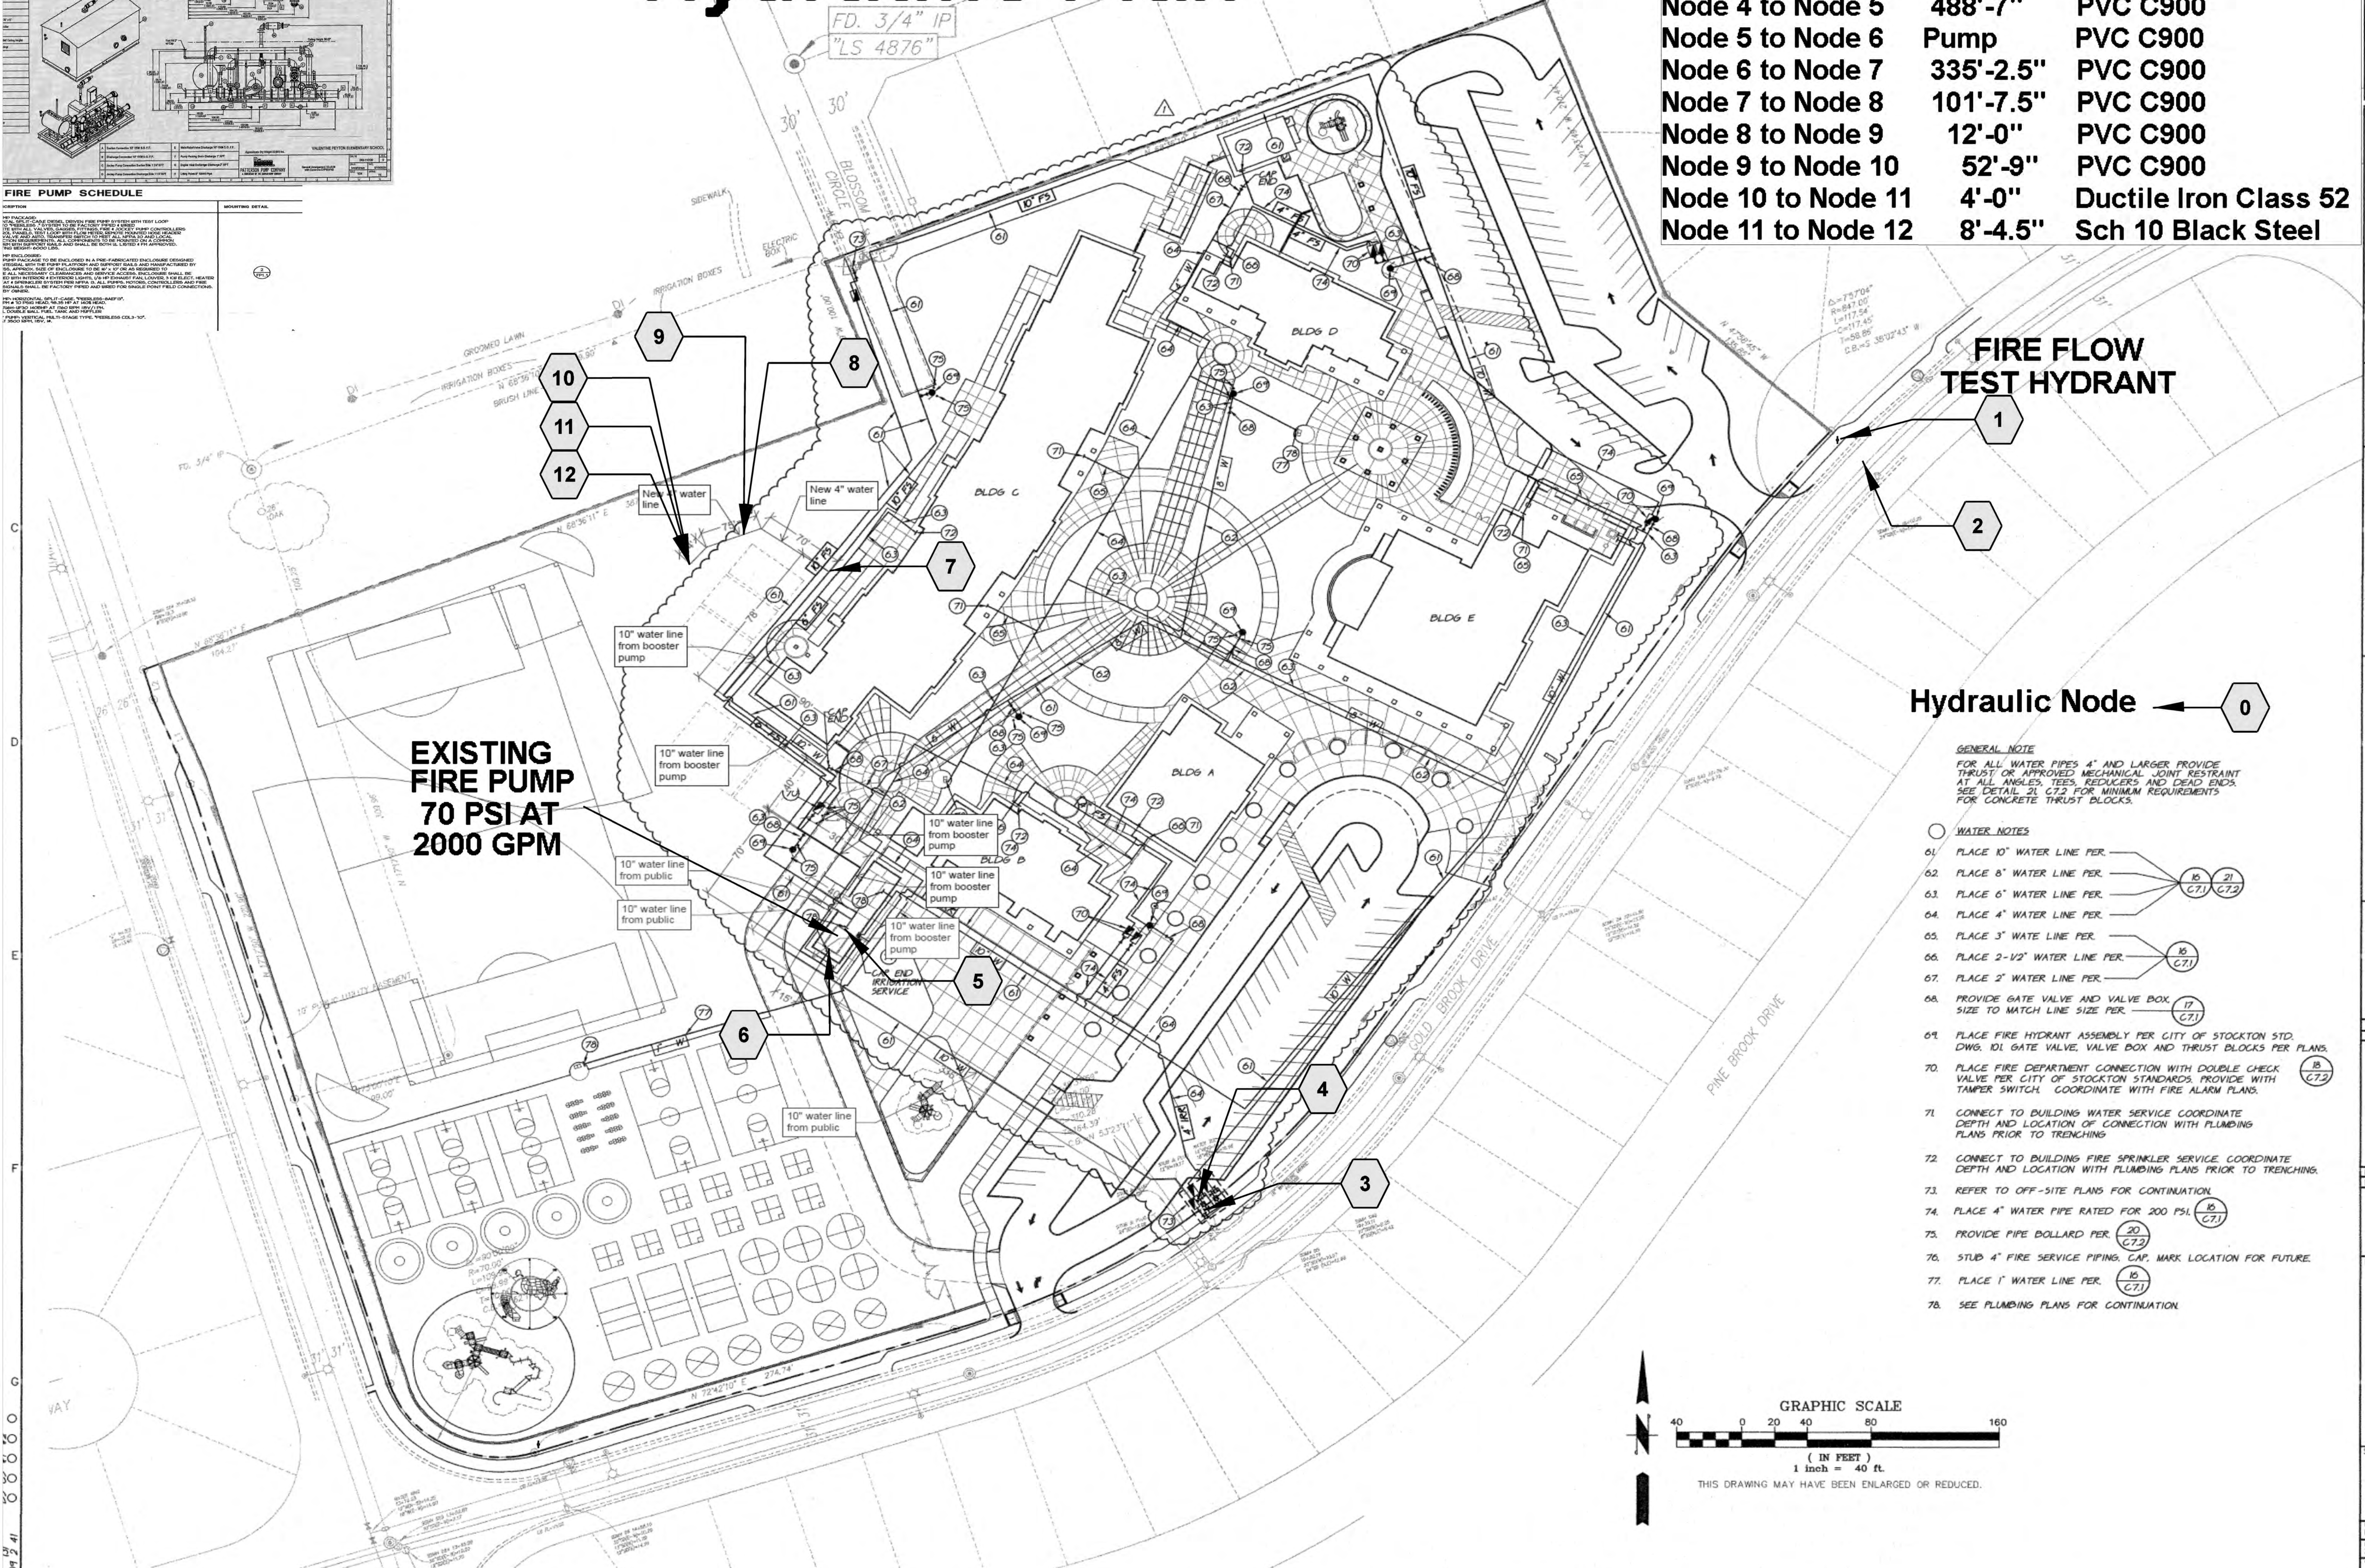


FIRE FLOW TEST HYDRANT

EXISTING FIRE PUMP
70 PSI AT
2000 GPM

Hydraulic Node 0

- GENERAL NOTE
FOR ALL WATER PIPES 4" AND LARGER PROVIDE THRUST OR APPROVED MECHANICAL JOINT RESTRAINT AT ALL ANGLES, TEES, REDUCERS AND DEAD ENDS. SEE DETAIL 21 C7.2 FOR MINIMUM REQUIREMENTS FOR CONCRETE THRUST BLOCKS.
- WATER NOTES
- 01. PLACE 10" WATER LINE PER.
 - 02. PLACE 8" WATER LINE PER.
 - 03. PLACE 6" WATER LINE PER.
 - 04. PLACE 4" WATER LINE PER.
 - 05. PLACE 3" WATER LINE PER.
 - 06. PLACE 2-1/2" WATER LINE PER.
 - 07. PLACE 2" WATER LINE PER.
 - 08. PROVIDE GATE VALVE AND VALVE BOX SIZE TO MATCH LINE SIZE PER.
 - 09. PLACE FIRE HYDRANT ASSEMBLY PER CITY OF STOCKTON STD. DWG. 101. GATE VALVE, VALVE BOX AND THRUST BLOCKS PER PLANS.
 - 10. PLACE FIRE DEPARTMENT CONNECTION WITH DOUBLE CHECK VALVE PER CITY OF STOCKTON STANDARDS. PROVIDE WITH TAMPER SWITCH. COORDINATE WITH FIRE ALARM PLANS.
 - 11. CONNECT TO BUILDING WATER SERVICE COORDINATE DEPTH AND LOCATION OF CONNECTION WITH PLUMBING PLANS PRIOR TO TRENCHING.
 - 12. CONNECT TO BUILDING FIRE SPRINKLER SERVICE. COORDINATE DEPTH AND LOCATION WITH PLUMBING PLANS PRIOR TO TRENCHING.
 - 13. REFER TO OFF-SITE PLANS FOR CONTINUATION.
 - 14. PLACE 4" WATER PIPE RATED FOR 200 PSI.
 - 15. PROVIDE PIPE BOLLARD PER.
 - 16. STUD 4" FIRE SERVICE PIPING. CAP, MARK LOCATION FOR FUTURE.
 - 17. PLACE 1" WATER LINE PER.
 - 18. SEE PLUMBING PLANS FOR CONTINUATION.

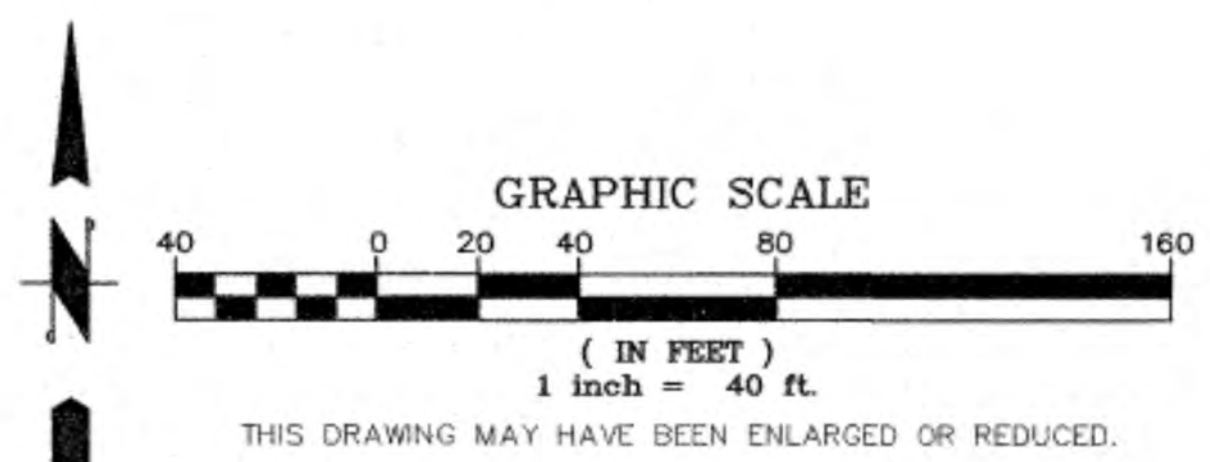

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP. 02-122690 INC.
REVIEWED FOR
SS [] FLS [] ACS []
DATE: 11/26/2024

SCHOOLHOUSE
MANUFACTURING
ARCHITECT STAMP:

ENGINEER STAMP:

CONSULTANT:
So Cal Fire Inc.
14102 Holt Avenue
North Tustin, CA 92705
714 368 0230
C-16 # 898658
CONSULTANT STAMP:
PROJECT NAME:

Peyton E S
2525 Gold Brook Drive
Stockton, CA 95212

ISSUE DATES: DATE:
DESCRIPTION: FSP 7-29-2024

DRAWN BY: J. E. Max
CHECKED BY:

SHEET TITLE:
Hydraulic Plan
SHEET NUMBER:
FP-3.1